


COMMERCIAL HEAT PUMP PIPING DETAIL (RAYPAK) – FOR REFERENCE ONLY
NOT TO SCALE

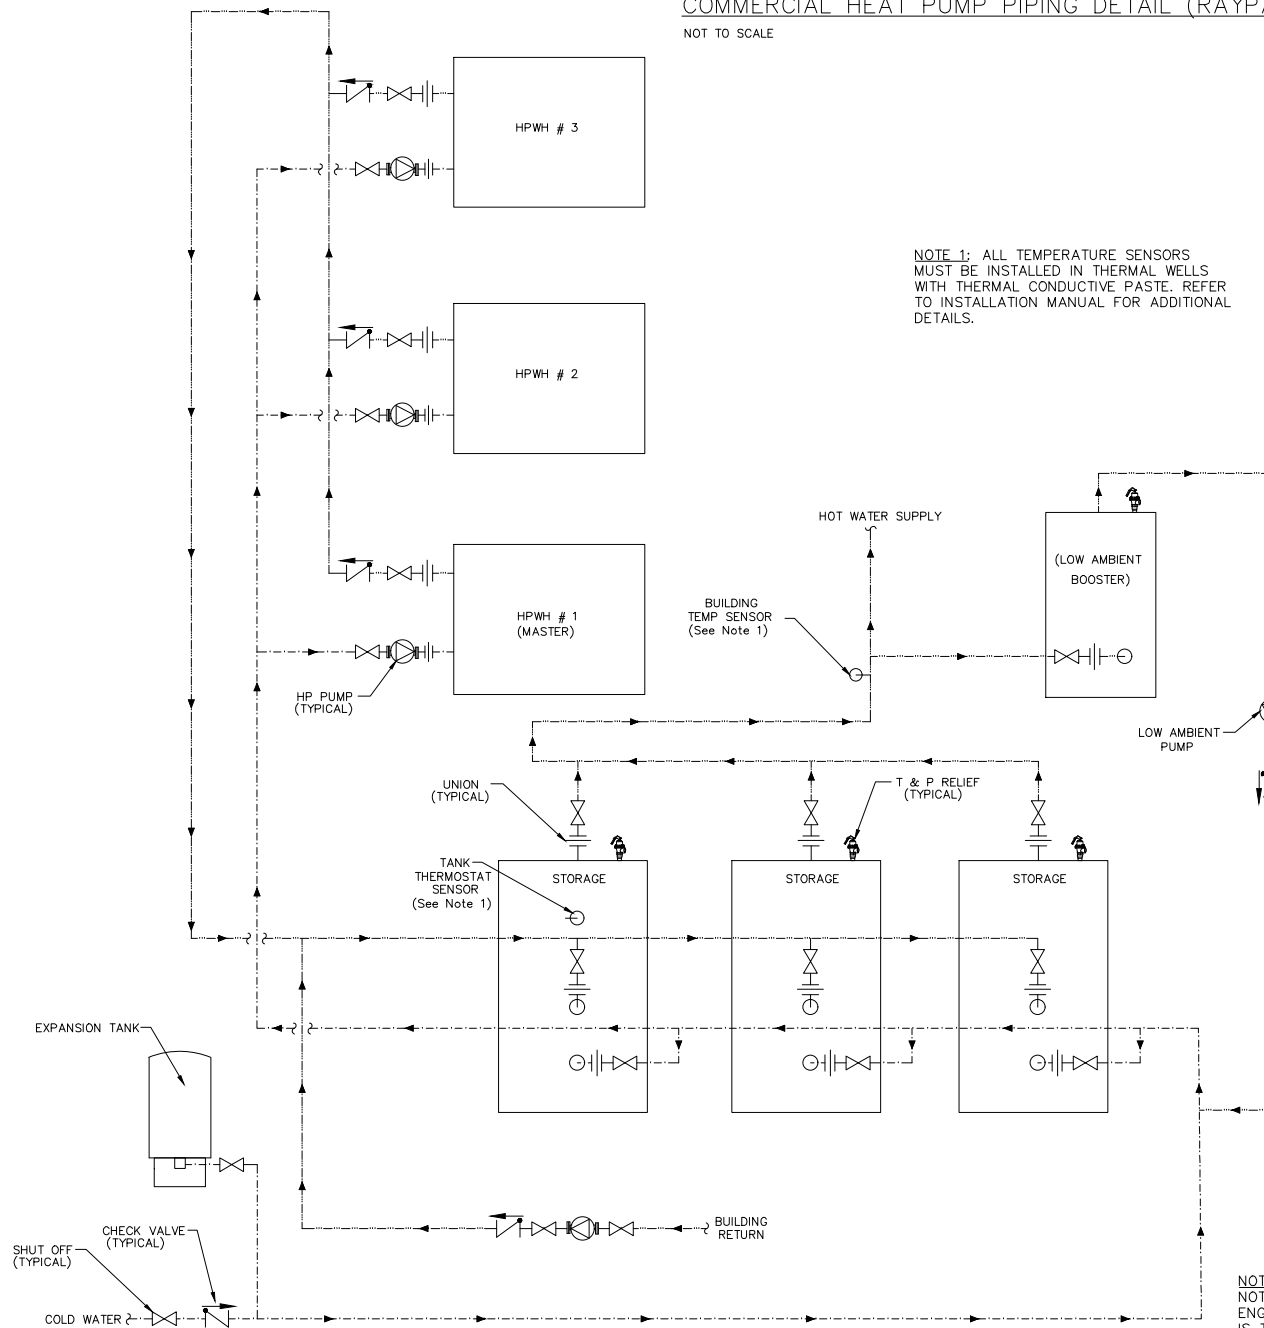

NOTE 1: ALL TEMPERATURE SENSORS
MUST BE INSTALLED IN THERMAL WELLS
WITH THERMAL CONDUCTIVE PASTE. REFER
TO INSTALLATION MANUAL FOR ADDITIONAL
DETAILS.

NOTICE: THIS DRAWING IS FOR REFERENCE ONLY AND SHALL
NOT BE USED AS AN ALTERNATIVE TO A PROFESSIONAL
ENGINEERED PROJECT DRAWING. ANY USE OF THIS DRAWING
IS THE RESPONSIBILITY OF THE PARTY USING IT. REFER
TO LOCAL CODES OR BUILDING OFFICIALS PRIOR TO
INSTALLATION.