


- NOTES:
1. PLACEMENT ON A LEVEL SURFACE FREE OF OBSTRUCTIONS (INCLUDING SNOW, FOR WINTER OPERATION) OR AIR RECIRCULATION ENSURES RATED PERFORMANCE; RELIABLE OPERATION AND EASE OF MAINTENANCE. SITE RESTRICTIONS MAY COMPROMISE MINIMUM CLEARANCES INDICATED BELOW, RESULTING IN UNPREDICTABLE AIR FLOW PATTERNS AND POSSIBLE DIMINISHED PERFORMANCE. YORK'S UNIT CONTROLS WILL OPTIMIZE OPERATION WITHOUT NUISANCE HIGH PRESSURE SAFETY CUTOUT; HOWEVER, THE SYSTEM DESIGNER MUST CONSIDER POTENTIAL PERFORMANCE DEGRADATION. ACCESS TO THE UNIT CONTROL CENTER ASSUMES THE UNIT IS NO HIGHER THAN ON SPRING ISOLATORS. RECOMMENDED MINIMUM CLEARANCES: SIDE TO WALL - 6"; REAR TO WALL - 6"; CONTROL PANEL END TO WALL - 6"; TOP - NO OBSTRUCTIONS ALLOWED; DISTANCE BETWEEN ADJACENT UNITS - 6" NO MORE THAN ONE ADJACENT WALL MAY BE HIGHER THAN THE UNIT.
  2. WEIGHTS (LB): SHIPPING - 2900 , OPERATING - 2973

MODEL	T.R.	VOLTAGE	REFRIGERANT
YCLA600A25E	50	230 / 3 / 60	R-507
YCLA600A46E	50	460 / 3 / 60	R-507

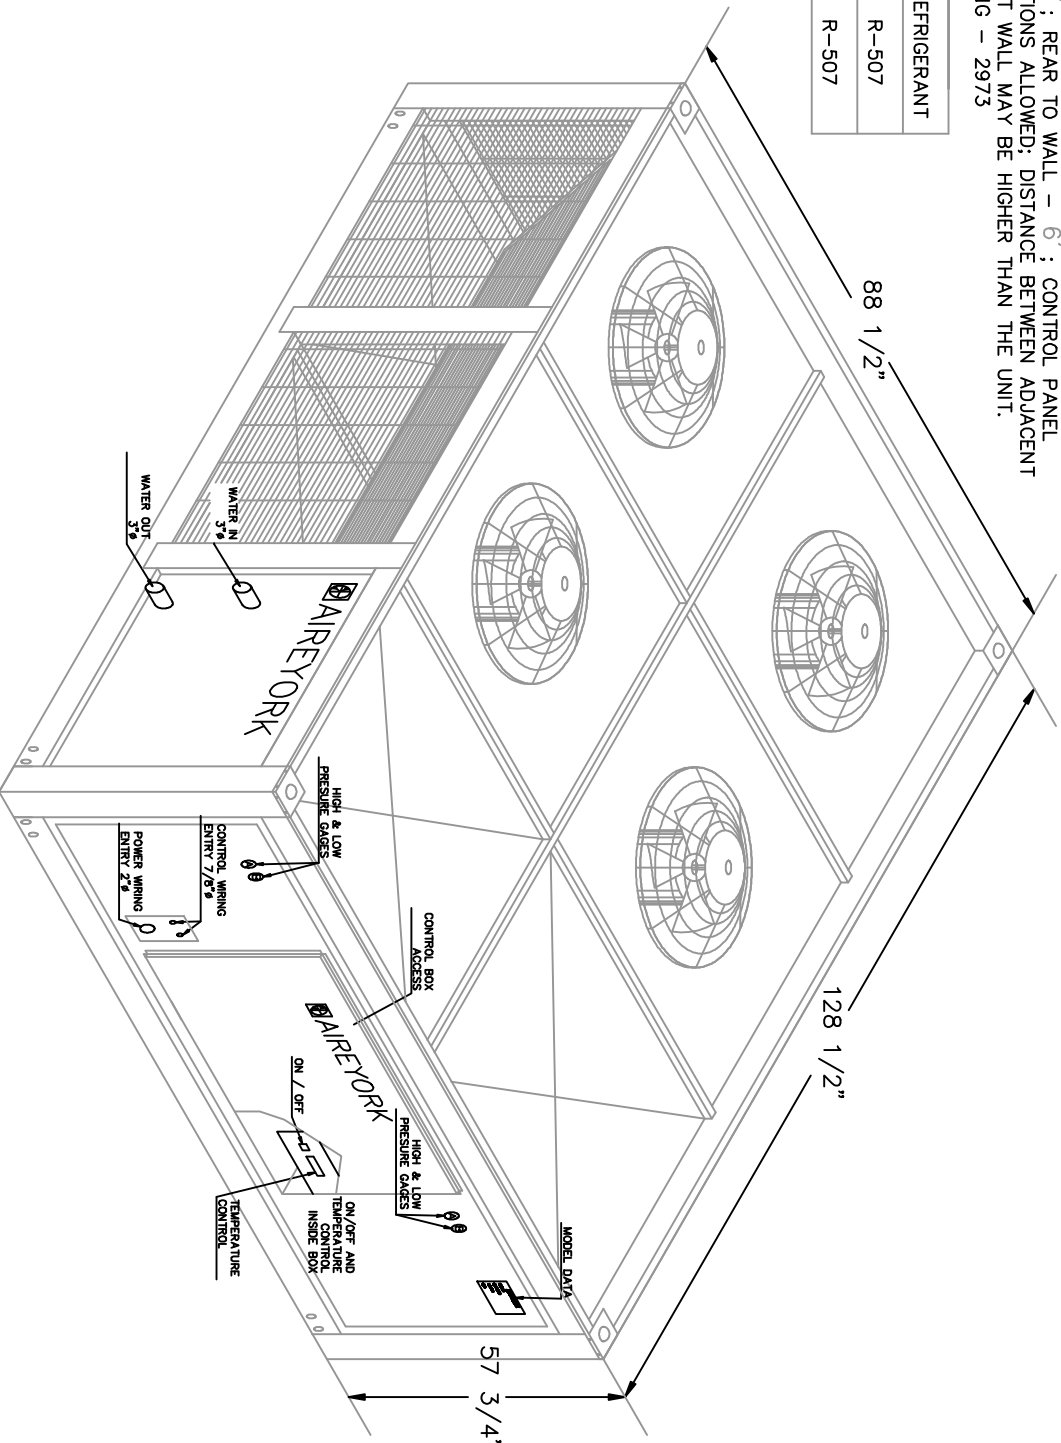

# PRODUCT DRAWING

AIR-COOLED SCROLL CHILLER SYSTEM  
 MODEL YCLA600A25E / A46E  
 NOT FOR CONSTRUCTION

Project Name:  
 Location:  
 Engineer: Mario Calleros  
 Contractor: AIREYORK  
 For: REFERENCE

Sold To:  
 Cust Purch Order#:  
 UNIT YORK Contract#:  
 TAG: UGA-01

Date:  
 Rev. Date:  
 Form: 190.54-E1S  
 Dwg. Lev.: 08/04  
 Dwg. Scale : NTS



Copyright (c) Aireyork S.A. de C.V.