

RIDGEWOOD BOARD OF EDUCATION

RIDGE ELEMENTARY SCHOOL

325 W. Ridgewood Avenue Ridgewood NJ 07450

**LOCAL GOVERNMENT ENERGY AUDIT PROGRAM
FOR
NEW JERSEY
BOARD OF PUBLIC UTILITIES**

July 2015

Prepared by:



6 Campus Drive
Parsippany, NJ 07054
(973) 538-2120

CHA PROJECT NO. 30237

TABLE OF CONTENTS

1.0 EXECUTIVE SUMMARY	1
2.0 BUILDING INFORMATION AND EXISTING CONDITIONS	4
3.0 UTILITIES	8
4.0 BENCHMARKING.....	12
5.0 ENERGY CONSERVATION MEASURES.....	13
5.1 ECM-1 Replace single pane windows with double pane windows.....	14
5.2 ECM-2 Replace old RTUs with high efficiency RTUs	14
5.3 ECM-3 Replace pneumatic control system with a DDC system	14
5.4 ECM-4 Install window ac unit controllers	15
5.5.1 ECM-L1 Lighting Replacement / Upgrades	15
5.5.2 ECM-L2 Install Lighting Controls (Occupancy Sensors)	16
5.5.3 ECM-L3 Lighting Replacements with Controls (Occupancy Sensors)	17
5.6 Additional O&M Opportunities.....	17
6.0 PROJECT INCENTIVES.....	18
6.1 Incentives Overview.....	18
6.1.1 New Jersey Smart Start Program.....	18
6.1.2 Direct Install Program.....	18
6.1.3 New Jersey Pay For Performance Program (P4P).....	19
6.1.4 Energy Savings Improvement Plan	20
6.1.5 Renewable Energy Incentive Program.....	21
7.0 ALTERNATIVE ENERGY SCREENING EVALUATION	22
7.1 Solar	22
7.1.1 Photovoltaic Rooftop Solar Power Generation	22
7.1.2 Solar Thermal Hot Water Generation.....	22
7.2 Wind Powered Turbines	22
7.3 Combined Heat and Power Plant.....	23
7.4 Demand Response Curtailment	24
8.0 CONCLUSIONS & RECOMMENDATIONS.....	25

APPENDICES

- A Utility Usage Analysis and List of Third Party Energy Suppliers
- B Equipment Inventory
- C ECM Calculations and Cost Estimates
- D New Jersey BPU Incentive Programs
 - i. Smart Start
 - ii. Direct Install
 - iii. Pay For Performance Incentive Program (P4P)
 - iv. Energy Savings Improvement Plan (ESIP)
- E Photovoltaic (PV) Solar Power Generation Analysis
- F Photos
- G EPA Benchmarking Report

REPORT DISCLAIMER

This audit was conducted in accordance with the standards developed by the American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE) for a Level II audit. Cost and savings calculations for a given measure were estimated to within $\pm 20\%$, and are based on data obtained from the owner, data obtained during site observations, professional experience, historical data, and standard engineering practice. Cost data does not include soft costs such as engineering fees, legal fees, project management fees, financing, etc.

A thorough walkthrough of the building was performed, which included gathering nameplate information and operating parameters for all accessible equipment and lighting systems. Unless otherwise stated, model, efficiency, and capacity information included in this report were collected directly from equipment nameplates and /or from documentation provided by the owner during the site visit. Typical operation and scheduling information was obtained from interviewing staff and spot measurements taken in the field.

List of Common Energy Audit Abbreviations

- A/C – Air Conditioning
- AHS – Air Handling Unit
- BMS – Building Management System
- Btu – British thermal unit
- CDW – Condenser Water
- CFM – Cubic feet per minute
- CHW – Chilled Water
- DCV – Demand Control Ventilation
- DDC – Direct Digital Control
- DHW – Domestic Hot Water
- DX – Direct Expansion
- EER – Energy Efficiency Ratio
- EF – Exhaust Fan
- EUI – Energy Use Intensity
- Gal – Gallon
- GPD – Gallons per day
- GPF – Gallons Per Flush
- GPH – Gallons per hour
- GPM – Gallons per minute
- GPS – Gallons per second
- HHW – Heating Hot Water
- HID – High Intensity Discharge
- HP – Horsepower
- HRU – Heat Recovery Unit
- HVAC – Heating, Ventilation, Air Conditioning
- HX – Heat Exchanger
- kbtu/mbtu – One thousand (1,000) Btu
- kW – Kilowatt (1,000 watts)
- kWh – Kilowatt-hours
- LED – Light Emitting Diode
- mbh – Thousand Btu per hour
- mmbtu – One million (1,000,000) Btu
- OCC – Occupancy Sensor
- PSI – Pounds per square inch
- RTU – Rooftop Unit
- SBC – System Benefits Charge
- SF – Square foot
- UH – Unit Heater
- V – Volts
- VAV – Variable Air Volume
- VSD – Variable Speed Drive
- W – Watt

1.0 EXECUTIVE SUMMARY

This report summarizes the energy audit performed by CHA for Ridgewood Board Of Education in connection with the New Jersey Board of Public Utilities (NJBPU) Local Government Energy Audit (LGEA) Program. The purpose of this report is to identify energy savings opportunities associated with major energy consumers and inefficient practices. Low-cost and no-cost are also identified during the study. This report details the results of the energy audit conducted for the building listed below:

Building Name	Address	Square Feet	Construction Date
Ridge Elementary School	325 W. Ridgewood Avenue Ridgewood NJ 07450	53,654	1959

The potential total annual energy and cost savings for the recommended energy conservation measures (ECM) identified in the survey are shown below:

Building Name	Electric Savings (kWh)	NG Savings (therms)	Total Savings (\$)	Payback (years)
Ridge Elementary School	38,159	0	6,029	12.2

Each individual measure's annual savings are dependent on that measure alone, there are no interactive effects calculated. There are three options shown for Lighting ECM savings; only one option can be chosen. Incentives shown (if any) are based only on the SmartStart Incentive Program. Other NJBPU or local utility incentives may also be available/ applicable and are discussed in Section 6.0.

Each measure recommended by CHA typically has a stand-alone simple payback period of 15 years or less. However, if the owner chooses to pursue an Energy Savings Improvement Plan (ESIP), high payback measures could be bundled with lower payback measures which ultimately can result in a payback which is favorable for an ESIP project to proceed. Occasionally, we will recommend an ECM that has a longer payback period, based on the need to replace that piece(s) of equipment due to its age, such as a boiler for example.

The following table provides a detailed summary of each ECM for the building surveyed, including costs, savings, SmartStart incentives and payback.

Summary of Energy Conservation Measures

ECM #	Energy Conservation Measure	Est. Costs (\$)	Est. Savings (\$/year)	Payback w/o Incentive	Potential Incentive (\$)*	Payback w/ Incentive	Recommended
ECM-1	Replace single pane windows with double pane windows	753,500	3,983	189.2	0	189.2	N
ECM-2	Replace RTUs with high efficiency RTUs	72,700	2,252	32.3	2,316	31.3	N
ECM-3	Replace pneumatic control system with DDC control system	214,799	3,055	70.3	0	70.3	N
ECM-4	Install window AC unit controller	6,200	991	6.3	0	6.3	Y
ECM-L1**	Lighting Replacement / Upgrade	62,825	4,542	13.8	2,785	13.2	N
ECM-L2**	Install Lighting Controls (Add Occupancy Sensors)	4,745	569	8.3	740	7.0	N
ECM-L3	Lighting Replacements with Controls (Occupancy Sensors)	67,570	5,038	13.4	3,525	12.7	Y
Total**		1,114,769	15,319	72.8	5,841	72.4	
Total(Recommended)		73,770	6,029	12.2	3,525	11.7	

* Incentive shown is per the New Jersey SmartStart Program.


** These ECMs are not included in the Total, as they are alternate measures not recommended.

By implementing the recommended ECMs, the building could result in a total of 16 metric tons of greenhouse gas (GHG) reduction.

The building has an existing 75 KW capacity solar photovoltaic (PV) system.

If Ridgewood Board Of Education implements the recommended ECMs, energy savings would be as follows:

	Existing Conditions	Post Recommended ECMs	Percent Savings
Costs (\$)	84,861	78,832	7%
Electricity (kWh)	357,633	319,474	11%
Natural Gas (therms)	29,696	29,696	0%
Site EUI (kbtu/SF/Yr)	78.1	75.7	

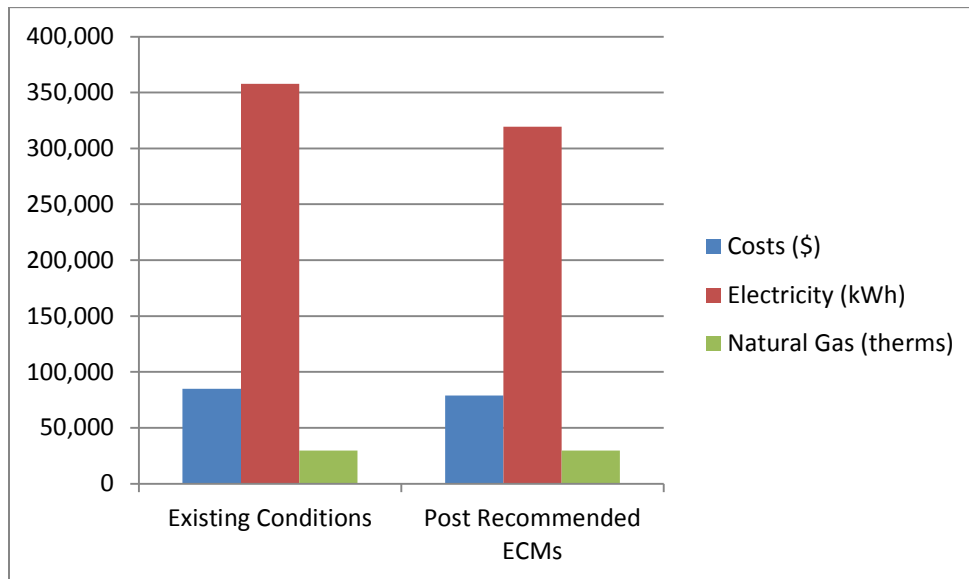

2.0 BUILDING INFORMATION AND EXISTING CONDITIONS

The following is a summary of building information related to HVAC, plumbing, building envelope, lighting, kitchen equipment and domestic hot water systems as observed during CHAs site visit. See Appendix B for detailed information on mechanical equipment, including capacities, model numbers and age. See Appendix F for representative photos of some of the existing conditions observed while onsite.

Building Name: Ridge Elementary School

Address: 325 W. Ridgewood Avenue Ridgewood NJ 07450

Gross Floor Area: 53,654 square feet

Number of Floors: Single Story

Year Built: 1959



General

Description of Spaces: The building is used as an elementary school and has classrooms, multi-purpose room, gymnasium, computer room, library, faculty room, office rooms, nurse's office, restrooms, furnace room and mechanical room.

Description of Occupancy: The facility has 500 students and 70 school faculty and staff members. Normal operating hours for the school are from 8:30AM to 3:30PM.

Number of Computers: The building has approximately 80 desktop and laptop computers.

Construction Materials: Concrete masonry unit (CMU) and brick façade.

Roof: The building has flat roofs with white rubber membrane waterproofing and believed to be well insulated. The roofs are in good condition and no ECMs associated with roofs have been evaluated.

Windows: The windows in the original building are single pane aluminum framed windows and are in fair condition. Windows in the additions are double pane and are in good condition. An ECM associated with window replacement of the single pane windows has been evaluated.

Exterior Doors: Exterior doors throughout the school are steel doors with double pane safety glass and are in good condition. Sweeps on exterior doors were observed to be in good condition. No ECMs associated with exterior doors have been evaluated.

Heating Ventilation & Air Conditioning (HVAC) Systems

Heating: The original building is heated by a hot air furnace that was installed in 1959 with a natural gas furnace. The natural gas furnace was replaced in 2003 with a 3750 MBH input capacity natural gas burner manufactured by John Zink Company. Warm air is distributed to all the spaces by a network of underground masonry ductwork. The maintenance staff stated that they do not have any issues with the heating system. The gas furnace is 12 years old and appears to be in good condition. No ECM related to the heating system has been evaluated.

The additions to the original building are heated by gas furnaces of five rooftop units. Warm conditioned air is supplied through a network of sheet metal ductwork and air outlets. .

Cooling: The additions to the original building are cooled by five rooftop units and four ductless split units. Three of the rooftop units, installed in 1999, are manufactured by Trane and serve classrooms 41 thru 49. The units are past their useful life. The other two rooftop units, installed in 2010, are manufactured by Aaon and serve classrooms 52 thru 57 and the multi-purpose room. The Aaon units are in good condition. The four ductless split units, installed in 2010, serve classroom 58, IDF closet, computer room 15 and a closet in the Principal's office. All the split units are in good condition. There are window air conditioners installed in classrooms. The window air conditioners appear to be in good condition. An ECM related to replacing older rooftop units with new efficient units has been evaluated.

Ventilation: The hot air furnace takes in outside air for ventilation through a ducted connection to an outside air intake louver with a control damper. The rooftop units are equipped with integral outside air intakes and control damper. As ventilation rates are assumed to be minimum, there are no ECMs associated with the ventilation system.

Exhaust: This building has multiple fractional HP exhaust fans serving restrooms and general exhaust all located on the roof. The fans are enclosed and therefore the capacities of fan motors are unknown, however, the exhaust fan covers appear to be in good condition. Therefore, no ECM related to the exhaust system has been evaluated.

Controls Systems

The heating system is controlled by a pneumatic control system. Compressed air to the pneumatic control devices is provided by an Ingersoll Rand compressor air system with two compressors. Rooftop units are provided with programmable thermostats. The control system is remotely monitored and controlled by Energy for America. The school provided a copy of the Energy for America operation manual that showed the set points for the cooling and heating systems. Cooling occupied set points are between 74°F and 78°F and unoccupied cooling set

point is set at 85°F. The heating occupied set points are between 68°F and 72°F and unoccupied heating set point is set at 55°F.

Although the existing pneumatic control system is in good working condition and provides basic day/night functions, the School District should consider replacing the existing pneumatic control system with a Direct Digital Control (DDC) system. The advantages of this type of system include individual unit controllability and scheduling, trending of set points and alarm notifications for malfunctioning devices. Front end graphics available in a DDC system enable the maintenance staff to see the functioning of all systems at one location and provide service to trouble spots quickly and efficiently. Web based control systems allow access and adjustment from remote locations. An ECM related to replacing the pneumatic system with a DDC system has been evaluated.

The ductless split units are provided with manufacturer supplied thermostats. Window air conditioners are provided with integral thermostats. To improve energy savings an ECM related to installing window air conditioner controllers has been evaluated.

Domestic Hot Water Systems

This building has two domestic water heaters. A Rheem gas fired DHW heater located in the furnace room provides domestic hot water to spaces in the original building. The water heater was installed in 2010, has an input capacity of 36 MBH and a 50 gallon storage capacity. Domestic hot water is circulated by a fractional HP pump. The additions are served by an A O Smith gas fired condensing water heater installed in 2012 in a mechanical room. The heater has an input rating of 100 MBH, 116.36 GPH recovery rate, and a nameplate efficiency of 96%. Domestic hot water is circulated by a fractional HP pump. Both the water heaters and associated circulating pumps are in good condition therefore, no ECM associated with DHW system has been evaluated.

Kitchen Equipment

There is no kitchen in the building.

Plug Load

This building has computers, residential appliances (microwave, refrigerator), and printers which contribute to the plug load in the building. We have calculated the plug load to have minimal impact compared to other electric consuming devices hence, no ECMs associated with plug load have been evaluated. However, replacing the appliances with Energy Star rated appliances when the old ones reach the end of its useful life span is included as an O&M.

Plumbing Systems

The urinals and toilets appear to be high flow plumbing fixtures. The sink faucets do not appear to have low-flow type aerators. A recommendation has been included in the O&M section to install low-flow plumbing fixtures and aerators when replacement is needed.

Lighting Systems

The building has a mixture of 32W T-8 fluorescent lighting and CFLs lights. The majority of lighting fixtures are T-8 fluorescent U-shape and linear fixtures. The gymnasium is provided with 12 mercury vapor lights each of 250 watts. Exterior lights are wall mounted metal halides and incandescent lights fixtures and are controlled by time clock. All light fixtures in the building are manually controlled by switches. It is recommended to replace the manual switches with occupancy sensors. We have provided three alternatives for lighting that include adding occupancy sensors to the existing lights, replacing the lights with LED lights and a third ECM that evaluates adding occupancy sensors to the proposed LED lights.

3.0 UTILITIES

Natural gas, electricity and water are separately metered into this building. Utilities used by the building are delivered and supplied by the following utility companies:

	Electric	Natural Gas	Water
Deliverer	PSE&G	PSE&G	Ridgewood Water
Supplier	Direct Energy	Direct Energy/ South Jersey Energy/ PSE&G	N/A

For the 15-month period ending in March 2015, the utilities usages and costs for the building were as follows:


Electric		
Annual Usage	357,633	kWh/yr
Annual Cost	56,555	\$
Blended Rate	0.158	\$/kWh
Natural Gas		
Annual Usage	29,696	Therms/yr
Annual Cost	25,418	\$
Rate	0.86	\$/therm
Water		
Annual Usage	516,000	Gallons
Annual Cost	2,888	\$
Rate	0.006	\$/Gallon

Blended Rate: Average rate charged determined by the annual cost / annual usage


Supply Rate: Actual rate charged for electricity usage in kWh (based on most recent electric bill)

Demand Rate: Rate charged for actual electrical demand in kW (based on most recent electric bill)

*Some months that do not have utility data and the missing demand usage are estimated and highlighted in the utility spreadsheet

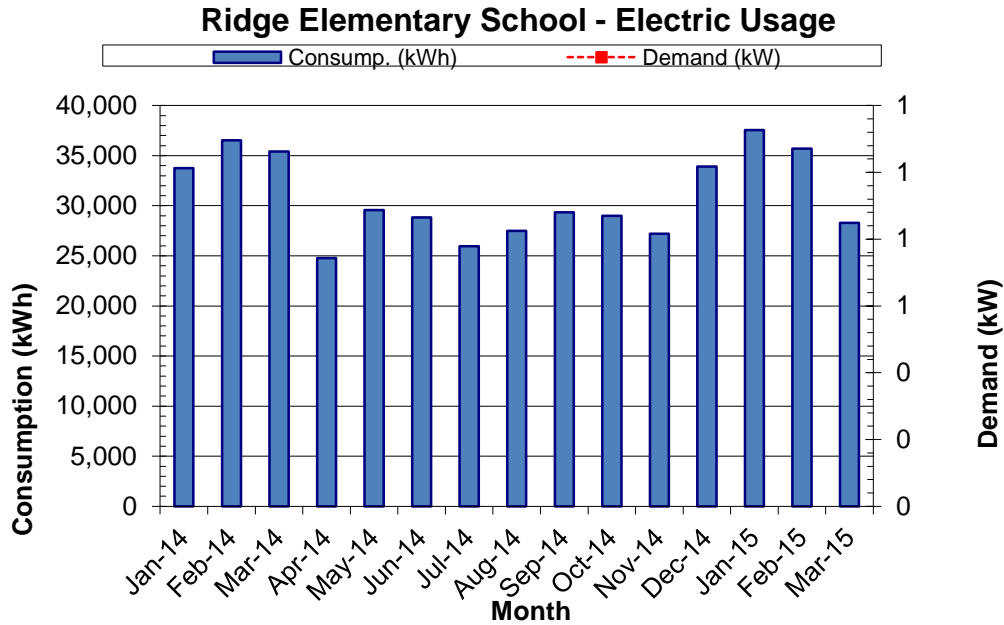

The major electric consuming loads are lighting and rooftop units. The usage varies with the usage of the building and weather conditions.

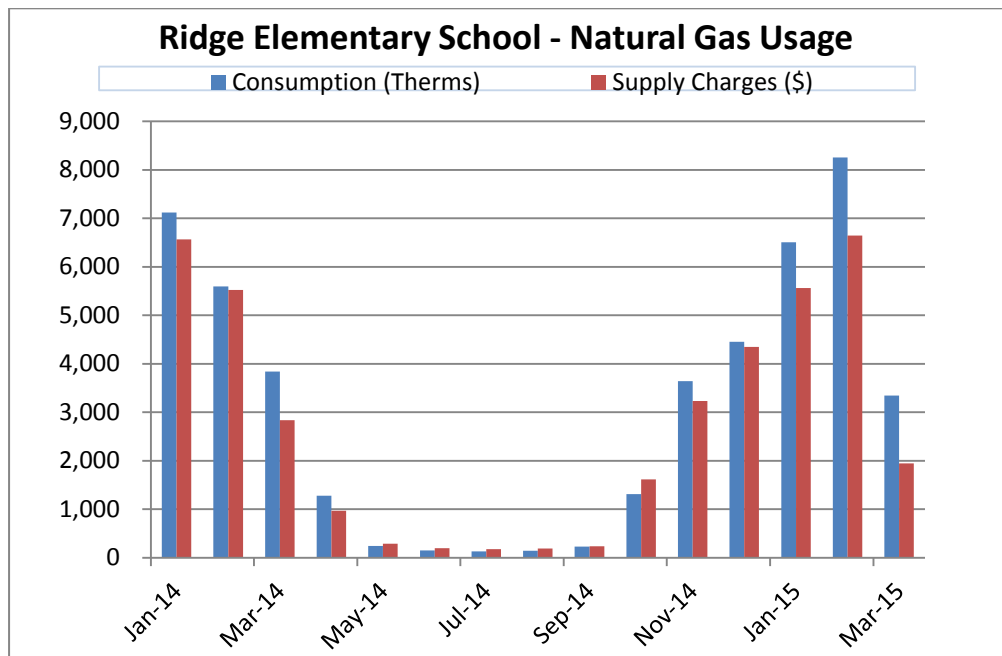

The natural gas usage in this building is for heating (boilers and gas furnaces of rooftop units) and DHW heaters, and therefore the usage in summer months is relatively small compared with heating months. The gas usage during the heating season is correlated to winter weather conditions.

See Appendix A for utility analysis.

Under New Jersey's energy deregulation law, the supply portion of the electric (or natural gas) bill is separated from the delivery portion. The supply portion is open to competition, and customers can shop around for the best price for their energy suppliers. The electric and natural gas distribution utilities will still deliver the gas/ electric supplies through their wires and pipes – and respond to emergencies, should they arise – regardless of where those supplies are purchased. Purchasing the energy supplies from a company other than your electric or gas utility is purely an economic decision; it has no impact on the reliability or safety of the service.

Comparison of Utility Rates to NJ State Average Rates*				Recommended to Shop for Third Party Supplier?
Utility	Units	School Average Rate	NJ Average Rate	
Electricity	\$/kWh	\$0.158	\$0.13	Y
Natural Gas	\$/Therm	\$0.86	\$0.96	N

* Per U.S. Energy Information Administration (2013 data – Electricity and Natural Gas, 2012 data – Fuel Oil)


Additional information on selecting a third party energy supplier is available here:

<http://www.state.nj.us/bpu/commercial/shopping.html>.

See Appendix A for a list of third-party energy suppliers licensed by the Board of Public Utilities to sell within the building's service area.



The charts below represent estimated utility end-use utility profiles for the building. The values used within the charts were estimated from a review of the utility analysis and the energy savings calculations.

Site End-Use Utility Profile

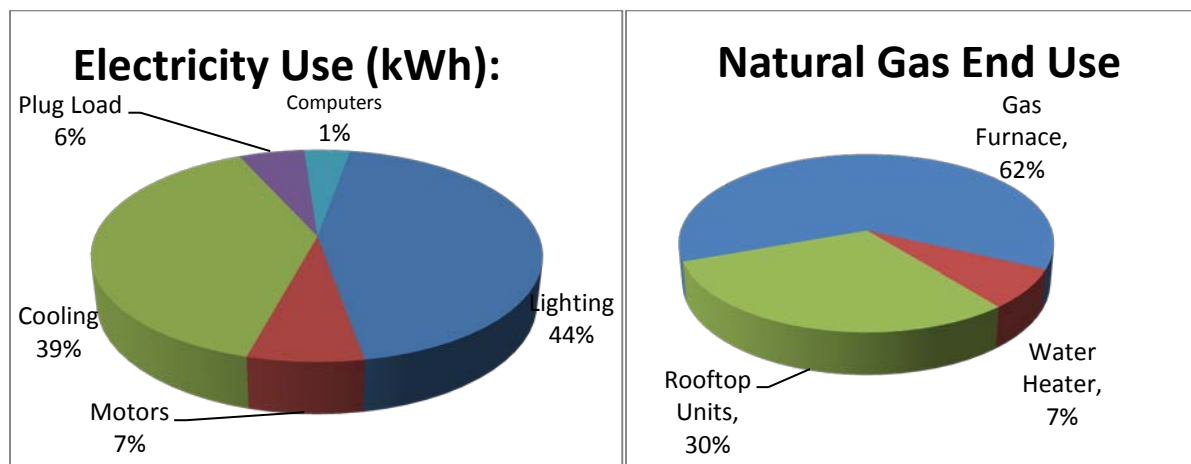

Most of the electricity consumed by educational facilities is used to for lighting, cooling, and plug loads such as computers and copiers; most of the natural gas is used for space heating. Each school's energy profile is different, and the following charts represent typical utility profiles for K-12 schools per U.S. Department of Energy.

Typical End-Use Utility Profile for Educational Facilities

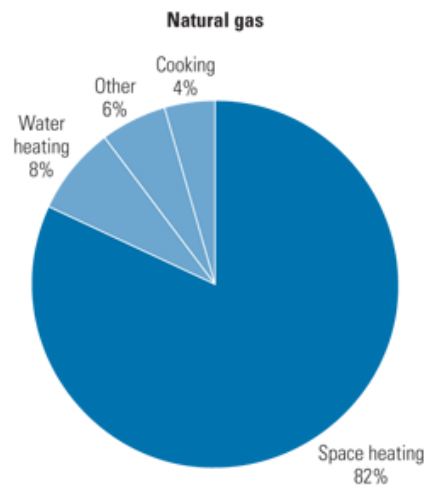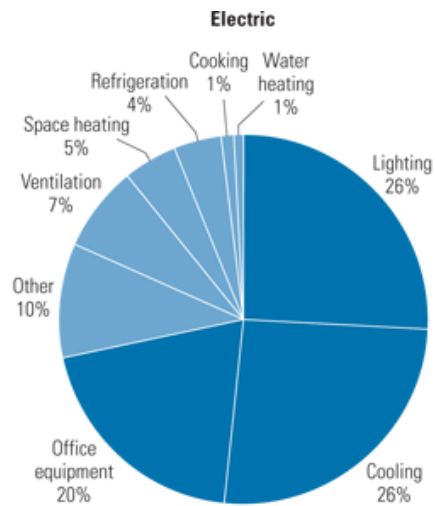

Courtesy: E source; from Commercial Building Energy Consumption Survey, 1999 data

4.0 BENCHMARKING

The EPA Portfolio Manager benchmarking tool provides a site and source Energy Use Intensity (EUI), as well as an Energy Star performance rating for qualifying building types. The EUIs are provided in kBtu/ft²/year, and the performance rating represents how energy efficient a building is on a scale of 1 to 100, with 100 being the most efficient. In order for a building to receive an Energy Star label, the energy benchmark rating must be at least 75. As energy use decreases from implementation of the proposed measures, the Energy Star rating will increase. However, the EPA does not have score for all types of buildings. The buildings that do not have energy rating now are compared with national median EUI.

The site EUI is the amount of heat and electricity consumed by a building as reflected in utility bills. Site energy may be delivered to a facility in the form of primary energy, which is raw fuel burned to create heat or electricity, such as natural gas or oil; or as secondary energy, which is the product created from a raw fuel such as electricity or district steam. To provide an equitable comparison for different buildings with varying proportions of primary and secondary energy consumption, Portfolio Manager uses the convention of source EUIs. The source energy also accounts for losses incurred in production, storage, transmission, and delivery of energy to the site, which provide an equivalent measure for various types of buildings with differing energy sources. The results of the benchmarking are contained in the table below. Copies of the benchmarking report are available in Appendix G.

Site EUI kBtu/ft ² /yr	Source EUI (kBtu/ft ² /yr)	Energy Star Rating (1-100)
78.1	129.5	33

The school has a below average Energy Star Rating Score (50 being the median score), and as such by implementing the measures discussed in this report, it is expected that the EUI can be further reduced and the Energy Star Rating further increased.

EPA Portfolio Manager can be accessed with the following:

Username: RidgewoodBOE

Password: Energystar1

5.0 ENERGY CONSERVATION MEASURES

The following types of energy savings opportunities are identified in this section of the report:

- Energy conservation measures (ECMs) are energy savings recommendations that typically require a financial investment. For these areas of opportunity, CHA prepared detailed calculations, as summarized in this section and in Appendix C. In general, additional savings may exist from reductions in maintenance activities associated with new equipment or better controls; however for conservatism, maintenance savings are not accounted for in this report; instead the only savings which are reported are those derived directly from reductions in energy which can be tracked by the utility bills.
- Operational and Maintenance measures (O&M) consist of low- or no-cost operational opportunities, which if implemented would have positive impacts on overall building operation, comfort levels, and/or energy usage. There are no estimated savings, costs or paybacks associated with the O&M measures included as part of this study.

Energy savings were quantified in the form of:

- electrical usage (kWh=Kilowatt-hour),
- electrical demand (kW=kilowatts),
- natural gas (therms=100,000 Btu),
- propane gas (gallons=91,650 Btu),
- fuel oil (gallons =138,700 Btu), and
- water (kgal=1,000 gallons).

These recommendations are influenced by the time period that it takes for a proposed project to “break even” referred to as “Simple Payback”. Simple payback is calculated by dividing the estimated cost of implementing the ECM by the energy cost savings (in dollars) of that ECM.

Another financial indicator of the performance of a particular ECM is the Return on Investment or ROI, which represents the benefit (annual savings over the life of a project) of an investment divided by the cost of the investment. The result is expressed as a percentage or ratio.

Two other financial analyses included in this report are Internal Rate of Return (IRR) and Net Present Value (NPV). Internal Rate of Return is the discount rate at which the present value of a project costs equals the present value of the project savings. Net Present Value is the difference between present value of an investment’s future net cash flows and the initial investment. If the NPV equals “0”, the project would equate to investing the same amount of dollars at the desired rate. NPV is sometimes referred to as Net Present Worth. These values are provided in the Summary Tab in Appendix C.

5.1 ECM-1 Replace single pane windows with double pane windows

The building has old steel frame single pane windows which lead to large amount of the heating/cooling loss. Replacing the old windows with high heat resistance double pane windows will help reduce the energy loss and save energy.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-1 Replace single pane windows with double pane windows

Budgetary Cost	Annual Utility Savings				ROI	Potential Incentive*	Payback (without incentive)	Payback (with incentive)
	Electricity		Natural Gas	Total				
\$	kW	kWh	Therms	\$		\$	Years	Years
753,500	0	1,298	4,414	3,983	(0.9)	0	189.2	189.2

* Incentive shown, if available, is per the New Jersey SmartStart Program. See section 6.0 for other incentive opportunities.

This measure is not recommended due to the long payback period.

5.2 ECM-2 Replace old RTUs with high efficiency RTUs

The school has 5 rooftop units, three of which were installed in 1999 and two were installed in 2010. The three units installed in 1999 are past their useful life. This ECM evaluates the energy savings associated with replacing older less efficient rooftop units with modern high efficiency rooftop units of the same capacities. Calculations show savings in electric power consumption only as it is assumed that the gas furnaces will have the same efficiencies.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-2 Replace old RTUS with high efficiency RTUs

Budgetary Cost	Annual Utility Savings				ROI	Potential Incentive*	Payback (without incentive)	Payback (with incentive)
	Electricity		Natural Gas	Total				
\$	kW	kWh	Therms	\$		\$	Years	Years
72,700	8	14,251	0	2,252	(0.5)	2,316	32.3	31.3

* Incentive shown, if available, is per the New Jersey SmartStart Program. See section 6.0 for other incentive opportunities.

This measure is not recommended due to the long payback period.

5.3 ECM-3 Replace pneumatic control system with a DDC system

Although the existing pneumatic control system is in good working condition and provides basic day/night functions, the School District should consider replacing the existing pneumatic control system with a Direct Digital Control (DDC) system. The advantages of this type of system include individual unit controllability and scheduling,

trending of set points and alarm notifications for malfunctioning devices. Front end graphics available in a DDC system enable the maintenance staff to see the functioning of all systems at one location and provide service to trouble spots quickly and efficiently. Web based control systems allow access and adjustment from remote locations.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-3 Replace pneumatic control system with a DDC system

Budgetary Cost	Annual Utility Savings				ROI	Potential Incentive*	Payback (without incentive)	Payback (with incentive)
	Electricity		Natural Gas	Total				
\$	kW	kWh	Therms	\$		\$	Years	Years
214,799	0	7,592	2,167	3,055	(0.6)	0	70.3	70.3

* Does not qualify for Incentive from the New Jersey SmartStart Program. See section 6.0 for other incentive opportunities

This measure is not recommended due to the long payback period.

5.4 ECM-4 Install window ac unit controllers

There are 30 window air conditioners in the school. Most of the air conditioners are installed in the classrooms and are currently controlled manually by the occupants. Window air conditioners may not be turned off when the room is unoccupied. This ECM evaluates implementation of a digital timer device that will automatically turn the window A/C unit off at a preset time.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-4 Install window ac unit controllers

getary Cost	Annual Utility Savings				ROI	Potential Incentive*	Payback (without incentive)	Payback (with incentive)
	Electricity		Natural Gas	Total				
\$	kW	kWh	Therms	\$		\$	Years	Years
6,200	0	6,272	0	991	1.4	0	6.3	6.3

* Does not qualify for Incentive from the New Jersey SmartStart Program. See section 6.0 for other incentive opportunities

This measure is recommended.

5.5.1 ECM-L1 Lighting Replacement / Upgrades

The building has a mixture of 32W T-8 fluorescent lighting and CFLs lights. The majority of lighting fixtures are T-8 fluorescent U-shape and linear fixtures. The gymnasium is provided with 12 metal halide lights each of 400 watts and the multi-purpose room is provided with 12 mercury vapor lights each of 250 watts. Exterior lights are wall mounted metal halides and incandescent lights fixtures and are controlled by time clock.

All light fixtures in the building are manually controlled by switches. It is recommended to replace the manual switches with occupancy sensors. We have provided three alternatives for lighting that include adding occupancy sensors to the existing lights, replacing the lights with LED lights and a third ECM that evaluates adding occupancy sensors to the proposed LED lights.

Overall energy consumption can be reduced by replacing inefficient bulbs and linear fluorescent bulbs with more efficient LED technology. To compute the annual savings for this ECM, the energy consumption of the current lighting fixtures was established and compared to the proposed fixture power requirement with the same annual hours of operation. The difference between the existing and proposed annual energy consumption was the energy savings. These calculations are based on 1 to 1 replacements of the fixtures, and do not take into account lumen output requirements for a given space. A more comprehensive engineering study should be performed to determine correct lighting levels.

Supporting calculations, including assumptions for lighting hours and annual energy usage for each fixture, are provided in Appendix C and summarized below:

ECM-L1 Lighting Replacement / Upgrades

Budgetary Cost	Annual Utility Savings			ROI	Potential Incentive*	Payback (without incentive)	Payback (with incentive)
	Electricity		Natural Gas				
\$	kW	kWh	Therms	\$	\$	Years	Years
62,825	10	28,744	0	4,542	0.1	2,785	13.8
							13.2

* LED new fixtures are still qualified for prescribed incentives, however, LED retrofits must go through the custom incentive which is not calculated in LGEA study therefore, the potential incentive shown in the table is the possible prescribed incentive.

This measure is not recommended in lieu of ECM L3.

5.5.2 ECM-L2 Install Lighting Controls (Occupancy Sensors)

Presently, this building has a central lighting control system which turns off all the lights except safety lights at midnight and turn on the lights at 7:00AM. The timer system overrides the switches. Review of the comprehensive lighting survey determined that lighting in some areas could benefit from installation of occupancy sensors to turn off lights when they are unoccupied.

This measure recommends installing occupancy sensors for the current lighting system. Using a process similar to that utilized in Section ECM-L1, the energy savings for this measure was calculated by applying the known fixture wattages in the space to the estimated existing and proposed times of operation for each fixture.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-L2 Install Lighting Controls (Occupancy Sensors)

Budgetary Cost	Annual Utility Savings				ROI	Potential Incentive*	Payback (without incentive)	Payback (with incentive)
	Electricity		Natural Gas	Total				
\$	kW	kWh	Therms	\$		\$	Years	Years
4,745	0	3,599	620	569	0.8	740	8.3	7.0

* Incentive shown is per the New Jersey SmartStart Program. See section 6.0 for other incentive opportunities.

This measure is not recommended in lieu of ECM L3.

5.5.3 ECM-L3 Lighting Replacements with Controls (Occupancy Sensors)

This measure is a combination of ECM-L1 and ECM-L2; recommending replace/upgrade the current lighting fixtures to more efficient ones and installing occupancy sensors on the new lights. Interactive effects of the higher efficiency lights and occupancy sensors lead the energy and cost savings for this measure to not be cumulative or equivalent to the sum of replacing the lighting fixtures alone and installing occupancy sensors without the lighting upgrade. The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-L3 Lighting Replacements with Controls (Occupancy Sensors)

Budgetary Cost	Annual Utility Savings				ROI	Potential Incentive*	Payback (without incentive)	Payback (with incentive)
	Electricity		Natural Gas	Total				
\$	kW	kWh	Therms	\$		\$	Years	Years
67,570	11	31,887	0	5,038	0.1	3,525	13.4	12.7

* LED new fixtures are still qualified for prescribed incentives, however, LED retrofits must go through the custom incentive which is not calculated in LGEA study therefore, the potential incentive shown in the table is the possible prescribed incentive.

This measure is recommended.

5.6 Additional O&M Opportunities

This list of operations and maintenance (O&M) - type measures represent low-cost or no-cost opportunities, which if implemented will have a positive impact on the overall building operations, comfort and/or energy consumption. The recommended O&M measures for this building are as follows:

- Provide window air conditioner covers.
- Purchase ENERGY STAR® labeled electric and gas appliances
- Install low flow plumbing fixtures when needed.
- Train custodians to turn off lights and electric appliances when not used

6.0 PROJECT INCENTIVES

6.1 Incentives Overview

The following sections give detailed information on available incentive programs including New Jersey Smart Start, Direct Install, New Jersey Pay for Performance (P4P) and Energy Savings Improvement Plan (ESIP). If the School District wishes to and is eligible to participate in the Energy Savings Improvement Plan (ESIP) program and/or the Pay for Performance Incentive Program (P4P), it cannot participate in either the Smart Start or Direct Install Programs. Refer to Appendix D for more information on the Smart Start program.

6.1.1 New Jersey Smart Start Program

For this energy audit, The New Jersey Smart Start Incentives are used in the energy savings calculations, where applicable. This program is intended for medium and large energy users and provides incentives for:

- Electric Chillers
- Gas Chillers
- Gas Heating
- Unitary HVAC
- Ground Source Heat Pumps
- Variable frequency Drives/ motors
- Refrigeration
- Prescriptive and performance lighting and lighting controls

The equipment is procured using a typical bid- build method, installed and paid for and then the incentives are reimbursed to the owner.

Refer to Appendix D for more information on the Smart Start program.

6.1.2 Direct Install Program

The Direct Install Program applies to smaller facilities that have a peak electrical demand of 200 kW or less in any of the previous 12 months. Buildings must be located in New Jersey and served by one of the state's public, regulated electric utility companies.

Direct Install is funded through New Jersey's Clean Energy Program and is designed to provide capital for building energy upgrade projects to fast track implementation. The program will pay up to 70% of the costs for lighting, HVAC, motors, refrigeration, and other equipment upgrades with higher efficiency alternatives. If a building is eligible for this funding, the Direct Install Program can reduce the implementation cost of energy conservation projects.

The Direct Install program has specific HVAC equipment and lighting requirements and is generally applicable only to smaller package HVAC units, small boilers and lighting retrofits.

The program pays a maximum amount of \$75,000 per building, and up to \$250,000 per customer per year. Installations must be completed by an approved Direct Install participating contractor, a list of which can be found on the New Jersey Clean Energy Website. Contractors will coordinate with the applicant to arrange installation of recommended measures identified in a previous energy assessment, such as this energy audit. The incentive is reimbursed to the Owner upon successful replacement and payment of the equipment.

Refer to Appendix D for more information on this program.

6.1.3 New Jersey Pay For Performance Program (P4P)

This building may be eligible for incentives from the New Jersey Office of Clean Energy. The most significant incentives are available from the New Jersey Pay for Performance (P4P) Program. The P4P program is designed to offset the cost of energy conservation projects for facilities that pay the Societal Benefits Charge (SBC) and whose demand (kW) in any of the preceding 12 months exceeds 100 kW. This demand minimum has been waived for buildings owned by local governments or municipalities and non-profit organizations and *is not applicable to public schools*. Facilities that meet this criterion must also achieve a minimum performance target of 15% energy reduction by using the EPA Portfolio Manager benchmarking tool before and after implementation of the measure(s). Additionally, the overall return on investment (ROI) must exceed 10%. If the participant is a municipal electric company customer, and a customer of a regulated gas New Jersey Utility, only gas measures will be eligible under the Program. Available incentives are as follows:

Incentive #1: Energy Reduction Plan – This incentive is designed to offset the cost of services associated with the development of the Energy Reduction Plan (ERP). The ERP must include a detailed energy audit of the desired ECMs, energy savings calculations (using building modeling software) and inputting of all utility bills into the EPA Portfolio Manager website.

- Incentive Amount: \$0.10/SF
- Minimum incentive: \$5,000
- Maximum Incentive: \$50,000 or 50% of Facility annual energy cost

The standard incentive pays \$0.10 per square foot, up to a maximum of \$50,000, not to exceed 50% of facility annual energy cost, paid after approval of application. For building audits funded by the New Jersey Board of Public Utilities, which receive an initial 75% incentive toward performance of the energy audit, facilities are only eligible for an additional \$0.05 per square foot, up to a maximum of \$25,000, rather than the standard incentive noted above. The ERP must be completed by a Certified Energy Manager (CEM) and submitted along with the project application.

Incentive #2: Installation of Recommended Measures – This incentive is based on projected energy savings as determined in Incentive #1 (Minimum 15% savings must be achieved), and is paid upon successful installation of recommended measures.

Electric

- Base incentive based on 15% savings: \$0.09/ per projected kWh saved.
- For each % over 15% add: \$0.005 per projected kWh saved.
- Maximum incentive: \$0.11/ kWh per projected kWh saved.

Gas

- Base incentive based on 15% savings: \$0.90/ per projected Therm saved.
- For each % over 15% add: \$0.05 per projected Therm saved.
- Maximum incentive: \$1.25 per projected Therm saved.

Incentive cap: 25% of total project cost

Incentive #3: Post-Construction Benchmarking Report – This incentive is paid after acceptance of a report proving energy savings over one year utilizing the Environmental Protection Agency (EPA) Portfolio Manager benchmarking tool.

Electric

- Base incentive based on 15% savings: \$0.09/ per projected kWh saved.
- For each % over 15% add: \$0.005 per projected kWh saved.
- Maximum incentive: \$0.11/ kWh per projected kWh saved.

Gas

- Base incentive based on 15% savings: \$0.90/ per projected Therm saved.
- For each % over 15% add: \$0.05 per projected Therm saved.
- Maximum incentive: \$1.25 per projected Therm saved.

Combining Incentives #2 and #3 will provide a total of \$0.18/ kWh and \$1.8/therm not to exceed 50% of total project cost. Additional Incentives for #2 and #3 are increased by \$0.005/kWh and \$0.05/therm for each percentage increase above the 15% minimum target to 20%, calculated with the EPA Portfolio Manager benchmarking tool, not to exceed 50% of total project cost.

For the purpose of demonstrating the eligibility of the ECM's to meet the minimum savings requirement of 15% annual savings and 10% ROI for the Pay for Performance Program, all ECM's identified in this report have been included in the incentive calculations. The results for the building are shown in Appendix C, with more detailed program information in Appendix D.

6.1.4 Energy Savings Improvement Plan

The Energy Savings Improvement Program (ESIP) allows government agencies to make energy related improvements to their facilities and pay for the costs using the value of energy savings that result from the improvements. Under the recently enacted Chapter 4 of the Laws of 2009 (the law), the ESIP provides all government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources.

ESIP allows local units to use “energy savings obligations” (ESO) to pay for the capital costs of energy improvements to their facilities. ESIP loans have a maximum loan term of 15 year. ESOs are not considered “new general obligation debt” of a local unit and do not count against debt limits or require voter approval. They may be issued as refunding

bonds or leases. Savings generated from the installation of energy conservation measures pay the principal of and interest on the bonds; for that reason, the debt service created by the ESOs is not paid from the debt service fund, but is paid from the general fund.

For local governments interested in pursuing an ESIP, the first step is to perform an energy audit. Pursuing a Local Government Energy Audit through New Jersey's Clean Energy Program is a valuable first step to the ESIP approach. The "Local Finance Notice" outlines how local governments can develop and implement an ESIP for their facilities. The ESIP can be prepared internally if the entity has qualified staff. If not, the ESIP must be implemented by an independent contractor and not by the energy savings company producing the Energy Reduction Plan.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Local units should carefully consider all alternatives to develop an approach that best meets their needs. Refer to Appendix D for more information on this program.

6.1.5 Renewable Energy Incentive Program

The Renewable Energy Incentive Program (REIP) is part of New Jersey's efforts to reach its Energy Master Plan goals of striving to use 30 percent of electricity from renewable sources by 2020.

Incentives for sustainable bio-power projects and for energy storage projects are currently under development, with competitive solicitations for each of those technologies expected to begin in the first quarter of 2014. The wind program is currently on hold.

New solar projects are no longer eligible for REIP incentives, but can register for Solar Renewable Energy Certificates (SRECs) through the SREC Registration Program (SRP).

7.0 | ALTERNATIVE ENERGY SCREENING EVALUATION

7.1 Solar

7.1.1 Photovoltaic Rooftop Solar Power Generation

The building has an existing 75 KW capacity solar photovoltaic (PV) system. It is our understanding that the roof was evaluated to maximize the installation of solar PV cells and additional solar PV cells cannot be installed on the roof. Hence no further evaluation of PV solar system was done.

7.1.2 Solar Thermal Hot Water Generation

Active solar thermal systems use solar collectors to gather the sun's energy to heat a fluid. An absorber in the collector (usually black colored piping) converts the sun's energy into heat. The heat is transferred to circulating water, antifreeze, or air for immediate use or is storage for later utilization. Applications for active solar thermal energy include supplementing domestic hot water, heating swimming pools, space heating or preheating air in residential and commercial buildings.

A standard solar hot water system is typically composed of solar collectors, heat storage vessel, piping, circulators, and controls. Systems are typically integrated to work alongside a conventional heating system that provides heat when solar resources are not sufficient. The solar collectors are usually placed on the roof of the building, oriented south, and tilted at the same angle as the site's latitude, to maximize the amount of solar radiation collected on a yearly basis.


Several options exist for using active solar thermal systems for space heating. The most common method is called a passive solar hot water system involves using glazed collectors to heat a liquid held in a storage tank (similar to an active solar hot water system described above which requires pumping). The most practical system would transfer the heat from the panels to thermal storage tanks and then use the pre-heated water for domestic hot water production. DHW is presently produced by natural gas fired water heaters and, therefore, this measure would offer natural gas utility savings. Unfortunately, the amount of domestic hot water that is currently used by this school is very small. Installing a solar domestic hot water system is not recommended due to the limited amount of domestic hot water presently consumed by the school.

This measure is not recommended due to the relatively low domestic hot water usage.

7.2 Wind Powered Turbines

Wind power is the conversion of kinetic energy from wind into mechanical power that is used to drive a generator which creates electricity by means of a wind turbine. A wind turbine consists of rotor and blades connected to a gearbox and generator that are mounted onto a tower. Newer wind turbines also use advanced technology to generate electricity at a variety of frequencies depending on the wind speed, convert it to DC and then back to AC before sending it to the grid. Wind turbines range from 50 – 750 kW for

utility scale turbines down to below 50 kW for residential use. On a scale of 1 (the lowest) to 7 (the highest), Class 3 and above (wind speeds of 13 mph or greater) are generally considered “good wind resource” according to the Wind Energy Development Programmatic EIS Information Center hosted by the Bureau of Land Management. According to the map below, published by NREL, Newark, NJ is classified as Class 1 at 50m, meaning the city would not be a good candidate for wind power.

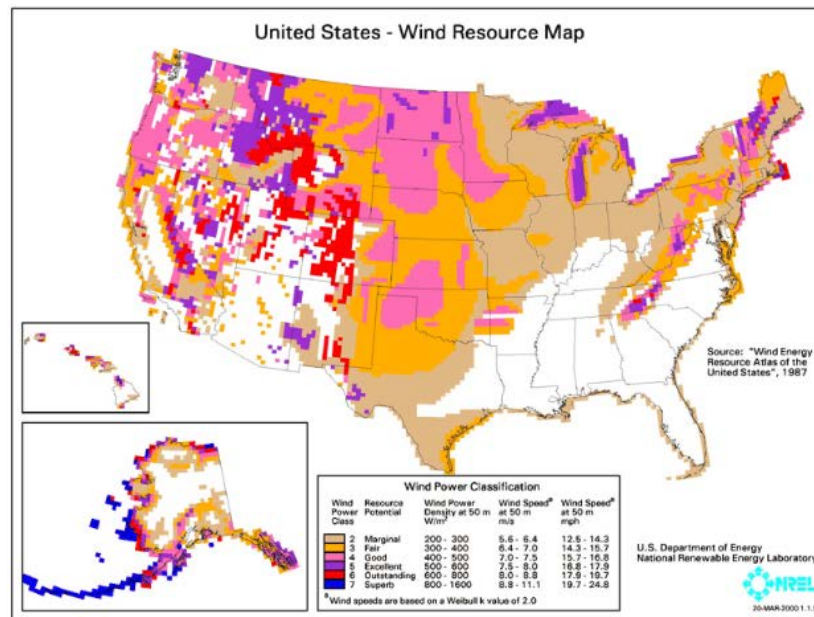

This measure is not recommended due to the location of the school.

7.3 Combined Heat and Power Plant

Combined heat and power (CHP), cogeneration, is self-production of electricity on-site with beneficial recovery of the heat byproduct from the electrical generator. Common CHP equipment includes reciprocating engine-driven, micro turbines, steam turbines, and fuel cells. Typical CHP customers include industrial, commercial, institutional, educational institutions, and multifamily residential facilities. CHP systems that are commercially viable at the present time are sized approximately 50 kW and above, with numerous options in blocks grouped around 300 kW, 800 kW, 1,200 kW and larger. Typically, CHP systems are used to produce a portion of the electricity needed by a facility some or all of the time, with the balance of electric needs satisfied by purchase from the grid.

Any proposed CHP project will need to consider many factors, such as existing system load, use of thermal energy produced, system size, natural gas fuel availability, and proposed plant location. The building has sufficient need for electrical generation and the ability to use most of the thermal byproduct during the winter; however thermal usage during the summer months does not exist. Thermal energy produced by the CHP plant in the warmer months will be wasted. An absorption chiller could be installed to utilize the heat to produce chilled water; however, there is no chilled water distribution

system in the building. CHP is not recommended due to the building's limited summer thermal demand.

This measure is not recommended due to the absence of year-round thermal loads which are needed for efficiency CHP operation. However, a mini-size CHP could be an option for the school to consider. The sizing and energy savings of the mini-size CHP require further study.

7.4 Demand Response Curtailment

Presently, electricity is delivered by PSE&G, which receives the electricity from regional power grid RFC. PSE&G is the regional transmission organization (RTO) that coordinates the movement of wholesale electricity in all or parts of 13 states and the District of Columbia including the State of New Jersey.

Utility Curtailment is an agreement with the utility provider's regional transmission organization and an approved Curtailment Service Provider (CSP) to shed electrical load by either turning major equipment off or energizing all or part of a facility utilizing an emergency generator; therefore, reducing the electrical demand on the utility grid. This program is to benefit the utility company during high demand periods and utility provider offers incentives to the CSP to participate in this program. Enrolling in the program will require program participants to drop electrical load or turn on emergency generators during high electrical demand conditions or during emergencies. Part of the program also will require that program participants reduce their required load or run emergency generators with notice to test the system.

A pre-approved CSP will require a minimum of 100 kW of load reduction to participate in any curtailment program. From January 2013 through June 2014 the following table summarizes the electricity load profile for the building.

Building Electric Load Profile

Peak Demand kW	Min Demand kW	Avg Demand kW	Onsite Generation Y/N	Eligible? Y/N
N/A	N/A	N/A	-	-

*the demand is estimated from one month bill

This measure could not be evaluated since data was not available.

8.0 CONCLUSIONS & RECOMMENDATIONS

The following section summarizes the LGEA energy audit conducted by CHA for Ridge Elementary School.

The following projects should be considered for implementation:


- Install window AC unit controllers
- Lighting Replacements / Upgrades

The potential annual energy and cost savings for the recommended ECMs are shown in the following table.

Electric Savings (kWh)	Natural Gas Savings (therms)	Total Savings (\$)	Payback (years)
38,159	0	6,029	12.2

If the school implements the recommended ECMs, energy savings would be as follows:

	Existing Conditions	Post Recommended ECMs	Percent Savings
Costs (\$)	84,861	78,832	7%
Electricity (kWh)	357,633	319,474	11%
Natural Gas (therms)	29,696	29,696	0%
Site EUI (kbtu/SF/Yr)	78.1	75.7	

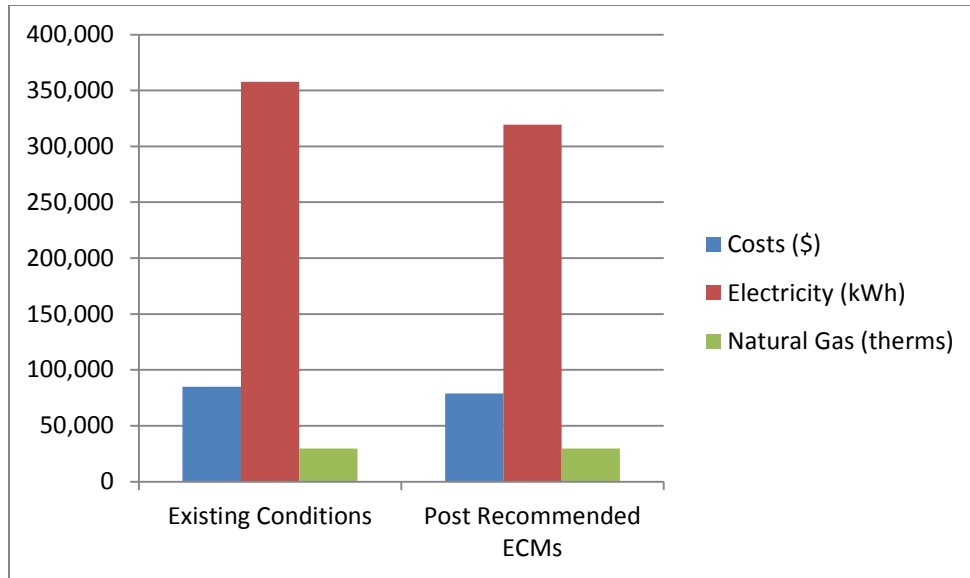

Next Steps: This energy audit has identified several areas of potential energy savings. Ridgewood Board Of Education can use this information to pursue incentives offered by the NJBPU's NJ Clean Energy Program. A close-out meeting will be scheduled with school staff members to review the ECMs and possible incentive options.

APPENDIX A


Utility Usage Analysis and Alternate Utility Suppliers

Ridgewood BOE NJBPU LGEA
Ridge Elementary School
325 W Ridgewood Ave, Ridgewood, NJ


Annual Utilities
12-month Summary

Electric		
Annual Usage	357,633	kWh/yr
Annual Cost	56,555	\$
Blended Rate	0.158	\$/kWh
Natural Gas		
Annual Usage	29,696	Therms/yr
Annual Cost	25,418	\$
Rate	0.856	\$/therm
Water		
Annual Usage	516,000	Gallons
Annual Cost	2,888	\$
Rate	0.006	\$/Gallon
Energy Summary		
Building Area	53,654	SF
Energy Usage Intensity (EUI)	78	KBtu/SF/yr
Energy Cost Index (ECI)	1.58	\$/SF/yr
Total Annual Utility Costs	84,862	\$

Utility	KBtu	%
Electric	1,220,294	29%
Natural Gas	2,968,886	71%
	4,189,180	100%

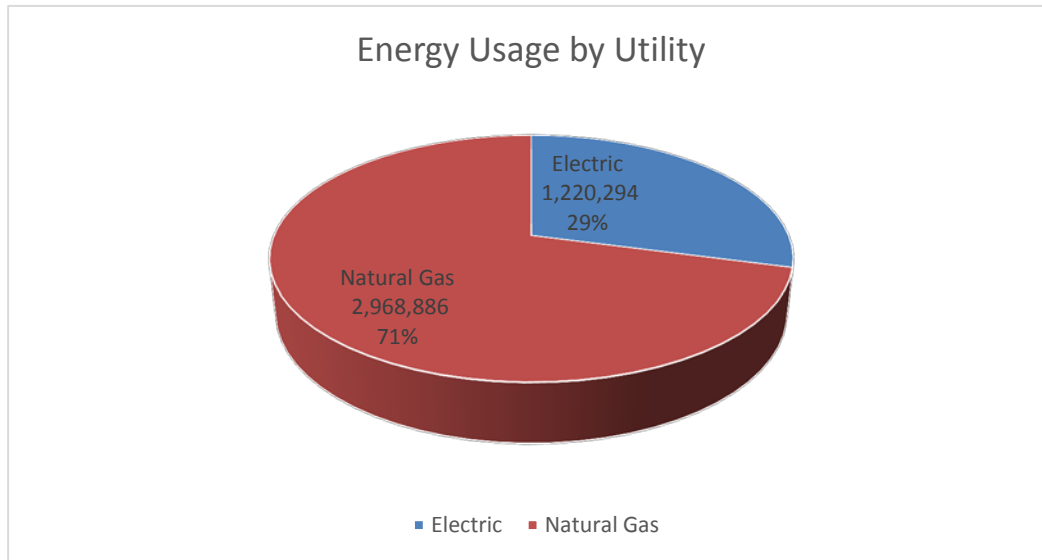

Utility	\$	%
Electric	56,555	69%
Natural Gas	25,418	31%
	81,974	100%

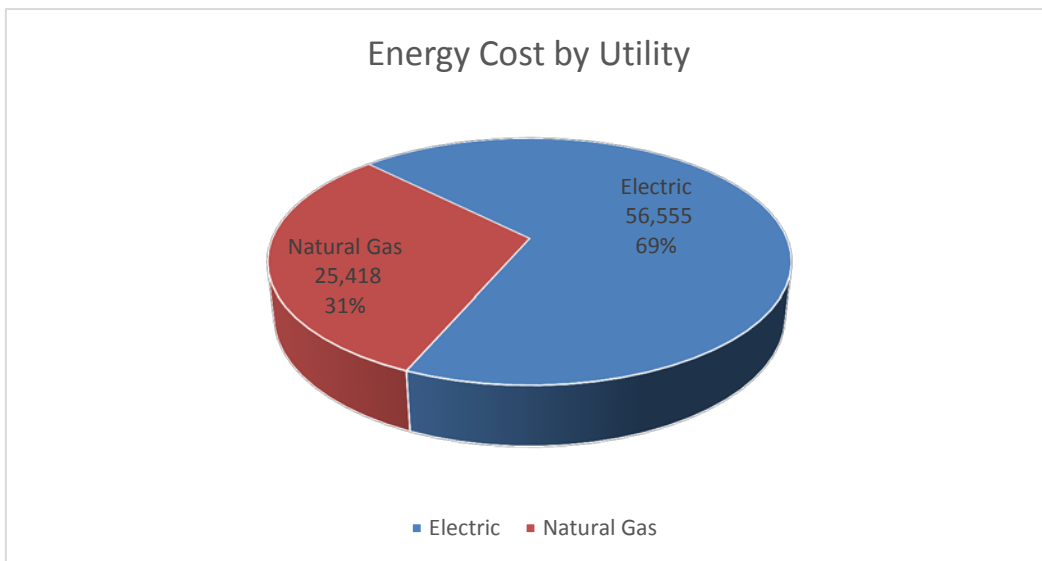

Ridgewood BOE NJBPU LGEA
 Ridge Elementary School
 325 W Ridgewood Ave, Ridgewood, NJ

Electric Service

For Service at: 325 W Ridgewood Ave, Ridgewood, NJ

Account No.: 0

Meter No.:


Delivery: PSE&G

Supply: Energy Direct

			Provider Charges			Usage (kWh) vs. Demand (kW) Charges		Unit Costs				
Month	Consump. (kWh)	Demand (kW)	Delivery (\$)	Supplier (\$)	Total (\$)	Consumption (\$)	Demand (\$)	Delivery (\$/kWh)	Supplier (\$/kWh)	Consumption Rate (\$/kWh)	Demand (\$/kW)	Blended Rate (\$/kWh)
January-14	33,750		5,187.79		5,187.79	5187.79		0.154	0.000	0.154	#DIV/0!	0.154
February-14	36,524		5,176.10		5,176.10	5176.10		0.142	0.000	0.142	#DIV/0!	0.142
March-14	35,409		4,817.06		4,817.06	4817.06		0.136	0.000	0.136	#DIV/0!	0.136
April-14	24,766		3,419.53		3,419.53	3419.53		0.138	0.000	0.138	#DIV/0!	0.138
May-14	29,563		5,158.91		5,158.91	5158.91		0.175	0.000	0.175	#DIV/0!	0.175
June-14	28,840		5,180.19		5,180.19	5180.19		0.180	0.000	0.180	#DIV/0!	0.180
July-14	25,959		4,323.67		4,323.67	4323.67		0.167	0.000	0.167	#DIV/0!	0.167
August-14	27,498		5,215.67		5,215.67	5215.67		0.190	0.000	0.190	#DIV/0!	0.190
September-14	29,354		4,141.90		4,141.90	4141.90		0.141	0.000	0.141	#DIV/0!	0.141
October-14	28,994		4,215.60		4,215.60	4215.60		0.145	0.000	0.145	#DIV/0!	0.145
November-14	27,201		5,011.10		5,011.10	5011.10		0.184	0.000	0.184	#DIV/0!	0.184
December-14	33,922		4,948.62		4,948.62	4948.62		0.146	0.000	0.146	#DIV/0!	0.146
January-15	37,566		5,021.00		5,021.00	5021.00		0.134	0.000	0.134	#DIV/0!	0.134
February-15	35,688		5,347.00		5,347.00	5347.00		0.15	0.00	0.15	#DIV/0!	0.15
March-15	28,282		4,572.00		4,572.00	4572.00		0.162	0.000	0.162	#DIV/0!	0.162
Total (All)	463,316	0.00	\$71,736.14	\$0.00	\$71,736.14	\$71,736.14	\$0.00	\$0.15	\$0.00	\$0.15	#DIV/0!	\$0.15
Total (last 12-months)	357,633	0.00	\$56,555.19	\$0.00	\$56,555.19	\$56,555.19	\$0.00	\$0.16	\$0.00	\$0.16	#DIV/0!	\$0.16
Notes	1	2	3	4	5			6	7			8

- 1.) Number of kWh of electric energy used per month
- 2.) Number of kW of power measured
- 3.) Electric charges from Delivery provider
- 4.) Electric charges from Supply provider - note, includes 8.875% tax
- 5.) Total charges (Delivery + Supplier)
- 6.) Delivery Charges (\$) / Consumption (kWh)
- 7.) Supplier Charges (\$) / Consumption (kWh)
- 8.) Total Charges (\$) / Consumption (kWh)

Ridge Elementary School - Electric Usage

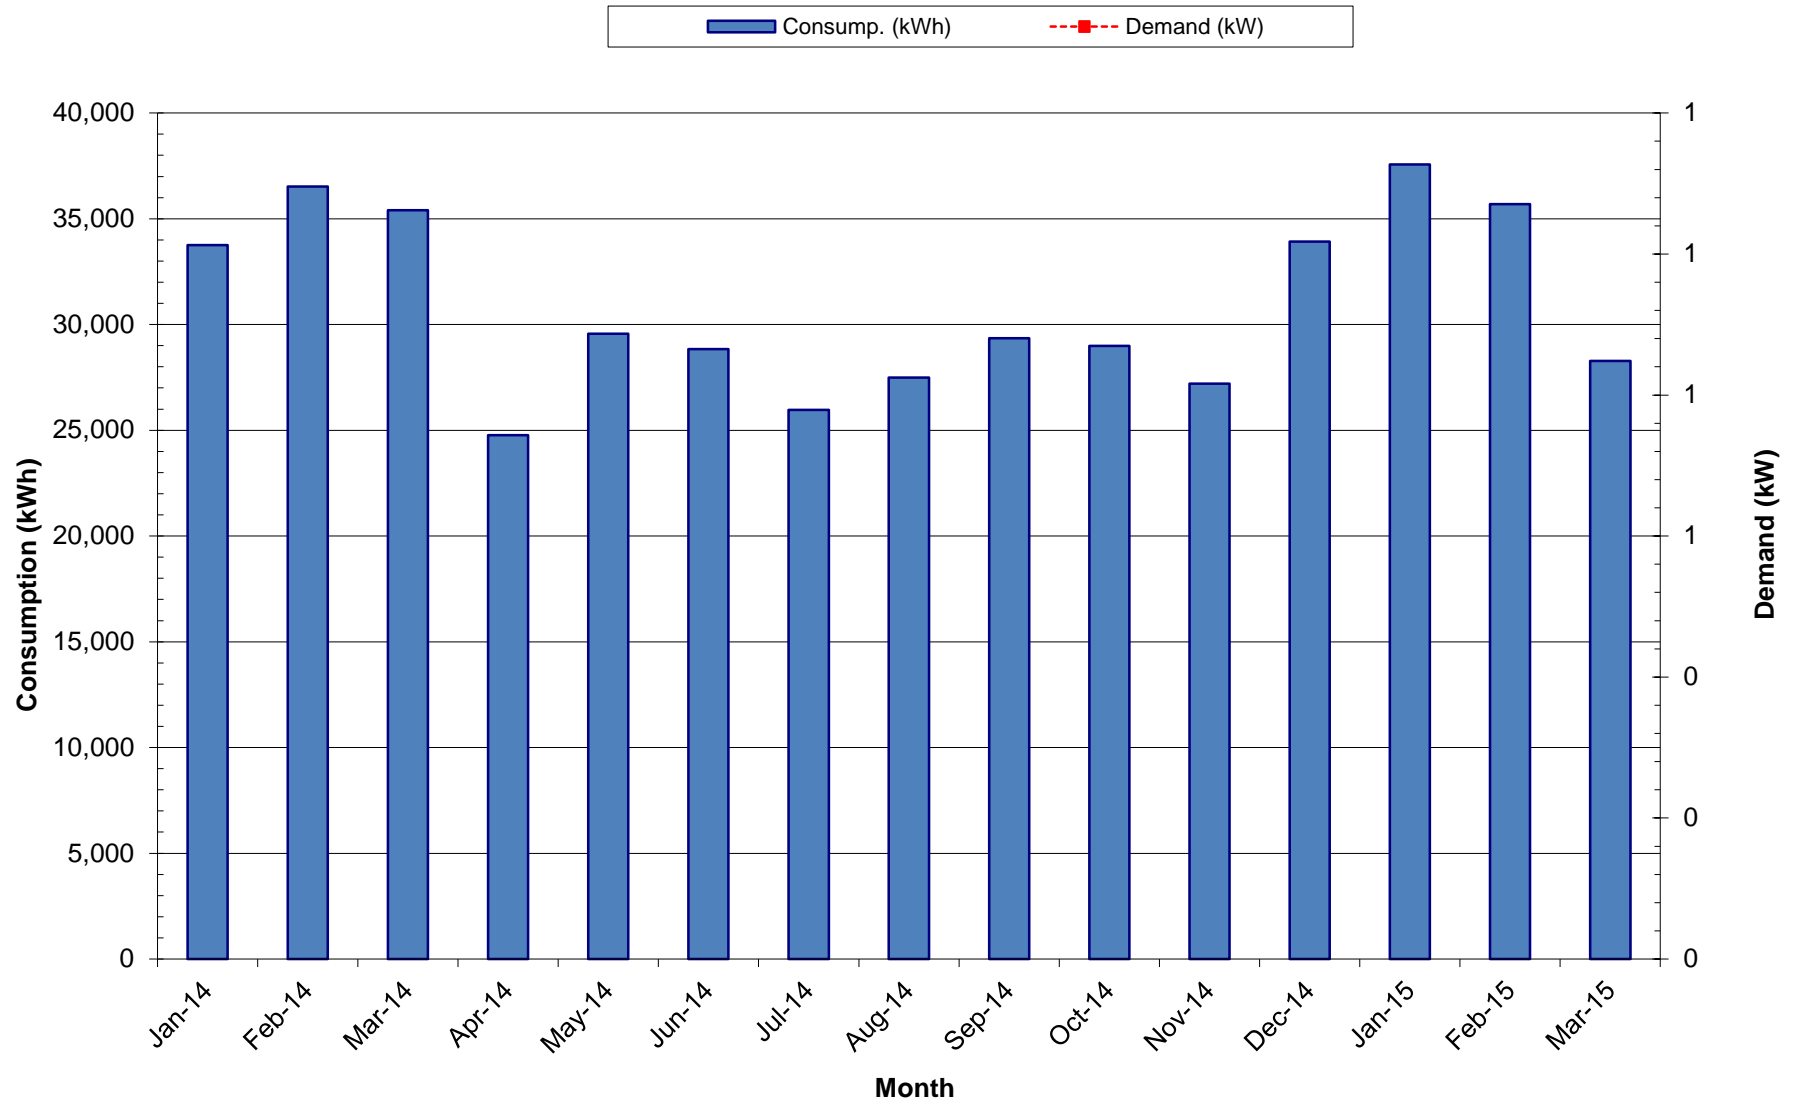

Ridgewood BOE NJBPU LGEA
Ridge Elementary School
325 W Ridgewood Ave, Ridgewood, NJ

Natural Gas Service

For Service at: 325 W Ridgewood Ave, Ridgewood, NJ


Account No.: 0

Meter No:

Delivery: PSE&G

Supply: Direct Energy/South Jersey Energy/PSE&G

Month	Consumption (Therms)	Delivery Charges (\$)	Supply Charges (\$)	Total Charges (\$)	Rate (\$/Therm)
January-14	7,120.27	6,567.14		6,567.14	0.92
February-14	5,594.50	5,523.16		5,523.16	0.99
March-14	3,839.93	2,835.91		2,835.91	0.74
April-14	1,278.23	971.36		971.36	0.76
May-14	244.41	291.42		291.42	1.19
June-14	147.83	196.70		196.70	1.33
July-14	132.00	177.69		177.69	1.35
August-14	144.00	186.72		186.72	1.30
September-14	229.66	236.94		236.94	1.03
October-14	1,314.97	1,613.32		1,613.32	1.23
November-14	3,642.63	3,236.40		3,236.40	0.89
December-14	4,453.22	4,348.94		4,348.94	0.98
January-15	6,507.00	5,567.00		5,567.00	0.86
February-15	8,254.00	6,644.00		6,644.00	0.80
March-15	3,348.00	1,948.00		1,948.00	0.58
Total (12 Months)	29,696	\$ 25,418.49	\$ 25,418.49	\$ 25,418.49	\$ 0.86

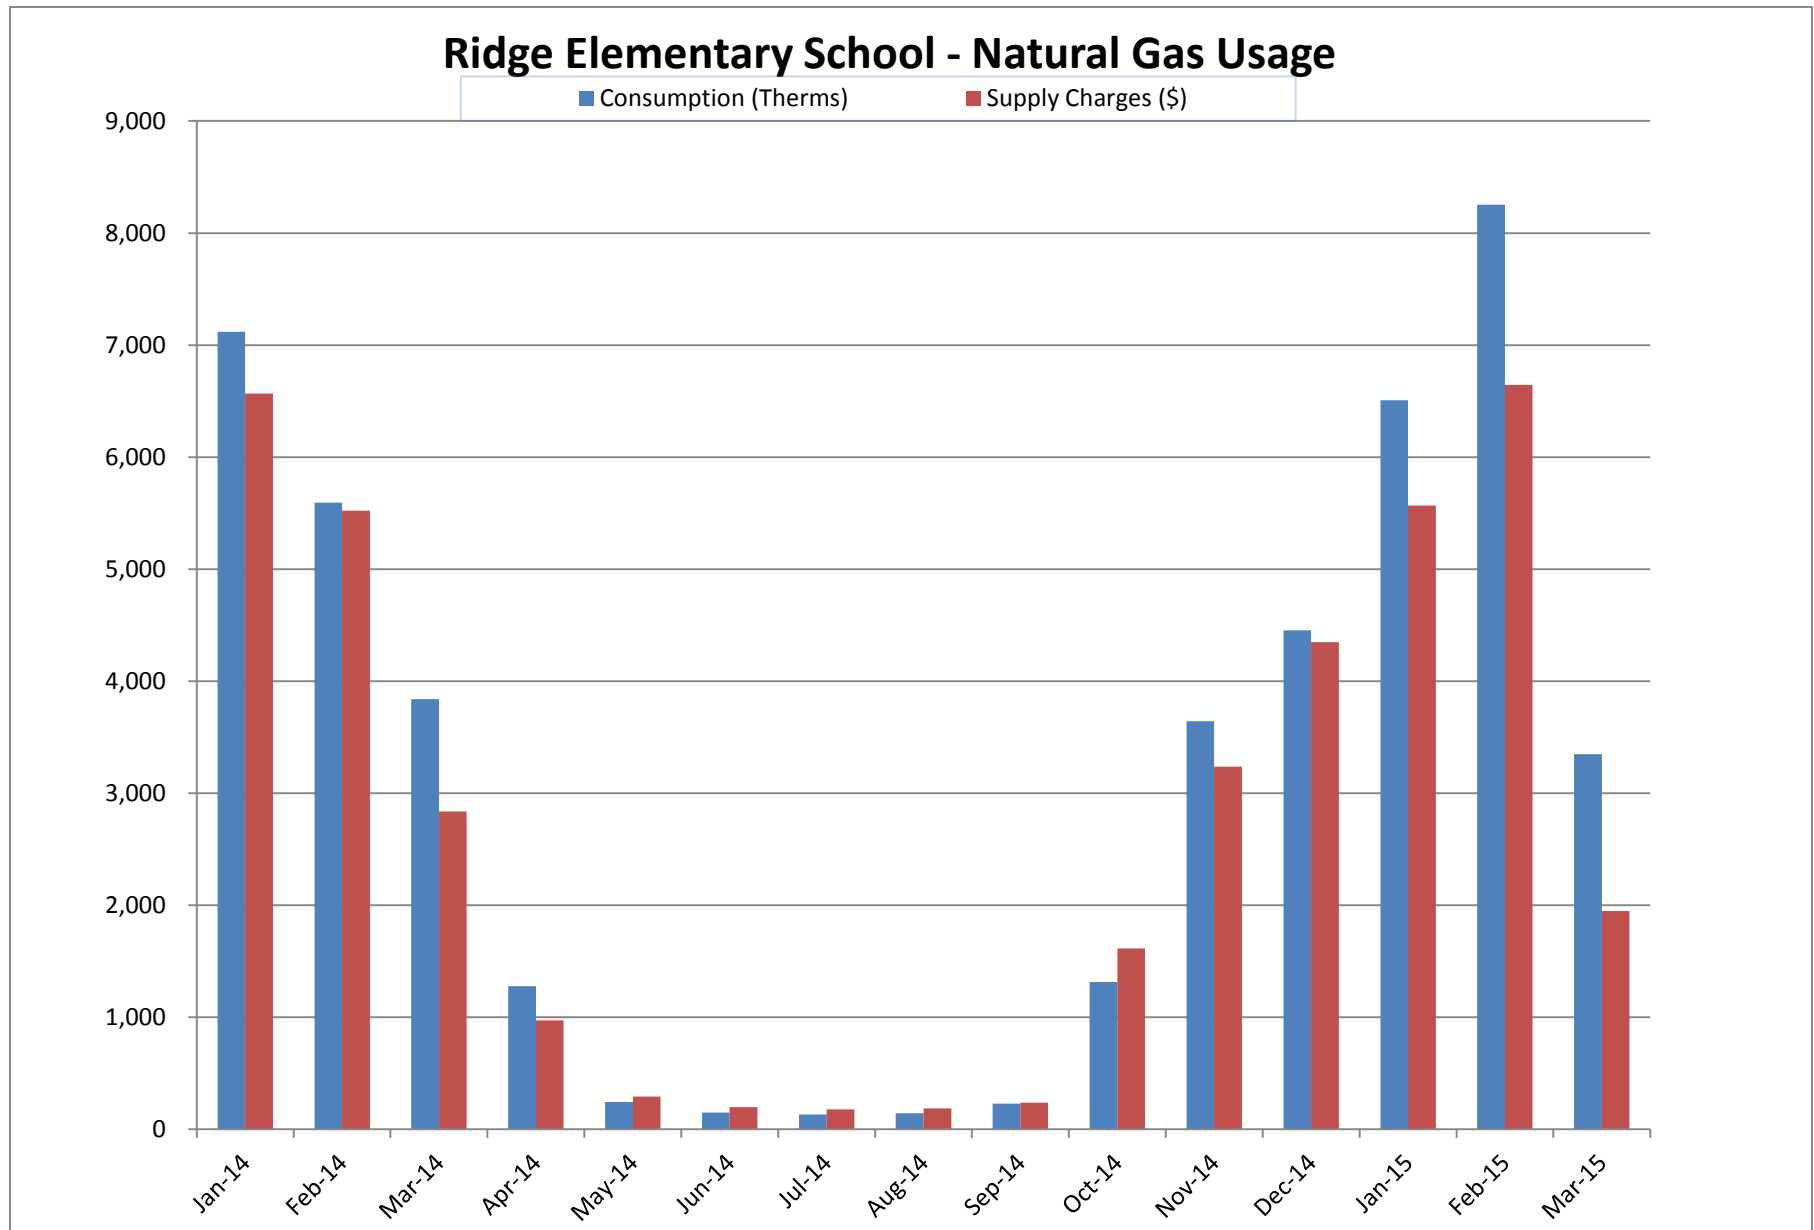

Ridgewood BOE NJBPU LGEA
Ridge Elementary School
325 W Ridgewood Ave, Ridgewood, NJ

For Service at:

Account No.:

Meter No.:

Water & Sewer Service


Delivery -
Supplier -

Ridgewood Water

Month	Total (\$)	Gallons	\$/Gallon
March-14	\$ 726.67	130,000	\$ 0.01
June-14	\$ 797.02	145,000	\$ 0.01
September-14	\$ 684.46	121,000	\$ 0.01
December-14	\$ 679.77	120,000	\$ 0.01
Total	\$ 2,887.92	516,000	\$ 0.01

Water Usage

■ Gallons

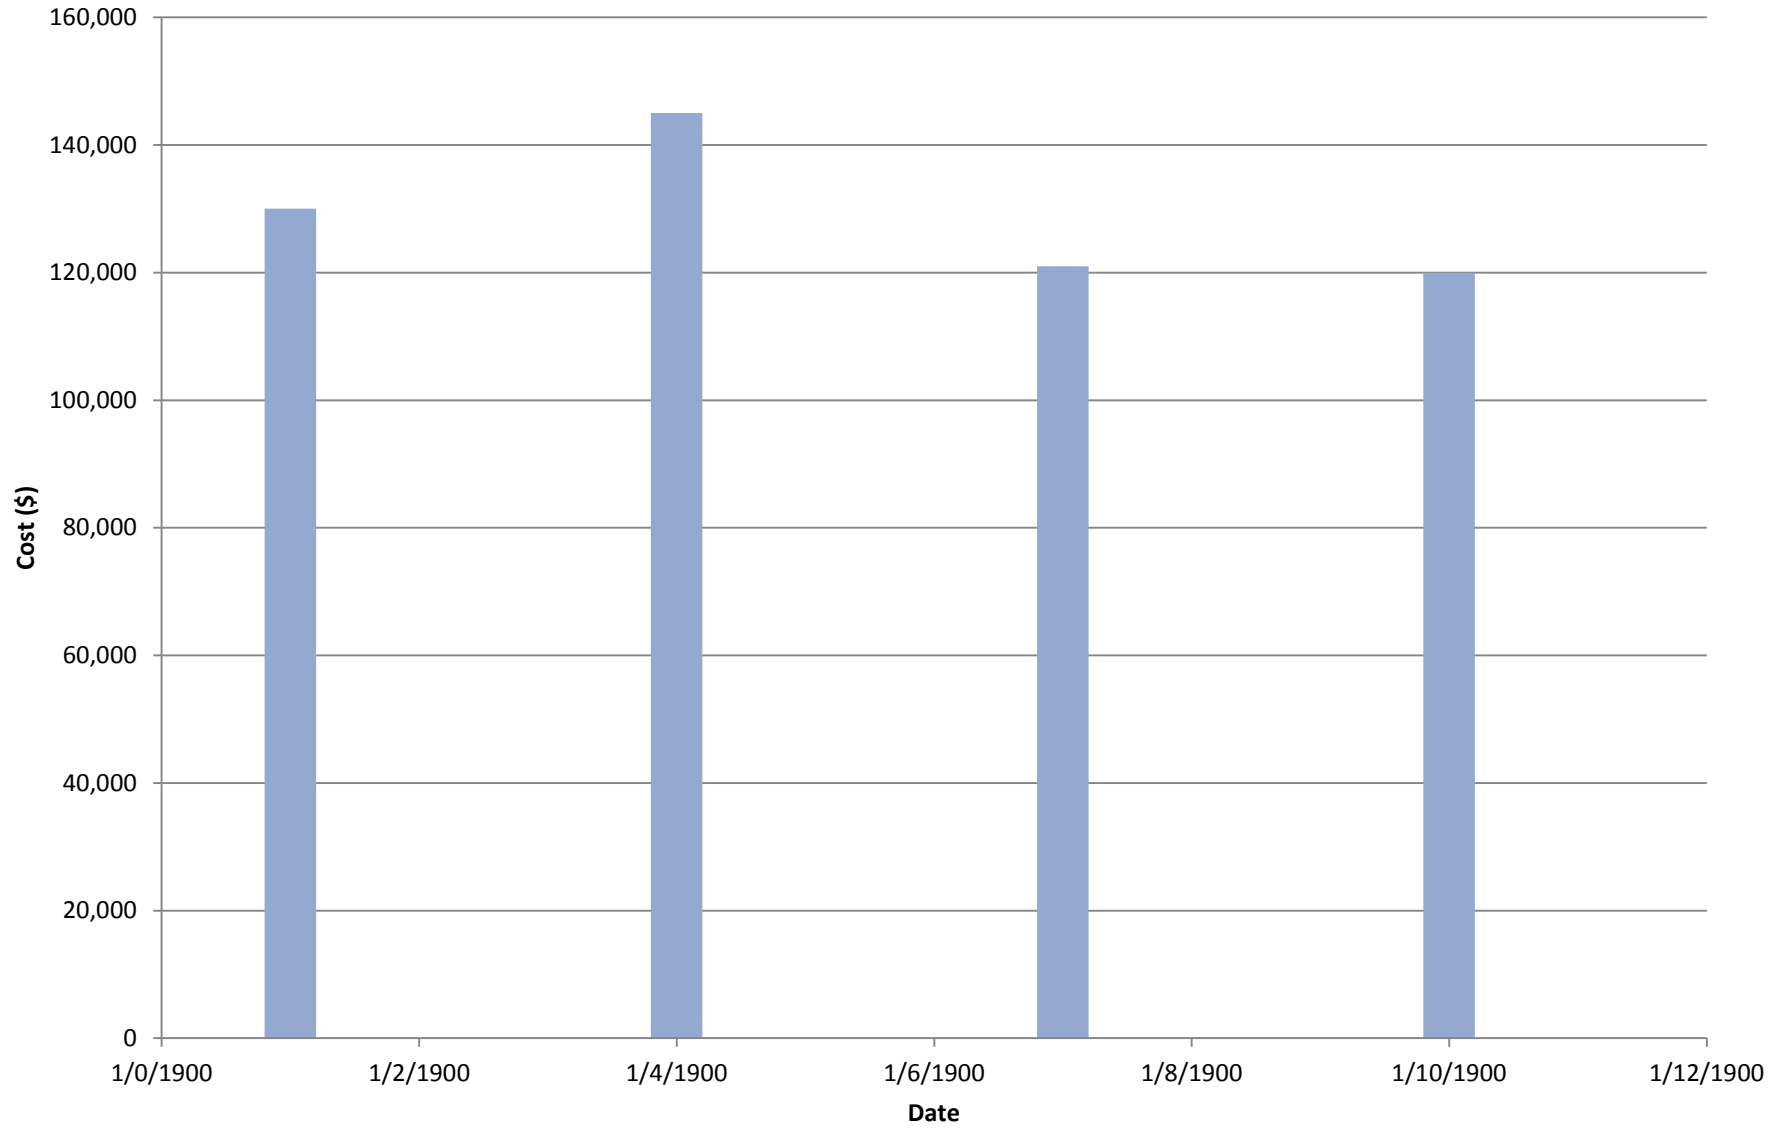

PSE&G ELECTRIC SERVICE TERRITORY

Last Updated: 12/11/14

***CUSTOMER CLASS - R – RESIDENTIAL C – COMMERCIAL I –INDUSTRIAL**

Supplier	Telephone & Web Site	*Customer Class
Abest Power & Gas of NJ, LLC 202 Smith Street Perth Amboy, NJ 08861	(888)987-6937 www.AbestPower.com	R/C/I ACTIVE
AEP Energy, Inc. f/k/a BlueStar Energy Services 309 Fellowship Road, Fl. 2 Mount Laurel, NJ 08054	(866) 258-3782 www.aepenergy.com	R/C/I ACTIVE
Alpha Gas and Electric, LLC 641 5 th Street Lakewood, NJ 08701	(855) 553-6374 www.alphagasandelectric.com	R/C ACTIVE
Ambit Northeast, LLC d/b/a Ambit Energy 103 Carnegie Center Suite 300 Princeton, NJ 08540	877-282-6284 www.ambitenergy.com	R/C ACTIVE
American Powernet Management, LP 437 North Grove St. Berlin, NJ 08009	(877) 977-2636 www.americanpowernet.com	C/I ACTIVE
Amerigreen Energy, Inc. 333Sylvan Avenue Englewood Cliffs, NJ 07632	888-559-4567 www.amerigreen.com	R/C ACTIVE
AP Gas & Electric, (NJ) LLC 10 North Park Place, Suite 420 Morristown, NJ 07960	(855) 544-4895 www.apgellc.com	R/C/I ACTIVE
Astral Energy LLC 16 Tyson Place Bergenfield, NJ 07621	(888)850-1872 www.AstralEnergyLLC.com	R/C/I ACTIVE
Barclays Capital Services, Inc. 70 Hudson Street Jersey City, NJ 07302-4585	(800) 526-7000 www.barclays.com	C ACTIVE
BBPC, LLC d/b/a Great Eastern Energy	(888) 651-4121	C

116 Village Blvd. Suite 200 Princeton, NJ 08540	www.greateasternenergy.com	ACTIVE
Berkshire Energy Partners, LLC 9 Berkshire Road Landenberg, PA 19350 Attn: Dana A. LeSage, P.E.	(610) 255-5070 www.berkshireenergypartners.com	C/I ACTIVE
Blue Pilot Energy, LLC 197 State Rte. 18 South Ste. 3000 East Brunswick, NJ 08816	(800) 451-6356 www.bluepilotenergy.com	R/C ACTIVE
Brick Standard, LLC 235 Hudson Street Suite 1 Hoboken, NJ 07030	(201)706-8101 www.standardalternative.com	C/I ACTIVE
CCES LLC dba Clean Currents Energy Services 566 Terhune Street Teaneck, NJ 07666	(877) 933-2453 www.cleancurrents.com	R/C ACTIVE
Champion Energy Services, LLC 1200 Route 22 Bridgewater, NJ 08807	(888) 653-0093 www.championenergyservices.com	R/C/I ACTIVE
Choice Energy, LLC 4257 US Highway 9, Suite 6C Freehold, NJ 07728	(888) 565-4490 www.4choiceenergy.com	R/C ACTIVE
Clearview Electric, Inc. 1744 Lexington Avenue Pennsauken, NJ 08110	(888) CLR-VIEW (800) 746- 4702 www.clearviewenergy.com	R/C/I ACTIVE
Commerce Energy, Inc. 7 Cedar Terrace Ramsey, NJ 07446	1-866-587-8674 www.commerceenergy.com	R/C ACTIVE
Community Energy Inc. 51 Sandbrook Headquarters Road Stockton, NJ 08559	(866)946-3123 www.communityenergyinc.com	R/C/I ACTIVE
ConEdison Solutions Cherry Tree Corporate Center 535 State Highway Suite 180 Cherry Hill, NJ 08002	(888) 665-0955 www.conedsolutions.com	C/I ACTIVE

ConocoPhillips Company 224 Strawbridge Drive Suite 107 Moorestown, NJ 08057	(800) 646-4427 www.conocophillips.com	C/I ACTIVE
Constellation NewEnergy, Inc. 900A Lake Street, Suite 2 Ramsey, NJ 07446	(888) 635-0827 www.constellation.com	R/C/I ACTIVE
Constellation Energy 900A Lake Street, Suite 2 Ramsey, NJ 07446	(877) 997-9995 www.constellation.com	R ACTIVE
Credit Suisse, (USA) Inc. 700 College Road East Princeton, NJ 08450	(212) 538-3124 www.creditsuisse.com	C ACTIVE
Direct Energy Business, LLC 120 Wood Avenue, Suite 611 Iselin, NJ 08830	(888) 925-9115 http://www.business.directenergy.com/	R ACTIVE
Direct Energy Business Marketing, LLC (fka Hess Energy Marketing) 1 Hess Plaza Woodbridge, NJ 07095	(800) 437-7872 http://www.business.directenergy.com/	C/I ACTIVE
Direct Energy Services, LLC 120 Wood Avenue, Suite 611 Iselin, NJ 08830	(888) 925-9115 www.directenergy.com	R ACTIVE
Direct Energy Small Business, LLC (fka Hess Small Business Services, LLC) One Hess Plaza Woodbridge, NJ 07095	(888) 464-4377 http://www.business.directenergy.com/	C/I ACTIVE
Discount Energy Group, LLC 811 Church Road, Suite 149 Cherry Hill, New Jersey 08002	(800) 282-3331 www.discountenergygroup.com	R/C ACTIVE
DTE Energy Supply, Inc. One Gateway Center, Suite 2600 Newark, NJ 07102	(877) 332-2450 www.dtesupply.com	C/I ACTIVE

Energy.me Midwest LLC 90 Washington Blvd Bedminster, NJ 07921	(855) 243-7270 www.energy.me	R/C/I ACTIVE
Energy Plus Holdings LLC 309 Fellowship Road East Gate Center, Suite 200 Mt. Laurel, NJ 08054	(877) 866-9193 www.energypluscompany.com	R/C ACTIVE
Ethical Electric Benefit Co. d/b/a Ethical Electric 100 Overlook Center, 2 nd Fl. Princeton, NJ 08540	(888) 444-9452 www.ethicalelectric.com	R/C ACTIVE
Energy Service Providers, Inc., d/b/a New Jersey Gas & Electric 1 Bridge Plaza fl. 2 Fort Lee, NJ 07024	(866) 568-0290 www.njgande.com	R/C ACTIVE
FirstEnergy Solutions 150 West State Street Trenton, NJ 08608	(866) 625-7318 www.fes.com	C/I ACTIVE
Gateway Energy Services Corp. 120 Wood Avenue Suite 611 Iselin, NJ 08830	(866)348-4193 www.directenergybusiness.com	R/C ACTIVE
GDF SUEZ Energy Resources NA, Inc. 333 Thornall Street Sixth Floor Edison, NJ 08837	(866) 999-8374 www.gdfsuezenergyresources.com	C/I ACTIVE
GDF Suez Retail Energy Solutions LLC d/b/a THINK ENERGY 333 Thornall St. Sixth Floor Edison, NJ 08819	1-866-252-0078 www.mythinkenergy.com	R/C/I ACTIVE
Glacial Energy of New Jersey, Inc. 21 Pine Street, Suite 237 Rockaway, NJ 07866	(888) 452-2425 www.glacialenergy.com	C/I ACTIVE
Global Energy Marketing LLC 129 Wentz Avenue Springfield, NJ 07081	(800) 542-0778 www.globalp.com	R/C/I ACTIVE

Green Mountain Energy Company 211 Carnegie Center Drive Princeton, NJ 08540	(866) 767-5818 www.greenmountain.com/commercial-home	C/I ACTIVE
Harborside Energy LLC 101 Hudson Street Suite 2100 Jersey City, NJ 07302	(877) 940-3835 www.harborsideenergynj.com	R/C ACTIVE
Hess Corporation 1 Hess Plaza Woodbridge, NJ 07095	(800) 437-7872 www.hess.com	C/I ACTIVE
HIKO Energy, LLC 655 Suffern Road Teaneck, NJ 07666	(888) 264-4908 www.hikoenergy.com	R/C/I ACTIVE
Hudson Energy Services, LLC 7 Cedar Street Ramsey, New Jersey 07446	(877) Hudson 9 www.hudsonenergyservices.com	C ACTIVE
IDT Energy, Inc. 550 Broad Street Newark, NJ 07102	(877) 887-6866 www.idtenergy.com	R/C ACTIVE
Independence Energy Group, LLC 211 Carnegie Center Princeton, NJ 08540	(877) 235-6708 www.chooseindependence.com	R/C ACTIVE
Inspire Energy Holdings LLC 923 Haddonfield Road 3rd Fl. Building B2 Cherry Hill, NJ 08002	(866) 403-2620 www.inspireenergy.com	R/C/I
Integrus Energy Services, Inc. 33 Wood Ave, South, Suite 610 Iselin, NJ 08830	(800) 536-0151 www.integrusenergy.com	C/I ACTIVE
Jsynergy, LLC 445 Central Ave. Suite 204 Cedarhurst, NY 11516	(516) 331-2020 Jsynergylc.com	R/C/I ACTIVE
Kuehne Chemical Company, Inc. 86 North Hackensack Avenue South Kearney, NJ 07032	(973) 589-0700 kuehnechemical@comcast.net	I

Liberty Power Delaware, LLC 1973 Highway 34, Suite 211 Wall, NJ 07719	(866) 769-3799 www.libertypowercorp.com	C/I ACTIVE
Liberty Power Holdings, LLC 1973 Highway 34, Suite 211 Wall, NJ 07719	(866) 769-3799 www.libertypowercorp.com	R/C/I ACTIVE
Linde Energy Services 575 Mountain Avenue Murray Hill, NJ 07974	(800) 247-2644 www.linde.com	C/I ACTIVE
Marathon Power LLC 302 Main Street Paterson, NJ 07505	(888) 779-7255 www.mecny.com	R/C/I ACTIVE
MP2 Energy NJ, LLC 111 River Street, Suite 1204 Hoboken, NJ 07030	(877) 238-5343 www.mp2energy.com	R/C/I ACTIVE
Natures Current, LLC 95 Fairmount Avenue Philadelphia, Pennsylvania 19123	(215) 464-6000 www.naturescurrent.com	R/C/I ACTIVE
MPower Energy NJ LLC One University Plaza, Suite 507 Hackensack, NJ 07601	(877) 286-7693 www.mpowerenergy.com	R/C/I ACTIVE
NATGASCO, Inc. (Supreme Energy, Inc.) 532 Freeman St. Orange, NJ 07050	(800) 840-4427 www.supremeenergyinc.com	R/C/I ACTIVE
New Jersey Gas & Electric 10 North Park Place Suite 420 Morristown, NJ 07960	(866) 568-0290 www.njgande.com	R/C/ ACTIVE
NextEra Energy Services New Jersey, LLC 651 Jernee Mill Road Sayreville, NJ 08872	(877) 528-2890 Commercial (800) 882-1276 Residential www.nexteraenergyservices.com	R/C/I ACTIVE
Noble Americas Energy Solutions The Mac-Cali Building 581 Main Street, 8th Floor Woodbridge, NJ 07095	(877) 273-6772 www.noblesolutions.com	C/I ACTIVE

Nordic Energy Services, LLC 50 Tice Boulevard, Suite 340 Woodcliff Lake, NJ 07677	(877) 808-1027 www.nordiceenergy.us.com	R/C/I ACTIVE
North American Power and Gas, LLC 222 Ridgedale Avenue Cedar Knolls, NJ 07927	(888) 313-9086 www.napower.com	R/C/I ACTIVE
North Eastern States, Inc. d/b/a Entrust Energy 90 Washington Valley Road Bedminster, NJ 07921	(888) 535-6340 www.entrustenergy.com	R/C/I ACTIVE
Oasis Power, LLC d/b/a Oasis Energy 11152 Westheimer, Suite 901 Houston, TX 77042	(800)324-3046 www.oasisenergy.com	R/C ACTIVE
Palmco Power NJ, LLC One Greentree Centre 10,000 Lincoln Drive East, Suite 201 Marlton, NJ 08053	(877) 726-5862 www.PalmcoEnergy.com	R/C/I ACTIVE
Park Power, LLC 1200 South Church St. Suite 23 Mount Laurel, NJ 08054	(856) 778-0079 www.parkpower.com	R/C/I ACTIVE
Plymouth Rock Energy, LLC 338 Maitland Avenue Teaneck, NJ 07666	(855) 32-POWER (76937) www.plymouthenergy.com	R/C/I ACTIVE
Power Management Co., LLC b/b/a PMC Lightsavers Limited Liability Company 1600 Moseley Road Victor, NY 14564	(585) 249-1360 www.powermanagementco.com	C/I ACTIVE
PPL Energy Plus, LLC 811 Church Road Cherry Hill, NJ 08002	(800) 281-2000 www.pplenergyplus.com	C/I ACTIVE
PPL EnergyPlus Retail, LLC 788 Shrewsbury Avenue, Suite 220 Tinton Falls, NJ 07724	(732) 741-0505 – 2000 www.pplenergyplus.com	C/I ACTIVE
Progressive Energy Consulting, LLC	(917) 837-7400	R/C/I

PO Box 4582 Wayne, New Jersey 07474	Progressivenrg@optionline.net	ACTIVE
Prospect Resources, Inc. 208 W. State Street Trenton, NJ 08608-1002	(847) 673-1959 www.prospectresources.com	C ACTIVE
Public Power & Utility of New Jersey, LLC One International Blvd, Suite 400 Mahwah, NJ 07495	(888) 354-4415 www.ppandu.com	R/C/I ACTIVE
Reliant Energy 211 Carnegie Center Princeton, NJ 08540	(877) 297-3795 (877) 297-3780 www.reliant.com	R/C/I ACTIVE
ResCom Energy LLC 18C Wave Crest Ave. Winfield Park, NJ 07036	(888) 238-4041 http://rescomenergy.com	R/C/I ACTIVE
Residents Energy, LLC 550 Broad Street Newark, NJ 07102	(888) 828-7374 www.residentsenergy.com	R/C
Respond Power LLC 1001 East Lawn Drive Teaneck, NJ 07666	(877) 973-7763 www.majorenergy.com	R/C/I ACTIVE
Save on Energy, LLC 1101 Red Ventures Drive Fort Mill, SC 29707	1 (877)-658-3183 www.saveonenergy.com	R/C
SFE Energy One Gateway Center Suite 2600 Newark, NJ 07012	1 (877) 316-6344 www.sfeenergy.com	R/C/I ACTIVE
S.J. Energy Partners, Inc. 208 White Horse Pike, Suite 4 Barrington, NJ 08007	(800) 695-0666 www.sjnaturalgas.com	C ACTIVE
SmartEnergy Holdings, LLC 100 Overlook Center 2nd Floor Princeton, NJ NJ 08540 United States of America	(800) 443-4440 www.smartenergy.com	R/C/I ACTIVE
South Jersey Energy Company 1 South Jersey Plaza, Route 54 Folsom, NJ 08037	(800) 266-6020 www.southjerseyenergy.com	R/C/I ACTIVE

Spark Energy Gas, LP/ Spark Energy 2105 City West Blvd. Suite 100 Houston, TX 77042	(713)600-2600 www.sparkenergy.com	R/C/I ACTIVE
Sperian Energy Corp. 1200 Route 22 East, Suite 2000 Bridgewater, NJ 08807	(888) 682-8082 www.sperianenergy.com	R/C/I ACTIVE
Starion Energy PA Inc. 101 Warburton Avenue Hawthorne, NJ 07506	(800) 600-3040 www.starionenergy.com	R/C/I ACTIVE
Stream Energy New Jersey, LLC 309 Fellowship Rd., Suite 200 Mt. Laurel, NJ 08054	(877) 369-8150 www.streamenergy.net	R/C ACTIVE
Summit Energy Services, Inc. 10350 Ormsby Park Place Suite 400 Louisville, KY 40223	1 (800) 90-SUMMIT www.summitenergy.com	C/I ACTIVE
Texas Retail Energy LLC Park 80 West Plaza II, Suite 200 Saddle Brook, NJ 07663 Attn: Chris Hendrix	(866) 532-0761 Texasretailenergy.com	C/I ACTIVE
TransCanada Power Marketing Ltd. 190 Middlesex Essex Turnpike, Suite 200 Iselin, NJ 08830	(877) MEGAWAT www.transcanada.com/powermarketing	C/I ACTIVE
TriEagle Energy, LP 90 Washington Valley Rd Bedminster, NJ 07921	(877) 933-2453 www.trieagleenergy.com	R/C/I ACTIVE
UGI Energy Services, Inc. dba UGI Energy Link 224 Strawbridge Drive Suite 107 Moorestown, NJ 08057	(800) 427-8545 www.ugienergylink.com	C/I ACTIVE
Verde Energy USA, Inc. 2001 Route 46 Waterview Plaza Suite 301 Parsippany, NJ 07054	(800) 388-3862 www.lowcostpower.com	R/C ACTIVE

Viridian Energy 2001 Route 46, Waterview Plaza Suite 310 Parsippany, NJ 07054	(866) 663-2508 www.viridian.com	R/C/I ACTIVE
XOOM Energy New Jersey, LLC 744 Broad Street. 16 th Floor Newark, NJ 07102	(888) 997-8979 www.xoomenergy.com	R/C/I ACTIVE
YEP Energy 89 Headquarters Plaza North #1463 Morristown, NJ 07960	(855) 363-7736 www.yepenergyNJ.com	R/C/I ACTIVE
Your Energy Holdings, LLC One International Boulevard Suite 400 Mahwah, NJ 07495-0400	(855) 732-2493 www.thisisyourenergy.com	R/C/I ACTIVE

[Back to the main supplier page](#)

PSE&G GAS SERVICE TERRITORY
Last Updated: 12/11/14

***CUSTOMER CLASS - R – RESIDENTIAL C – COMMERCIAL I - INDUSTRIAL**

Supplier	Telephone & Web Site	*Customer Class
Ambit Northeast, LLC d/b/a Ambit Energy 103 Carnegie Center Suite 300 Princeton, NJ 08540	877-282-6284 www.ambitenergy.com	R/C ACTIVE
Amerigreen Energy, Inc. 333 Sylvan Avenue Suite 206 Englewood Cliffs, NJ 07632	(888)559-4567 www.amerigreen.com	R/C/I ACTIVE
Astral Energy LLC 16 Tyson Place Bergenfield, NJ 07621	888-850-1872 www.AstralEnergyLLC.com	R/C/I ACTIVE
BBPC, LLC Great Eastern Energy 116 Village Blvd. Suite 200 Princeton, NJ 08540	888-651-4121 www.greateasternenergy.com	C ACTIVE
Choice Energy, LLC 4257 US Highway 9, Suite 6C Freehold, NJ 07728	(888) 565-4490 www.4choiceenergy.com	R/C/I
Clearview Electric Inc. d/b/a Clearview Gas 1744 Lexington Ave. Pennsauken, NJ 08110	800-746-4720 www.clearviewenergy.com	R/C ACTIVE
Colonial Energy, Inc. 83 Harding Road Wyckoff, NJ 07481	845-429-3229 www.colonialgroupinc.com	C/I ACTIVE
Commerce Energy, Inc. 7 Cedar Terrace Ramsey, NJ 07746	888 817-8572 www.commerceenergy.com	R ACTIVE
Compass Energy Services, Inc. 33 Wood Avenue South, 610 Iselin, NJ 08830	866-867-8328 www.compassenergy.net	C/I ACTIVE

Compass Energy Gas Services, LLC 33 Wood Avenue South Suite 610 Iselin, NJ 08830	866-867-8328 www.compassenergy.net	C/I ACTIVE
ConocoPhillips Company 224 Strawbridge Drive, Suite 107 Moorestown, NJ 08057	800-646-4427 www.conocophillips.com	C/I ACTIVE
Consolidated Edison Energy, Inc. d/b/a Con Edison Solutions 535 State Highway 38, Suite 140 Cherry Hill, NJ 08002	888-686-1383 x2130 www.conedenergy.com	
Consolidated Edison Solutions, Inc. Cherry Tree Corporate Center 535 State Highway 38, Suite 140 Cherry Hill, NJ 08002	888-665-0955 www.conedsolutions.com	C/I ACTIVE
Constellation NewEnergy-Gas Division, LLC 116 Village Boulevard, Suite 200 Princeton, NJ 08540	800-785-4373 www.constellation.com	C/I ACTIVE
Constellation Energy Gas Choice, Inc. 116 Village Blvd., Suite 200 Princeton, NJ 08540	800-785-4373 www.constellation.com	R/C/I ACTIVE
Direct Energy Business, LLC 120 Wood Avenue, Suite 611 Iselin, NJ 08830	888-925-9115 http://www.business.directenergy.com/	R ACTIVE
Direct Energy Business Marketing, LLC (fka Hess Energy Marketing) One Hess Plaza Woodbridge, NJ 07095	(800) 437-7872 http://www.business.directenergy.com/	C/I ACTIVE
Direct Energy Services, LLC 120 Wood Avenue, Suite 611 Iselin, NJ 08830	(888) 925-9115 www.directenergy.com	R ACTIVE

Direct Energy Small Business, LLC (fka Hess Small Business Services, LLC) One Hess Plaza Woodbridge, NJ 07095	(888) 464-4377 http://www.business.directenergy.com/	C/I ACTIVE
Gateway Energy Services Corp. 120 Wood Avenue Suite 611 Iselin, NJ 08830	(866) 348-4193 www.gesc.com	R/C ACTIVE
Glacial Energy of New Jersey, Inc. 21 Pine Street, Suite 237 Rockaway, NJ 07866	888-452-2425 www.glacialenergy.com	C/I ACTIVE
Global Energy Marketing, LLC 129 Wentz Avenue Springfield, NJ 07081	800-542-0778 www.globalp.com	C/I ACTIVE
Great Eastern Energy 116 Village Blvd., Suite 200 Princeton, NJ 08540	888-651-4121 www.greateastern.com	C/I ACTIVE
Greenlight Energy 330 Hudson Street, Suite 4 Hoboken, NJ 07030	718-204-7467 www.greenlightenergy.us	C ACTIVE
Harborside Energy LLC 101 Hudson Street, Suite 2100 Jersey City, NJ 07302	877-940-3835 www.harborsideenergynj.com	R/C ACTIVE
Hess Energy, Inc. One Hess Plaza Woodbridge, NJ 07095	800-437-7872 www.hess.com	C/I ACTIVE
HIKO Energy, LLC 655 Suffern Road Teaneck, NJ 07666	888 264-4908 www.hikoenergy.com	R/C/I ACTIVE
Hudson Energy Services, LLC 7 Cedar Street Ramsey, NJ 07446	877- Hudson 9 www.hudsonenergyservices.com	C ACTIVE
IDT Energy, Inc. 550 Broad Street Newark, NJ 07102	877-887-6866 www.idtenergy.com	R/C ACTIVE

Infinite Energy dba Intelligent Energy 1200 Route 22 East Suite 2000 Bridgewater, NJ 08807-2943	(800) 927-9794 www.InfiniteEnergy.com	R/C/I ACTIVE
Integrays Energy Services-Natural Gas, LLC 101 Eisenhower Parkway Suite 300 Roseland, NJ 07068	(800) 536-0151 www.integraysenergy.com	C/I ACTIVE
Jsynergy LLC 445 Cental Ave. Suite 204 Cedarhurst, NY 11516	(516) 331-2020 www.Jsnergylc.com	R/C/I ACTIVE
Major Energy Services, LLC 1001 East Lawn Drive Teaneck NJ 07666	888-625-6760 www.majorenergy.com	R/C/I ACTIVE
Marathon Power LLC 302 Main Street Paterson, NJ 07505	888-779-7255 www.mecny.com	R/C/I ACTIVE
Metromedia Energy, Inc. 6 Industrial Way Eatontown, NJ 07724	1-877-750-7046 www.metromediaenergy.com	C/I ACTIVE
Metro Energy Group, LLC 14 Washington Place Hackensack, NJ 07601	888-53-Metro www.metroenergy.com	R/C ACTIVE
MPower Energy NJ LLC One University Plaza, Suite 507 Hackensack, NJ 07601	877-286-7693 www.mpowerenergy.com	R/C/I ACTIVE
NATGASCO (Supreme Energy, Inc.) 532 Freeman Street Orange, NJ 07050	800-840-4427 www.supremeenergyinc.com	R/C/I ACTIVE
New Energy Services LLC 101 Neptune Avenue Deal, New Jersey 07723	800-660-3643 www.newenergyservicesllc.com	R/C/I ACTIVE
New Jersey Gas & Electric 10 North Park Place Suite 420 Morristown, NJ 07960	866-568-0290 www.njgande.com	R/C ACTIVE

Noble Americas Energy Solutions The Mac-Cali Building 581 Main Street, 8th fl. Woodbridge, NJ 07095	877-273-6772 www.noblesolutions.com	C/I ACTIVE
North American Power & Gas, LLC d/b/a North American Power 197 Route 18 South Ste. 300 New Brunswick, NJ 08816	888- 313-8086 www.napower.com	R/C/I ACTIVE
North Eastern States, Inc. d/b/a Entrust Energy 90 Washington Valley Road Bedminster, NJ 07921	(888) 535-6340 www.entrustenergy.com	R/C/I ACTIVE
Oasis Power, LLC d/b/a Oasis Energy 11152 Westheimer, Suite 901 Houston, TX 77042	(800)324-3046 www.oasisenergy.com	R/C ACTIVE
Palmco Energy NJ, LLC One Greentree Centre 10,000 Lincoln Drive East, Suite 201 Marlton, NJ 08053	877-726-5862 www.PalmcoEnergy.com	R/C/I ACTIVE
Plymouth Rock Energy, LLC 338 Maitland Avenue Teaneck, NJ 07666	855-32-POWER (76937) www.plymouthenergy.com	R/C/I ACTIVE
PPL EnergyPlus, LLC Shrewsbury Executive Offices 788 Shrewsbury Avenue Suite 2200 Tinton Falls, NJ 07724	(732) 741-0505 www.pplenergyplus.com	C/I ACTIVE
PPL EnergyPlus Retail, LLC Shrewsbury Executive Offices 788 Shrewsbury Avenue, Suite 220 Tinton Falls, NJ 07724	(732) 741-0505 – 2000 www.pplenergyplus.com	C/I ACTIVE
Public Power & Utility of New Jersey, LLC One International Blvd, Suite 400 Mahwah, NJ 07495	(888) 354-4415 www.ppandu.com	R/C/I ACTIVE

Residents Energy, LLC 550 Broad Street Newark, NJ 07102	(888) 828-7374 www.residentsenergy.com	R/C
Respond Power LLC 1001 East Lawn Drive Teaneck, NJ 07666	(877) 973-7763 www.respondpower.com	R/C/I ACTIVE
Save on Energy, LLC 1101 Red Ventures Drive Fort Mill, SC 29707	1 (877) 658-3183 www.saveonenergy.com	R/C ACTIVE
SFE Energy One Gateway Center Suite 2600 Newark, NJ 07012	1 (877) 316-6344 www.sfeenergy.com	R/C/I ACTIVE
S.J. Energy Partners, Inc. 208 White Horse Pike, Suite 4 Barrington, NJ 08007	(800) 695-0666 www.sjnaturalgas.com	C ACTIVE
South Jersey Energy Company 1 South Jersey Plaza, Route 54 Folsom, NJ 08037	800-266-6020 www.southjerseyenergy.com	R/C/I ACTIVE
SouthStar Energy d/b/a New Jersey Energy 1085 Morris Avenue, Suite 155 Union, NJ 07083	(866) 477-8823 www.newjerseyenergy.com	R/C ACTIVE
Spark Energy Gas, LP/ Spark Energy 2105 City West Blvd. Suite 100 Houston, TX 77042	(713)600-2600 www.sparkenergy.com	R/C/I ACTIVE
Sperian Energy Corp. Bridgewater Center 1200 Route 22 East Bridgewater, NJ 08807	888-682-8082 www.sperianenergy.com	R/C/I ACTIVE
Sprague Energy Corp. 12 Ridge Road Chatham Township, NJ 07928	855-466-2842 www.spragueenergy.com	C/I ACTIVE
Stuyvesant Energy LLC 10 West Ivy Lane, Suite 4 Englewood, NJ 07631	800-640-6457 www.stuyfuel.com	C ACTIVE

Stream Energy New Jersey, LLC 309 Fellowship Road Suite 200 Mt. Laurel, NJ 08054	(877) 369-8150 www.streamenergy.net	R/C ACTIVE
Summit Energy Services, Inc. 10350 Ormsby Park Place Suite 400 Louisville, KY 40223	1 (800) 90-SUMMIT www.summitenergy.com	C/I ACTIVE
Systrum Energy 1 Bergen Blvd. Fairview, NJ 07022	877-797-8786 www.systrumenergy.com	R/C/I ACTIVE
Tiger Natural Gas, Inc. dba Tiger, Inc. 234 20th Avenue Brick, NJ 008724	888-875-6122 www.tigernaturalgas.com	R/C/I ACTIVE
UGI Energy Services, Inc. dba UGI Energy Link 224 Strawbridge Drive, Suite 107 Moorestown, NJ 08057	800-427-8545 www.ugienergylink.com	C/I ACTIVE
UGI Energy Services, Inc. d/b/a GASMARK 224 Strawbridge Drive, Suite 107 Moorestown, NJ 08057	856-273-9995 www.ugienergylink.com	C/I ACTIVE
Verde Energy USA, Inc. 2001 Route 46 Waterview Plaza, Suite 301 Parsippany, NJ 07054	800-388-3862 www.lowcostpower.com	R/C ACTIVE
Viridian Energy PA LLC 2001 Route 46, Waterview Plaza Suite 230 Parsippany, NJ 07054	866-663-2508 www.viridian.com	R/C ACTIVE
Vista Energy Marketing, L.P. 197 State Route 18 South, Suite 3000 South Wing East Brunswick, NJ 08816	888-508-4782 www.vistaenergymarketing.com	R/C/I ACTIVE
Woodruff Energy 73 Water Street Bridgeton, NJ 08302	800-557-1121 www.woodruffenergy.com	R/C/I ACTIVE

Woodruff Energy US LLC 73 Water Street, P.O. Box 777 Bridgeton, NJ 08302	856-455-1111 800-557-1121 www.woodruffenergy.com	C/I ACTIVE
XOOM Energy New Jersey, LLC 744 Broad Street. 16th Floor Newark, NJ 07102	888-997-8979 www.xoomenergy.com	R/C/I ACTIVE
Your Energy Holdings, LLC One International Boulevard Suite 400 Mahwah, NJ 07495-0400	855-732-2493 www.thisisyourenergy.com	R/C/I ACTIVE

[Back to main supplier information page](#)

APPENDIX B

Equipment Inventory

CHA Project # 30237
Ridge Elementary School
325 W. Ridgewood Avenue Ridgewood, NJ 07450

Description	Column #	Manufacturer Name	Model No.	Serial No.	Equipment Type / Make	Capacity/Size / Efficiency	Efficiency	Location	Areas/Equipment Served	Date Installed	Remaining Useful Life (years)	Other Info.	Current year	Years Old	ASHRAE life expectancy
Hot Air Furnace	1	N/A	N/A	N/A	Gas Fired Hot Air Furnace	3750 MBH Max. Input	N/A	Furnace Room	Hot Air to spaces in original building	1999	-38	Gas burner was installed in 2003	2015	56	18
Rooftop Unit	1	Trane	YCD240B3HBF	P31104812D	Rooftop Unit with gas heating and electric cooling	20 ton nominal cooling and 400 MBH Input / 324 MBH Output gas furnace	9.5 EER / 81% gas furnace efficiency	Roof	Classrooms 43 thru 49	1999	-1		2015	16	15
Rooftop Unit	1	Trane	YCD048C3HBBF	P31103737D	Rooftop Unit with gas heating and electric cooling	4 ton nominal cooling and 120 MBH Input / 97.2 MBH Output gas furnace	10.9 EER / 80% gas furnace efficiency	Roof	Classroom 41	1999	-1		2015	16	15
Rooftop Unit	1	Trane	YCD048C3HBBF	P31103878D	Rooftop Unit with gas heating and electric cooling	4 ton nominal cooling and 120 MBH Input / 97.2 MBH Output gas furnace	10.9 EER / 80% gas furnace efficiency	Roof	Classroom 42	1999	-1		2015	16	15
Rooftop Unit	1	Aaon	RN-009-8-0-EA09-3F9	201012-ANG013233	Rooftop Unit with gas heating and electric cooling	9 ton nominal cooling and 195 MBH Input / 156 MBH Output gas furnace	80% Gas Furnace Efficiency	Roof	Classrooms / Rooms 52 thru 57	2010	10		2015	5	15
Rooftop Unit	1	Aaon	RN-016-8-0-EA09-349	201011-BNGM13255	Rooftop Unit with gas heating and electric cooling	16 ton nominal cooling and 270 MBH Input / 219 MBH Output gas furnace	81% gas furnace efficiency	Roof	Multi-Purpose Room	2010	10		2015	5	15
DX Split Heat Pump Unit	1	Daikin	RZQ18PVJU	N/A	DX Split Heat Pump Unit	18 MBH Coolig and 20 MBH Heating Capacities	N/A	Roof	Room 58	2010	10		2015	5	15
DX Split Heat Pump Unit	1	Daikin	RXS36HVJU	A000739	DX Split Heat Pump Unit	36 MBH Cooling and 38 MBH Heating Capacities	N/A	Roof	IDF Closet Room 55	2010	10		2015	5	15
Ductless DX Split AC Unit	1	Daikin	RXS36HVJU	A000737	DX Split Heat Pump Unit	36 MBH Cooling and 38 MBH Heating Capacities	N/A	Roof	Computer Room 15	2010	10		2015	5	15
Ductless DX Split AC Unit	1	Toshiba	N/A	N/A	DX Split Heat Pump Unit	N/A	N/A	Grade	Closet in Principal's Office	2010	10		2015	5	15
Water Heater	1	Rheem	43VP50SE2	RHLN1110901728	Gas fired water heater	38 MBH Input 50 Gallon Storage	N/A	Furnace Room	Domestic Hot Water to spaces in original building	2010	10		2015	5	15
Centrifugal Pump	1	Bell and Gossett	N/A	N/A	Centrifugal Pump with FHP Motor	N/A	N/A	Furnace Room	Domestic Hot Water to spaces in original building	2010	5		2015	5	10
Water Heater	1	A O Smith	BTX 100 120	1101M000889	Gas fired condensing water heater	100 MBH Input 116.36 GPH Recovery Rate	96% Thermal Efficiency	Room 54A	Domestic Hot Water to spaces in new wing	2011	11		2015	4	15
Centrifugal Pump	1	Taco	N/A	N/A	Centrifugal Pump with FHP Motor	N/A	N/A	Room 54A	Domestic hot water to spaces in new wing	2011	6		2015	4	10

APPENDIX C

ECM Calculations

Energy Audit of Ridgewood Schools - Ridge ES
CHA Project No.30040

ECM-L1 Lighting Replacements

Budgetary	Annual Utility Savings				Estimated	Total	New Jersey	Payback	Payback
Cost					Maintenance	Savings	Incentive	(without incentive)	(with incentive)
\$	kW	kWh	therms	\$	\$	\$	\$	Years	Years
\$62,825	10.48	28,743.5	0	\$4,541	0	\$4,541	\$2,785	13.8	13.2

*Incentive based on New Jersey Smart Start Prescriptive Lighting Measures

ECM-L2 Install Occupancy Sensors

Budgetary	Annual Utility Savings				Estimated	Total	New Jersey	Payback	Payback
Cost					Maintenance	Savings	Incentive	(without incentive)	(with incentive)
\$	kW	kWh	therms	\$	\$	\$	\$	Years	Years
\$4,745	0.0	3,599	0	\$569	0	\$569	\$740	8.3	7.0

*Incentive based on New Jersey Smart Start Prescriptive Lighting Measures

ECM-L3 Lighting Replacements with Occupancy Sensors

Budgetary	Annual Utility Savings				Estimated	Total	New Jersey	Payback	Payback
Cost					Maintenance	Savings	Incentive	(without incentive)	(with incentive)
\$	kW	kWh	therms	\$	\$	\$	\$	Years	Years
\$67,570	10.5	31,887	0	\$5,038	0	\$5,038	\$3,525	13.4	12.7

*Incentive based on New Jersey Smart Start Prescriptive Lighting Measures

Cost of Electricity:

\$0.158	\$/kWh
\$0.00	\$/kW

EXISTING CONDITIONS												Retrofit Control
Field Code	Area Description	Usage	No. of Fixtures	Standard Fixture Code	Fixture Code	Watts per Fixture	kW/Space	Exist Control	Annual Hours	Annual kWh		
	Unique description of the location - Room number/Room name: Floor number (if applicable)	Describe Usage Type using Operating Hours	No. of fixtures before the retrofit	Lighting Fixture Code	Code from Table of Standard Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	Pre-inst. control device	Estimated annual hours for the usage group	(kW/space) * (Annual Hours)	Retrofit control device	Notes
35LED	Room 38	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 39	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 40	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
46LED	Room 41	Classrooms	16	W 32 P F 2 (ELE)	F42ILL	59	0.94	SW	2600	2,454	OCC	
32LED	Room 41	Classrooms	3	1T 32 R F 2 (ELE)	F42LL	60	0.18	SW	2600	468	OCC	
46LED	Room 42	Classrooms	18	W 32 P F 2 (ELE)	F42ILL	59	1.06	SW	2600	2,761	OCC	
35LED	OT/PT	Classrooms	5	T 32 R F 3 (ELE)	F43ILL/2	90	0.45	SW	2600	1,170	OCC	
46LED	Room 44	Classrooms	12	W 32 P F 2 (ELE)	F42ILL	59	0.71	SW	2600	1,841	OCC	
46LED	Room 46	Classrooms	12	W 32 P F 2 (ELE)	F42ILL	59	0.71	SW	2600	1,841	OCC	
46LED	Room47	Classrooms	14	W 32 P F 2 (ELE)	F42ILL	59	0.83	SW	2600	2,148	OCC	
40LED	Restrooms	Restroom	5	T 32 R F 2 (ELE)	F42LL	60	0.30	SW	2600	780	OCC	
102	Restrooms	Restroom	3	O CF 26	CFQ26/1-L	27	0.08	SW	2600	211	OCC	
40LED	Corridors	Stairway and Hallways	27	T 32 R F 2 (ELE)	F42LL	60	1.62	SW	3640	5,897	NONE	
35LED	Room 34	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room35	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 36	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 37	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Corridors	Stairway and Hallways	12	T 32 R F 3 (ELE)	F43ILL/2	90	1.08	SW	3640	3,931	NONE	
102	Restrooms	Restroom	4	O CF 26	CFQ26/1-L	27	0.11	SW	2600	281	OCC	
46LED	Room 48	Classrooms	5	W 32 P F 2 (ELE)	F42ILL	59	0.30	SW	2600	767	OCC	
46LED	Room 49	Classrooms	2	W 32 P F 2 (ELE)	F42ILL	59	0.12	SW	2600	307	OCC	
46LED	Restrooms	Restroom	2	W 32 P F 2 (ELE)	F42ILL	59	0.12	SW	2600	307	OCC	
46LED	PE Office	Offices	3	W 32 P F 2 (ELE)	F42ILL	59	0.18	SW	2600	460	OCC	
46	Room 32 MDF	Offices	8	W 32 C F 2 (ELE)	F42LL	60	0.48	SW	2600	1,248	OCC	
102	Room 32 MDF	Offices	1	O CF 26	CFQ26/1-L	27	0.03	SW	2600	70	OCC	
102	Room 33	Storage Areas	1	O CF 26	CFQ26/1-L	27	0.03	SW	1040	28	OCC	
108	Closet	Storage Areas	1	I 65	I65/1	65	0.07	SW	1040	68	OCC	
40LED	Corridors	Stairway and Hallways	8	T 32 R F 2 (ELE)	F42LL	60	0.48	SW	3640	1,747	NONE	
237	Gymnasium	Gymnasium	12	MV 250	mv250/1	290	3.48	SW	3000	10,440	OCC	
254LED	Stage Room 30A	Storage Areas	7	CFQ26/2	CFQ26/2	66	0.46	SW	1040	480	OCC	
35LED	Library	Media Center	24	T 32 R F 3 (ELE)	F43ILL/2	90	2.16	SW	2600	5,616	OCC	
102	Stage Room 30A	Storage Areas	2	O CF 26	CFQ26/1-L	27	0.05	SW	1040	56	OCC	
254LED	Corridors	Stairway and Hallways	6	CFQ26/2	CFQ26/2	66	0.40	SW	3640	1,441	NONE	
35LED	Room 29	Classrooms	10	T 32 R F 3 (ELE)	F43ILL/2	90	0.90	SW	2600	2,340	OCC	
102	Storage	Storage Areas	1	O CF 26	CFQ26/1-L	27	0.03	SW	1040	28	OCC	
102	Restrooms	Restroom	4	O CF 26	CFQ26/1-L	27	0.11	SW	2600	281	OCC	
65	Restrooms	Restroom	2	I 100	I100/1	100	0.20	SW	2600	520	OCC	
46	Faculty	Offices	12	W 32 C F 2 (ELE)	F42LL	60	0.72	SW	2600	1,872	OCC	
254LED	Faculty	Offices	3	CFQ26/2	CFQ26/2	66	0.20	SW	2600	515	OCC	
65	Closet	Storage Areas	1	I 100	I100/1	100	0.10	SW	1040	104	OCC	
35LED	Room 17	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 18	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 19	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 20	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 21	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 23	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 24	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Corridors	Stairway and Hallways	24	T 32 R F 3 (ELE)	F43ILL/2	90	2.16	SW	3640	7,862	NONE	
112	Room 22	Storage Areas	6	I 40 W F 2	I40/1	40	0.24	SW	1040	250	OCC	
199	Furnace Room	Boiler Room	2	W 32 C F 1 (ELE)	F41LL	32	0.06	SW	3750	240	OCC	
46	Furnace Room	Boiler Room	2	W 32 C F 2 (ELE)	F42LL	60	0.12	SW	3750	450	OCC	
102	Furnace Room	Boiler Room	1	O CF 26	CFQ26/1-L	27	0.03	SW	3750	101	OCC	
5LED	Corridors	Stairway and Hallways	3	2T 32 R F 2 (u) (ELE)	FU2LL	60	0.18	SW	3640	655	NONE	
40LED	Restrooms	Restroom	2	T 32 R F 2 (ELE)	F42LL	60	0.12	SW	2600	312	OCC	
102	Janitor's Closet	Janitor's Closet	1	O CF 26	CFQ26/1-L	27	0.03	SW	1092	29	OCC	
46	Restrooms	Restroom	4	W 32 C F 2 (ELE)	F42LL	60	0.24	SW	2600	624	OCC	
70	Restrooms	Restroom	4	W 32 C F 1	F41LL	32	0.13	SW	2600	333	OCC	
65	Restrooms	Restroom	1	I 100	I100/1	100	0.10	SW	2600	260	OCC	
102	Storage	Storage Areas	1	O CF 26	CFQ26/1-L	27	0.03	SW	1040	28	OCC	
46	Storage	Storage Areas	2	W 32 C F 2 (ELE)	F42LL	60	0.12	SW	1040	125	OCC	
112	Room 9	Offices	5	I 40 W F 2	I40/1	40	0.20	SW	2600	520	OCC	
35LED	Corridors	Stairway and Hallways	19	T 32 R F 3 (ELE)	F43ILL/2	90	1.71	SW	3640	6,224	NONE	
46LED	Room 15	Classrooms	15	W 32 P F 2 (ELE)	F42ILL	59	0.89	SW	2600	2,301	OCC	
35LED	Room 10	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
46LED	Room 11	Classrooms	12	W 32 P F 2 (ELE)	F42ILL	59	0.71	SW	2600	1,841	OCC	
35LED	Room 12	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 13	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	
35LED	Room 14	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2600	2,106	OCC	

Cost of Electricity:

\$0.158	\$/kWh
\$0.00	\$/kW

EXISTING CONDITIONS												Retrofit Control
Field Code	Area Description	Usage	No. of Fixtures	Standard Fixture Code	Fixture Code	Watts per Fixture	kW/Space	Exist Control	Annual Hours	Annual kWh		
	Unique description of the location - Room number/Room name: Floor number (if applicable)	Describe Usage Type using Operating Hours	No. of fixtures before the retrofit	Lighting Fixture Code	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	Pre-inst. control device	Estimated annual hours for the usage group	(kW/space) * (Annual Hours)	Retrofit control device	Notes
35LED	Multipurpose Room	Gymnasium	40	T 32 R F 3 (ELE)	F43ILL/2	90	3.60	SW	3000	10,800	OCC	
40LED	Rooms 50 A B and C	Storage Areas	8	T 32 R F 2 (ELE)	F42LL	60	0.48	SW	1040	499	OCC	
46LED	Room 52	Classrooms	11	W 32 P F 2 (ELE)	F42ILL	59	0.65	SW	2600	1,687	OCC	
46LED	Room 53	Classrooms	11	W 32 P F 2 (ELE)	F42ILL	59	0.65	SW	2600	1,687	OCC	
46LED	Room 54	Classrooms	20	W 32 P F 2 (ELE)	F42ILL	59	1.18	SW	2600	3,068	OCC	
102	Room 54	Classrooms	10	O CF 26	CFQ26/1-L	27	0.27	SW	2600	702	OCC	
40LED	Room 54 A	Storage Areas	1	T 32 R F 2 (ELE)	F42LL	60	0.06	OCC	1040	62	OCC	
40LED	Room 54 B	Storage Areas	1	T 32 R F 2 (ELE)	F42LL	60	0.06	OCC	1040	62	OCC	
40LED	Room 55	Storage Areas	1	T 32 R F 2 (ELE)	F42LL	60	0.06	SW	1040	62	OCC	
40LED	Room 56	Storage Areas	1	T 32 R F 2 (ELE)	F42LL	60	0.06	SW	1040	62	OCC	
40LED	Room 57	Storage Areas	2	T 32 R F 2 (ELE)	F42LL	60	0.12	SW	1040	125	OCC	
40LED	Corridors	Stairway and Hallways	16	T 32 R F 2 (ELE)	F42LL	60	0.96	SW	3640	3,494	NONE	
18LED	Nurse Room 2	Offices	5	T 32 R F 4 (ELE)	F44ILL	112	0.56	SW	2600	1,456	OCC	
108	Nurse Room 2	Offices	1	I 65	I65/1	65	0.07	SW	2600	169	OCC	
18LED	Restrooms	Restroom	1	T 32 R F 4 (ELE)	F44ILL	112	0.11	SW	2600	291	OCC	
46	Room 4	Offices	4	W 32 C F 2 (ELE)	F42LL	60	0.24	SW	2600	624	OCC	
35LED	Corridors	Stairway and Hallways	6	T 32 R F 3 (ELE)	F43ILL/2	90	0.54	SW	3640	1,966	NONE	
5LED	Room 6	Offices	4	2T 32 R F 2 (u) (ELE)	FU2LL	60	0.24	SW	2600	624	OCC	
32LED	Main Office Room 5	Offices	12	1T 32 R F 2 (ELE)	F42LL	60	0.72	SW	2600	1,872	OCC	
32LED	Principal Room 3	Offices	6	1T 32 R F 2 (ELE)	F42LL	60	0.36	SW	2600	936	OCC	
108	Restrooms	Restroom	1	I 65	I65/1	65	0.07	SW	2600	169	OCC	
102	Closet	Storage Areas	1	O CF 26	CFQ26/1-L	27	0.03	SW	1040	28	OCC	
32LED	Room 1	Offices	6	1T 32 R F 2 (ELE)	F42LL	60	0.36	SW	2600	936	OCC	
32LED	Room 58	Offices	6	1T 32 R F 2 (ELE)	F42LL	60	0.36	SW	2600	936	OCC	
102	Storage	Storage Areas	1	O CF 26	CFQ26/1-L	27	0.03	SW	1040	28	OCC	
65	Storage	Storage Areas	1	I 100	I100/1	100	0.10	SW	1040	104	OCC	
32LED	Corridors	Stairway and Hallways	3	1T 32 R F 2 (ELE)	F42LL	60	0.18	SW	3640	655	NONE	
35LED	Room 59	Classrooms	15	T 32 R F 3 (ELE)	F43ILL/2	90	1.35	SW	2600	3,510	OCC	
35LED	Room 60	Classrooms	15	T 32 R F 3 (ELE)	F43ILL/2	90	1.35	SW	2600	3,510	OCC	
227LED	Exterior	Outdoor Lighting	13	70 W MH Wall Pack	MH70/1	95	1.24	O	3640	4,495	PHC	
261LED	Exterior	Outdoor Lighting	2	PAR 38 SP	H100/1	100	0.20	SW	3640	728	OCC	
262LED	Exterior	Outdoor Lighting	6	CF42/1	CF42/1-I	48	0.29	SW	3640	1,048	OCC	
	Total		743				56.82			158,940		

		EXISTING CONDITIONS						RETROFIT CONDITIONS				COST & SAVINGS ANALYSIS						
Area Description		No. of Fixtures	Standard Fixture Code	Fixture Code	Watts per Fixture	kW/Space	kW/Space	Retrofit Control	Annual Hours	Annual kWh	Annual kWh Saved	Annual kW Saved	Annual \$ Saved	Retrofit Cost	NJ Smart Start Lighting Incentive	Simple Payback With Out Incentive	Simple Payback	
Field Code	Unique description of the location - Room number/Room name: Floor number (if applicable)	No. of fixtures before the retrofit	Lighting Fixture Code	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	(Watts/Fixt) * (Number of Fixtures)	Retrofit control device	Estimated annual hours for the usage group	(kW/Space) * (Annual Hours)	(Original Annual kWh) - (Retrofit Annual kWh)	(Original Annual kW) - (Retrofit Annual kW)	(kW Saved) * (\$/kWh)	Cost for renovations to lighting system		Length of time for renovations cost to be recovered	Length of time for renovations cost to be recovered	
35LED	Room 38	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.8	0.8	OCC	2600	2,106.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
35LED	Room 39	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.8	0.8	OCC	2600	2,106.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
35LED	Room 40	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.8	0.8	OCC	2600	2,106.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
46LED	Room 41	16	W 32 P F 2 (ELE)	F42ILL	59	0.9	0.9	OCC	2600	2,454.4	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
32LED	Room 41	3	1T 32 R F 2 (ELE)	F42LL	60	0.2	0.2	OCC	2600	468.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
46LED	Room 42	18	W 32 P F 2 (ELE)	F42ILL	59	1.1	1.1	OCC	2600	2,761.2	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
35LED	OT/PT	5	T 32 R F 3 (ELE)	F43ILL/2	90	0.5	0.5	OCC	2600	1,170.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
46LED	Room 44	12	W 32 P F 2 (ELE)	F42ILL	59	0.7	0.7	OCC	2600	1,840.8	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
46LED	Room 46	12	W 32 P F 2 (ELE)	F42ILL	59	0.7	0.7	OCC	2600	1,840.8	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
46LED	Room47	14	W 32 P F 2 (ELE)	F42ILL	59	0.8	0.8	OCC	2600	2,147.6	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
40LED	Restrooms	5	T 32 R F 2 (ELE)	F42LL	60	0.3	0.3	OCC	1820	546.0	234.0	0.0	\$36.97	\$128.25	\$20.00	3.5	2.9	
102	Restrooms	3	O CF 26	CFQ26/1-L	27	0.1	0.1	OCC	1820	147.4	63.2	0.0	\$9.98	\$128.25	\$20.00	12.8	10.8	
40LED	Corridors	27	T 32 R F 2 (ELE)	F42LL	60	1.6	1.6	NONE	3640	5,896.8	0.0	0.0	\$0.00	\$0.00	\$0.00		#DIV/0!	
35LED	Room 34	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.8	0.8	OCC	2600	2,106.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
35LED	Room35	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.8	0.8	OCC	2600	2,106.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
35LED	Room 36	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.8	0.8	OCC	2600	2,106.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
35LED	Room 37	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.8	0.8	OCC	2600	2,106.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
35LED	Corridors	12	T 32 R F 3 (ELE)	F43ILL/2	90	1.1	1.1	NONE	3640	3,931.2	0.0	0.0	\$0.00	\$0.00	\$0.00		#DIV/0!	
102	Restrooms	4	O CF 26	CFQ26/1-L	27	0.1	0.1	OCC	1820	196.6	84.2	0.0	\$13.31	\$128.25	\$20.00	9.6	8.1	
46LED	Room 48	5	W 32 P F 2 (ELE)	F42ILL	59	0.3	0.3	OCC	2600	767.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
46LED	Room 49	2	W 32 P F 2 (ELE)	F42ILL	59	0.1	0.1	OCC	2600	306.8	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
46LED	Restrooms	2	W 32 P F 2 (ELE)	F42ILL	59	0.1	0.1	OCC	1820	214.8	92.0	0.0	\$14.54	\$128.25	\$20.00	8.8	7.4	
46LED	PE Office	3	W 32 P F 2 (ELE)	F42ILL	59	0.2	0.2	OCC	2080	368.2	92.0	0.0	\$14.54	\$128.25	\$20.00	8.8	7.4	
46	Room 32 MDF	8	W 32 C F 2 (ELE)	F42LL	60	0.5	0.5	OCC	2080	998.4	249.6	0.0	\$39.44	\$128.25	\$20.00	3.3	2.7	
102	Room 32 MDF	1	O CF 26	CFQ26/1-L	27	0.0	0.0	OCC	2080	56.2	14.0	0.0	\$2.22	\$128.25	\$20.00	57.8	48.8	
102	Room 33	1	O CF 26	CFQ26/1-L	27	0.0	0.0	OCC	728	19.7	8.4	0.0	\$1.33	\$128.25	\$20.00	96.4	81.3	
108	Closet	1	I 65	I65/1	65	0.1	0.1	OCC	728	47.3	20.3	0.0	\$3.20	\$128.25	\$20.00	40.0	33.8	
40LED	Corridors	8	T 32 R F 2 (ELE)	F42LL	60	0.5	0.5	NONE	3640	1,747.2	0.0	0.0	\$0.00	\$0.00	\$0.00		#DIV/0!	
237	Gymnasium	12	MV 250	mv250/1	290	3.5	3.5	OCC	2400	8,352.0	2,088.0	0.0	\$329.90	\$128.25	\$20.00	0.4	0.3	
254LED	Stage Room 30A	7	CFQ26/2	CFQ26/2	66	0.5	0.5	OCC	728	336.3	144.1	0.0	\$22.77	\$128.25	\$20.00	5.6	4.8	
35LED	Library	24	T 32 R F 3 (ELE)	F43ILL/2	90	2.2	2.2	OCC	2600	5,616.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
102	Stage Room 30A	2	O CF 26	CFQ26/1-L	27	0.1	0.1	OCC	728	39.3	16.8	0.0	\$2.66	\$128.25	\$20.00	48.2	40.7	
254LED	Corridors	6	CFQ26/2	CFQ26/2	66	0.4	0.4	NONE	3640	1,441.4	0.0	0.0	\$0.00	\$0.00	\$0.00		#DIV/0!	
35LED	Room 29	10	T 32 R F 3 (ELE)	F43ILL/2	90	0.9	0.9	OCC	2600	2,340.0	0.0	0.0	\$0.00	\$128.25	\$20.00		#DIV/0!	
102	Storage	1	O CF 26	CFQ26/1-L	27	0.0	0.0	OCC	728	19.7	8.4	0.0	\$1.33	\$128.25	\$20.00	96.4	81.3	
102	Restrooms	4	O CF 26	CFQ26/1-L	27	0.1	0.1	OCC	1820	196.6	84.2	0.0	\$13.31	\$128.25	\$20.00	9.6	8.1	
40LED	Room 55	1	T 32 R F 2 (ELE)	F42LL	60	0.1	0.1	OCC	728	43.7	18.7	0.0	\$2.96	\$128.25	\$20.00	43.4	36.6	
40LED	Room 56	1	T 32 R F 2 (ELE)	F42LL	60	0.1	0.1	OCC	728	43.7	18.7	0.0	\$2.96	\$128.25	\$20.00	43.4	36.6	
40LED	Room 57	2	T 32 R F 2 (ELE)	F42LL	60	0.1	0.1	OCC	728	87.4	37.4	0.0	\$5.92	\$128.25	\$20.00	21.7	18.3	
40LED	Corridors	16	T 32 R F 2 (ELE)	F42LL	60	1.0	1.0	NONE	3640	3,494.4	0.0	0.0	\$0.00	\$0.00	\$0.00		#DIV/0!	
18LED	Nurse Room 2	5	T 32 R F 4 (ELE)	F44ILL	112	0.6	0.6	OCC	2080	1,164.8	291.2	0.0	\$46.01	\$128.25	\$20.00	2.8	2.4	
108	Nurse Room 2	1	I 65	I65/1	65	0.1	0.1	OCC	2080	135.2	33.8	0.0	\$5.34	\$128.25	\$20.00	24.0	20.3	
Total		317				24.9	24.9			65,978.66	3,599.38	0.0	568.7	4745.3	740.0			
										Demand Savings			0.0	\$0				

Page 1, ECM-L3

Ridgewood School District
CHA Project Numer: 30237

Rate of Discount (used for NPV) 3.0%

Utility Costs		Yearly Usage	Metric Ton Carbon Dioxide Equivalent	Building Area	Annual Utility Cost		
\$	0.158	\$/kWh blended		53,654	Electric	Natural Gas	Water
\$	0.158	\$/kWh supply	357,633		\$ 56,555	\$ 25,418	\$ 2,888
\$	-	\$/kW	0.0				
\$	0.86	\$/Therm	29,696				
\$	6.00	\$/kgals	516				
\$	-	\$/Gal	-				

Ridge Elementary School																						
Recommend? Y or N		Item	Savings					Cost	Simple Payback	Life Expectancy	GHG Reduction (Metric tons)	NJ Smart Start Incentives	Direct Install Eligible (Y/N)	Payback w/ Incentives	Simple Projected Lifetime Savings					ROI	NPV	IRR
			kW	kWh	therms	No. 2 Oil gal	Water kgal								kW	kWh	therms	kgal/yr	\$			
N	ECM-1	Replace single pane windows with double pane windows	0.0	1,298	4,414	0	0	3,983	\$ 753,500	189.2	25	\$ -	N	189.2	0.0	32,447	110,351	0	\$ 99,587	(0.9)	(\$684,135)	-11.9%
N	ECM-2	Replace RTUs with high efficiency RTUs	8.4	14,251		0	0	2,252	\$ 72,700	32.3	15	\$ 2,316	Y	31.3	126.6	213,759	0	0	\$ 33,774	(0.5)	(\$43,505)	-8.0%
N	ECM-3	Replace pneumatic control system with DDC control system	0.0	11,502	2,167	0	0	3,672	\$ 214,799	58.5	25	\$ -	N	58.5	0.0	287,551	54,180	0	\$ 91,811	(0.6)	(\$150,850)	-5.7%
Y	ECM-4	Install window AC unit controller	0.0	6,272	0	0	0	991	\$ 6,200	6.3	15	\$ -	N	6.3	0.0	94,077	0	0	\$ 14,864	1.4	\$5,630	13.6%
N	ECM-L1	Lighting Replacement / Upgrade	10.5	28,744	0	0	0	4,542	\$ 62,825	13.8	15	\$ 2,785	N	13.2	157.2	431,160	0	0	\$ 68,123	0.1	(\$5,823)	1.6%
N	ECM-L2	Install Lighting Controls (Add Occupancy Sensors)	0	3,599	0	0	0	569	\$ 4,745	8.3	15	\$ 740	N	7.0	0.0	53,985	0	0	\$ 8,530	0.8	\$2,783	11.4%
Y	ECM-L3	Lighting Replacements with Controls (Occupancy Sensors)	11	31,887	0	0	0	5,038	\$ 67,570	13.4	15	\$ 3,525	N	12.7	157.5	478,305	0	0	\$ 75,572	0.1	(\$3,900)	2.1%
Total			18.9	65,209	6,581	0	0	\$ 15,937	\$ 1,114,769	70.0	19.0	\$ 5,841		69.6	284	1,106,139	164,531	-	\$ 315,608	(0.7)	(876,760)	-10.6%
Recommended Measures (highlighted green above)			10.5	38,159	0	0	0	\$ 6,029	\$ 73,770	12.2	15.0	\$ 3,525		0	11.7	158	572,382	-	\$ 90,436	0.2	1,730	3.3%
% of Existing			#DIV/0!	11%	0%	0%	0															

City:		Newark, NJ				
Occupied Hours/Week		168				
		Building	Auditorium	Gymnasium	Library	Classrooms
		Operating	Occupied	Occupied	Occupied	Occupied
Temp	Enthalpy h (Btu/lb)	Bin Hours	Hours	Hours	Hours	Hours
102.5						
97.5	35.4	6	6	0	0	0
92.5	37.4	31	31	0	0	0
87.5	35.0	131	131	0	0	0
82.5	33.0	500	500	0	0	0
77.5	31.5	620	620	0	0	0
72.5	29.9	664	664	0	0	0
67.5	27.2	854	854	0	0	0
62.5	24.0	927	927	0	0	0
57.5	20.3	600	600	0	0	0
52.5	18.2	730	730	0	0	0
47.5	16.0	491	491	0	0	0
42.5	14.5	656	656	0	0	0
37.5	12.5	1,023	1,023	0	0	0
32.5	10.5	734	734	0	0	0
27.5	8.7	334	334	0	0	0
22.5	7.0	252	252	0	0	0
17.5	5.4	125	125	0	0	0
12.5	3.7	47	47	0	0	0
7.5	2.1	34	34	0	0	0
2.5	1.3	1	1	0	0	0
-2.5						
-7.5						

Multipliers	
Material:	1.027
Labor:	1.246
Equipment:	1.124

Heating System Efficiency	80%
Cooling Eff (kW/ton)	1.3

Heating	
Hours	4,427 Hrs
Weighted Avg	40 F
Avg	28 F



Cooling	
Hours	4,333 Hrs
Weighted Avg	68 F
Avg	78 F

Utility End Use Analysis		
Electricity Use (kWh):		Notes/Comments:
357,633	Total	Based on utility analysis
158,940	Lighting	From Lighting Calculations
25,000	Motors	Estimated
139,693	Cooling	Estimate based on calculations
20,000	Plug Load	Estimated
14,000	Computers	Estimated
Natural Gas Use (Therms):		Notes/Comments:
29,696	Total	Based on utility analysis
18,546	Gas Furnace	Remaining
2,150	Water Heater	Estimate based on calculations
9,000	Rooftop Units	Estimate based on calculations

44%
 7%
 39%
 6%
 4%
 0%

62%
 7%
 30%

100%

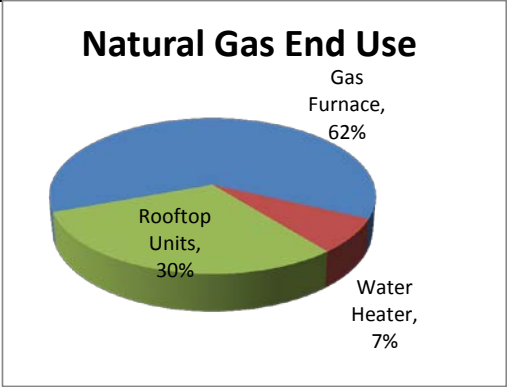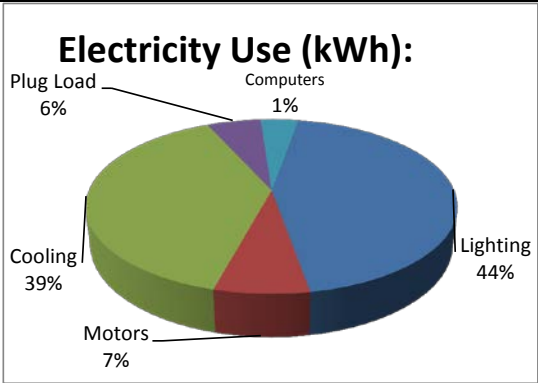

Ridgewood School District
CHA Project Numer: 30237
Ridge Elementary School

Note: pricing is for energy calculations only -do not use for procurement

ECM-1 Replace single pane windows with double pane windows

Existing: The building has old steel frame single pane windows which lead to large amount of the heating/cooling loss. Replacing the old windows with high heat resistance double pane windows will help reduce the energy loss and save energy.
Proposed: Replace single pane windows with double pane windows.

Linear Feet of panel Edge	1,858.0 LF	Cooling System Efficiency	1.3 kW/ton	Heating System Efficiency	80%
Area of Panel	5,200.0 SF	Ex Occupied Cing Temp.	76 °F	Heating On Temp.	50 °F
Existing Infiltration Factor	0.50 cfm/LF	Ex Unoccupied Cing Temp.	76 °F	Ex Occupied Htg Temp.	70 °F
Proposed Infiltration Factor	0.40 cfm/LF	Cooling Occ Enthalpy Setpoint	27.5 Btu/lb	Ex Unoccupied Htg Temp.	70 °F
Existing U Value	1.00 Btu/h/SF°F	Cooling Unocc Enthalpy Setpoint	34 Btu/lb	Electricity	\$ 0.158 \$/kWh
Proposed U Value	0.60 Btu/h/SF°F			Natural Gas	\$ 0.86 \$/therm

					EXISTING LOADS		PROPOSED LOADS		COOLING ENERGY		HEATING ENERGY	
					Occupied	Unoccupied	Occupied	Unoccupied				
Avg Outdoor Air Temp. Bins °F	Avg Outdoor Air Enthalpy	Existing Equipment Bin Hours	Occupied Equipment Bin Hours	Unoccupied Equipment Bin Hours	Panel Infiltration & Heat Load BTUH	Panel Infiltration & Heat Load BTUH	Panel Infiltration & Heat Load BTUH	Panel Infiltration & Heat Load BTUH	Existing Cooling Energy kWh	Proposed Cooling Energy kWh	Existing Heating Energy Therms	Proposed Heating Energy Therms
A		B	C	D	E	F	G	H	I	J	K	L
102.5	50.1	0	0	0	-232,279	-205,106	-158,263	-136,525	0	0	0	0
97.5	42.5	6	2	4	-174,508	-147,334	-117,246	-95,507	102	67	0	0
92.5	39.5	45	16	29	-135,966	-108,793	-91,613	-69,874	578	379	0	0
87.5	36.6	146	52	94	-97,843	-70,669	-66,314	-44,575	1272	828	0	0
82.5	34.0	298	106	192	-60,973	-33,800	-42,019	-20,280	1405	906	0	592
77.5	31.6	476	170	306	-24,940	2,233	-18,392	3,347	460	339	0	0
72.5	29.2	662	237	426	0	0	0	0	0	0	0	0
67.5	27.0	740	264	476	0	0	0	0	0	0	0	0
62.5	24.5	765	273	492	0	0	0	0	0	0	0	0
57.5	21.4	733	262	471	0	0	0	0	0	0	0	0
52.5	18.7	668	239	430	0	0	0	0	0	0	0	0
47.5	16.2	659	235	424	139,575	139,575	88,260	88,260	0	0	1,150	727
42.5	14.4	685	245	441	170,591	170,591	107,873	107,873	0	0	1,461	924
37.5	12.6	739	264	475	201,608	201,608	127,486	127,486	0	0	1,863	1,178
32.5	10.7	717	256	461	232,625	232,625	147,100	147,100	0	0	2,086	1,319
27.5	8.6	543	194	349	263,641	263,641	166,713	166,713	0	0	1,790	1,132
22.5	6.8	318	114	205	294,658	294,658	186,326	186,326	0	0	1,172	741
17.5	5.5	245	88	158	325,674	325,674	205,939	205,939	0	0	998	631
12.5	4.1	156	56	100	356,691	356,691	225,553	225,553	0	0	696	440
7.5	2.6	92	33	59	387,708	387,708	245,166	245,166	0	0	446	282
2.5	1.0	36	13	23	418,724	418,724	264,779	264,779	0	0	189	119
-2.5	0.0	19	7	12	449,741	449,741	284,393	284,393	0	0	107	68
-7.5	-1.5	8	3	5	480,757	480,757	304,006	304,006	0	0	48	30
TOTALS		8,760	3,129	5,631					3817	2519	12,006	7,592

Existing Panel Infiltration	929 cfm	Savings	4,414 Therms	\$ 3,778
Existing Panel Heat Transfer	5,200 Btu/h°F		1,298 kWh	\$ 205
Proposed Panel Infiltration	743 cfm			\$ 3,983
Proposed Panel Heat Transfer	3,120 Btu/h°F			

Panel ID	Location	Quantity	Width (ft)	Height (ft)	Linear Feet (LF)	Area (SF)	Infiltration Rate (CFM/LF)	U Value (Btu/h/SF°F)	Infiltration (CFM)	Heat Transfer (Btu/h°F)
1	Whole Building				1858.0	5200.0	0.5	1	929.0	5200.0
Total		0	0	0	1,858.0	5,200.0	0.50	1.00	929.0	5200.0

Multipliers	
Material:	1.10
Labor:	1.35
Equipment:	1.10

ECM-1 Replace single pane windows with double pane windows - Cost

Description	QTY	UNIT	UNIT COSTS			SUBTOTAL COSTS			TOTAL COST	REMARKS
			MAT.	LABOR	EQUIP.	MAT.	LABOR	EQUIP.		
Window Replacement	5,200	sqft	\$ 65	\$ 40	\$ -	\$338,000	\$208,000	\$ -	\$ 546,000	Vendor Est per SF

Cost estimated are for Energy Savings only- do not use for procurement

\$ 546,000	Subtotal
\$ 81,900	15% Contingency
\$ 125,580	20% Contractor O&P
\$ -	0% Engineering Fees
\$ 753,500	Total

Ridgewood School District
CHA Project Numer: 30237
Ridge Elementary School

ECM-2

Replace RTUs with high efficiency RTUs

Description: The school has 5 rooftop units, three of which were installed in 1999 and two were installed in 2010. The three units installed in 1999 are past their useful life. This ECM evaluates the energy savings associated with replacing older less efficient rooftop units with modern high efficiency rooftop units of the same capacities. Calculations show savings in electric power consumption only as it is assumed that the gas furnaces will have the same efficiencies.

Equipment Tag	Equipment Description	General Type	Cooling Capacity (Btu/h)	Heating Capacity (Btu/h)
AC-1	Rooftop Unit	4 ton unit	48,000	120 MBH
AC-2	Rooftop Unit	4 ton unit	48,000	120 MBH
AC-3	Rooftop Unit	20 ton unit	240,000	400 MBH
				-

Item	Value	Units	Formula/Comments
Demand Rate	\$ -	/ kW	
Electricity Rate	\$ 0.16	/kWh	
FORMULA CONSTANTS			
Coincidence Factor	0.67		NJ Protocols
Conversion	3.412	btu/kW	
COOLING			
Cooling Capacity	336,000	btu/hr	
Baseline EER	10.0		NJ Protocols
Proposed EER	16.0		NJ Protocols
Equivalent Full Load Hours	1,131	hrs	NJ Protocols
Demand Savings	8.44	kW	
Energy Savings	14,251	kWh	
SAVINGS			
Demand Savings	8.44	kW	
Energy Savings	14,251	kWh	
Cost Savings	\$ 2,252		

Savings calculation formulas are taken from NJ Protocols document for Electric HVAC Equipment

Ridgewood School District
CHA Project Numer: 30237
Ridge Elementary School

Multipliers	
Material:	1.03
Labor:	1.25
Equipment:	1.12

ECM-2 - Cost

Description	QTY	UNIT	UNIT COSTS			SUBTOTAL COSTS			TOTAL COST	REMARKS
			MAT.	LABOR	EQUIP.	MAT.	LABOR	EQUIP.		
						\$ -	\$ -	\$ -	\$ -	
Existing RTU demolition	3	EA	\$ 200	\$ 250		\$ 616	\$ 935	\$ -	\$ 1,551	RS Means 2012
4 Ton RTU	2	EA	\$ 6,000	\$ 1,500		\$ 12,324	\$ 3,738	\$ -	\$ 16,062	RS Means 2012
20 Ton RTU	1	EA	\$ 27,700	\$ 1,500		\$ 28,448	\$ 1,869	\$ -	\$ 30,317	
Controls	3	EA	\$ 75	\$ 300		\$ 231	\$ 1,121	\$ -	\$ 1,352	RS Means 2012
Electrical - misc.	1	LS	\$ 2,000	\$ 2,000		\$ 2,054	\$ 2,492	\$ -	\$ 4,546	Estimated
Crane	1	EA			\$ 3,000			\$ 3,372		

**Cost Estimates are for Energy Savings calculations only, do not use for procurement

\$ 53,828	Subtotal
\$ 18,840	35% Contingency
\$ 72,700	Total

ECM-3 Replace pneumatic control system with DDC control system

Description: The school's original building has a pneumatic control system. Although the existing pneumatic control system is in good working condition and provides basic day/night functions, the School District should consider replacing the existing pneumatic control system with a Direct Digital Control (DDC) system and integrate with the existing DDC system in the school. The advantages of this type of system include individual unit controllability and scheduling, trending of set points and alarm notifications for malfunctioning devices. Front end graphics available in a DDC system enable the maintenance staff to see the functioning of all systems at one location and provide service to trouble spots quickly and efficiently. Web based control systems allow access and adjustment from remote locations.

Building Information:

53,654	Sq Footage	\$0.16	\$/kWh Blended
Y	Cooling	\$0.86	\$/Therm
Y	Heating		

FULL DDC - TEMPERATURE SETBACK SAVINGS CALCULATION

EXISTING CONDITIONS		
Heating		
Heating Season Facility Temp	70	F
Weekly Occupied Hours	50	hrs
Heating Season Setback Temp	55	F
Heating Season % Savings per Degree Setback	1%	
Annual Boiler Capacity	3,750	Mbtu/yr
Connected Heating Load Capacity	3,750,000	Btu/hr
Equivalent Full Load Heating Hours	800	hrs
Heating System Efficiency	80%	
Cooling		
Cooling Season Facility Temp	76	F
Weekly Occupied Hours	50	hrs
Cooling Season Setback Temp	85	F
Cooling Season % Savings per Degree Setback	1%	
Connected Cooling Load Capacity	62	Tons
Equivalent Full Load Cooling Hours	381	hrs
Cooling Equipment EER	10.0	
SAVINGS		
Natural Gas Savings	1,892	Therms
Cooling Electricity Savings	6,195	kWh

FULL DDC - ADDITIONAL CONTROLS SAVINGS CALCULATION

EXISTING CONDITIONS		
Existing Facility Total Electric usage	357,633	kWh
Existing Facility Total Gas usage	29,696	Therms
Existing Facility Cooling Electric usage	139,693.0	kWh ¹
Existing Facility Heating Natural Gas usage	27,546	Therms ²
PROPOSED CONDITIONS		
Proposed Facility Cooling Electric Savings	1,397	kWh
Proposed Facility Natural Gas Savings	275	Therms
SAVINGS		
Electric Savings	1,397	kWh
Natural Gas Savings	275	Therms

Assumptions

- 39% of facility total electric usage dedicated to cooling based on utility information
- 93% of facility total natural gas usage dedicated to heating based on utility information
- 1% It is estimated there would be 1% savings after upgrading the system.
- 4368 estimated compressor run hours

Air Compressor

Motor Capad Load	Run Hours	Electric Usage
HP	%	hr/yr
1.5	80%	4,368
		3,910

Nighttime Setback

EXISTING CONDITIONS		
Heating		
Heating Season Facility Temp	70	F
Weekly Occupied Hours	50	hrs
Heating Season Setback Temp	70	F
Heating Season % Savings per Degree Setback	1%	
Annual Boiler Capacity	3,750	Mbtu/yr
Connected Heating Load Capacity	3,750,000	Btu/hr
Equivalent Full Load Heating Hours	800	hrs
Heating Equipment Efficiency	80%	
Cooling		
Cooling Season Facility Temp	76	F
Weekly Occupied Hours	50	hrs
Cooling Season Setback Temp	85	F
Cooling Season % Savings per Degree Setback	1%	
Connected Cooling Load Capacity	-	Tons
Equivalent Full Load Cooling Hours	381	hrs
Cooling Equipment EER	10.0	
SAVINGS		
Natural Gas Savings	0	Therms ³
Cooling Electricity Savings	0	kWh

COMBINED SAVINGS

Natural Gas Savings	2,167	Therms
Cooling Electricity Savings	11,502	kWh
Total Cost Savings	\$ 3,672	
Estimated Total Project Cost	\$ 214,799	
Simple Payback	58.5	Yrs

Savings calculation formulas for setback are taken from NJ Protocols document for Occupancy Controlled Thermostats
Savings calculations for additional controls are estimated based on the level of control to be added and prior experience

Ridgewood School District
CHA Project Numer: 30237
Ridge Elementary School

Multipliers	
Material:	1.03
Labor:	1.25
Equipment:	1.00

ECM-3 - Cost

Description	QTY	UNIT	UNIT COSTS			SUBTOTAL COSTS			TOTAL COST	REMARKS
			MAT.	LABOR	EQUIP.	MAT.	LABOR	EQUIP.		
						\$ -	\$ -	\$ -	\$ -	
DDC Project Cost	1	LS	\$ 70,000	\$ 70,000		\$ 71,890	\$ 87,220	\$ -	\$ 159,110	Estimated @ \$3 / SFT
			\$ -	\$ -		\$ -	\$ -	\$ -	\$ -	
						\$ -	\$ -	\$ -	\$ -	
						\$ -	\$ -	\$ -	\$ -	

**Cost Estimates are for Energy Savings calculations only, do not use for procurement

\$ 159,110	Subtotal
\$ 55,689	35% Contingency
\$ 214,799	Total

Ridgewood School District
CHA Project Numer: 30237
Ridge Elementary School

EQUIPMENT	AREA/EQUIPMENT SERVED	COOLING CAPACITY (btu/h)
Window AC Units	30 window air conditioners each of 12,000 BTUH capacity in Classrooms and Offices	360,000

4

Total btu/h of all window A/C Units: 360,000 btu/h

ECM-4 **Install window AC unit controller**

ECM Description : There are 30 window air conditioners in the school. Most of the air conditioners are installed in the classrooms and are currently controlled manually by the occupants. Window air conditioners may not be turned off when the room is unoccupied. This ECM evaluates implementation of a digital timer device that will automatically turn the window A/C unit off at a preset time.

ASSUMPTIONS		Comments
Electric Cost	\$0.158 / kWh	
Average run hours per Week	50 Hours	
Space Balance Point	55 F	
Space Temperature Setpoint	76 deg F	Setpoint.
BTU/Hr Rating of existing DX equipment	360,000 Btu / Hr	Estimated total cooling capacity of window air conditioners.
Average EER	10.0	
Existing Annual Electric Usage	13,800 kWh	

Item	Value	Units	Comments
Proposed Annual Electric Usage	7,528	kWh	Unit will cycle on w/ temp of room. Possible operating time shown below

ANNUAL SAVINGS	
Annual Electrical Usage Savings	6,272 kWh
Annual Cost Savings	\$991
Total Project Cost	\$6,200
Simple Payback	6 years

OAT - DB Bin Temp F	Annual Hours	Existing Hours of Operation	Proposed % of time of operation	Proposed hrs of Operation
102.5	0	0	100%	0
97.5	6	2	89%	2
92.5	31	9	79%	7
87.5	131	39	68%	27
82.5	500	149	58%	86
77.5	620	185	47%	87
72.5	664	0	0%	0
67.5	854	0	0%	0
62.5	927	0	0%	0
57.5	600	0	0%	0
52.5	730	0	0%	0
47.5	491	0	0%	0
42.5	656	0	0%	0
37.5	1,023	0	0%	0
32.5	734	0	0%	0
27.5	334	0	0%	0
22.5	252	0	0%	0
17.5	125	0	0%	0
12.5	47	0	0%	0
7.5	34	0	0%	0
2.5	1	0	0%	0
-2.5	0	0	0%	0
-7.5	0	0	0%	0
Total	8,760	383	55%	209

Ridgewood School District
CHA Project Numer: 30237
Ridge Elementary School

Multipliers	
Material:	1.03
Labor:	1.25
Equipment:	1.12

ECM-4 - Cost

Description	QTY	UNIT	UNIT COSTS			SUBTOTAL COSTS			TOTAL COST	REMARKS
			MAT.	LABOR	EQUIP.	MAT.	LABOR	EQUIP.		
						0	\$ -	\$ -	\$ -	
Window AC Controller	30	EA	\$ 150	\$ -	\$ -	4621.5	\$ -	\$ -	\$ 4,622	Estimated
						\$ -	\$ -	\$ -	\$ -	

**Cost Estimates are for Energy Savings calculations only, do not use for procurement

\$ 4,622	Subtotal
\$ 1,618	35% Contingency
\$ 6,200	Total

Ridgewood School District
CHA Project Numer: 30237
Ridge Elementary School

New Jersey Pay For Performance Incentive Program

Note: The following calculation is based on the New Jersey Pay For Performance Incentive Program per April, 2012.
 Building must have a minimum average electric demand of 100 kW. This minimum is waived for buildings owned by local governments or non-profit organizations.

At a minimum, all recommended measures were used for this calculation. To qualify for P4P incentives, the following P4P requirements must be met:

- At least 15% source energy savings
- No more than 50% savings from lighting measures
- Scope includes more than one measure
- Project has at least a 10% internal rate of return
- At least 50% of the source energy savings must come from investor-owned electricity and/or natural gas (note: exemption for fuel conversions)

Total Building Area (Square Feet)	53,654
Is this audit funded by NJ BPU (Y/N)	Yes

Board of Public Utilities (BPU)

Incentive #1		
Audit is funded by NJ BPU	\$0.05	\$/sqft

	Annual Utilities	
	kWh	Therms
Existing Cost (from utility)	\$56,555	\$25,418
Existing Usage (from utility)	357,633	29,696
Proposed Savings	38,159	0
Existing Total MMBtus	4,190	
Proposed Savings MMBtus	130	
% Energy Reduction	3.1%	
Proposed Annual Savings	\$6,029	

	Min (Savings = 15%)		Increase (Savings > 15%)		Max Incentive		Achieved Incentive	
	\$/kWh	\$/therm	\$/kWh	\$/therm	\$/kWh	\$/therm	\$/kWh	\$/therm
Incentive #2	\$0.09	\$0.90	\$0.005	\$0.05	\$0.11	\$1.25	\$0.00	\$0.00
Incentive #3	\$0.09	\$0.90	\$0.005	\$0.05	\$0.11	\$1.25	\$0.00	\$0.00

	Incentives \$		
	Elec	Gas	Total
Incentive #1	\$0	\$0	\$0
Incentive #2	\$0	\$0	\$0
Incentive #3	\$0	\$0	\$0
Total All Incentives	\$0	\$0	\$0

Total Project Cost	\$73,770
--------------------	----------

	Allowable Incentive	
% Incentives #1 of Utility Cost*	0.0%	\$0
% Incentives #2 of Project Cost**	0.0%	\$0
% Incentives #3 of Project Cost**	0.0%	\$0
Total Eligible Incentives***	\$0	
Project Cost w/ Incentives	\$73,770	

Project Payback (years)	
w/o Incentives	w/ Incentives
12.2	12.2

* Maximum allowable incentive is 50% of annual utility cost if not funded by NJ BPU, and %25 if it is.

** Maximum allowable amount of Incentive #2 is 25% of total project cost.

Maximum allowable amount of Incentive #3 is 25% of total project cost.

*** Maximum allowable amount of Incentive #1 is \$50,000 if not funded by NJ BPU, and \$25,000 if it is.

Maximum allowable amount of Incentive #2 & #3 is \$1 million per gas account and \$1 million per electric account; maximum 2 million per project

APPENDIX D

New Jersey Board of Public Utilities Incentives

- i. Smart Start**
 - ii. Direct Install**
 - iii. Pay for Performance (P4P)**
 - iv. Energy Savings Improvement Plan (ESIP)**
-

I. SMART START



Your Power to Save

At Home, for Business, and for the Future

[About Us](#) | [Press Room](#) | [Library](#)

HOME

RESIDENTIAL

COMMERCIAL, INDUSTRIAL
AND LOCAL GOVERNMENT



[Home](#) » [Commercial & Industrial](#) » [Programs](#)

NJ SmartStart Buildings

Program Overview

COMMERCIAL, INDUSTRIAL AND LOCAL GOVERNMENT

HURRICANE SANDY

PROGRAMS

NJ SMARTSTART BUILDINGS

EQUIPMENT INCENTIVES

FOOD SERVICE EQUIPMENT

APPLICATION FORMS

TOOLS AND RESOURCES

PAY FOR PERFORMANCE

COMBINED HEAT & POWER AND
FUEL CELLS

LOCAL GOVERNMENT ENERGY
AUDIT

LARGE ENERGY USERS PROGRAM

ENERGY SAVINGS IMPROVEMENT
PROGRAM

DIRECT INSTALL

ENERGY BENCHMARKING

OIL, PROPANE & MUNICIPAL
ELECTRIC CUSTOMERS

EDA PROGRAMS

SBC CREDIT PROGRAM



With New Jersey SmartStart Buildings ...

... A smart start now means better performance later! Whether you're starting a commercial or industrial project from the ground up, renovating existing space, or upgrading equipment, there are unique opportunities to upgrade the energy efficiency of the project.

Special Notice

Enhanced incentives are available for NJ SmartStart Building upgrades in buildings impacted by Hurricane Sandy. Eligible projects receive an additional 50% and new incentives have been added for high efficiency food service equipment.

Visit the Sandy web page for details and important links.

New Jersey SmartStart Buildings can provide a range of support — at no cost to you — for substantial energy savings, both now and for the future. Learn more about:

[Project Categories](#)

[Custom Measures](#)

[Incentives for Qualifying Equipment and Projects](#)

[Program Terms and Conditions](#)

[Find a Trade Ally](#)

Please note: pre-approval is required for almost all energy efficiency incentives. To receive an incentive, you must submit an application form (and applicable worksheets) and receive an approval letter from the program before any equipment is installed (click here for complete Terms and Conditions). Upon receipt of an approval letter, you may proceed to install the equipment listed on your approved application. Equipment installed prior to the date of the approval letter is not eligible for an incentive. **Any customer and/or agent who purchases equipment prior to the receipt of an incentive approval letter does so at his/her own risk.**

Getting Started

Submit your project application form as soon as you know you will be doing a construction project or replacing/adding equipment.

PAST PROGRAMS**TOOLS AND RESOURCES****PROGRAM UPDATES****CONTACT US**

Apply for pre-approval by submitting an application for the type of equipment you have or plan to install. The application should be accompanied by a related worksheet, where applicable, manufacturer's specification sheet (refer to the specific program requirements on the background application for specs needed for your project) for the equipment you are planning to install. (Program representatives will review your application package and approve it, reject it, or advise you of upgrades in equipment that will save energy costs and/or increase your in

Support for Custom Energy-Efficiency Measures

Custom measures allows program participants the opportunity to receive an incentive for energy-efficiency measures that are not on the prescriptive equipment Incentive list, but are project/facility specific.

Incentives for Qualifying Equipment and Projects

Financial incentives are available for large and small projects. These incentives offset some or maybe even all! — of the added cost to purchase qualifying energy-efficient equipment, and provides significant long-term energy savings. Ranges of incentives are available for qualifying equipment (depending on type, size, and efficiency) in several categories.

Find out more about equipment incentives

For specific details on equipment requirements and financial incentives, including incentives for equipment not listed here, contact a program representative. Fiscal year financial incentives will be limited to a maximum of \$500,000 per customer utility account and are available as long as permits are obtained.

[Home](#) | [Residential](#) | [Commercial & Industrial](#) | [Renewable Energy](#)
[About Us](#) | [Press Room](#) | [Library](#) | [FAQs](#) | [Calendar](#) | [Newsletters](#) | [Contact Us](#) | [Site](#)



Your Power to Save

At Home, for Business, and for the Future

[About Us](#) | [Press Room](#) | [Library](#)

HOME

RESIDENTIAL

COMMERCIAL, INDUSTRIAL
AND LOCAL GOVERNMENT



COMMERCIAL, INDUSTRIAL AND LOCAL GOVERNMENT

HURRICANE SANDY

PROGRAMS

NJ SMARTSTART BUILDINGS

EQUIPMENT INCENTIVES

FOOD SERVICE EQUIPMENT

APPLICATION FORMS

TOOLS AND RESOURCES

PAY FOR PERFORMANCE

COMBINED HEAT & POWER AND
FUEL CELLS

LOCAL GOVERNMENT ENERGY
AUDIT

LARGE ENERGY USERS PROGRAM

ENERGY SAVINGS IMPROVEMENT
PROGRAM

DIRECT INSTALL

ENERGY BENCHMARKING

OIL, PROPANE & MUNICIPAL
ELECTRIC CUSTOMERS

EDA PROGRAMS

SBC CREDIT PROGRAM

[Home](#) » [Commercial & Industrial](#) » [Programs](#) » [NJ SmartStart Buildings](#)

Equipment Incentives

Special Notice

Enhanced incentives are available for NJ SmartStart Building upgrades in buildings impacted by Hurricane Sandy. Eligible projects receive an additional 50% and new incentives have been added for high efficiency food service equipment.

Visit the Sandy web page for details and important links.

More reasons for a smart start on your next project!

New Jersey SmartStart Buildings provides **financial incentives for qualifying equipment**. These incentives were developed to help our customers offset some of the added cost to purchase qualifying energy-efficient equipment, which provides significant long-term energy savings. A wide range of incentives are available for qualifying equipment (depending on type, size and efficiency).

Listed below are the types of qualifying equipment and ranges of incentives. For details on equipment requirements and full listings of incentives, refer to the **online application forms**.

Please note that almost all equipment incentives require pre-approval before equipment is installed. (click for exceptions) To start the pre-approval process, submit an Equipment Application, and appropriate Equipment Worksheets, for the type of equipment you are planning to install along with equipment specification sheets (refer to the specific program requirements on the back of the application for specific information needed for your project) and a current utility bill(s).

In order to be eligible to receive financial incentives under this Program, Applicants must receive electric and/or gas service from one of the regulated electric and/or gas utilities in the State of New Jersey. They are: Atlantic City Electric, Jersey Central Power & Light, Rockland Electric Company, New Jersey Natural Gas, Elizabethtown Gas, PSE&G, and South Jersey Gas.



Electric Chillers

Water-cooled chillers (\$12 - \$170 per ton)
Air-cooled chillers (\$8 - \$52 per ton)

Gas Cooling

Gas absorption chillers (\$185-\$450 per ton)
Gas Engine-Driven Chillers (Calculated through Custom Measure F

PAST PROGRAMS**TOOLS AND RESOURCES****PROGRAM UPDATES****CONTACT US****Desiccant Systems** (\$1.00 per cfm - gas or electric)**Electric Unitary HVAC**

Unitary AC and split systems (\$73 - \$92 per ton)
 Air-to-air heat pumps (\$73 - \$92 per ton)
 Water-source heat pumps (\$81 per ton)
 Packaged terminal AC & HP (\$65 per ton)
 Central DX AC Systems (\$40 - \$72 per ton)
 Dual Enthalpy Economizer Controls (\$250)
 Occupancy Controlled Thermostats (\$75 each)
 A/C Economizing Controls (\$85 - \$170 each)

Ground Source Heat Pumps

Closed Loop (\$450-750 per ton)

Gas Heating

Gas-fired boilers < 300 MBH (\$300 per unit)
 Gas-fired boilers ≥ 300 MBH - 1500 MBH (\$1.75 per MBH)
 Gas-fired boilers ≥ 1500 MBH - ≤ 4000 MBH (\$1.00 per MBH)
 Gas-fired boilers > 4000 MBH (Calculated through Custom Measure)
 Gas furnaces (\$300-\$400 per unit)
 Gas infrared heaters - indoor only (\$300 - \$500 per unit)
 Boiler economizing controls (\$1,200 - \$2,700 per unit)

Variable Frequency Drives

Variable air volume (\$65 - \$155 per hp)
 Chilled-water pumps (\$60 per hp)
 Compressors (\$5,250 to \$12,500 per drive)

Natural Gas Water Heating

Gas water heaters ≤ 50 gallons (\$50 per unit)
 Gas-fired water heaters > 50 gallons (\$1.00 - \$2.00 per MBH)
 Tankless water heaters replacing a free standing water heater > 82 energy factor (\$300 per heater)
 Gas-fired booster water heaters (\$17 - \$35 per MBH)

Premium Motors

Three-phase motors (\$45 - \$700 per motor) (**Incentive was discontinued effective March 1, 2013 except for buildings impacted by Hurricane Sandy. Approved applications will have the standard timeframe from the program commitment date to complete the installation.**)

Refrigerator/Freezer Case Premium Efficiency Motors (ECM)

Fractional (< 1 HP) Electronic Commutated Motors (ECM) (\$40 per for replacement of existing shaded-pole motor in refrigerated/freezer case)

Prescriptive Lighting

New Linear Fluorescent

T-12, HID and Incandescent to T-5 and T-8 (\$25 - \$200 per fixture) **(Note: T12 replacements are only available for buildings impacted by Hurricane Sandy)**

New Induction (\$70 per replaced HID fixture)

New LED

Screw-in/Plug-in (\$10 - \$20 per lamp)

Refrigerator/Freezer Case (\$30 - \$65 per fixture)

Outdoor pole/arm/wall-mounted luminaires (\$100 - \$175 per fixture)

Display case (\$30 per case)

Shelf-mounted display and task (\$15 per linear foot)

Wall-wash, desk, recessed (\$20 - \$35 per fixture)

Parking garage luminaires (\$100 per fixture)

Track or Mono-Point directional (\$50 per fixture)

Stairwell and Passageway luminaires (\$40 per fixture)

High-Bay, Low-Bay (\$150 per fixture)

Bollard (\$50 per fixture)

Luminaires for Ambient Lighting of Interior Commercial Space
Linear panels (\$50 per fixture)

Fuel pump canopy (\$100 per fixture)

LED retrofit kits (custom measures)

New Pulse-Start Metal Halide (\$25 per fixture)

Linear Fluorescent Retrofit (\$10 - \$20 per fixture)

Induction Retrofit (\$50 per retrofitted HID fixture)

New Construction/Complete Renovation (performance-based)

Note: Incentives for T-12 to T-5 and T-8 lamps with electronic ballast in facilities (\$10 per fixture, 1-4 lamps) and T-5/T-8 high bay fixtures (\$16 - per fixture) were discontinued effective March 1, 2013 for T-12 retrofits replacements except for buildings impacted by Hurricane Sandy. Approved applications will have the standard timeframe of one year from the project commitment date to complete the installation

Lighting Controls

Occupancy Sensors

Wall mounted (\$20 per control)

Remote mounted (\$35 per control)

Daylight dimmers (\$25 per fixture controlled, \$50 per fixture for office applications only)

Occupancy controlled hi-low fluorescent controls (\$25 per fixture controlled)

HID or Fluorescent Hi-Bay Controls

Occupancy hi-low (\$35 per fixture controlled)

Daylight dimming (\$45 per fixture controlled)

Refrigeration

Covers and Doors

Energy-Efficient doors for open refrigerated doors/covers (\$100 per door)

Aluminum Night Curtains for open refrigerated cases (\$3.50 per linear foot)

Controls

Door Heater Control (\$50 per control)

Electric Defrost Control (\$50 per control)

Evaporator Fan Control (\$75 per control)

Novelty Cooler Shutoff (\$50 per control)

Food Service Equipment

Cooking

Combination Electric Oven/Steamer (\$1,000 per oven)
 Combination Gas Oven/Steamer (\$750 per oven)
 Electric Convection Oven (\$350 per oven)
 Gas Convection Oven (\$500 per oven)
 Gas Rack Oven (\$1,000 single, \$2,000 double)
 Gas Conveyor Oven (\$500 small deck, \$750 large deck)
 Electric Fryer (\$200 per vat)
 Gas Fryer (\$749 per vat)
 Electric Large Vat Fryer (\$200 per vat)
 Gas Large Vat Fryer (\$500 per vat)
 Electric Griddle (\$300 per griddle)
 Gas Griddle (\$125 per griddle)
 Electric Steam Cooker (\$1,250 per steamer)
 Gas Steam Cooker (\$2,000 per steamer)

Holding

Full Size Insulated Cabinets (\$300 per cabinet)
 Three Quarter Size Insulated Cabinets (\$250 per cabinet)
 Half Size Insulated Cabinets (\$200 per cabinet)

Cooling

Glass Door Refrigerators (\$75 - \$150 per unit)
 Solid Door Refrigerators (\$50 - \$200 per unit)
 Glass Door Freezers (\$200 - \$1,000 per unit)
 Solid Door Freezers (\$100 - \$600 per unit)
 Ice Machines (\$50 - \$500 per unit)

Cleaning

Dishwashers (\$400 - \$1,500 per unit)

Other Equipment Incentives*

Performance Lighting (\$1.00 per watt per square foot below program incentive threshold, currently 5% more energy efficient than ASHRAE 2007 for New Construction only.)

Custom electric and gas equipment incentives (not prescriptive)

*Equipment incentives are calculated based on type, efficiency, size, and application and are evaluated on a case-by-case basis. Contact us for details.

Home | Residential | Commercial & Industrial | Renewable Energy
 About Us | Press Room | Library | FAQs | Calendar | Newsletters | Contact Us | Site

II. DIRECT INSTALL



Your Power to Save

At Home, for Business, and for the Future

[About Us](#) | [Press Room](#) | [Library](#)

HOME

RESIDENTIAL

COMMERCIAL, INDUSTRIAL
AND LOCAL GOVERNMENT

Home » Commercial & Industrial » Programs

Direct Install

COMMERCIAL, INDUSTRIAL AND LOCAL GOVERNMENT

HURRICANE SANDY

PROGRAMS

NJ SMARTSTART BUILDINGS

PAY FOR PERFORMANCE

COMBINED HEAT & POWER AND
FUEL CELLSLOCAL GOVERNMENT ENERGY
AUDIT

LARGE ENERGY USERS PROGRAM

ENERGY SAVINGS IMPROVEMENT
PROGRAM

DIRECT INSTALL

PARTICIPATION STEPS

PARTICIPATING
CONTRACTORS

SUSTAINABLE JERSEY

ENERGY BENCHMARKING

OIL, PROPANE & MUNICIPAL
ELECTRIC CUSTOMERS

EDA PROGRAMS

SBC CREDIT PROGRAM

NEW JERSEY'S CLEAN ENERGY PROGRAM

DIRECT Install

Let us pay up to 70% of your energy efficiency upgrade.

Sometimes, the biggest challenge to improving energy efficiency is knowing where to and how to get through the process. Created specifically for existing small to medium facilities, Direct Install is a turnkey solution that makes it easy and affordable to upgrade high efficiency equipment. Direct Install is designed to cut your facility's energy costs replacing lighting, HVAC and other outdated operational equipment with energy efficient alternatives. The program pays up to 70% of retrofit costs, dramatically improving your payback on the project. There is a \$125,000 incentive cap on each project.

ELIGIBILITY



Existing small to mid-sized commercial and industrial facilities with a peak electric demand that did not exceed 200 kW any of the preceding 12 months are eligible to participate in Direct Install. Applicants will submit the last 12 months of electric utility bills indicating that they are below the demand threshold and have occupied the building during that time. Buildings must be located in New Jersey and served by the state's public, regulated electric or natural gas utility companies.

SYSTEMS & EQUIPMENT ADDRESSED BY THE PROGRAM

Lighting
Heating, Cooling & Ventilation (HVAC)
Refrigeration
Motors
Natural Gas
Variable Frequency Drives



Measures eligible for Direct Install are limited to specific equipment categories, types and capacities. Boilers may not exceed 500,000 Btuh and furnaces may not exceed 140,

III. PAY FOR PERFORMANCE (P4P)



Your Power to Save

At Home, for Business, and for the Future

[About Us](#) | [Press Room](#) | [Library](#)

HOME

RESIDENTIAL

COMMERCIAL, INDUSTRIAL
AND LOCAL GOVERNMENT

COMMERCIAL, INDUSTRIAL AND LOCAL GOVERNMENT

HURRICANE SANDY

PROGRAMS

NJ SMARTSTART BUILDINGS

PAY FOR PERFORMANCE

EXISTING BUILDINGS

PARTICIPATION STEPS

APPLICATIONS AND
FORMS

APPROVED PARTNERS

NEW CONSTRUCTION

FAQS

BECOME A PARTNER

COMBINED HEAT & POWER AND
FUEL CELLSLOCAL GOVERNMENT ENERGY
AUDIT

LARGE ENERGY USERS PROGRAM

ENERGY SAVINGS IMPROVEMENT
PROGRAM

DIRECT INSTALL

ENERGY BENCHMARKING

[Home](#) » [Commercial & Industrial](#) » [Programs](#) » [Pay for Performance](#)

Pay for Performance - Existing Buildings

Download program applications and incentive forms.

The Greater the Savings, the Greater Your Incentives

Take a comprehensive, whole-building approach to saving energy in your existing facility. Earn incentives that are directly linked to your savings. Pay for Performance relies on a



program partners who provide technical services under direct contract to you. Acting as your energy expert, your partner will develop a whole-building energy reduction plan for each project with a whole-building technical component of a traditional energy audit, a financial plan for full implementation of energy efficient measures and a construction schedule for installation.

Eligibility

Existing commercial, industrial and institutional buildings with demand over 100 kW for any of the preceding twelve months to participate including hotels and casinos, large office buildings, family buildings, supermarkets, manufacturing facilities, schools, shopping malls and restaurants. Buildings that fall into the following customer classes are not required to meet the 100 kW demand threshold to participate in the program: hospitals, public colleges and universities, 501(c)(3) non-profit organizations, affordable multifamily housing, and local governmental entities. Your energy reduction plan will define a comprehensive package of measures capable of reducing the existing energy consumption of your building by 15% or more.

Exceptions to the 15% threshold requirement may be made for certain industrial, manufacturing, water treatment and datacenter building types whose annual energy consumption is heavily weighted on process loads. Details are available in the high energy intensity section of this page.

ENERGY STAR Portfolio Manager

Pay for Performance takes advantage of the ENERGY STAR Program with Portfolio Manager, EPA's interactive tool that allows facility managers to track and evaluate energy and water consumption across all of their buildings. The tool provides the opportunity to load in the characteristics and energy usage of your buildings and determine an energy performance benchmark score. You can then assess energy management goals over time, identify strategic opportunities for savings, and receive EPA recognition for superior energy performance.



This rating system assesses building performance by tracking and scoring energy use in your facilities and comparing it to similar buildings. That can be a big help in locating opportunities for cost-justified energy efficiency upgrades. And, based on our findings, you may be invited to participate in the Building Performance with ENERGY STAR initiative and receive special recognition as an industry leader in energy efficiency.

Incentives

**OIL, PROPANE & MUNICIPAL
ELECTRIC CUSTOMERS**

Pay for Performance incentives are awarded upon the satisfactory completion of three p milestones:

EDA PROGRAMS

Incentive #1 - Submittal of complete energy reduction plan prepared by an app program partner - Contingent on moving forward, incentives will be between \$5 \$50,000 based on approximately \$.10 per square foot, not to exceed 50% of th annual energy expense.

SBC CREDIT PROGRAM

Incentive #2 - Installation of recommended measures - Incentives are based on the projected level of electricity and natural gas savings resulting from the installation of comprehensive energy-efficiency measures.

PAST PROGRAMS

TOOLS AND RESOURCES

Incentive #3 - Completion of Post-Construction Benchmarking Report - A completed report verifying energy reductions based on one year of post-

PROGRAM UPDATES

implementation results. Incentives for electricity and natural gas savings will be based on actual savings, provided that the minimum performance threshold of savings has been achieved.

CONTACT US



A detailed Incentive Structure document is available on the applications and form

Steps to Participation

[Click here](#) for a step-by-step description of the program.

[Home](#) | [Residential](#) | [Commercial & Industrial](#) | [Renewable Energy](#)
[About Us](#) | [Press Room](#) | [Library](#) | [FAQs](#) | [Calendar](#) | [Newsletters](#) | [Contact Us](#) | [Site](#)

How did you learn about this Energy Efficiency Program?

- ☐ Advertisement ☐ Internet Search ☐ Mailer ☐ Video
☐ Tradeshow/Event ☐ Word of Mouth ☐ Radio ☐ Contractor
☐ Other _____

PAY FOR PERFORMANCE APPLICATION FORM

July 1, 2015 – June 30, 2016

Utility Serving Applicant:

- ☐ Atlantic City Electric ☐ Jersey Central Power & Light ☐ PSE&G
☐ New Jersey Natural Gas ☐ Elizabethtown Gas ☐ Rockland Electric Co. ☐ South Jersey Gas
☐ Other Electric Service Provider (please specify): _____
☐ Other Fuel Provider: _____ ☐ Oil: _____ ☐ Other (Please specify): _____

Instructions

1. Read the Participation Agreement (pages 3,4) and sign where indicated.
 2. Fill out all applicable spaces on this form. Note Customer/Owner Information must be listed for the utility rate payer of the Project facility.
 3. Provide a copy of the customer's company W-9 form.
 4. Provide the most recent (within 2 years) consecutive 12 month period of utility bills for the project for all accounts, organized in chronological order and separated by account. Utilize Utility Tool for applications with multiple accounts to organize data.
 5. Provide brief description of facility, noting any special or unusual circumstances and/or site conditions.
 6. Partner must submit the application package via e-mail, mail or fax DIRECTLY to the Market Manager – see back of this form.
- Approval of this Application is not an approval of the project's scope of work. Scope of work is only approved upon approval of the Energy Reduction Plan. See application and program guidelines for more information.**

Customer/Owner Information (payment will be made to entity entered here)

Company Name		Project Contact/Title	
Company Address		City	State
Phone/Fax	E-mail	Federal ID/SSN	NAICS Code
		Zip	

Partner Information

Company Name		Project Contact/Title	
Company Address		City	State
Phone	Fax	E-mail	Zip

Project Information

Project Name			
Building Address		City	State
		Zip	
Utility Account Number(s): Electric		Gas	
* Note: Please use the back of this page for additional utility accounts if quantity exceeds space allotment.			
Annual Peak kW Demand	Building Type		Number of Buildings
Size of Building(s) (gross sq/ft)		Direct, Master or Sub Metered	

Funding

- ☐ Check the box if an Energy Savings Improvement Program (ESIP) will be a source of funding. ESIP allows government agencies to pay for energy related improvements using the value of the resulting energy savings.

Do you expect to receive funding under any other efficiency programs? ☐ No ☐ Yes If Yes, please specify below:

Utility Program – Utility: _____ Program Name: _____

Federal Program – Organization: _____ Program Name: _____

Other Program – Organization: _____ Program Name: _____

Additional Project information

Additional Utility Account(s)

Account type	Account number
Account type	Account number
Account type	Account number
Account type	Account number
Account type	Account number
Account type	Account number
Account type	Account number
Account type	Account number
Account type	Account number
Account type	Account number
Account type	Account number
Account type	Account number

Additional Comments:

Complete this application form and send it directly to the Commercial/Industrial Market Manager by e-mail, mail or fax.

New Jersey's Clean Energy Program
c/o TRC Energy Services-P4P
900 Route 9 North, Suite 404 • Woodbridge, NJ 07095

Phone: 866-657-6278 • Fax: 732-855-0422
E-mail: P4P@NJCleanEnergy.com

Visit our website: NJCleanEnergy.com/P4P

New Jersey SmartStart Buildings[®] is a registered trademark. Use of the mark without the permission of the New Jersey Board of Public Utilities, Office of Clean Energy is prohibited.

*Incentives/Requirements subject to change.



001-FY16-07/15

Pay For Performance-Existing Buildings

Participation Agreement

Definitions:

ADMINISTRATOR – New Jersey Board of Public Utilities (NJBPUB)

APPLICATION PROCESS – The Program pays incentives in phases upon satisfactory completion of each of three Program milestones - approval of a complete Energy Reduction Plan, installation of all recommended measures per the Energy Reduction Plan, completion of Post-Construction Benchmarking Report (for incentive amounts, please refer to Incentive Amounts). In order to be eligible for Program Incentives, a Participating Customer or an agent authorized by a Customer, must submit to the Market Manager a properly completed application package – application form, Participating Customer's company W-9, twelve consecutive months of the project's utility bills and executed Participation Agreement. All components of the application package must be filled out completely, truthfully and accurately. This application package must be received on or before June 30, 2016 in order to be eligible for the Fiscal Year 2016 Incentives. The Market Manager will review the application package to determine if the project is eligible for a Program Incentive. When approved, the Participating Customer will receive an approval letter from their Case Manager with the estimated authorized first incentive amount and the date by which the Energy Reduction Plan must be submitted. Upon receipt of the approval letter, the Participating Customer and Partner may proceed with work on the Energy Reduction Plan. The Market Manager or agent thereof reserves the right to conduct a pre-inspection of the facility prior to the installation of equipment. This will be done prior to the issuance of the Energy Reduction Plan approval letter. Approval of this Application is not an approval of the project's scope of work. Scope of work is only approved upon approval of the Energy Reduction Plan. See application and program guidelines for more information.

CHANGES TO THE PROGRAM – The Program and Participation Agreements may be changed by the Market Manager at any time without notice. Approved applications, however, will be processed to completion under the agreements in effect at the time of the Market Manager's approval.

ELIGIBILITY - Program Incentives are available to existing commercial and industrial buildings with peak kilowatt demand usage of more than 200 kW in any of the most recent preceding twelve months of utility bills, 100 kW for multifamily buildings, and a customer of the New Jersey Utilities. Market Manager has the discretion to approve applications that fall below the 200 kW minimum, 100 kW for multifamily, by no more than 10%. If the Participant is a municipal electric company customer, and a customer of an investor-owned gas New Jersey Utility, only gas measures will be eligible for incentives under the Program. Similarly, if the Participant is an oil/propane customer and a customer of an investor-owned electric New Jersey Utility, only electricity measures will be eligible for incentives under the Program.

Projects may not participate or apply for incentives for energy efficient measures through other New Jersey's Clean Energy Programs while participating in this Program. Equipment procured by participating Customer through another program offered by New Jersey Utilities, as applicable, is not eligible for incentives through this Program. Customers who, from July 1, 2014 - June 30, 2015, have not contributed to the Societal Benefits Charge of the applicable New Jersey Utility, may not be eligible for incentives offered through this program.

ENDORSEMENT – The Market Manager and Administrator do not endorse, support or recommend any particular manufacturer, product or system design in promoting this Program.

ENERGY-EFFICIENT MEASURES – Any device eligible to receive a Program Incentive payment through the New Jersey's Clean Energy Commercial and Industrial Program

ENERGY REDUCTION PLAN – A document created by the Participating Customer's selected Partner that defines several key aspects of the project including (but not limited to) existing conditions as a result of a whole-building technical analysis, benchmarking summaries, recommended measures, financing plan and implementation schedule.

ENERGY REDUCTION PLAN APPROVAL – After application approval, the Participating Customer and Partner must work together to finalize and submit an Energy Reduction Plan which incorporates a work scope that will achieve the minimum 15% reduction in source energy performance target in accordance with the Program rules and policies along with the Benchmarking Tool, modeling software file, a copy of the executed Partner and Participating Customer contract, a copy of the executed Installation Agreement and a Request for Incentive #1 Payment form. All components of the submittal package must be filled out completely, truthfully and accurately. The Market Manager, agents thereof and/or the selected Partner must be provided reasonable access to the Participating Customer's facility, staff, tenants and/or others necessary to develop an Energy Reduction Plan that will achieve the minimum 15% performance target as well as the necessary utility billing data as dictated by the Program. The Energy Reduction Plan submittal package will be reviewed and must be approved by the Market Manager prior to payment of Incentive #1. Upon approval of the submittal package, the Customer will receive an Incentive #1 approval letter indicating the date by which all measures in the Energy Reduction Plan must be installed (no later than twelve months following the Energy Reduction Plan submittal approval date, up to twenty four months with extension approvals).

INCENTIVE AMOUNTS – Incentive #1 - \$0.10 per square foot of the project with a maximum amount of \$50,000 and minimum of \$5,000, not to exceed 50% of the project's annual energy cost and contingent on installation of measures in the Energy Reduction Plan and receipt of a signed Installation Agreement. If installation does not commence within the required timeframe, Incentive #1 may be required to be returned to the program. In the event the project is cancelled and Incentive #1 is not returned, the project may reapply to the program in the future but another Incentive #1 will not be paid. Incentive #2 – 50% of the total performance-based incentive (combination of Incentives #2 and #3) calculated per Program's incentive structure; Incentive #3 – remaining amount based on the realized energy savings of the project. For customers that have successfully participated in the Local Government Energy Audit Program, Incentive #1 will be reduced by 50% to \$0.05 per square foot up to \$25,000. Actual Incentive #1 paid shall not be higher than 5% over the committed amount. Actual Incentive #2 paid shall not be higher than the committed amount, unless the Energy Reduction Plan has been resubmitted due to changes in the work scope. Actual Incentive #3 paid shall be higher or lower than the committed amount based on actual energy savings but shall not be greater than program Incentive Caps.

The Market Manager will provide incentives according to those described in this section or as modified upon notice to Participating Customer. All incentive payments are paid directly to the Participating Customer as indicated on the application form. The Program is not bound to pay any incentive unless the submittal package associated with the incentive payment is approved by the Market Manager who reserves the sole discretion of approving or disapproving the submittal packages.

INCENTIVE CAP – Program Incentives #2 and #3 will be capped not to exceed 50% of the total project cost, lesser of estimated or actual. Incentive #1 will be capped not to exceed 50% of the project's annual energy cost. Program Incentives (Incentive #1, #2 and #3) are restricted to \$1M per gas and electric account (limited to \$2M per project) in a program year. Campus style facilities, which are master-metered, are subject to the annual incentive cap of \$1 million per gas and electric account. The Participating Customer will also be subject to an annual Entity Cap of \$4M or \$5M if a Combined Heat and Power/Fuel Cell Application is approved for the same facility (Definition of an Entity can be found in the Board Order Docket No. EO07030203).

INSTALLATION AGREEMENT – The Participating Customer must submit an executed Installation Agreement as part of the Request for Incentive #1 Form. By executing the Installation Agreement, the Customer agrees to install all of the measures in the Energy Reduction Plan, which are estimated to result in meeting or exceeding the minimum 15% performance target. The Customer agrees to the performance-based incentives (Incentives #2 & #3) as indicated in the document which are based on the results of the Energy Reduction Plan. Implementation of the measures must commence in the time period twelve months following the approval date of the Energy Reduction Plan, up to twenty four months with extension approvals. Failure to complete the installation of the measures in the Energy Reduction Plan may result in the repayment of Incentive #1, and the forfeiting of Incentives #2 and #3. In the event the project is cancelled and Incentive #1 is not returned, the project may reapply to the program in the future but another Incentive #1 will not be paid.

LIMITATION OF LIABILITY – By virtue of participating in this Program, Participating Customers agree to waive any and all claims or damages against TRC Energy Services, the Market Manager, and the Administrator, except the receipt of the Program Incentive. Participating Customers agree that the Market Manager's and Administrator's liability, in connection with this Program, is limited to paying the Program Incentive specified. Under no circumstances shall the Market Manager, its representatives, or subcontractors, or the Administrator be liable for any lost profits, special, punitive, consequential or incidental damages or for any other damages or claims connected with or resulting from participation in this Program. Further, any liability attributed to the Market Manager under this Program shall be individual, and not joint and/or several.

The Market Manager's review and approval of the Energy Reduction Plan cannot be construed to be a determination as to performance, applicability, dollar savings, energy savings, or any other aspect of the proposed project. The Market Manager and Administrator offer no guarantee or warranty of performance of the project's equipment or system. The participant assumes full responsibility and liability for the installation of all equipment, including but not limited to design, specification, all permits, installation, maintenance, performance and financing. By participating in the program and accepting incentive dollars, you agree to hold harmless the Market Manager and Administrator and their respective staffs with respect to the Project

MARKET MANAGER – TRC Energy Services is responsible for managing the New Jersey Clean Energy Commercial & Industrial Programs.

MEASUREMENT & VERIFICATION APPROVAL – Twelve months subsequent to the Incentive #2 Payment Submittal package approval date, measurement and verification of the projected energy reduction will be conducted by the Participating Customer's Partner using the project's post-installation utility data (supplied by the Customer). The Participating Customer must work with their Partner to submit the Incentive #3 Payment Submittal, consisting of the Post-Construction Benchmarking Report, Benchmarking Tool, and Request for Incentive #3 form. All components of the submittal package must be filled out completely, truthfully and accurately.

Upon review of the submittal package (by the Market Manager or agent thereof), the remaining 50% of the total performance-based incentive (Incentives #2 & #3) will be released to the Participating Customer. If the Post-Construction Benchmarking Report indicates that the project did not meet the minimum performance target, the post-installation completion period may be extended to up to twenty-four months subsequent to the Incentive Payment #2 package approval date. If after this time the minimum performance target is still not met, the final Incentive #3 will not be paid.

NEW JERSEY UTILITIES – The investor-owned electric and/or gas utilities in the State of New Jersey. They are: Atlantic City Electric, Jersey Central Power & Light, Rockland Electric Company, New Jersey Natural Gas, Elizabethtown Gas, PSE&G, and South Jersey Gas.

PARTICIPATING CUSTOMERS – Those non-residential electric and/or gas service customers of the New Jersey Utilities who participate in this Program.

PARTICIPATING CUSTOMER'S CERTIFICATION – Participating Customer agrees that all information is true and that he/she has conformed to all of the Program and equipment requirements per the Program Guidelines. Participating Customer certifies that he/she purchased and installed the equipment listed in the Energy Reduction Plan at their defined New Jersey project location.

PARTNER – An approved professional who provides technical building performance services to Participating Customers, acting as their “energy efficiency expert”. Participating Customers are required to hire an approved Pay for Performance Partner to develop the Energy Reduction Plan and facilitate installation of the recommended package of Energy-Efficient Measures. Participants are required to enter into a contractual agreement with a selected Partner which outlines the set of minimum services the Partner will provide to the Participating Customer throughout the life of the project. It is strongly recommended that Participating Customers perform due diligence in selecting a Pay for Performance Partner. Fees charged by the Partner are not regulated by the Program and could vary between Partners. Incentives may cover some, or potentially all, of the Partner fees.

PERFORMANCE-BASED INCENTIVES – The combination of Incentives #2 and #3, which are based on the projected and actual energy reduction performance of the project.

PERFORMANCE TARGET – A minimum of a 15% annual source energy savings must be achieved in order to participate. The performance target is based on reducing the total energy consumption for the facility. No more than 50% of the total source energy savings may be derived from lighting measures; up to 70% lighting savings may be considered but performance target will increase by 1% for each percent over 50% (e.g. project with 60% savings from lighting will have a minimum performance target of 25%). A 4% performance target may be offered to customers whose annual energy consumption is heavily weighted to manufacturing and process loads, as well as hospitals. This approach will be reviewed on a case-by-case basis and must be pre-approved by the Market Manager. In order to be considered, the project must involve: A manufacturing facility, including such industries as plastics and packaging, chemicals, petrochemicals, metals, paper and pulp, transportation, biotechnology, pharmaceutical, food and beverage, mining and mineral processing, general manufacturing, equipment manufacturers and data centers; and manufacturing and/or process-related loads, including data center consumption, consume 50% or more of total facility energy consumption. For hospitals, 50% or more of the gross floor area must be used for general medical and surgical services and 50% or more of the licensed beds must provide acute care services. The total energy savings may not come from a single measure. No more than 50% of the total source energy savings may be derived from non-investor owned utilities or fuels.

POST-INSTALLATION APPROVAL – After the complete installation of all measures in the Energy Reduction Plan, the Customer and their Partner must finalize and submit the Incentive #2 Payment Submittal, consisting of the Installation Report, invoices, and Request for Incentive #2 Payment form. All components of the submittal package must be filled out completely, truthfully and accurately. Upon review of the submittal package and verification of the complete installation of all measures in the Energy Reduction Plan (via inspection by the Market Manager or agent thereof), 50% of the total performance based incentive (Incentives #2 & #3) will be released to the Participating Customer. Upon approval of the submittal package, the Customer will receive an Incentive #2 approval letter indicating the date by which the post-installation Measurement & Verification phase began and will end (twelve to twenty four months in length).

The Market Manager reserves the right to verify sales transactions and to have reasonable access to Participating Customer's facility to inspect both pre-existing products or equipment (if applicable) and the Energy-Efficient Measures installed under this Program, either prior to issuing incentives or at a later time. Energy-Efficient Measures must be installed in buildings located within the service territory of one of the New Jersey Utilities (as defined by the Program) as designated on the Participating Customer's Pay for Performance application. Program Incentives are available for qualified Energy-Efficient Measures as listed and described in the Program Guidelines. The Participating Customer must ultimately own the equipment, either through an up-front purchase or at the end of a short-term lease.

PRE-INSTALLED MEASURES - An Energy Reduction Plan must be approved by the program and an approval letter sent to the customer in order for incentives to be committed. Upon receipt of an Energy Reduction Plan, all project facilities must be pre-inspected. Measures installed prior to pre-inspection of the facility shall not be included as part of the ERP scope of work and will not be eligible for incentive

Measure installation undertaken prior to ERP approval, but after pre-inspection, is done at the customer's own risk. In the event that an Energy Reduction Plan is rejected by the program, the customer will not receive any incentives.

PRODUCT INSTALLATION OR EQUIPMENT INSTALLATION – Installation of the Energy-Efficient Measures. Projects with a contract threshold of \$15,444 are required to pay no less than prevailing wage rate to workers employed in the performance of any construction undertaken in connection with Board of Public Utilities financial assistance, or undertaken to fulfill any condition of receiving Board of Public Utilities financial assistance, including the performance of any contract to construct, renovate or otherwise prepare a facility, the operations of which are necessary for the receipt of Board of Public Utilities financial assistance. By submitting an application, or accepting program incentives, applicant agrees to adhere to New Jersey Prevailing Wage requirements, as applicable.

PROGRAM – New Jersey's Clean Energy Pay for Performance Program offered herein by the New Jersey Board of Public Utilities pursuant to state regulatory approval under the New Jersey Electric Discount and Energy Competition Act, NJSA 48:3-49, et seq.

PROGRAM GUIDELINES – See Pay for Performance Program Guidelines available from your Partner.

PROGRAM INCENTIVES – Refers to the amount or level of incentive that the Program provides to participating customers pursuant to the Program offered herein (see the description under “Incentive Amount” heading).

PROGRAM OFFER – The Program covers products purchased and/or services rendered on or after July 1, 2015.

PROJECT – A commercial or industrial existing building with peak demand in excess of 200 kW in any of the most recent preceding twelve months of electric usage, 100 kW for multifamily buildings. Multifamily building(s) must be four (4) stories or greater or three (3) stories and under having central heating, cooling, or metering serving more than one building. Refer to Multifamily Decision Tree.

TAX CLEARANCE CERTIFICATION – Businesses must apply for and receive a Tax Clearance Certificate from the New Jersey Division of Taxation before they can receive any incentive, grant or other financial assistance from the Program.

TAX LIABILITY – The Market Manager will not be responsible for any tax liability that may be imposed on any Participating Customer as a result of the payment of Program Incentives. All Participating Customers must supply their federal tax identification number or social security number on the application form in addition to providing a copy of their W-9 form as part of the application package in order to receive a Program Incentive.

TERMINATION – New Jersey's Clean Energy Program reserves the right to extend, modify (this includes modification of Program Incentive levels) or terminate this Program without prior or further notice.

WARRANTIES – THE MARKET MANAGER AND ADMINISTRATOR DO NOT WARRANT THE PERFORMANCE OF INSTALLED EQUIPMENT, AND/OR SERVICES RENDERED AS PART OF THIS PROGRAM, EITHER EXPRESSLY OR IMPLICITLY. NO WARRANTIES OR REPRESENTATIONS OF ANY KIND, WHETHER STATUTORY, EXPRESSED, OR IMPLIED, INCLUDING, WITHOUT LIMITATIONS, WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE REGARDING EQUIPMENT OR SERVICES PROVIDED BY A MANUFACTURER OR VENDOR. CONTACT YOUR VENDOR/ SERVICES PROVIDER FOR DETAILS REGARDING PERFORMANCE AND WARRANTIES.

ACKNOWLEDGEMENT – I have read, understood and am in compliance with all rules and regulations concerning this incentive program. I certify that all information provided is correct to the best of my knowledge, and I give the Market Manager permission to share my records with the New Jersey Board of Public Utilities, and contractors it selects to manage, coordinate or evaluate the Pay For Performance Program, including the release of electric and natural gas utility billing information, as well as make available to the public non-sensitive information. I allow reasonable access to my property to inspect the installation and performance of the technologies and installations that are eligible for incentives under the guidelines of New Jersey's Clean Energy Program. This arrangement supersedes all other communications and representations.

CUSTOMER'S SIGNATURE

PARTNER SIGNATURE

By signing, I certify that I have read, understand and agree to the Participation Agreement listed above.

IV. ENERGY SAVINGS IMPROVEMENT PLAN (ESIP)



Your Power to Save

At Home, for Business, and for the Future

[About Us](#) | [Press Room](#) | [Library](#)

HOME

RESIDENTIAL

COMMERCIAL, INDUSTRIAL
AND LOCAL GOVERNMENT

COMMERCIAL, INDUSTRIAL AND LOCAL GOVERNMENT

HURRICANE SANDY

PROGRAMS

NJ SMARTSTART BUILDINGS

PAY FOR PERFORMANCE

COMBINED HEAT & POWER AND
FUEL CELLSLOCAL GOVERNMENT ENERGY
AUDIT

LARGE ENERGY USERS PROGRAM

ENERGY SAVINGS IMPROVEMENT
PROGRAM

DIRECT INSTALL

ENERGY BENCHMARKING

OIL, PROPANE & MUNICIPAL
ELECTRIC CUSTOMERS

EDA PROGRAMS

SBC CREDIT PROGRAM

PAST PROGRAMS

TOOLS AND RESOURCES

PROGRAM UPDATES

CONTACT US

Home » Commercial & Industrial » Programs

Energy Savings Improvement Program

A new State law allows government agencies to make energy related improvements to their facilities and pay for the costs using the value of energy savings that result from the improvements. Under Chapter 4 of the Laws of 2009 (the law), the "Energy Savings Improvement Program" (ESIP), provides all government agencies in New Jersey with a flexible tool to make energy related improvements to their facilities and pay for the costs using the value of energy savings that result from the improvements. The program also allows agencies to reduce energy usage with minimal expenditure of new financial resources.

This Local Finance Notice outlines how local governments can develop and implement an ESIP at their facilities. Below are two sample RFPs:

Local Government
School Districts (K-12)

All RFPs must be submitted to the Board for approval at ESIP@bpu.state.nj.us.

The Board also adopted protocols to measure energy savings:

Measuring Energy Savings
Procedures for Implementation

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Local units should carefully consider all alternatives to develop an approach that best meets their needs. Local units considering an ESIP should carefully review the Local Finance Notice, the law, and consult with qualified professionals to determine how they should approach the task.

The NJ Board of Public Utilities sponsored Sustainable Jersey in the creation of an ESIP Guidebook that explains how to implement the program. The guidebook also includes a list of successful projects and a list of helpful resources.

FIRST STEP – ENERGY AUDIT

For local governments interested in pursuing an ESIP, the first step is to perform an energy audit as prescribed in P.L.2012 c.55.

ENERGY REDUCTION PLANS

If you have an ESIP plan that needs to be submitted to the Board of Public Utilities, please email it to ESIP@bpu.state.nj.us. Please limit the file size to 3MB (or break it into smaller files).

Frankford Township School District
Northern Hunterdon-Voorhees Regional High School
Manalapan Township (**180 MB** - Right Click, Save As)

ESIP PROGRAM

Final version 42413

BPU RULES

1. Public Entity must decide if they will use an ESCO or DIY method or Hybrid thereof prior to issuing the RFP and the RFP must state the intended method. A change in the project procurement model after the RFP closing date will be cause for immediate rejection and disqualification of potential Clean Energy program incentives.
2. RFP procedures shall be adhered to as per the legislation, including the use of BPU approved forms. Any alteration of the forms, without prior approval from the BPU shall be grounds for rejection.
3. RFP must include copy of an audit (ASHRAE Level II w/Level III for lighting) and audit must be prepared by a firm classified by DPMC in the 036 discipline.
4. All firms, including professional services, whether using ESCO or DIY model, must be DPMC classified.
5. If an Architect is engaged by the public entity, the architectural fees are the responsibility of the public entity and must be paid directly to the firm. These fees may be included in the energy cost savings analysis and payback.

ESCO's may contract directly with an architectural firm, in which case the architectural firm serves as a subcontractor to the ESCO and the project related service costs may be included within the project's economic model.

6. Public entity shall conduct pre-bid meetings and site visits per existing statutes.

In the interest of open public bidding transparency, it is a requirement of the BPU that all proposers must attend the pre-proposal bid meeting.

7. There shall be no negative cash flow in any year of the program.
section 7 (1)(a)
"the energy savings resulting from the program will be sufficient to cover the cost of the program's energy conservation measures."
8. SREC values are not permitted to be used in the energy cost savings calculations.
9. Capital cost avoidance values are not to be used in the energy savings calculations.
10. Operational and Maintenance (O&M) cost savings may be permitted in the cost savings calculations, but only with supporting documentation.
11. Blended utility rates shall not be permitted. Use the actual utility tariff or local contracted rates if there is a third party supplier.

For the RFP proposals, the public entity shall define the utility rates in the RFP

12. Contracted third party utility rates may only be used for the term of the contract (5 yr. maximum)
Subsequent years are to be projected at the utility tariff rates plus the annual BPU escalation rates.
13. Public entity shall conduct M&V (measurement and verification) at the one (1) year operational date and shall provide a copy of the M&V report to the Board of Public Utilities.

For the RFP proposals, the ESCO shall provide the cost for the one (1) year M&V only. For comparative purposes, the one year M&V pricing shall be indicated on the proposal Form VI, under the “Annual Service Costs” column. Additional M&V costs are at the discretion of the local unit and are not to be included in the proposal.

14. The decisions made by BPU staff regarding compliance or other issues that arise in connection with the RFP procurement process shall be considered a final decision of the BPU. Any appeal will need to be through the New Jersey Superior Court, Appellate Division.
15. For the RFP proposals only, Demand Response (DR) revenues claimed by ESCO’s can only be projected for a maximum period of three (3) years. DR revenue projections beyond three years will not be permitted. DR revenues must be included and presented under the “Energy Rebates/Incentives” column of FORM VI.
16. ESCO “fees” proposed during the RFP phase of the project cannot increase post-award. ESCO’s are required to maintain the fee percentages through final contract negotiations and construction of the Board approved Energy Savings Plan
17. Public Bid openings shall be held on the due date of the proposal submissions. The public entity shall announce the name of the bidder and the total dollar amount. After award of a contract, all proposals received will be made available by the owner for public inspection
18. Rejection of bids by the public entity shall be conducted in accordance with the appropriate sections of the applicable legislation, as stated in Title 40A:11-13.2. Additionally all proposals must be returned to the respective ESCO’s upon rejection.
19. Field changes that exceed 5% of the project cost require BPU approval.
20. Energy Savings Plans (ESP) that is dependent upon incentives from the Clean Energy Program must review the current program requirements, at the time of application, for each incentive to insure eligibility. If any program incentive is denied, resubmission of all ESIP related forms will be necessary to remain ESIP qualified.

APPENDIX E

Photovoltaic Analysis (Not Applicable For This Building)

APPENDIX F

Photos



RIDGE ELEMENTARY SCHOOL



AAOV ROOFTOP UNIT



TRANE ROOFTOP UNIT



HOT AIR FURNACE



DOMESTIC WATER HEATER



DOMESTIC HOT WATER CIRCULATING PUMP



DOMESTIC HOT WATER IN NEW WING



SOLAR PV SYSTEM PANEL

APPENDIX G

EPA Benchmarking Report



ENERGY STAR[®] Statement of Energy Performance

33

ENERGY STAR[®]
Score¹

Ridge Elementary School

Primary Property Function: K-12 School
Gross Floor Area (ft²): 53,654
Built: 1959

For Year Ending: March 31, 2015
Date Generated: July 01, 2015

1. The ENERGY STAR score is a 1-100 assessment of a building's energy efficiency as compared with similar buildings nationwide, adjusting for climate and business activity.

Property & Contact Information

Property Address

Ridge Elementary School
325 West Ridgewood Avenue
Ridgewood, New Jersey 07450

Property Owner

,
(____)____-____

Primary Contact

,
(____)____-____

Property ID: 4472184

Energy Consumption and Energy Use Intensity (EUI)

Site EUI

78.1 kBtu/ft²

Annual Energy by Fuel

Natural Gas (kBtu)	2,969,595 (71%)
Electric - Grid (kBtu)	1,220,243 (29%)

National Median Comparison

National Median Site EUI (kBtu/ft ²)	67.3
National Median Source EUI (kBtu/ft ²)	111.6
% Diff from National Median Source EUI	16%

Source EUI

129.5 kBtu/ft²

Annual Emissions

Greenhouse Gas Emissions (Metric Tons CO ₂ e/year)	321
---	-----

Signature & Stamp of Verifying Professional

I _____ (Name) verify that the above information is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Licensed Professional

,
(____)____-____



Professional Engineer Stamp
(if applicable)