

**FRANKLIN LAKES PUBLIC SCHOOL DISTRICT
WOODSIDE ELEMENTARY SCHOOL
ENERGY ASSESSMENT**

for

**NEW JERSEY
BOARD OF PUBLIC UTILITIES**

CHA PROJECT NO. 24497

November 2012

Prepared by:



6 Campus Drive
Parsippany, NJ 07054

(973) 538-2120

TABLE OF CONTENTS

1.0 EXECUTIVE SUMMARY	1
2.0 INTRODUCTION AND BACKGROUND	2
3.0 EXISTING CONDITIONS	3
3.1 Building – Envelope.....	3
3.2 Utility Usage.....	3
3.3 HVAC Systems	4
3.4 Control Systems	4
3.5 Lighting/Electrical Systems	4
3.6 Domestic Hot Water Systems	5
3.7 Plumbing Systems	5
4.0 ENERGY CONSERVATION MEASURES.....	6
4.1 ECM-1 Replace Gas Fired DHW	6
4.2 ECM-2 Install VSDs and Premium Motors on HW Pumps.....	6
4.3 ECM-3 Upgrade Pneumatic Controls to DDC System	7
4.4 ECM-4 Demand Controlled Ventilation (DCV) (Cafeteria)	8
4.5 ECM-5 Window Replacements and Reduced Glazing.....	8
4.6 ECM-6 Lighting Replacement / Upgrades	9
4.7 ECM-7 Install Lighting Controls (Occupancy Sensors)	10
4.8 ECM-8 Lighting Replacements with Controls (Occupancy Sensors)	10
4.9 ECM-9 Install Low Flow Plumbing.....	11
5.0 ENERGY CONSERVATION OPPORTUNITIES	12
5.1 Convert DX Cooling HVAC Units to Chilled Water	12
6.0 PROJECT INCENTIVES.....	13
6.1 Incentives Overview.....	13
6.1.1 New Jersey Pay For Performance Program.....	13
6.1.2 New Jersey Smart Start Program	14
6.1.3 Public Service Electric and Gas (PSE&G) Direct Install Program	14
6.1.4 Energy Savings Improvement Plans (ESIP).....	15

7.0	ALTERNATIVE ENERGY SCREENING EVALUATION	17
7.1	Solar	17
7.1.1	Photovoltaic Rooftop Solar Power Generation.....	17
7.1.2	Solar Thermal Hot Water Plant	18
7.2	Demand Response Curtailment	18
8.0	EPA PORTFOLIO MANAGER	19
9.0	CONCLUSIONS & RECOMMENDATIONS	20

APPENDICES

A	Utility Usage Analysis
B	Equipment Inventory
C	ECM Calculations
D	New Jersey Pay For Performance Incentive Program
E	Energy Savings Improvement Plan (ESIP)
F	Photovoltaic (PV) Rooftop Solar Power Generation
G	EPA Portfolio Manager

REPORT DISCLAIMER

This audit was conducted in accordance with the standards developed by the American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE) for a Level II audit. Cost and savings calculations for a given measure were estimated to within $\pm 20\%$, and are based on data obtained from the owner, data obtained during site observations, professional experience, historical data, and standard engineering practice. Cost data does not include soft costs such as engineering fees, legal fees, project management fees, financing, etc.

A thorough walkthrough of the school was performed, which included gathering nameplate information and operating parameters for all accessible equipment and lighting systems. Unless otherwise stated, model, efficiency, and capacity information included in this report were collected directly from equipment nameplates and /or from documentation provided by the owner during the site visit. Typical operation and scheduling information was obtained from interviewing school staff and spot measurements taken in the field.

1.0 EXECUTIVE SUMMARY

The Franklin Lakes Public School District recently engaged CHA to perform an energy audit for the Woodside Elementary School in connection with the New Jersey Board of Public Utilities' Local Government Energy Audit Program. This report details the results of the energy audit conducted for:

Building Name	Address	Square Feet	Construction Date
Woodside Elementary School	305 Woodside Ave Franklin Lakes, NJ 07417	53,400	1960

The Energy Conservation Measures (ECMs) identified in this report will allow for a more efficient use of energy and if pursued have the opportunity to qualify for the New Jersey SmartStart Buildings Program and/or Direct Install Program. Potential annual savings of \$13,100 for the recommended ECMs may be realized with a payback of 7.2 years. A summary of the costs, savings, and paybacks for the recommended ECMs follows:

Summary of Energy Conservation Measures							
Energy Conservation Measure		Approx. Costs (\$)	Approx. Savings (\$/year)	Payback (Years) w/o Incentive	Potential Incentive (\$)*	Payback (Years) w/ Incentive	Recommended For Implementation
ECM-1	Replace Gas-Fired DHW Heater	6,000	400	15	300	14	
ECM-2	Install VSD & Premium Motors on HW Pumps	10,000	1,900	5	2,300	4	X
ECM-3	Upgrade Pneumatic Control to DDC System	20,000	5,500	4	0	4	X
ECM-4	Demand Controlled Ventilation (Gym & Cafeteria)	20,000	1,800	11	0	11	X
ECM-5	Window Replacement and Reduced Glazing	215,000	4,200	>20	0	>20	
ECM-6	Lighting Replacement / Upgrades	52,000	3,000	17	5,600	15	
ECM-7	Install Lighting Controls (Occupancy Sensors)	18,000	3,500	5	3,000	4	X
ECM-8	Lighting Replacements with Lighting Controls (Occupancy Sensors)	70,000	5,800	12	8,700	11	
ECM-9	Install Low Flow Plumbing Fixtures	5,000	400	13	0	13	X

* Incentive shown is the maximum amount potentially available per the NJ SmartStart Programs.

2.0 INTRODUCTION AND BACKGROUND

The Woodside Elementary School building is a 53,400 square foot school consisting of two floors. The building was constructed in 1960. The school includes classrooms, offices, multi-purpose room, gymnasium, and a media center. The school hours of operation are from 8:45 AM – 3:30 PM Monday through Friday, with various after-school activities. The employees work hours are from 8:00 AM – 5:00 PM. The building is occupied approximately 8 hours per day Monday through Friday; totaling 40-50 hours per week. The school has approximately 282 students and 45 staff members.

New Jersey's Clean Energy Program, funded by the New Jersey Board of Public Utilities, supports energy efficiency and sustainability for Municipal and Local Government Energy Audits. Through the support of a utility trust fund, New Jersey is able to assist state and local authorities in reducing energy consumption while increasing comfort.



3.0 EXISTING CONDITIONS

3.1 Building – Envelope

The building envelope of the main building and addition are constructed of block walls (CMU) with a brick veneer. The majority of the interior walls are also painted block walls; 5/8" metal studs finished with gypsum board are used in spaces such as front office areas. The pitched roof is constructed of pine slates, one layer of tar (felt) paper, and finished with cedar shingles. The flat roof is constructed of 4" plywood, 4 ply built up roofing system.

Windows and doors are original 1960. The Windows have aluminum frames and single pane glazing. Doors are un-insulated steel. Windows doors and their associated seals are in fair condition.

3.2 Utility Usage

The utility consumption for the school includes electricity, natural gas for heating, and potable water. Electricity is delivered by Orange & Rockland and supplied by Direct Energy. Natural gas delivered by PSE&G and supplied by Woodruff Energy and Hess.

For the 12-month period ranging from June 2011 through May 2012, the utilities usage for the building was as follows:

Actual Cost & Site Usage by Utility

Electric		
Annual Usage	416,640	kWh/yr
Annual Cost	56,082.19	\$
Blended Rate	0.135	\$/kWh
Supply Rate	0.120	\$/kWh
Demand Rate	4.15	\$/kW
Peak Demand	204.0	kW
Min. Demand	91.2	kW
Avg. Demand	124.4	kW
Natural Gas		
Annual Usage	24,963.49	therms
Annual Cost	24,361.60	\$
Rate	1.02	\$/therms

Electrical usage was generally higher in the summer months when air conditioning equipment was operational. Natural Gas consumption was highest in winter months for heating.

Under New Jersey's energy deregulation law, the supply portion of the electric (or natural gas) bill is separated from the delivery portion. With the supply portion open to competition, customers can shop around for the best price on their energy supplies. Their electric and natural gas distribution utilities will still deliver those supplies through their wires and pipes – and respond to emergencies, should they arise – regardless of where those supplies are purchased.

Purchasing your energy supplies from a company other than your electric or gas utility is purely an economic decision; it has no impact on the reliability or safety of your service. Additional information on selecting a third party energy supplier is available here: <http://www.state.nj.us/bpu/commercial/shopping.html>. See Appendix A for a list of third-party energy suppliers licensed by the Board of Public Utilities to sell within the building's service area.

3.3 HVAC Systems

Hot water (HW) provides heat in the school. Three AERCO Benchmark condensing hot water boilers, located in the mechanical room, have an inputs of 1,500,000 BTU, output of 1,290,000 BTU, yielding 86% efficiency. They were installed in 2010 and are in excellent condition. . These boilers operate using a hot water reset schedule based on outdoor air temperature. The HW is pumped to the building to serve the building by two 7.5 HP pumps with an efficiency of 85.5%. The primary heating terminal units are classroom unit ventilators. Small classrooms are conditioned with a single Unit Ventilator (UV) while larger ones have two UVs. Supplemental heat is provided by fin tube radiations, cabinet heaters and convectors.

The administration area uses a chilled water system to condition air to the area. Chilled water is produced by a 45-ton McQuay chiller with a remote condenser on the roof. Music room and cafeteria have dedicated Roof Top Units (RTUs) to condition those spaces. The gymnasium has a HV-1 unit for ventilation and does not provide cooling. All the units are packaged rooftop unit. Split systems are equipped with direct expansion (DX) cooling coils and connected to a dedicated remote condensing unit located outdoors, either on the roof or ground, are utilized to cool a couple of spaces like the media center.

Systems in the school are controlled by factory mounted controls. The facility director stated that the typical setpoints of classrooms or offices are 70°F heating and 74°F cooling with +/- 3 degree variance.

Specifics on mechanical equipment can be found within the equipment inventory located in Appendix B.

3.4 Control Systems

The building has pneumatic controls. An air compressor creates compressed air to control the air handling units. The UVs have factory mounted thermostats that control the temperature in the classrooms. The spaces with Split systems have a thermostat that controls the space temperature for that space.

Systems in the school are controlled by factory mounted controls. The facility director stated that the typical setpoints of classrooms or offices are 70°F heating and 74°F cooling with +/- 3 degree variance.

3.5 Lighting/Electrical Systems

The school was upgraded in 2010 with new lamps bulbs and occupancy sensors to control the lighting system under the PSE&G Direct Install Program. Select area lights are still switched

manually. Some classrooms, offices and restrooms have sensors but there is an opportunity to add ceiling mounted sensors to other offices, hallways and restrooms. The school has all electronic ballast. Generally speaking the school has compact florescent lighting (CFLs). Classrooms, offices and corridor fixtures are four foot T-8 32W recessed fluorescents or in some cases four foot T-5 bulbs. Storage closets have 60W incandescent bulbs and the gymnasium utilizes 400W metal halides lamps.

Parking lot lighting consists of pole mounted high pressure sodium light fixtures which are on a timer. The building exterior utilizes 250W MVR lamps and Luminaire wall packs.

3.6 Domestic Hot Water Systems

The school utilizes a BTU D80T2503NA domestic hot water heater (DWH) to produce domestic hot water (DHW). The capacity is 80 gallon and was installed in 2000. The input is 250,000 BTU/hr and is estimated to be 80% efficient.

3.7 Plumbing Systems

The majority of the plumbing fixtures are low flow, 1.6 gallons per flush water closets, 1.0 gallon per flush urinals and 2.0 gallon per minute faucets. However, there were 10 water closets that appear to have high-flow flush valves. Ultra –low flow fixtures with new infrared operated flush valves and faucets could be installed to reduce water usage. The plumbing fixtures are in good condition.

.

4.0 ENERGY CONSERVATION MEASURES

4.1 ECM-1 Replace Gas Fired DHW

The school utilizes an 80 gallon, 250,000 BTU Bradford White D80T2503NA domestic hot water heater (DWH). The DHW is 80% efficiency and is past the useful life according to ASHRAE. This ECM assesses replacing this DWH with a more efficient tankless type domestic water heater sized to meet the DHW requirements of the building.

According to the U.S. Department of Energy, 2.5% of stored capacity is lost every hour during DHW heater standby. This value was applied to the total volume to determine annual standby losses. Proposed efficiency was based on a typical high efficiency natural gas condensing type hot water heater. The new water heater will require water and gas piping modifications, venting, and electrical connections.

Domestic hot water heaters have an expected life of 12 years, according to ASHRAE, and total energy savings over the life of the project are estimated at 4,800 therms and \$4,800.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-1 Replace Gas Fired DHW

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	Kgals	\$	\$	\$		\$	Years	Years
6,000	0	0	400	0	400	0	400	(0.1)	300	15.0	14.3

* Incentive shown is per the New Jersey SmartStart Install Program. See section 5.0 for other incentive opportunities.

This measure is not recommended.

4.2 ECM-2 Install VSDs and Premium Motors on HW Pumps

The hot water system is served by two (2) 7.5 HP pumps. The pumps are constant volume with standard efficiency motors. The hot water system pumps operate at a constant speed (constant water flows) even though the building load does not require all of the flow to maintain temperatures. By adding variable speed drives (VSDs) and inverter duty premium efficiency motors, and reducing the flow (by slowing the motors down), significant electrical energy can be saved.

The calculation use a system “on” set point of 55°F and bin weather data to estimate the heating hours of the building for the year. It was calculated that the heating hours are 4,887. The assumption of this calculation is that the operating hours, motor horsepower, and capacity stay the same.

VSDs have an expected life of 15 years, according to ASHRAE, and total energy savings over the life of the project are estimated at 213,000 kWh and \$28,500.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-2 Install VSDs and Premium Motors on HW Pumps

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
10,000	0	14,200	0	0	1,900	0	1,900	2.9	2,300	5.3	4.1

* Does not qualify for an Incentive per the New Jersey SmartStart Program. See section 5.0 for other incentive opportunities.

This measure is recommended.

4.3 ECM-3 Upgrade Pneumatic Controls to DDC System

The building has pneumatic controls. An air compressor creates compressed air to control the air handling units. The UVs have factory mounted thermostats that control the temperature in the classrooms. The spaces with Split systems have a thermostat that controls the space temperature for that space.

The annual electrical and natural gas consumption is taken from the utility bills. Per the U.S. Energy Information Administration, the percent of a building's cooling and heating is 52% and 48%, respectively. Utilizing these numbers, the annual electrical and natural gas usage was found. Based on project experience upgrading to a central DDC system produces a 10% energy saving.

Upgrading to a central DDC system has an expected life of 15 years, according to ASHRAE, and total energy savings over the life of the project are estimated at 76,,500 kWh, 70,500 therms, and \$82,500. It is also noted that to continue to gain this annual savings proper maintenance of equipment needs to take place.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-3 Upgrade Pneumatic Control to DDC System

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
20,000	0	5,100	4,700	0	5,500	0	5,500	3.1	0	3.6	3.6

* Incentive shown is per the New Jersey Direct Install Program. See section 5.0 for other incentive opportunities.

This measure is recommended.

4.4 ECM-4 Demand Controlled Ventilation (DCV) (Cafeteria)

The gymnasium & cafeteria have dedicated rooftop units which are designed to provide ventilation based on maximum occupancy. This occurs infrequently and reducing the amount of ventilation will result in energy savings. Installation of carbon dioxide (CO₂) sensors will allow for a reduction of outside air during periods of low occupancy. The quantity of ventilation air will be based on maintaining an acceptable CO₂ level in the space as an indicator of indoor air quality. A limit of 1000 PPM of CO₂ is recommended in ASHRAE Standard 62-2010, Ventilation for Acceptable Indoor Air Quality. Sensors will be installed to measure the building air CO₂ concentration, and the control sequence of operation changed. During unoccupied periods, the outside air dampers should be closed.

Bin weather data was utilized to obtain the annual operating hours required to maintain the current setpoint of 70°F. The BTU/Hr rating is calculated from the OA conditions and CFM. It is assumed that installing the controls will reduce the amount of OA to be conditioned by 20%. The annual thermal usage was estimated. The energy saving is the difference in natural gas usage.

Controls have an expected life of 15 years, according to ASHRAE, and total energy savings over the life of the project are estimated at 120,000 kWh, 10,500 therms and \$27,000.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-4 Demand Controlled Ventilation (DCV) (Gym & Cafeteria)

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
20,000	0	8,000	700	0	1,800	0	1,800	0.4	0	11.1	11.1

* Does not qualify for an Incentive per the New Jersey SmartStart Program. See section 5.0 for other incentive opportunities.

This measure is recommended.

4.5 ECM-5 Window Replacements and Reduced Glazing

The school has 4,800 square feet of window area. These windows are constructed with aluminum frames and single pane glazing. Due to age, construction type, and condition, the windows incur excess air infiltration and provide average thermal resistance to heat transfer. An assessment considered installing aluminum frame with triple pane glazing with internal blinds to decrease energy losses.

The calculation uses bin hours to estimate the occupied and unoccupied bin hours. This is converted to existing energy for the occupied and unoccupied cases using the existing window U-factor and the heating and cooling temperature. The two are summed together to create the annual utility usage for the baseline. The same steps are done to calculate the proposed utility usage. The difference in heating losses through the windows resulted in annual heating and cooling savings.

Windows have an expected life of 30 years, according to manufacturer; total energy savings over the life of the windows are estimated at 48,000 kWh and 69,000 therms, which results in a cost savings of \$78,000 without inflation/escalation.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized as follows:

ECM-5 Window Replacements and Reduced Glazing

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	Kgals	\$	\$	\$		\$	Years	Years
215,000	0	2,000	3,800	0	4,200	0	4,200	(0.4)	0	>20	>20

* Does not qualify for an Incentive per the New Jersey SmartStart Program. See section 5.0 for other incentive opportunities.

This measure is not recommended.

4.6 ECM-6 Lighting Replacement / Upgrades

The school was upgraded in 2010 with new lamps bulbs and occupancy sensors to control the lighting system under the PSE&G Direct Install Program. Select area lights are still switched manually. Some classrooms, offices and restrooms have sensors but there is an opportunity to add ceiling mounted sensors to other offices, hallways and restrooms. The school has all electronic ballast. Generally speaking the school has compact florescent lighting (CFLs). Classrooms, offices and corridor fixtures are four foot T-8 32W recessed fluorescents or in some cases four foot T-5 bulbs. Storage closets have 60W incandescent bulbs and the gymnasium utilizes 400W metal halides lamps.

Energy savings for this measure were calculated by applying the existing and proposed fixture wattages to estimated times of operation. The difference between energy requirements resulted in a total annual savings of 20,600 kWh with an electrical demand reduction of about 9.7 kW. Supporting calculations, including assumptions for lighting hours and annual energy usage for each fixture, are provided in Appendix C.

Lighting has an expected life of 15 years, according to the manufacturer, and total energy savings over the life of the project are estimated at 309,000 kWh and \$45,000.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-6 Lighting Replacement / Upgrades

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
52,000	9.7	20,600	0	0	3,000	0	3,000	(0.2)	5,600	17.3	15.5

* Incentive shown is per the New Jersey Direct Install Program. See section 5.0 for other incentive opportunities.

This measure is not recommended in lieu of ECM-7.

4.7 ECM-7 Install Lighting Controls (Occupancy Sensors)

Review of the comprehensive lighting survey determined that lighting in classrooms, restrooms, and various other spaces, are typically operational, regardless of occupancy. Therefore, installing an occupancy sensor in these spaces to turn off lights when the areas are unoccupied was assessed.

Using a process similar to that utilized in section 4.6, the energy savings for this measure were calculated by applying the known fixture wattages in the space to the estimated existing and proposed times of operation for each fixture. The difference between the two values resulted in an annual savings of 28,900 kWh. Ceiling-mounted occupancy sensors with dimmer control are required for this measure.

Occupancy sensors have an expected life of 15 years, according to the manufacturer, and total energy savings over the life of the project are estimated at 660,000 kWh and \$93,000.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-8 Install Lighting Controls (Occupancy Sensors)

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
18,000	0	28,900	0	0	3,500	0	3,500	2.3	3,000	5.1	4.2

* Incentive shown is per the New Jersey Direct Install Program. See section 5.0 for other incentive opportunities.

This measure is recommended.

4.8 ECM-8 Lighting Replacements with Controls (Occupancy Sensors)

Due to interactive effects, the energy and cost savings for occupancy sensors and lighting upgrades are not cumulative. This measure is a combination of ECMs-7 and 8 to reflect actual expected energy and demand reduction.

The lighting retrofits and controls have an expected lifetime of 15 years, according to the manufacturer, and total energy savings over the life of the project are estimated at 660,000 kWh and \$93,000.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-8 Lighting Replacements with Controls (Occupancy Sensors)

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
70,000	9.7	44,000	0	0	5,800	0	5,800	0.2	8,700	12.1	10.6

* Incentive shown is per the New Jersey Direct Install Program. See section 5.0 for other incentive opportunities.

This measure is not recommended in lieu of ECM-7.

4.9 ECM-9 Install Low Flow Plumbing

The school has a mixture of older and newer style fixtures in the restrooms. The older style fixtures consume more water than modern plumbing fixtures. It was determined that there are 10 toilets with an average water use of 3.5 gal/flush. Per the number of occupants, it was estimated that each toilet and faucet is utilized approximately nine times per day.

The water savings associated from replacing these fixtures with low-flow fixtures was calculated by taking the difference of the annual water usage for the proposed and base case. The basis of this calculation is the number of times each fixture is used, gallons per use, and number of fixtures. Replacing the existing fixtures in the restrooms with 1.28 gals/flush toilets would save 100 KGal annually.

Toilets and faucets have an expected life of 15 years, according to the manufacturer, and total energy savings over the life of the project are estimated at 100 KGal and \$15,000.

The implementation cost and savings related to this ECM are presented in Appendix C and summarized below:

ECM-9 Install Low Flow Plumbing

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
5,000	0	0	0	100	400	0	400	0.3	0	12.5	12.5

* There is no incentive available through the New Jersey Smart Start or Direct Install Programs for this ECM. See section 5.0 for other incentive opportunities.

This measure is recommended.

5.0 ENERGY CONSERVATION OPPORTUNITIES

5.1 Convert DX Cooling HVAC Units to Chilled Water

This building currently uses a chiller to make chilled water to condition the administration area. The capacity of the chiller is 45 tons and according to the maintenance personnel there is additional capacity on the system for additional load. There are HVAC units in the area are presently direct Expansion (DX) cooling that could be converted to chilled water. Each DX unit consumes electricity to change the phase of the refrigerant to condition this air to 55 degrees F. Analyzing the tonnage, number of units and hours of operation could justify changing these units from DX cooling to chilled water and installing a new central chiller plant to supply chilled water. Further analysis will be needed to evaluate the savings associated with this measure.

6.0 PROJECT INCENTIVES

6.1 Incentives Overview

6.1.1 New Jersey Pay For Performance Program

The school will be eligible for incentives from the New Jersey Office of Clean Energy. The most significant incentives are available from the New Jersey Pay for Performance (P4P) Program. The P4P program is designed for qualified energy conservation projects applied to facilities whose demand in any of the preceding 12 months exceeds 100 kW. This average minimum has been waived for buildings owned by local governments or municipalities and non-profit organizations, however. Facilities that meet this criterion must also achieve a minimum performance target of 15% energy reduction by using the EPA Portfolio Manager benchmarking tool before and after implementation of the measure(s). If the participant is a municipal electric company customer, and a customer of a regulated gas New Jersey Utility, only gas measures will be eligible under the Program. Available incentives are as follows:

Incentive #1: Energy Reduction Plan – This incentive is designed to offset the cost of services associated with the development of the Energy Reduction Plan (ERP).

- Incentive Amount: \$0.10/SF
- Minimum incentive: \$5,000
- Maximum Incentive: \$50,000 or 50% of School annual energy cost

The standard incentive pays \$0.10 per square foot, up to a maximum of \$50,000, not to exceed 50% of school annual energy cost, paid after approval of application. For building audits funded by the New Jersey Board of Public Utilities, which receive an incentive toward performance of the energy audit, facilities are only eligible for an additional \$0.05 per square foot, up to a maximum of \$25,000, rather than the standard incentive noted above.

Incentive #2: Installation of Recommended Measures – This incentive is based on projected energy savings as determined in Incentive #1 (Minimum 15% savings must be achieved), and is paid upon successful installation of recommended measures.

Electric

- Base incentive based on 15% savings: \$0.09/ per projected kWh saved.
- For each % over 15% add: \$0.005 per projected kWh saved.
- Maximum incentive: \$0.11/ kWh per projected kWh saved

Gas

- Base incentive based on 15% savings: \$0.90/ per projected Therm saved.
- For each % over 15% add: \$0.05 per projected Therm saved.
- Maximum incentive: \$1.25 per projected Therm saved

Incentive cap: 25% of total project cost

Incentive #3: Post-Construction Benchmarking Report – This incentive is paid after acceptance of a report proving energy savings over one year utilizing the Environmental Protection Agency (EPA) Portfolio Manager benchmarking tool.

Electric

- Base incentive based on 15% savings: \$0.09/ per projected kWh saved.
- For each % over 15% add: \$0.005 per projected kWh saved.

- Maximum incentive: \$0.11/ kWh per projected kWh saved

Gas

- Base incentive based on 15% savings: \$0.90/ per projected Therm saved.
- For each % over 15% add: \$0.05 per projected Therm saved.
- Maximum incentive: \$1.25 per projected Therm saved

Incentives #2 and #3 can be combined to yield additive savings.

Total P4P incentives are summarized below:

	Incentives \$		
	Electric	Gas	Total
Incentive #1	\$0	\$0	\$5,340
Incentive #2	\$8,076	\$12,028	\$20,104
Incentive #3	\$8,076	\$12,028	\$20,104
Total	\$16,151	\$24,056	\$45,547

The current recommended ECM's meet the minimum annual savings of 15% required by the P4P program and therefore the building would be eligible for incentives #1, #2 and #3. See Appendix D for additional analysis.

6.1.2 New Jersey Smart Start Program

For this program, specific incentives for energy conservation measures are calculated on an individual basis utilizing the 2011 New Jersey Smart Start incentive program. This program provides incentives dependent upon mechanical and electrical equipment. If applicable, incentives from this program are reflected in the ECM summaries and attached appendices.

If the complex qualifies and enters into the New Jersey Pay for Performance Program, all energy savings will be included in the total site energy reduction, and savings will be applied towards the Pay for Performance incentive. A project is not applicable for both New Jersey incentive programs.

6.1.3 Public Service Electric and Gas (PSE&G) Direct Install Program

The Public Service Electric and Gas (PSE&G) Direct Install Program targets government and non-profit customer facilities where the peak electrical demand does not exceed 150 kW in any of the previous 12 months. All elementary and secondary schools are considered regardless of size and rate class. Customers must be a PSE&G customer of record with separately metered PSE&G electric or gas account.

Direct Install is funded through PSE&G and is designed to provide capital for building energy upgrade projects to fast track implementation. The program will pay up to 80% of the costs for lighting retrofits including sensors and controls, refrigeration, motors, HVAC and site-specific custom projects. PSE&G makes the investment in energy efficiency upgrades easy for the client by initially covering 100% of the cost to install the recommended energy efficiency measures. The client will repay the remaining 20% of the total cost to install the energy efficiency measures,

interest free, over the next two years on your PSE&G bill or one lump sum payment depending on the clients preference. If a building is eligible for this funding, the PSE&G Direct Install Program can significantly reduce the implementation cost of energy conservation projects.

Installations must be completed by a PSE&G Direct Install participating contractor which is assigned by the PSE&G project manager. More information regarding the program can be found on PSE&G's website at:

http://www.pseg.com/business/small_large_business/save_energy/gov_efficiency.jsp.

Contractors will coordinate with the applicant to arrange installation of recommended measures identified in a previous energy assessment, such as this document once the cost proposal is approved.

This program is applicable to the Woodside Elementary School based on the program requirements that consider all elementary and secondary schools regardless of size or rate class.

The Direct Install Program targets small and medium sized facilities where the peak electrical demand does not exceed 150 kW in any of the previous 12 months. Buildings must be located in New Jersey and served by one of the state's public, regulated electric utility companies. On a case-by-case basis, the program manager may accept a project for a customer that is within 10% of the 150 kW peak demand threshold.

Direct Install is funded through New Jersey's Clean Energy Program and is designed to provide capital for building energy upgrade projects to fast track implementation. The program will pay up to 70% of the costs for lighting, HVAC, motors, refrigeration, and other equipment upgrades with higher efficiency alternatives. If a building is eligible for this funding, the Direct Install Program can significantly reduce the implementation cost of energy conservation projects.

The program pays a maximum amount of \$75,000 per building, and up to \$250,000 per customer per year. Installations must be completed by a Direct Install participating contractor, a list of which can be found on the New Jersey Clean Energy Website at <http://www.njcleanenergy.com>. Contractors will coordinate with the applicant to arrange installation of recommended measures identified in a previous energy assessment, such as this document.

This program is not applicable to the Woodside Elementary School based on the school's average peak demand of 204.0 kW.

6.1.4 Energy Savings Improvement Plans (ESIP)

The Energy Savings Improvement Program (ESIP) allows government agencies to make energy related improvements to their facilities and pay for the costs using the value of energy savings that result from the improvements. Under the recently enacted Chapter 4 of the Laws of 2009 (the law), the ESIP provides all government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources.

ESIP allows local units to use "energy savings obligations" to pay for the capital costs of energy improvements to their facilities. This can be done over a maximum term of 15 years. Energy savings obligations are not considered "new general obligation debt" of a local unit and do not count against debt limits or require voter approval. They may be issued as refunding bonds or leases. Savings generated from the installation of energy conservation measures pay the principal

of and interest on the bonds; for that reason, the debt service created by the ESOs is not paid from the debt service fund, but is paid from the general fund.

For local governments interested in pursuing an ESIP, the first step is to perform an energy audit. Pursuing a Local Government Energy Audit through New Jersey's Clean Energy Program is a valuable first step to the ESIP approach. The "Local Finance Notice" outlines how local governments can develop and implement an ESIP for their facilities (see Appendix E). The ESIP can be prepared internally if the entity has qualified staff. If not, the ESIP must be implemented by an independent contractor and not by the energy savings company producing the Energy Reduction Plan.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Local units should carefully consider all alternatives to develop an approach that best meets their needs.

7.0 ALTERNATIVE ENERGY SCREENING EVALUATION

7.1 Solar

7.1.1 Photovoltaic Rooftop Solar Power Generation

The school was evaluated for the potential to install rooftop photovoltaic (PV) solar panels for power generation. Present technology incorporates the use of solar cell arrays that produce direct current (DC) electricity. This DC current is converted to alternating current (AC) with the use of an electrical device known as an inverter. The building's roof has sufficient room to install a large solar cell array.

The PVWATTS solar power generation model was utilized to calculate PV power generation. The closest city available in the model is Newark, New Jersey and a fixed tilt array type was utilized to calculate energy production.

Installation of (PV) arrays in the state New Jersey will allow the owner to participate in the New Jersey solar renewable energy certificates program (SREC). This is a program that has been set up to allow entities with large amounts of environmentally unfriendly emissions to purchase credits from zero emission (PV) solar-producers. One SREC credit is equivalent to 1000 kilowatt hours of PV electrical production; these credits can be traded for period of 15 years from the date of installation. The average SREC value per credit is estimated to be about \$75/ SREC per year based on current market data, and this number was utilized in the cash flow for this report.

The existing load justifies the use of a 70.0 kW PV solar array. The system costs for PV installations were derived from contractor budgetary pricing in the state of New Jersey for estimates of total cost of system installation. It should be noted that the cost of installation is currently about \$4.00 per watt or \$4,000 per kW of installed system. Other cost considerations will also need to be considered such as structural reinforcement of the roof. PV panels have an approximate 20 year life span; however, the inverter device that converts DC electricity to AC has a life span of 10 to 12 years and will need to be replaced multiple times during the useful life of the PV system.

The implementation cost and savings related to this ECM are presented in Appendix F and summarized as follows:

Photovoltaic (PV) Rooftop Solar Power Generation – 70.0 kW System

Budgetary Cost	Annual Utility Savings				Total Savings	New Jersey Renewable Energy Incentive*	New Jersey Renewable SREC**	Payback (without incentive)	Payback (with incentives)
	Electricity		Natural Gas	Total					
\$	kW	kWh	Therms	\$	\$	\$	\$	Years	Years
280,000	70.0	91,233	0	12,316	12,316	0	6,842	>20	14.6

** Estimated Solar Renewable Energy Certificate Program (SREC) for 15 years at \$95/1000 kWh

This measure is not recommended due to the long payback time. It is suggested, however, that the market for SREC credits is closely monitored. This market is fluctuating, and if the value per SREC is increased the measure could potentially show for a shorter payback in the near future.

7.1.2 Solar Thermal Hot Water Plant

Active solar thermal systems use solar collectors to gather the sun's energy to heat water, another fluid, or air. An absorber in the collector converts the sun's energy into heat. The heat is then transferred by circulating water, antifreeze, or sometimes air to another location for immediate use or storage for later utilization. Applications for active solar thermal energy include providing hot water, heating swimming pools, space heating, and preheating air in residential and commercial buildings.

A standard solar hot water system is typically composed of solar collectors, heat storage vessel, piping, circulators, and controls. Systems are typically integrated to work alongside a conventional heating system that provides heat when solar resources are not sufficient. The solar collectors are usually placed on the roof of the building, oriented south, and tilted around the site's latitude, to maximize the amount of radiation collected on a yearly basis.

Several options exist for using active solar thermal systems for space heating. The most common method involves using glazed collectors to heat a liquid held in a storage tank (similar to an active solar hot water system). The most practical system would transfer the heat from the panels to thermal storage tanks and transfer solar produced thermal energy to use for domestic hot water production. DHW is presently produced by gas-fired water heaters and, therefore, this measure would offer natural gas utility savings.

This measure is not recommended due to the relatively low use of domestic hot water throughout the entire year.

7.2 Demand Response Curtailment

Presently, electricity is delivered by Orange & Rockland, which receives the electricity from regional power grid RFC. Direct Energy is the regional transmission organization (RTO) that coordinates the movement of wholesale electricity in all or parts of 13 states and the District of Columbia including the State of New Jersey.

Utility Curtailment is an agreement with the utility provider's regional transmission organization and an approved Curtailment Service Provider (CSP) to shed electrical load by either turning major equipment off or energizing all or part of a school utilizing an emergency generator; therefore, reducing the electrical demand on the utility grid. This program is to benefit the utility company during high demand periods and utility provider offers incentives to the CSP to participate in this program. Enrolling in the program will require program participants to drop electrical load or turn on emergency generators during high electrical demand conditions or during emergencies. Part of the program also will require that program participants reduce their required load or run emergency generators with notice to test the system.

A pre-approved CSP will require a minimum of 100 kW of load reduction to participate in any curtailment program. From June 2011 through May 2012, the electric usage for the school had a maximum electricity demand of 204.0 kW and a minimum of 91.2 kW. The monthly average over the observed 12 month period was 124.4 kW.

This measure is not recommended.

8.0 EPA PORTFOLIO MANAGER

The EPA Portfolio Manager benchmarking tool was used to assess the building's energy performance. Portfolio Manager provides a site and source Energy Use Intensity (EUI), as well as an Energy Star performance rating for qualifying building types. The EUIs are provided in kBtu/ft²/year, and the performance rating represents how energy efficient a building is on a scale of 1 to 100, with 100 being the most efficient. In order for a building to receive an Energy Star label, the energy benchmark rating must be at least 75. As energy use decreases from implementation of the proposed measures, the Energy Star rating will increase.

The site EUI is the amount of heat and electricity consumed by a building as reflected in utility bills. Site energy may be delivered to a school in the form of primary energy, which is raw fuel burned to create heat or electricity, such as natural gas or oil; or as secondary energy, which is the product created from a raw fuel such as electricity or district steam. To provide an equitable comparison for different buildings with varying proportions of primary and secondary energy consumption, Portfolio Manager uses the convention of source EUIs. The source energy also accounts for losses incurred in production, storage, transmission, and delivery of energy to the site, which provide an equivalent measure for various types of buildings with differing energy sources. The results of the Portfolio Manager benchmarking tool are contained in the table below.

Building	Site EUI kBtu/ft ² /yr	Source EUI Btu/ft ² /yr	Energy Star Rating (1-100)
Woodside Elementary School	72	137	65

The Woodside Elementary school has an above average Energy Star rating of 65, with a score of 50 being the median score. By implementing the measures discussed in this report, it is expected that the EUI can be reduced and the score increased. By obtaining a score of 75 or better, the school would be eligible to receive the Energy Star Rating Certification.

The Portfolio Manager account can be accessed by entering the username and password shown below at the login screen of the Portfolio Manager website (<https://www.energystar.gov/istar/pmpam/>). The account has been shared with the NYSERDABENCHMARKING master account.

Username: franklinlakesboe

Password: energystar

A full EPA Energy Star Portfolio Manager Report is located in Appendix G.

The user name and password for the building's EPA Portfolio Manager Account has been provided to Michael Solokas, Business Administrator

9.0 CONCLUSIONS & RECOMMENDATIONS

The LGEA energy audit conducted by CHA at the Woodside Elementary School identified several potential ECMs lighting control replacement, upgrading the pneumatic controls and installing VSDs and premium motors can yield potential annual savings of \$10,900. A summary of the costs, savings, and paybacks are as follows:

ECM-2 Install VSDs and Premium Motors on HW Pumps

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	Kgals	\$	\$	\$		\$	Years	Years
10,000	0	14,200	0	0	1,900	0	1,900	2.9	2,300	5.3	4.1

ECM-3 Upgrade Pneumatic Control to DDC System

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
20,000	0	5,100	4,700	0	5,500	0	5,500	3.1	0	3.6	3.6

ECM-4 Demand Controlled Ventilation (DCV) (Gym & Cafeteria)

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
20,000	0	8,000	700	0	1,800	0	1,800	0.4	0	11.1	11.1

* Does not qualify for an Incentive per the New Jersey SmartStart Program. See section 5.0 for other incentive opportunities.

ECM-7 Install Lighting Controls (Occupancy Sensors)

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
18,000	0	28,900	0	0	3,500	0	3,500	2.3	3,000	5.1	4.2

ECM-9 Install Low Flow Plumbing

Budgetary Cost	Annual Utility Savings					Estimated Maintenance Savings	Total Savings	ROI	Potential Incentive*	Payback (without Incentive)	Payback (with Incentive)
	Electricity		Natural Gas	Water	Total						
\$	kW	kWh	Therms	kGals	\$	\$	\$		\$	Years	Years
5,000	0	0	0	100	400	0	400	0.3	0	12.5	12.5

* There is no incentive available through the New Jersey Smart Start or Direct Install Programs for this ECM. See section 5.0 for other incentives.

APPENDIX A

Utility Usage Analysis

Third Party Energy Suppliers List


Franklin Lakes BOE
490 Pulis Ave, Franklin Lakes, NJ 07417

Electric Service
Delivery - Orange & Rockland
Supplier - Direct Energy

For Service at: Woodside Avenue School
Account No.: 56582-71003 / 1065362
Meter No.: 601001321

Month	Consumption (kWh)	Demand (kW)	Charges			Unit Costs		
			Total (\$)	Delivery (\$)	Supply (\$)	Blended Rate (\$/kWh)	Consumption (\$/kWh)	Demand (\$/kW)
June-11	46,800	204.0	\$2,763.31	\$2,763.31		\$ 0.059	\$ 0.042	\$ 3.83
July-11	41,280	151.2	\$6,590.13	\$2,369.25	\$4,220.88	\$ 0.160	\$ 0.146	\$ 3.80
August-11	38,400	112.8	\$6,032.74	\$2,106.34	\$3,926.40	\$ 0.157	\$ 0.146	\$ 3.76
September-11	37,200	146.4	\$5,974.61	\$2,170.91	\$3,803.70	\$ 0.161	\$ 0.146	\$ 3.70
October-11	30,743	117.6	\$4,804.60	\$1,810.72	\$2,993.88	\$ 0.156	\$ 0.141	\$ 3.95
November-11	33,817	98.4	\$5,562.52	\$1,955.14	\$3,607.38	\$ 0.164	\$ 0.151	\$ 4.72
December-11	29,760	98.4	\$4,366.43	\$1,777.31	\$2,589.12	\$ 0.147	\$ 0.131	\$ 4.72
January-12	34,560	98.4	\$4,959.72	\$1,953.00	\$3,006.72	\$ 0.144	\$ 0.130	\$ 4.72
February-12	28,800	91.2	\$4,219.95	\$1,714.35	\$2,505.60	\$ 0.147	\$ 0.130	\$ 5.09
March-12	28,560	91.2	\$4,189.12	\$1,704.40	\$2,484.72	\$ 0.147	\$ 0.130	\$ 5.09
April-12	30,480	100.8	\$4,435.73	\$1,783.97	\$2,651.76	\$ 0.146	\$ 0.130	\$ 4.61
May-12	36,240	182.4	\$2,183.33	\$2,183.33		\$ 0.060	\$ 0.043	\$ 3.40
Total (All)	416,640	204.0	\$56,082.19	\$24,292.03	\$31,790.16	\$ 0.135	\$ 0.120	\$ 4.15

Electric Usage - Woodside Avenue School

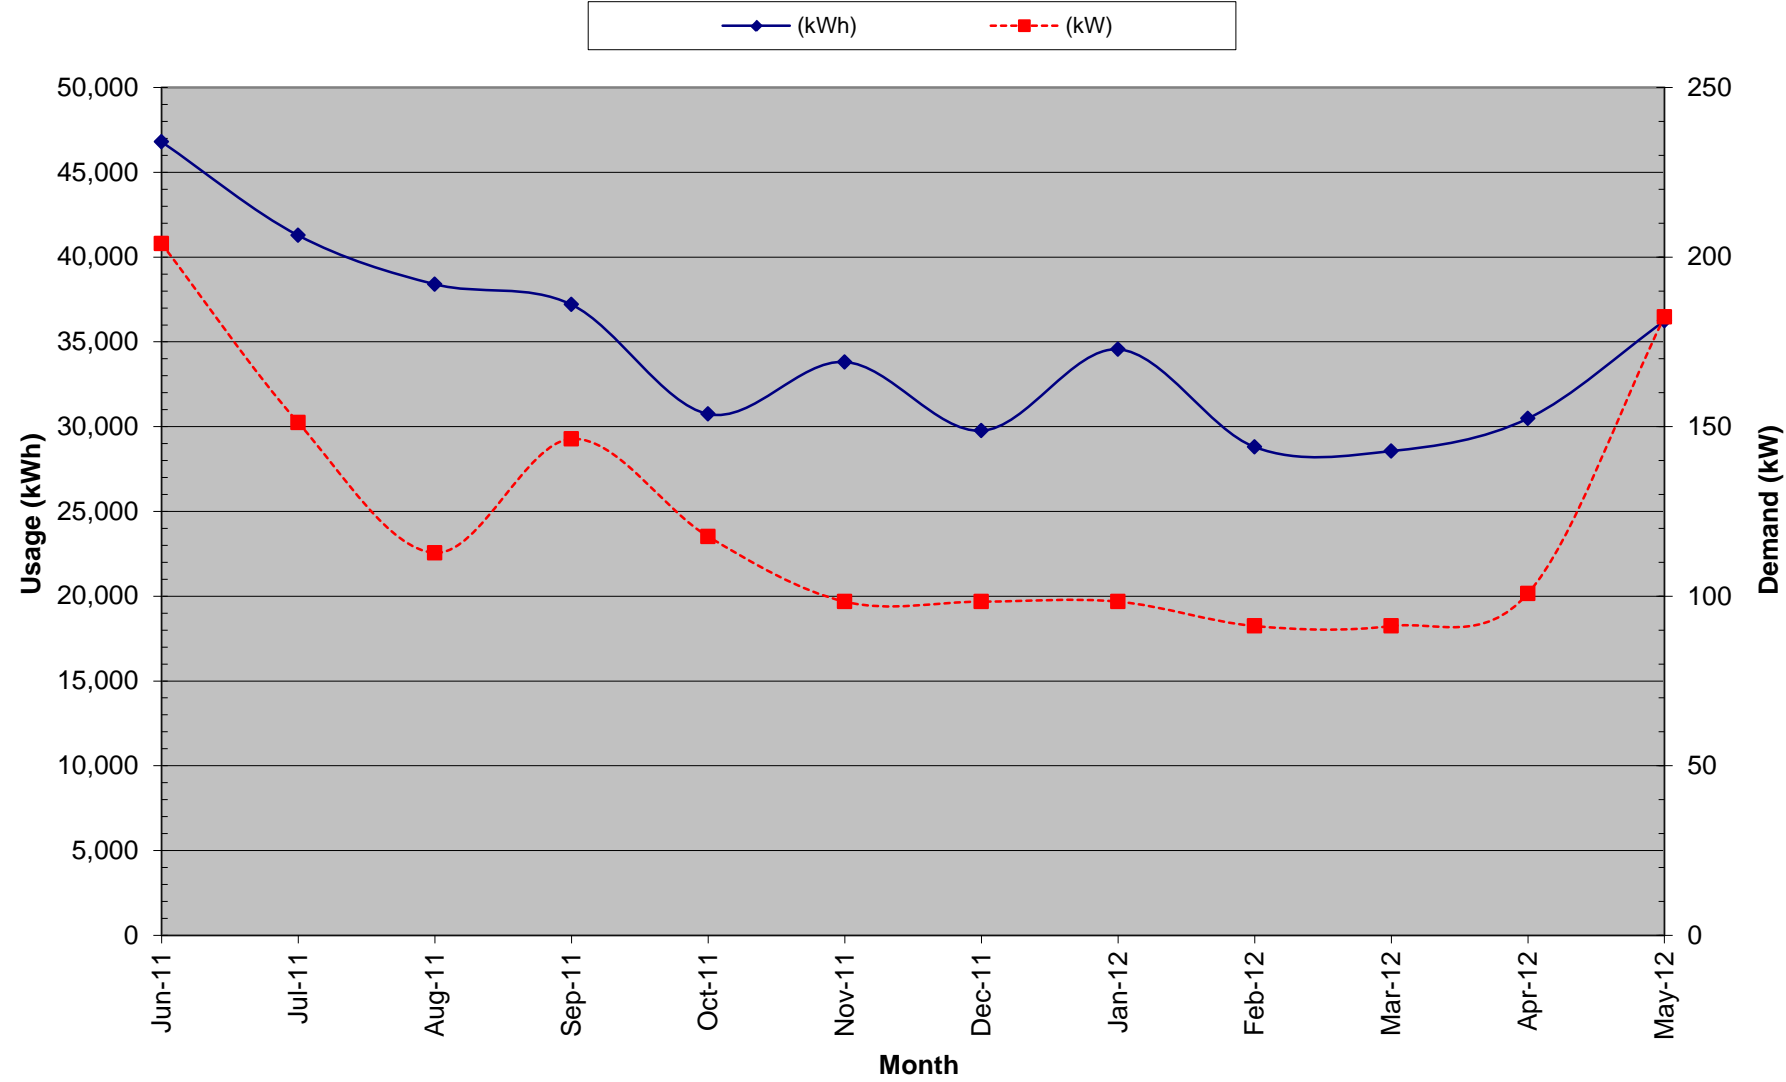


Franklin Lakes BOE
490 Pulis Ave, Franklin Lakes, NJ 07417

Gas Service
Delivery - PSE&G
Supplier - Woodruff Energy / Hess

For Service at: Woodside Avenue School
Account No.: 6669547501
Meter No.: 2917501

Month	Total (\$)	Delivery (\$)	Supply (\$)	Total Therms	\$/Therm
Jun-11	\$ 97.29	\$ 97.29	\$ -	0	#DIV/0!
Jul-11	\$ 125.71	\$ 103.23	\$ 22.48	34.801	\$ 3.61
Aug-11	\$ 141.58	\$ 107.66	\$ 33.92	56.002	\$ 2.53
Sep-11	\$ 143.67	\$ 109.37	\$ 34.30	67.692	\$ 2.12
Oct-11	\$ 1,609.96	\$ 1,175.02	\$ 434.94	868.145	\$ 1.85
Nov-11	\$ 3,479.05	\$ 1,667.20	\$ 1,811.85	3423.88	\$ 1.02
Dec-11	\$ 5,637.51	\$ 2,037.71	\$ 3,599.80	5380.338	\$ 1.05
Jan-12	\$ 5,603.30	\$ 1,914.82	\$ 3,688.48	5556.479	\$ 1.01
Feb-12	\$ 5,301.14	\$ 1,857.08	\$ 3,444.06	5570.659	\$ 0.95
Mar-12	\$ 1,820.76	\$ 370.91	\$ 1,449.85	2345.092	\$ 0.78
Apr-12	\$ 852.87	\$ 240.00	\$ 612.87	991.229	\$ 0.86
May-12	\$ 150.65	\$ 109.04	\$ 41.61	67.285	\$ 2.24
Total	\$ 24,963.49	\$ 9,789.33	\$ 15,174.16	24361.602	\$ 1.02

Natural Gas Usage - Woodside Avenue School

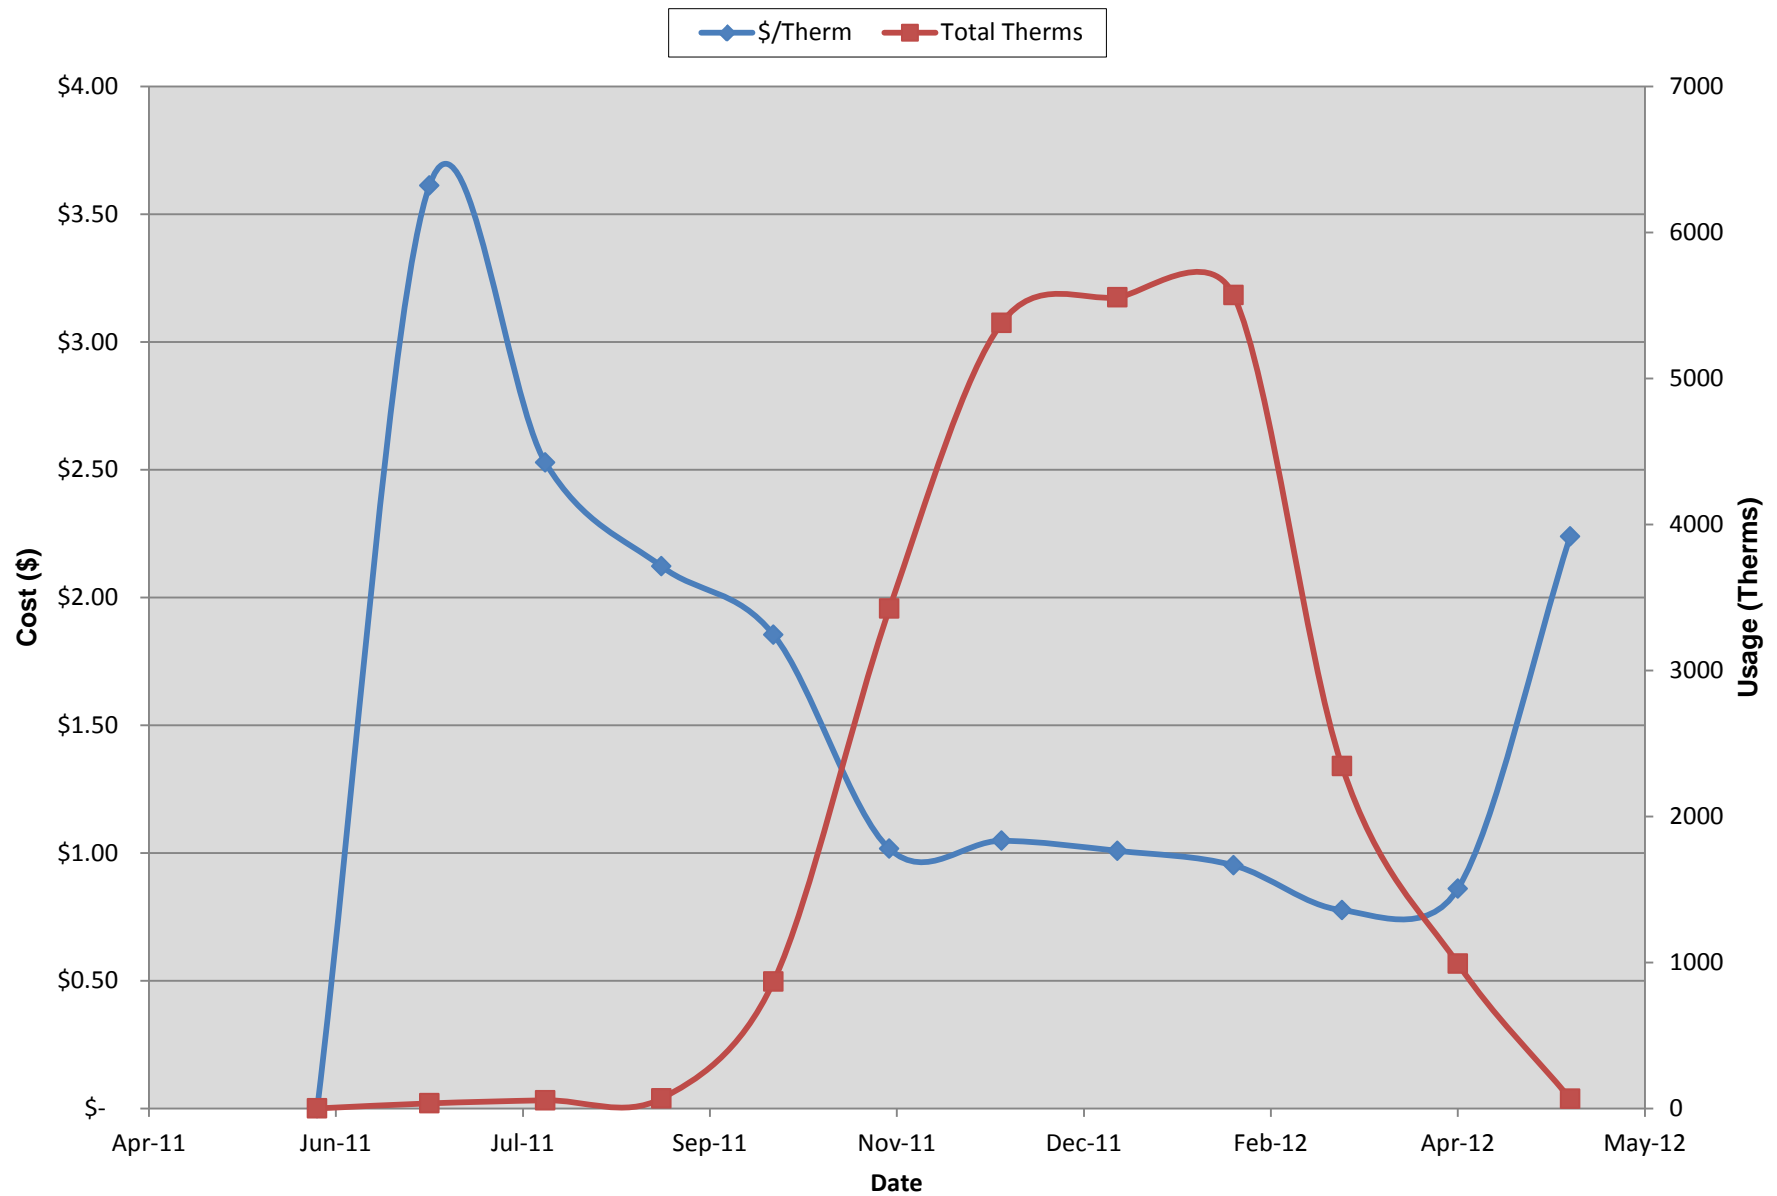

Franklin Lakes BOE

490 Pulis Ave, Franklin Lakes, NJ 07417

Water Service

Delivery -

Supplier -


For Service at: Woodside Avenue School

Account No.:

Meter No.:

Month	Total (\$)	Total kGals	\$/kGal
Aug-10			#DIV/0!
Sep-10			#DIV/0!
Oct-10			#DIV/0!
Nov-10			#DIV/0!
Dec-10			#DIV/0!
Jan-11			#DIV/0!
Feb-11			#DIV/0!
Mar-11			#DIV/0!
Apr-11			#DIV/0!
May-11			#DIV/0!
Jun-11			#DIV/0!
Jul-11			#DIV/0!
Aug-11			#DIV/0!
Sep-11			#DIV/0!
Oct-11			#DIV/0!
Nov-11			#DIV/0!
Dec-11			#DIV/0!
Jan-12			#DIV/0!
Feb-12			#DIV/0!
Mar-12			#DIV/0!
Apr-12			#DIV/0!
May-12			#DIV/0!
Jun-12			#DIV/0!
Jul-12			#DIV/0!
Total	\$ -	0.00	#DIV/0!

Water Usage - Woodside Avenue School

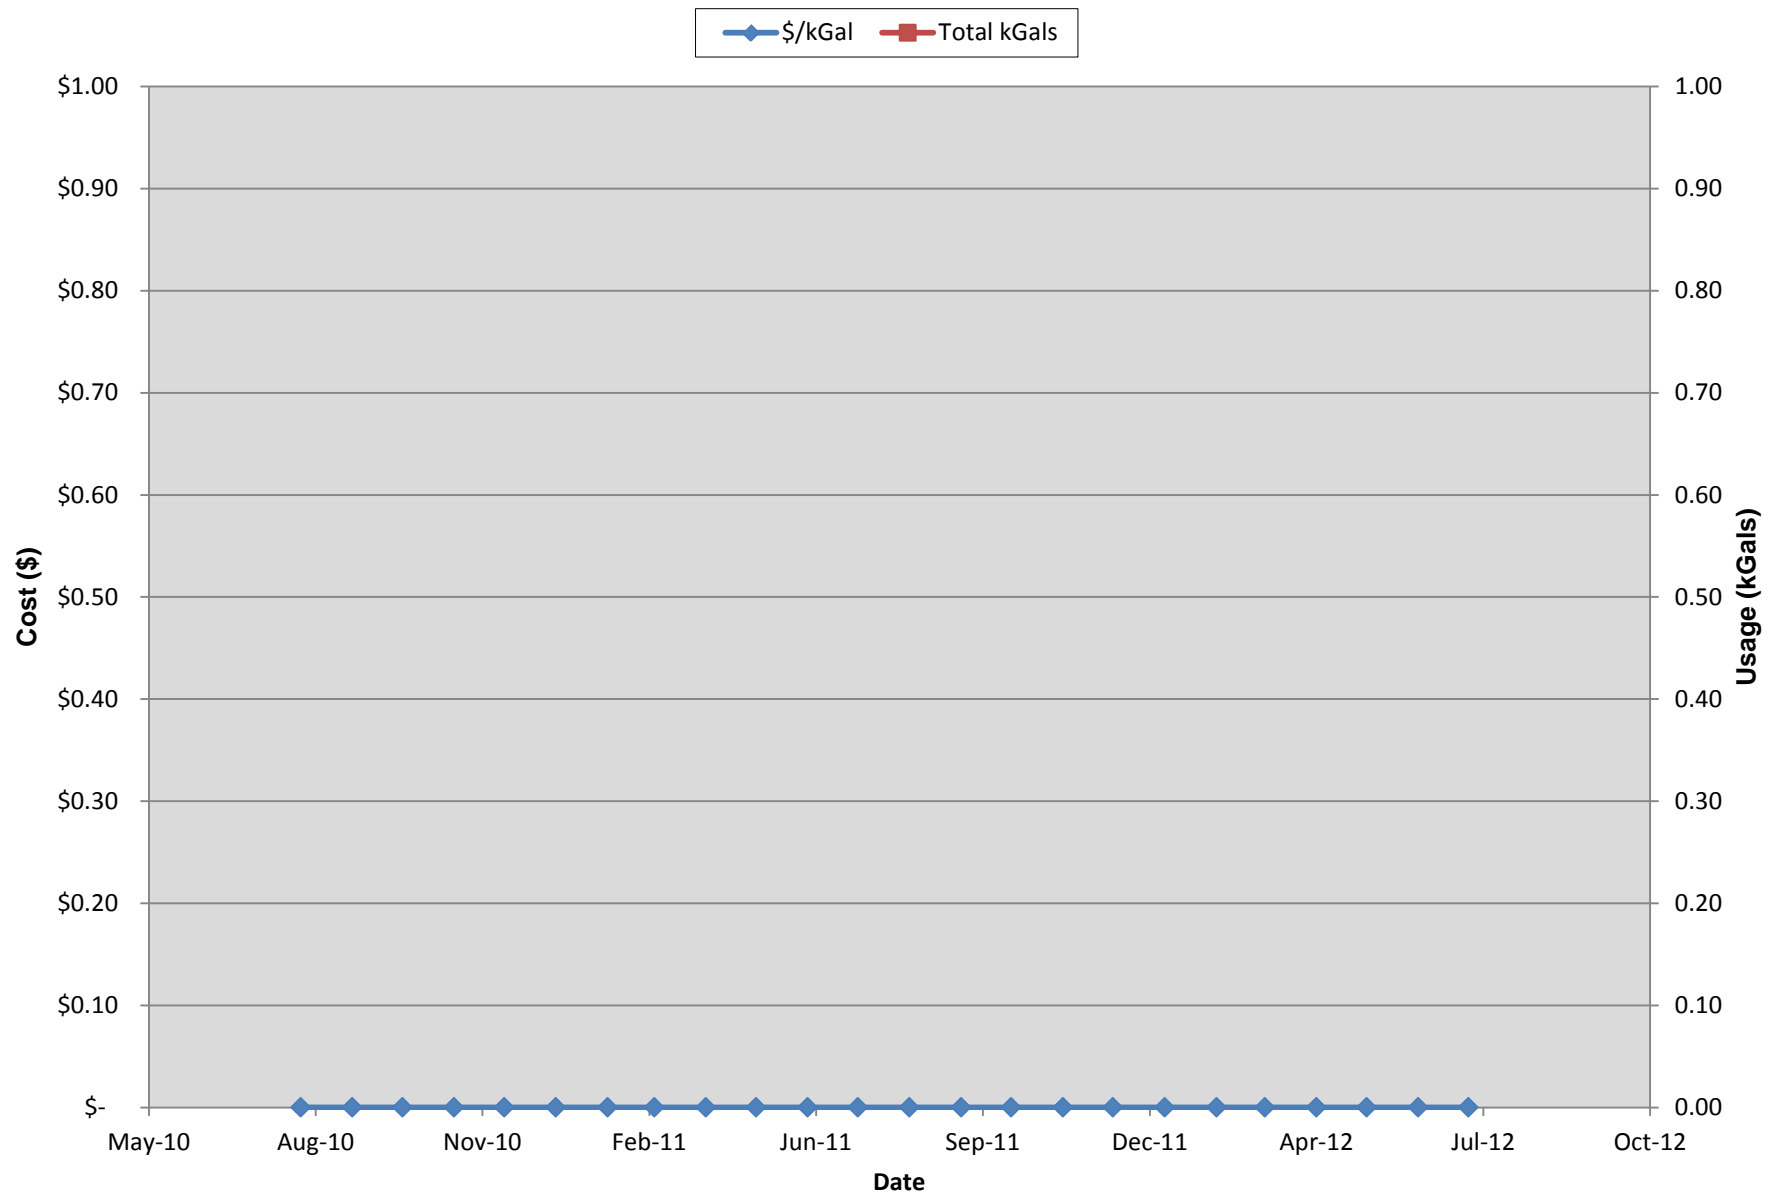

PSE&G ELECTRIC SERVICE TERRITORY

Last Updated: 10/24/12

***CUSTOMER CLASS - R – RESIDENTIAL C – COMMERCIAL I –INDUSTRIAL**

Supplier	Telephone & Web Site	*Customer Class
AEP Energy, Inc. 309 Fellowship Road, Fl. 2 Mount Laurel, NJ 08054	(866) 258-3782 www.aepenergy.com	C/I ACTIVE
Alpha Gas and Electric, LLC 641 5th Street Lakewood, NJ 08701	(855) 553-6374 www.alphagasandelectric.com	R/C ACTIVE
Ambit Northeast, LLC 103 Carnegie Center Suite 300 Princeton, NJ 08540	(877)-30-AMBIT (877) 302-6248 www.ambitenergy.com	R/C ACTIVE
American Powernet Management, LP 437 North Grove St. Berlin, NJ 08009	(877) 977-2636 www.americanpowernet.com	C ACTIVE
Amerigreen Energy, Inc. 1463 Lambertson Road Trenton, NJ 08611	888-423-8357 www.amerigreen.com	R/C ACTIVE
AP Gas & Electric, LLC 10 North Park Place, Suite 420 Morristown, NJ 07960	(855) 544-4895 www.apge.com	R/C/I ACTIVE
Astral Energy LLC 16 Tyson Place Bergenfield, NJ 07621	(201) 384-5552 www.astralenergyllc.com	R/C/I ACTIVE
Barclays Capital Services, Inc. 70 Hudson Street Jersey City, NJ 07302-4585	(888) 978-9974 www.group.barclays.com	C ACTIVE
BBPC, LLC d/b/a Great Eastern Energy 116 Village Blvd. Suite 200 Princeton, NJ 08540	(888) 651-4121 www.greateasternenergy.com	C/I ACTIVE
Champion Energy Services, LLC 72 Avenue L Newark, NJ 07105	(877) 653-5090 www.championenergyservices.com	R/C/I ACTIVE
Choice Energy, LLC 4257 US Highway 9, Suite 6C Freehold, NJ 07728	888-565-4490 www.4choiceenergy.com	R/C ACTIVE
Clearview Electric, Inc. 505 Park Drive Woodbury, NJ 08096	(888) CLR-VIEW (800) 746-4702 www.clearviewenergy.com	R/C/I ACTIVE
Commerce Energy, Inc. 7 Cedar Terrace Ramsey, NJ 07446	1-866-587-8674 www.commerceenergy.com	R ACTIVE
ConEdison Solutions Cherry Tree Corporate Center 535 State Highway Suite 180 Cherry Hill, NJ 08002	(888) 665-0955 www.conedsolutions.com	C/I ACTIVE
Constellation NewEnergy, Inc. 900A Lake Street, Suite 2 Ramsey, NJ 07446	(866) 237-7693 www.constellation.com	R/C/I ACTIVE

Constellation Energy 900A Lake Street, Suite 2 Ramsey, NJ 07446	(877) 997-9995 www.constellation.com	R ACTIVE
Credit Suisse, (USA) Inc. 700 College Road East Princeton, NJ 08450	(212) 538-3124 www.creditsuisse.com	C ACTIVE
Direct Energy Business, LLC 120 Wood Avenue, Suite 611 Iselin, NJ 08830	(888) 925-9115 www.directenergybusiness.com	C/I ACTIVE
Direct Energy Services, LLC 120 Wood Avenue, Suite 611 Iselin, NJ 08830	(866) 348-4193 www.directenergy.com	R ACTIVE
Discount Energy Group, LLC 811 Church Road, Suite 149 Cherry Hill, New Jersey 08002	(800) 282-3331 www.discountenergygroup.com	R/C ACTIVE
Dominion Retail, Inc. d/b/a Dominion Energy Solutions 395 Route #70 West Suite 125 Lakewood, NJ 08701	(866) 275-4240 www.dom.com/products	R/C ACTIVE
DTE Energy Supply, Inc. One Gateway Center, Suite 2600 Newark, NJ 07102	(877) 332-2450 www.dtesupply.com	C/I ACTIVE
Energy.me Midwest LLC 90 Washington Blvd Bedminster, NJ 07921	(855) 243-7270 www.energy.me	R/C/I ACTIVE
Energy Plus Holdings LLC 309 Fellowship Road East Gate Center, Suite 200 Mt. Laurel, NJ 08054	(877) 866-9193 www.energypluscompany.com	R/C ACTIVE
Ethical Electric Benefit Co. d/b/a Ethical Electric 100 Overlook Center, 2nd Fl. Princeton, NJ 08540	(888) 444-9452 www.ethicalelectric.com	R/C ACTIVE
FirstEnergy Solutions 300 Madison Avenue Morristown, NJ 07962	(800) 977-0500 www.fes.com	C/I ACTIVE
Gateway Energy Services Corp. 44 Whispering Pines Lane Lakewood, NJ 08701	(800) 805-8586 www.gesc.com	R/C/I ACTIVE
GDF SUEZ Energy Resources NA, Inc. 333 Thornall Street Sixth Floor Edison, NJ 08837	(866) 999-8374 www.gdfsuezenergyresources.com	C/I ACTIVE
Glacial Energy of New Jersey, Inc. 75 Route 15 Building E Lafayette, NJ 07848	(888) 452-2425 www.glacialenergy.com	C/I ACTIVE
Global Energy Marketing LLC 129 Wentz Avenue Springfield, NJ 07081	(800) 542-0778 www.globalp.com	C/I ACTIVE

Green Mountain Energy Company 211 Carnegie Center Drive Princeton, NJ 08540	(866) 767-5818 www.greenmountain.com/commercial-home	C/I ACTIVE
Hess Corporation 1 Hess Plaza Woodbridge, NJ 07095	(800) 437-7872 www.hess.com	C/I ACTIVE
HIKO Energy, LLC 655 Suffern Road Teaneck, NJ 07666	(888) 264-4908 www.hikoenergy.com	R/C ACTIVE
HOP Energy, LLC d/b/a Metro Energy, HOP Fleet Fueling, HOP Energy Fleet Fueling 1011 Hudson Avenue Ridgefield, NJ 07657	(877) 390-7155 www.hopenegy.com	R/C/I ACTIVE
Hudson Energy Services, LLC 7 Cedar Street Ramsey, New Jersey 07446	(877) Hudson 9 www.hudsonenergyservices.com	C ACTIVE
IDT Energy, Inc. 550 Broad Street Newark, NJ 07102	(877) 887-6866 www.idtenergy.com	R/C ACTIVE
Independence Energy Group, LLC 3711 Market Street, 10th Fl. Philadelphia, PA 19104	(877) 235-6708 www.chooseindependence.com	R/C ACTIVE
Integrus Energy Services, Inc. 99 Wood Ave, South, Suite 802 Iselin, NJ 08830	(877) 763-9977 www.integrusenergy.com	C/I ACTIVE
Keil & Sons, Inc. d/b/a Systrum Energy 1 Bergen Blvd. Fairview, NJ 07022	(877) 797-8786 www.systrumenergy.com	R/C/I ACTIVE
Liberty Power Delaware, LLC 1973 Highway 34, Suite 211 Wall, NJ 07719	(866) 769-3799 www.libertypowercorp.com	C/I ACTIVE
Liberty Power Holdings, LLC 1973 Highway 34, Suite 211 Wall, NJ 07719	(866) 769-3799 www.libertypowercorp.com	C/I ACTIVE
Linde Energy Services 575 Mountain Avenue Murray Hill, NJ 07974	(800) 247-2644 www.linde.com	C/I ACTIVE
Marathon Power LLC 302 Main Street Paterson, NJ 07505	(888) 779-7255 www.mecny.com	R/C/I ACTIVE
MXenergy Electric Inc. 900 Lake Street Ramsey, NJ 07446	(800) 785-4374 www.mxenergy.com	R/C/I ACTIVE
NATGASCO, Inc. 532 Freeman St. Orange, NJ 07050	(973) 678-1800 x. 251 www.supremeenergyinc.com	R/C ACTIVE
NextEra Energy Services New Jersey, LLC 651 Jernee Mill Road Sayreville, NJ 08872	(877) 528-2890 Commercial (800) 882-1276 Residential www.nexteraenergyservices.com	R/C/I ACTIVE
New Jersey Gas & Electric 1 Bridge Plaza fl. 2 Fort Lee, NJ 07024	(866) 568-0290 www.NJGandE.com	R/C ACTIVE

Noble Americas Energy Solutions The Mac-Cali Building 581 Main Street, 8th Floor Woodbridge, NJ 07095	(877) 273-6772 www.noblesolutions.com	C/I ACTIVE
North American Power and Gas, LLC 222 Ridgedale Avenue Cedar Knolls, NJ 07927	(888) 313-9086 www.napower.com	R/C/I ACTIVE
Palmco Power NJ, LLC One Greentree Centre 10,000 Lincoln Drive East, Suite 201 Marlton, NJ 08053	(877) 726-5862 www.PalmcoEnergy.com	R/C/I ACTIVE
Pepco Energy Services, Inc. 112 Main St. Lebanon, NJ 08833	(800) ENERGY-9 (363-7499) www.pepco-services.com	C/I ACTIVE
Plymouth Rock Energy, LLC 338 Maitland Avenue Teaneck, NJ 07666	(855) 32-POWER (76937) www.plymouthenergy.com	R/C/I ACTIVE
PPL Energy Plus, LLC 811 Church Road Cherry Hill, NJ 08002	(800) 281-2000 www.pplenenergyplus.com	C/I ACTIVE
Public Power & Utility of New Jersey, LLC 39 Old Ridgebury Rd. Suite 14 Danbury, CT 06810	(888) 354-4415 www.ppandu.com	R/C/I ACTIVE
Reliant Energy 211 Carnegie Center Princeton, NJ 08540	(877) 297-3795 (877) 297-3780 www.reliant.com/pjm	R/C/I ACTIVE
ResCom Energy LLC 18C Wave Crest Ave. Winfield Park, NJ 07036	(888) 238-4041 http://rescomenergy.com	R/C/I ACTIVE
Respond Power LLC 10 Regency CT Lakewood, NJ 08701	(877) 973-7763 www.respondpower.com	R/C/I ACTIVE
South Jersey Energy Company 1 South Jersey Plaza, Route 54 Folsom, NJ 08037	(800) 266-6020 www.southjerseyenergy.com	C/I ACTIVE
Sperian Energy Corp. 1200 Route 22 East, Suite 2000 Bridgewater, NJ 08807	(888) 682-8082	R/C/I ACTIVE
S.J. Energy Partners, Inc. 208 White Horse Pike, Suite 4 Barrington, N.J. 08007	(800) 695-0666 www.sjnaturalgas.com	R/C ACTIVE
Spark Energy, L.P. 2105 CityWest Blvd., Ste 100 Houston, Texas 77042	(800) 441-7514 www.sparkenergy.com	R/C/I ACTIVE
Sprague Energy Corp. 12 Ridge Road Chatham Township, NJ 07928	(800) 225-1560 www.spragueenergy.com	C/I ACTIVE
Starion Energy PA Inc. 101 Warburton Avenue Hawthorne, NJ 07506	(800) 600-3040 www.starionenergy.com	R/C/I ACTIVE
Stream Energy 309 Fellowship Rd., Suite 200 Mt. Laurel, NJ 08054	(877) 39-8150 www.streamenergy.net	R ACTIVE

UGI Energy Services, Inc. d/b/a GASMARK 224 Strawbridge Drive Suite 107 Moorestown, NJ 08057	(856) 273-9995 www.ugienergyservices.com	C/I ACTIVE
Verde Energy USA, Inc. 50 East Palisades Avenue Englewood, NJ 07631	(800) 388-3862 www.lowcostpower.com	R/C/I ACTIVE
Viridian Energy 2001 Route 46, Waterview Plaza Suite 310 Parsippany, NJ 07054	(866) 663-2508 www.viridian.com	R/C/I ACTIVE
Xoom Energy New Jersey, LLC 744 Broad Street Newark, NJ 07102	(888) 997-8979 www.xoomenergy.com	R/C/I ACTIVE
YEP Energy 89 Headquarters Plaza North #1463 Morristown, NJ 07960	(855) 363-7736 www.yepenergyNJ.com	R/C/I ACTIVE
Your Energy Holdings, LLC One International Boulevard Suite 400 Mahwah, NJ 07495-0400	(855) 732-2493 www.thisisyourenergy.com	R/C/I ACTIVE

[Back to the main supplier page](#)

PSE&G GAS SERVICE TERRITORY

Last Updated: 10/24/12

***CUSTOMER CLASS - R – RESIDENTIAL C – COMMERCIAL I - INDUSTRIAL**

Supplier	Telephone & Web Site	*Customer Class
Ambit Northeast, LLC 103 Carnegie Center Suite 300 Princeton, NJ 08540	(877)-30-AMBIT (877) 302-6248 www.ambitenergy.com	R/C ACTIVE
Astral Energy LLC 16 Tyson Place Bergenfield, NJ 07621	888-850-1872 www.astralenergyllc.com	R/C/I ACTIVE
BBPC, LLC Great Eastern Energy 116 Village Blvd. Suite 200 Princeton, NJ 08540	888-651-4121 www.greateasternenergy.com	C/I ACTIVE
Clearview Electric Inc. d/b/a Clearview Gas 1744 Lexington Ave. Pennsauken, NJ 08110	800-746-4720 www.clearviewenergy.com	R/C ACTIVE
Colonial Energy, Inc. 83 Harding Road Wyckoff, NJ 07481	845-429-3229 www.colonialgroupinc.com	C/I ACTIVE
Commerce Energy, Inc. 7 Cedar Terrace Ramsey, NJ 07746	(888) 817-8572 www.commerceenergy.com	R ACTIVE
Compass Energy Services, Inc. 1085 Morris Avenue, Suite 150 Union, NJ 07083	866-867-8328 908-638-6605 www.compassenergy.net	C/I ACTIVE
ConocoPhillips Company 224 Strawbridge Drive, Suite 107 Moorestown, NJ 08057	800-646-4427 www.conocophillips.com	C/I ACTIVE
Consolidated Edison Energy, Inc. d/b/a Con Edison Solutions 535 State Highway 38, Suite 140 Cherry Hill, NJ 08002	888-686-1383 x2130 www.conedenergy.com	
Consolidated Edison Solutions, Inc. Cherry Tree Corporate Center 535 State Highway 38, Suite 140 Cherry Hill, NJ 08002	888-665-0955 www.conedsolutions.com	C/I ACTIVE
Constellation NewEnergy-Gas Division, LLC 900A Lake Street, Suite 2 Ramsey, NJ 07466	(800) 900-1982 www.constellation.com	C/I ACTIVE
Direct Energy Business, LLC 120 Wood Avenue, Suite 611 Iselin, NJ 08830	888-925-9115 www.directenergy.com	C/I ACTIVE
Direct Energy Services, LLP 120 Wood Avenue, Suite 611 Iselin, NJ 08830	866-348-4193 www.directenergy.com	R ACTIVE
Gateway Energy Services Corp. 44 Whispering Pines Lane Lakewood, NJ 08701	800-805-8586 www.gesc.com	R/C/I ACTIVE
UGI Energy Services, Inc. d/b/a GASMARK 224 Strawbridge Drive, Suite 107 Moorestown, NJ 08057	856-273-9995 www.ugienergyservices.com	C/I ACTIVE
Global Energy Marketing, LLC 129 Wentz Avenue Springfield, NJ 07081	800-542-0778 www.globalp.com	C/I ACTIVE
Great Eastern Energy 116 Village Blvd., Suite 200 Princeton, NJ 08540	888-651-4121 www.greateastern.com	C/I ACTIVE

Greenlight Energy 330 Hudson Street, Suite 4 Hoboken, NJ 07030	718-204-7467 www.greenlightenergy.us	C ACTIVE
Hess Energy, Inc. One Hess Plaza Woodbridge, NJ 07095	800-437-7872 www.hess.com	C/I ACTIVE
Hess Small Business Services, LLC One Hess Plaza Woodbridge, NJ 07095	888-494-4377 www.hessenergy.com	C/I ACTIVE
HIKO Energy, LLC 655 Suffern Road Teaneck, NJ 07666	(888) 264-4908 www.hikoenergy.com	R/C ACTIVE
Hudson Energy Services, LLC 7 Cedar Street Ramsey, NJ 07446	877- Hudson 9 www.hudsonenergyservices.com	C ACTIVE
IDT Energy, Inc. 550 Broad Street Newark, NJ 07102	877-887-6866 www.idtenergy.com	R/C ACTIVE
Integrus Energy Services – Natural Gas, LLC 99 Wood Avenue South Suite #802 Iselin, NJ 08830	800-536-0151 www.integrusenergy.com	C/I ACTIVE
Intelligent Energy 2050 Center Avenue, Suite 500 Fort Lee, NJ 07024	800-927-9794 www.intelligentenergy.org	R/C/I ACTIVE
Keil & Sons, Inc. d/b/a Systrum Energy 1 Bergen Blvd. Fairview, NJ 07022	1-877-797-8786 www.systrumenergy.com	R/C/I ACTIVE
Major Energy Services, LLC 10 Regency CT Lakewood, NJ 08701	888-625-6760 www.majorenergy.com	R/C/I ACTIVE
Marathon Power LLC 302 Main Street Paterson, NJ 07505	888-779-7255 www.mecny.com	R/C/I ACTIVE
Metromedia Energy, Inc. 6 Industrial Way Eatontown, NJ 07724	800-828-9427 www.metromediaenergy.com	C ACTIVE
Metro Energy Group, LLC 14 Washington Place Hackensack, NJ 07601	888-53-Metro www.metroenergy.com	R/C ACTIVE
MxEnergy, Inc. 900 Lake Street Ramsey, NJ 07446	800-758-4374 www.mxenergy.com	R/C/I ACTIVE
NATGASCO (Mitchell Supreme) 532 Freeman Street Orange, NJ 07050	800-840-4GAS www.natgasco.com	C ACTIVE
New Energy Services LLC 101 Neptune Avenue Deal, New Jersey 07723	800-660-3643 www.newenergyservicesllc.com	R/C/I ACTIVE
New Jersey Gas & Electric 1 Bridge Plaza, Fl. 2 Fort Lee, NJ 07024	866-568-0290 www.NJGandE.com	R/C ACTIVE
Noble Americas Energy Solutions The Mac-Cali Building 581 Main Street, 8th fl. Woodbridge, NJ 07095	877-273-6772 www.noblesolutions.com	C/I ACTIVE
North American Power & Gas, LLC d/b/a North American Power 197 Route 18 South Ste. 3000 East Brunswick, NJ 08816	(888) 313-9086 www.napower.com	R/C/I ACTIVE

Palmco Energy NJ, LLC One Greentree Centre 10,000 Lincoln Drive East, Suite 201 Marlton, NJ 08053	877-726-5862 www.PalmcoEnergy.com	R/C/I ACTIVE
Pepco Energy Services, Inc. 112 Main Street Lebanon, NJ 08833	800-363-7499 www.pepco-services.com	C/I ACTIVE
Plymouth Rock Energy, LLC 338 Maitland Avenue Teaneck, NJ 07666	855-32-POWER (76937) www.plymouthenergy.com	R/C/I ACTIVE
PPL EnergyPlus, LLC 811 Church Road - Office 105 Cherry Hill, NJ 08002	800-281-2000 www.pplenergyplus.com	C/I ACTIVE
Respond Power LLC 10 Regency CT Lakewood, NJ 08701	(877) 973-7763 www.respondpower.com	R/C/I ACTIVE
South Jersey Energy Company 1 South Jersey Plaza, Route 54 Folsom, NJ 08037	800-266-6020 www.southjerseyenergy.com	C/I ACTIVE
S.J. Energy Partners, Inc. 208 White Horse Pike, Suite 4 Barrington, NJ 08007	800-695-0666 www.sjnaturalgas.com	R/C ACTIVE
Spark Energy Gas, L.P. 2105 CityWest Blvd, Ste 100 Houston, Texas 77042	800-411-7514 www.sparkenergy.com	R/C/I ACTIVE
Sprague Energy Corp. 12 Ridge Road Chatham Township, NJ 07928	855-466-2842 www.spragueenergy.com	C/I ACTIVE
Stuyvesant Energy LLC 10 West Ivy Lane, Suite 4 Englewood, NJ 07631	800-640-6457 www.stuyfuel.com	C ACTIVE
Stream Energy New Jersey, LLC 309 Fellowship Road Suite 200 Mt. Laurel, NJ 08054	(973) 494-8097 www.streamenergy.net	R/C ACTIVE
Systrum Energy 1 Bergen Blvd. Fairview, NJ 07022	877-797-8786 www.systrumenergy.com	R/C/I ACTIVE
Woodruff Energy 73 Water Street Bridgeton, NJ 08302	800-557-1121 www.woodruffenergy.com	R/C/I ACTIVE
Woodruff Energy US LLC 73 Water Street, P.O. Box 777 Bridgeton, NJ 08302	856-455-1111 800-557-1121 www.woodruffenergy.com	C/I ACTIVE
Xoom Energy New Jersey, LLC 744 Broad Street Newark, NJ 07102	888-997-8979 www.xoomenergy.com	R/C/I ACTIVE
Your Energy Holdings, LLC One International Boulevard Suite 400 Mahwah, NJ 07495-0400	(855) 732-2493 www.thisisyouenergy.com	R/C/I ACTIVE

[Back to main supplier information page](#)

APPENDIX B

Equipment Inventory

Franklin Lakes Public Schools - NJBPU
CHA Project #24497
High Mountain Road Elementary School

Description	QTY	Manufacturer Name	Model No.	Serial No.	Equipment Type / Utility	Capacity/Size /Efficiency	Location	Areas/Equipment Served	Date Installed	Remaining Useful Life (years)	Other Info.
B-1, B-2, B-3	3	AERCO	Benchmark 1.5N	#1:G-10-1102, #2:G-10-1103, #3:G-10-1104	Heating / Natural Gas	Input: 1,500,000 BTU, Output: 1,290,000 BTU, 90% efficiency	Mech Room	School	2010	22	Good Condition
DWH	1	Bradford White	D80T2503NA	XA3202182	Heating / Natural Gas	Input: 250,000, 80 gallons, 80%	Mech Room	School	2000	-	Good Condition
P-1, P-2	2	B&G	1510	#1:C111390-01G01, #2:C111390-02G01	Heating / Electric	1800 RPM, 7.5 HP, 400gpm, standard	Mech Room	School	1995	-	Good Condition
CH-1	1	McQuay	WHR045E-A	55L8135100	Heating / Electric DX	Reciprocating; 45 ton	Mech Room	Office Unit	1995	7	Good Condition
CU	1	McQuay	APD 060C	95J0120606	Heating / Electric DX	Remote Condenser	Roof	CH-1	1995	7	Good Condition
AC-1	1	Quincy	QT53CCDT00252	20080111-0106	HVAC / Compressed Air	-	Mech Room	School (controls)	1995	3	Good Condition
CU-1, CU-2	1	Trane	2TTA2060A3000AA	#1:32245H03F, #2:32245M53F	HVAC / Electric DX	-	Roof	Library	2003	11	Good Condition
CU-2	1	AG	024GB1AG	L955021441	HVAC / Electric DX	2-ton	Ground	-	2003	1	Good Condition
HV-1	1	Nesbitt	HW24-4	LPH100H	HVAC / Electric DX		Attic	Gym	1995	3	Good Condition
AHU-W-3	1	Trane	LPCAC08D1C0H6C R	T03F41410	HVAC / Electric DX	-	Closet	Cafeteria / Music	2002		Good Condition
UVCUW-5		Arcoaire	NAC042AKA5	E032822102	HVAC / Electric DX	-	Ground				Good Condition
UVCUW-4		Arcoaire	NAC042AKB2	E033250627	HVAC / Electric DX	-	Ground				Good Condition
AHCU-W-3		Trane	TTA120A300EA	23124Y7AD	HVAC / Electric DX	-	Ground	AHU-W-3	2002		Good Condition
UVCU-W-3		Arcoaire	NAC042AKB2	E033230998	HVAC / Electric DX	-	Ground				Good Condition

Energy Audit of Woodside Avenue Elementary School

CHA Project No.24497

Existing Lighting

Cost of Electricity:

\$0.125 \$/kWh

\$6.07 \$/kW

EXISTING CONDITIONS												
	Area Description	Usage	No. of Fixtures	Standard Fixture Code	NYSERDA Fixture Code	Watts per Fixture	kW/Space	Exist Control	Annual Hours	Retrofit Control	Annual kWh	
Field Code	Unique description of the location - Room number/Room name: Floor number (if applicable)	Describe Usage Type using Operating Hours	No. of fixtures before the retrofit	"Lighting Fixture Code" Example 2T 40 R F(U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	Pre-inst. control device	Estimated annual hours for the usage group	Retrofit control device	(kW/space) * (Annual Hours)	Notes
13	Boiler Room	Mechanical Room	13	S 32 P F 2 (ELE)	F42LL	60	0.78	SW	1000	SW	780	1
13	Custodian	Storage/Janitor	4	S 32 P F 2 (ELE)	F42LL	60	0.24	SW	500	C-OCC	120	2
71	Attic	Storage/Janitor	6	I 60	I60/1	60	0.36	SW	500	SW	180	3
55	Vest	Hallways	1	2T 17 R F 3 (ELE)	F23ILL	47	0.05	SW	2280	C-OCC	107	4
55	Corridor	Hallways	5	2T 17 R F 3 (ELE)	F23ILL	47	0.24	SW	2280	C-OCC	536	5
254	Vest	Hallways	1	T 32 R F 4 (ELE)	F44LL	118	0.12	SW	2280	C-OCC	269	6
254	Main Lobby	Hallways	3	T 32 R F 4 (ELE)	F44LL	118	0.35	C-OCC	2280	C-OCC	807	7
201	Library	Classrooms	52	T 32 R F 3 (ELE)	F43ILL/2	90	4.68	C-OCC	2400	C-OCC	11,232	8
13	13	Classrooms	4	S 32 P F 2 (ELE)	F42LL	60	0.24	C-OCC	2400	C-OCC	576	9
13	12	Classrooms	4	S 32 P F 2 (ELE)	F42LL	60	0.24	SW	2400	C-OCC	576	10
13	Main Office	Offices	8	S 32 P F 2 (ELE)	F42LL	60	0.48	C-OCC	2400	C-OCC	1,152	11
199	Main Office Kitchen	Offices	1	W 32 C F 1 (ELE)	F41LL	32	0.03	SW	2400	C-OCC	77	12
13	Principal	Offices	8	S 32 P F 2 (ELE)	F42LL	60	0.48	C-OCC	2400	C-OCC	1,152	13
71	Principal TR	Offices	3	I 60	I60/1	60	0.18	SW	2400	C-OCC	432	14
71	Principal Storage	Offices	1	I 60	I60/1	60	0.06	SW	2400	C-OCC	144	15
13	Main Office Vest	Offices	5	S 32 P F 2 (ELE)	F42LL	60	0.30	C-OCC	2400	C-OCC	720	16
55	Nurse Vest	Offices	1	2T 17 R F 3 (ELE)	F23ILL	47	0.05	C-OCC	2400	C-OCC	113	17
13	Nurse	Offices	6	S 32 P F 2 (ELE)	F42LL	60	0.36	C-OCC	2400	C-OCC	864	18
55	Nurse TR	Bath Room	1	2T 17 R F 3 (ELE)	F23ILL	47	0.05	SW	2000	C-OCC	94	19
71	Nurse Storage	Storage Areas	1	I 60	I60/1	60	0.06	SW	1000	C-OCC	60	20
55	Corridor	Hallways	7	2T 17 R F 3 (ELE)	F23ILL	47	0.33	C-OCC	2280	C-OCC	750	21
13	6	Classrooms	8	S 32 P F 2 (ELE)	F42LL	60	0.48	C-OCC	2400	C-OCC	1,152	22
13	5 Child Study Team Office	Offices	9	S 32 P F 2 (ELE)	F42LL	60	0.54	C-OCC	2400	C-OCC	1,296	23
13	3 Classroom	Classrooms	9	S 32 P F 2 (ELE)	F42LL	60	0.54	C-OCC	2400	C-OCC	1,296	24
13	4	Classrooms	9	S 32 P F 2 (ELE)	F42LL	60	0.54	C-OCC	2400	C-OCC	1,296	25
13	1	Classrooms	9	S 32 P F 2 (ELE)	F42LL	60	0.54	C-OCC	2400	C-OCC	1,296	26
13	2	Classrooms	9	S 32 P F 2 (ELE)	F42LL	60	0.54	C-OCC	2400	C-OCC	1,296	27
9	Gym	Gynasium	9	High Bay MH 400 35 Feet High	MH400/1	458	4.12	SW	2000	SW	8,244	28
249	49 Gym Office	Offices	2	F 48 R F 2 (ELE)	F41GL	32	0.06	SW	2400	C-OCC	154	29
249	Gym Storage	Storage Areas	2	F 48 R F 2 (ELE)	F41GL	32	0.06	C-OCC	1000	C-OCC	64	30
13	Gym Storage	Storage Areas	9	S 32 P F 2 (ELE)	F42LL	60	0.54	SW	1000	C-OCC	540	31
13	Boys TR	Bath Room	1	S 32 P F 2 (ELE)	F42LL	60	0.06	SW	2000	C-OCC	120	32
55	Corridor	Hallways	8	2T 17 R F 3 (ELE)	F23ILL	47	0.38	SW	2280	C-OCC	857	33
13	Gym Storage	Storage Areas	9	S 32 P F 2 (ELE)	F42LL	60	0.54	SW	1000	C-OCC	540	34
55	Women's TR	Bath Room	1	2T 17 R F 3 (ELE)	F23ILL	47	0.05	SW	2000	C-OCC	94	35
258	Corridor	Hallways	5	CFQ13W	CFQ13/2-L	28	0.14	SW	2280	C-OCC	319	36
55	Corridor	Bath Room	16	2T 17 R F 3 (ELE)	F23ILL	47	0.75	SW	2000	C-OCC	1,504	37
13	32 Classroom	Classrooms	4	S 32 P F 2 (ELE)	F42LL	60	0.24	SW	2400	C-OCC	576	38
254	31 Classroom	Classrooms	11	T 32 R F 4 (ELE)	F44LL	118	1.30	C-OCC	2400	C-OCC	3,115	39
13	33 Custodian	Classrooms	2	S 32 P F 2 (ELE)	F42LL	60	0.12	C-OCC	2400	C-OCC	288	40
249	34 Classroom	Classrooms	9	F 48 R F 2 (ELE)	F41GL	32	0.29	C-OCC	2400	C-OCC	691	41
249	35 Classroom	Classrooms	9	F 48 R F 2 (ELE)	F41GL	32	0.29	C-OCC	2400	C-OCC	691	42
249	36 Classroom	Classrooms	9	F 48 R F 2 (ELE)	F41GL	32	0.29	C-OCC	2400	C-OCC	691	43
249	37 Classroom	Classrooms	9	F 48 R F 2 (ELE)	F41GL	32	0.29	C-OCC	2400	C-OCC	691	44
249	38 Classroom	Classrooms	9	F 48 R F 2 (ELE)	F41GL	32	0.29	C-OCC	2400	C-OCC	691	45
249	39 Classroom	Classrooms	9	F 48 R F 2 (ELE)	F41GL	32	0.29	C-OCC	2400	C-OCC	691	46
249	40 Classroom	Classrooms	9	F 48 R F 2 (ELE)	F41GL	32	0.29	C-OCC	2400	C-OCC	691	47
249	41 Classroom	Classrooms	9	F 48 R F 2 (ELE)	F41GL	32	0.29	C-OCC	2400	C-OCC	691	48
201	Storage	Storage Areas	1	T 32 R F 3 (ELE)	F43ILL/2	90	0.09	SW	1000	C-OCC	90	49
201	Instrumental Music Room	Classrooms	10	T 32 R F 3 (ELE)	F43ILL/2	90	0.90	SW	2400	C-OCC	2,160	50

Energy Audit of Woodside Avenue Elementary School

CHA Project No.24497

Existing Lighting

Cost of Electricity:

\$0.125 \$/kWh

\$6.07 \$/kW

EXISTING CONDITIONS												
	Area Description	Usage	No. of Fixtures	Standard Fixture Code	NYSERDA Fixture Code	Watts per Fixture	kW/Space	Exist Control	Annual Hours	Retrofit Control	Annual kWh	
Field Code	Unique description of the location - Room number/Room name: Floor number (if applicable)	Describe Usage Type using Operating Hours	No. of fixtures before the retrofit	"Lighting Fixture Code" Example 2T 40 R F(U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	Pre-inst. control device	Estimated annual hours for the usage group	Retrofit control device	(kW/space) * (Annual Hours)	Notes
201	5S Music	Classrooms	16	T 32 R F 3 (ELE)	F43ILL/2	90	1.44	SW	2400	C-OCC	3,456	51
201	Storage	Storage Areas	2	T 32 R F 3 (ELE)	F43ILL/2	90	0.18	SW	1000	C-OCC	180	52
55	Vest	Hallways	1	2T 17 R F 3 (ELE)	F23ILL	47	0.05	SW	2280	C-OCC	107	53
55	Corridor	Hallways	5	2T 17 R F 3 (ELE)	F23ILL	47	0.24	SW	2280	C-OCC	536	54
201	Cafeteria	Cafeteria	20	T 32 R F 3 (ELE)	F43ILL/2	90	1.80	SW	1600	SW	2,880	55
249	Women's TR	Bath Room	1	F 48 R F 2 (ELE)	F41GL	32	0.03	SW	2000	C-OCC	64	56
249	Men's TR	Bath Room	1	F 48 R F 2 (ELE)	F41GL	32	0.03	SW	2000	C-OCC	64	57
13	Jan Closet	Storage/Janitor	1	S 32 P F 2 (ELE)	F42LL	60	0.06	SW	500	C-OCC	30	58
55	Corridor	Hallways	12	2T 17 R F 3 (ELE)	F23ILL	47	0.56	SW	2280	C-OCC	1,286	59
71	30 Closet	Storage/Janitor	1	I 60	I60/1	60	0.06	SW	500	C-OCC	30	60
201	Men's TR	Bath Room	1	T 32 R F 3 (ELE)	F43ILL/2	90	0.09	SW	2000	C-OCC	180	61
201	Women's TR	Bath Room	1	T 32 R F 3 (ELE)	F43ILL/2	90	0.09	SW	2000	C-OCC	180	62
55	Boys TR	Bath Room	6	2T 17 R F 3 (ELE)	F23ILL	47	0.28	SW	2000	C-OCC	564	63
55	Girl's TR	Bath Room	6	2T 17 R F 3 (ELE)	F23ILL	47	0.28	SW	2000	C-OCC	564	64
55	Corridor	Hallways	5	2T 17 R F 3 (ELE)	F23ILL	47	0.24	C-OCC	2280	C-OCC	536	65
201	25 SGI	Classrooms	4	T 32 R F 3 (ELE)	F43ILL/2	90	0.36	C-OCC	2400	C-OCC	864	66
201	26 SGI	Classrooms	4	T 32 R F 3 (ELE)	F43ILL/2	90	0.36	C-OCC	2400	C-OCC	864	67
201	30 SGI	Classrooms	4	T 32 R F 3 (ELE)	F43ILL/2	90	0.36	SW	2400	C-OCC	864	68
201	Srorage Closet	Storage Areas	2	T 32 R F 3 (ELE)	F43ILL/2	90	0.18	C-OCC	1000	C-OCC	180	69
201	42 Science	Classrooms	15	T 32 R F 3 (ELE)	F43ILL/2	90	1.35	SW	2400	C-OCC	3,240	70
201	46 Classroom	Classrooms	32	T 32 R F 3 (ELE)	F43ILL/2	90	2.88	C-OCC	2400	C-OCC	6,912	71
201	Faculty Room	Break/Lunch Rooms	11	T 32 R F 3 (ELE)	F43ILL/2	90	0.99	C-OCC	3102.5	C-OCC	3,071	72
201	24 Classroom	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	SW	2400	C-OCC	1,944	73
13	Storage	Storage Areas	4	S 32 P F 2 (ELE)	F42LL	60	0.24	C-OCC	1000	C-OCC	240	74
201	15 O/PT	Offices	3	T 32 R F 3 (ELE)	F43ILL/2	90	0.27	SW	2400	C-OCC	648	75
71	Storage	Storage Areas	5	I 60	I60/1	60	0.30	C-OCC	1000	C-OCC	300	76
201	16 Classroom	Classrooms	1	T 32 R F 3 (ELE)	F43ILL/2	90	0.09	C-OCC	2400	C-OCC	216	77
201	17 Classroom	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	C-OCC	2400	C-OCC	1,944	78
201	18 Classroom	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	C-OCC	2400	C-OCC	1,944	79
201	19 Classroom	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	C-OCC	2400	C-OCC	1,944	80
201	20 Classroom	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	C-OCC	2400	C-OCC	1,944	81
201	21 Classroom	Classrooms	9	T 32 R F 3 (ELE)	F43ILL/2	90	0.81	C-OCC	2400	C-OCC	1,944	82
201	22 Classroom	Classrooms	20	T 32 R F 3 (ELE)	F43ILL/2	90	1.80	C-OCC	2400	C-OCC	4,320	83
13	22 Classroom	Classrooms	5	S 32 P F 2 (ELE)	F42LL	60	0.30	C-OCC	2400	C-OCC	720	84
55	Storage	Storage Areas	2	2T 17 R F 3 (ELE)	F23ILL	47	0.09	SW	1000	C-OCC	94	85
13	Resource Center	Offices	8	S 32 P F 2 (ELE)	F42LL	60	0.48	C-OCC	2400	C-OCC	1,152	86
201	23 Classroom	Classrooms	20	T 32 R F 3 (ELE)	F43ILL/2	90	1.80	C-OCC	2400	C-OCC	4,320	87
13	23 Classroom	Classrooms	5	S 32 P F 2 (ELE)	F42LL	60	0.30	C-OCC	2400	C-OCC	720	88
71	22 TR	Bath Room	1	I 60	I60/1	60	0.06	C-OCC	2000	C-OCC	120	89
71	23 TR	Bath Room	1	I 60	I60/1	60	0.06	C-OCC	2000	C-OCC	120	90
55	Corridor	Hallways	10	2T 17 R F 3 (ELE)	F23ILL	47	0.47	SW	2280	C-OCC	1,072	91
	Total		640				47.54				104,925	

APPENDIX C

ECM Calculations

Summary of Energy Conservation Measures							
Energy Conservation Measure		Approx. Costs (\$)	Approx. Savings (\$/year)	Payback (Years) w/o Incentive	Potential Incentive (\$)*	Payback (Years) w/ Incentive	Recommended For Implementation
ECM-1	Replace Gas-Fired DHW Heater	6,000	400	15	300	14	X
ECM-2	Install VSD & Premium Motors on HW Pumps	10,000	1,900	5	2,300	4	X
ECM-3	Upgrade Pneumatic Control to DDC System	20,000	5,500	4	0	4	X
ECM-4	Demand Controlled Ventilation (Gym & Cafeteria)	20,000	1,800	11	0	11	X
ECM-5	Window Replacements and Reduced Glazing	215,000	4,200	>20	0	>20	
ECM-6	Lighting Replacement / Upgrades	52,000	3,000	17	5,600	15	
ECM-7	Install Lighting Controls (Occupancy Sensors)	18,000	3,500	5	3,000	4	X
ECM-8	Lighting Replacements with Lighting Controls (Occupancy Sensors)	70,000	5,800	12	8,700	11	
ECM-9	Install Low Flow Plumbing Fixtures	5,000	400	13	0	13	X

Franklin Lakes Public Schools - NJBPU
CHA Project #24497
Woodside Avenue Elementary School

ECM Summary Sheet

ECM-1 Replace Gas-Fired DHW Heater

Budgetary Cost	Annual Utility Savings				Estimated Maintenance Savings	Total Savings	ROI	Incentive *	Payback (without incentive) Years	Payback (with incentive) Years
	Electric kWh	Electric kW	Nat Gas Therms	Total \$						
\$				\$	\$	\$		\$		
6,000	0	0	400	400	0	400	(0.1)	300	15.0	14.3

ECM-2 Install VSD & Premium Motors on HW Pumps

Budgetary Cost	Annual Utility Savings				Estimated Maintenance Savings	Total Savings	ROI	Incentive *	Payback (without incentive) Years	Payback (with incentive) Years
	Electric kWh	Electric kW	Nat Gas Therms	Total \$						
\$				\$	\$	\$		\$		
10,000	14,200	0	0	1,900	0	1,900	2.9	2,300	5.3	4.1

ECM-3 Upgrade Pneumatic Control to DDC System

Budgetary Cost	Annual Utility Savings				Estimated Maintenance Savings	Total Savings	ROI	Incentive *	Payback (without incentive) Years	Payback (with incentive) Years
	Electric kWh	Electric kW	Nat Gas Therms	Total \$						
\$				\$	\$	\$		\$		
20,000	5,100	0	4,700	5,500	0	5,500	3.1	0	3.6	3.6

ECM-4 Demand Controlled Ventilation (Gym & Cafeteria)

Budgetary Cost	Annual Utility Savings				Estimated Maintenance Savings	Total Savings	ROI	Incentive *	Payback (without incentive) Years	Payback (with incentive) Years
	Electric kWh	Electric kW	Nat Gas Therms	Total \$						
\$				\$	\$	\$		\$		
20,000	8,000	0	700	1,800	0	1,800	0.4	0	11.1	11.1

ECM-5 Window Replacements and Reduced Glazing

Budgetary Cost	Annual Utility Savings				Estimated Maintenance Savings	Total Savings	ROI	Incentive *	Payback (without incentive) Years	Payback (with incentive) Years
	Electric kWh	Electric kW	Nat Gas Therms	Total \$						
\$				\$	\$	\$		\$		
215,000	2,000	0	3,800	4,200	0	4,200	(0.4)	0	>20	>20

ECM-6 Lighting Replacement / Upgrades

Budgetary Cost	Annual Utility Savings				Estimated Maintenance Savings	Total Savings	ROI	Incentive *	Payback (without incentive) Years	Payback (with incentive) Years
	Electric kWh	Electric kW	Nat Gas Therms	Total \$						
\$				\$	\$	\$		\$		
52,000	20,600	9.7	0	3,000	0	3,000	(0.2)	5,600	17.3	15.5

ECM-7 Install Lighting Controls (Occupancy Sensors)

Budgetary Cost	Annual Utility Savings				Estimated Maintenance Savings	Total Savings	ROI	Incentive *	Payback (without incentive) Years	Payback (with incentive) Years
	Electric kWh	Electric kW	Nat Gas Therms	Total \$						
\$				\$	\$	\$		\$		
18,000	28,900	0.0	0	3,500	0	3,500	2.3	3,000	5.1	4.3

ECM-8 Lighting Replacements with Lighting Controls (Occupancy Sensors)

Budgetary Cost	Annual Utility Savings				Estimated Maintenance Savings	Total Savings	ROI	Incentive *	Payback (without incentive) Years	Payback (with incentive) Years
	Electric kWh	Electric kW	Nat Gas Therms	Total \$						
\$				\$	\$	\$		\$		
70,000	44,000	9.7	0	5,800	0	5,800	0.2	8,700	12.1	10.6

ECM-9 Install Low Flow Plumbing Fixtures

Budgetary Cost	Annual Utility Savings				Estimated Maintenance Savings	Total Savings	ROI	Incentive *	Payback (without incentive) Years	Payback (with incentive) Years
	Electric kWh	Electric kW	Water kgal/yr	Total \$						
\$				\$	\$	\$		\$		
5,000	0	0.0	0	400	0	400	0.3	0	12.5	12.5

Franklin Lakes Public Schools - NJBPU
CHA Project #24497

Utility Costs		Yearly Usage	MTCDE	Building Area	Annual Utility Cost	
\$	0.135	\$/kWh blended		53,400	Electric	Natural Gas
\$	0.120	\$/kWh supply	416,640		\$56,082.19	\$24,963.49
\$	4.15	\$/kW	124.4			
\$	1.02	\$/Therm	24,362			
\$	6.18	\$/kgals	569			

Woodside Avenue Elementary School

	Item	Savings						Cost	Simple Payback	MTCDE	Life Expectancy	NJ Smart Start Incentives	Direct Install Eligible (Y/N)*	Direct Install Incentives**	Max Incentives	Payback w/ Incentives***	Simple Projected Lifetime Savings						ROI
		kW	kWh	therms	cooling kWh	kgal/yr	\$										kW	kWh	therms	cooling	kgal/yr	\$	
ECM-1	Replace Gas-Fired DHW Heater	0.0	0	431	0	0	\$ 400	\$ 6,030	15.1	2.3	12	\$ 300	Y	\$ 4,200	\$ 300	14.3	0.0	0	5,175	0	0	\$ 5,303	(0.1)
ECM-2	Install VSD & Premium Motors on HW Pumps	0.0	14,243	0	0	0	\$ 1,900	\$ 9,712	5.1	6.0	20	\$ 2,300	Y	\$ 6,800	\$ 2,300	3.9	0.0	284,855	0	0	0	\$ 38,343	2.9
ECM-3	Upgrade Pneumatic Control to DDC System	0.0	0	4,669	5,058	0	\$ 5,500	\$ 20,000	3.6	27.0	15			\$ -	\$ -	3.6	0.0	0	70,035	75,872	0	\$ 81,978	3.1
ECM-4	Demand Controlled Ventilation (Gym & Cafeteria)	0.0	0	735	8,031	0	\$ 1,800	\$ 20,000	11.1	7.3	15			\$ -	\$ -	11.1	0.0	0	11,022	120,461	0	\$ 27,510	0.4
ECM-5	Window Replacements and Reduced Glazing	0.0	0	3,787	2,039	0	\$ 4,200	\$ 215,000	51.2	21.1	30			\$ -	\$ -	51.2	0.0	0	113,617	61,184	0	\$ 124,660	(0.4)
ECM-6	Lighting Replacement / Upgrades	9.7	20,625	0	0	0	\$ 3,000	\$ 52,180	17.4	8.7	15	\$ 5,640	Y	\$ 36,500	\$ 5,640	15.5	145.6	309,369	0	0	0	\$ 44,292	(0.2)
ECM-7	Install Lighting Controls (Occupancy Sensors)	0.0	28,899	0	0	0	\$ 3,500	\$ 17,618	5.0	12.1	15	\$ 3,045	Y	\$ 12,300	\$ 3,045	4.2	0.0	433,481	0	0	0	\$ 58,349	2.3
ECM-8	Lighting Replacements with Lighting Controls (Occupancy Sensors)	9.7	44,044	0	0	0	\$ 5,800	\$ 69,797	12.0	18.5	15	\$ 8,685	Y	\$ 48,900	\$ 8,685	10.5	145.6	660,664	0	0	0	\$ 86,356	0.2
ECM-9	Install Low Flow Plumbing Fixtures	0.0	0	0	0	62	\$ 400	\$ 4,538	11.3	0.0	15			\$ -	\$ -	11.3	0.0	0	0	0	936	\$ 5,786	0.3
Total (Does Not Include ECM-12 & ECM-13)		9.7	58,287	9,622	15,128	62	\$ 20,000	\$ 345,076	17.3		17	\$ 11,285		\$ 59,900	\$ 11,285	16.7	145.6	945,519	199,851	257,516	936	\$369,936	0.1
Total Measures with Payback <15		0.0	14,243	4,669	5,058	0	\$ 7,400	\$ 29,712	4.0		17	\$ 2,300		\$ 6,800	\$ 2,300	3.7	0.0	284,855	70,035	75,872	0	\$120,322	3.0
% of Existing		8%	14%	39%	4%	11%																	

ECM-1: Replace gas-Fired DHW Heater

Summary

Item	Value	Units	Formula/Comments
Avg. Monthly Utility Demand by Water Heater	162	Therms/month	Calculated from utility bill
Total Annual Utility Demand by Water Heater	194,893	MBTU/yr	1therm = 100 MBTU
Existing DHW Heater Efficiency	80%		Per manufacturer nameplate
Total Annual Hot Water Demand (w/ standby losses)	155,914	MBTU/yr	
Existing Tank Size	80	Gallons	Per manufacturer nameplate
Hot Water Piping System Capacity	200	Gallons	Estimated Per existing system (includes HWR piping)
Hot Water Temperature	140	°F	Per building personnel
Room Temperature	70	°F	
Standby Losses (% by Volume)	2.5%		(2.5% of stored capacity per hour, per U.S. Department of Energy)
Standby Losses (Heat Loss)	4.1	MBH	
Annual Standby Hot Water Load	35,770	MBTU/yr	
New Tank Size	0	Gallons	Based on Takagi Flash T-H1 instantaneous, condensing DHW Heater
Hot Water Piping System Capacity	200	Gallons	Estimated Per existing system (includes HWR piping)
Hot Water Temperature	140	°F	
Room Temperature	70	°F	
Standby Losses (% by Volume)	2.5%		(2.5% of stored capacity per hour, per U.S. Department of Energy)
Standby Losses (Heat Loss)	2.9	MBH	
Annual Standby Hot Water Load	25,550	MBTU/yr	
Total Annual Hot Water Demand	145,694	MBTU/yr	
Proposed Avg. Hot water heater efficiency	96%		Based on Takagi Flash T-H1 instantaneous, condensing DHW Heater
Proposed Fuel Use	1,518	Therms	Standby Losses and inefficient DHW heater eliminated
Utility Cost	\$1.02	\$/Therm	
Existing Operating Cost of DHW	\$1,997	\$/yr	
Proposed Operating Cost of DHW	\$1,555	\$/yr	

Savings Summary:

Utility	Energy Savings	Cost Savings
Therms/yr	431	\$442

Multipliers	
Material:	1.10
Labor:	1.35
Equipment:	1.10

ECM-1: Replace gas-Fired DHW Heater - Cost

Description	QTY	UNIT	UNIT COSTS			SUBTOTAL COSTS			TOTAL COST	REMARKS
			MAT.	LABOR	EQUIP.	MAT.	LABOR	EQUIP.		
Gas-Fired DHW Heater Removal	1	LS		\$ 50		\$ -	\$ 68	\$ -	\$ 68	
80 gallon Tankless Gas-Fired DHW Heater	1	LS	\$ 4,000	\$ 280		\$ 2,200	\$ 378	\$ -	\$ 2,578	
Miscellaneous Electrical	1	LS	\$ 300			\$ 330	\$ -	\$ -	\$ 330	
Venting Kit	1	EA	\$ 450	\$ 650		\$ 495	\$ 878	\$ -	\$ 1,373	
Miscellaneous Piping and Valves	1	LS	\$ 200			\$ 220	\$ -	\$ -	\$ 220	
						\$ -	\$ -	\$ -	\$ -	
						\$ -	\$ -	\$ -	\$ -	
						\$ -	\$ -	\$ -	\$ -	
						\$ -	\$ -	\$ -	\$ -	

\$ 4,568	Subtotal
\$ 457	10% Contingency
\$ 1,005	20% Contractor O&P
\$ -	
\$ 6,030	Total

ECM-2: Install VSD & Premium Motors on HW Pumps

Variable Inputs

Blended Electric Rate	\$0.13
Heating System "On" Point	55
VFD Efficiency	98.5%

ECM Description Summary

PUMP SCHEDULE							
Pump ID	Qty	HP	Total HP	Existing Motor Motor Eff.	New Motor Motor Eff.	Exist. Motor kW Note 1	New Motor kW Note 2
P-1, P-2	1	7.5	7.5	85.5%	92.0%	5.24	4.87
					Total:	5.24	4.87

SAVINGS ANALYSIS									
OAT - DB Avg Temp F	OAT - WB Avg Temp F	Annual Hours in Bin	Heating Hours Bin	Pump Load %	Existing Pump kWh	Proposed Pump kW	Speed efficiency %	Proposed Pump kWh	Proposed Savings kWh
(A)	(B)	(C)	(D) =IF(A>TP,0,C)	(E) =0.5+0.5*(50-A)/(50-10)) See Note 4	(F) =D*AA	(G) =BB*E^2.5/CC	(H)	(I) =D*G	(J) =F-H
See Note 3	See Note 3	See Note 3				See Note 5			
97.5	75	6	0	0%	0	0.0	0.0%	0	0
92.5	74	45	0	0%	0	0.0	0.0%	0	0
87.5	72	146	0	0%	0	0.0	0.0%	0	0
82.5	69	298	0	0%	0	0.0	0.0%	0	0
77.5	67	476	0	0%	0	0.0	0.0%	0	0
72.5	64	662	0	0%	0	0.0	0.0%	0	0
67.5	62	740	0	0%	0	0.0	0.0%	0	0
62.5	58	765	0	0%	0	0.0	0.0%	0	0
57.5	53	733	0	0%	0	0.0	0.0%	0	0
52.5	47	668	668	53%	3,499	1.0	84.1%	794	2,705
47.5	43	659	659	58%	3,451	1.3	88.8%	953	2,499
42.5	38	685	685	64%	3,588	1.6	92.7%	1,191	2,397
37.5	34	739	739	69%	3,870	2.0	95.9%	1,531	2,340
32.5	30	717	717	75%	3,755	2.4	98.2%	1,758	1,998
27.5	25	543	543	81%	2,844	2.9	99.8%	1,567	1,277
22.5	20	318	318	86%	1,666	3.4	100.0%	1,081	584
17.5	16	245	245	92%	1,283	4.0	100.0%	974	309
12.5	11	156	156	97%	817	4.6	99.7%	721	97
7.5	6	92	92	100%	482	4.9	99.0%	459	23
2.5	2	36	36	100%	189	4.9	99.0%	180	9
-2.5	-3	19	19	100%	100	4.9	99.0%	95	5
-7.5	-8	8	8	100%	42	4.9	99.0%	40	2
		8,760	4,887		25,585			11,342	14,243

Notes:

- 1) Existing motor power was determined using...
- 2) New motor power is the same as existing motor power adjusted for the new efficiency, if a new motor is proposed.
- 3) Weather data from NOAA for ...
- 4) The pump load is estimated at 100% at X deg. OAT and 50% at X deg. OAT and varies linearly in between.
- 5) The required VFD motor draw is based on a 2.5 power relationship to load.

HW PUMP VFD - SAVINGS SUMMARY					
	Electric Demand	Electric Usage	Nat Gas Usage	Maint.	Total Cost
	(kW)	(kWh)	(Therms)	(\$)	(\$)
Savings	0	14,243	0	\$0	\$1,917

Multipliers	
Material:	1.10
Labor:	1.35
Equipment:	1.00

ECM-2: Install VSD & Premium Motors on HW Pumps - Cost

Description	QTY	UNIT	UNIT COSTS			SUBTOTAL COSTS			TOTAL COST	REMARKS
			MAT.	LABOR	EQUIP.	MAT.	LABOR	EQUIP.		
						\$ -	\$ -	\$ -	\$ -	
7.5 HP VFD	2	ea	\$ 2,021	\$ 509		\$ 4,447	\$ 1,375	\$ -	\$ 5,822	
7.5 HP Motor	2	ea	\$ 536	\$ 84		\$ 1,178	\$ 227	\$ -	\$ 1,405	
Electrical - misc.	2	ls	\$ 200	\$ 150		\$ 440	\$ 405	\$ -	\$ 845	
Duct pressure sensor/transmitter	2	ea	\$ 500	\$ 200		\$ 1,100	\$ 540	\$ -	\$ 1,640	
						\$ -	\$ -	\$ -	\$ -	
						\$ -	\$ -	\$ -	\$ -	

\$ 9,712	Subtotal
\$ -	
\$ -	
\$ -	
\$ 9,712	Total

Franklin Lakes Public Schools - NJBPU
CHA Project #24497
Woodside Avenue Elementary School

ECM 3: Upgrade Pneumatic Control to DDC System

EXISTING CONDITIONS		
Cost of Electricity	\$ 0.13	\$/kWh
Cost of Natural Gas	\$ 1.02	\$/Therms
Existing Facility Electric usage	416,640	kWh ¹
Existing Facility Natural Gas Usage	24,362	Therms ¹
Existing Facility Electric usage	122,110	kBtu
Existing Facility Natural Gas Usage	244	kBtu
Existing Facility Energy Usage	122,354	kBtu
Existing Facility HVAC Energy Usage	64,848	kBtu ²
SAVINGS		
Total Energy Savings	9,727	kBtu ⁵
Electricity Savings	5,058	kWh ³
Natural Gas Savings	4,669	Therms ⁴
Total Cost Savings	\$5,465	\$
Estimated Total Project Cost	\$ 20,000	⁶
Simple Payback	3.7	years

Assumptions

- 1 Total combined energy usage from utility bill analysis
- 2 53% of facility total energy used for HVAC; Source: http://www.esource.com/BEA/demo/PDF/CEA_offices.pdf
- 3 52% of electrical energy savings
- 4 48% of natural gas energy savings
- 5 15% energy savings, typical for upgrading to DDC
- 6 \$ 20,000 estimated measure installed

Franklin Lakes Public Schools - NJBPU
CHA Project #24497
Woodside Avenue Elementary School

AIR HANDLER	AREA SERVED	FAN MOTOR HP	CFM	OA CFM
HV-1	Gym	15	12000	3000
AHU-W-3	Cafeteria /Music	5.0	5,000	1,500
		5.0	HP	4,500 CFM

ECM 4: Demand Controlled Ventilation

ECM Description Summary

It is assumed the original system controls provide the full design ventilation outside air flow. Reducing outside air during occupied time periods will reduce heating and cooling energy used during the occupied period. A limit of 1000 PPM of CO2 is recommended in ASHRAE Standard 62-1982, Ventilation for Acceptable Indoor Air Quality. During unoccupied periods the outside air dampers should be closed.

Electric Cost	\$	0.13	/kWh
Natural Gas Cost	\$	1.02	/therm
Facility Ventilation Heating Load		243,000	BTU/Hour ^{1,2,3,4}
Facility Ventilation Cooling Load		69,429	BTU/Hour ^{1,2,3,4}
Existing Ventilation Heating Usage		3,674	therms ⁶
Existing Ventilation Cooling Usage		30,758	kWh ⁶
Proposed Ventilation Heating Usage		2,939	therms ⁷
Proposed Ventilation Cooling Usage		24,606	kWh ⁷
Proposed Ventilation Fan Savings		1,879	kWh ^{5,8}
Total heating savings		735	therms
Total cooling savings		8,031	kWh
Total cost savings		1,834	
Estimated Total Project Cost		\$20,000	⁹
Simple Payback		11	years

Assumptions

- 1 4,500 OA AHU airflow based existing design drawing schedules
- 2 35 °F, Assumed average heating Δt (mixed air and supply)
- 3 10 °F, Assumed average cooling Δt (mixed air and supply)
- 4 70% Typical energy recovery unit efficiency assumed based on prior project experience
- 5 3.7 kW of existing supply fan motor calculated based on electrical data from nameplate
- 6 1,512 AHU run time per heating/cooling seasons [12 hours/day, 21 days/month, 6 months/year]
- 7 20% Estimated savings for DCV based on reducing unit run time from 12 hours to 10 hours per day
- 8 504 Assumed supply fan run time reduction based on 2 hours/day fan is "off" due to DCV
- 9 \$ 20,000 estimated measure cost for installation of sensors and associated controls

Franklin Lakes Public Schools - NJBPU
CHA Project #24497
High Mountain Road Elementary School

ECM-5 Replace Windows

Existing: Windows are not properly sealed. This can lead to increased energy consumption due to infiltration/exfiltration and heat gain/loss.
Proposed: Install weather strip or caulking to properly seal windows

Linear Feet of window Edge	3,242.0 LF	Cooling System Efficiency	1.2 kW/ton	Heating System Efficiency	80%
Area of window glass	4,788.0 SF	Ex Occupied CIng Temp.	74 °F	Heating On Temp.	60 °F
Existing Infiltration Factor	0.20 cfm/LF	Ex Unoccupied CIng Temp.	76 °F	Ex Occupied Htg Temp.	68 °F
Proposed Infiltration Factor	0.10 cfm/LF	Cooling Occ Enthalpy Setpoint	27.5 Btu/lb	Ex Unoccupied Htg Temp.	58 °F
Existing U Value	0.87 Btuh/SF°F	Cooling Unocc Enthalpy Setpoint	27.5 Btu/lb	Electricity	\$ 0.135 \$/kWh
Proposed U Value	0.45 Btuh/SF°F			Natural Gas	\$ 1.02 \$/therm

					EXISTING LOADS		PROPOSED LOADS		COOLING ENERGY		HEATING ENERGY	
Avg Outdoor Air Temp. Bins °F	Avg Outdoor Air Enthalpy	Existing Equipment Bin Hours	Occupied Equipment Bin Hours	Unoccupied Equipment Bin Hours	Occupied Window Infiltration & Heat Load BTUH	Unoccupied Window Infiltration & Heat Load BTUH	Occupied Window Infiltration & Heat Load BTUH	Unoccupied Window Infiltration & Heat Load BTUH	Existing Cooling Energy kWh	Proposed Cooling Energy kWh	Existing Heating Energy Therms	Proposed Heating Energy Therms
					E	F	G	H	I	J	K	L
102.5	50.1	0	0	0	-184,661	-176,330	-94,377	-90,068	0	0	0	0
97.5	42.5	6	2	4	-141,658	-133,327	-72,517	-68,207	82	42	0	0
92.5	39.5	45	16	29	-112,076	-103,745	-57,367	-53,058	480	246	0	0
87.5	36.6	146	52	94	-82,787	-74,456	-42,363	-38,054	1131	578	0	0
82.5	34.0	298	106	192	-54,373	-46,042	-27,797	-23,488	1461	746	0	0
77.5	31.6	476	170	306	-26,542	-18,211	-13,523	-9,213	1009	512	0	0
72.5	29.2	662	237	426	0	0	0	0	0	0	0	0
67.5	27.0	740	264	476	0	0	0	0	0	0	0	0
62.5	24.5	765	273	492	0	0	0	0	0	0	0	0
57.5	21.4	733	262	471	51,091	2,433	26,300	1,252	0	0	182	93
52.5	18.7	668	239	430	75,420	26,762	38,823	13,776	0	0	369	190
47.5	16.2	659	235	424	99,750	51,091	51,347	26,300	0	0	564	290
42.5	14.4	685	245	441	124,079	75,420	63,871	38,823	0	0	795	409
37.5	12.6	739	264	475	148,408	99,750	76,394	51,347	0	0	1,082	557
32.5	10.7	717	256	461	172,737	124,079	88,918	63,871	0	0	1,268	653
27.5	8.6	543	194	349	197,066	148,408	101,442	76,394	0	0	1,126	580
22.5	6.8	318	114	205	221,395	172,737	113,965	88,918	0	0	756	389
17.5	5.5	245	88	158	245,725	197,066	126,489	101,442	0	0	657	338
12.5	4.1	156	56	100	270,054	221,395	139,013	113,965	0	0	466	240
7.5	2.6	92	33	59	294,383	245,725	151,537	126,489	0	0	303	156
2.5	1.0	36	13	23	318,712	270,054	164,060	139,013	0	0	129	67
-2.5	0.0	19	7	12	343,041	294,383	176,584	151,537	0	0	74	38
-7.5	-1.5	8	3	5	367,370	318,712	189,108	164,060	0	0	34	17
TOTALS		8,760	3,129	5,631					4164	2124	7,805	4,018

Existing Window Infiltration	648 cfm	Savings	3,787 Therms	\$ 3,881
Existing Window Heat Transfer	4,166 Btuh/°F		2,039 kWh	\$ 275
Proposed Window Infiltration	324 cfm			\$ 4,155
Proposed Window Heat Transfer	2,155 Btuh/°F			

Window ID	Location	Quantity	Width (ft)	Height (ft)	Linear Feet (LF)	Area (SF)	Infiltration Rate (CFM/LF)	U Value (Btuh/SF°F)	Infiltration (CFM)	Heat Transfer (Btuh/°F)
1	Exterior Wall	93	7	6	2418.0	3906.0	0.2	0.87	483.6	3398.2
2	Exterior Wall	28	2.5	6	476.0	420.0	0.2	0.87	95.2	365.4
3	Exterior Wall	12	3.5	11	348.0	462.0	0.2	0.87	69.6	401.9
Total		133	13	23	3,242.0	4,788.0	0.20	0.87	648.4	4165.6

ECM-10: Install Low Flow Plumbing Fixtures

EXISTING CONDITIONS		
Cost of Water / 1000 Gallons	\$6.18	\$ / kGal
Toilets in Building	10	
Average Flushes / Toilet (per Day)	9	
Average Gallons / Flush	3.5	Gal

PROPOSED CONDITIONS		
Proposed Toilets to be Replaced	10	
Proposed Gallons / Flush	1.6	Gal
Proposed Material Cost of new Flush Valves	\$315	
Proposed Installation cost of new Flush Valves	\$139	
Total cost of new toilets & valves	\$4,538	

SAVINGS		
Current Toilet Water Use	115	kGal / year
Proposed Toilet Water Use	53	kGal / year
Water Savings	62	kGal / year
Cost Savings	\$386	/ year
Simple Payback	11.8	years

Energy Audit of Woodside Avenue Elementary School
CHA Project No.24497

ECM-1 Lighting Replacements

Budgetary	Annual Utility Savings				Estimated	Total	New Jersey	Payback	Payback
Cost					Maintenance	Savings	Incentive	(without incentive)	(with incentive)
					Savings				
\$	kW	kWh	therms	\$	\$	\$	\$	Years	Years
\$52,180	9.7	20,625	0	\$3,290	0	\$3,290	\$5,640	15.9	14.1

*Incentive based on New Jersey Smart Start Prescriptive Lighting Measures

ECM-2 Install Occupancy Sensors

Budgetary	Annual Utility Savings				Estimated	Total	New Jersey	Payback	Payback
Cost					Maintenance	Savings	Incentive	(without incentive)	(with incentive)
					Savings				
\$	kW	kWh	therms	\$	\$	\$	\$	Years	Years
\$17,618	0.0	28,899	0	\$3,620	0	\$3,620	\$3,045	4.9	4.0

*Incentive based on New Jersey Smart Start Prescriptive Lighting Measures

ECM-3 Lighting Replacements with Occupancy Sensors

Budgetary	Annual Utility Savings				Estimated	Total	New Jersey	Payback	Payback
Cost					Maintenance	Savings	Incentive	(without incentive)	(with incentive)
					Savings				
\$	kW	kWh	therms	\$	\$	\$	\$	Years	Years
\$69,797	9.7	44,044	0	\$6,224	0	\$6,224	\$8,685	11.2	9.8

*Incentive based on New Jersey Smart Start Prescriptive Lighting Measures

Energy Audit of Woodside Avenue Elementary School

CHA Project No.24497

ECM-1 Lighting Replacements

Cost of Electricity: \$0.125 \$/kWh
\$6.07 \$/kW

		EXISTING CONDITIONS								RETROFIT CONDITIONS								COST & SAVINGS ANALYSIS							
	Area Description	No. of Fixtures	Standard Fixture Code	NYSERDA Fixture Code	Watts per Fixture	kW/Space	Exist Control	Annual Hours	Annual kWh	Number of Fixtures	Standard Fixture Code	Fixture Code	Watts per Fixture	kW/Space	Retrofit Control	Annual Hours	Annual kWh	Annual kWh Saved	Annual kW Saved	Annual \$ Saved	Retrofit Cost	NJ Smart Start Lighting Incentive	Simple Payback With Out Incentive	Simple Payback	
Field Code	Unique description of the location - Room number/Room name: Floor number (if applicable)	No. of fixtures before the retrofit	"Lighting Fixture Code" Example 2T 40 R F(U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	Pre-inst. control device	Estimated daily hours for the usage group	(kW/Space) * (Annual Hours)	No. of fixtures after the retrofit	"Lighting Fixture Code" Example 2T 40 R F(U) w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Number of Fixtures)	Retrofit control device	Estimated annual hours for the usage group	(kW/Space) * (Annual Hours)	(Original Annual kWh) - (Retrofit Annual kWh)	(Original Annual kW) - (Retrofit Annual kW)	(kWh Saved) * (\$/kWh)	Cost for renovations to lighting system	Prescriptive Lighting Measures	Length of time for renovations cost to be recovered	Length of time for renovations cost to be recovered	
13	Boiler Room	13	S 32 P F 2 (ELE)	F42LL	60	0.8	SW	1000	780	13	0	F42SSILL	48	0.6	SW	1,000	624	156	0.2	\$ 30.90	\$ 1,381.25	\$130	44.7	8.0	
13	Custodian	4	S 32 P F 2 (ELE)	F42LL	60	0.2	SW	500	120	4	0	F42SSILL	48	0.2	SW	500	96	24	0.0	\$ 6.50	\$ 425.00	\$40	65.4	16.0	
71	Attic	6	I 60	I60/1	60	0.4	SW	500	180	6	CF 26	CFQ26/1-L	27	0.2	SW	500	81	99	0.2	\$ 26.82	\$ 40.50	\$0	1.5	0.4	
55	Vest	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2280	107	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2,280	107	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
55	Corridor	5	2T 17 R F 3 (ELE)	F23ILL	47	0.2	SW	2280	536	5	2T 17 R F 3 (ELE)	F23ILL	47	0.2	SW	2,280	536	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
254	Vest	1	T 32 R F 4 (ELE)	F44LL	118	0.1	SW	2280	269	1	T 32 R F 4 (ELE)	F44LL	118	0.1	SW	2,280	269	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
254	Main Lobby	3	T 32 R F 4 (ELE)	F44LL	118	0.4	C-OCC	2280	807	3	T 32 R F 4 (ELE)	F44LL	118	0.4	C-OCC	2,280	807	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
201	Library	52	T 32 R F 3 (ELE)	F43ILL/2	90	4.7	C-OCC	2400	11,232	52	0	F43SSILL	72	3.7	C-OCC	2,400	8,986	2,246	0.9	\$ 349.54	\$ 5,525.00	\$780	15.8	2.1	
13	13	4	S 32 P F 2 (ELE)	F42LL	60	0.2	C-OCC	2400	576	4	0	F42SSILL	48	0.2	C-OCC	2,400	461	115	0.0	\$ 17.92	\$ 425.00	\$40	23.7	3.3	
13	12	4	S 32 P F 2 (ELE)	F42LL	60	0.2	SW	2400	576	4	0	F42SSILL	48	0.2	SW	2,400	461	115	0.0	\$ 17.92	\$ 425.00	\$40	23.7	3.3	
13	Main Office	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,152	8	0	F42SSILL	48	0.4	C-OCC	2,400	922	230	0.1	\$ 35.85	\$ 850.00	\$80	23.7	3.3	
199	Main Office Kitchen	1	W 32 C F 1 (ELE)	F41LL	32	0.0	SW	2400	77	1	0	F41SSILL	26	0.0	SW	2,400	62	14	0.0	\$ 2.24	\$ 106.25	\$15	47.4	6.3	
13	Principal	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,152	8	0	F42SSILL	48	0.4	C-OCC	2,400	922	230	0.1	\$ 35.85	\$ 850.00	\$80	23.7	3.3	
71	Principal TR	3	I 60	I60/1	60	0.2	SW	2400	432	3	CF 26	CFQ26/1-L	27	0.1	SW	2,400	194	238	0.1	\$ 36.97	\$ 20.25	\$0	0.5	0.1	
71	Principal Storage	1	I 60	I60/1	60	0.1	SW	2400	144	1	CF 26	CFQ26/1-L	27	0.0	SW	2,400	65	79	0.0	\$ 12.32	\$ 6.75	\$0	0.5	0.1	
13	Main Office Vest	5	S 32 P F 2 (ELE)	F42LL	60	0.3	C-OCC	2400	720	5	0	F42SSILL	48	0.2	C-OCC	2,400	576	144	0.1	\$ 22.41	\$ 531.25	\$50	23.7	3.3	
55	Nurse Vest	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	2400	113	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	2,400	113	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
13	Nurse	6	S 32 P F 2 (ELE)	F42LL	60	0.4	C-OCC	2400	864	6	0	F42SSILL	48	0.3	C-OCC	2,400	691	173	0.1	\$ 26.89	\$ 637.50	\$60	23.7	3.3	
55	Nurse TR	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2000	94	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2,000	94	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
71	Nurse Storage	1	I 60	I60/1	60	0.1	SW	1000	60	1	CF 26	CFQ26/1-L	27	0.0	SW	1,000	27	33	0.0	\$ 6.54	\$ 6.75	\$0	1.0	0.2	
55	Corridor	7	2T 17 R F 3 (ELE)	F23ILL	47	0.3	C-OCC	2280	750	7	2T 17 R F 3 (ELE)	F23ILL	47	0.3	C-OCC	2,280	750	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
13	6	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,152	8	0	F42SSILL	48	0.4	C-OCC	2,400	922	230	0.1	\$ 35.85	\$ 850.00	\$80	23.7	3.3	
13	5 Child Study Team Office	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296	9	0	F42SSILL	48	0.4	C-OCC	2,400	1,037	259	0.1	\$ 40.33	\$ 956.25	\$90	23.7	3.3	
13	3 Classroom	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296	9	0	F42SSILL	48	0.4	C-OCC	2,400	1,037	259	0.1	\$ 40.33	\$ 956.25	\$90	23.7	3.3	
13	4	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296	9	0	F42SSILL	48	0.4	C-OCC	2,400	1,037	259	0.1	\$ 40.33	\$ 956.25	\$90	23.7	3.3	
13	1	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296	9	0	F42SSILL	48	0.4	C-OCC	2,400	1,037	259	0.1	\$ 40.33	\$ 956.25	\$90	23.7	3.3	
13	2	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296	9	0	F42SSILL	48	0.4	C-OCC	2,400	1,037	259	0.1	\$ 40.33	\$ 956.25	\$90	23.7	3.3	
9	Gym	9	High Bay MH 400 35 Feet High	MH400/1	458	4.1	SW	2000	8,244	9	0	QL200/1	200	1.8	SW	2,000	3,600	4,644	2.3	\$ 750.77	\$ 6,682.50	\$0	8.9	1.4	
249	49 Gym Office	2	F 48 R F 2 (ELE)	F41GL	32	0.1	SW	2400	154	2	F 48 R F 2 (ELE)	F41GL	32	0.1	SW	2,400	154	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
249	Gym Storage	2	F 48 R F 2 (ELE)	F41GL	32	0.1	C-OCC	1000	64	2	F 48 R F 2 (ELE)	F41GL	32	0.1	C-OCC	1,000	64	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
13	Gym Storage	9	S 32 P F 2 (ELE)	F42LL	60	0.5	SW	1000	540	9	0	F42SSILL	48	0.4	SW	1,000	432	108	0.1	\$ 21.39	\$ 956.25	\$90	44.7	8.0	
13	Boys TR	1	S 32 P F 2 (ELE)	F42LL	60	0.1	SW	2000	120	1	0	F42SSILL	48	0.0	SW	2,000	96	24	0.0	\$ 3.88	\$ 106.25	\$10	27.4	4.0	
55	Corridor	8	2T 17 R F 3 (ELE)	F23ILL	47	0.4	SW	2280	857	8	2T 17 R F 3 (ELE)	F23ILL	47	0.4	SW	2,280	857	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
13	Gym Storage	9	S 32 P F 2 (ELE)	F42LL	60	0.5	SW	1000	540	9	0	F42SSILL	48	0.4	SW	1,000	432	108	0.1	\$ 21.39	\$ 956.25	\$90	44.7	8.0	
55	Women's TR	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2000	94	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2,000	94	-	0.0	\$ -	\$ -	\$0		#DIV/0!	
258	Corridor	5	CFQ13W	CFQ13/2-L	28	0.1	SW	2280	319																

Cost of Electricity: \$0.125 \$/kWh
\$6.07 \$/kW

		EXISTING CONDITIONS								RETROFIT CONDITIONS								COST & SAVINGS ANALYSIS								
	Area Description	No. of Fixtures	Standard Fixture Code	NYSERDA Fixture Code	Watts per Fixture	kW/Space	Exist Control	Annual Hours	Annual kWh	Number of Fixtures	Standard Fixture Code	Fixture Code	Watts per Fixture	kW/Space	Retrofit Control	Annual Hours	Annual kWh	Annual kWh Saved	Annual kW Saved	Annual \$ Saved	Retrofit Cost	NJ Smart Start Lighting Incentive	Simple Payback With Out Incentive	Simple Payback		
Field Code	Unique description of the location - Room number/Room name: Floor number (if applicable)	No. of fixtures before the retrofit	"Lighting Fixture Code" Example 2T 40 R F (U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	Pre-inst. control device	Estimated daily hours for the usage group	(kW/Space) * (Annual Hours)	No. of fixtures after the retrofit	"Lighting Fixture Code" Example 2T 40 R F (U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Number of Fixtures)	Retrofit control device	Estimated annual hours for the usage group	(kW/Space) * (Annual Hours)	(Original Annual kWh) - (Retrofit Annual kWh)	(Original Annual kW) - (Retrofit Annual kW)	(kWh Saved) * (\$/kWh)	Cost for renovations to lighting system	Prescriptive Lighting Measures	Length of time for renovations cost to be recovered	Length of time for renovations cost to be recovered		
13	23 Classroom	5	S 32 P F 2 (ELE)	F42LL	60	0.3	C-OCC	2400	720	5	0	F42SSILL	48	0.2	C-OCC	2,400	576	144	0.1	\$ 22.41	\$ 531.25	\$50	23.7	3.3		
71	22 TR	1	I 60	I60/1	60	0.1	C-OCC	2000	120	1	CF 26	CFQ26/1-L	27	0.0	C-OCC	2,000	54	66	0.0	\$ 10.67	\$ 6.75	\$0	0.6	0.1		
71	23 TR	1	I 60	I60/1	60	0.1	C-OCC	2000	120	1	CF 26	CFQ26/1-L	27	0.0	C-OCC	2,000	54	66	0.0	\$ 10.67	\$ 6.75	\$0	0.6	0.1		
55	Corridor	10	2T 17 R F 3 (ELE)	F23ILL	47	0.5	SW	2280	1,072	10	2T 17 R F 3 (ELE)	F23ILL	47	0.5	SW	2,280	1,072	-	0.0	\$ -	\$ -	\$0		#DIV/0!		
Total		640				47.5			104,925	640			4,912	37.8			84,301	20,625	9.7	\$3,290	\$52,180	\$5,640				
																		Demand Savings		9.7	\$707					
																		kWh Savings		20,625	\$2,584					
																		Total savings			\$3,290		15.9	14.1		

Energy Audit of Woodside Avenue Elementary School

CHA Project No.24497

ECM-2 Install Occupancy Sensors

Cost of Electricity: \$0.125 \$/kWh
\$6.07 \$/kW

		EXISTING CONDITIONS								RETROFIT CONDITIONS								COST & SAVINGS ANALYSIS							
	Area Description	No. of Fixtures	Standard Fixture Code	NYSERDA Fixture Code	Watts per Fixture	kW/Space	Exist Control	Annual Hours	Annual kWh	Number of Fixtures	Standard Fixture Code	Fixture Code	Watts per Fixture	kW/Space	Retrofit Control	Annual Hours	Annual kWh	Annual kWh Saved	Annual kW Saved	Annual \$ Saved	Retrofit Cost	NJ Smart Start Lighting Incentive	Simple Payback With Out Incentive	Simple Payback	
Field Code	Unique description of the location - Room number/Room name: Floor number (if applicable)	No. of fixtures before the retrofit	"Lighting Fixture Code" Example 2T 40 R F (U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	Pre-inst. control device	Estimated annual hours for the usage group	(kW/Space) * (Annual Hours)	No. of fixtures after the retrofit	"Lighting Fixture Code" Example 2T 40 R F (U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Number of Fixtures)	Retrofit control device	Estimated annual hours for the usage group	(kW/Space) * (Annual Hours)	(Original Annual kWh) - (Retrofit Annual kWh)	(Original Annual kW) - (Retrofit Annual kW)	(kW Saved) * (\$/kWh)	Cost for renovations to lighting system	Length of time for renovations cost to be recovered	Length of time for renovations cost to be recovered		
13	Boiler Room	13	S 32 P F 2 (ELE)	F42LL	60	0.8	SW	1000	780.0	13	S 32 P F 2 (ELE)	F42LL	60	0.8	SW	1000	780.0	0.0	0.0	\$0.00	\$0.00	\$0.00		#DIV/0!	
13	Custodian	4	S 32 P F 2 (ELE)	F42LL	60	0.2	SW	500	120.0	4	S 32 P F 2 (ELE)	F42LL	60	0.2	C-OCC	0	0.0	120.0	0.0	\$15.03	\$202.50	\$35.00	13.5	11.1	
71	Attic	6	I 60	I60/1	60	0.4	SW	500	180.0	6	I 60	I60/1	60	0.4	SW	0	0.0	180.0	0.0	\$22.55	\$0.00	\$0.00	0.0	0.0	
55	Vest	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2280	107.2	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	2280	107.2	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!	
55	Corridor	5	2T 17 R F 3 (ELE)	F23ILL	47	0.2	SW	2280	535.8	5	2T 17 R F 3 (ELE)	F23ILL	47	0.2	C-OCC	2280	535.8	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!	
254	Vest	1	T 32 R F 4 (ELE)	F44LL	118	0.1	SW	2280	269.0	1	T 32 R F 4 (ELE)	F44LL	118	0.1	C-OCC	2280	269.0	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!	
254	Main Lobby	3	T 32 R F 4 (ELE)	F44LL	118	0.4	C-OCC	2280	807.1	3	T 32 R F 4 (ELE)	F44LL	118	0.4	C-OCC	2280	807.1	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!	
201	Library	52	T 32 R F 3 (ELE)	F43ILL/2	90	4.7	C-OCC	2400	11,232.0	52	T 32 R F 3 (ELE)	F43ILL/2	90	4.7	C-OCC	1680	7,862.4	3,369.6	0.0	\$422.09	\$202.50	\$35.00	0.5	0.4	
13	13	4	S 32 P F 2 (ELE)	F42LL	60	0.2	C-OCC	2400	576.0	4	S 32 P F 2 (ELE)	F42LL	60	0.2	C-OCC	1680	403.2	172.8	0.0	\$21.65	\$202.50	\$35.00	9.4	7.7	
13	12	4	S 32 P F 2 (ELE)	F42LL	60	0.2	SW	2400	576.0	4	S 32 P F 2 (ELE)	F42LL	60	0.2	C-OCC	1680	403.2	172.8	0.0	\$21.65	\$202.50	\$35.00	9.4	7.7	
13	Main Office	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,152.0	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	1200	576.0	576.0	0.0	\$72.15	\$202.50	\$35.00	2.8	2.3	
199	Main Office Kitchen	1	W 32 C F 1 (ELE)	F41LL	32	0.0	SW	2400	76.8	1	W 32 C F 1 (ELE)	F41LL	32	0.0	C-OCC	1200	38.4	38.4	0.0	\$4.81	\$202.50	\$35.00	42.1	34.8	
13	Principal	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,152.0	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	1200	576.0	576.0	0.0	\$72.15	\$202.50	\$35.00	2.8	2.3	
71	Principal TR	3	I 60	I60/1	60	0.2	SW	2400	432.0	3	I 60	I60/1	60	0.2	C-OCC	1200	216.0	216.0	0.0	\$27.06	\$202.50	\$35.00	7.5	6.2	
71	Principal Storage	1	I 60	I60/1	60	0.1	SW	2400	144.0	1	I 60	I60/1	60	0.1	C-OCC	1200	72.0	72.0	0.0	\$9.02	\$202.50	\$35.00	22.5	18.6	
13	Main Office Vest	5	S 32 P F 2 (ELE)	F42LL	60	0.3	C-OCC	2400	720.0	5	S 32 P F 2 (ELE)	F42LL	60	0.3	C-OCC	1200	360.0	360.0	0.0	\$45.10	\$202.50	\$35.00	4.5	3.7	
55	Nurse Vest	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	2400	112.8	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	1200	56.4	56.4	0.0	\$7.06	\$202.50	\$35.00	28.7	23.7	
13	Nurse	6	S 32 P F 2 (ELE)	F42LL	60	0.4	C-OCC	2400	864.0	6	S 32 P F 2 (ELE)	F42LL	60	0.4	C-OCC	1200	432.0	432.0	0.0	\$54.11	\$202.50	\$35.00	3.7	3.1	
55	Nurse TR	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2000	94.0	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	2000	94.0	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!	
71	Nurse Storage	1	I 60	I60/1	60	0.1	SW	1000	60.0	1	I 60	I60/1	60	0.1	C-OCC	250	15.0	45.0	0.0	\$5.64	\$202.50	\$35.00	35.9	29.7	
55	Corridor	7	2T 17 R F 3 (ELE)	F23ILL	47	0.3	C-OCC	2280	750.1	7	2T 17 R F 3 (ELE)	F23ILL	47	0.3	C-OCC	2280	750.1	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!	
13	6	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,152.0	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	1680	806.4	345.6	0.0	\$43.29	\$202.50	\$35.00	4.7	3.9	
13	5 Child Study Team Office	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296.0	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	1200	648.0	648.0	0.0	\$81.17	\$202.50	\$35.00	2.5	2.1	
13	3 Classroom	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296.0	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	1680	907.2	388.8	0.0	\$48.70	\$202.50	\$35.00	4.2	3.4	
13	4	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296.0	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	1680	907.2	388.8	0.0	\$48.70	\$202.50	\$35.00	4.2	3.4	
13	1	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296.0	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	1680	907.2	388.8	0.0	\$48.70	\$202.50	\$35.00	4.2	3.4	
13	2	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296.0	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	1680	907.2	388.8	0.0	\$48.70	\$202.50	\$35.00	4.2	3.4	
9	Gym	9	High Bay MH 400 35 Feet High	MH400/1	458	4.1	SW	2000	8,244.0	9	High Bay MH 400 35 Feet High	MH400/1	458	4.1	SW	2000	8,244.0	0.0	0.0	\$0.00	\$0.00	\$0.00		#DIV/0!	
249	49 Gym Office	2	F 48 R F 2 (ELE)	F41GL	32	0.1	SW	2400	153.6	2	F 48 R F 2 (ELE)	F41GL	32	0.1	C-OCC	1200	76.8	76.8	0.0	\$9.62	\$202.50	\$35.00	21.0	17.4	
249	Gym Storage	2	F 48 R F 2 (ELE)	F41GL	32	0.1	C-OCC	1000	64.0	2	F 48 R F 2 (ELE)	F41GL	32	0.1	C-OCC	250	16.0	48.0	0.0	\$6.01	\$202.50	\$35.00	33.7	27.9	
13	Gym Storage	9	S 32 P F 2 (ELE)	F42LL	60	0.5	SW	1000	540.0	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	250	135.0	405.0	0.0	\$50.73	\$202.50	\$35.00	4.0	3.3	
13	Boys TR	1	S 32 P F 2 (ELE)	F42LL	60	0.1	SW	2000	120.0	1	S 32 P F 2 (ELE)	F42LL	60	0.1	C-OCC	2000	120.0	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!	
55	Corridor	8	2T 17 R F 3 (ELE)	F23ILL	47	0.4	SW	2280	857.3	8	2T 17 R F 3 (ELE)	F23ILL	47	0.4	C-OCC	2280	857.3	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!	
13	Gym Storage	9	S 32 P F 2 (ELE)	F42LL	60	0.5																			

Cost of Electricity: \$0.125 \$/kWh
\$6.07 \$/kW

EXISTING CONDITIONS										RETROFIT CONDITIONS								COST & SAVINGS ANALYSIS						
	Area Description	No. of Fixtures	Standard Fixture Code	NYSERDA Fixture Code	Watts per Fixture	kW/Space	Exist Control	Annual Hours	Annual kWh	Number of Fixtures	Standard Fixture Code	Fixture Code	Watts per Fixture	kW/Space	Retrofit Control	Annual Hours	Annual kWh	Annual kWh Saved	Annual kW Saved	Annual \$ Saved	Retrofit Cost	NJ Smart Start Lighting Incentive	Simple Payback With Out Incentive	Simple Payback
Field Code	Unique description of the location - Room number/Room name: Floor number (if applicable)	No. of fixtures before the retrofit	"Lighting Fixture Code" Example 2T 40 R F(U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	Pre-inst. control device	Estimated annual hours for the usage group	(kW/space) * (Annual Hours)	No. of fixtures after the retrofit	"Lighting Fixture Code" Example 2T 40 R F(U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Number of Fixtures)	Retrofit control device	Estimated annual hours for the usage group	(kW/space) * (Annual Hours)	(Original Annual kWh) - (Retrofit Annual kWh)	(Original Annual kW) - (Retrofit Annual kW)	(kW Saved) * (\$/kWh)	Cost for renovations to lighting system		Length of time for renovations cost to be recovered	Length of time for renovations cost to be recovered
13	23 Classroom	5	S 32 P F 2 (ELE)	F42LL	60	0.3	C-OCC	2400	720.0	5	S 32 P F 2 (ELE)	F42LL	60	0.3	C-OCC	1680	504.0	216.0	0.0	\$27.06	\$202.50	\$35.00	7.5	6.2
71	22 TR	1	I 60	I60/1	60	0.1	C-OCC	2000	120.0	1	I 60	I60/1	60	0.1	C-OCC	2000	120.0	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!
71	23 TR	1	I 60	I60/1	60	0.1	C-OCC	2000	120.0	1	I 60	I60/1	60	0.1	C-OCC	2000	120.0	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!
55	Corridor	10	2T 17 R F 3 (ELE)	F23ILL	47	0.5	SW	2280	1,071.6	10	2T 17 R F 3 (ELE)	F23ILL	47	0.5	C-OCC	2280	1,071.6	0.0	0.0	\$0.00	\$202.50	\$35.00		#DIV/0!
	Total	640				47.5			104,925	640				48			76,027	28,899	0	3,620	\$17,618	3,045		
																		Demand Savings		0.0	\$0			
																		kWh Savings		28,899	\$3,620			
																		Total Savings			\$3,620		4.9	4.0

Energy Audit of Woodside Avenue Elementary School

CHA Project No.24497

ECM-3 Lighting Replacements with Occupancy Sensors

Cost of Electricity: \$0.125 \$/kWh

\$6.07 \$/kWh


		EXISTING CONDITIONS								RETROFIT CONDITIONS								COST & SAVINGS ANALYSIS									
	Area Description	No. of Fixtures	Standard Fixture Code	NYSERDA Fixture Code	Watts per Fixture	kW/Space	Exist Control	Annual Hours	Annual kWh	Number of Fixtures	Standard Fixture Code	Fixture Code	Watts per Fixture	kW/Space	Retrofit Control	Annual Hours	Annual kWh	Annual kWh Saved	Annual kWh Saved	Annual \$ Saved	Retrofit Cost	NJ Smart Start Lighting Incentive	Simple Payback With Out Incentive	Simple Payback			
Field Code	Unique description of the location - Room number/Room name: Floor number (if applicable)	No. of fixtures before the retrofit	"Lighting Fixture Code" Example 2T 40 R F (U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	Pre-inst. control device	Estimated daily hours for the usage group	(kW/Space) * (Annual Hours)	No. of fixtures after the retrofit	"Lighting Fixture Code" Example 2T 40 R F (U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Number of Fixtures)	Retrofit control device	Estimated annual hours for the usage group	(kW/Space) * (Annual Hours)	(Original Annual kWh) - (Retrofit Annual kWh)	(Original Annual kW) - (Retrofit Annual kW)	(kWh Saved) * (\$/kWh)	Cost for renovations to lighting system	Prescriptive Lighting Measures	Length of time for renovations cost to be recovered	Length of time for renovations cost to be recovered			
13	Boiler Room	13	S 32 P F 2 (ELE)	F42LL	60	0.8	SW	1000	780	13	0	F42SSILL	48	0.6	SW	1,000	624	156	0.2	\$ 30.90	\$ 1,381.25	\$ 130	44.7	40.5			
13	Custodian	4	S 32 P F 2 (ELE)	F42LL	60	0.2	SW	500	120	4	0	F42SSILL	48	0.2	C-OCC	-	-	120	0.0	\$ 18.53	\$ 627.50	\$ 75	33.9	29.8			
71	Attic	6	I 60	I60/1	60	0.4	SW	500	180	6	CF 26	CFQ26/1-L	27	0.2	SW	-	-	180	0.2	\$ 36.96	\$ 40.50	\$ -	1.1	1.1			
55	Vest	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2280	107	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	2,280	107	-	0.0	\$ -	\$ 202.50	\$ 35					
55	Corridor	5	2T 17 R F 3 (ELE)	F23ILL	47	0.2	SW	2280	536	5	2T 17 R F 3 (ELE)	F23ILL	47	0.2	C-OCC	2,280	536	-	0.0	\$ -	\$ 202.50	\$ 35					
254	Vest	1	T 32 R F 4 (ELE)	F44LL	118	0.1	SW	2280	269	1	T 32 R F 4 (ELE)	F44LL	118	0.1	C-OCC	2,280	269	-	0.0	\$ -	\$ 202.50	\$ 35					
254	Main Lobby	3	T 32 R F 4 (ELE)	F44LL	118	0.4	C-OCC	2280	807	3	T 32 R F 4 (ELE)	F44LL	118	0.4	C-OCC	2,280	807	-	0.0	\$ -	\$ 202.50	\$ 35					
201	Library	52	T 32 R F 3 (ELE)	F43ILL/2	90	4.7	C-OCC	2400	11,232	52	0	F43SSILL	72	3.7	C-OCC	1,680	6,290	4,942	0.9	\$ 687.21	\$ 5,727.50	\$ 815	8.3	7.1			
13	13	4	S 32 P F 2 (ELE)	F42LL	60	0.2	C-OCC	2400	576	4	0	F42SSILL	48	0.2	C-OCC	1,680	323	253	0.0	\$ 35.24	\$ 627.50	\$ 75	17.8	15.7			
13	12	4	S 32 P F 2 (ELE)	F42LL	60	0.2	SW	2400	576	4	0	F42SSILL	48	0.2	C-OCC	1,680	323	253	0.0	\$ 35.24	\$ 627.50	\$ 75	17.8	15.7			
13	Main Office	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,152	8	0	F42SSILL	48	0.4	C-OCC	1,200	461	691	0.1	\$ 93.57	\$ 1,052.50	\$ 115	11.2	10.0			
199	Main Office Kitchen	1	W 32 C F 1 (ELE)	F41LL	32	0.0	SW	2400	77	1	0	F41SSILL	26	0.0	C-OCC	1,200	31	46	0.0	\$ 6.15	\$ 308.75	\$ 50	50.2	42.1			
13	Principal	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,152	8	0	F42SSILL	48	0.4	C-OCC	1,200	461	691	0.1	\$ 93.57	\$ 1,052.50	\$ 115	11.2	10.0			
71	Principal TR	3	I 60	I60/1	60	0.2	SW	2400	432	3	CF 26	CFQ26/1-L	27	0.1	C-OCC	1,200	97	335	0.1	\$ 49.15	\$ 222.75	\$ 35	4.5	3.8			
71	Principal Storage	1	I 60	I60/1	60	0.1	SW	2400	144	1	CF 26	CFQ26/1-L	27	0.0	C-OCC	1,200	32	112	0.0	\$ 16.38	\$ 209.25	\$ 35	12.8	10.6			
13	Main Office Vest	5	S 32 P F 2 (ELE)	F42LL	60	0.3	C-OCC	2400	720	5	0	F42SSILL	48	0.2	C-OCC	1,200	288	432	0.1	\$ 58.48	\$ 733.75	\$ 85	12.5	11.1			
55	Nurse Vest	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	2400	113	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	1,200	56	56	0.0	\$ 7.06	\$ 202.50	\$ 35	28.7	23.7			
13	Nurse	6	S 32 P F 2 (ELE)	F42LL	60	0.4	C-OCC	2400	864	6	0	F42SSILL	48	0.3	C-OCC	1,200	346	518	0.1	\$ 70.18	\$ 840.00	\$ 95	12.0	10.6			
55	Nurse TR	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2000	94	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	2,000	94	-	0.0	\$ -	\$ 202.50	\$ 35					
71	Nurse Storage	1	I 60	I60/1	60	0.1	SW	1000	60	1	CF 26	CFQ26/1-L	27	0.0	C-OCC	250	7	53	0.0	\$ 9.07	\$ 209.25	\$ 35	23.1	19.2			
55	Corridor	7	2T 17 R F 3 (ELE)	F23ILL	47	0.3	C-OCC	2280	750	7	2T 17 R F 3 (ELE)	F23ILL	47	0.3	C-OCC	2,280	750	-	0.0	\$ -	\$ 202.50	\$ 35					
13	6	8	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,152	8	0	F42SSILL	48	0.4	C-OCC	1,680	645	507	0.1	\$ 70.48	\$ 1,052.50	\$ 115	14.9	13.3			
13	5 Child Study Team Office	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296	9	0	F42SSILL	48	0.4	C-OCC	1,200	518	778	0.1	\$ 105.27	\$ 1,158.75	\$ 125	11.0	9.8			
13	3 Classroom	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296	9	0	F42SSILL	48	0.4	C-OCC	1,680	726	570	0.1	\$ 79.29	\$ 1,158.75	\$ 125	14.6	13.0			
13	4	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296	9	0	F42SSILL	48	0.4	C-OCC	1,680	726	570	0.1	\$ 79.29	\$ 1,158.75	\$ 125	14.6	13.0			
13	1	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296	9	0	F42SSILL	48	0.4	C-OCC	1,680	726	570	0.1	\$ 79.29	\$ 1,158.75	\$ 125	14.6	13.0			
13	2	9	S 32 P F 2 (ELE)	F42LL	60	0.5	C-OCC	2400	1,296	9	0	F42SSILL	48	0.4	C-OCC	1,680	726	570	0.1	\$ 79.29	\$ 1,158.75	\$ 125	14.6	13.0			
9	Gym	9	High Bay MH 400 35 Feet High	MH400/1	458	4.1	SW	2000	8,244	9	0	QL200/1	200	1.8	SW	2,000	3,600	4,644	2.3	\$ 750.77	\$ 6,682.50	\$ -	8.9	8.9			
249	49 Gym Office	2	F 48 R F 2 (ELE)	F41GL	32	0.1	SW	2400	154	2	F 48 R F 2 (ELE)	F41GL	32	0.1	C-OCC	1,200	77	77	0.0	\$ 9.62	\$ 202.50	\$ 35	21.0	17.4			
249	Gym Storage	2	F 48 R F 2 (ELE)	F41GL	32	0.1	C-OCC	1000	64	2	F 48 R F 2 (ELE)	F41GL	32	0.1	C-OCC	250	16	48	0.0	\$ 6.01	\$ 202.50	\$ 35	33.7	27.9			
13	Gym Storage	9	S 32 P F 2 (ELE)	F42LL	60	0.5	SW	1000	540	9	0	F42SSILL	48	0.4	C-OCC	250	108	432	0.1	\$ 61.98	\$ 1,158.75	\$ 125	18.7	16.7			
13	Boys TR	1	S 32 P F 2 (ELE)	F42LL	60	0.1	SW	2000	120	1	0	F42SSILL	48	0.0	C-OCC	2,000	96	24	0.0	\$ 3.88	\$ 308.75	\$ 45	79.6	68.0			
55	Corridor	8	2T 17 R F 3 (ELE)	F23ILL	47	0.4	SW	2280	857	8	2T 17 R F 3 (ELE)	F23ILL	47	0.4	C-OCC	2,280	857	-	0.0	\$ -	\$ 202.50	\$ 35					
13	Gym Storage	9	S 32 P F 2 (ELE)	F42LL	60	0.5	SW	1000	540	9	0	F42SSILL	48	0.4	C-OCC	250	108	432	0.1	\$ 61.98	\$ 1,158.75	\$ 125	18.7	16.7			
55	Women's TR	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	SW	2000	94	1	2T 17 R F 3 (ELE)	F23ILL	47	0.0	C-OCC	2,000	94	-									

Cost of Electricity: \$0.125 \$/kWh
 \$6.07 \$/kW

		EXISTING CONDITIONS								RETROFIT CONDITIONS								COST & SAVINGS ANALYSIS						
	Area Description	No. of Fixtures	Standard Fixture Code	NYSERDA Fixture Code	Watts per Fixture	kW/Space	Exist Control	Annual Hours	Annual kWh	Number of Fixtures	Standard Fixture Code	Fixture Code	Watts per Fixture	kW/Space	Retrofit Control	Annual Hours	Annual kWh	Annual kWh Saved	Annual kW Saved	Annual \$ Saved	Retrofit Cost	NJ Smart Start Lighting Incentive	Simple Payback With Out Incentive	Simple Payback
Field Code	Unique description of the location - Room number/Room name: Floor number (if applicable)	No. of fixtures before the retrofit	"Lighting Fixture Code" Example 2T 40 R F(U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Fixt No.)	Pre-inst. control device	Estimated daily hours for the usage group	(kW/Space) * (Annual Hours)	No. of fixtures after the retrofit	"Lighting Fixture Code" Example 2T 40 R F(U) = 2'x2' Troff 40 w Recess. Floor 2 lamps U shape	Code from Table of Standard Fixture Wattages	Value from Table of Standard Fixture Wattages	(Watts/Fixt) * (Number of Fixtures)	Retrofit control device	Estimated annual hours for the usage group	(kW/Space) * (Annual Hours)	(Original Annual kWh) - (Retrofit Annual kWh)	(Original Annual kW) - (Retrofit Annual kW)	(kWh Saved) * (\$/kWh)	Cost for renovations to lighting system	Prescriptive Lighting Measures	Length of time for renovations cost to be recovered	Length of time for renovations cost to be recovered
13	23 Classroom	5	S 32 P F 2 (ELE)	F42LL	60	0.3	C-OCC	2400	720	5	0	F42SSILL	48	0.2	C-OCC	1,680	403	317	0.1	\$ 44.05	\$ 733.75	\$ 85	16.7	14.7
71	22 TR	1	I 60	I60/I	60	0.1	C-OCC	2000	120	1	CF 26	CFQ26/I-L	27	0.0	C-OCC	2,000	54	66	0.0	\$ 10.67	\$ 209.25	\$ 35	19.6	16.3
71	23 TR	1	I 60	I60/I	60	0.1	C-OCC	2000	120	1	CF 26	CFQ26/I-L	27	0.0	C-OCC	2,000	54	66	0.0	\$ 10.67	\$ 209.25	\$ 35	19.6	16.3
55	Corridor	10	2T 17 R F 3 (ELE)	F23ILL	47	0.5	SW	2280	1,072	10	2T 17 R F 3 (ELE)	F23ILL	47	0.5	C-OCC	2,280	1,072	-	0.0	\$ -	\$ 202.50	\$ 35		
	Total	640				47.5			104,925	640				37.8			60,881		9.7	6,224	69,797	\$8,685		
																		Demand Savings	9.7	\$707				
																		kWh Savings		44,044	\$5,517			
																		Total Savings		\$6,224		11.2	9.8	

APPENDIX D

New Jersey Pay For Performance Incentive Program



COMMERCIAL, INDUSTRIAL AND LOCAL GOVERNMENT

PROGRAMS

NJ SMARTSTART BUILDINGS

PAY FOR PERFORMANCE

EXISTING BUILDINGS

PARTICIPATION STEPS

APPLICATIONS AND
FORMS

APPROVED PARTNERS

NEW CONSTRUCTION

FAQS

BECOME A PARTNER

COMBINED HEAT & POWER AND
FUEL CELLS

LOCAL GOVERNMENT ENERGY
AUDIT

LARGE ENERGY USERS PILOT

ENERGY SAVINGS IMPROVEMENT
PLAN

DIRECT INSTALL

ARRA

ENERGY BENCHMARKING

OIL, PROPANE & MUNICIPAL
ELECTRIC CUSTOMERS

TEACH

EDA PROGRAMS

TECHNOLOGIES

TOOLS AND RESOURCES

PROGRAM UPDATES


Home » Commercial & Industrial » Programs » Pay for Performance

Pay for Performance - Existing Buildings

Download program applications and incentive forms.

The Greater the Savings, the Greater Your Incentives

Take a comprehensive, whole-building approach to saving energy in your existing facilities and earn incentives that are directly linked to your savings. Pay for Performance relies on a network of program partners who provide technical services under direct contract to you. Acting as your energy expert, your partner will develop an energy reduction plan for each project with a whole-building technical component of a traditional energy audit, a financial plan for funding the energy efficient measures and a construction schedule for installation.



Eligibility

Existing commercial, industrial and institutional buildings with a peak demand over 100 kW for any of the preceding twelve months are eligible to participate including hotels and casinos, large office buildings, multi-family buildings, supermarkets, manufacturing facilities, schools, shopping malls and restaurants. Buildings that fall into the following five customer classes are not required to meet the 100 kW demand in order

to participate in the program: hospitals, public colleges and universities, 501(c)(3) non-profits, affordable multifamily housing, and local governmental entities. Your energy reduction plan must define a comprehensive package of measures capable of reducing the existing energy consumption of your building by 15% or more.

Exceptions to the 15% threshold requirement may be made for certain industrial, manufacturing, water treatment and datacenter building types whose annual energy consumption is heavily weighted on process loads. Details are available in the high energy intensity section of the FAQ page.

ENERGY STAR Portfolio Manager

Pay for Performance takes advantage of the ENERGY STAR Program with Portfolio Manager, EPA's interactive tool that allows facility managers to track and evaluate energy and water consumption across all of their buildings. The tool provides the opportunity to load in the characteristics and energy usage of your buildings and determine an energy performance benchmark score. You can then assess energy management goals over time, identify strategic opportunities for savings, and receive EPA recognition for superior energy performance.



This rating system assesses building performance by tracking and scoring energy use in your facilities and comparing it to similar buildings. That can be a big help in locating opportunities for cost-justified energy efficiency upgrades. And, based on our findings, you may be invited to participate in the Building Performance with ENERGY STAR initiative and receive special recognition as an industry leader in energy efficiency.

Incentives

Pay for Performance incentives are awarded upon the satisfactory completion of three program milestones:

Incentive #1 - Submittal of complete energy reduction plan prepared by an approved program partner - Contingent on moving forward, incentives will be between \$5,000 and \$50,000 based on approximately \$.10 per square foot, not to exceed 50% of the facility's annual energy expense.

Incentive #2 - Installation of recommended measures - Incentives are based on the projected level of electricity and natural gas savings resulting from the installation of comprehensive energy-efficiency measures.

Incentive #3 - Completion of Post-Construction Benchmarking Report - A completed report verifying energy reductions based on one year of post-implementation results. Incentives for electricity and natural gas savings will be paid based on actual savings, provided that the minimum performance threshold of 15% savings has been achieved.



Program



Large Scale CHI
Program Announ

2012 Large Ene
Announcement

Economic Devel
Introduces Rev
Pay for Perform

Incentives Now
Screw-in Lamps

Other updates pos

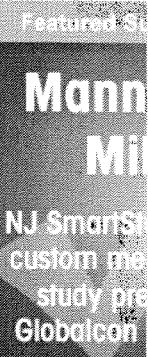

Follow Us:

CONTACT US

A detailed Incentive Structure document is available on the applications and forms page.


Energy Efficiency Revolving Loan Fund (EE RLF)

New Jersey-based commercial, institutional or industrial entities (including 501(c)(3) organizations) that have received an approved energy reduction plan under Pay for Performance may be eligible for supplemental financing through the EE RLF. The financing, in the form of low-interest loans, can be used to support up to 80% of total eligible project costs, not to exceed \$2.5 million or 100% of total eligible project costs from all public state funding sources. Visit the NJ EDA website for details.

Steps to Participation

[Click here](#) for a step-by-step description of the program.

[Home](#) | [Residential](#) | [Commercial & Industrial](#) | [Renewable Energy](#)
[About Us](#) | [Press Room](#) | [Library](#) | [FAQs](#) | [Calendar](#) | [Newsletters](#) | [Contact Us](#) | [Site Map](#)

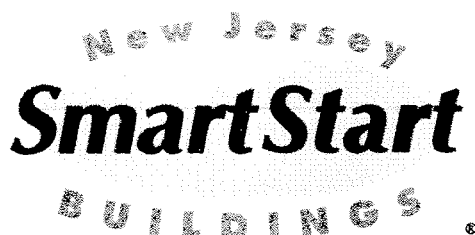

2012 PAY FOR PERFORMANCE PROGRAM Existing Buildings Incentive Structure

Incentive #1: Energy Reduction Plan

Incentive Amount:.....\$0.10 per sq ft
Minimum Incentive:.....\$5,000
Maximum Incentive:.....\$50,000 or 50% of facility annual energy cost (whichever is less)

This incentive is designed to offset the cost of services associated with the development of the Energy Reduction Plan (ERP) and is paid upon ERP approval. Incentive is contingent on implementation of recommended measures outlined in the ERP.

Incentive #2: Installation of Recommended Measures

Minimum Performance Target:.....15%

Electric Incentives

Base Incentive based on 15% savings:.....\$0.09 per projected kWh saved
For each % over 15% add:.....\$0.005 per projected kWh saved
Maximum Incentive:.....\$0.11 per projected kWh saved

Gas Incentives

Base Incentive based on 15% savings:.....\$0.90 per projected Therm saved
For each % over 15% add:.....\$0.05 per projected Therm saved
Maximum Incentive:.....\$1.25 per projected Therm saved

Incentive Cap:25% of total project cost

This incentive is based on projected energy savings outlined in the ERP. Incentive is paid upon successful installation of recommended measures.

Incentive #3: Post-Construction Benchmarking Report

Minimum Performance Target:.....15%

Electric Incentives

Base Incentive based on 15% savings:.....\$0.09 per actual kWh saved
For each % over 15% add:.....\$0.005 per actual kWh saved
Maximum Incentive:.....\$0.11 per actual kWh saved

Gas Incentives

Base Incentive based on 15% savings:.....\$0.90 per actual Therm saved
For each % over 15% add:.....\$0.05 per actual Therm saved
Maximum Incentive:.....\$1.25 per actual Therm saved

Incentive Cap:25% of total project cost

This incentive will be released upon submittal of a Post-Construction Benchmarking Report that verifies that the level of savings actually achieved by the installed measures meets or exceeds the minimum performance threshold. To validate the savings and achievement of the Energy Target, the EPA Portfolio Manager shall be used. Savings should be rounded to the nearest percent. Total value of Incentive #2 and Incentive #3 may not exceed 50% of the total project cost. Incentives will be limited to \$1 million per gas and electric account per building; maximum of \$2 million per project. See Participation Agreement for details.

New Jersey Pay For Performance Incentive Program

Note: The following calculation is based on the New Jersey Pay For Performance Incentive Program per April, 2012. Building must have a minimum average electric demand of 100 kW. This minimum is waived for buildings owned by local governments or non-profit organizations. Values used in this calculation are for measures with a positive return on investment (ROI) only.

Total Building Area (Square Feet)	53,400
Is this audit funded by NJ BPU (Y/N)	Yes

Board of Public Utilities (BPU)

Incentive #1		
Audit is funded by NJ BPU	\$0.10	\$/sqft

	Annual Utilities	
	kWh	Therms
Existing Cost (from utility)	\$56,082	\$24,963
Existing Usage (from utility)	416,640	24,362
Proposed Savings	73,415	9,622
Existing Total MMBtus	3,858	
Proposed Savings MMBtus	1,213	
% Energy Reduction	31.4%	
Proposed Annual Savings	\$7,400	

	Min (Savings = 15%)		Increase (Savings > 15%)		Max Incentive		Achieved Incentive	
	\$/kWh	\$/therm	\$/kWh	\$/therm	\$/kWh	\$/therm	\$/kWh	\$/therm
Incentive #2	\$0.09	\$0.90	\$0.005	\$0.05	\$0.11	\$1.25	\$0.11	\$1.25
Incentive #3	\$0.09	\$0.90	\$0.005	\$0.05	\$0.11	\$1.25	\$0.11	\$1.25

	Incentives \$		
	Elec	Gas	Total
Incentive #1	\$0	\$0	\$5,340
Incentive #2	\$8,076	\$12,028	\$20,104
Incentive #3	\$8,076	\$12,028	\$20,104
Total All Incentives	\$16,151	\$24,056	\$45,547

Total Project Cost	\$345,076
--------------------	-----------

		Allowable Incentive
% Incentives #1 of Utility Cost*	6.6%	\$5,340
% Incentives #2 of Project Cost**	5.8%	\$20,104
% Incentives #3 of Project Cost**	5.8%	\$20,104
Total Eligible Incentives***	\$45,547	
Project Cost w/ Incentives	\$299,529	

Project Payback (years)	
w/o Incentives	w/ Incentives
46.6	40.5

* Maximum allowable incentive is 50% of annual utility cost if not funded by NJ BPU, and %25 if it is.

** Maximum allowable amount of Incentive #2 is 25% of total project cost.

Maximum allowable amount of Incentive #3 is 25% of total project cost.

*** Maximum allowable amount of Incentive #1 is \$50,000 if not funded by NJ BPU, and \$25,000 if it is.

Maximum allowable amount of Incentive #2 & #3 is \$1 million per gas account and \$1 million per electric account; maximum 2 million per project

APPENDIX E

Energy Savings Improvement Plan (ESIP)



Your Power to Save
At Home, for Business, and for the Future

HOME

RESIDENTIAL

COMMERCIAL, INDUSTRIAL
AND LOCAL GOVERNMENT

RENEWABLE ENERGY



COMMERCIAL, INDUSTRIAL
AND LOCAL GOVERNMENT

PROGRAMS

- NJ SMARTSTART BUILDINGS
- PAY FOR PERFORMANCE
- COMBINED HEAT & POWER AND FUEL CELLS
- LOCAL GOVERNMENT ENERGY AUDIT
- LARGE ENERGY USERS PILOT
- ENERGY SAVINGS IMPROVEMENT PLAN
- DIRECT INSTALL
- ENERGY BENCHMARKING
- T-12 SCHOOLS LIGHTING INITIATIVE
- OIL, PROPANE & MUNICIPAL ELECTRIC CUSTOMERS
- EDA PROGRAMS
- TEACH
- ARRA
- TECHNOLOGIES
- TOOLS AND RESOURCES
- PROGRAM UPDATES
- CONTACT US

Home » Commercial & Industrial » Programs

Energy Savings Improvement Plan

A new State law allows government agencies to make energy related improvements to their facilities and pay for the costs using the value of energy savings that result from the improvements. Under the recently enacted Chapter 4 of the Laws of 2009 (the law), the "Energy Savings Improvement Program" (ESIP), provides all government agencies in New Jersey with a flexible tool to improve and reduce energy usage with minimal expenditure of new financial resources.

This [Local Finance Notice](#) outlines how local governments can develop and implement an ESIP for their facilities. Below are two sample RFPs:

- Local Government
- School Districts (K-12)

The Board also adopted [protocols](#) to measure energy savings.

The ESIP approach may not be appropriate for all energy conservation and energy efficiency improvements. Local units should carefully consider all alternatives to develop an approach that best meets their needs. Local units considering an ESIP should carefully review the Local Finance Notice, the law, and consult with qualified professionals to determine how they should approach the task.

FIRST STEP – ENERGY AUDIT

For local governments interested in pursuing an ESIP, the first step is to perform an energy audit. As explained in the Local Finance Notice, this may be done internally if an agency has qualified staff to conduct the audit. If not, the audit must be implemented by an independent contractor and not by the energy savings company producing the Energy Reduction Plan.

Pursuing a [Local Government Energy Audit](#) through New Jersey's Clean Energy Program is a valuable first step to the ESIP approach - and it's free. **Incentives provide 100% of the cost of the audit.**

ENERGY REDUCTION PLANS

If you have an ESIP plan you would like to submit to the Board of Public Utilities, please email it to ESIP@bpu.state.nj.us. Please limit the file size to 3MB (or break it into smaller files).

- Frankford Township School District
- Northern Hunterdon-Voorhees Regional High School
- Manalapan Township (180 MB - Right Click, Save As)

Program Updates

- Board Order - Standby Charges for Distributed Generation Customers
- T-12 Schools Lighting Replacement Initiative - Funding Allocation Reached
- Other updates posted.

Featured Success Story

Rutgers University:
Continued Commitment to Saving Energy

Applications and Brochures
Download the latest program materials.

e-Newsletter
SIGN UP TODAY!

Follow Us:



APPENDIX F

Solar Photovoltaic Analysis

Photovoltaic (PV) Solar Power Generation - Screening Assessment

Franklin Lakes Public Schools - NJBPU Woodside Avenue Elementary School

Cost of Electricity	\$0.135	/kWh
Electricity Usage	416,640	kWh/yr
System Unit Cost	\$4,000	/kW

Photovoltaic (PV) Solar Power Generation - Screening Assessment

Budgetary	Annual Utility Savings				Estimated	Total	Federal Tax	New Jersey	Payback	Payback
Cost					Maintenance	Savings	Credit	Renewable	(without	(with
					Savings			** SREC	incentive)	incentive)
\$	kW	kWh	therms	\$	\$	\$	\$	\$	Years	Years
\$280,000	70.0	91,233	0	\$12,316	0	\$12,316	\$0	\$6,842	22.7	14.6

** Estimated Solar Renewable Energy Certificate Program (SREC) SREC for 15 Years= \$75 /1000kwh

Area Output*

1,584 m²
17,051 ft²

Perimeter Output*

196 m
644 ft

Available Roof Space for PV:

(Area Output - 10 ft x Perimeter) x 85%
9,022 ft²

Approximate System Size:

Is the roof flat? (Yes/No) Yes

8 watt/ft²
72,177 DC watts
70 kW Enter into PV Watts

PV Watts Inputs***

Enter into PV Watts (always 20 if flat, if
Array Tilt Angle 20 pitched - enter estimated roof angle)
Array Azimuth 180 Enter into PV Watts (default)
Zip Code 07417 Enter into PV Watts
DC/AC Derate Factor 0.83 Enter into PV Watts

PV Watts Output

91,233 annual kWh calculated in PV Watts program

% Offset Calc

Usage 416,640 (from utilities)
PV Generation 91,233 (generated using PV Watts)
% offset 22%

* <http://www.freemaptools.com/area-calculator.htm>

** <http://www.flettexchange.com>

*** http://gisatnrel.nrel.gov/PVWatts_Viewer/index.html





AC Energy & Cost Savings



(Type comments here to appear on printout; maximum 1 row of 90 characters.)

Station Identification		Results			
Cell ID:	0268370	Month	Solar Radiation (kWh/m ² /day)	AC Energy (kWh)	Energy Value (\$)
State:	New Jersey				
Latitude:	40.9 ° N	1	2.65	4890	660.15
Longitude:	74.2 ° W	2	3.47	5792	781.92
PV System Specifications		3	4.83	8595	1160.33
DC Rating:	70.0 kW	4	5.28	8810	1189.35
DC to AC Derate Factor:	0.830	5	5.93	10052	1357.02
AC Rating:	58.1 kW	6	6.32	10093	1362.56
Array Type:	Fixed Tilt	7	5.87	9500	1282.50
Array Tilt:	20.0 °	8	5.55	9044	1220.94
Array Azimuth:	180.0 °	9	5.04	8096	1092.96
Energy Specifications		10	4.14	7119	961.07
Cost of Electricity:	13.5 ¢/kWh	11	2.82	4781	645.44
		12	2.46	4460	602.10
		Year	4.54	91233	12316.45
<input type="button" value="Output Hourly Performance Data"/>		<input type="button" value="Output Results as Text"/>			
(Gridded data is monthly, hourly output not available.)		Saving Text from a Browser			
<input type="button" value="Run PVWATTS v.2 for another location"/>		<input type="button" value="Run PVWATTS v.1"/>			

Please send questions and comments to [Webmaster](#)

[Disclaimer and copyright notice.](#)



RReDC home page (<http://rredc.nrel.gov>)

APPENDIX G

EPA Portfolio Manager



STATEMENT OF ENERGY PERFORMANCE

Woodside Avenue School

Building ID: 3257020

For 12-month Period Ending: May 31, 2012¹

Date SEP becomes ineligible: N/A

Date SEP Generated: August 17, 2012

Facility

Woodside Avenue School
305 Woodside Ave.
Franklin Lakes, NJ 07417

Facility Owner

N/A

Primary Contact for this Facility

N/A

Year Built: 1960**Gross Floor Area (ft²):** 53,400**Energy Performance Rating²** (1-100) 65**Site Energy Use Summary³**

Electricity - Grid Purchase(kBtu)	1,421,576
Natural Gas (kBtu) ⁴	2,436,161
Total Energy (kBtu)	3,857,737

Energy Intensity⁴

Site (kBtu/ft ² /yr)	72
Source (kBtu/ft ² /yr)	137

Emissions (based on site energy use)

Greenhouse Gas Emissions (MtCO ₂ e/year)	259
---	-----

Electric Distribution Utility

Rockland Electric Co [Consolidated Edison Inc]

National Median Comparison

National Median Site EUI	83
National Median Source EUI	157
% Difference from National Median Source EUI	-13%
Building Type	K-12 School

Stamp of Certifying Professional

Based on the conditions observed at the time of my visit to this building, I certify that the information contained within this statement is accurate.

Meets Industry Standards⁵ for Indoor Environmental Conditions:

Ventilation for Acceptable Indoor Air Quality	N/A
Acceptable Thermal Environmental Conditions	N/A
Adequate Illumination	N/A

Certifying Professional

N/A

Notes:

1. Application for the ENERGY STAR must be submitted to EPA within 4 months of the Period Ending date. Award of the ENERGY STAR is not final until approval is received from EPA.
2. The EPA Energy Performance Rating is based on total source energy. A rating of 75 is the minimum to be eligible for the ENERGY STAR.
3. Values represent energy consumption, annualized to a 12-month period.
4. Values represent energy intensity, annualized to a 12-month period.
5. Based on Meeting ASHRAE Standard 62 for ventilation for acceptable indoor air quality, ASHRAE Standard 55 for thermal comfort, and IESNA Lighting Handbook for lighting quality.

ENERGY STAR® Data Checklist for Commercial Buildings

In order for a building to qualify for the ENERGY STAR, a Professional Engineer (PE) or a Registered Architect (RA) must validate the accuracy of the data underlying the building's energy performance rating. This checklist is designed to provide an at-a-glance summary of a property's physical and operating characteristics, as well as its total energy consumption, to assist the PE or RA in double-checking the information that the building owner or operator has entered into Portfolio Manager.

Please complete and sign this checklist and include it with the stamped, signed Statement of Energy Performance.

NOTE: You must check each box to indicate that each value is correct, OR include a note.

CRITERION	VALUE AS ENTERED IN PORTFOLIO MANAGER	VERIFICATION QUESTIONS	NOTES	<input checked="" type="checkbox"/>
Building Name	Woodside Avenue School	Is this the official building name to be displayed in the ENERGY STAR Registry of Labeled Buildings?		<input type="checkbox"/>
Type	K-12 School	Is this an accurate description of the space in question?		<input type="checkbox"/>
Location	305 Woodside Ave., Franklin Lakes, NJ 07417	Is this address accurate and complete? Correct weather normalization requires an accurate zip code.		<input type="checkbox"/>
Single Structure	Single Facility	Does this SEP represent a single structure? SEPs cannot be submitted for multiple-building campuses (with the exception of a hospital, k-12 school, hotel and senior care facility) nor can they be submitted as representing only a portion of a building.		<input type="checkbox"/>
School (K-12 School)				
CRITERION	VALUE AS ENTERED IN PORTFOLIO MANAGER	VERIFICATION QUESTIONS	NOTES	<input checked="" type="checkbox"/>
Gross Floor Area	53,400 Sq. Ft.	Does this square footage include all supporting functions such as kitchens and break rooms used by staff, storage areas, administrative areas, elevators, stairwells, atria, vent shafts, etc. Also note that existing atriums should only include the base floor area that it occupies. Interstitial (plenum) space between floors should not be included in the total. Finally gross floor area is not the same as leasable space. Leasable space is a subset of gross floor area.		<input type="checkbox"/>
Open Weekends?	No (Default)	Is this building normally open at all on the weekends? This includes activities beyond the work conducted by maintenance, cleaning, and security personnel. Weekend activity could include any time when the space is used for classes, performances or other school or community activities. If the building is open on the weekend as part of the standard schedule during one or more seasons, the building should select ?yes? for open weekends. The ?yes? response should apply whether the building is open for one or both of the weekend days.		<input type="checkbox"/>
Number of PCs	93 (Default)	Is this the number of personal computers in the K12 School?		<input type="checkbox"/>
Number of walk-in refrigeration/freezer units	1 (Default)	Is this the total number of commercial walk-in type freezers and coolers? These units are typically found in storage and receiving areas.		<input type="checkbox"/>
Presence of cooking facilities	Yes (Default)	Does this school have a dedicated space in which food is prepared and served to students? If the school has space in which food for students is only kept warm and/or served to students, or has only a galley that is used by teachers and staff then the answer is "no".		<input type="checkbox"/>
Percent Cooled	100 % (Default)	Is this the percentage of the total floor space within the facility that is served by mechanical cooling equipment?		<input type="checkbox"/>
Percent Heated	100 % (Default)	Is this the percentage of the total floor space within the facility that is served by mechanical heating equipment?		<input type="checkbox"/>
Months	N/A(Optional)	Is this school in operation for at least 8 months of the year?		<input type="checkbox"/>

High School?	No	Is this building a high school (teaching grades 10, 11, and/or 12)? If the building teaches to high school students at all, the user should check 'yes' to 'high school'. For example, if the school teaches to grades K-12 (elementary/middle and high school), the user should check 'yes' to 'high school'.	<input type="checkbox"/>
--------------	----	--	--------------------------

ENERGY STAR® Data Checklist for Commercial Buildings

Energy Consumption

Power Generation Plant or Distribution Utility: Rockland Electric Co [Consolidated Edison Inc]

Fuel Type: Electricity		
Meter: Electricity (kWh (thousand Watt-hours)) Space(s): Entire Facility Generation Method: Grid Purchase		
Start Date	End Date	Energy Use (kWh (thousand Watt-hours))
05/01/2012	05/31/2012	36,240.00
04/01/2012	04/30/2012	30,480.00
03/01/2012	03/31/2012	28,560.00
02/01/2012	02/29/2012	28,800.00
01/01/2012	01/31/2012	34,560.00
12/01/2011	12/31/2011	29,760.00
11/01/2011	11/30/2011	33,817.00
10/01/2011	10/31/2011	30,743.00
09/01/2011	09/30/2011	37,200.00
08/01/2011	08/31/2011	38,400.00
07/01/2011	07/31/2011	41,280.00
06/01/2011	06/30/2011	46,800.00
Electricity Consumption (kWh (thousand Watt-hours))		416,640.00
Electricity Consumption (kBtu (thousand Btu))		1,421,575.68
Total Electricity (Grid Purchase) Consumption (kBtu (thousand Btu))		1,421,575.68
Is this the total Electricity (Grid Purchase) consumption at this building including all Electricity meters?		<input type="checkbox"/>
Fuel Type: Natural Gas		
Meter: Natural Gas (therms) Space(s): Entire Facility		
Start Date	End Date	Energy Use (therms)
05/01/2012	05/31/2012	67.29
04/01/2012	04/30/2012	991.23
03/01/2012	03/31/2012	2,345.09
02/01/2012	02/29/2012	5,570.66
01/01/2012	01/31/2012	5,556.48
12/01/2011	12/31/2011	5,380.34
11/01/2011	11/30/2011	3,423.88
10/01/2011	10/31/2011	868.15
09/01/2011	09/30/2011	67.69
08/01/2011	08/31/2011	56.00

07/01/2011	07/31/2011	34.80
06/01/2011	06/30/2011	0.00
Natural Gas Consumption (therms)		24,361.61
Natural Gas Consumption (kBtu (thousand Btu))		2,436,161.00
Total Natural Gas Consumption (kBtu (thousand Btu))		2,436,161.00
Is this the total Natural Gas consumption at this building including all Natural Gas meters?		<input type="checkbox"/>

Additional Fuels

Do the fuel consumption totals shown above represent the total energy use of this building?
Please confirm there are no additional fuels (district energy, generator fuel oil) used in this facility.

☐

On-Site Solar and Wind Energy

Do the fuel consumption totals shown above include all on-site solar and/or wind power located at your facility? Please confirm that no on-site solar or wind installations have been omitted from this list. All on-site systems must be reported.

☐

Certifying Professional

(When applying for the ENERGY STAR, the Certifying Professional must be the same PE or RA that signed and stamped the SEP.)

Name: _____ Date: _____

Signature: _____

Signature is required when applying for the ENERGY STAR.

FOR YOUR RECORDS ONLY. DO NOT SUBMIT TO EPA.

Please keep this Facility Summary for your own records; do not submit it to EPA. Only the Statement of Energy Performance (SEP), Data Checklist and Letter of Agreement need to be submitted to EPA when applying for the ENERGY STAR.

Facility
Woodside Avenue School
305 Woodside Ave.
Franklin Lakes, NJ 07417

Facility Owner
N/A

Primary Contact for this Facility
N/A

General Information

Woodside Avenue School	
Gross Floor Area Excluding Parking: (ft ²)	53,400
Year Built	1960
For 12-month Evaluation Period Ending Date:	May 31, 2012

Facility Space Use Summary

School	
Space Type	K-12 School
Gross Floor Area (ft ²)	53,400
Open Weekends? ^d	No
Number of PCs ^d	93
Number of walk-in refrigeration/freezer units ^d	1
Presence of cooking facilities ^d	Yes
Percent Cooled ^d	100
Percent Heated ^d	100
Months ^o	N/A
High School?	No
School District ^o	N/A

Energy Performance Comparison

Performance Metrics	Evaluation Periods		Comparisons		
	Current (Ending Date 05/31/2012)	Baseline (Ending Date 05/31/2012)	Rating of 75	Target	National Median
Energy Performance Rating	65	65	75	N/A	50
Energy Intensity					
Site (kBtu/ft ²)	72	72	65	N/A	83
Source (kBtu/ft ²)	137	137	123	N/A	157
Energy Cost					
\$/year	\$ 76,099.04	\$ 76,099.04	\$ 68,419.61	N/A	\$ 87,486.51
\$/ft ² /year	\$ 1.43	\$ 1.43	\$ 1.29	N/A	\$ 1.64
Greenhouse Gas Emissions					
MtCO ₂ e/year	259	259	233	N/A	298
kgCO ₂ e/ft ² /year	5	5	5	N/A	6

More than 50% of your building is defined as K-12 School. Please note that your rating accounts for all of the spaces listed. The National Median column presents energy performance data your building would have if your building had a median rating of 50.

Notes:

o - This attribute is optional.

d - A default value has been supplied by Portfolio Manager.


Statement of Energy Performance

2012

Woodside Avenue School
305 Woodside Ave.
Franklin Lakes, NJ 07417

Portfolio Manager Building ID: 3257020

The energy use of this building has been measured and compared to other similar buildings using the Environmental Protection Agency's (EPA's) Energy Performance Scale of 1–100, with 1 being the least energy efficient and 100 the most energy efficient. For more information, visit energystar.gov/benchmark.

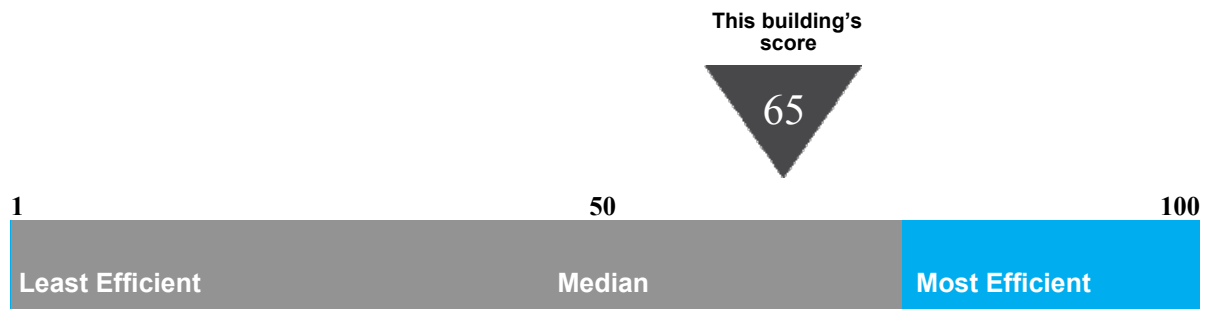

This building uses 137 kBtu per square foot per year.*

*Based on source energy intensity for the 12 month period ending May 2012

Buildings with a score of
75 or higher may qualify
for EPA's ENERGY STAR.

I certify that the information contained within this statement is accurate and in accordance with U.S.
Environmental Protection Agency's measurement standards, found at energystar.gov

Date of certification

