


FOUR OF COMMERCIAL GAS MODELS

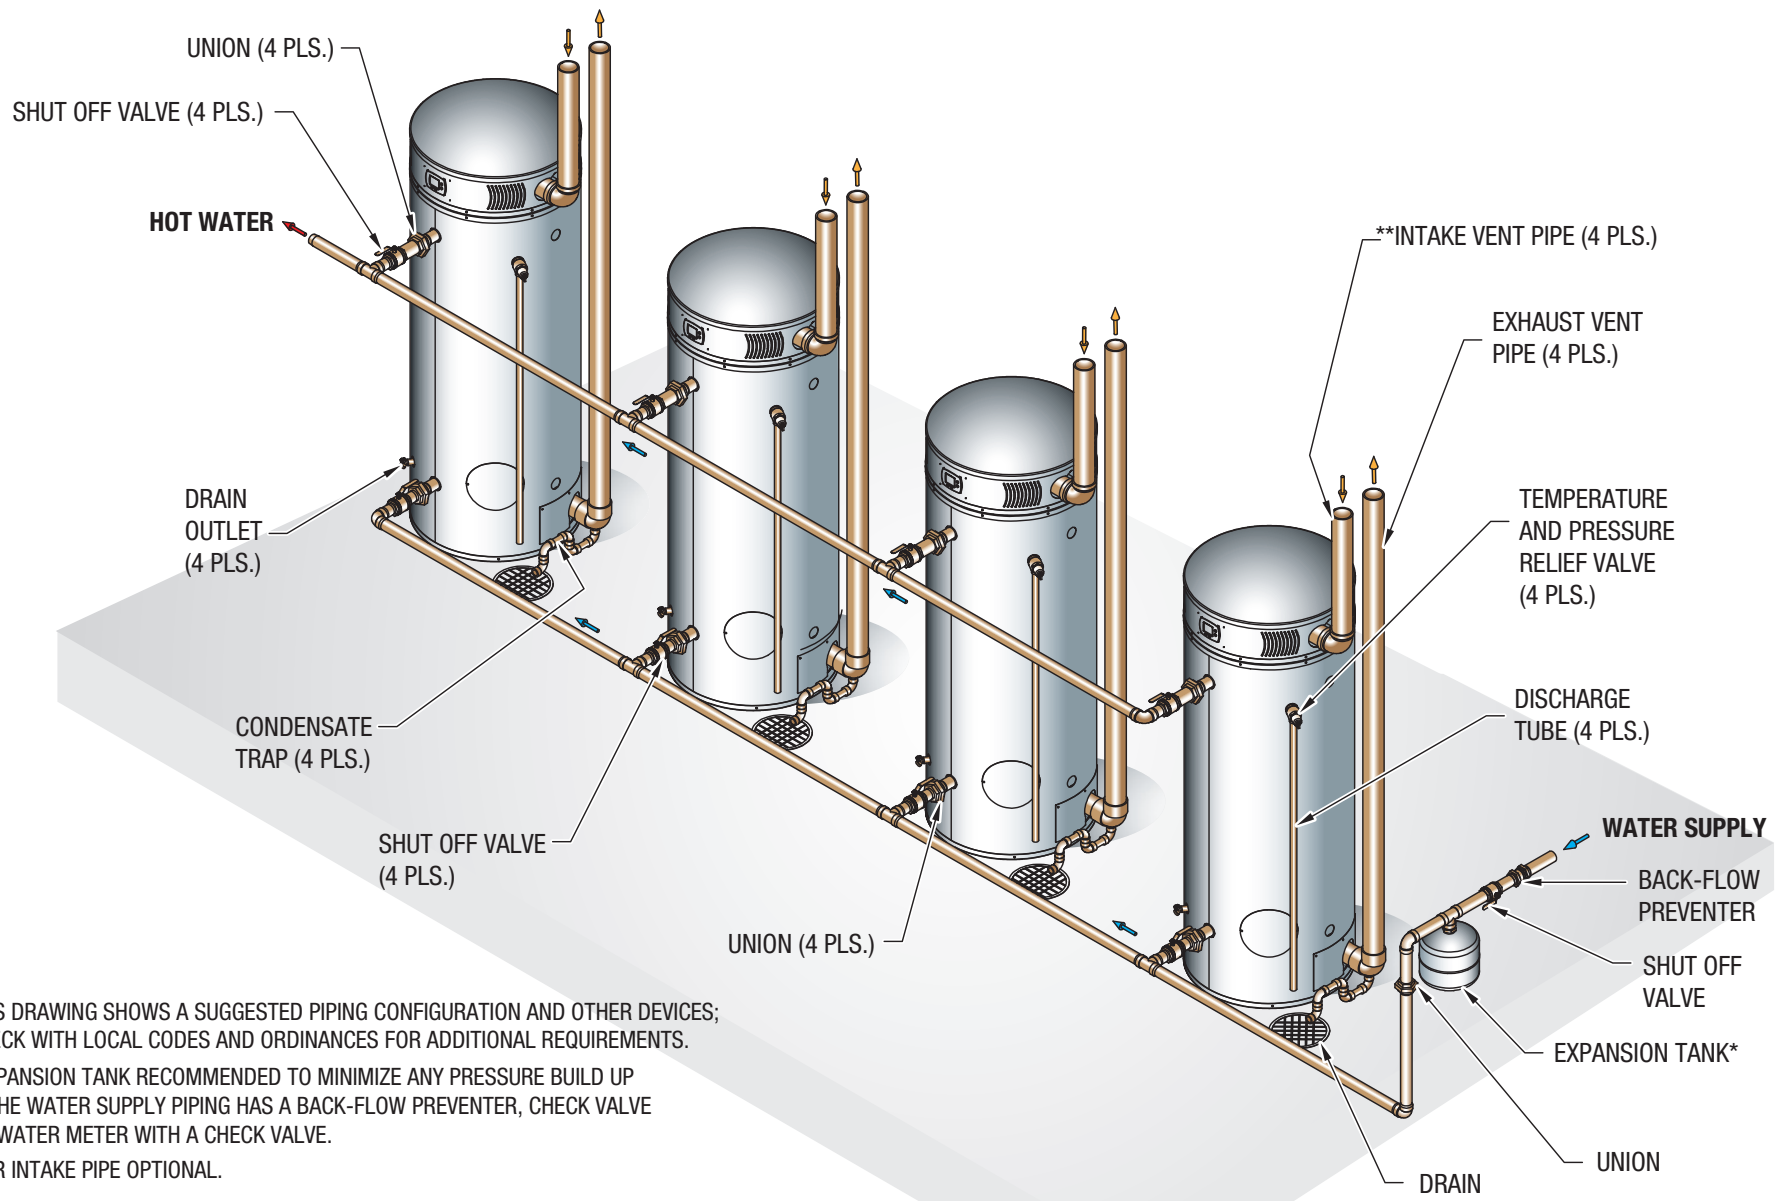

THIS DRAWING SHOWS A SUGGESTED PIPING CONFIGURATION AND OTHER DEVICES;
CHECK WITH LOCAL CODES AND ORDINANCES FOR ADDITIONAL REQUIREMENTS.

*EXPANSION TANK RECOMMENDED TO MINIMIZE ANY PRESSURE BUILD UP
IF THE WATER SUPPLY PIPING HAS A BACK-FLOW PREVENTER, CHECK VALVE
OR WATER METER WITH A CHECK VALVE.

**AIR INTAKE PIPE OPTIONAL.