


FLOOR PLAN NOTES

- 1. ALL DIMENSIONS TO INTERIOR WALLS ARE TO FACE OF STUD. 2. ALL DIMENSIONS TO OUTSIDE FACE OF EXTERIOR WALLS ARE
- TO OUTSIDE FACE OF SHEATHING. ALL DIMENSIONS TO INSIDE FACE OF EXTERIOR WALL ARE TO FACE OF STUD.
- 3. ALL INTERIOR STUD WALLS TO BE 2x4 STUDS @ 16" O.C., U.NO. 4. ALL DOORS SHALL BE 6" FROM ADJACENT WALL OR CENTERED IN WALL U.N.O. . BEDROOM WINDOWS SHALL MEET THE REQUIREMENTS OF
- 2019 RCO CHAPTER 311 FOR FOR EGRESS. EGRESS CLEAR OPENINGS ON GRADE FLOOR SHALL BE A MINIMUM OF 5.0 SQUARE FEET. EGRESS CLEAR OPENINGS ON ALL OTHER FLOORS SHALL BE A MINIMUM OF 5.7 SQUARE FEET.
- 6. EGRESS WINDOWS TO HAVE A MINIMUM CLEAR HEIGHT OF 24" AND A MINIMUM CLEAR OPENING WIDTH OF 20". WINDOW SILL HEIGHT SHALL NOT EXCEED 44" ABOVE THE FINISH FLOOR. ALL ANGLED WALLS ARE 45 DEGREES U.N.O.
- 8. ALL WOOD IN LOCATIONS SUBJECT TO TERMITE DECAY SHALL BE PRESSURE TREATED OR BE OF AN APPROVED DECAY RESISTANT SPECIES. THIS INCLUDES, BUT NOT LIMITED TO, ALL EXTERIOR DECKS, SILLS AND SLEEPERS ON CONCRETE, MASONRY, OR IN DIRECT CONTACT WITH THE GROUND.
- . SMOKE DETECTORS SHALL BE INSTALLED INSIDE EACH BEDROOM, OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS AND ON EACH FLOOR, INCLUDING THE BASEMENT. THE SMOKE DETECTORS SHALL BE HARDWIRED WITH BATTERY BACKUP AND CONNECTED TOGETHER. ALL SMOKE ALARMS TO USE IONIZATION AND PHOTOELECTRIC TECHNOLOGY ON ALL LEVELS. SMOKE
- ALARMS OUTSIDE OF BEDROOMS TO USE PHOTOELECTRIC TECHNOLOGY 10. FIRE STOPPING SHALL BE PROVIDED TO CUT OFF ALL CONCEALED DRAFT OPENINGS (VERTICAL AND HORIZONTAL) AND TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES
- AND BETWEEN STORIES AND ROOF. 11. LVL SHEETS TO BE PROVIDED AT FRAMING INSPECTION. 12. BLOCK ALL BEARING POINTS TO BEAM OR TO FOUNDATION. 13. ALL VERTICAL AND HORIZONTAL JOINTS IN THE EXTERIOR WALL SHEATHING ARE TO FALL ON A STUD, PLATE, BAND

## DOOR LEGEND

BOARD OR 2x BLOCKING

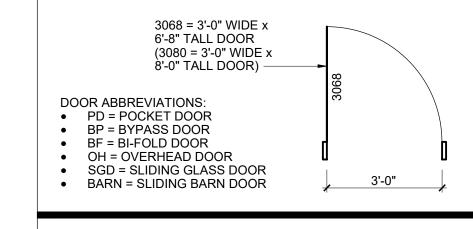

## STRUCTURAL LEGEND

N .	
TRUSS / JOIST / RAFTER INDICATOR	
DIRECTION OF SPAN	
EXTENTS OF STRUCTURE	
SOLID BLOCKING	
STEEL BEAM (SEE PLAN FOR SIZE)	
HEADER / BEAM (SEE PLAN FOR SIZE)	
GIRDER TRUSS (SEE TRUSS MANF DWGS)	
O───── STEEL COLUMN (SEE PLAN FOR SIZE)	
POINT LOAD LOCATION	
●── POINT LOAD FROM ABOVE	
SEE SHEET A4-1 FOR GENERAL STRUCTURAL NOTES	
ALL LV/LAND 2× MOOD REAMS: (D) = DRODDED (E) = ELLISH	
ALL LVL AND 2X WOOD BEAWS. (D) - DROPPED. (F) - FLOSH	l
ALL HEADERS AND BEAMS TO BEAR ON MINIMUM (1) KING STU (KS) & (1) JACK STUD (JS) EACH SIDE OF OPENING, U.N.O.	JD
	DIRECTION OF SPAN EXTENTS OF STRUCTURE  SOLID BLOCKING STEEL BEAM (SEE PLAN FOR SIZE) HEADER / BEAM (SEE PLAN FOR SIZE) GIRDER TRUSS (SEE TRUSS MANF DWGS) STEEL COLUMN (SEE PLAN FOR SIZE) POINT LOAD LOCATION POINT LOAD FROM ABOVE  SEE SHEET A4-1 FOR GENERAL STRUCTURAL NOTES  ALL LVL AND 2x WOOD BEAMS: (D) = DROPPED. (F) = FLUSH  ALL HEADERS AND BEAMS TO BEAR ON MINIMUM (1) KING STU

	#	DATE	ISSUED WITH: CHANGE DESCRIPTION






SCALE: 1/4" = 1'-0" SHEET # / DESCRIPTION

FIRST FLOOR PLAN

DATE: 12.20.2025




SCOTT SBAKER, LICENSE #14654
EXPURATION DATE 12/31/2027

SBA STUDIOS PROJECT # 2025-544

FIRST FLOOR PLAN


2,472 S.F.

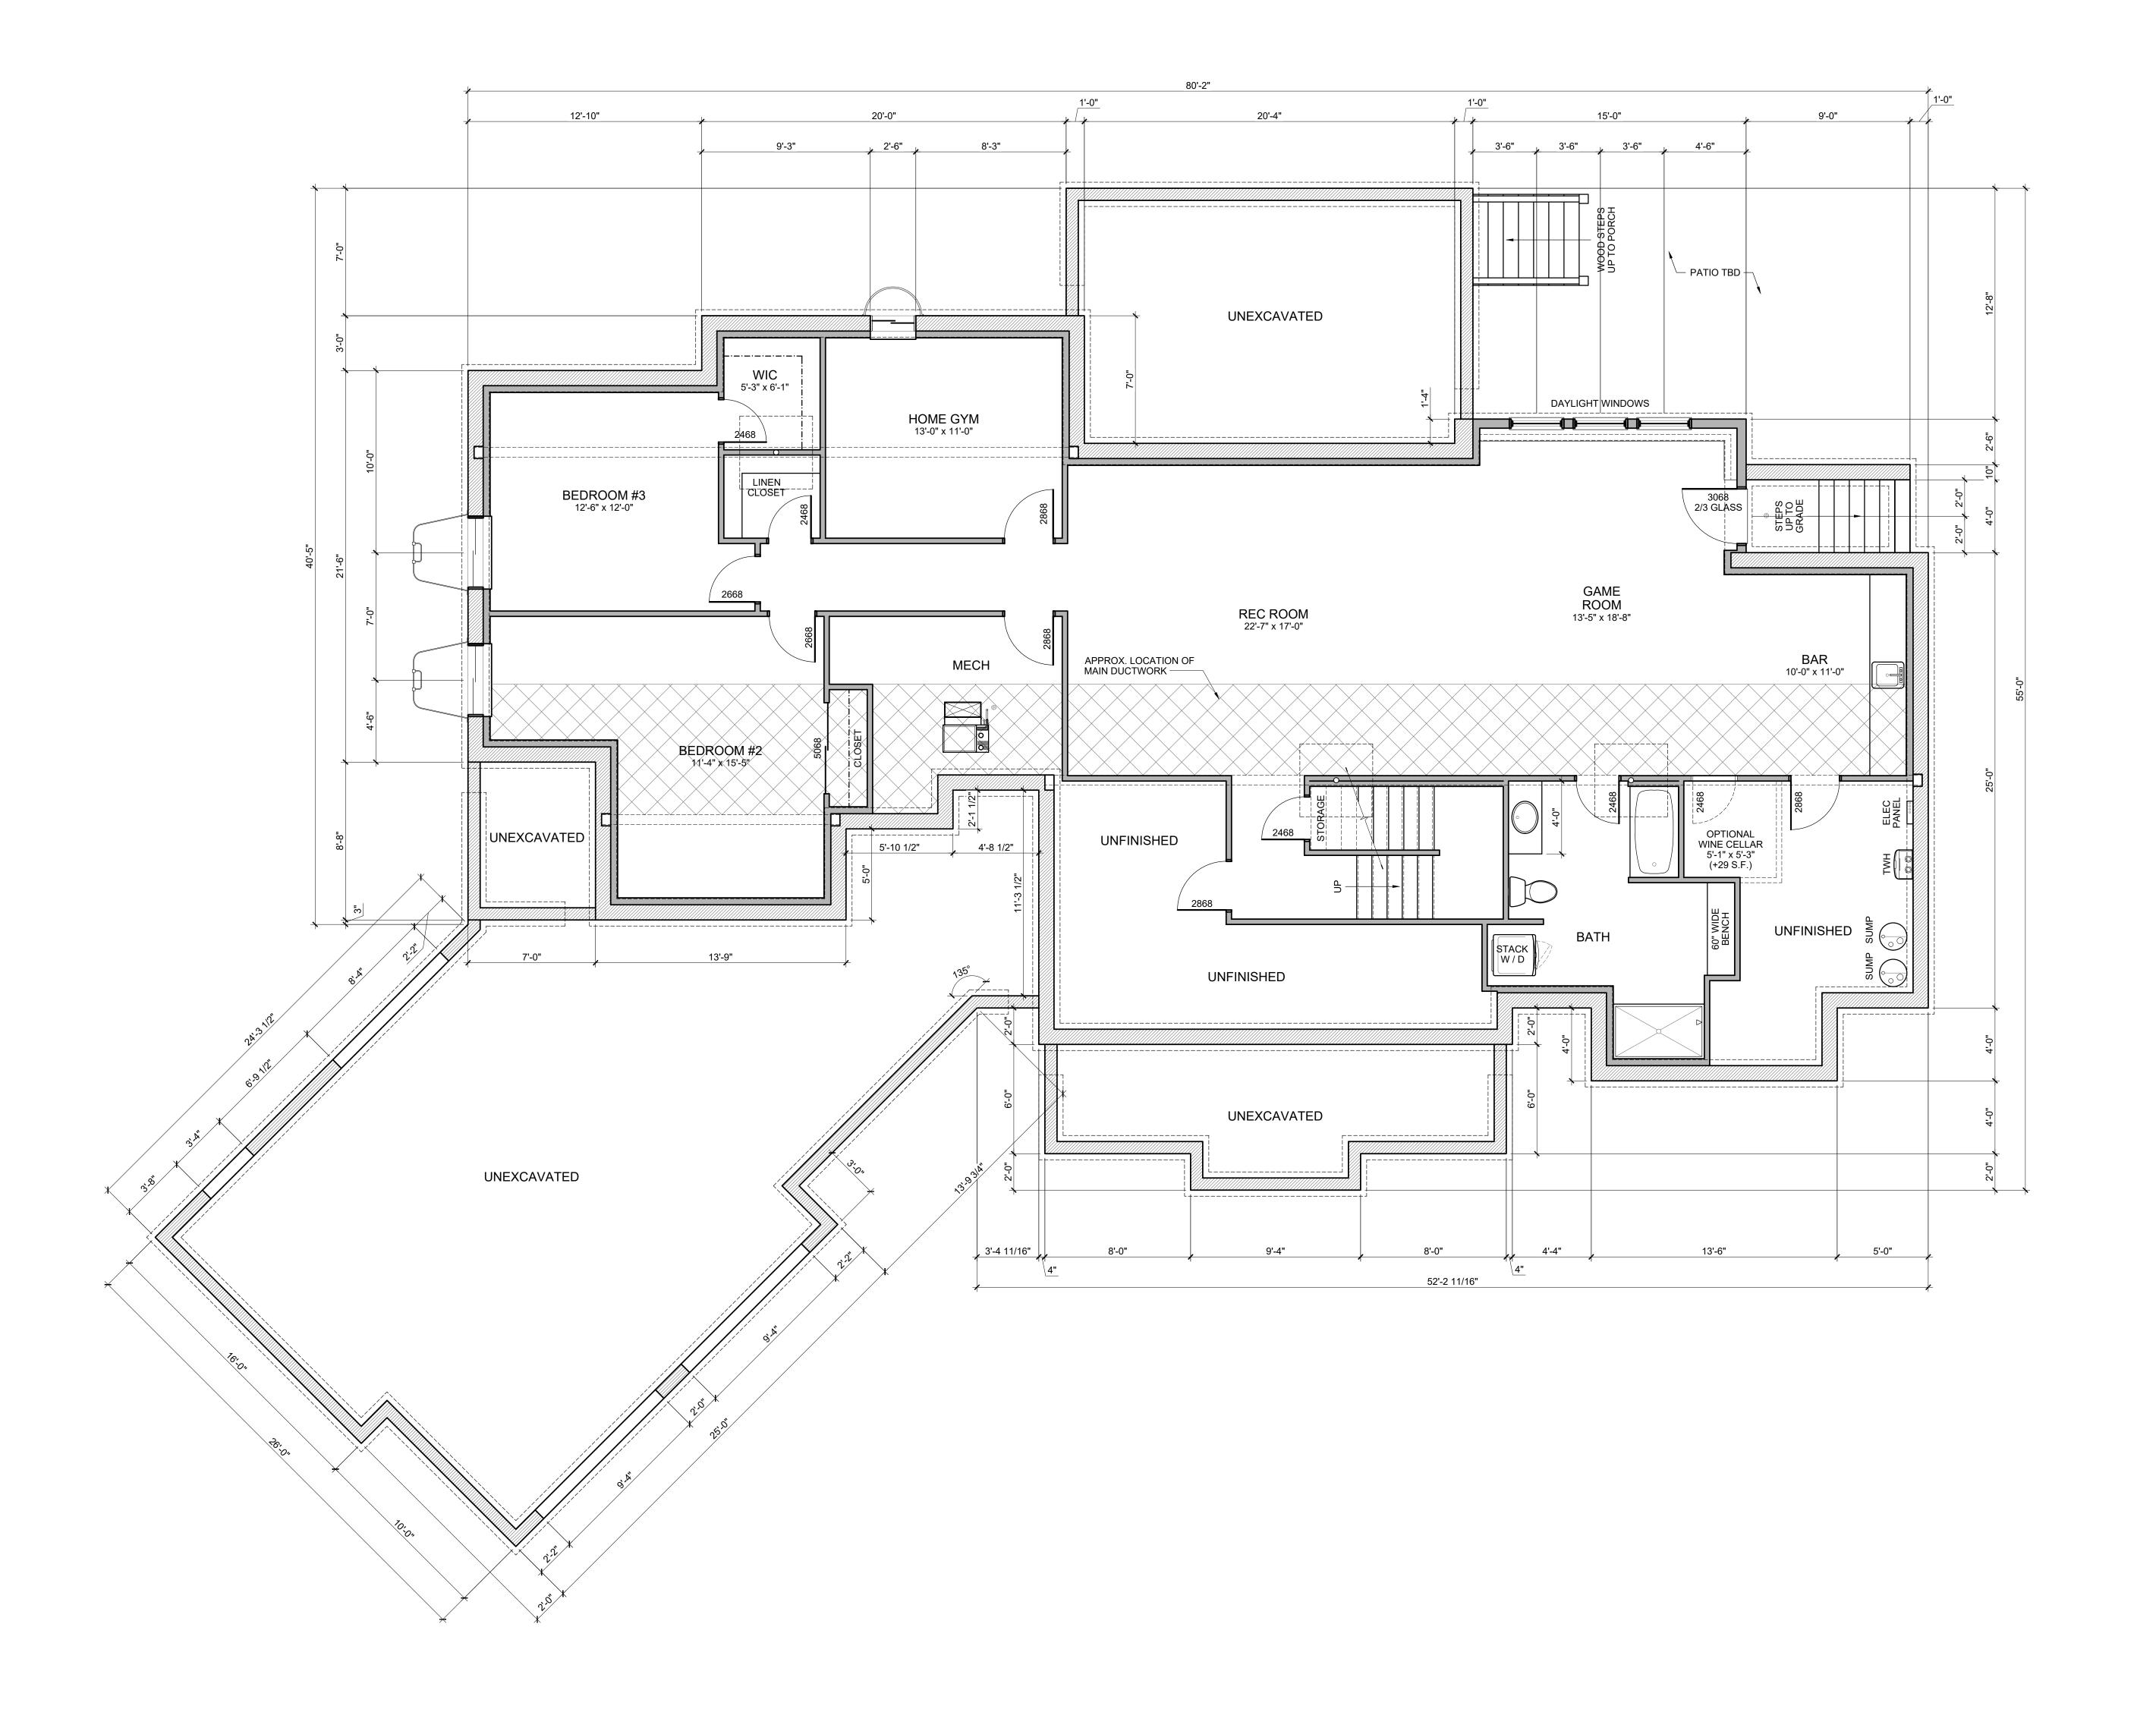

FLOOR PLAN NOTES

- 1. ALL DIMENSIONS TO INTERIOR WALLS ARE TO FACE OF STUD. 2. ALL DIMENSIONS TO OUTSIDE FACE OF EXTERIOR WALLS ARE
- TO OUTSIDE FACE OF SHEATHING. ALL DIMENSIONS TO INSIDE FACE OF EXTERIOR WALL ARE TO FACE OF STUD.
- 3. ALL INTERIOR STUD WALLS TO BE 2x4 STUDS @ 16" O.C., U.NO. 4. ALL DOORS SHALL BE 6" FROM ADJACENT WALL OR CENTERED IN WALL U.N.O. . BEDROOM WINDOWS SHALL MEET THE REQUIREMENTS OF 2019 RCO CHAPTER 311 FOR FOR EGRESS. EGRESS CLEAR
- OPENINGS ON GRADE FLOOR SHALL BE A MINIMUM OF 5.0 SQUARE FEET. EGRESS CLEAR OPENINGS ON ALL OTHER FLOORS SHALL BE A MINIMUM OF 5.7 SQUARE FEET.
- 6. EGRESS WINDOWS TO HAVE A MINIMUM CLEAR HEIGHT OF 24" AND A MINIMUM CLEAR OPENING WIDTH OF 20". WINDOW SILL HEIGHT SHALL NOT EXCEED 44" ABOVE THE FINISH FLOOR. ALL ANGLED WALLS ARE 45 DEGREES U.N.O.
- 8. ALL WOOD IN LOCATIONS SUBJECT TO TERMITE DECAY SHALL BE PRESSURE TREATED OR BE OF AN APPROVED DECAY RESISTANT SPECIES. THIS INCLUDES, BUT NOT LIMITED TO, ALL EXTERIOR DECKS, SILLS AND SLEEPERS ON CONCRETE, MASONRY, OR IN DIRECT CONTACT WITH THE GROUND. 9. SMOKE DETECTORS SHALL BE INSTALLED INSIDE EACH
- BEDROOM, OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS AND ON EACH FLOOR, INCLUDING THE BASEMENT. THE SMOKE DETECTORS SHALL BE HARDWIRED WITH BATTERY BACKUP AND CONNECTED TOGETHER. ALL SMOKE ALARMS TO USE IONIZATION AND PHOTOELECTRIC TECHNOLOGY ON ALL LEVELS. SMOKE ALARMS OUTSIDE OF BEDROOMS TO USE PHOTOELECTRIC
- TECHNOLOGY 10. FIRE STOPPING SHALL BE PROVIDED TO CUT OFF ALL CONCEALED DRAFT OPENINGS (VERTICAL AND HORIZONTAL) AND TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES AND BETWEEN STORIES AND ROOF.
- 11. LVL SHEETS TO BE PROVIDED AT FRAMING INSPECTION. 12. BLOCK ALL BEARING POINTS TO BEAM OR TO FOUNDATION. 13. ALL VERTICAL AND HORIZONTAL JOINTS IN THE EXTERIOR WALL SHEATHING ARE TO FALL ON A STUD, PLATE, BAND BOARD OR 2x BLOCKING

## DOOR LEGEND

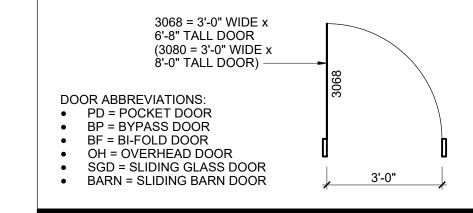

## STRUCTURAL LEGEND

	TRUSS / JOIST / RAFTER INDICATOR  — DIRECTION OF SPAN  — EXTENTS OF STRUCTURE
2//////// <del>-</del>	— SOLID BLOCKING
□ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □	— STEEL BEAM (SEE PLAN FOR SIZE)
	— HEADER / BEAM (SEE PLAN FOR SIZE)
	— GIRDER TRUSS (SEE TRUSS MANF DWGS)
0-	— STEEL COLUMN (SEE PLAN FOR SIZE)
•	— POINT LOAD LOCATION

■ POINT LOAD FROM ABOVE

SEE SHEET A4-1 FOR GENERAL STRUCTURAL NOTES ALL LVL AND 2x WOOD BEAMS: (D) = DROPPED. (F) = FLUSH ALL HEADERS AND BEAMS TO BEAR ON MINIMUM (1) KING STUD (KS) & (1) JACK STUD (JS) EACH SIDE OF OPENING, U.N.O.

	#	DATE	ISSUED WITH: CHANGE DESCRIPTION





SCALE: 1/4" = 1'-0" SHEET # / DESCRIPTION

FIN. BASEMENT PLAN

DATE: 12.20.2025




FINISHED BASEMENT PLAN 1,804 S.F. FINISHED BASEMENT







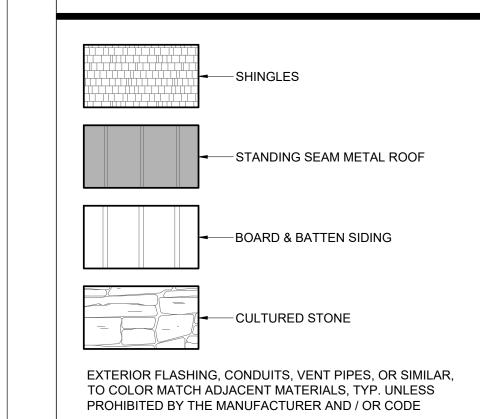

# DATE ISSUED WITH: CHANGE DESCRIPTION

BUILDERS ——— EST. 1962 ———





SCALE: 1/4" = 1'-0" SHEET # / DESCRIPTION EXTERIOR ELEVATIONS DATE: 12.20.2025