


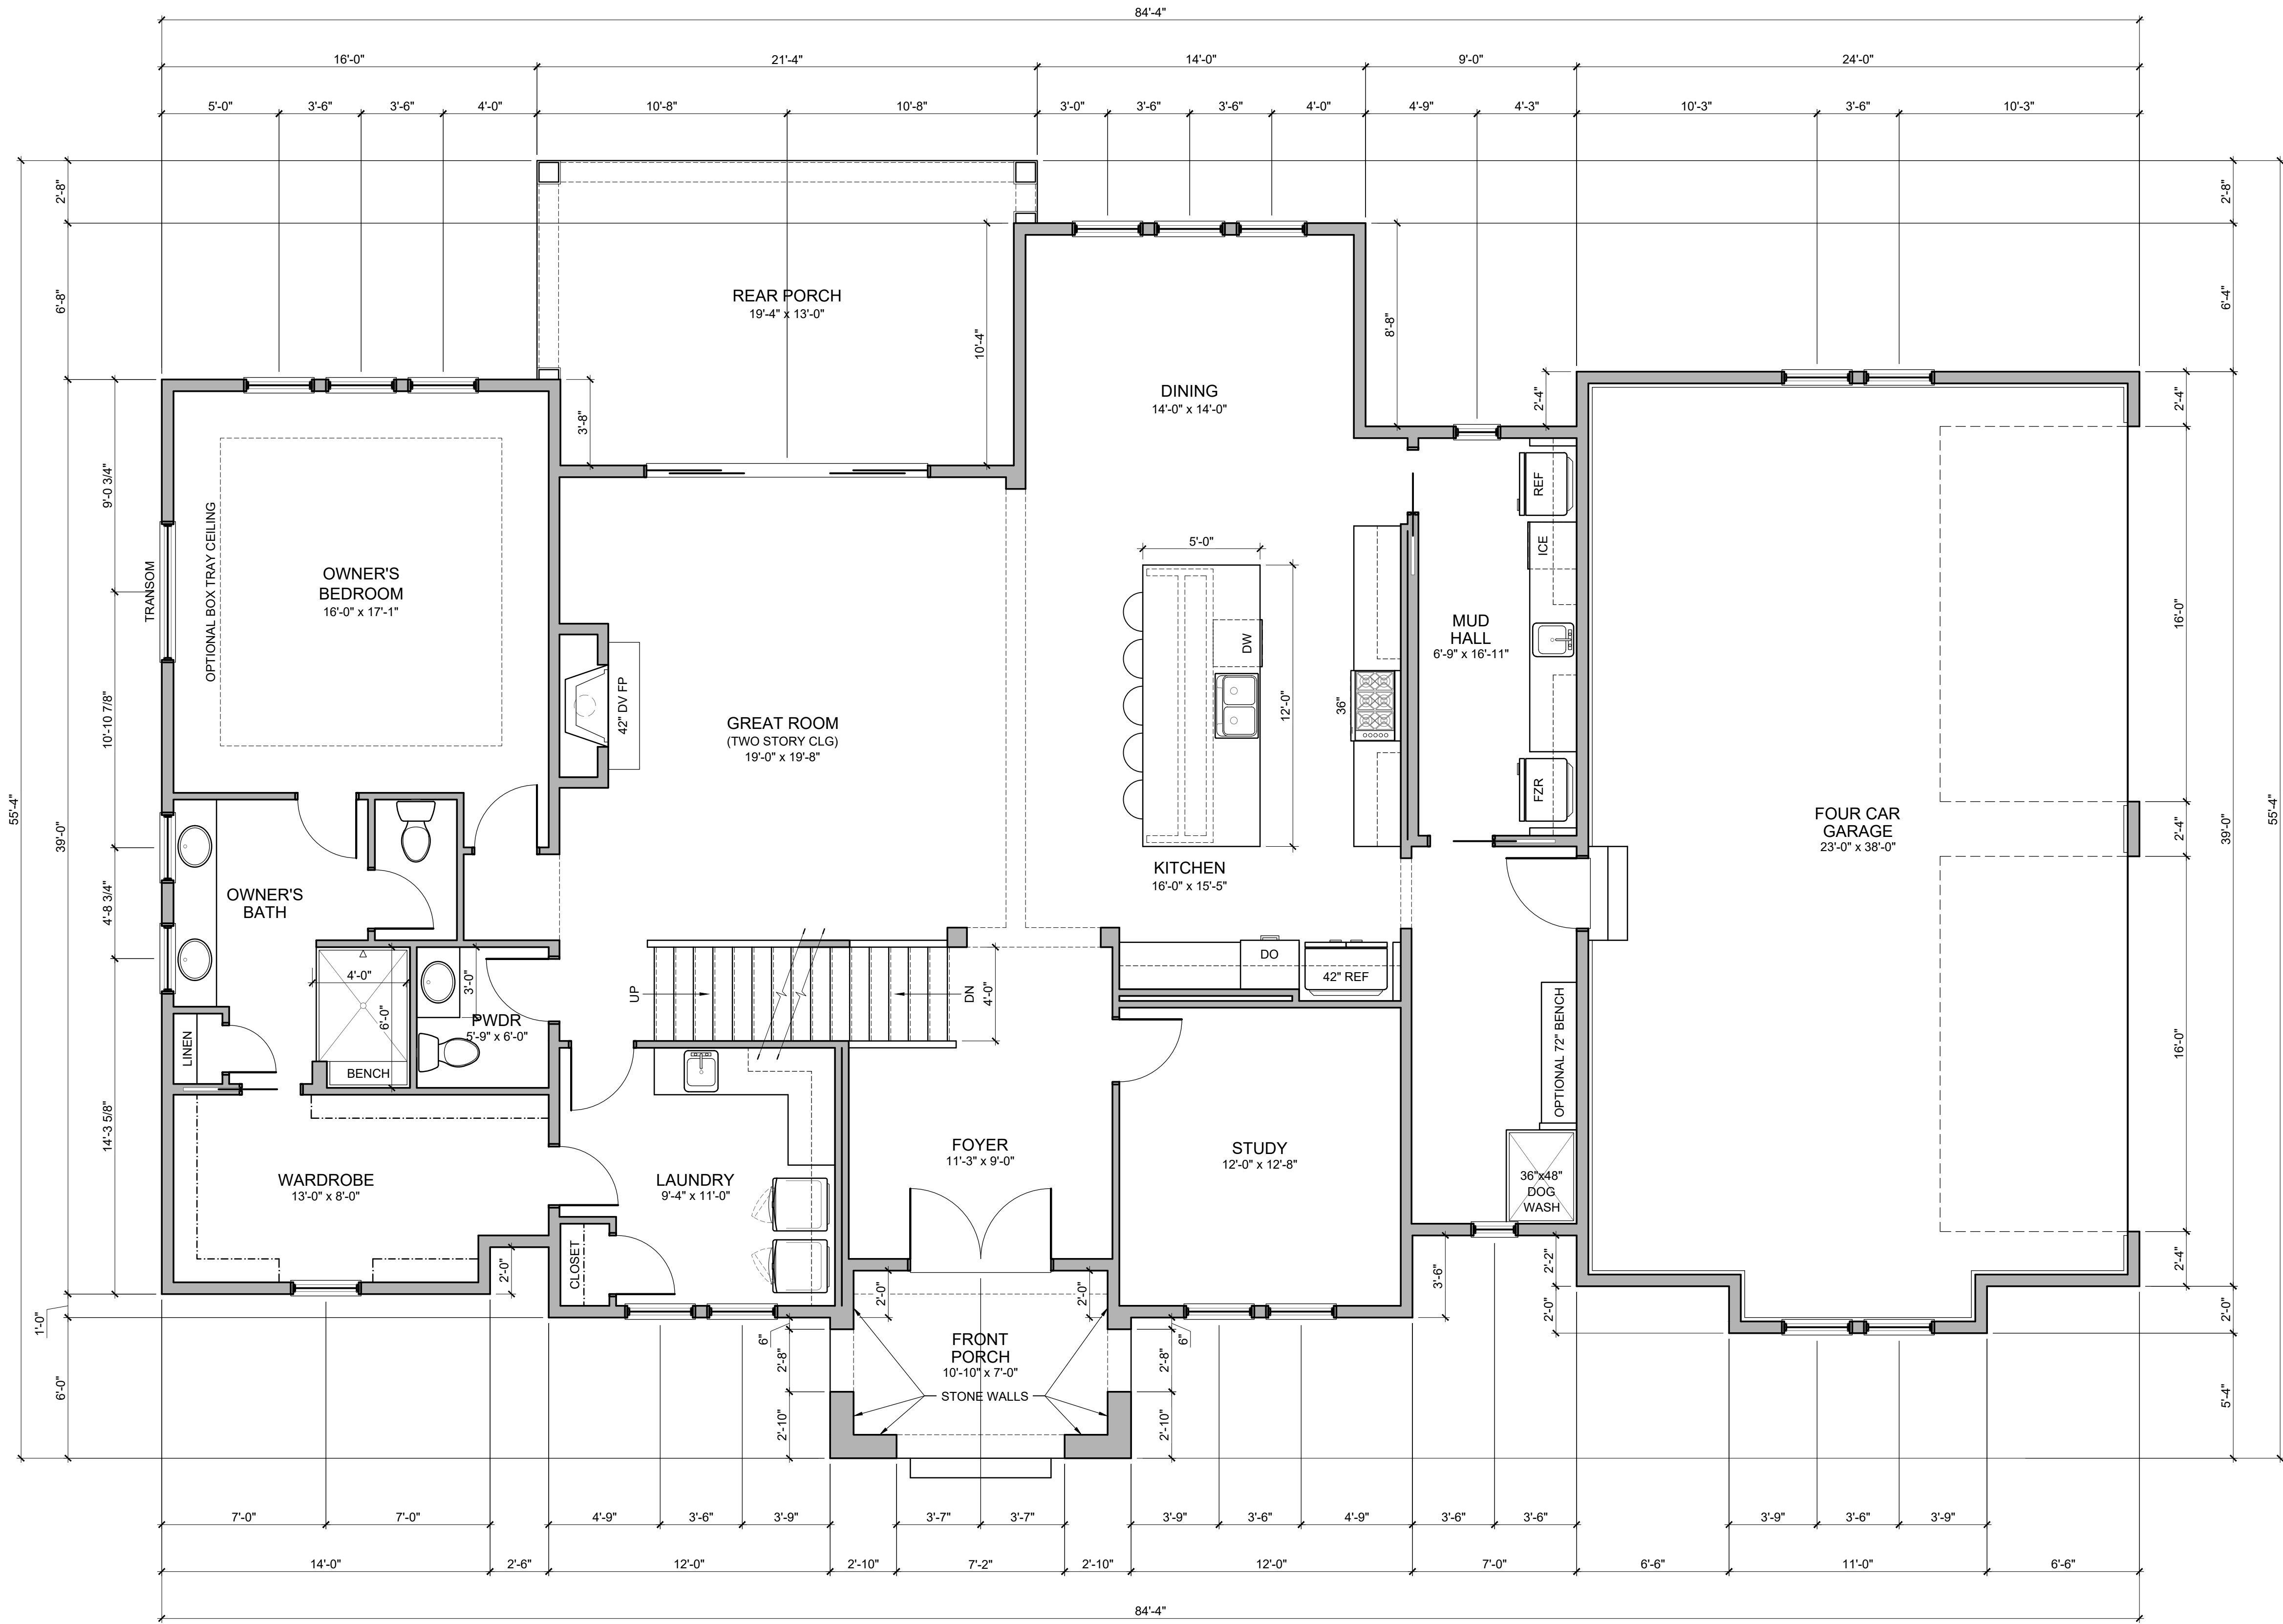

FLOOR PLAN NOTES

1. ALL DIMENSIONS TO INTERIOR WALLS ARE TO FACE OF STUD.
2. ALL DIMENSIONS TO OUTSIDE FACE OF EXTERIOR WALLS ARE TO OUTSIDE FACE OF SHEATHING. DIMENSIONS TO INSIDE FACE OF EXTERIOR WALL ARE TO FACE OF STUD.
3. ALL INTERIOR STUD WALLS TO BE 2x4 STUDS @ 16" O.C., U.N.O.
4. ALL DOORS SHALL BE 6" FROM ADJACENT WALL OR CENTERED IN WALL, U.N.O.
5. BEDROOM WINDOWS SHALL MEET 2019 RCO CHAPTER 311 EGRESS REQUIREMENTS. CLEAR OPENINGS: GRADE FLOOR MIN. 5.0 SF, OTHER FLOORS MIN. 5.7 SF.
6. EGRESS WINDOWS SHALL HAVE MIN. 24" CLEAR HEIGHT AND 20" MIN. CLEAR WIDTH. WINDOW SILL SHALL NOT EXCEED 44" ABOVE FINISH FLOOR.
7. ALL ANGLED WALLS ARE 45° U.N.O.
8. ALL WOOD IN LOCATIONS SUBJECT TO TERMITE OR DECAY SHALL BE PRESSURE TREATED OR APPROVED DECAY-RESISTANT SPECIES, INCLUDING EXTERIOR DECKS, SILLS, AND SLEEPERS ON CONCRETE, MASONRY, OR IN GROUND CONTACT.
9. SMOKE DETECTORS SHALL BE INSTALLED INSIDE EACH BEDROOM, OUTSIDE EACH SLEEPING AREA, AND ON EACH FLOOR, INCLUDING BASEMENT. DETECTORS SHALL BE HARDWIRED WITH BATTERY BACKUP AND INTERCONNECTED. USE IONIZATION AND PHOTOELECTRIC TECHNOLOGY IN BEDROOMS, PHOTOELECTRIC ELSEWHERE.
10. FIRE STOPPING SHALL SEAL ALL CONCEALED VERTICAL AND HORIZONTAL OPENINGS TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES, WITHIN WALLS, AND WITHIN CEILING OR SOFFIT CAVITIES PER RCO 302.11.
11. LVL SHEETS TO BE PROVIDED AT FRAMING INSPECTION.
12. BLOCK ALL BEARING POINTS TO BEAMS OR FOUNDATION.
13. ALL VERTICAL AND HORIZONTAL JOINTS IN EXTERIOR WALL SHEATHING SHALL FALL ON A STUD, PLATE, BAND BOARD, OR 2x BLOCKING.

DOOR LEGEND

3068 = 3'-0" WIDE x 6'-8" TALL DOOR
(3080 = 3'-0" WIDE x 8'-0" TALL DOOR)

DOOR ABBREVIATIONS:

- PD = POCKET DOOR
- BP = BYPASS DOOR
- BF = BI-FOLD DOOR
- OH = OVERHEAD DOOR
- SGD = SLIDING GLASS DOOR
- BARN = SLIDING BARN DOOR

STRUCTURAL LEGEND

TRUSS / JOIST / RAFTER INDICATOR
DIRECTION OF SPAN
EXTENTS OF STRUCTURE

SOLID BLOCKING
STEEL BEAM (SEE PLAN FOR SIZE)
HEADER / BEAM (SEE PLAN FOR SIZE)
GIRDER TRUSS (SEE TRUSS MANF DWGS)
STEEL COLUMN (SEE PLAN FOR SIZE)
POINT LOAD LOCATION
POINT LOAD FROM ABOVE

SEE SHEET A4-1 FOR GENERAL STRUCTURAL NOTES

ALL LVL AND 2x WOOD BEAMS: (D) = DROPPED, (F) = FLUSH


ALL HEADERS AND BEAMS TO BEAR ON MINIMUM (1) KING STUD (KS) & (1) JACK STUD (JS) EACH SIDE OF OPENING, U.N.O.

#	DATE	ISSUED WITH: CHANGE DESCRIPTION

P&D BUILDERS
EST. 1962

SBA STUDIOS
ARCHITECTURAL DESIGN
614.562.7761 WWW.SBA-STUDIOS.COM

SCALE: 1/4" = 1'-0"
SHEET # / DESCRIPTION
FIRST FLOOR PLAN
A1-1
DATE: 08.13.2026
QTO
SCOTT B. BAKER, LICENSE #14654
EXPIRATION DATE 12/31/2027
SBA STUDIOS PROJECT # 2026-350

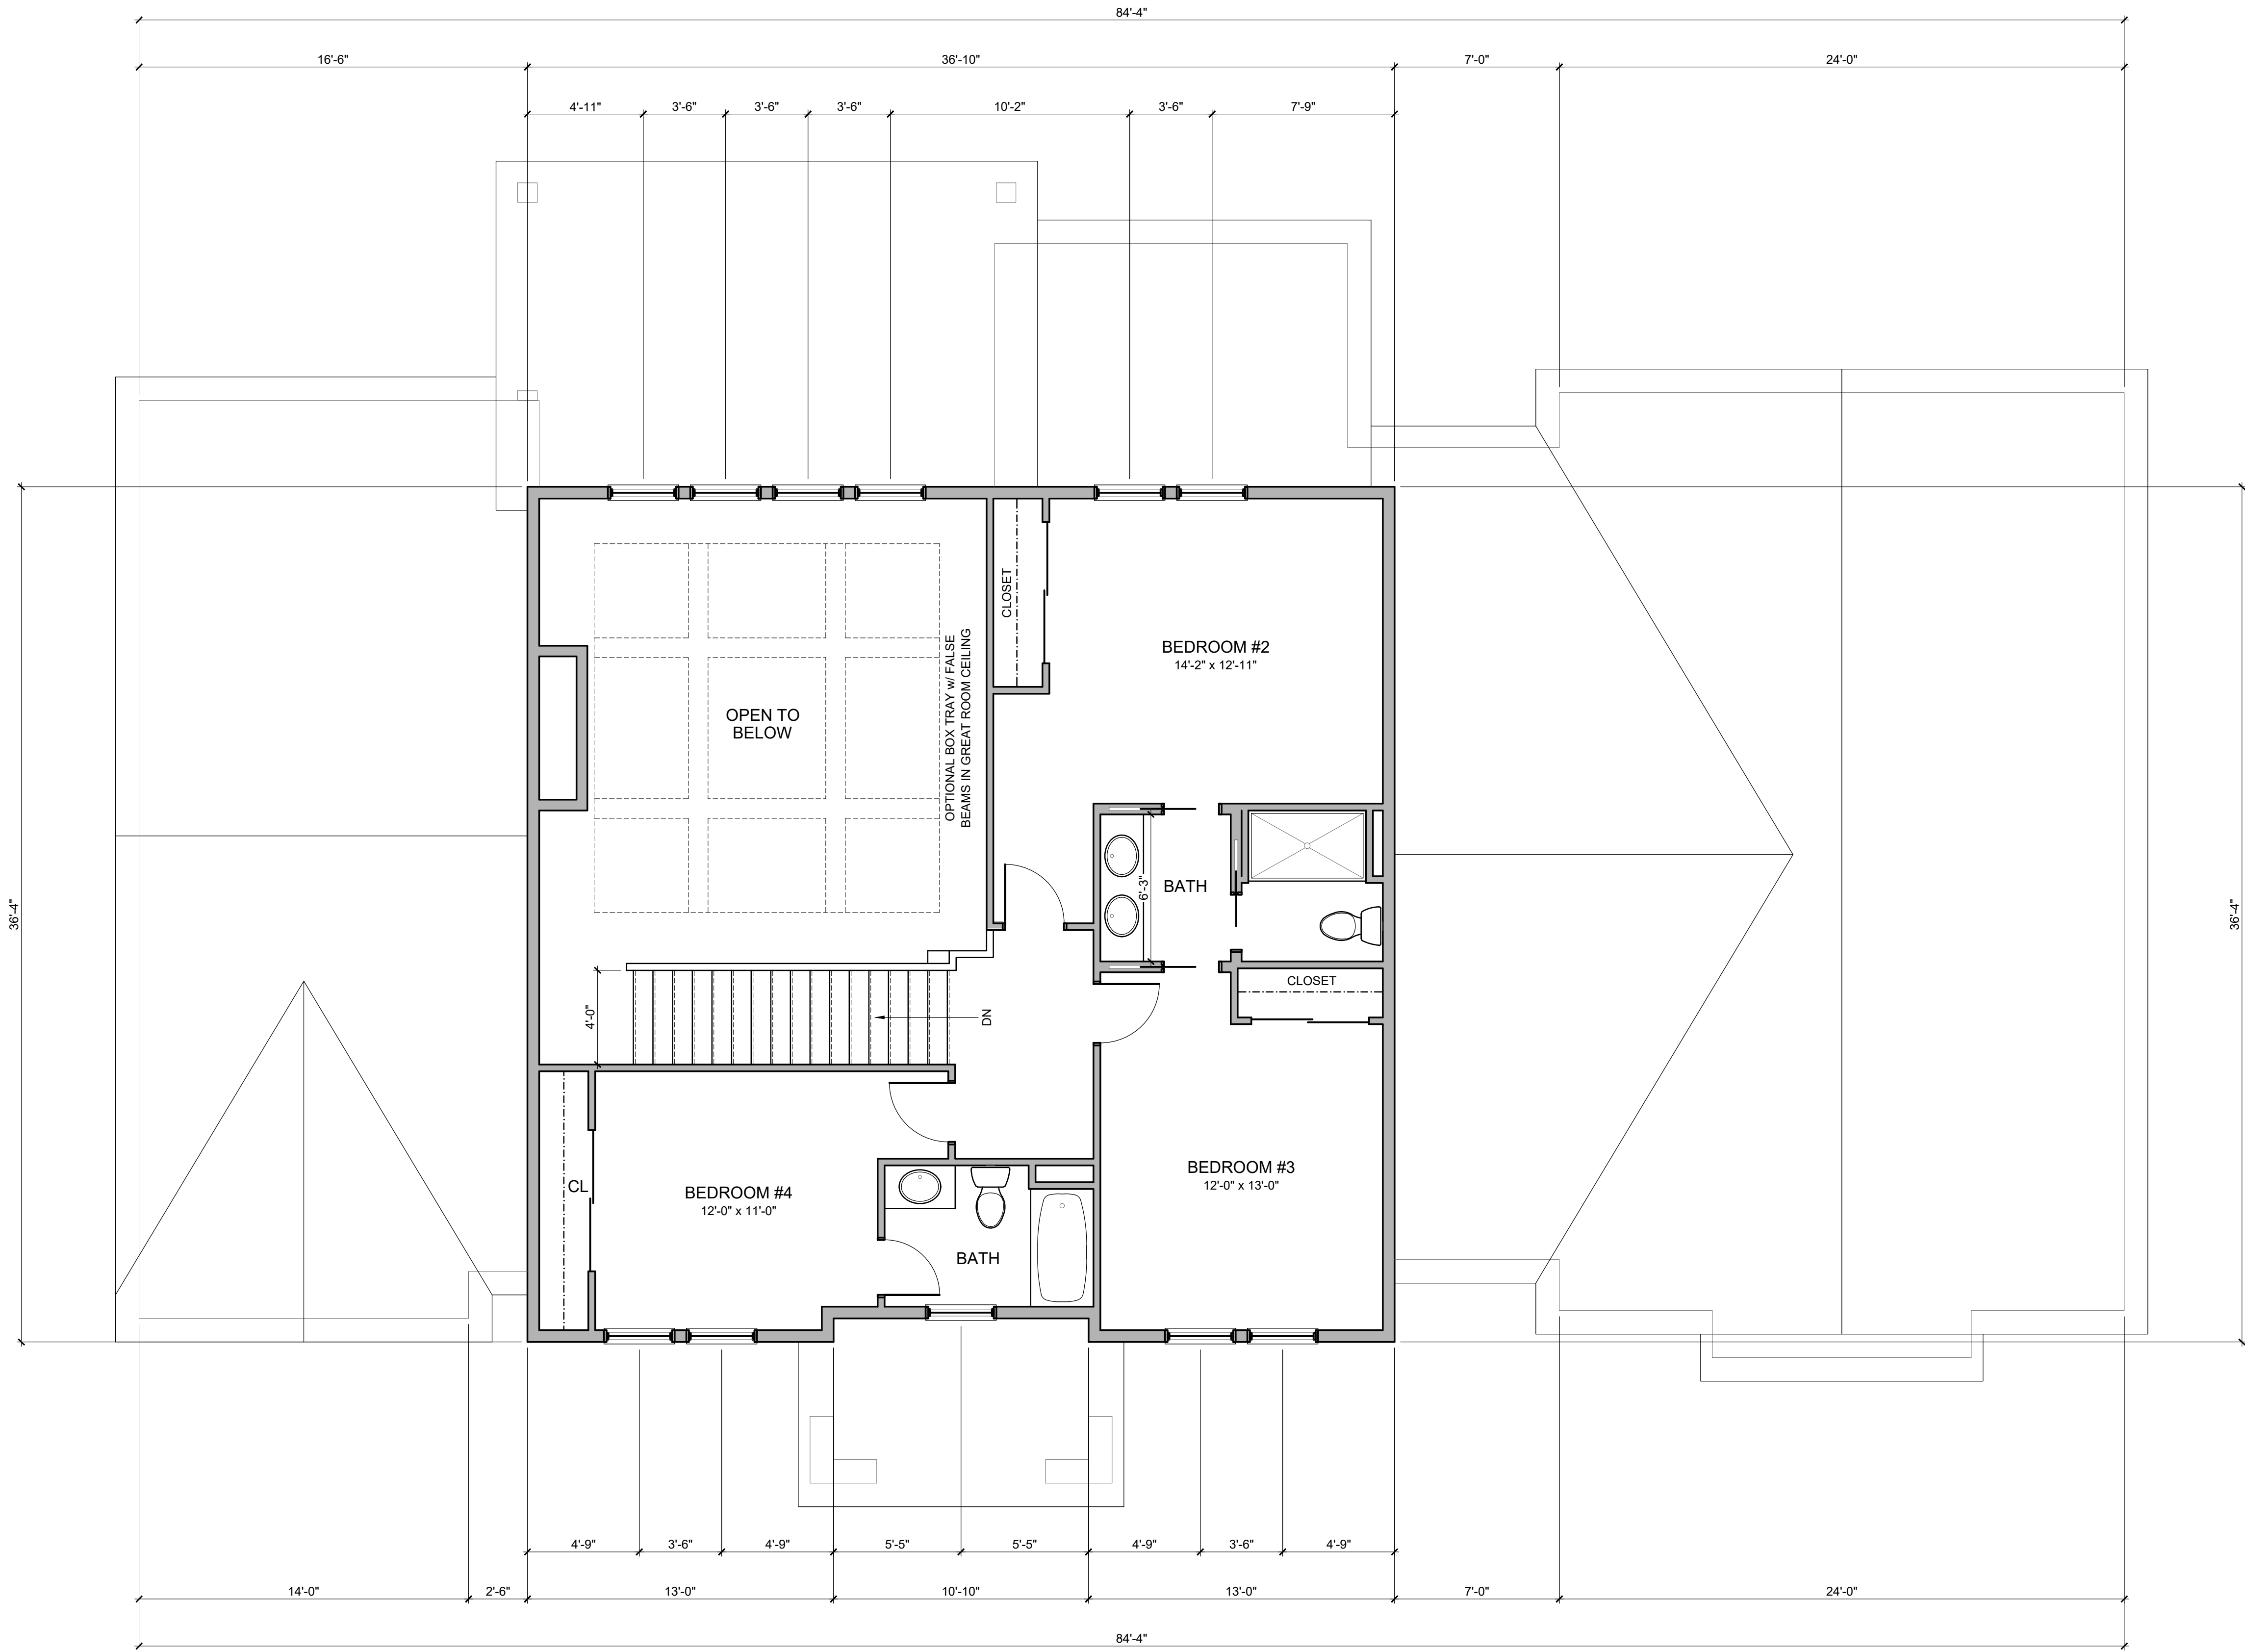

FLOOR PLAN NOTES

1. ALL DIMENSIONS TO INTERIOR WALLS ARE TO FACE OF STUD.
2. ALL DIMENSIONS TO OUTSIDE FACE OF EXTERIOR WALLS ARE TO OUTSIDE FACE OF SHEATHING. DIMENSIONS TO INSIDE FACE OF EXTERIOR WALL ARE TO FACE OF STUD.
3. ALL INTERIOR STUD WALLS TO BE 2x4 STUDS @ 16" O.C., U.N.O.
4. ALL DOORS SHALL BE 6" FROM ADJACENT WALL OR CENTERED IN WALL, U.N.O.
5. BEDROOM WINDOWS SHALL MEET 2019 RCO CHAPTER 311 EGRESS REQUIREMENTS. CLEAR OPENINGS: GRADE FLOOR MIN. 5.0 SF, OTHER FLOORS MIN. 5.7 SF.
6. EGRESS WINDOWS SHALL HAVE MIN. 24" CLEAR HEIGHT AND 20" MIN. CLEAR WIDTH. WINDOW SILL SHALL NOT EXCEED 44" ABOVE FINISH FLOOR.
7. ALL ANGLED WALLS ARE 45° U.N.O.
8. ALL WOOD IN LOCATIONS SUBJECT TO TERMITE OR DECAY SHALL BE PRESSURE TREATED OR APPROVED DECAY-RESISTANT SPECIES, INCLUDING EXTERIOR DECKS, SILLS, AND SLEEPERS ON CONCRETE, MASONRY, OR IN GROUND CONTACT.
9. SMOKE DETECTORS SHALL BE INSTALLED INSIDE EACH BEDROOM, OUTSIDE EACH SLEEPING AREA, AND ON EACH FLOOR, INCLUDING BASEMENT. DETECTORS SHALL BE HARDWIRED WITH BATTERY BACKUP AND INTERCONNECTED. USE IONIZATION AND PHOTOELECTRIC TECHNOLOGY IN BEDROOMS, PHOTOELECTRIC ELSEWHERE.
10. FIRE STOPPING SHALL SEAL ALL CONCEALED VERTICAL AND HORIZONTAL OPENINGS TO FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES, WITHIN WALLS, AND WITHIN CEILING OR SOFFIT CAVITIES PER RCO 302.11.
11. LVL SHEETS TO BE PROVIDED AT FRAMING INSPECTION.
12. BLOCK ALL BEARING POINTS TO BEAMS OR FOUNDATION.
13. ALL VERTICAL AND HORIZONTAL JOINTS IN EXTERIOR WALL SHEATHING SHALL FALL ON A STUD, PLATE, BAND BOARD, OR 2x BLOCKING.

DOOR LEGEND

3068 = 3'-0" WIDE x 6'-8" TALL DOOR
(3080 = 3'-0" WIDE x 8'-0" TALL DOOR)

DOOR ABBREVIATIONS:

- PD = POCKET DOOR
- BP = BYPASS DOOR
- BF = BI-FOLD DOOR
- OH = OVERHEAD DOOR
- SGD = SLIDING GLASS DOOR
- BARN = SLIDING BARN DOOR

STRUCTURAL LEGEND

TRUSS / JOIST / RAFTER INDICATOR
DIRECTION OF SPAN
EXTENTS OF STRUCTURE

SOLID BLOCKING
STEEL BEAM (SEE PLAN FOR SIZE)
HEADER / BEAM (SEE PLAN FOR SIZE)
GIRDER TRUSS (SEE TRUSS MANF DWGS)

STEEL COLUMN (SEE PLAN FOR SIZE)
POINT LOAD LOCATION
POINT LOAD FROM ABOVE

SEE SHEET A4-1 FOR GENERAL STRUCTURAL NOTES

ALL LVL AND 2x WOOD BEAMS: (D) = DROPPED, (F) = FLUSH

ALL HEADERS AND BEAMS TO BEAR ON MINIMUM (1) KING STUD (KS) & (1) JACK STUD (JS) EACH SIDE OF OPENING, U.N.O.

#	DATE	ISSUED WITH: CHANGE DESCRIPTION

P&D BUILDERS
EST. 1962

SBA STUDIOS
ARCHITECTURAL DESIGN
614.562.7761 WWW.SBA-STUDIOS.COM

SCALE: 1/4" = 1'-0"


SHEET # / DESCRIPTION
SECOND FLOOR PLAN

A1-2

DATE: 08.13.2026
QTO

SCOTT B. BAKER, LICENSE #14654
EXPIRATION DATE 12/31/2027

SBA STUDIOS PROJECT # 2026-350

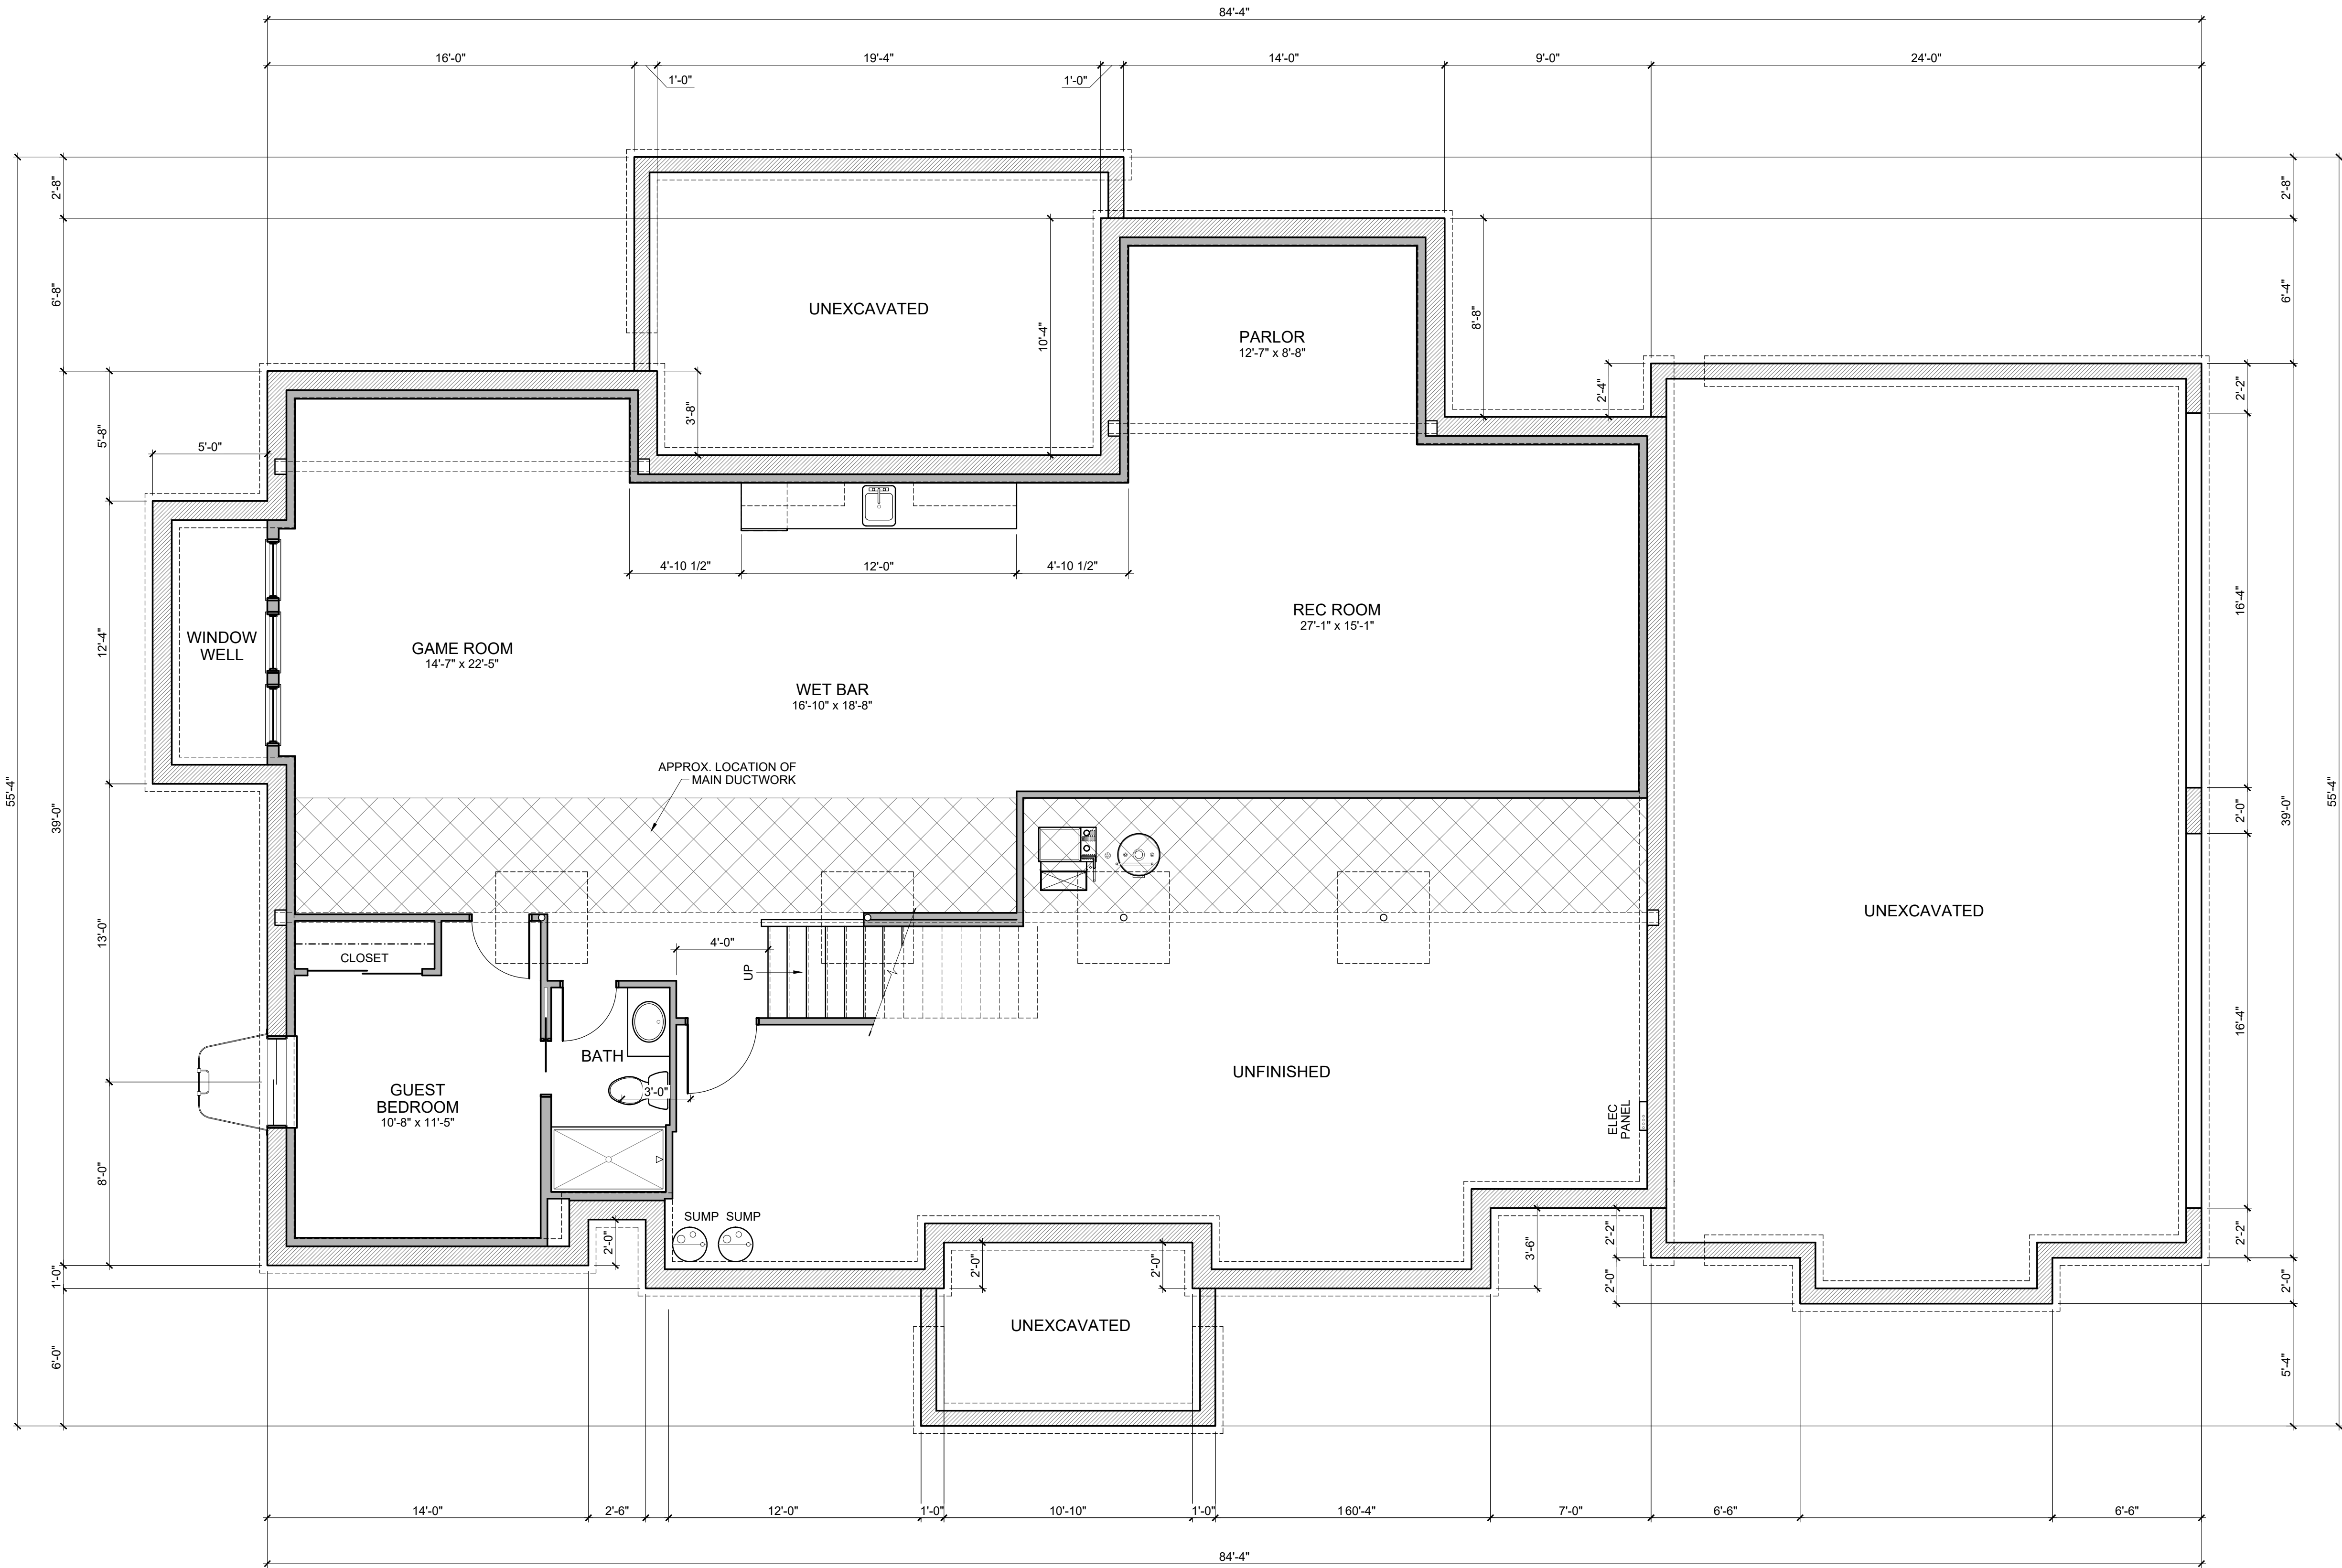

FOUNDATION NOTES

1. ALL 8" FOUNDATION WALLS SHALL BE SUPPORTED ON A MINIMUM 16" x 8" CONTINUOUS POURED CONCRETE FOOTING UNLESS NOTED OTHERWISE. SEE DETAILS.
2. FOUNDATION CONSTRUCTION SHALL CONFORM TO STRUCTURAL INFORMATION SHOWN AND STRUCTURAL NOTES TO MAINTAIN INTENDED LOAD PATHS.
3. BASEMENT HABITABLE SPACES AND HALLWAYS SHALL HAVE A MINIMUM 7'-0" CLEAR CEILING HEIGHT, EXCEPT 6'-4" MINIMUM AT BEAMS, DUCTS, AND OBSTRUCTIONS.
4. PREFABRICATED CONCRETE LINTELS AT FOOTING LEVEL CHANGES SHALL HAVE A MINIMUM 8" BEARING EACH END.
5. REFER TO STRUCTURAL NOTES FOR ADDITIONAL REQUIREMENTS.

STRUCTURAL LEGEND

TRUSS / JOIST / RAFTER INDICATOR
DIRECTION OF SPAN
EXTENTS OF STRUCTURE

SOLID BLOCKING
STEEL BEAM (SEE PLAN FOR SIZE)
HEADER / BEAM (SEE PLAN FOR SIZE)
GIRDER TRUSS (SEE TRUSS MANF DWGS)

STEEL COLUMN (SEE PLAN FOR SIZE)
POINT LOAD LOCATION
POINT LOAD FROM ABOVE

SEE SHEET A4-1 FOR GENERAL STRUCTURAL NOTES

ALL LVL AND 2x WOOD BEAMS: (D) = DROPPED, (F) = FLUSH


ALL HEADERS AND BEAMS TO BEAR ON MINIMUM (1) KING STUD (KS) & (1) JACK STUD (JS) EACH SIDE OF OPENING, U.N.O.

#	DATE	ISSUED WITH: CHANGE DESCRIPTION

P&D JOB NUMBER # 1805

P & D
BUILDERS
EST. 1962

SBA
STUDIOS
ARCHITECTURAL DESIGN
614.562.7761 WWW.SBA-STUDIOS.COM

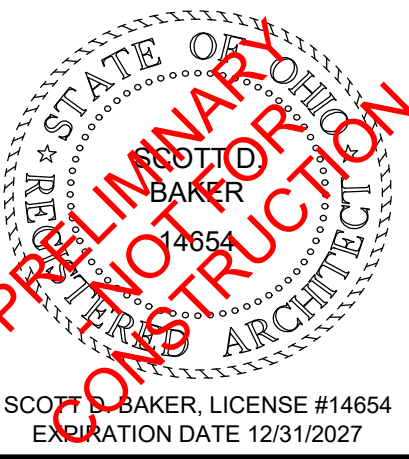

SCALE: 1/4" = 1'-0"
SHEET # / DESCRIPTION
FIN. BASEMENT PLAN
A1-0
DATE: 08.13.2026
QTO
SCOTT B. BAKER, LICENSE #14654 EXPIRATION DATE 12/31/2027
SBA STUDIOS PROJECT # 2026-350




2 REAR ELEVATION



1 FRONT ELEVATION

ELEVATION MATERIAL LEGEND

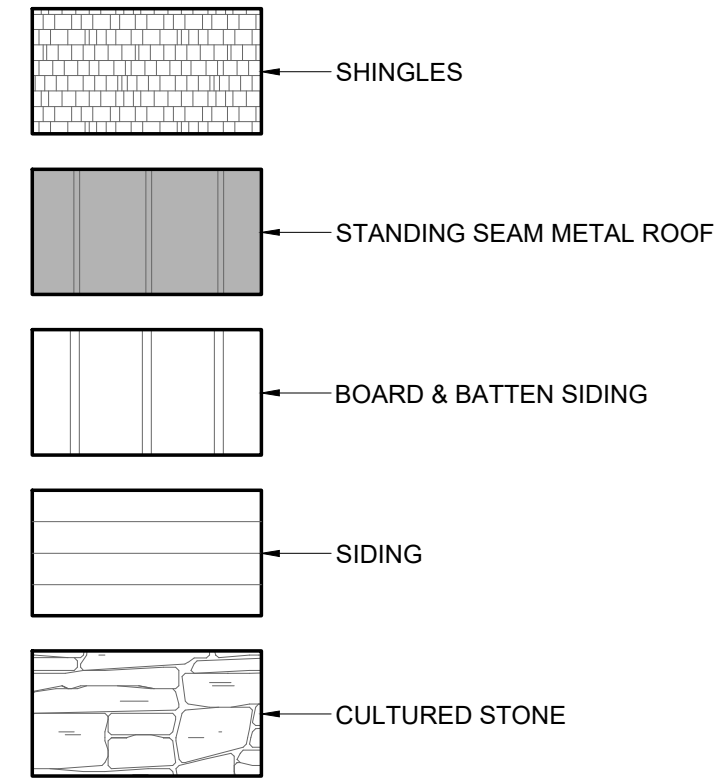


EXTERIOR FLASHING, CONDUITS, VENT PIPES, OR SIMILAR, TO COLOR MATCH ADJACENT MATERIALS, TYP. UNLESS PROHIBITED BY THE MANUFACTURER AND / OR CODE

#	DATE	ISSUED WITH: CHANGE DESCRIPTION

P&D JOB NUMBER # 1805

P&D BUILDERS
EST. 1962

SBA STUDIOS
ARCHITECTURAL DESIGN
614.562.7761 WWW.SBA-STUDIOS.COM

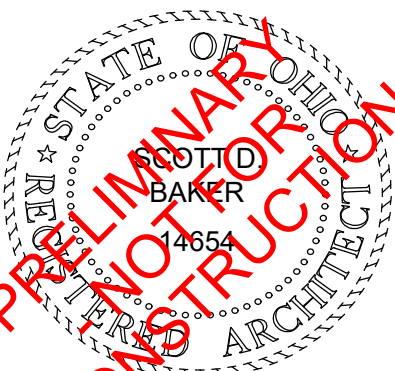

SCOTT S. BAKER, LICENSE #14654
EXPIRATION DATE 12/31/2027

SCALE: 1/4" = 1'-0"
SHEET # / DESCRIPTION
EXTERIOR ELEVATIONS
A2-1
DATE: 08.13.2026
QTO
SBA STUDIOS PROJECT # 2026-350