
## P&D Builders - Job #1714



## 2 REAR ELEVATION



## **ELEVATION MATERIAL LEGEND**

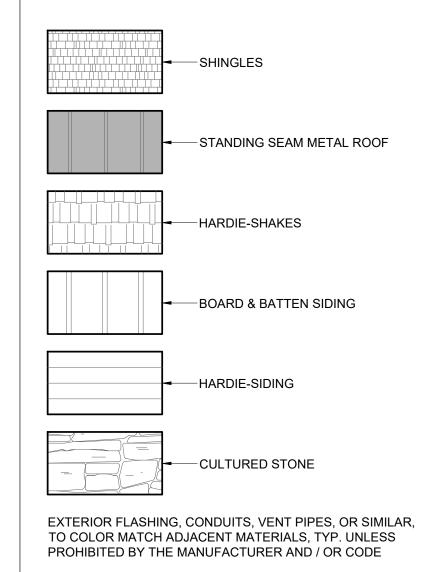

#	DATE	ISSUED WITH: CHANGE DESCRIPTION

P&D
BUILDERS
EST. 1962






# P&D Builders - Job #1714



2 LEFT SIDE ELEVATION



## **ELEVATION MATERIAL LEGEND**

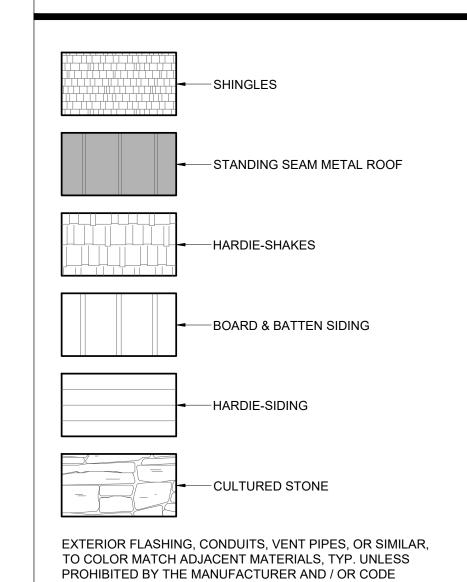


#	DATE	ISSUED WITH: CHANGE DESCRIPTION

P&D BUILDERS





RIGHT SIDE ELEVATION

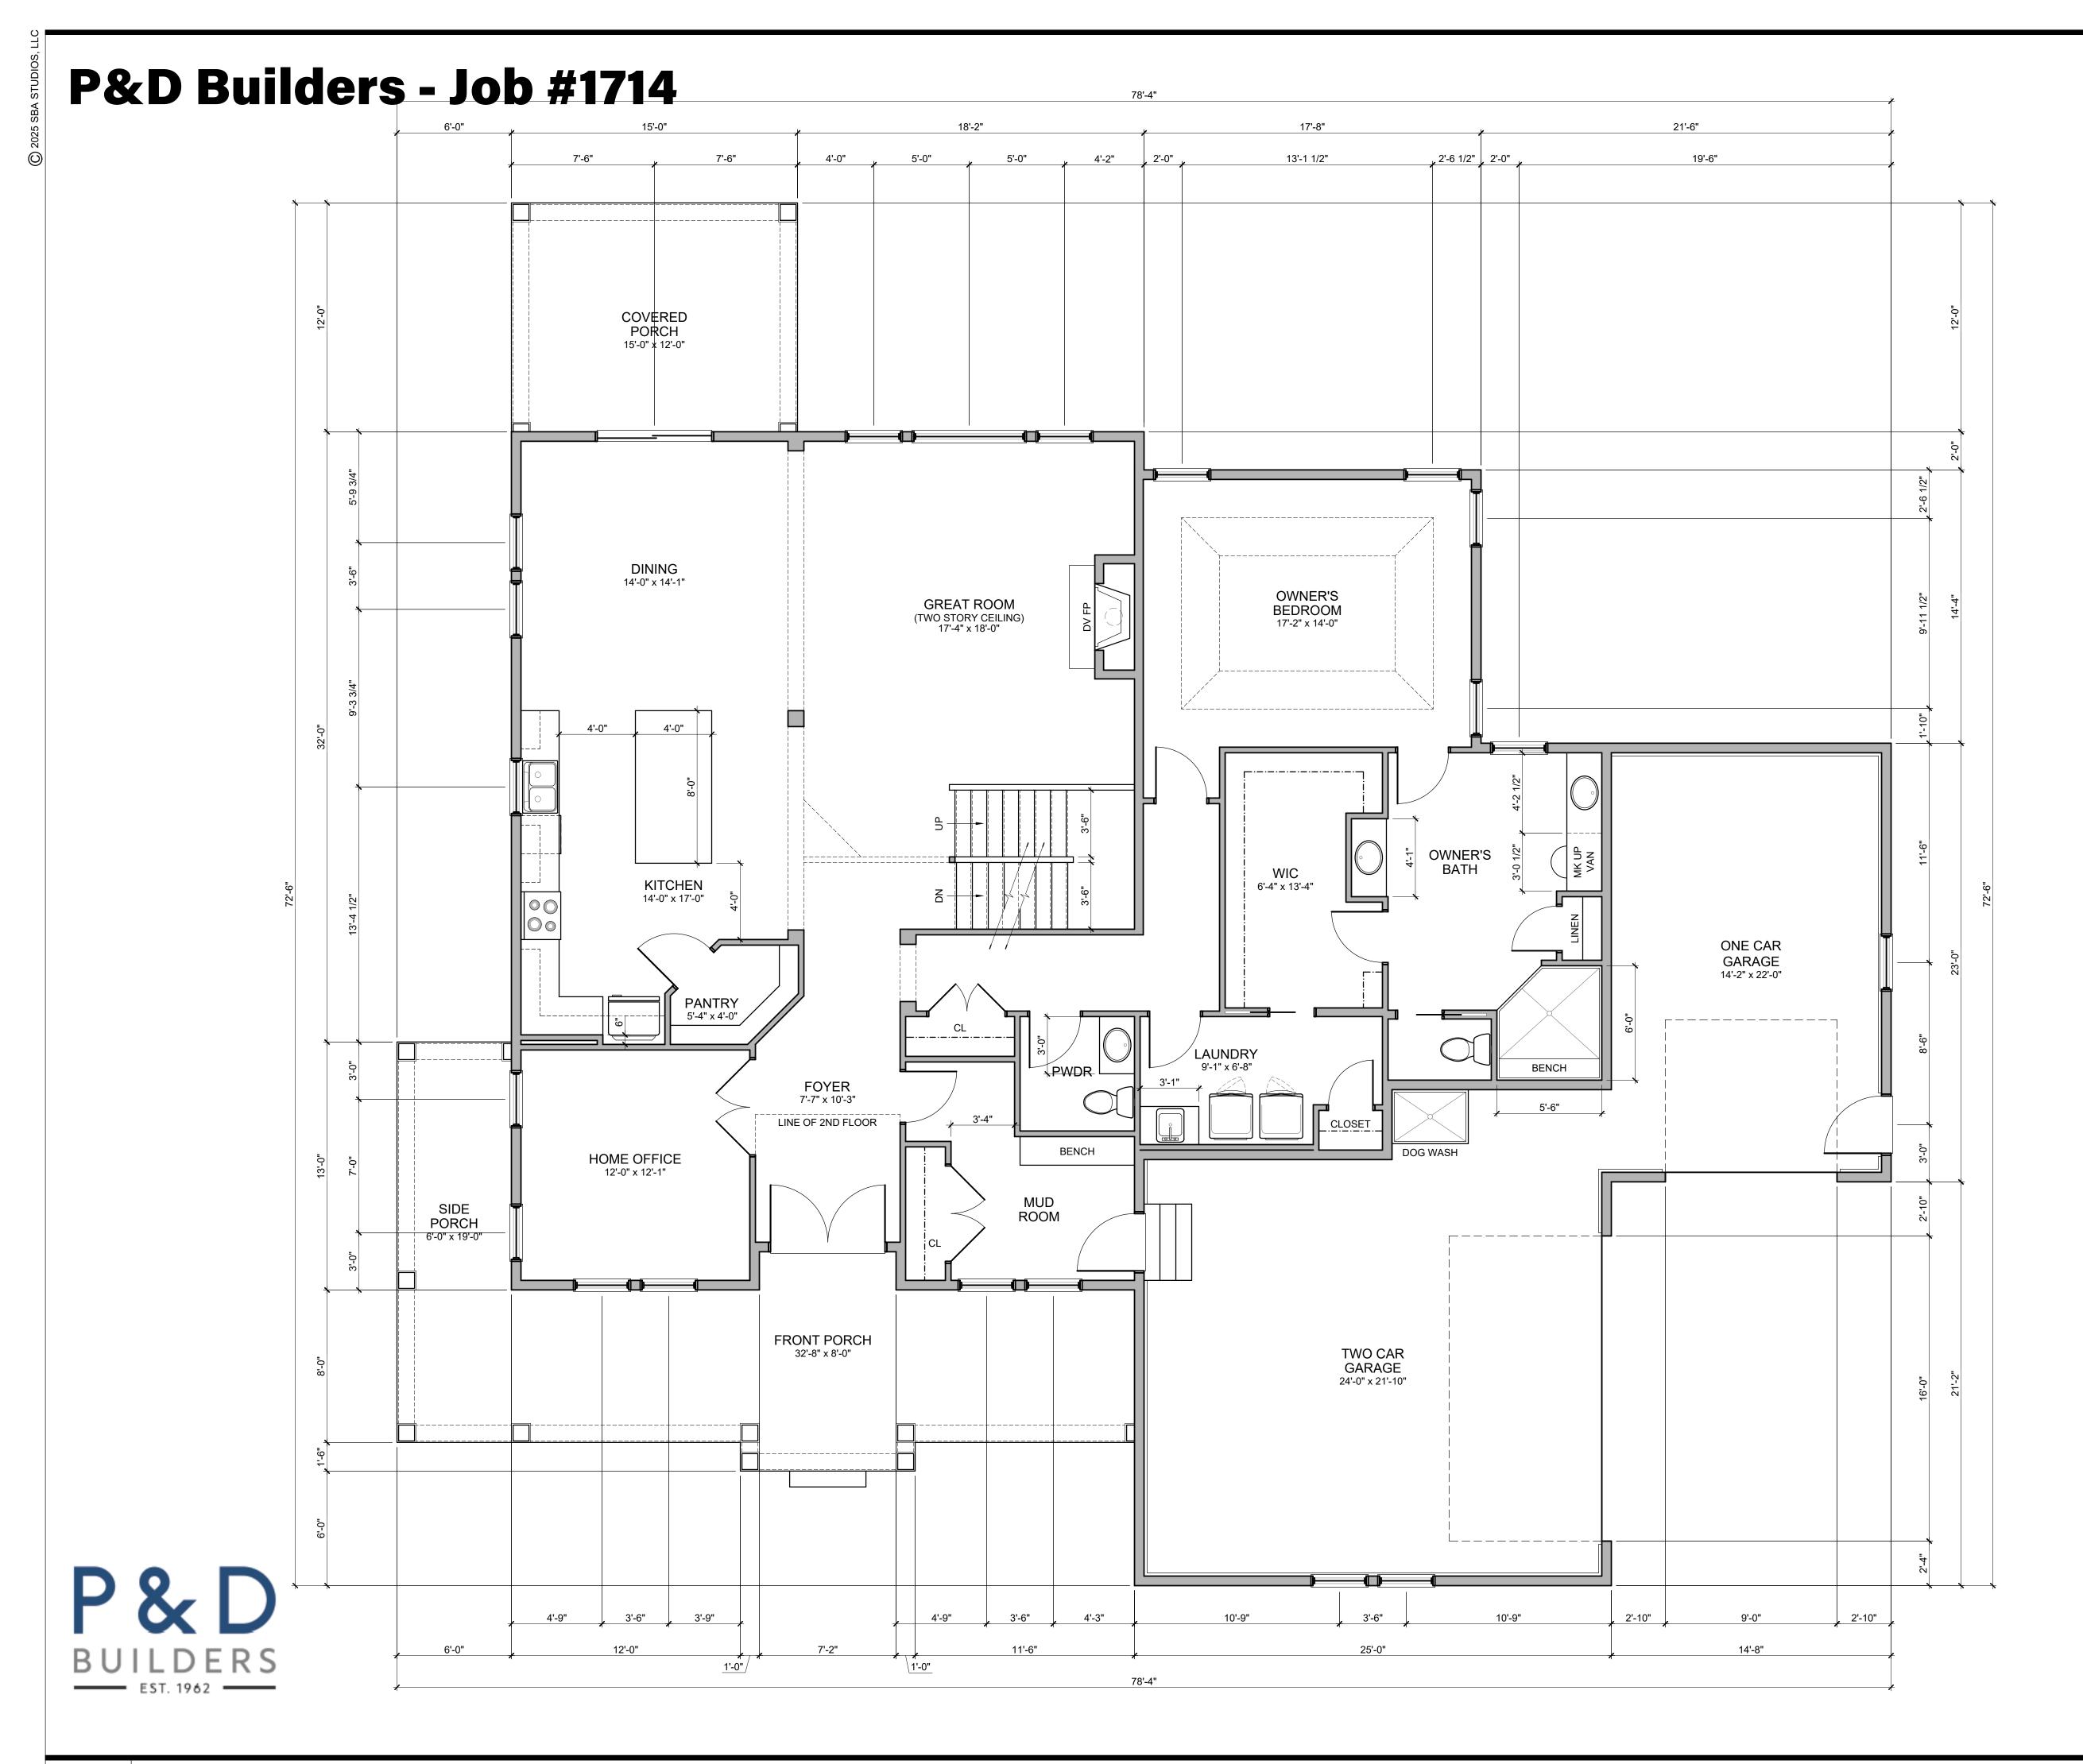

FLOOR PLAN NOTES


- 1. ALL DOORS SHALL BE 6" FROM ADJACENT WALL OR CENTERED IN WALL UNLESS NOTED OTHERWISE.
- 2. ALL INTERIOR STUD WALLS TO BE 2x4 STUDS @ 16" O.C. UNLESS NOTED OTHERWISE.
- 3. ALL DIMENSIONS TO INTERIOR WALLS ARE TO FACE OF STUD.
  ALL DIMENSIONS TO OUTSIDE FACE OF EXTERIOR WALLS ARE
  TO OUTSIDE FACE OF SHEATHING. ALL DIMENSIONS TO INSIDE
- FACE OF EXTERIOR WALL ARE TO FACE OF STUD.

  4. ALL BEDROOM WINDOWS SHALL MEET CODE REQUIREMENTS
  FOR EGRESS. EGRESS CLEAR OPENINGS ON GRADE FLOOR
  SHALL BE A MINIMUM OF 5.0 SQUARE FEET. EGRESS CLEAR
  OPENINGS ON ALL OTHER FLOORS SHALL BE A MINIMUM OF 5.7
- SQUARE FEET.

  EGRESS WINDOWS TO HAVE A MINIMUM CLEAR HEIGHT OF 24"
  AND A MINIMUM CLEAR OPENING WIDTH OF 20". SILL HEIGHT
  SHALL NOT EXCEED 44" ABOVE THE FINISH FLOOR.
- ALL ANGLED WALLS ARE 45 DEGREES U.N.O.
   ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL
- APPLICABLE CODES AND REGULATIONS.

  8. CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT SITE BEFORE BEGINNING CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED IMMEDIATELY TO
- THE ARCHITECT IN WRITING FOR JUSTIFICATION AND / OR CORRECTION BEFORE PROCEEDING WITH WORK.
  CONTRACTORS SHALL ASSUME RESPONSIBILITY FOR ERRORS THAT ARE NOT REPORTED.
- 9. ALL DIMENSIONS SHALL BE READ OR CALCULATED AND NEVER SCALED.
- 10. CONTRACTOR SHALL ENSURE COMPATIBILITY OF THE BUILDING WITH ALL SITE REQUIREMENTS.
- 11. ALL WOOD IN LOCATIONS SUBJECT TO TERMITE DECAY SHALL BE PRESSURE TREATED (CCA) OR BE OF AN APPROVED DECAY RESISTANT SPECIES. THIS INCLUDES, BUT NOT LIMITED TO, ALL EXTERIOR DECKS, SILLS AND SLEEPERS ON CONCRETE, MASONRY, OR IN DIRECT CONTACT WITH THE GROUND.

#### DOOR LEGEND

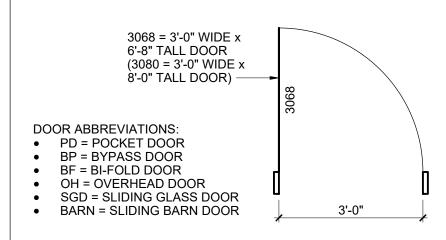

TRUSS / JOIST / RAFTER INDICATOR

## STRUCTURAL LEGEND

i DIRECTION OF SPAN
EXTENTS OF STRUCTURE
ZZZZZZZZZSOLID BLOCKING
STEEL BEAM (SEE PLAN FOR SIZE)
<b>─</b> HEADER / BEAM (SEE PLAN FOR SIZE)
GIRDER TRUSS (SEE TRUSS MANF DWGS)
O───── STEEL COLUMN (SEE PLAN FOR SIZE)
POINT LOAD LOCATION
●── POINT LOAD FROM ABOVE
SEE SHEET A4-1 FOR GENERAL STRUCTURAL NOTES

ALL HEADERS AND BEAMS TO BEAR ON MINIMUM (1) KING STUD (KS) & (1) JACK STUD (JS) EACH SIDE OF OPENING, U.N.O.

ALL LVL AND 2x WOOD BEAMS: (D) = DROPPED. (F) = FLUSH

# DATE ISSUED WITH: CHANGE DESCRIPTION

P&D BUILDERS




EXPURATION DATE 12/31/2025 SBA STUDIOS PROJECT # 2024-546

SCALE: 1/4" = 1'-0"

SHEET # / DESCRIPTION

FIRST FLOOR PLAN

DATE: 01.21.2024




1 FIRST FLOOR PLAN 2,224 S.F.

#### FLOOR PLAN NOTES

- 1. ALL DOORS SHALL BE 6" FROM ADJACENT WALL OR CENTERED IN WALL UNLESS NOTED OTHERWISE.
- 2. ALL INTERIOR STUD WALLS TO BE 2x4 STUDS @ 16" O.C. UNLESS NOTED OTHERWISE.
- 3. ALL DIMENSIONS TO INTERIOR WALLS ARE TO FACE OF STUD. ALL DIMENSIONS TO OUTSIDE FACE OF EXTERIOR WALLS ARE TO OUTSIDE FACE OF SHEATHING. ALL DIMENSIONS TO INSIDE
- FACE OF EXTERIOR WALL ARE TO FACE OF STUD. . ALL BEDROOM WINDOWS SHALL MEET CODE REQUIREMENTS FOR EGRESS. EGRESS CLEAR OPENINGS ON GRADE FLOOR SHALL BE A MINIMUM OF 5.0 SQUARE FEET. EGRESS CLEAR OPENINGS ON ALL OTHER FLOORS SHALL BE A MINIMUM OF 5.7
- SQUARE FEET. 5. EGRESS WINDOWS TO HAVE A MINIMUM CLEAR HEIGHT OF 24" AND A MINIMUM CLEAR OPENING WIDTH OF 20". SILL HEIGHT SHALL NOT EXCEED 44" ABOVE THE FINISH FLOOR.
- . ALL ANGLED WALLS ARE 45 DEGREES U.N.O. 7. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE CODES AND REGULATIONS.
- . CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT SITE BEFORE BEGINNING CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED IMMEDIATELY TO THE ARCHITECT IN WRITING FOR JUSTIFICATION AND / OR CORRECTION BEFORE PROCEEDING WITH WORK. CONTRACTORS SHALL ASSUME RESPONSIBILITY FOR ERRORS
- THAT ARE NOT REPORTED. 9. ALL DIMENSIONS SHALL BE READ OR CALCULATED AND NEVER
- 10. CONTRACTOR SHALL ENSURE COMPATIBILITY OF THE BUILDING WITH ALL SITE REQUIREMENTS.
- 11. ALL WOOD IN LOCATIONS SUBJECT TO TERMITE DECAY SHALL BE PRESSURE TREATED (CCA) OR BE OF AN APPROVED DECAY RESISTANT SPECIES. THIS INCLUDES, BUT NOT LIMITED TO, ALL EXTERIOR DECKS, SILLS AND SLEEPERS ON CONCRETE, MASONRY, OR IN DIRECT CONTACT WITH THE GROUND.

## DOOR LEGEND

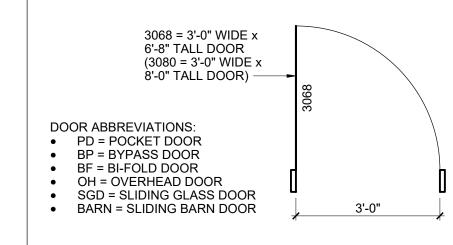

## STRUCTURAL LEGEND

DIRECTION OF SPAN EXTENTS OF STRUCTURE
SOLID BLOCKING
STEEL BEAM (SEE PLAN FOR SIZE)
GIRDER TRUSS (SEE TRUSS MANF DWGS)
O⊸ STEEL COLUMN (SEE PLAN FOR SIZE)
● <del></del>
POINT LOAD FROM ABOVE
SEE SHEET A4-1 FOR GENERAL STRUCTURAL NOTES

TRUSS / JOIST / RAFTER INDICATOR

ALL LVL AND 2x WOOD BEAMS: (D) = DROPPED. (F) = FLUSH ALL HEADERS AND BEAMS TO BEAR ON MINIMUM (1) KING STUD (KS) & (1) JACK STUD (JS) EACH SIDE OF OPENING, U.N.O.

#	DATE	ISSUED WITH: CHANGE DESCRIPTION

BUILDERS




SCALE: 1/4" = 1'-0" SHEET # / DESCRIPTION

DATE: 01.21.2024



SECOND FLOOR PLAN 993 S.F.

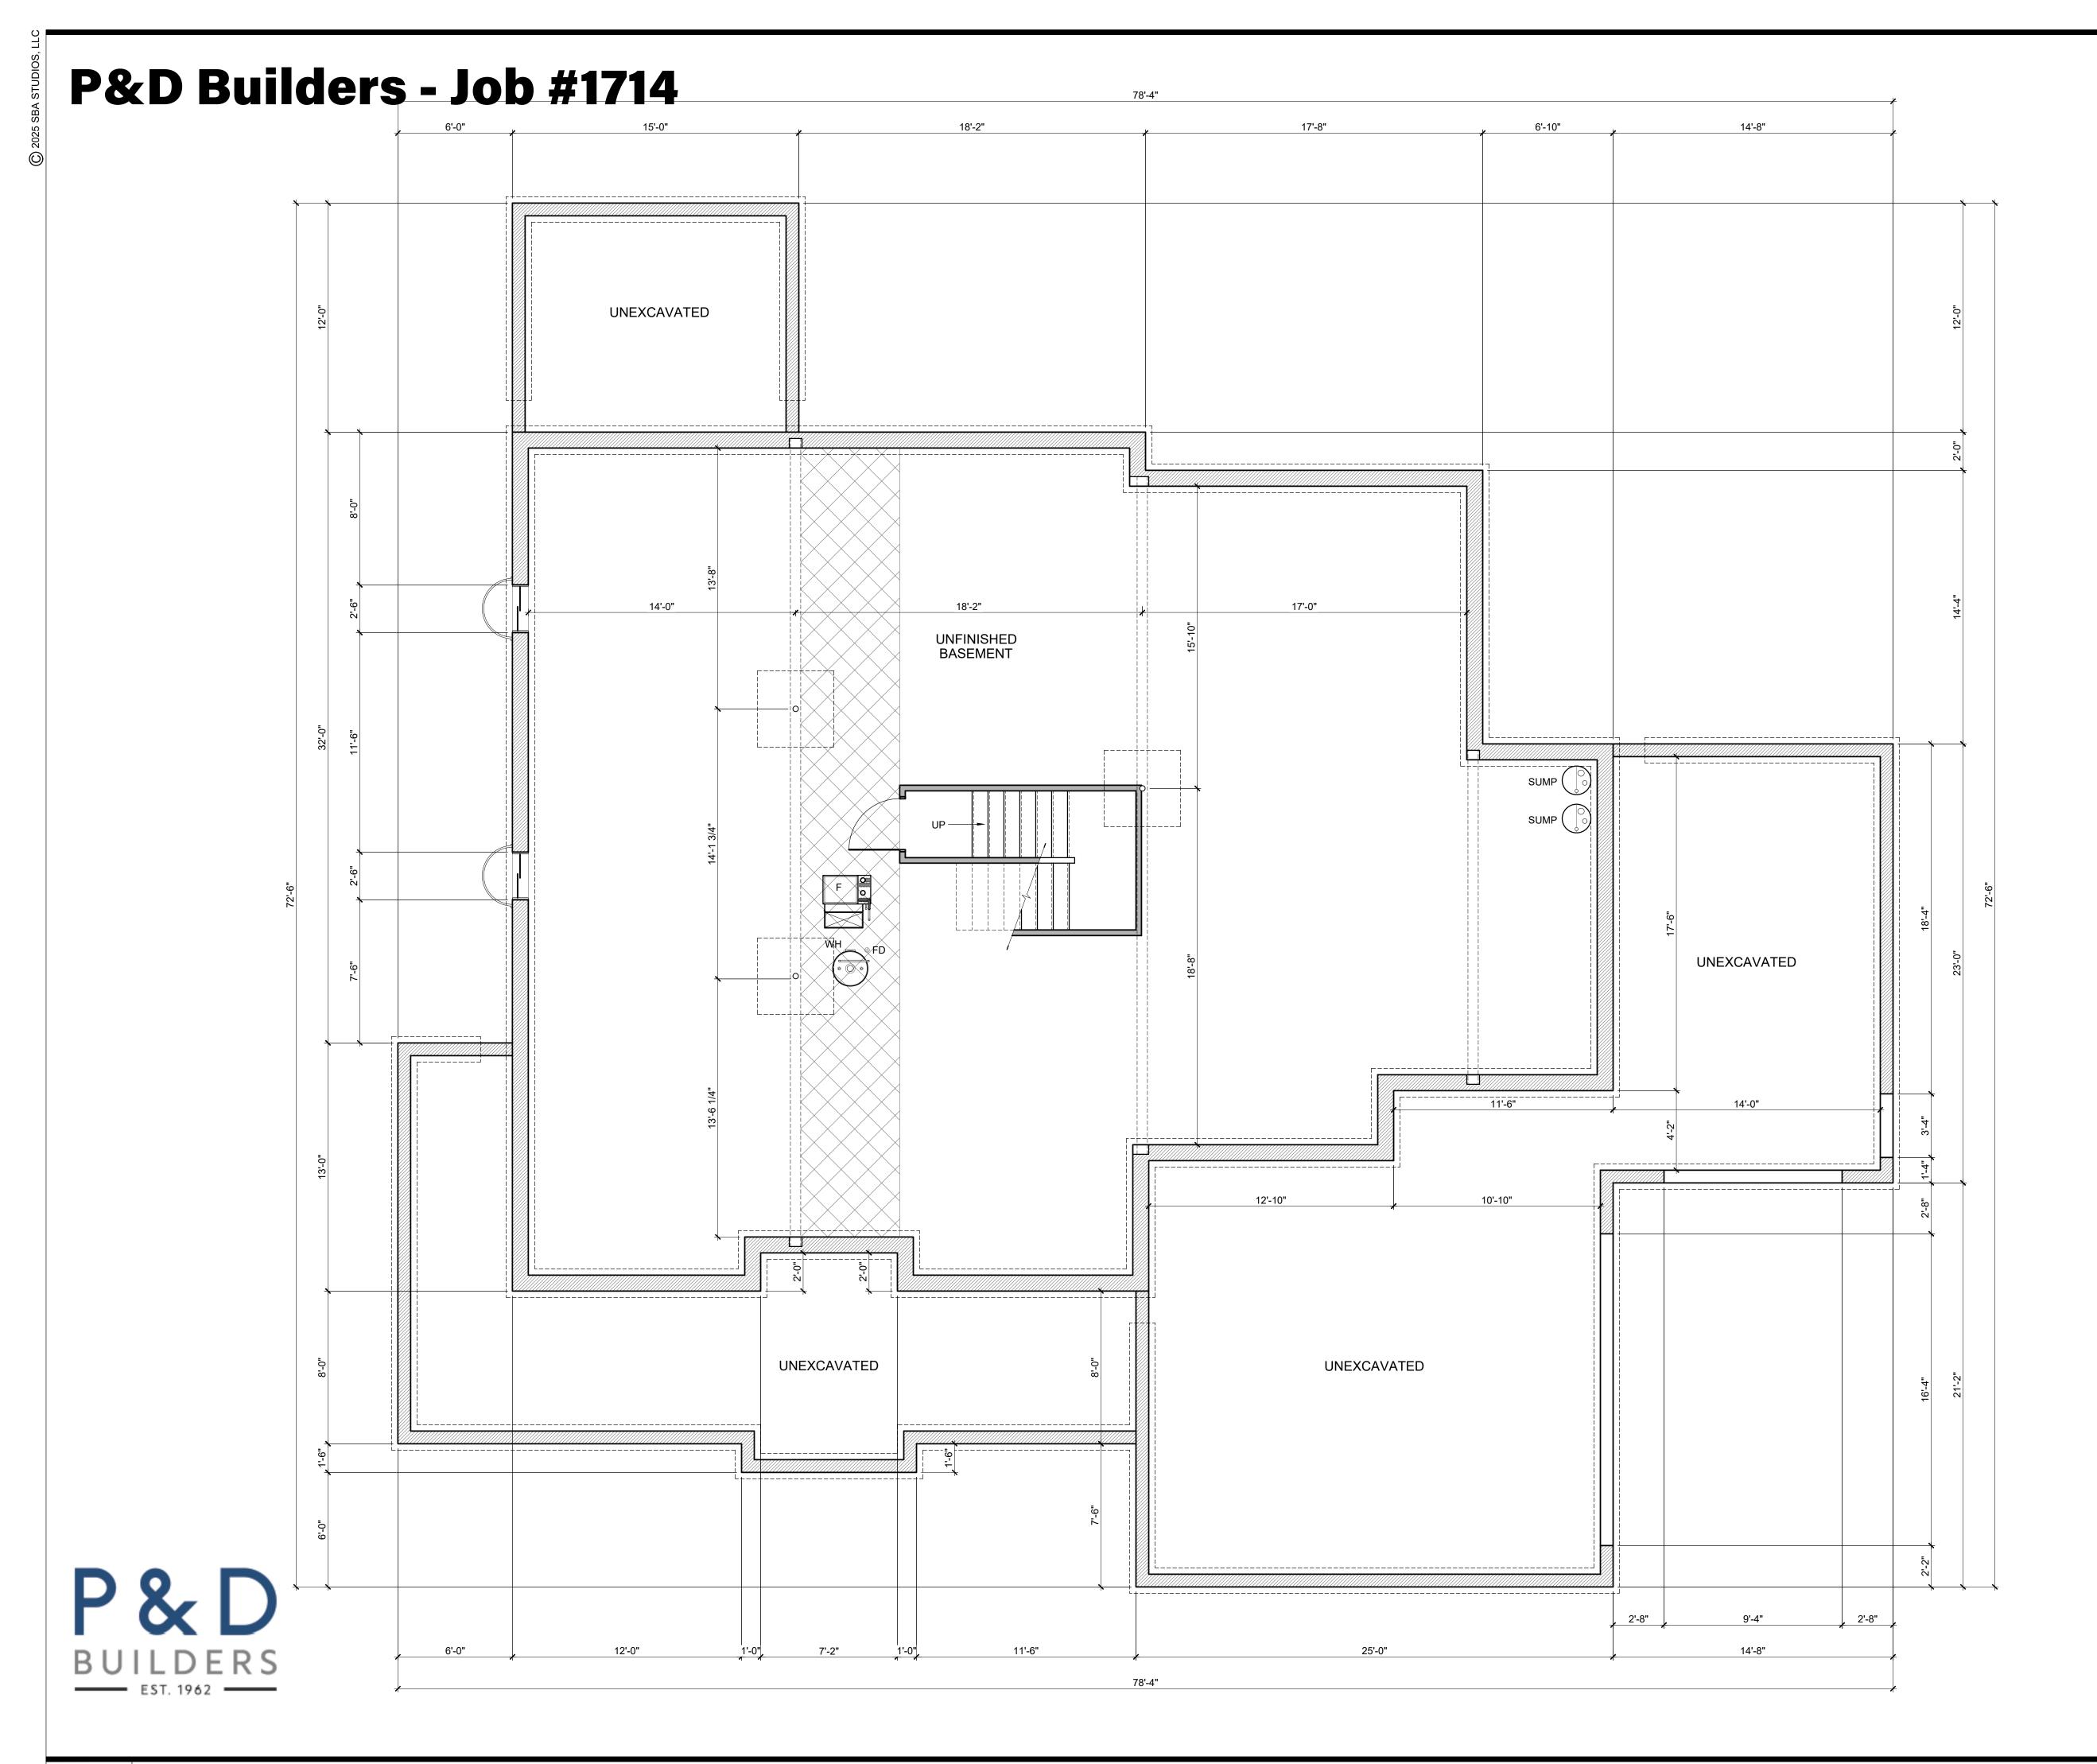

## FOUNDATION NOTES

- 1. ALL 8" FOUNDATION WALLS SHALL HAVE A MINIMUM 16" x 8" CONTINUOUS POURED CONCRETE FOOTING, SEE WALL
- 2. CONTRACTOR TO VERIFY THAT ALL STRUCTURAL LOADS
- TRANSFER TO FOUNDATION
- . CEILING HEIGHTS IN BASEMENTS W/ITH HABITABLE SPACES OR HALLWAYS SHALL NOT BE LESS THAN 7'-0" CLEAR, EXCEPT UNDER BEAMS, DUCTS OR OTHER OBSTRUCTIONS WHERE THE CLEAR HEIGHT SHALL BE 6'-4" MINIMUM.
- . ALL PREFABRICATED CONCRETE LINTELS AT FOOTING LEVEL CHANGES SHALL HAVE 8" MINIMUM BEARING AT EACH END.
- REFER TO STRUCTURAL NOTES SHEET FOR GENERAL STRUCTURE INFORMATION.

## STRUCTURAL LEGEND

TRUSS / JOIST / RAFTER INDICATOR - DIRECTION OF SPAN EXTENTS OF STRUCTURE 

STEEL BEAM (SEE PLAN FOR SIZE) GIRDER TRUSS (SEE TRUSS MANF DWGS) O── STEEL COLUMN (SEE PLAN FOR SIZE)

POINT LOAD LOCATION POINT LOAD FROM ABOVE

SEE SHEET A4-1 FOR GENERAL STRUCTURAL NOTES

ALL LVL AND 2x WOOD BEAMS: (D) = DROPPED. (F) = FLUSH ALL HEADERS AND BEAMS TO BEAR ON MINIMUM (1) KING STUD (KS) & (1) JACK STUD (JS) EACH SIDE OF OPENING, U.N.O.

# DATE ISSUED WITH: CHANGE DESCRIPTION

BUILDERS




SCALE: 1/4" = 1'-0" SHEET # / DESCRIPTION

BASEMENT PLAN

DATE: 01.21.2024



## P&D Builders - Job #1714

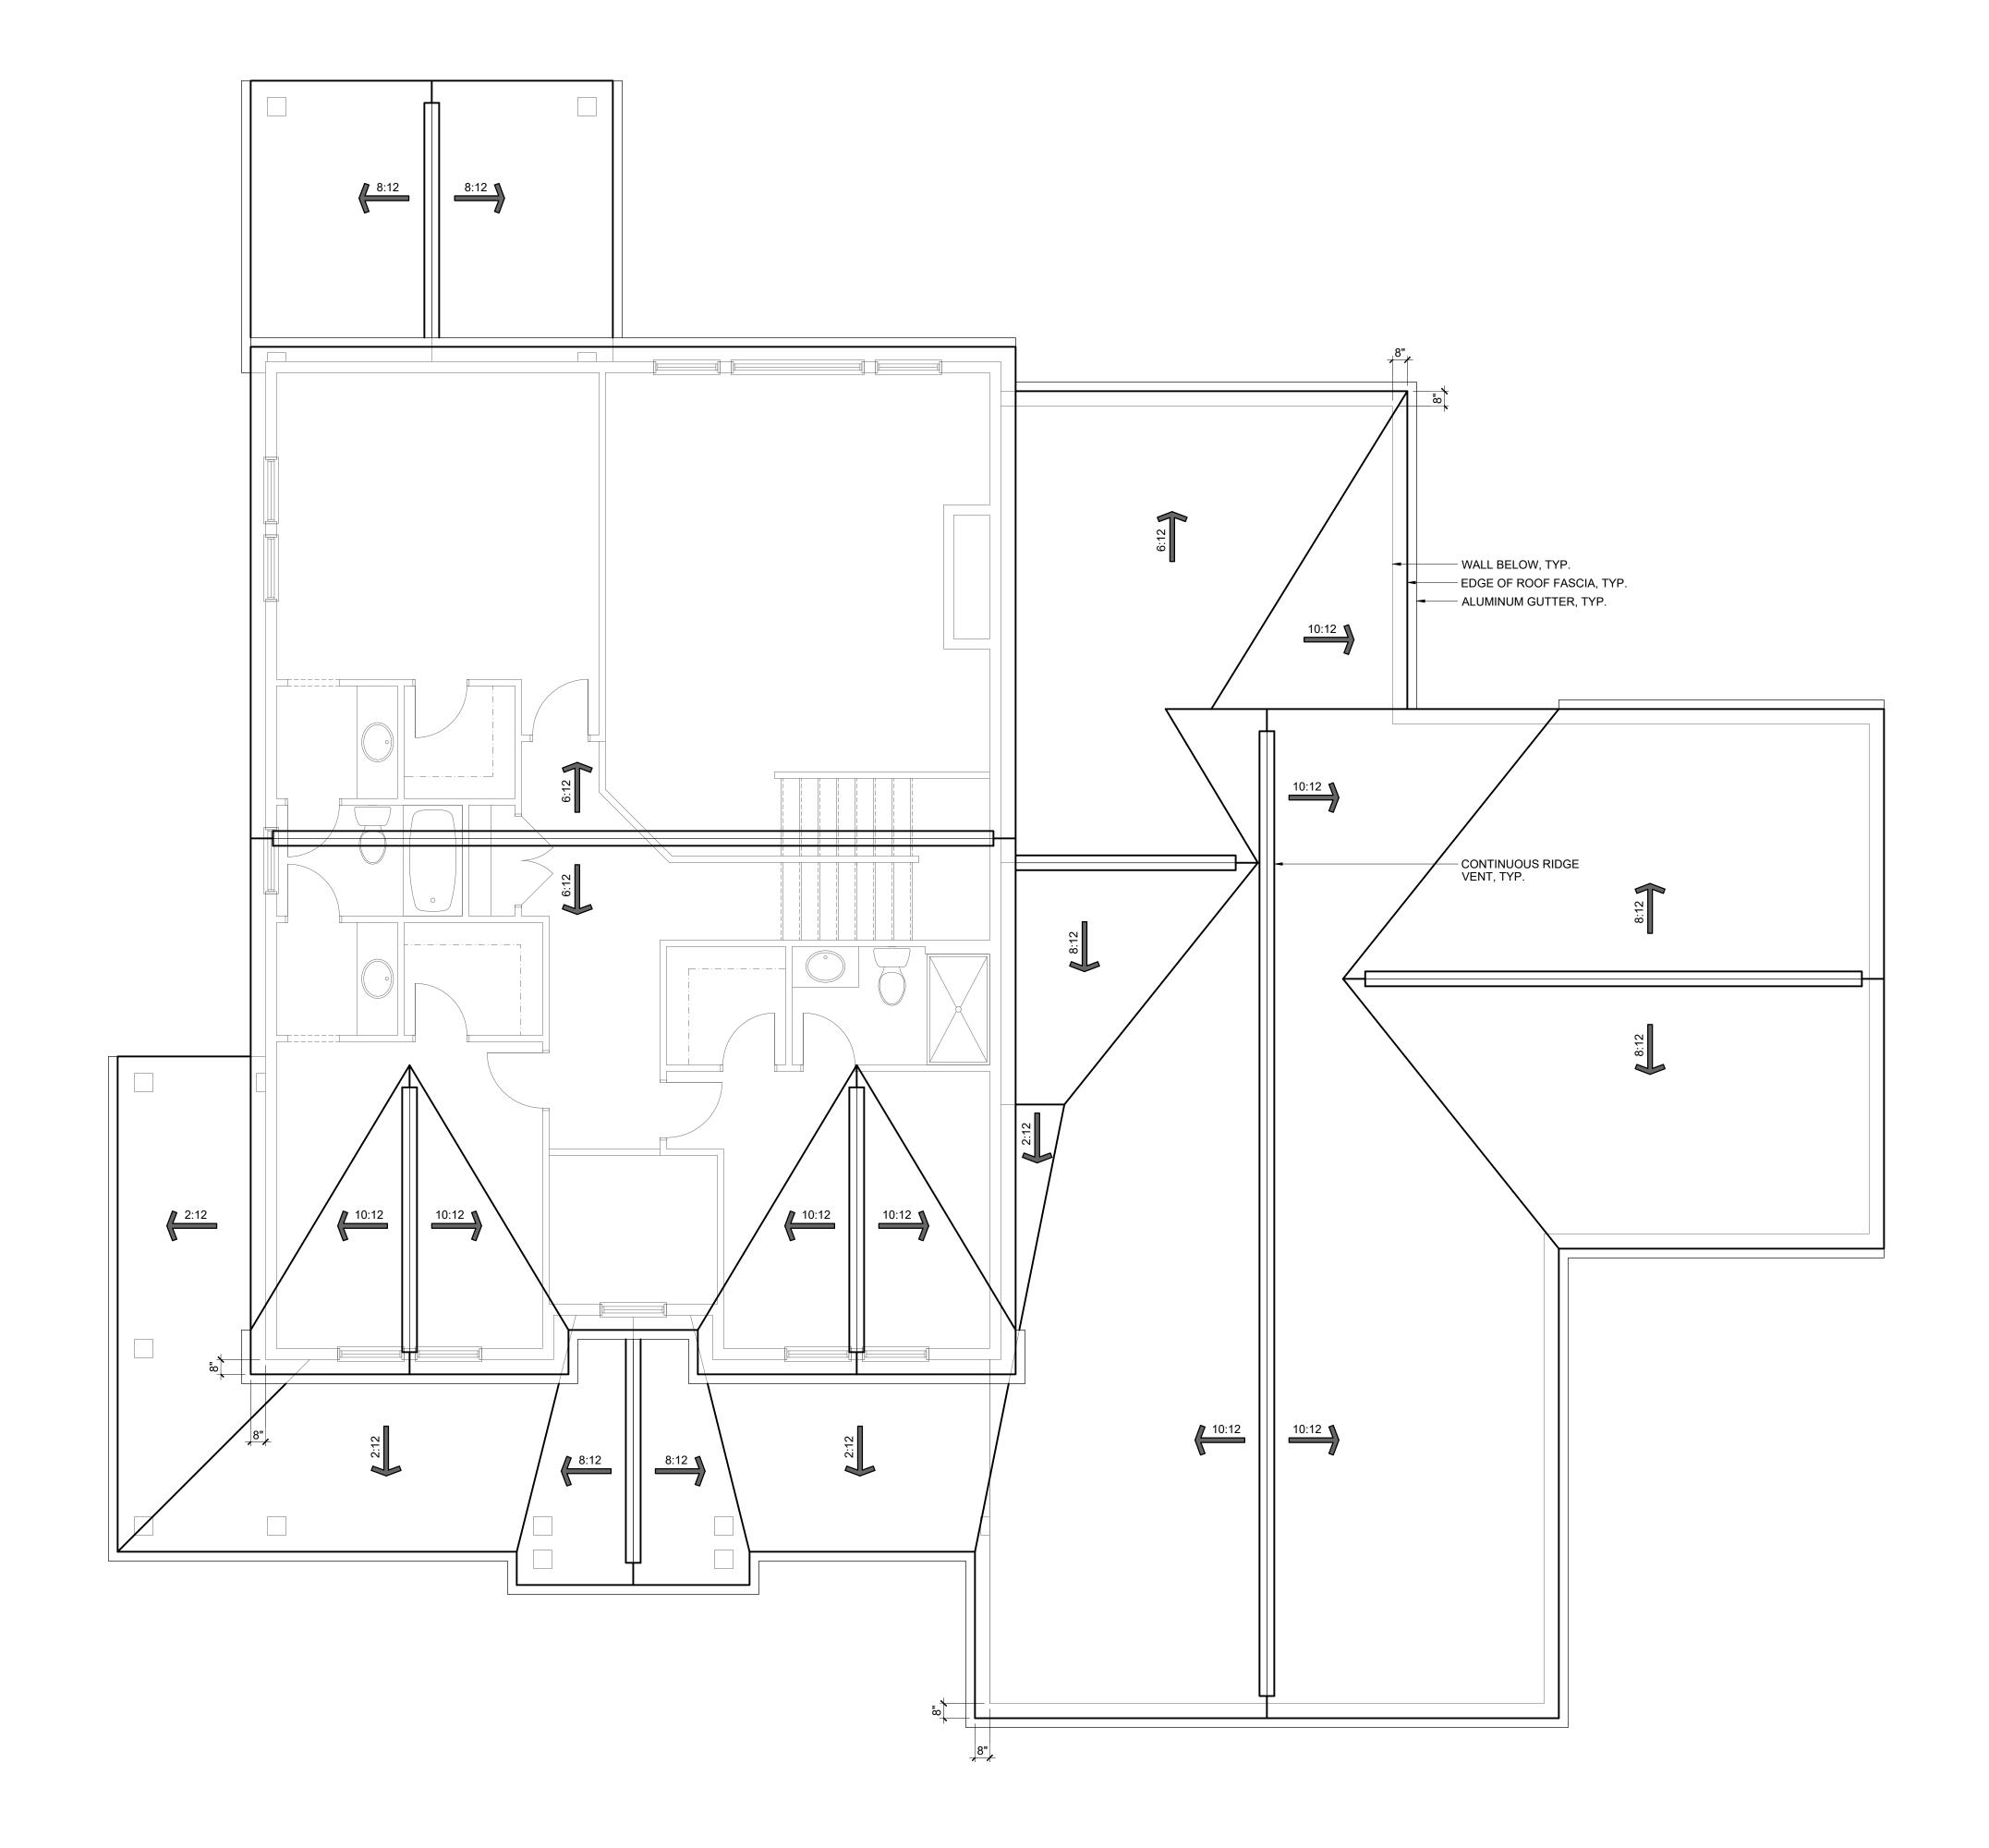




FLOOR PLAN NOTES

- 1. ALL DOORS SHALL BE 6" FROM ADJACENT WALL OR CENTERED IN WALL UNLESS NOTED OTHERWISE.
- 2. ALL INTERIOR STUD WALLS TO BE 2x4 STUDS @ 16" O.C. UNLESS NOTED OTHERWISE.
- 3. ALL DIMENSIONS TO INTERIOR WALLS ARE TO FACE OF STUD. ALL DIMENSIONS TO OUTSIDE FACE OF EXTERIOR WALLS ARE TO OUTSIDE FACE OF SHEATHING. ALL DIMENSIONS TO INSIDE FACE OF EXTERIOR WALL ARE TO FACE OF STUD.
- ALL BEDROOM WINDOWS SHALL MEET CODE REQUIREMENTS FOR EGRESS. EGRESS CLEAR OPENINGS ON GRADE FLOOR SHALL BE A MINIMUM OF 5.0 SQUARE FEET. EGRESS CLEAR OPENINGS ON ALL OTHER FLOORS SHALL BE A MINIMUM OF 5.7 SQUARE FEET.
- 6. EGRESS WINDOWS TO HAVE A MINIMUM CLEAR HEIGHT OF 24" AND A MINIMUM CLEAR OPENING WIDTH OF 20". SILL HEIGHT SHALL NOT EXCEED 44" ABOVE THE FINISH FLOOR. 6. ALL ANGLED WALLS ARE 45 DEGREES U.N.O.
- 7. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE CODES AND REGULATIONS.
- 8. CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT SITE BEFORE BEGINNING CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED IMMEDIATELY TO THE ARCHITECT IN WRITING FOR JUSTIFICATION AND / OR CORRECTION BEFORE PROCEEDING WITH WORK. CONTRACTORS SHALL ASSUME RESPONSIBILITY FOR ERRORS
- THAT ARE NOT REPORTED. 9. ALL DIMENSIONS SHALL BE READ OR CALCULATED AND NEVER
- 10. CONTRACTOR SHALL ENSURE COMPATIBILITY OF THE BUILDING WITH ALL SITE REQUIREMENTS.
- 11. ALL WOOD IN LOCATIONS SUBJECT TO TERMITE DECAY SHALL BE PRESSURE TREATED (CCA) OR BE OF AN APPROVED DECAY RESISTANT SPECIES. THIS INCLUDES, BUT NOT LIMITED TO, ALL EXTERIOR DECKS, SILLS AND SLEEPERS ON CONCRETE, MASONRY, OR IN DIRECT CONTACT WITH THE GROUND.

### DOOR LEGEND

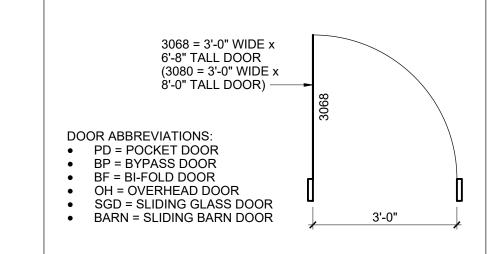

#### STRUCTURAL LEGEND

TRUSS / JOIST / RAFTER INDICATOR - DIRECTION OF SPAN EXTENTS OF STRUCTURE STEEL BEAM (SEE PLAN FOR SIZE) **─·─·** HEADER / BEAM (SEE PLAN FOR SIZE) GIRDER TRUSS (SEE TRUSS MANF DWGS) O

✓ STEEL COLUMN (SEE PLAN FOR SIZE) POINT LOAD LOCATION ■ POINT LOAD FROM ABOVE

ALL LVL AND 2x WOOD BEAMS: (D) = DROPPED. (F) = FLUSH ALL HEADERS AND BEAMS TO BEAR ON MINIMUM (1) KING STUD

(KS) & (1) JACK STUD (JS) EACH SIDE OF OPENING, U.N.O.

SEE SHEET A4-1 FOR GENERAL STRUCTURAL NOTES

# DATE ISSUED WITH: CHANGE DESCRIPTION

BUILDERS



SCALE: 1/4" = 1'-0" SHEET # / DESCRIPTION

**ROOF PLAN** 

DATE: 01.21.2024

