

National Radiology Data Registry

Facility Report, 2020 Jul-Dec

Sample Facility
(Facility ID: 100853)




nrdr.acr.org



This page is intentionally blank.

CT Colonography Registry

Jul 2020 - Dec 2020

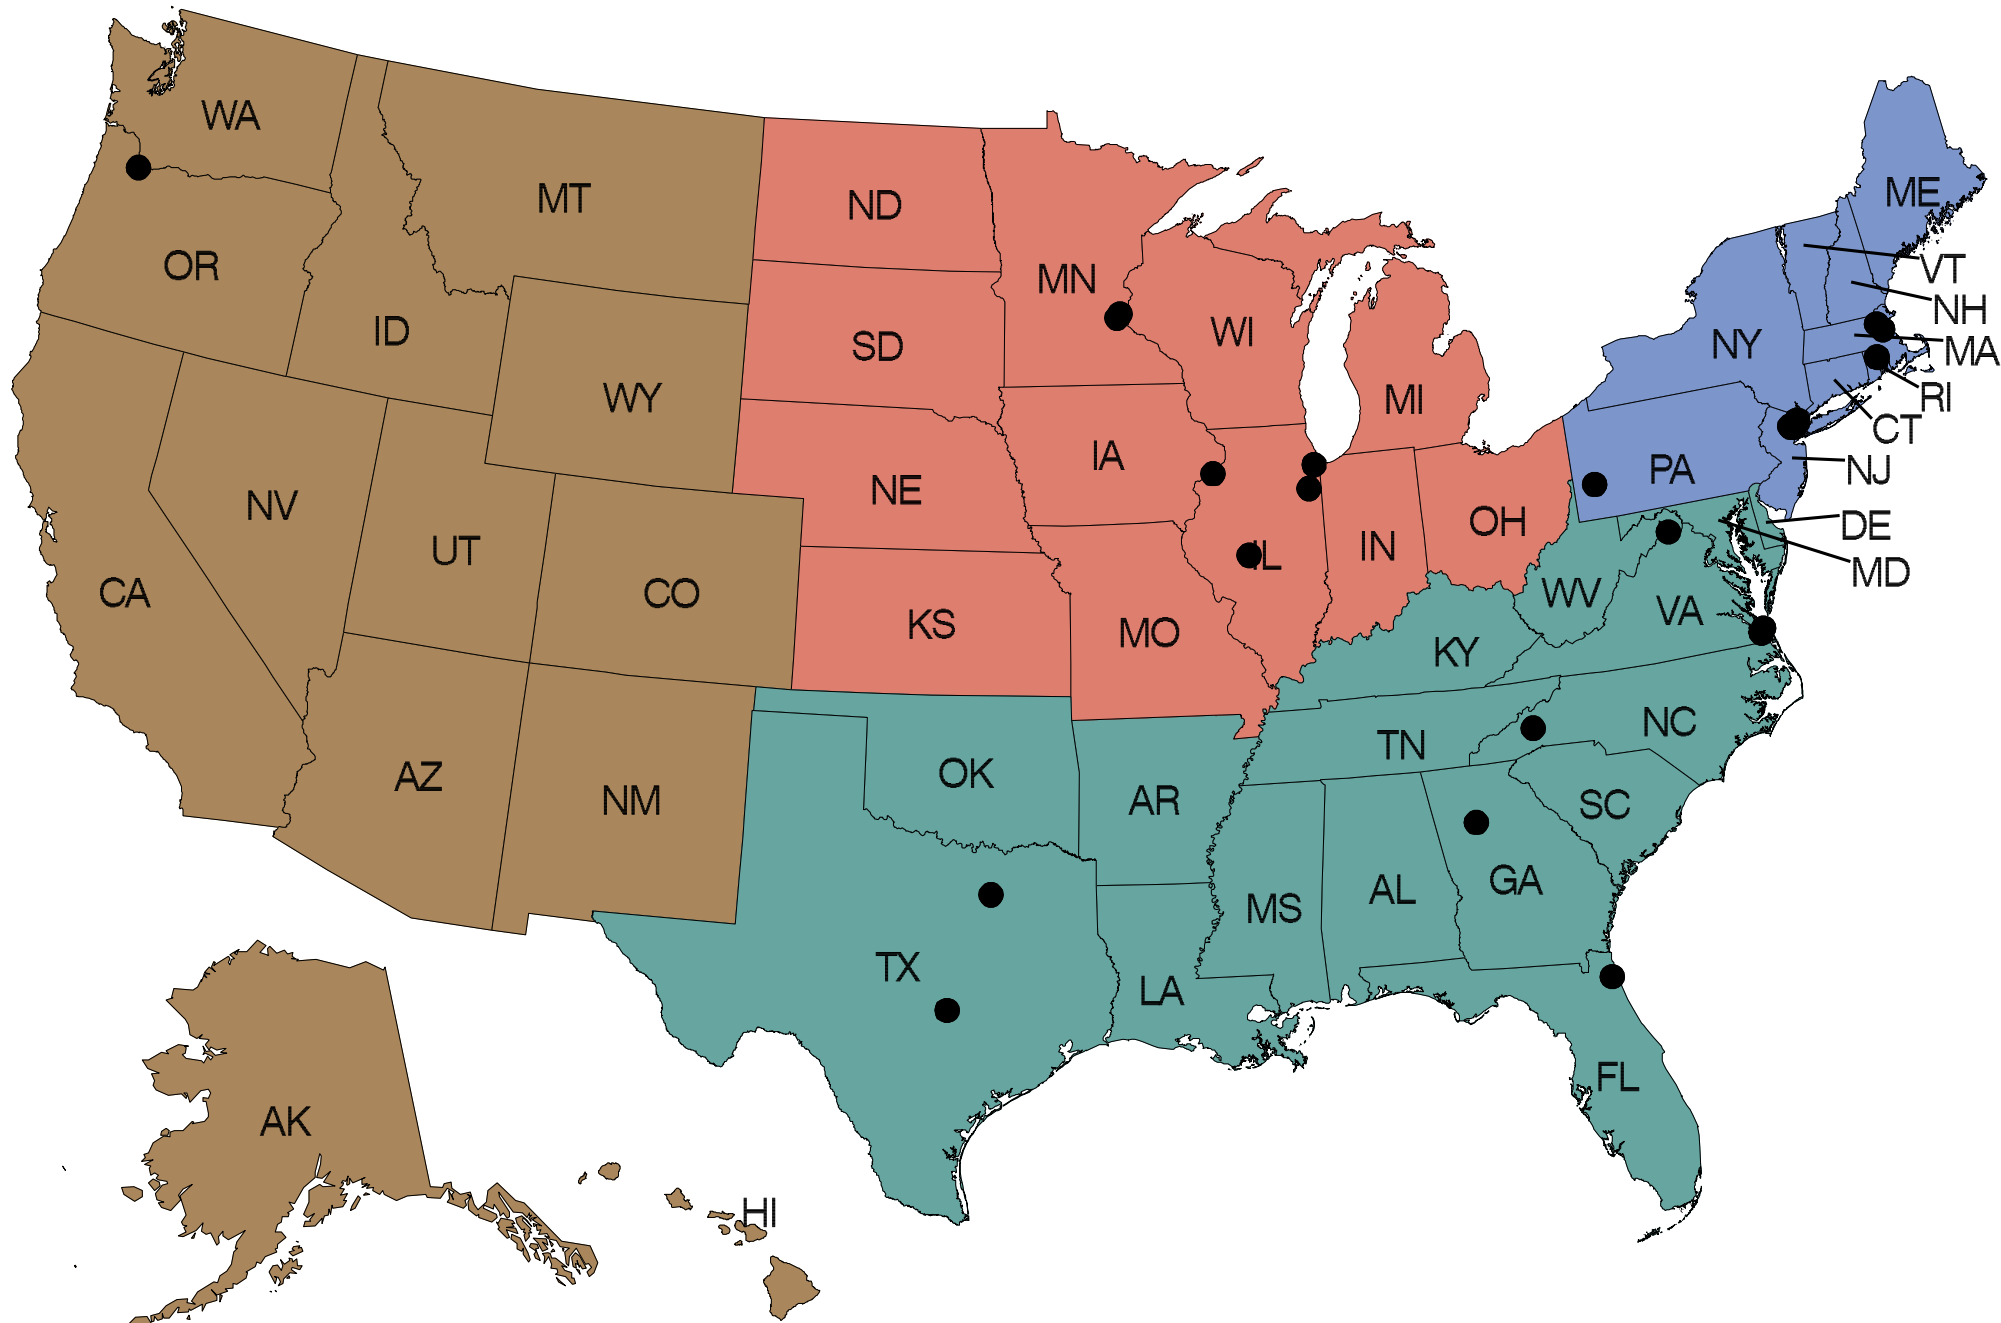

Black dots indicate CTC participating facilities

Census Region Northeast Midwest South West

CT Colonography Registry
Jul 2020 - Dec 2020
Summary Table - Sample Facility

	Facility						Registry		
	Your facility: 100853			Other facilities					
	Num ¹	Den ²	%	Num ¹	Den ²	%	Num ¹	Den ²	%
Adequate Bowel Cleansing and Distention	73	98	74.5	230	293	78.5	303	391	77.5
Adequacy of Screening CTC Exam	125	126	99.2	439	444	98.9	564	570	98.9
Adequacy of Diagnostic CTC Exam	5	19	26.3	7	52	13.5	12	71	16.9
Colonic Perforations	0	55	0.0	0	137	0.0	0	192	0.0
True Positives		0		1	1	100.0	1	1	100.0
Clinically Significant Extracolonic Findings	21	102	20.6	53	311	17.0	74	413	17.9

Table of CT DIvol - Sample Facility


<i>Your Facility (100853)</i>		<i>CTC Registry</i>	
<i>N</i>	<i>P25-Median-P75</i>	<i>N</i>	<i>P25-Median-P75</i>
130	(5/11/15)	546	(5/11/14)

¹Num (Numerator): Instances


²Den (Denominator): Total number eligible for measure
 Total # of cases in the CTC Registry= 673

CTC Facility Characteristics


Facility type
Sample Facility : Freestanding

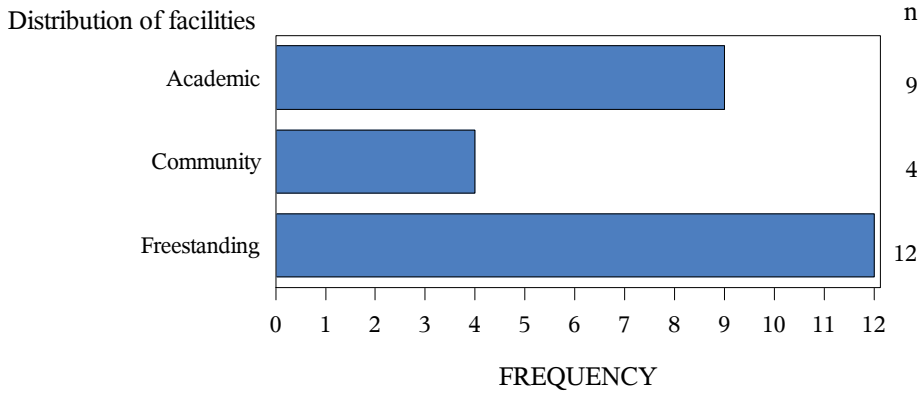


Location
Sample Facility : Metropolitan

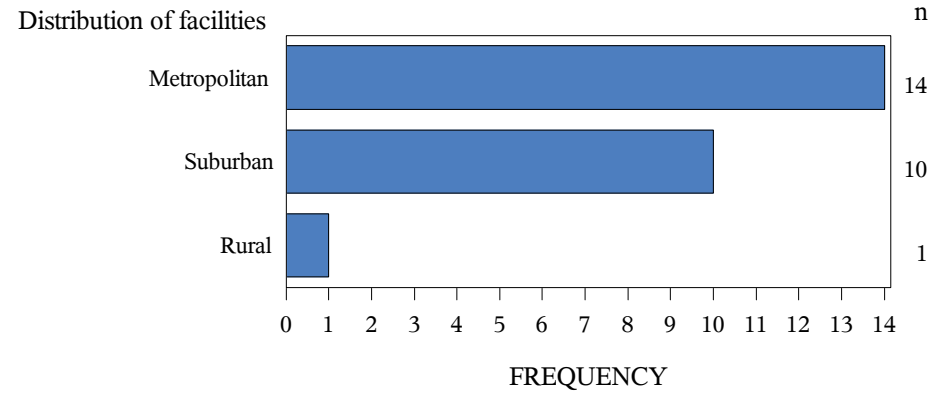

Number of exams
Sample Facility : <50

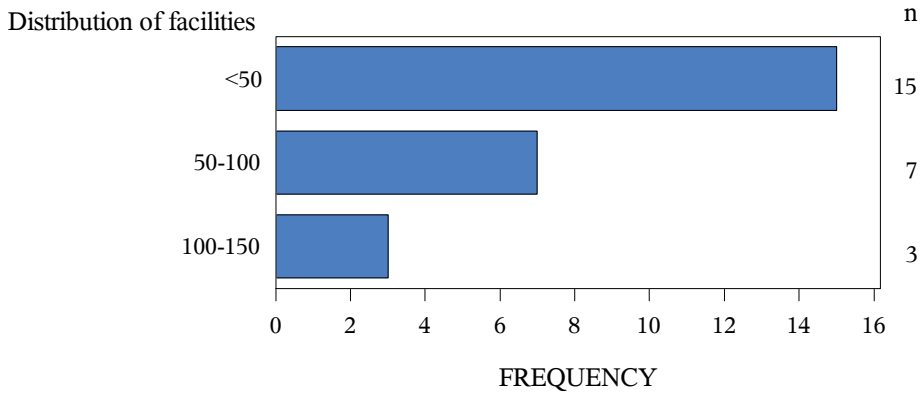


Census region
Sample Facility : South

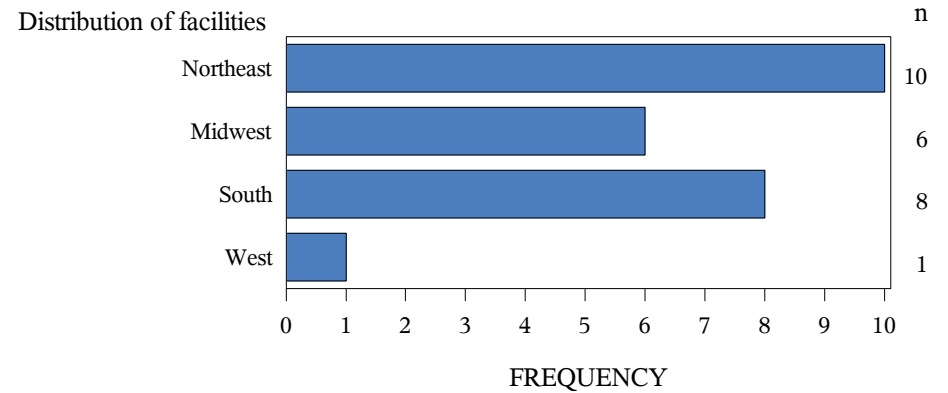

CT Colonography

Jul 2020 - Dec 2020


Summary Chart - Sample Facility

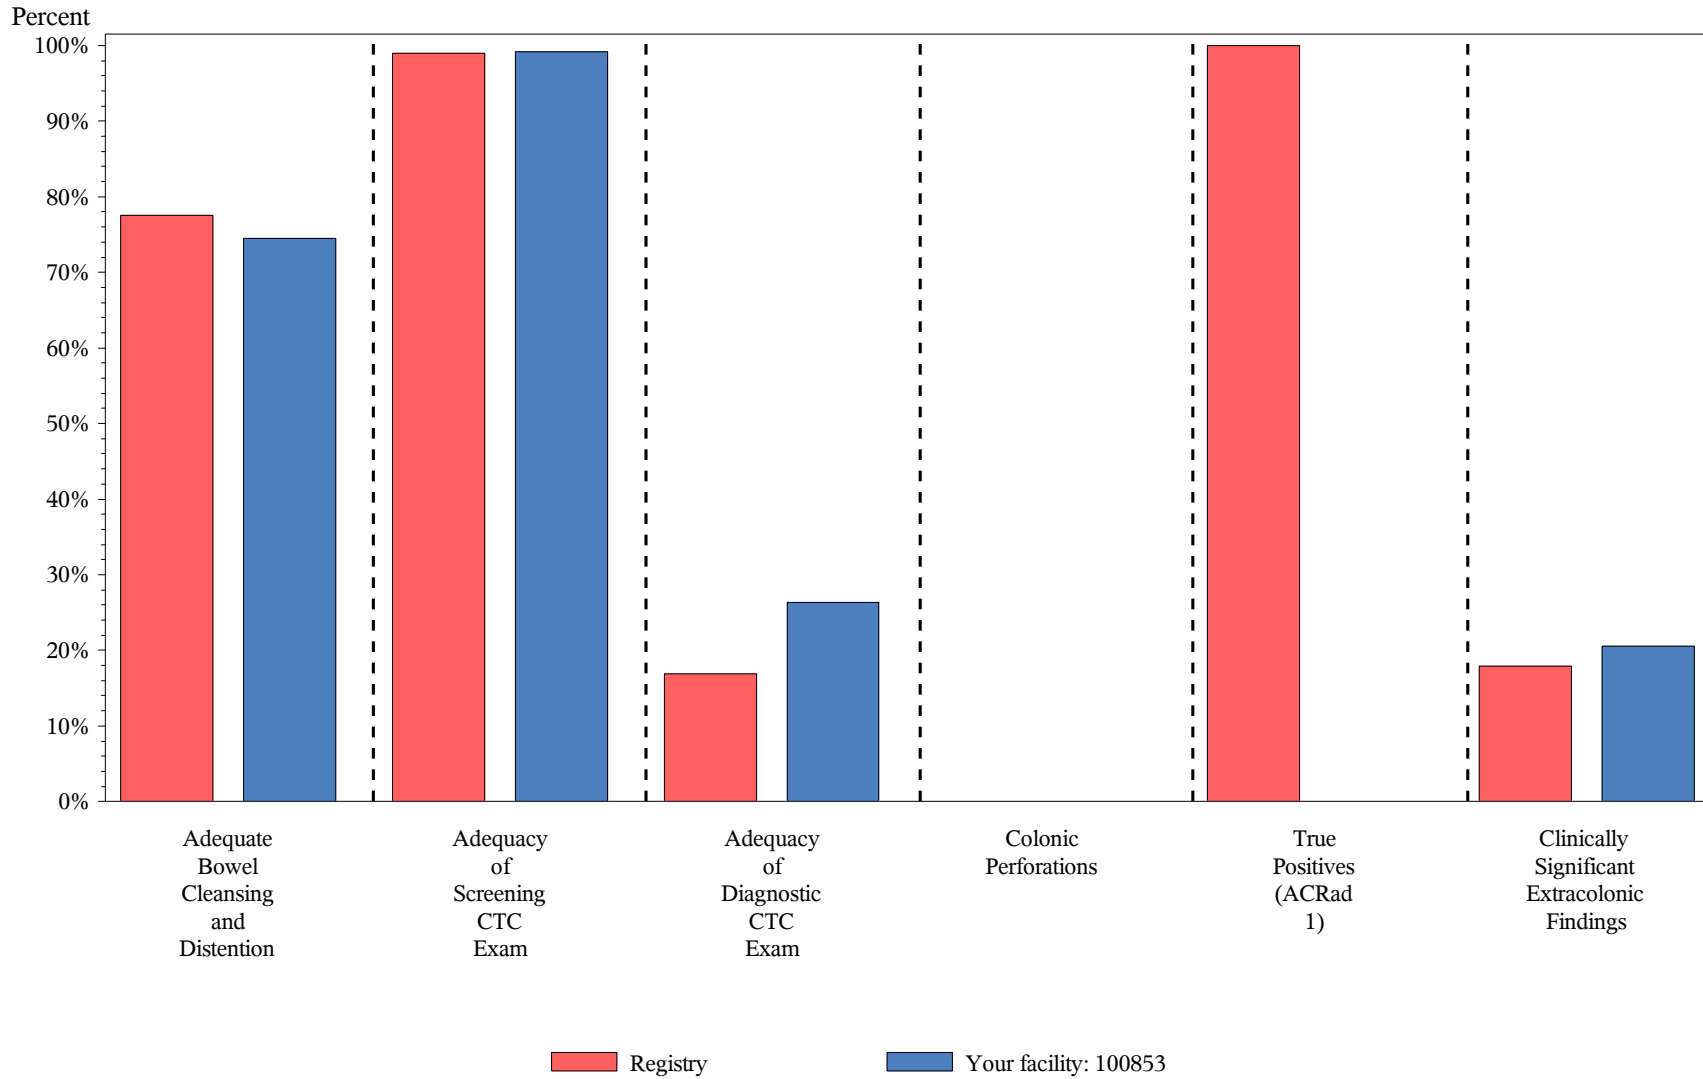

CT Colonography

Jul 2020 - Dec 2020


Trend Chart: Adequate Bowel Cleansing and Distention

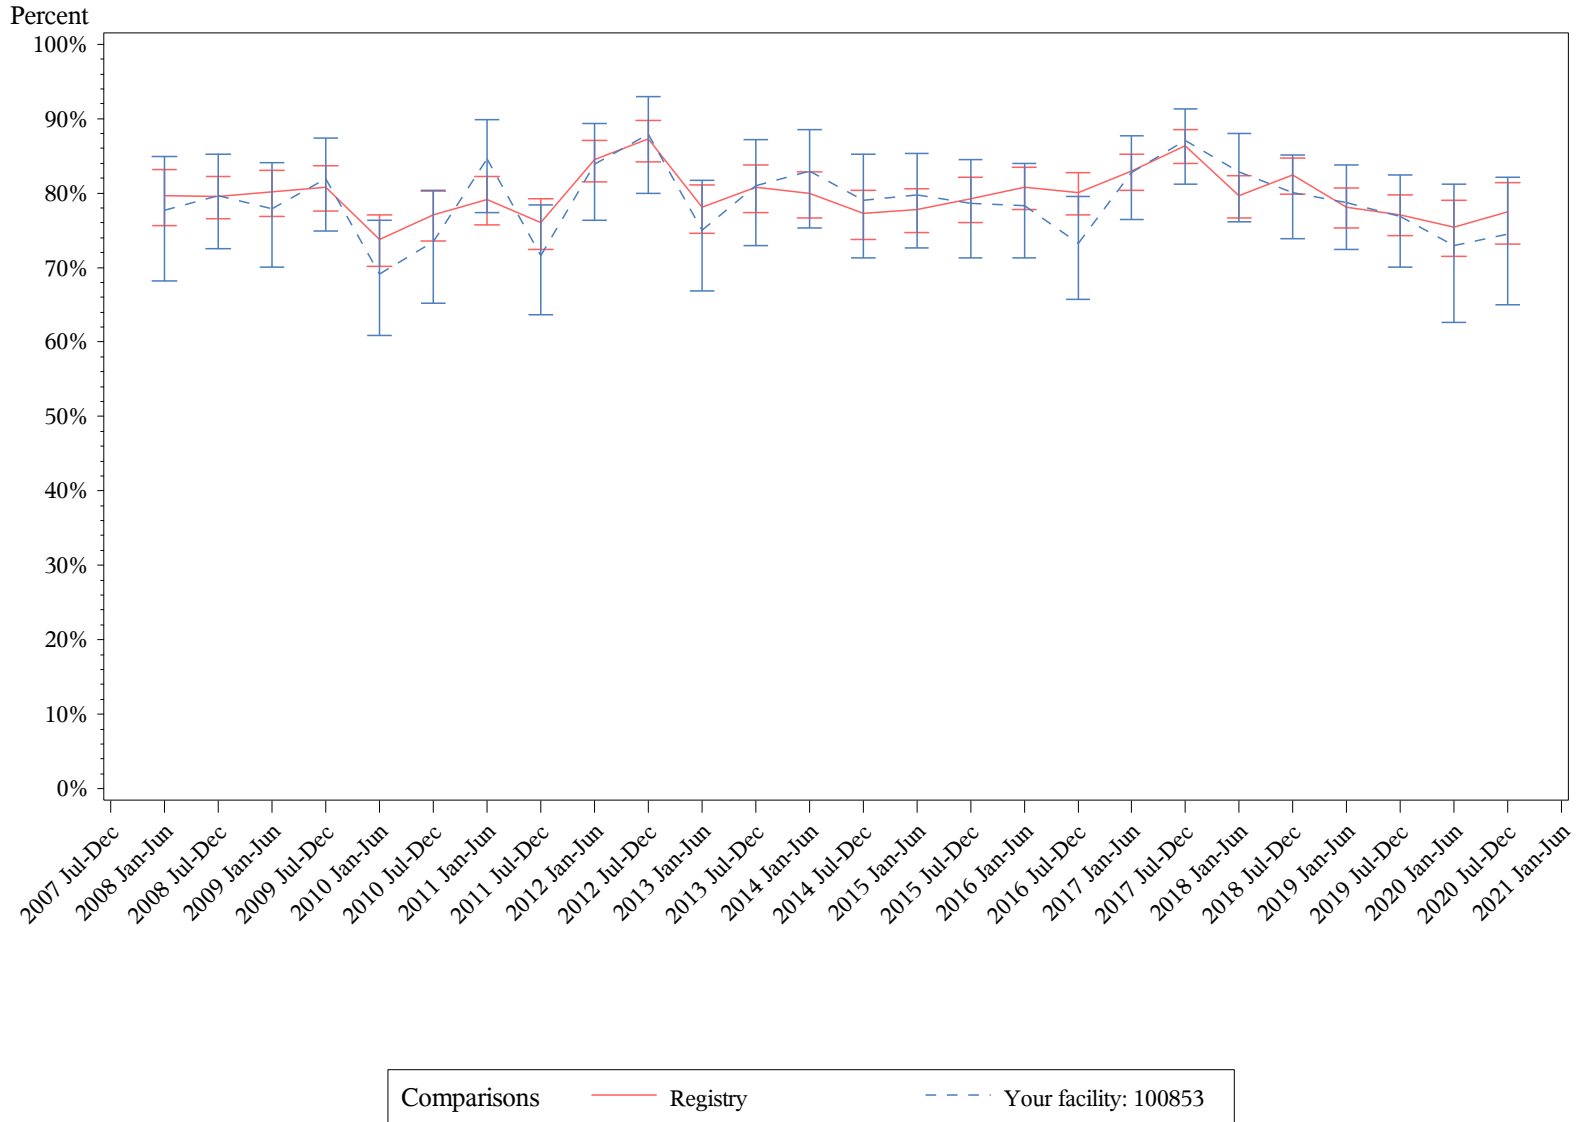

CT Colonography

Jul 2020 - Dec 2020

Trend Chart: Adequacy of Screening CTC Exam

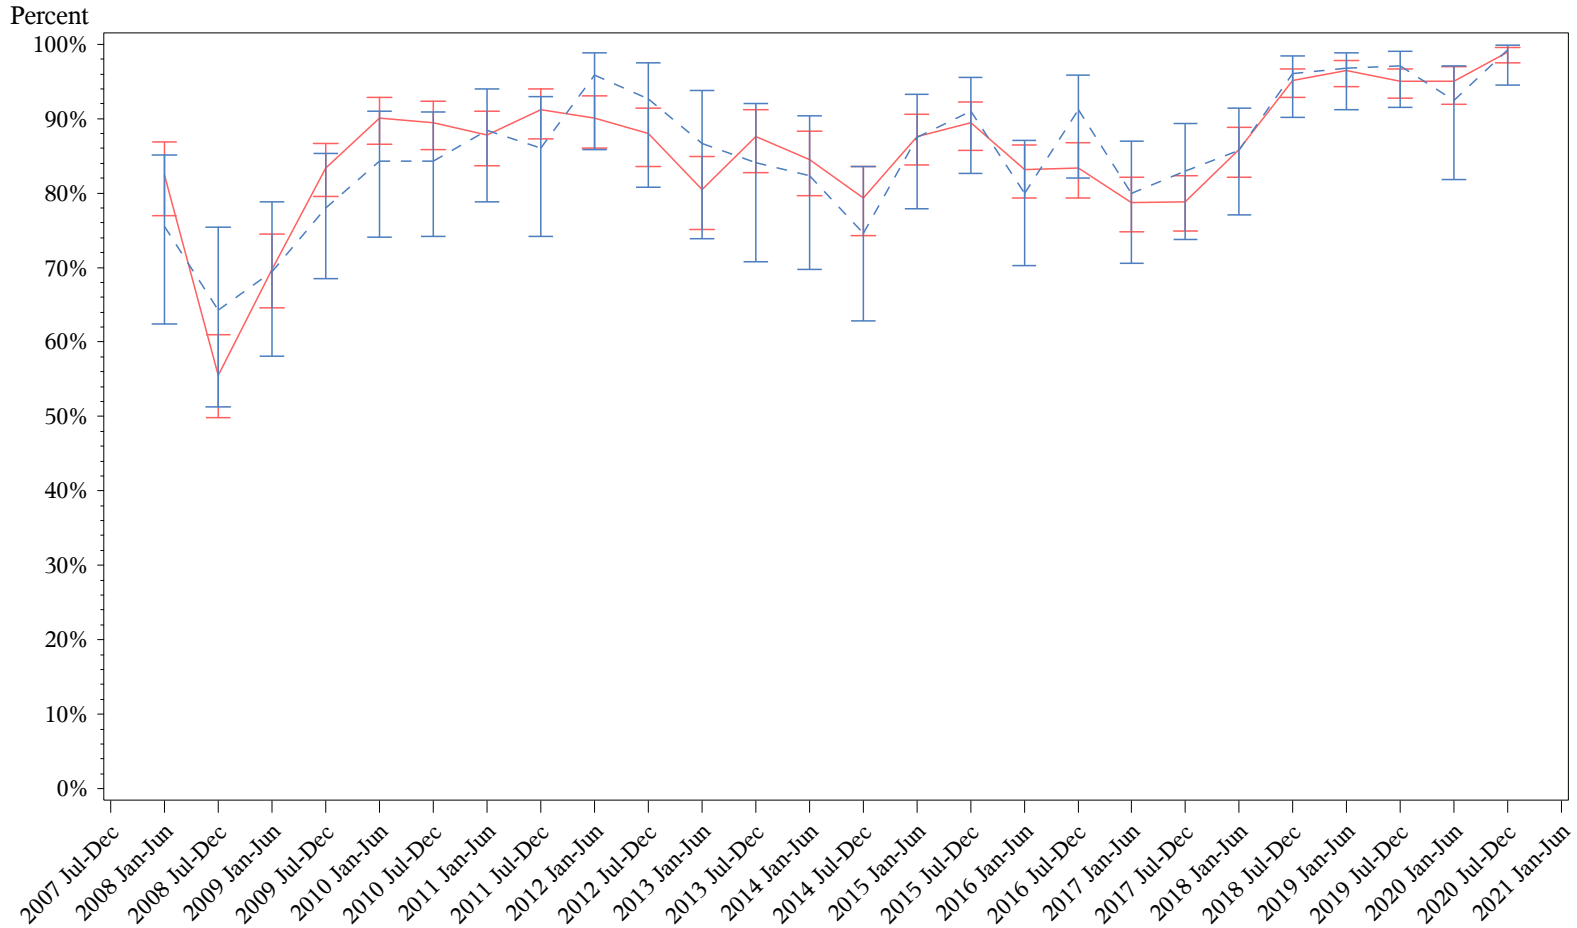


**For exams submitted before October 7, 2008, screening adequacy rates were calculated using collimation and kVp, effective mAs and quality reference mAs. For exams submitted on or after October 7, 2008, screening adequacy rates were calculated using CTDIvol.*

Comparisons — Registry - - - Your facility: 100853

CT Colonography

Jul 2020 - Dec 2020

Trend Chart: Adequacy of Diagnostic CTC Exam

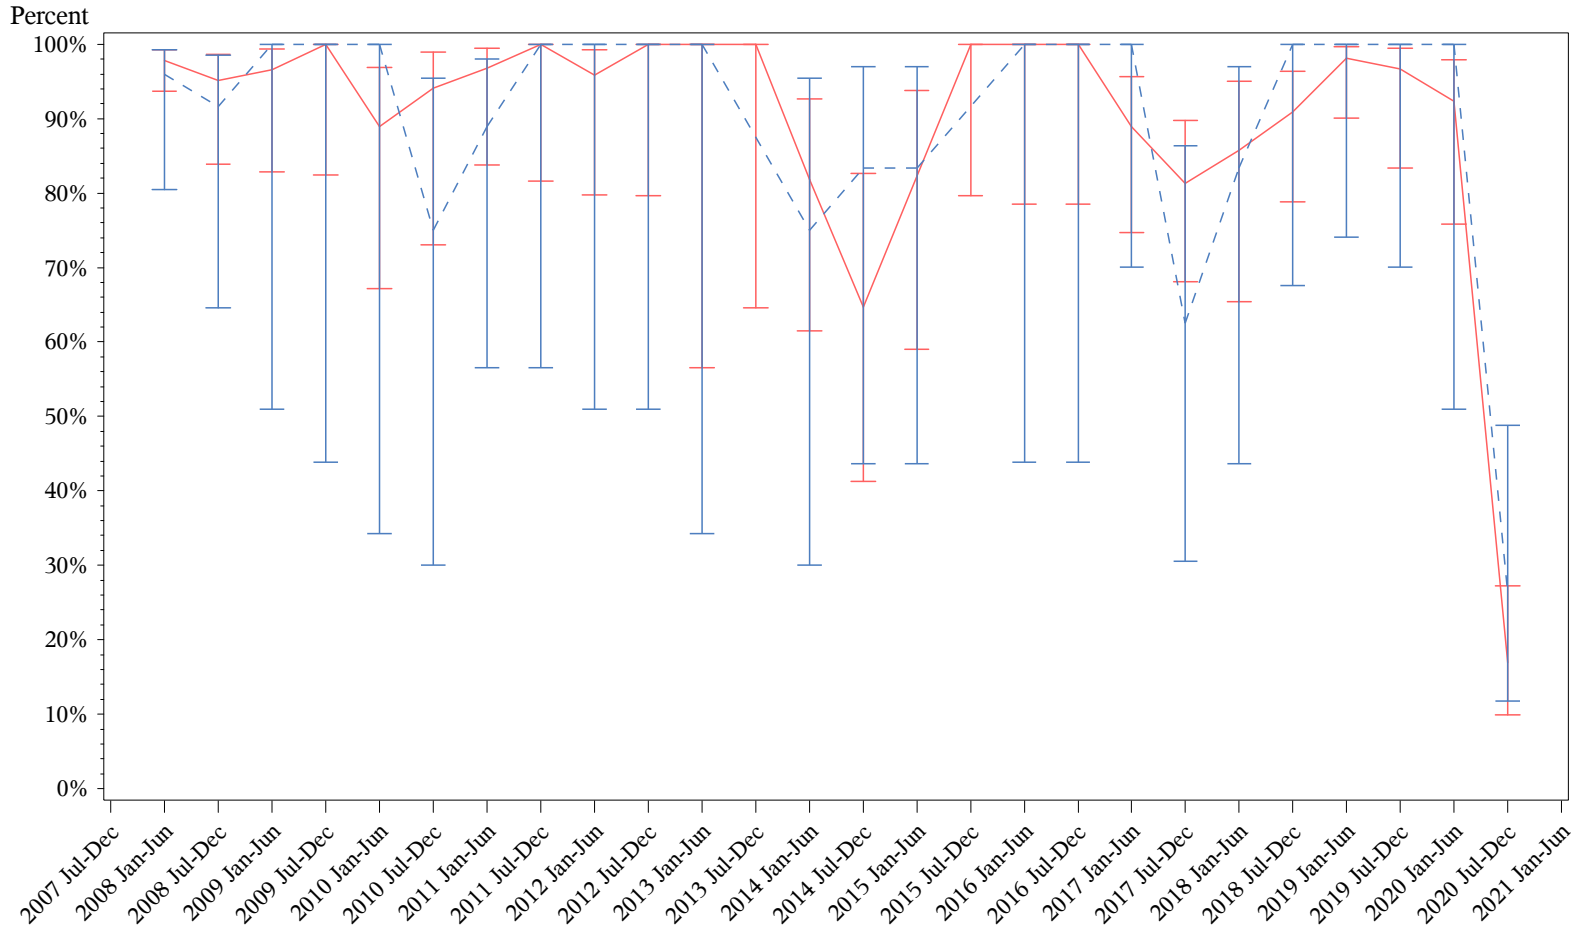


**For exams submitted before October 7, 2008, diagnostic adequacy rates were calculated using collimation and kVp.*

Comparisons Registry Your facility: 100853

CT Colonography

Jul 2020 - Dec 2020


Trend Chart: Colonic Perforations

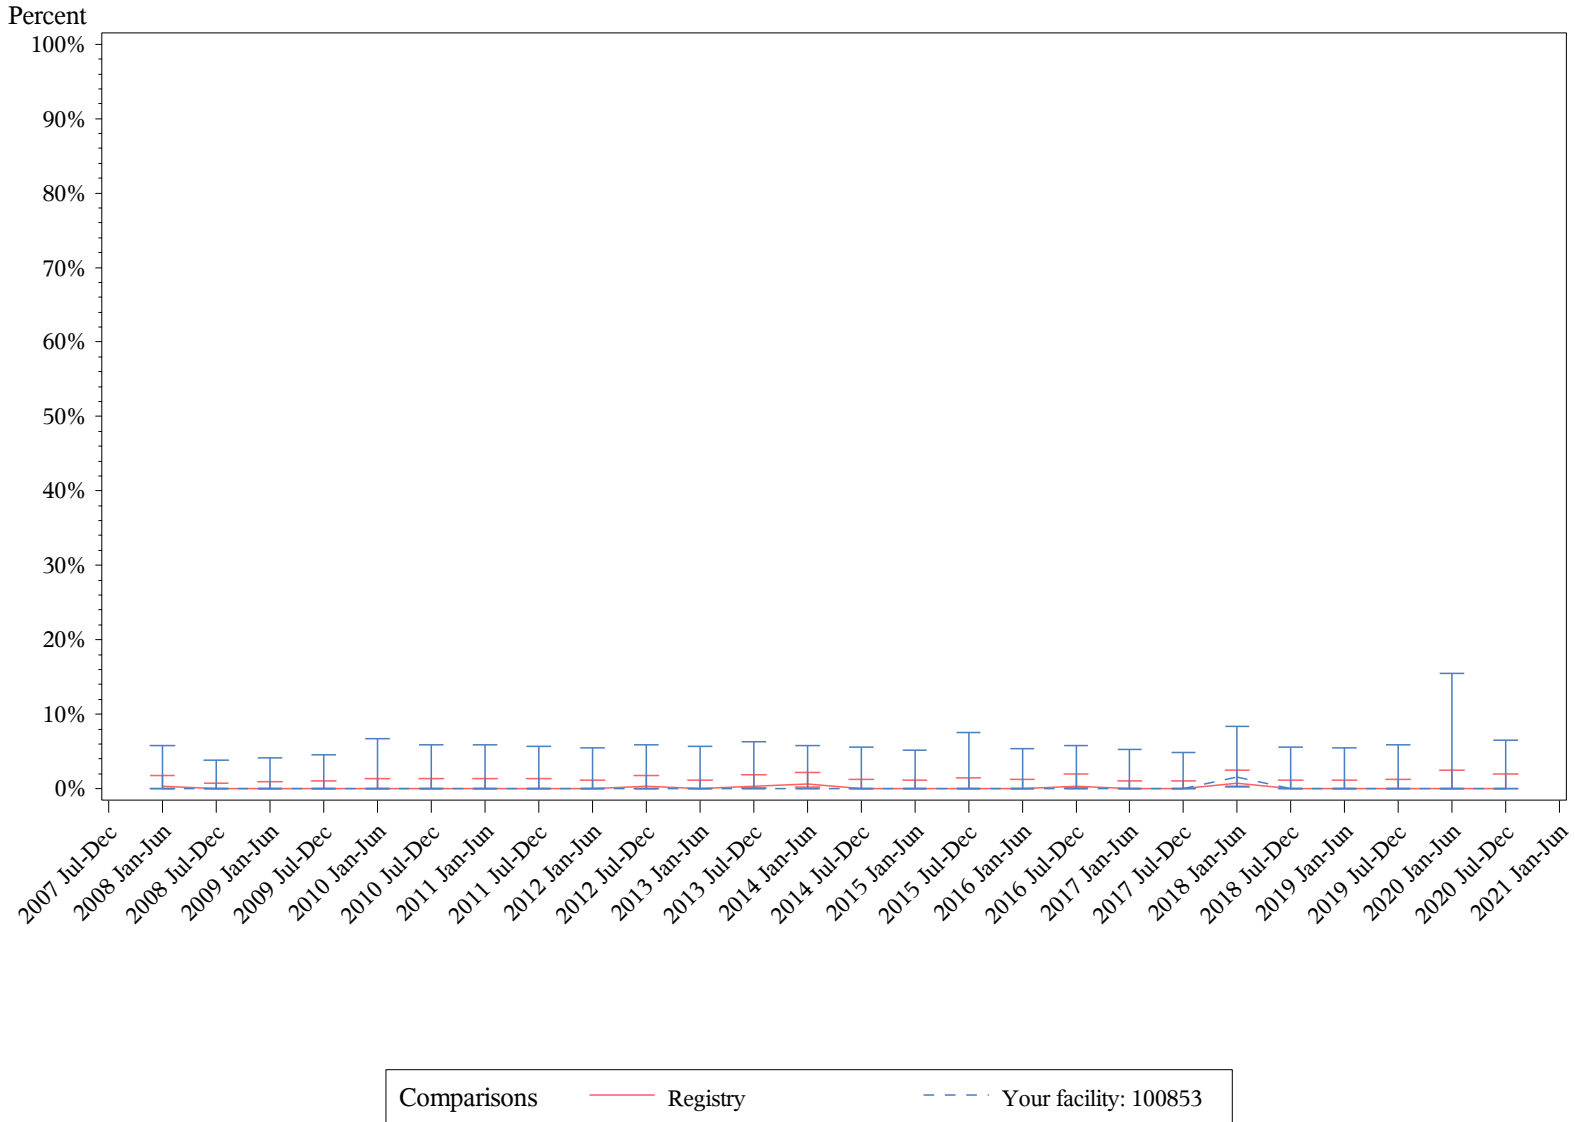

CT Colonography

Jul 2020 - Dec 2020


Trend Chart: True Positives (ACRad 1)

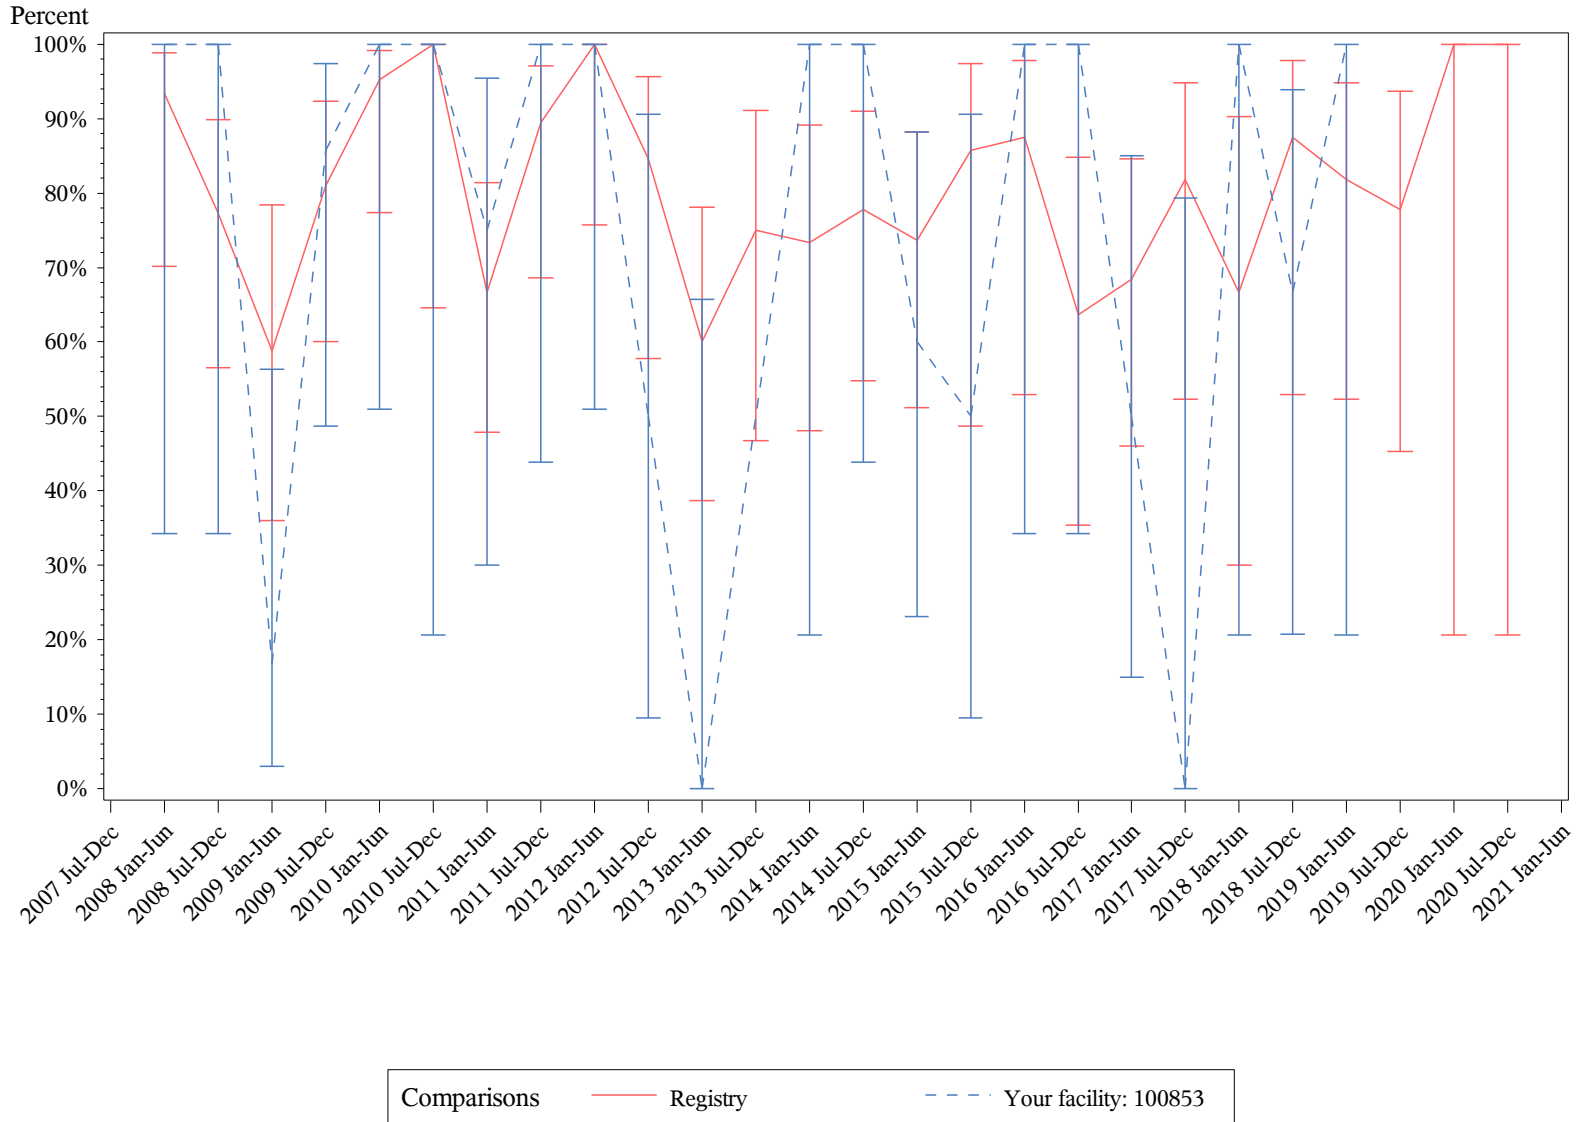

CT Colonography

Jul 2020 - Dec 2020

Trend Chart: Clinically Significant Extracolonic Findings

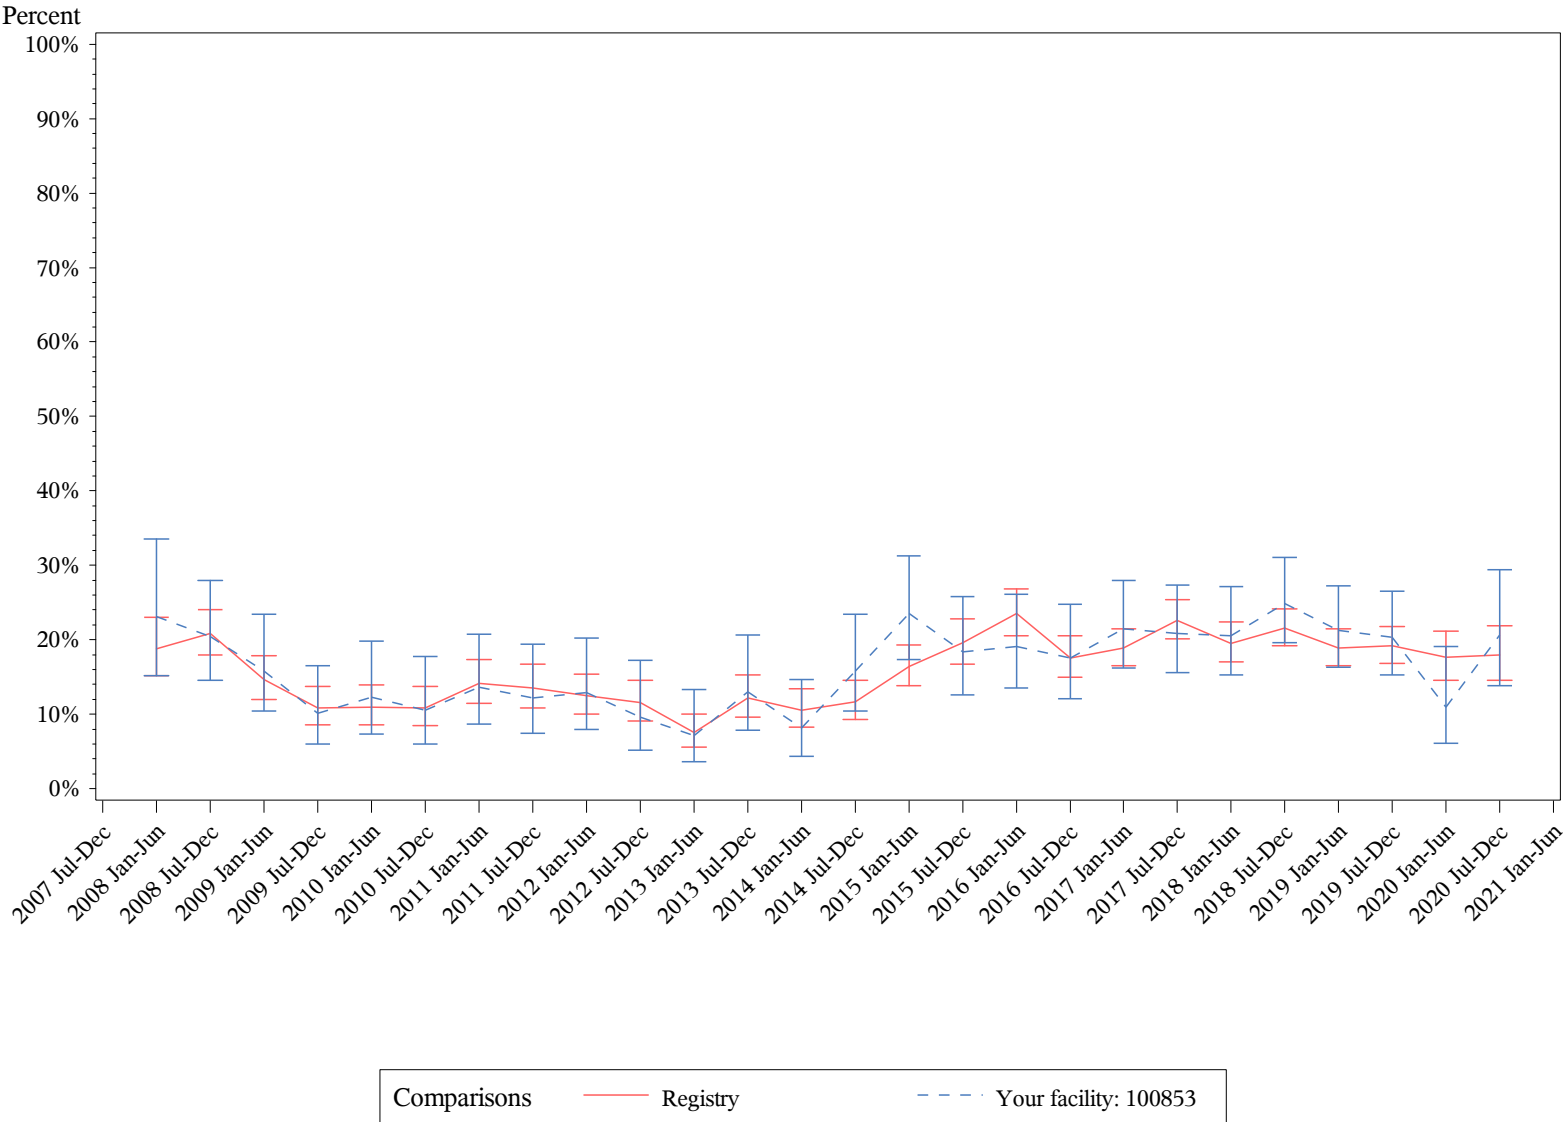

This page is intentionally blank.

Promote your participation in NRDR™!
Download your marketing toolkit today.

acr.org/CTCtoolkit

CONTACT US

1.800.227.5463, ext. 3535
nrd@acr.org | nrd.acr.org

