


**1 POWER, TELEPHONE, SECURITY, SPECIAL SYSTEMS, DEMOLITION FLOOR PLAN**  
SCALE 3/32" = 1'-0"

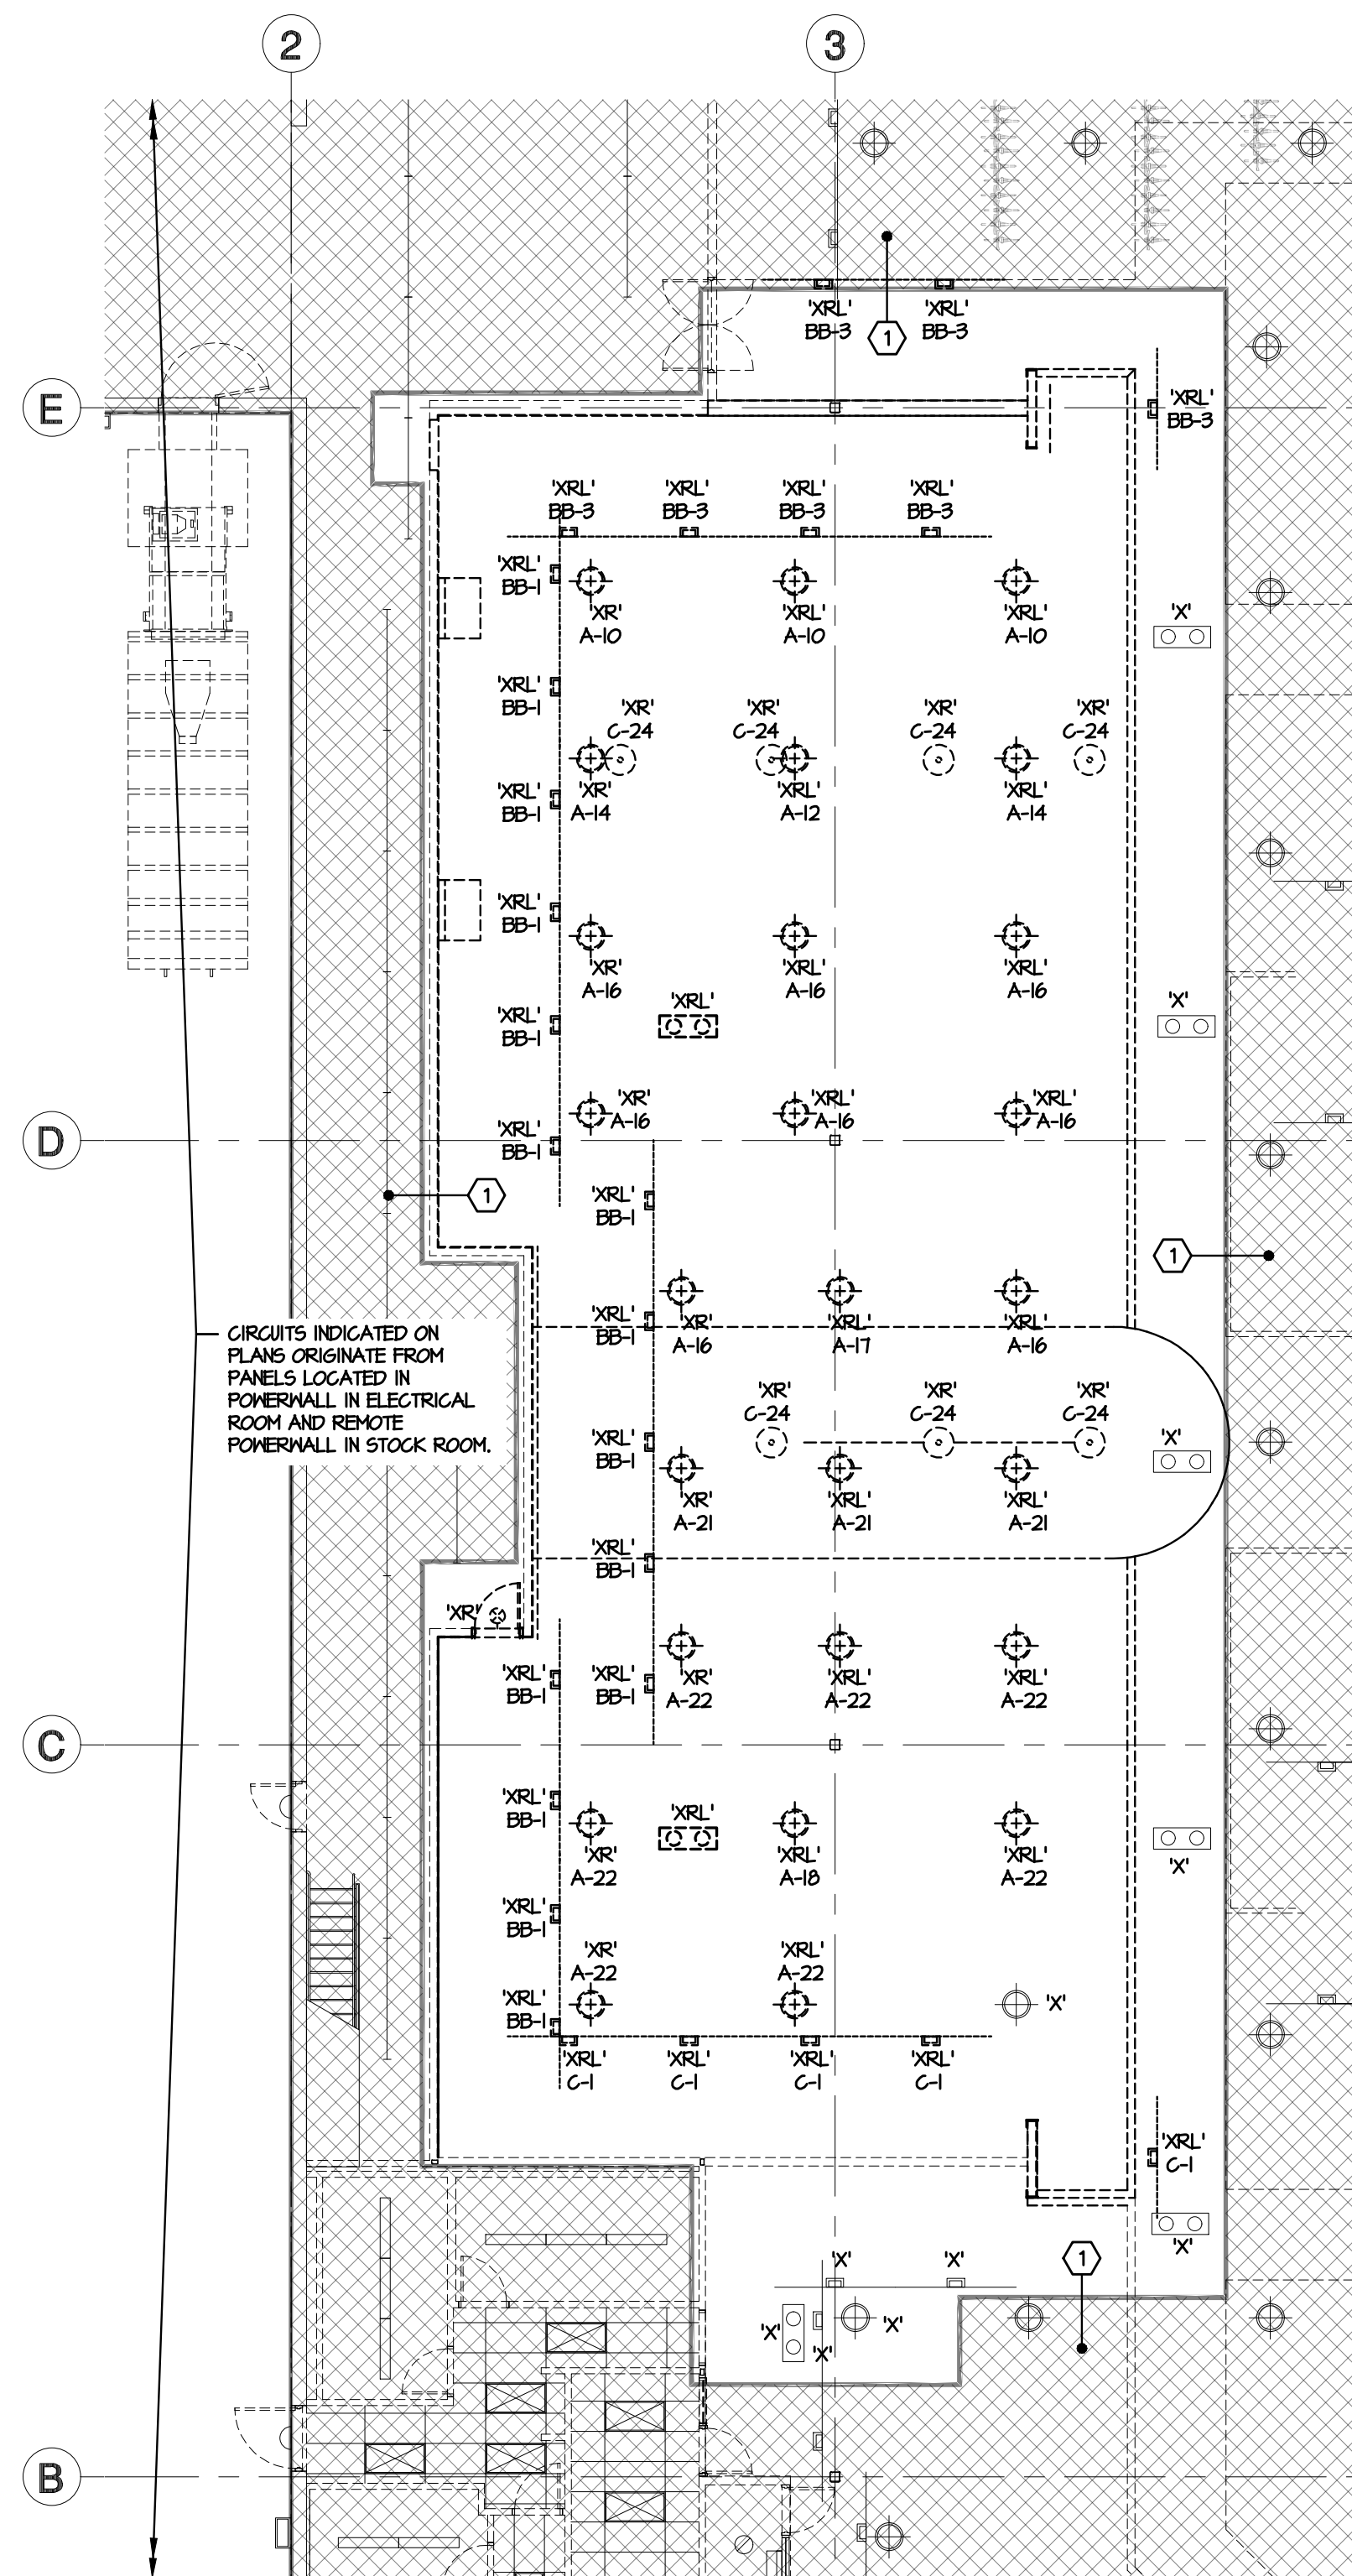

**2 LIGHTING DEMOLITION PLAN**  
SCALE 3/32" = 1'-0"

SYMBOL LIST	
	HIGHBAY LIGHTING FIXTURE
	HIGHBAY NIGHTLIGHT FIXTURE
	TRACK HEAD LIGHT AND TRACK FIXTURE
	STRIP LIGHTING FIXTURE
	STRIP LIGHTING FIXTURE WITH EMERGENCY BATTERY DRIVER
	PENDANT MOUNTED EMERGENCY LIGHTING FIXTURE
	WALL MOUNTED EMERGENCY LIGHTING FIXTURE
	EXIT LIGHT FIXTURE
	EXIT LIGHT FIXTURE, WALL MOUNTED
	DATA CABLE LOCATION
	TEMPERATURE SENSOR
	CARBON DIOXIDE SENSOR
	COMBINED TEMPERATURE / RELATIVE HUMIDITY / CARBON DIOXIDE SENSOR
	ACCESS POINT IN CEILING
	FIRE ALARM WALL MOUNTED VISUAL ONLY DEVICE
	FIRE ALARM WALL MOUNTED AUDIOVISUAL DEVICE
	FIRE ALARM CEILING OR PENDANT MOUNTED AUDIOVISUAL DEVICE

BA LEGEND	
SYMB	DESCRIPTION
	DOOR CONTACT
	CURTAIN MOTION
	MOTION DETECTOR - 360 DEG CEILING MOUNTED
	CEILING INFRARED SENSOR

CCTV LEGEND	
SYMB	DESCRIPTION
	FIXED CAMERA
	CAMERA - PENDANT MOUNTED
	PUBLIC VIEW MONITOR
	DEAD DROP

SPEAKER LEGEND	
I	SPEAKER # IN ZONE
F	ZONE (A THROUGH G)
	SPEAKER MOUNTED TO BOTTOM OF JOIST
	VOLUME CONTROL SPEAKER, CEILING MOUNT
	HORN SPEAKER
	VOLUME CONTROL SWITCH

**GENERAL DEMOLITION NOTES:**

A. THIS CONTRACTOR SHALL PERFORM ALL DEMOLITION OF EXISTING ELECTRICAL SYSTEMS AS INDICATED ON ELECTRICAL AND ARCHITECTURAL PLANS OR NECESSARY FOR THE PROJECT. REMOVE FROM SITE AND PROPERLY DISPOSE OF ALL MATERIAL AND DEBRIS FROM THIS WORK.

B. DEMOLITION DRAWINGS ARE GENERAL IN NATURE SHOWING THE SCOPE OF DEMOLITION WORK. CONTRACTOR SHALL VISIT THE SITE AND BECOME FAMILIAR WITH THE QUANTITY OF LIGHT FIXTURES, DEVICES, OUTLETS, CONNECTIONS, ETC. REMOVE ALL LIGHT FIXTURES, EQUIPMENT AND DEVICES AS NOTED OR NO LONGER REQUIRED FOR FINISHED CONSTRUCTION. ALL EXISTING RELATED CONDUIT, WIRE AND DEVICES IN PROJECT AREAS SHALL BE REMOVED AND DISPOSED OF. REMOVE CONDUITS BEYOND NEW SURFACES. REMOVE ALL EXISTING WIRE FROM CONDUIT BACK TO POINT OF COMMON USE OR TO PANELS. LABEL EXISTING CIRCUIT BREAKERS "SPARE" IF NOT REUSED FOR NEW WORK.

C. DISCONNECT EXISTING EQUIPMENT IN BUILDING THAT IS TO BE REMOVED UNDER OTHER SECTIONS. REMOVE DATA AND PHONE CABLEING SYSTEMS AS DIRECTED BY OWNER. NO CABLES SHALL BE REMOVED OR CUT WITHOUT APPROVAL FROM OWNER. ANY EXISTING CABLES TO REMAIN SHALL BE SUPPORTED FROM STRUCTURE BEFORE CEILING REMOVAL.

D. PATCH ALL SURFACES TO MATCH SURROUNDING FOR DEVICES TO BE REMOVED FROM EXISTING WALLS TO BE MAINTAINED. EXISTING ROUGH-IN BOXES IN WALL TO REMAIN MAY BE REUSED IF CODE COMPLYING AND APPROVED FOR LOCATION BY ARCHITECT.

E. THE OWNER RESERVES THE RIGHT OF SALVAGE FOR ALL EXISTING ELECTRICAL EQUIPMENT PRIOR TO DEMOLITION. THE CONTRACTOR SHALL REVIEW ALL MATERIALS AND DELIVER TO THE OWNER THOSE REQUIRED IN THEIR EXISTING CONDITION. ALL OTHER MATERIAL SHALL BE REMOVED BY THIS CONTRACTOR.

F. ALL CIRCUITS WHICH ARE REQUIRED TO REMAIN ACTIVE SHALL BE MAINTAINED OR REWORKED AS REQUIRED. ANY EXISTING CIRCUITS OR CABLEING SYSTEMS SERVING AREAS NOT AFFECTED BY DEMOLITION SHALL BE MAINTAINED. ALL CIRCUITS SHALL BE VERIFIED WITH EXISTING DRAWINGS AND ACTUAL FIELD CONDITIONS PRIOR TO BEGINNING DEMOLITION.

G. CONTRACTOR MAY OPTION TO REUSE HIRING WHEN FEASIBLE WHERE EQUIPMENT IS BEING REMOVED AND REPLACED IN THE SAME LOCATION, E.G. SHALL REFERENCED NEW WORK DRAWINGS TO SEE IF CIRCUITS ARE REUSED. IF HIRING IS IN ACCEPTABLE CONDITION, IT MAY BE USED TO REFEED NEW OR RELOCATED EQUIPMENT.

H. STORE TO REMAIN OPEN DURING DEMOLITION AND CONSTRUCTION, G.G. / E.G. TO GO OVER CONSTRUCTION PHASING SCHEDULE WITH DSO CONSTRUCTION MANAGER.

I. CONTRACTOR TO MAINTAIN ALL LOW VOLTAGE SYSTEM DEVICES THAT ARE NOT AFFECTED BY REMODEL. VERIFY QUANTITY AND LOCATION OF DEVICES IN THE FIELD. REFER TO NEW WORK PLANS FOR ADDITIONAL INFORMATION.

**DEMOLITION SYMBOLS:**

X' = INDICATES EXISTING DEVICE TO REMAIN.

XR' = INDICATES EXISTING DEVICE TO BE REMOVED, INCLUDING ALL CONDUIT AND WIRING BACK TO PANEL OR POINT OF COMMON USAGE.

XRL' = INDICATES EXISTING DEVICE TO BE REMOVED AND RELOCATED, EXTEND EXISTING WIRING AND REWIRE WITH LIKE KIND OR AS SHOWN ON DRAWING. CORRESPONDS WITH XR'.

XRL' = INDICATES NEW LOCATION OF RELOCATED EQUIPMENT. CORRESPONDS WITH XRL'.

XRM' = INDICATES EXISTING DEVICE TO BE REWORKED. REWORK AS SHOWN OR REPLACE EXISTING DEVICE WITH NEW AND REMARKS INDICATED.

XRD' = INDICATES EXISTING DEVICE TO BE DISCONNECTED AND ALL CONDUIT AND WIRING TO BE REMOVED.

CTX = INDICATES CONNECT TO EXISTING CIRCUITS.

**CODED NOTES:**

1. ALL EXISTING ELECTRICAL POWER, LIGHTING, LOW VOLTAGE SOUND, AND FIRE PROTECTION IN HATCHED AREA IS EXISTING TO REMAIN X'. MAINTAIN ALL EXISTING CONTROLS AND RELATED WIRING BACK TO PANELS OR POINT OF COMMON USAGE.

2. EXISTING FLOOR OUTLET TO BE DISCONNECTED AND CIRCUIT CAPPED AND LABELED SPARE WITH DETAILS ON LOCATION.

FOR ALL LIGHTING CIRCUITS THROUGHOUT THE SALES AREA, THE E.G. CAN OPTION TO REUSE, WHEREVER POSSIBLE, ANY EXISTING CONDUIT THAT IS IN CODE COMPLIANT CONDITION. ALL WIRING IS TO BE NEW FOR LIGHTING CIRCUITS, RECONNECT TO EXISTING CONTROLS AND ANY LIGHTING / EMERGENCY LIGHTING / EXIT SIGNS NOT SPECIFICALLY ADDRESSED SHALL BE RE-CIRCUITED TO NEAREST CIRCUITS PER THE CIRCUITING DESIGN SCHEME SHOWN. SUBMIT RFI WITH FIXTURE LOCATIONS TO ENGINEER OF RECORD IF CLARIFICATION IS NEEDED FOR ITEMS NOT ADDRESSED ON THIS DRAWING.

**MICHAEL CRISLIP ARCHITECT**  
25001 Emory Road, Suite 400  
Cleveland, Ohio 44128  
216.223.3200 mcr@mcra.com

Design and construction documents are instruments of service and the property of Michael Crislip Architect. The use of this design and these construction documents for purposes other than the specific project named herein is strictly prohibited without express written consent of Michael Crislip, Architect.

**SELF-DEVELOPED STORES**  
All work, materials, and systems shown in these plans and specifications, including but not limited to, shall be in accordance with the applicable building codes and standards. The Contractor shall be responsible for obtaining all necessary permits and approvals. The Contractor shall be responsible for obtaining all necessary permits and approvals. The Contractor shall be responsible for obtaining all necessary permits and approvals.

**DICK'S SPORTING GOODS**  
3800 GALLERIA DRIVE  
GREENVILLE, NC 27634  
STORE #1086

Project No.: 24.0122  
Drawn By: NA  
Date: 04-19-24  
Issue: BID / PERMIT

CONTRACTOR MUST VERIFY ALL CLEARANCES AND DIMENSIONS IN FIELD

**Mc&A**  
Consulting Engineers est. 1980  
25001 Emory Road, Suite #201  
Warrsville Heights, Ohio 44128  
Phone: 216-292-4696  
Fax: 216-292-8074  
Email: mca@mcra.com  
North Carolina Certificate Number: C-0085

**ED1.0**  
ELECTRICAL DEMOLITION PLANS

**DESIGNER STATEMENT**  
I hereby certify that the design of this building complies with the mechanical systems, service systems and equipment requirements of the 2018 North Carolina State Building Code & Energy Conservation Code.  
Signed: \_\_\_\_\_  
Date: \_\_\_\_\_