

Building Management System Integration for C•CURE 9000

USER GUIDE

Version 2.90

C•CURE and Software House are registered trademarks of Johnson Controls.

The trademarks, logos, and service marks displayed on this document are registered in the United States [or other countries]. Any misuse of the trademarks is strictly prohibited and Johnson Controls will aggressively enforce its intellectual property rights to the fullest extent of the law, including pursuit of criminal prosecution wherever necessary. All trademarks not owned by Johnson Controls are the property of their respective owners, and are used with permission or allowed under applicable laws.

Product offerings and specifications are subject to change without notice. Actual products may vary from photos. Not all products include all features. Availability varies by region; contact your regional sales manager.

This manual is proprietary information of Software House. Unauthorized reproduction of any portion of this manual is prohibited. The material in this manual is for information purposes only. It is subject to change without notice. Software House assumes no responsibility for incorrect information this manual may contain.

© 2020 Johnson Controls. All rights reserved. JOHNSON CONTROLS, TYCO and SOFTWARE HOUSE are trademarks of Johnson Controls.

Table of Contents

Preface	6
How to Use this Manual	7
Finding More Information	9
Conventions	10
Chapter 1 - Introduction	11
Overview	12
Features	12
Architecture	12
Using the Building Automation Pane	14
BMS integration Tasks	15
Chapter 2 - Installation	16
Overview	17
Before you begin	17
Getting the BMS integration	18
Installing the BMS integration	19
Uninstalling the BMS integration	22
Chapter 3 - BACnet Device Discovery	25
Overview	26
Auto Discovery BACnet Devices	27
Importing Device Objects Manually	30
Chapter 4 - BACnet Device Editor	31
BACnet Device Editor Overview	32
Accessing the BACnet Device Editor	33
Adding a BACnet Device Object	34
Deleting a BACnet Device Object	35
BACnet Device General Tab	36
BACnet Device General Tab Definitions	36
Configuring a BACnet Device Object	38
BACnet Device Triggers Tab Definitions	39
Defining a Trigger for a BACnet Device	39
BACnet Device - Status Tab	41

BACnet Device Status Tab Definitions	41
BACnet Device - State Images Tab	42
Customizing State Images for a BACnet Device	42
Chapter 5 - BACnet Object Editor	43
BACnet Object Editor Overview	44
Accessing the BACnet Object Editor	45
Deleting a BACnet Object	46
BACnet Object - General Tab	47
BACnet Object General Tab Definitions	47
Configuring a BACnet Object	49
Configuring Data Update Mechanism for a BACnet Object	49
BACnet Object - Triggers Tab	50
BACnet Object Triggers Tab Definitions	50
Defining a Trigger for a BACnet Object	51
BACnet Object - Status Tab	53
BACnet Object Status Tab Definitions	53
BACnet Object - State Images Tab	54
Customizing State Images for a BACnet Object	54
BACnet Schedule Object - Object Configuration Tab	56
BACnet Schedule Object - Object Configuration Tab Definitions	56
BACnet Schedule Object - Schedule Configuration Tab	57
Chapter 6 - Acknowledge Ack required Event Notification	59
Acknowledge Ack required Event Notification Overview	60
Accessing the Ack required Event Notification List	61
Acknowledging Ack required Event Notification	62
Chapter 7 - Widget on Map	63
Overview	64
Widget Descriptions	64
Adding a Widget on Map	71
Editing a Widget on Map	74
Chapter 8 - BACnet Event and Action	75
BACnet Event Action	76
BACnet Object Action Definition	76
Configuring BACnet Object Action	78
Chapter 9 - BACnet Gateway Template Editor	80
BACnet Gateway Template Overview	81
Viewing the Available BACnet Gateway Template list	82
Viewing the Mapping Definition of the BACnet Gateway Template	83

Creating a New BACnet Gateway Template	84
Editing a BACnet Gateway Template	85
Removing a BACnet Gateway Template	86
Chapter 9 - BACnet Gateway Device Editor	87
BACnet Gateway Device Editor Overview	88
Accessing the BACnet Gateway Device Editor	89
Adding a BACnet Gateway Device Object	90
Deleting a BACnet Gateway Device Object	91
BACnet Gateway Device General Tab	92
BACnet Gateway Device General Tab Definitions	92
Configuring a BACnet Gateway Device Object	93
Creating Monitored Mapping for BACnet Gateway Device	94
Viewing BACnet Gateway Monitored Objects	95
Viewing the Mapping Reports for BACnet Gateway Device	96
Chapter 10 - BACnet Gateway Object Editor	97
BACnet Gateway Object Editor Overview	98
Accessing the BACnet Gateway Object Editor	99
Deleting a BACnet Gateway Object	100
BACnet Gateway Object General Tab	101
BACnet Gateway Object General Tab Definitions	101
Configuring a BACnet Gateway Object	102
Viewing Monitor Object for this BACnet Gateway Object	103
Chapter 11 - BACnet Broadcast Management Device	104
BACnet/IP Broadcast Management Device Overview	105
Supported and Tested BBMD Network - First	106
Supported and Tested BBMD Network - Second	107
Accessing the BACnet Broadcast Management Device (BBMD)	108
Adding a BBMD	109
Editing a BBMD	110
Deleting a BBMD	111
BBMD General Tab	112
BACnet Object General Tab Definitions	112
Configuring a BBMD Network	113
Chapter 12 - BACnet Journal Messages	114
BMS Integration Journal Message Definitions	115

Preface

The *C•CURE 9000 Neo Integration User Guide* is for new and experienced security system users who want to learn to use this product for the C•CURE 9000 Security Management System.

In this preface

How to Use this Manual	7
Finding More Information	9
Conventions	10

How to Use this Manual

This manual is divided into 8 chapters and one appendix. Turn to the section in this manual containing the information you need.

[Chapter 1: Introduction](#)

This chapter provides Building Management System (BMS) integration overview.

[Chapter 2: Installation](#)

This chapter provides installation/un-installation instructions for this product.

[Chapter 3: BACnet Device Discovery](#)

This chapter describes how BMS integration automatically detects BACnet devices on the network and creates the corresponding devices and objects in C•CURE 9000.

[Chapter 4: BACnet Device Editor](#)

This appendix describes how to use BACnet device editor.

[Chapter 5: BACnet Object Editor](#)

This chapter describes how to use BACnet object editor.

[Chapter 6: Acknowledge Ack required Event Notification](#)

This chapter describes how to acknowledge Ack required Event Notification.

[Chapter 7: Widget on Map](#)

This chapter describes how to set animation for BACnet objects by widget on map.

[Chapter 8: BACnet Event and Action](#)

This chapter describes BACnet object specific action.

[Chapter 9: BACnet Gateway Template Editor](#)

This chapter describes How to maintenance BACnet Gateway Template.

[Chapter 10: BACnet Gateway Device Editor](#)

This chapter describes BACnet Gateway Device Editor.

Chapter 11: BACnet Gateway Object Editor

This chapter describes BACnet Gateway Object Editor.

Chapter 13: BACnet Journal Messages

This chapter describes the Journal Messages of BMS integration.

Finding More Information

You can access C•CURE 9000 manuals and online Help for more information about C•CURE 9000.

Manuals

C•CURE 9000 software manuals and Software House hardware manuals are available in Adobe PDF format on the C•CURE 9000 DVD.

You can access the manuals if you copy the appropriate PDF files from the C•CURE 9000 Installation DVD English\Manuals folder and install the Adobe Acrobat reader. Adobe Acrobat Reader can be installed from the C•CURE 9000 Installation DVD English\Reader folder.

The available C•CURE 9000 and Software House manuals are listed in the *C•CURE 9000 Installation and Upgrade Guide*, and appear as hyperlinks in the online.pdf file on the C•CURE 9000 DVD English\Manuals folder.

These manuals are also available from the Software House Member Center website (<http://www.swhouse.com/TechnicalLibrary/TechLibSW.aspx>).

Online Help

You can access C•CURE 9000 Help by pressing F1 or clicking Help from the menu bar in the Administration/Monitoring Station applications.

Conventions

This manual uses the following text formats and symbols.

Convention	Meaning
Bold	This font indicates screen elements, and also indicates when you should take a direct action in a procedure. Bold font describes one of the following items: <ul style="list-style-type: none">• A command or character to type, or• A button or option on the screen to press, or• A key on the keyboard to press• A screen element or name
blue color text	Indicates a hyperlink to a URL, or a cross-reference to a figure, table, or section in this guide.
<i>Regular italic font</i>	Indicates a new term.
<text>	Indicates a variable.

The following items are used to indicate important information.

NOTE

Indicates a note. Notes call attention to any item of information that may be of special importance.

TIP

Indicates an alternate method of performing a task.



Indicates a caution. A caution contains information essential to avoid damage to the system. A caution can pertain to hardware or software.



Indicates a warning. A warning contains information that advises users that failure to avoid a specific action could result in physical harm to the user or to the hardware.



Indicates a danger. A danger contains information that users must know to avoid death or serious injury.

Introduction

This chapter introduces the C•CURE 9000 BMS integration product. In this chapter:

Overview	12
Using the Building Automation Pane	14
BMS integration Tasks	15

Overview

This integration provides the generic integration between C•CURE 9000 and Building Management Devices based on BACnet protocol, allowing customers to configure and control BMS devices. It provides connectivity to equipment using the BACnet protocol over Ethernet (called "BACnet/IP" or "Annex J"). Devices on other BACnet network types may be accessed using BACnet gateway devices. If the device is based on other protocol(e.g. N2), a protocol converter to BACnet(e.g. BACnet - N2 router) is needed.

This integration also provides a gateway mechanism for wrapping objects in C•CURE 9000 to BACnet objects, so the third party system can monitor C•CURE 9000 object change through BACnet protocol if necessary.

BACnet, Building Automation and Control Networks, is a data communication protocol and an agreed-upon set of rules for creating interoperable networks of building systems. When using BMS integration, it is recommended that users be familiar with the standard BACnet objects and properties.

The BMS integration provides Device management, Alarm and Event management, and Action management features on C•CURE 9000, which works as Supervisory Controller and controls BACnet device directly. This integration also provide gateway function to map C•CURE 9000 objects to BACnet objects. It provides the default gateway templates and also provide the way to customize gateway template.

Features


The following is a list of major features supported by BMS integration.

- Automatic Device Discovery
- Multi-condition triggers
- Interaction among devices (Non-BACnet and BACnet)
- View devices animation state on map
- All the changes of value are logged in the security journal for future investigative reporting
- Supports BACnet/IP(Annex J) protocol:
- Supports subscription to the change of value (COV) event notification for many properties
- Supports the following Objects, with most properties of the standard object types supported: Analog Input, Analog Output, Analog Value, Binary Input, Binary Output, Binary Value, Multi-state Input, Multi-state Output, Multi-state Value, Schedule and Device.
- Supported Services: Who-Is, I-Am, ReadProperty, ReadPropertyMultiple, WriteProperty, WritePropertyMultiple, SubscribeCOV, SubscribeCOVProperty, ConfirmedCOVNotification, UnconfirmedCOVNotification.
- Acknowledge Event Notification in Alarm.
- BACnet gateway function - map C•CURE 9000 objects to BACnet objects.
- Default gateway templates: iStar people counting, Event gateway templates.
- Customized gateway template.
- View monitor objects summary.
- Supports BBMD: Manager BBMD: BACnet IP Communication across different networks.

Architecture

[Figure 1-1 on page 1-3](#) shows a diagram that depicts the relationship between BACnet devices and BMS integration.

Figure 1-1: Architecture

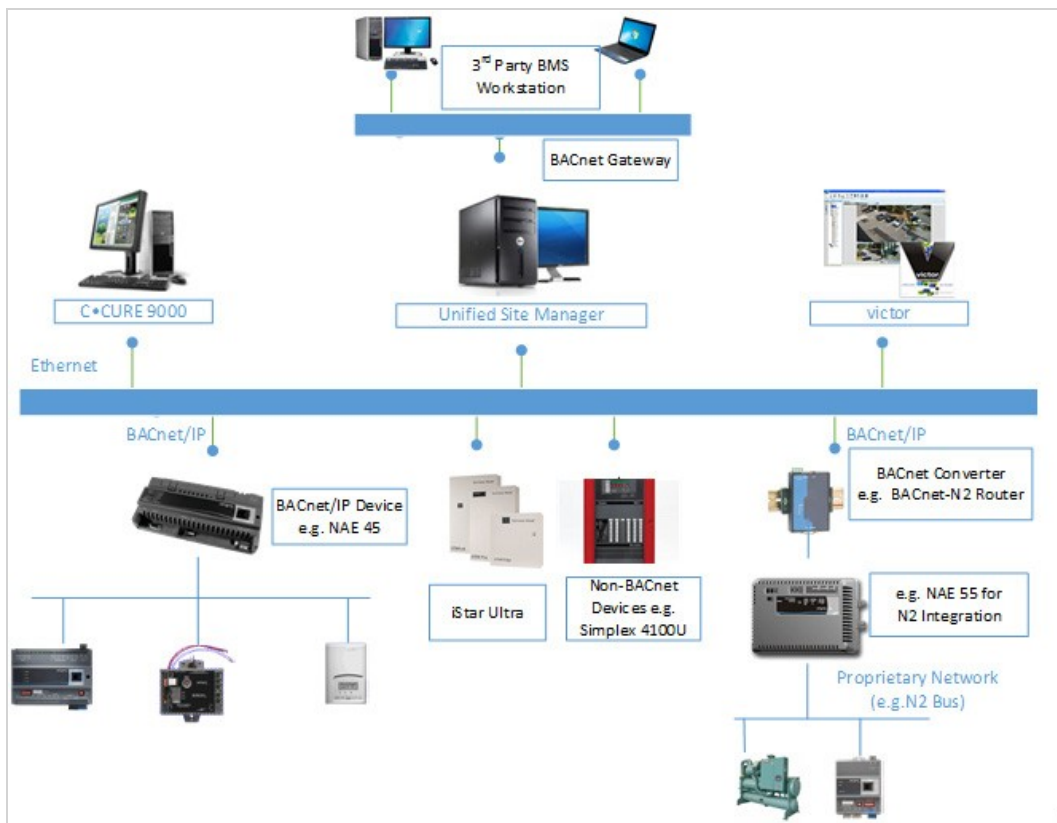

Using the Building Automation Pane

BACnet integration objects are created in the Building Automation pane on your C•CURE 9000 Administration Client Application.

When you install the BMS integration product, the building Automation Pane appeared on the navigation tree.

BMS integration Tasks

You can perform the following tasks with BMS integration:

- [Auto Discovery BACnet Devices](#) on [Page 27](#)
- [Importing Device Objects Manually](#) on [Page 30](#)
- [Accessing the BACnet Device Editor](#) on [Page 33](#)
- [Deleting a BACnet Device Object](#) on [Page 35](#)
- [Configuring a BACnet Device Object](#) on [Page 38](#)
- [Defining a Trigger for a BACnet Device](#) on [Page 39](#)
- [Customizing State Images for a BACnet Device](#) on [Page 42](#)
- [Accessing the BACnet Object Editor](#) on [Page 45](#)
- [Deleting a BACnet Object](#) on [Page 46](#)
- [Configuring a BACnet Object](#) on [Page 49](#)
- [Defining a Trigger for a BACnet Object](#) on [Page 51](#)
- [Customizing State Images for a BACnet Object](#) on [Page 54](#)
- [Acknowledge Ack required Event Notification](#) on [Page 59](#)
- [Adding a Widget on Map](#) on [Page 71](#)
- [Editing a Widget on Map](#) on [Page 74](#)
- [Configuring BACnet Object Action](#) on [Page 78](#)
- [Viewing the Available BACnet Gateway Template list](#) on [Page 82](#)
- [Viewing the Mapping Definition of the BACnet Gateway Template](#) on [Page 83](#)
- [Creating a New BACnet Gateway Template](#) on [Page 84](#)
- [Removing a BACnet Gateway Template](#) on [Page 86](#)
- [Accessing the BACnet Gateway Device Editor](#) on [Page 89](#)
- [Adding a BACnet Gateway Device Object](#) on [Page 90](#)
- [Deleting a BACnet Gateway Device Object](#) on [Page 91](#)
- [Configuring a BACnet Gateway Device Object](#) on [Page 93](#)
- [Creating Monitored Mapping for BACnet Gateway Device](#) on [Page 94](#)
- [Viewing BACnet Gateway Monitored Objects](#) on [Page 95](#)
- [Viewing the Mapping Reports for BACnet Gateway Device](#) on [Page 96](#)
- [Accessing the BACnet Gateway Object Editor](#) on [Page 99](#)
- [Deleting a BACnet Gateway Object](#) on [Page 100](#)
- [Configuring a BACnet Gateway Object](#) on [Page 102](#)
- [Viewing Monitor Object for this BACnet Gateway Object](#) on [Page 103](#)
- [BMS Integration Journal Message Definitions](#) on [Page 115](#)

Installation

This chapter provides instructions for installing and un-installing the BMS integration on a C•CURE 9000 server or client system.

In this chapter

Overview	17
Before you begin	17
Getting the BMS integration	18
Installing the BMS integration	19
Uninstalling the BMS integration	22

Overview

Before installing the C•CURE 9000 BMS integration, you must first install C•CURE 9000 software on your target computer. For information on installing C•CURE 9000, refer to the C•CURE 9000 Installation and Upgrade Guide.

Similar to the C•CURE 9000 system, the BMS integration has Client and Server components. You must install the Client components on every computer that runs C•CURE 9000 client applications, and you must install the Server components on the C•CURE 9000 server computer. The BMS integration has the same hardware, software, and disk space requirements as C•CURE 9000; if the target computer can install C•CURE 9000, then it satisfies BMS integration requirements.

To install the BMS integration, you run the setup.exe from the BMS integration installation kit.

A wizard prompts you to install the C•CURE 9000 BMS integration. You need to perform the basic installation process described in the following pages on each computer in your C•CURE 9000 system. Be sure to close all C•CURE 9000 and virus-checking applications on client workstations before performing the installation.

The following table lists the steps to install and register the C•CURE 9000 BMS integration on each computer in your C•CURE 9000 system. Perform these steps in order.

Table 1: Standard Installation Tasks

Task	See...
1. Install C•CURE 9000.	C•CURE 9000 Installation and Upgrade Guide
2. Close any open application and disable virus checking software.	See Before you begin . Note: Stop the Crossfire servers if C•CURE 9000 is already installed.
3. Perform the pre-installation steps.	
4. Start the BACnet driver installation program.	
5. Verify the license for the BACnet driver by running the License program on your C•CURE 9000 server.	Refer to the <i>C•CURE 9000 Installation and Upgrade Guide</i> .
6. When the Installation and registration are complete, restart the services	

Before you begin

You may need to perform some pre-installation steps before you install the C•CURE 9000 BMS integration.

Checking Networks Status

If you are installing C•CURE 9000 on a corporate network, be sure to coordinate with your corporate network administrator. Check that the network is working properly. According to BACnet protocol, the BACnet converter should receive broadcast. The C•CURE 9000 also should receive broadcast.

The default C•CURE 9000 BACnet port is UDP 47808.

Checking System Privileges

To perform the installation, you must have appropriate Windows permissions. You must be in the local Administrators group, or have equivalent privileges. See the Microsoft Operating System documentation or your system administrator for more information.

If you do not have sufficient permissions, the following error message will appear as shown in the following image.

Figure 1: Error Message



Database Installation

If you are installing server components of the C•CURE 9000 BMS integration, the C•CURE 9000 BMS integration will add some tables to the C•CURE 9000 database. Currently, the C•CURE 9000 BMS integration does not support installation with C•CURE 9000 on an Oracle Database. Therefore, you must install on a C•Cure 9000 system that is using SQL Server. The C•Cure 9000 BMS integration install program automatically finds the C•CURE 9000 database and adds tables and initial data to it.

Getting the BMS integration

The BMS integration is located on the C•CURE 9000 2.4 DVD in the Integration\BMS folder, and can also be downloaded from the Software House website.

NOTE

Please be advised to use C•CURE 9000 with the latest service Pack 1 for the BMS integration.

To Download the BMS integration from the Software House Website

1. Open a browser and navigate to www.swhouse.com.
2. Select **Products**, and then select **Software Downloads** in the list.
3. When the login page opens, log in. If you do not have an account, you must create one.
4. Click the **Software Downloads** link.
5. On the **Software Downloads** page, select the **Software House Connected** link.
6. Select **Building Automation** from list.
7. When the **BMS integration Downloads** list is displayed on the right hand of the page, select the BMS integration link for the version of C•CURE 9000 that you have installed.
8. Unzip the files to a folder on your local computer, or to a shared drive on the network.

Installing the BMS integration


This section provides the BMS integration installation procedure. You can install the software to a drive on a local computer or from a shared drive over the network.

This section assumes that you meet all the requirements described in Pre-installation Requirements.

Installing the BMS integration

1. Log into the server or client with Windows administration privileges.
2. Navigate to the folder that contains the BMS integration software.
3. Right-click `setup.exe`, and select **Run as administrator**.
4. On the welcome dialog box, click **Next**.

Figure 2: Confirmation Dialog Box

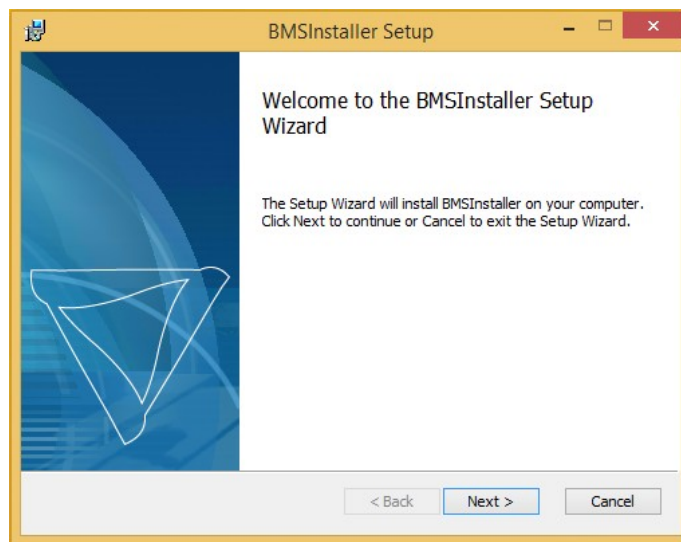


5. On the **License Agreement** page, select the **I accept the terms in the License Agreement** check box, and then click **Next**.

Figure 3: License Agreement



- On the **Database Server and Authentication** page, click **Next**.


Figure 4: Database Server

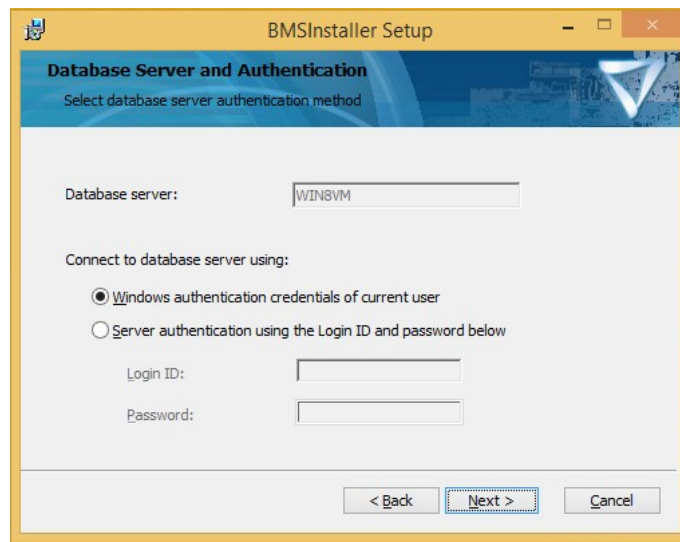

The screenshot shows the 'BMSInstaller Setup' window with the 'Database Server and Authentication' tab selected. The window title is 'BMSInstaller Setup'. The tab title is 'Database Server and Authentication'. Below the tab, it says 'Select database server authentication method'. There is a text box for 'Database server:' containing 'WIN8VM'. Below that, it says 'Connect to database server using:'. There are two radio buttons: the first is selected and labeled 'Windows authentication credentials of current user', and the second is labeled 'Server authentication using the Login ID and password below'. Below the second radio button, there are two text boxes: 'Login ID:' and 'Password:'. At the bottom right, there are three buttons: '< Back', 'Next >', and 'Cancel'.

- On the **Installation Options** page, click **Next**.


Figure 5: Installation Options

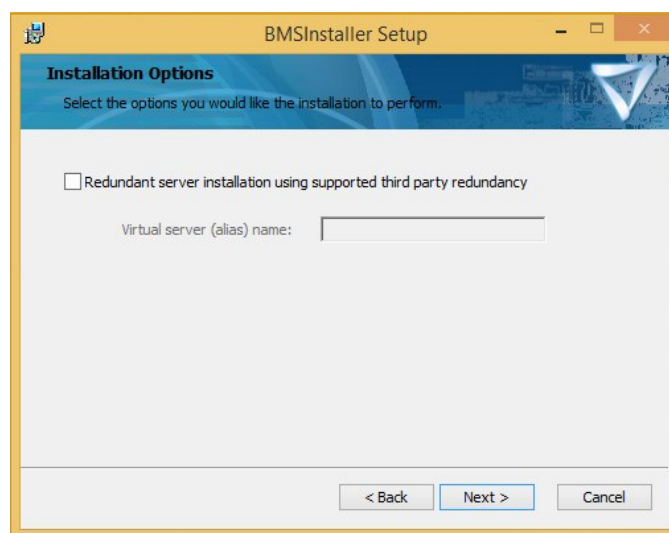

The screenshot shows the 'BMSInstaller Setup' window with the 'Installation Options' tab selected. The window title is 'BMSInstaller Setup'. The tab title is 'Installation Options'. Below the tab, it says 'Select the options you would like the installation to perform.'. There is a checkbox labeled 'Redundant server installation using supported third party redundancy'. Below the checkbox, there is a text box labeled 'Virtual server (alias) name:'. At the bottom right, there are three buttons: '< Back', 'Next >', and 'Cancel'.


- On the **Ready to Install BMSInstaller** page, click **Install**.

Figure 6: Ready to Install the Program

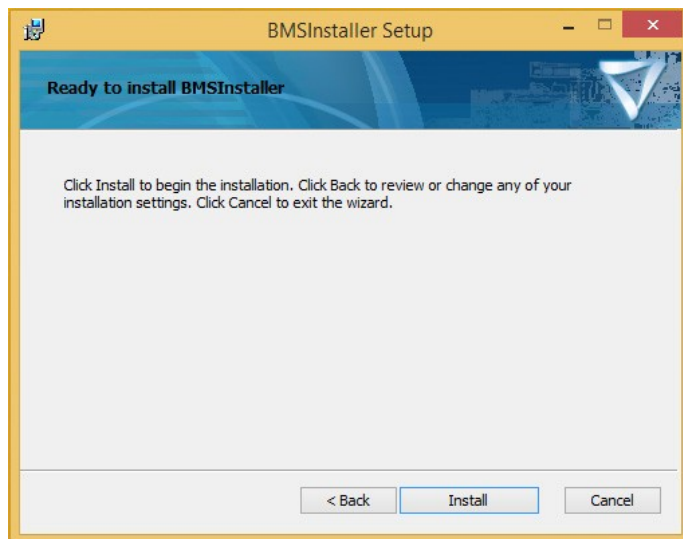

9. After the installation is complete, click **Finish**.

Figure 7: Installation Completed

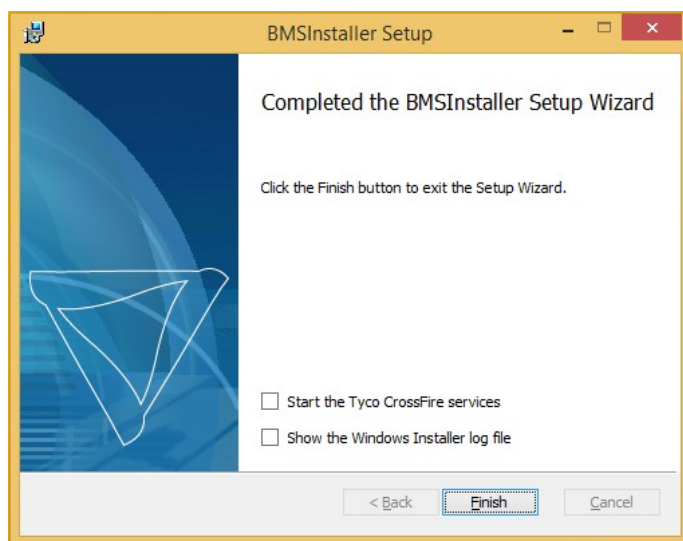

Starting the BMS integration

Before you can import BACnet devices, you must start the BMS integration using the C•CURE 9000 Server Management Application Server Components tab.

1. From the Start Menu, select **Start>All Programs>Software House>Server Configuration**. The C•CURE 9000 Server Management Application opens.
2. Click the **Services** tab.
3. Select the **Enabled** check box for the SoftwareHouse CrossFire BACnet Driver Service and then start the service.
4. When the Crossfire Framework Service, CrossFire Server Component Service, and the SoftwareHouse CrossFire BACnet Driver Service displays a status of "Running" you can configure BMS integration objects in the C•CURE 9000.

Uninstalling the BMS integration

This section describes how to uninstall the C•CURE 9000 BMS integration from the Server computer and from each Client computer in your security system.

The Uninstall process removes all software components that were installed on the computer by the C•CURE 9000 BMS integration program.



Please be advised that the BMS integration uninstall will shutdown and restart the C•CURE 9000 services. Therefore, the BMS integration uninstall should be planned accordingly.

Uninstalling this integration does not automatically remove objects that were configured in the C•CURE 9000 using it. Before you proceed with this uninstall, you **MUST** manually remove the objects from C•CURE 9000 to avoid potential issues with functions, such as partition deletion.


Unless you intend to reinstall the integration and continue using it, please ensure that the objects are deleted before removing the integration.

Once the uninstall process completes, the computer will be in a “clean” state.

To Uninstall BMS integration


1. Navigate to the installation kit folder.
2. Right-click `setup.exe`, and select **Run as administrator**, the following welcome dialog box appears.

Figure 8: Welcome Dialog Box

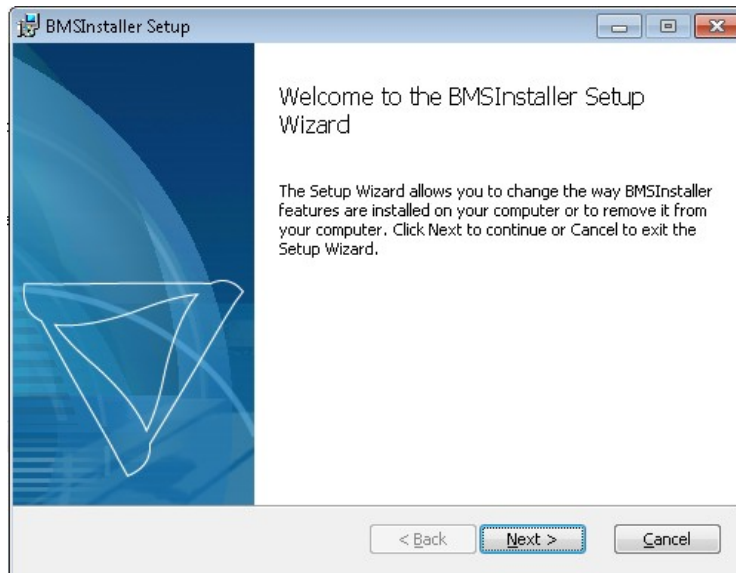


3. Click **Next**, open the **Program Maintenance** dialog box.

Figure 9: Program Maintenance

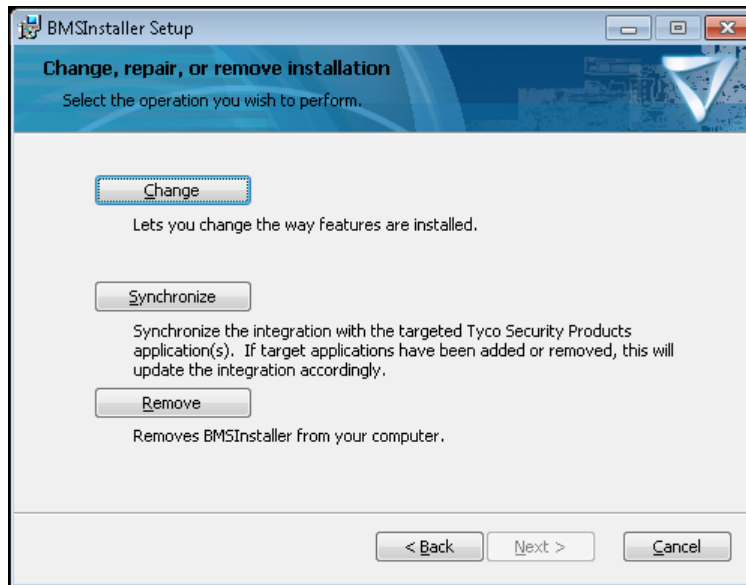


4. Select **Remove** and click **Next**. The Uninstall Options appears for you to choose whether or not to drop BMS Database. To drop the database, select the check box and then click Remove. To keep the database, click **Remove**.

Figure 10: Uninstall Options

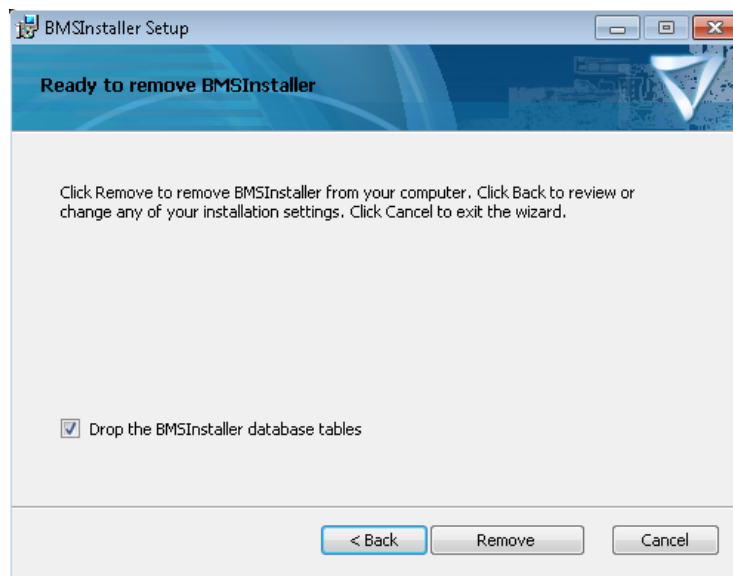


5. The **Removing BMSInstaller** dialog box opens showing the uninstalling progress.

Figure 11: Progress

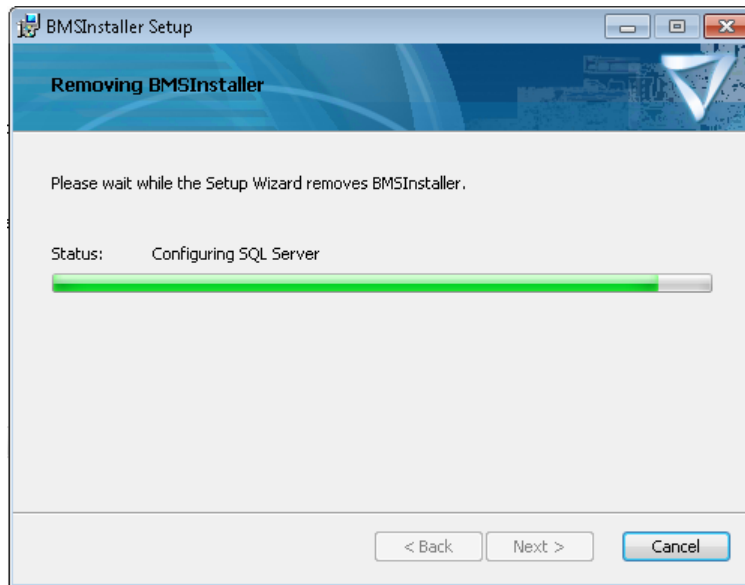

6. After a few minutes, the **Completed the BMSInstaller Setup Wizard** dialog box appears.

Figure 12: Completed

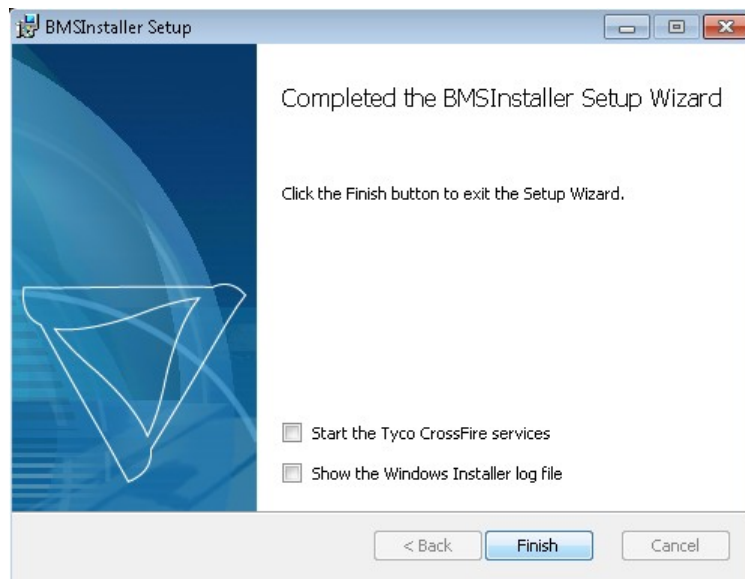

7. Click **Finish** to complete uninstalling.

BACnet Device Discovery

This chapter describes how BMS integration automatically detects BACnet devices on the network and creates the corresponding devices and objects in C•CURE 9000 and how manually import BACnet objects for the specific BACnet device.

In this chapter:

Overview	26
Auto Discovery BACnet Devices	27
Importing Device Objects Manually	30

Overview

The integration can discover BACnet devices and its objects automatically by broadcasting WHO-IS and receiving I-AM message through BACnet protocol. And user is allowed to choose and save the devices and objects to be imported.

The integration also support manually import BACnet objects for the specific BACnet device.


Auto Discovery BACnet Devices

Perform the following steps to auto discovery BACnet Devices on the network and create the corresponding devices and objects in C•CURE 9000.

- 1. On the navigation tree, select **Building Automation** to open the **Building Automation** pane.
- 2. Right click the BACnet Device folder, and select **Auto Discovery**.

The **Auto Discovery BACnet Devices** window lists the detected BACnet devices on the left grid, and shows the total number of detected BACnet device right above this grid. The devices in gray are already imported into system.

Figure 13: Auto Discovery BACnet Devices - Device list

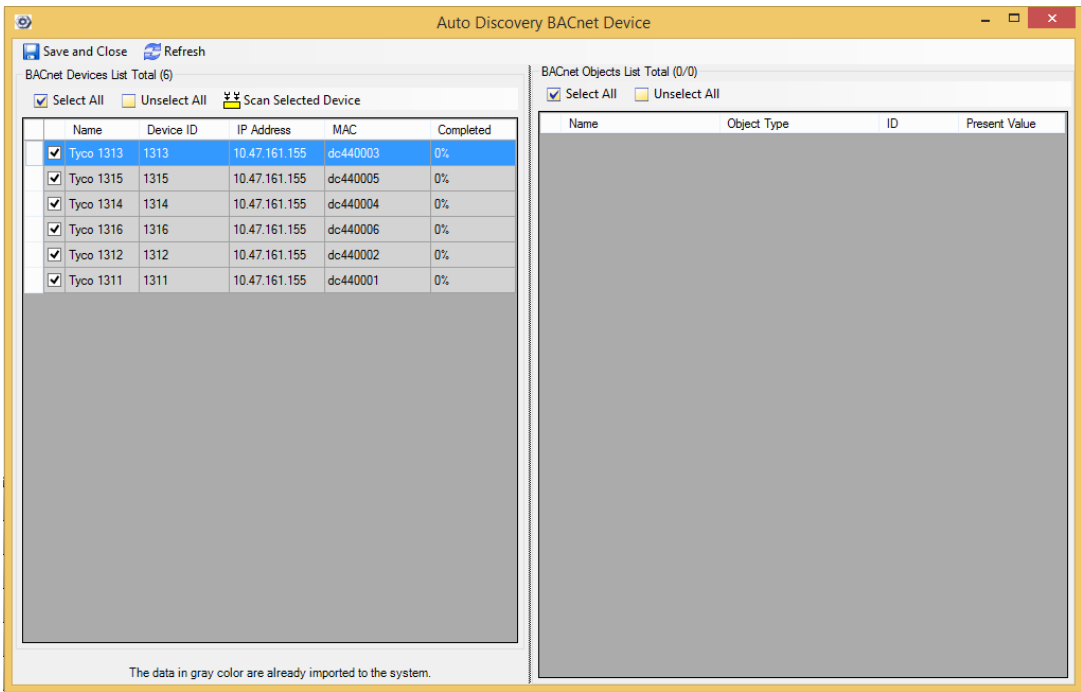

The following table describes the fields of the BACnet Device list grid.

Table 2: BACnet Device List Grid Descriptions

Fields	Descriptions
Name	BACnet device name
Device ID	BACnet device ID, which must be unique on the network.
IP Address	IP address of BACnet device
MAC	MAC address of BACnet device
Completed	The completed percent of BACnet objects been detected on the specific device. The value will refresh during devices scan.


NOTE

Auto discovery BACnet Devices may take a few seconds or minutes, which depends on the network speed and object amount on the device.

- 3. Tick the devices wanted to be imported, then click **Scan Selected Device**.

The BACnet objects on the selected devices appear in the list on the right grid. By default, all BACnet objects are selected. Clear the check boxes for any objects that you do not want to import. The objects in gray are already imported into system.

Figure 14: Auto Discovery BACnet Devices - Object list

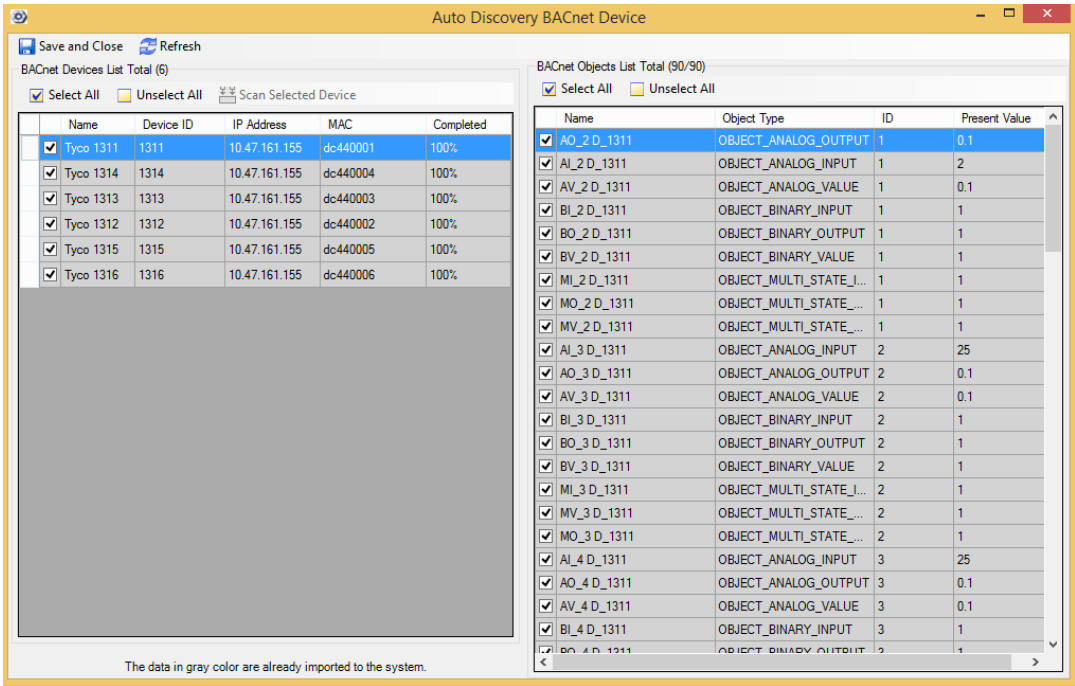

The following table describes the fields of the BACnet object list grid.


Table 3: BACnet Object List Grid Descriptions

Field	Description
Name	BACnet object name.
Object Type	BACnet object type. Valid value: Binary Input, Binary Output, Binary value, Analog Input, Analog Output, Analog value, Multistate Input, Multistate Output, Multistate Value and Schedule.
ID	BACnet object ID.
Present Value	Present value of the specific object.

4. Click **Save and Close**.

All selected BACnet devices and objects display on the Building Automation navigation tree.

Figure 15: BACnet Tree

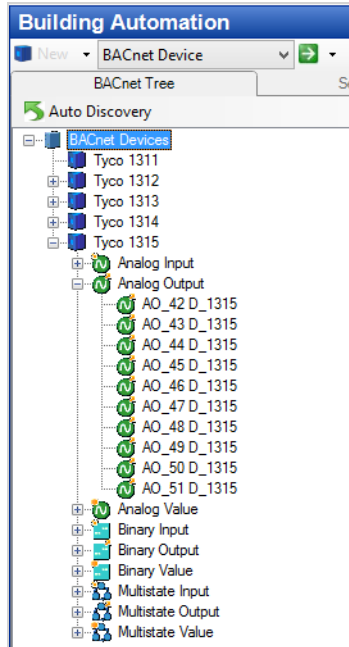

BACnet objects are categorized by object type on Building Automation navigation tree.


Importing Device Objects Manually

Perform the following steps to import device objects for the specific BACnet device.

1. On the navigation tree, select Building Automation to open the **Building Automation** pane.
2. Expand the **BACnet Devices** folder.
3. Right click the desired BACnet device, and select **Import Device Objects**.

The **Auto Discovery BACnet Devices** window opens, and retrieves BACnet objects in this device. When retrieval BACnet objects 100% completed, all available BACnet objects listed on the right grid.

Figure 16: Import Device Objects

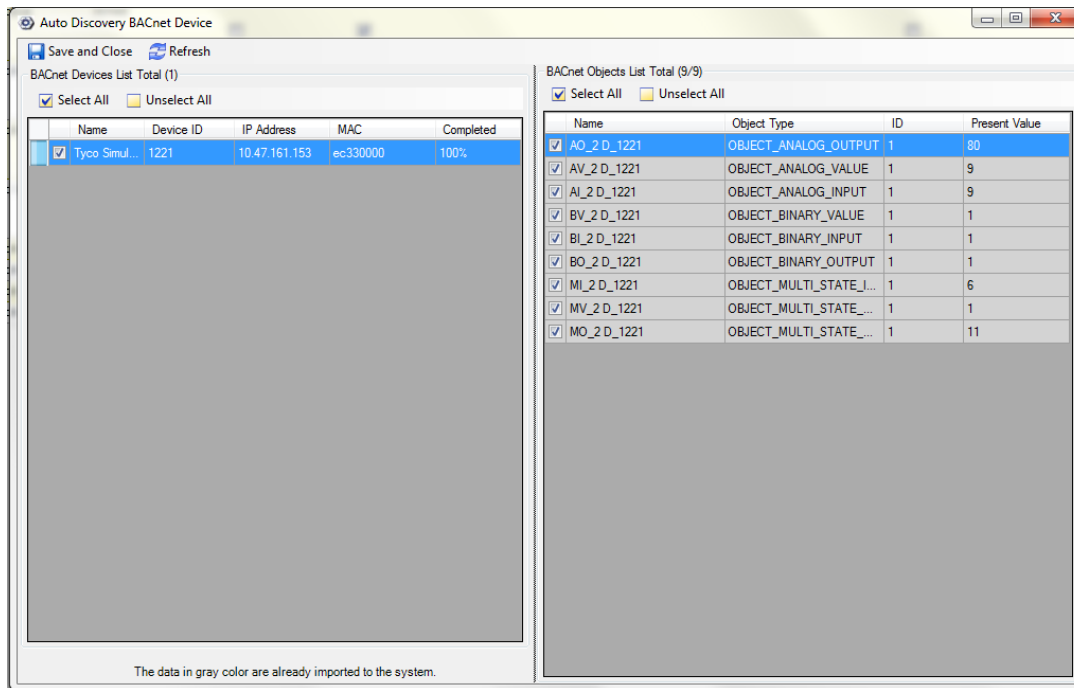

4. By default, all BACnet objects are ticked. Untick the objects if you don't want to import. The objects in gray are already imported into system.
5. Click **Save and Close**. All selected BACnet devices and objects display on the Building Automation navigation tree.

BACnet Device Editor

This chapter describes BACnet Device Editor. In this chapter:

BACnet Device Editor Overview	32
Accessing the BACnet Device Editor	33
Adding a BACnet Device Object	34
Deleting a BACnet Device Object	35
BACnet Device General Tab	36
BACnet Device General Tab Definitions	36
Configuring a BACnet Device Object	38
BACnet Device Triggers Tab Definitions	39
Defining a Trigger for a BACnet Device	39
BACnet Device - Status Tab	41
BACnet Device Status Tab Definitions	41
BACnet Device - State Images Tab	42
Customizing State Images for a BACnet Device	42

BACnet Device Editor Overview

The BACnet device represents the BACnet device in the C•CURE 9000 database.

Accessing the BACnet Device Editor

Perform the following steps to access the BACnet Device editor.

To Access the BACnet Device Editor

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click Building Automation. The Building Automation pane opens.
2. Expand the **BACnet Device** folder.
3. To open the BACnet device editor to edit an existing BACnet device, double-click a BACnet device icon or name or right-click a BACnet device and select **Edit** from context menu.

The BACnet Device Editor opens with the General tab visible.

Adding a BACnet Device Object

Perform the following steps to add a BACnet Device object.

To Add a BACnet Device Object

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Right-click the BACnet Device folder, then select **New** from context menu, the BACnet device editor opens.
3. Type a unique name in the **Name** field.
4. Type a textual description for the BACnet device in the **Description** field.
5. See [BACnet Device General Tab](#) to configure communication information.

NOTE

If the Network ID of the BACnet device is 0, MAC Address is not necessary, but if Network ID is not 0, you must enter MAC Address to identify device.


6. Select the Data Update Mechanism used for all sub objects of this BACnet device.
7. Check the **Enabled** option to connect to BACnet physical device.
8. Click the **Triggers** tab to configure Triggers for the BACnet device.
9. Click the **State Images** tab to view the state images for the BACnet device, and optionally customize the state images.
10. If you are done editing the BACnet device, click to save the BACnet device configuration.

Deleting a BACnet Device Object

You can delete a BACnet device from the Building Automation tree or from the dynamic view if you no longer need it.

To Delete a BACnet Device Object from the Building Automation Tree


1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Open the BACnet Device folder by clicking ➔ to the left of folder.
3. Right-click a BACnet device object to be deleted and select **Delete** from context menu. A confirmation dialog box opens.

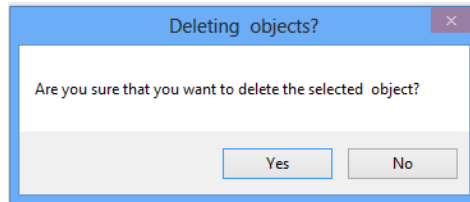

4. Click **Yes**. After a while, this BACnet device object and all BACnet objects in this device are deleted from Building Automation tree and C•CURE 9000 database.

To Delete a BACnet Device Object from the Dynamic View

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Select BACnet Device from Building Automation pane drop-down list.
3. Click ➔ to open a Dynamic View showing all BACnet Devices objects.
4. Right-click a BACnet device object to be deleted and select **Delete** from context menu. A confirmation dialog box opens.

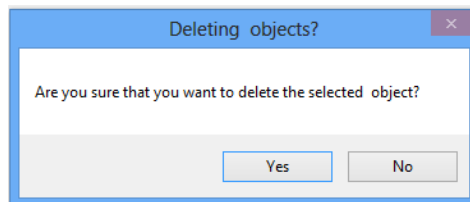

5. Click **Yes**. After a while, this BACnet device object and all BACnet objects in this device are deleted from Building Automation tree and C•CURE 9000 database.

BACnet Device General Tab

From the BACnet Device General tab, you can set the name and description for the BACnet device, and configure the communication settings for the device.

Figure 17: BACnet Device - General Tab

BACnet Device - Default Configuration Name 2749

Save and Close

Name: Default Configuration Name 2749

Description:

☒ Enabled

☐ Maintenance Mode

General

Triggers

Status

State images

Configurations

BACnet Device ID: 2749

MAC Address:

IP Address: 10.47.161.88

UDP Port: 47808

Network ID: 0

Data Update Mechanism

☒ Subscribe COV/Event Notification

☐ Polling

☐ None

☒ Use Subscribe COV

☐ Use Subscribe COV Property

☐ Present Value

COV Increment

0.1

☐ Status Flag

☐ Use Event Notification

0

...

Note: It is used to change data update mechanism for all sub objects in batch.

Poll Period

Poll Period: 300

Seconds

Comm Fail Delay: 10

Seconds

BACnet Device General Tab Definitions

The BACnet Device General tab includes the fields described in the following table.

Table 4: BACnet Device General Tab Definitions

Field	Description
Name	Enter a unique name up to 50 characters long for BACnet Device. If you enter the name of an existing object, the system will not save the object, and will display an error message indicating there is a conflict. Choose a different name.

Field	Description
Description	Enter a general comment about the BACnet device that will help you identify the device. This text is for information only.
Enabled	Select the Enabled option to connect to BACnet device and update status if connecting successfully, or clear this option to disable the BACnet Device. The default value is enabled. You can change IP Address and UDP port when disabled BACnet device.
Configuration	
BACnet Device ID	BACnet device ID, which must be unique on the network. Read only.
MAC Address	MAC address of BACnet device. Read only.
IP Address	BACnet IP address used to connect to the physical device, which must be unique on the network. Editable when BACnet device is disabled.
UDP Port	UDP port of BACnet device used to communicate with the physical device. Editable when BACnet device is disabled.
Network ID	Network ID of BACnet device.
Data Update Mechanism	When BACnet device is disabled, you can set data update mechanism for BACnet objects in this device. All BACnet objects' data update mechanism will change accordingly if you confirmed this change. Valid value: Subscribe COV/Event Notification, Polling, None. Please refer to BACnet Object General Tab Definitions on Page 47 to get the detailed description.
Poll Period	
Poll Period	Set poll interval, at which the integration will automatically check if the physical device is online. The default value is 300 seconds. Please increase the poll period accordingly when BACnet object amount increases.
Comm Fail Delay	Set the comm fail delay time. The default value is 5 seconds.

Configuring a BACnet Device Object

You can use the BACnet Device Editor to configure settings for BACnet device.

To Configure a BACnet Device Object

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Open the BACnet Device folder by clicking ➔ to the left of folder.
3. Double-click a BACnet device icon or name or right-click a BACnet device and select **Edit** from context menu, the BACnet device editor opens.
4. Type a unique name in the **Name** field.
5. Type a textual description for the BACnet device in the **Description** field.
6. See [“BACnet Device General Tab” on page 4-6](#) to configure communication information and Data Update Mechanism.
7. Select the Data Update Mechanism used for all sub objects of this BACnet device.
8. Check the **Enabled** option to connect to BACnet physical device.
9. You can click the **Triggers** tab to configure Triggers for the BACnet device.
10. You can click the **State Images** tab to view the state images for the BACnet device, and optionally customize the state images. See [“Customizing State Images for a BACnet Device” on page 4-13](#)
11. If you are done editing the BACnet device, click to save the BACnet device configuration.

BACnet Device Triggers Tab

C•CURE 9000 uses Triggers, which are configured procedures for activating events based on properties of an object. A Trigger automatically executes a specified Action when a particular predefined conditions occurs. The following image shows the BACnet Device Triggers tab.

Figure 18: BACnet Device Triggers Tab

The screenshot shows the 'BACnet Device - Tyco 1311' window. At the top, there's a 'Save and Close' button. Below it, the 'Name' field contains 'Tyco 1311' and the 'Description' field is empty. There are checkboxes for 'Enabled' (checked) and 'Maintenance Mode' (unchecked). The 'Triggers' tab is selected, showing a table with one trigger: 'Communication Status' (Offline) triggering 'Activate Event' for 'BACnet Device'. An 'Event' field at the bottom shows 'BACnet Device Offline'.

Property	Value	Action	Details
Communication Status	Offline	Activate Event	BACnet Device

The following table contains an example of how a Trigger is configured.




Table 5: Trigger Tab Setting Example

The following Triggers tab settings				
Property	Value	Action	Details	Schedule
Online Status	Online	Activate Event	BACnet Device Event	Always
<p>Would create the following Trigger:</p> <p>Anytime (Always Schedule) the Online Status (Property) equals Online (Value), activate the event (Action) named BACnet Device Event (Details).</p> <p>BACnet Device Event is an event that you would need to create using the Event Editor.</p> <p>For information about how to create and configure an event, refer to the <i>C•CURE 9000 User Software Configuration Guide</i>.</p>				

BACnet Device Triggers Tab Definitions



The following table provides definitions of BACnet Device Triggers tab.


Table 6: BACnet Device Triggers Tab Definitions

Field	Description
Add	Click  Add in the Triggers tab to create a new trigger.
Remove	Click  Remove in the Triggers tab to delete a new trigger.
Property	<p>Click within the Property column, and then click . The Property browser opens presenting properties available for the Panel. Click a Property to select it and add it to the column.</p> <p>The available properties are Communication Status and Operational Status.</p>
Value	<p>Click within the Value column to display a drop-down list of Values associated with the Property that you have selected. Click a Value you want to include as a parameter for the trigger to assign it to the column.</p> <p>The possible values are:</p> <ul style="list-style-type: none"> ■ Communication Status: Online/Offline ■ Operational Status: Operational/Non-operational
Action	Click within the Action column to display a drop-down list of valid actions. Click on Action that you want to include as a parameter for the trigger to add it to the column.
Details	Displays details about how the Action was configured.
Schedule	Only the Always Schedule is available for BACnet Device triggers.

Defining a Trigger for a BACnet Device

To Create a Trigger for BACnet Device

1. From the BACnet Device Editor, navigate to the **Triggers** tab.
2. Click  Add in the **Trigger** tab to create a new trigger.
3. Click  within the **Property** column to open the BACnet Device dialog box showing Properties available for the device.

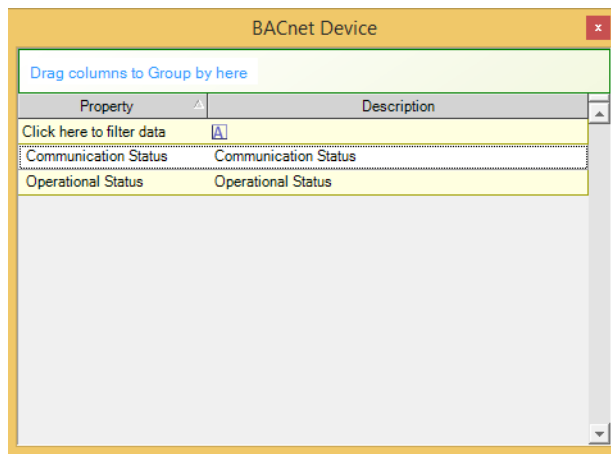

4. Click a Property to select it and add it to the Property column.
5. Click within the **Value** column to display a drop-down list. Click the Value that you want to include as a parameter for the trigger to add it to the column.
6. Click within the **Action** column to display a drop-down list of valid actions. Now only **Activate Event** is available.
When you select an Action, the lower pane in the Trigger box displays an Event field for you to define the Action details.
Click [...] to open Event Dialog. Select an Event that you want to associate with the trigger.
Once you define the Action details, the Details column displays information about how the Action has been configured.
7. Click **Save and Close** to save the BACnet Device with the Trigger you configured.

To Remove a Trigger

1. From the BACnet Device Editor, navigate to the **Trigger** tab.
2. Use [] to select the row in the Trigger table for the Trigger you want to remove.
3. Click **Remove**.
4. Click **Save and Close**.

BACnet Device - Status Tab

The BACnet Device Status tab provides read-only status information about the BACnet Device.

Figure 19: BACnet Device Status Tab

The screenshot shows a software window titled "BACnet Device - Tyco 1311". Inside, there's a "Save and Close" button at the top left. Below it, the "Name" field is set to "Tyco 1311" and the "Description" field is empty. There are two checkboxes: "Enabled" (checked) and "Maintenance Mode" (unchecked). Below these are four tabs: "General", "Triggers", "Status", and "State images". The "Status" tab is selected, showing a "Status" section with two read-only fields: "Communication Status" set to "Online" and "Operational Status" set to "Operational".

BACnet Device Status Tab Definitions

The following table provides BACnet Device Status tab definitions.


Table 7: BACnet Device Status Tab Definitions

Field	Value	Definition
Communication Status	Online	The server is successfully connected to the BACnet physical device.
	Offline	The server tries to connect to the BACnet physical device, but fails.
	Unknown	Server stops
Operational Status	Operational	The server can communicate with BACnet device successfully.
	Non-operational	The server can't communicate with BACnet device successfully.

BACnet Device - State Images Tab

From the BACnet Device State Images tab, you can change the default images used to indicate the BACnet Device states on the Monitoring Station.

Figure 20: BACnet Device State Images Tab

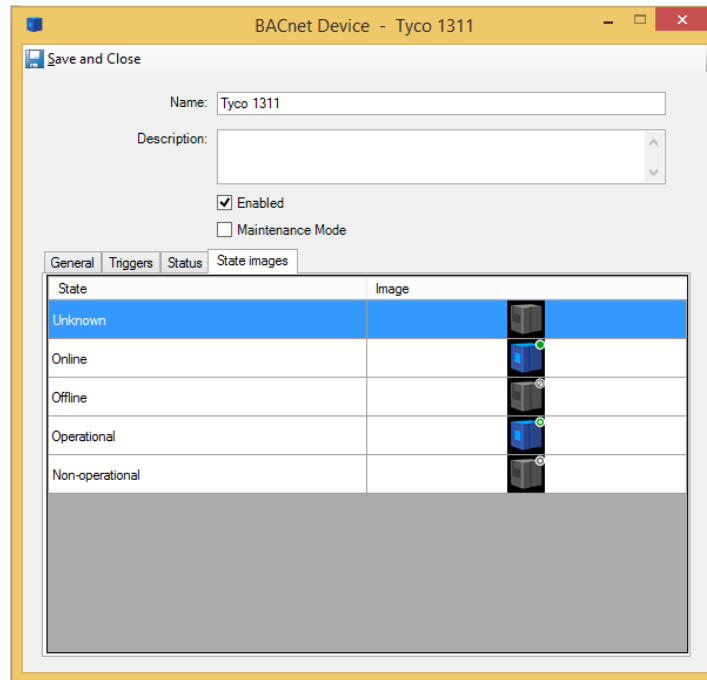

You can replace the default images with JPG formatted files of your choice, to uniquely identify your objects when activities are displayed on the Monitoring Station Client.

Customizing State Images for a BACnet Device

From the BACnet Device State Images tab, you can change the images that appear in the Monitoring Station to represent BACnet Devices.

To Customize BACnet Device State Images

1. From the **BACnet Device State Images** tab, double-click the existing image. A Windows Open dialog box appears allowing you to browse for a folder in which you have placed replacement images.
2. When you locate the replacement image, select it and click **Open** to replace the default image with this image.
3. When you are done editing the BACnet Device, click **Save and Close** to save the device configuration.

To Restore the Default State Image

1. From the **BACnet Device State Images** tab, select an existing image.
2. Right-click the image and select **Restore Default**.
3. Click **Save and Close** to save the device configuration.

BACnet Object Editor

This chapter describes BACnet Object Editor. In this chapter:

BACnet Object Editor Overview	44
Accessing the BACnet Object Editor	45
Deleting a BACnet Object	46
BACnet Object - General Tab	47
BACnet Object General Tab Definitions	47
Configuring a BACnet Object	49
Configuring Data Update Mechanism for a BACnet Object	49
BACnet Object - Triggers Tab	50
BACnet Object Triggers Tab Definitions	50
Defining a Trigger for a BACnet Object	51
BACnet Object - Status Tab	53
BACnet Object Status Tab Definitions	53
BACnet Object - State Images Tab	54
Customizing State Images for a BACnet Object	54
BACnet Schedule Object - Object Configuration Tab	56
BACnet Schedule Object - Object Configuration Tab Definitions	56
BACnet Schedule Object - Schedule Configuration Tab	57

BACnet Object Editor Overview

The BACnet Object represents the BACnet Object in the C•CURE 9000 database.

Accessing the BACnet Object Editor

Perform the following steps to access the BACnet Object editor to edit an existing BACnet Object.

To Access the BACnet Object Editor

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**.
2. In the **Building Automation** pane, expand the **BACnet Object** folder.
3. To open the BACnet Object editor, select one of the following options:
 - Double-click a BACnet Object icon or name.
 - Right-click a BACnet Object and select **Edit** from context menu.


The BACnet Object Editor opens with the General tab visible.

Deleting a BACnet Object

You can delete a BACnet Object from the Building Automation tree or from the dynamic view if you no longer need it.


To Delete a BACnet Object from the Building Automation Tree


1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click Building Automation.
2. In the **Building Automation** pane, expand the **BACnet Object** folder.
3. Right-click a BACnet Object to be deleted and select **Delete** from context menu. A confirmation dialog box opens.

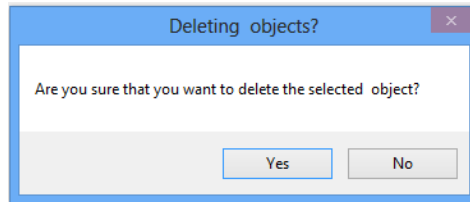

4. Click **Yes**. After a while, this BACnet Object is deleted from Building Automation tree and C•CURE 9000 database.

To Delete a BACnet Object from the Dynamic View

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Select **BACnet Object** from the **Building Automation** pane drop-down list.
3. Click  to open a Dynamic View showing all BACnet Objects.

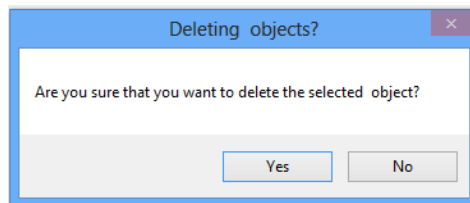

4. Right-click a BACnet Object to be deleted and select **Delete** from context menu. A confirmation dialog box opens.
5. Click **Yes**. After a while, this BACnet Object is deleted from Building Automation tree and C•CURE 9000 database.

BACnet Object - General Tab

From the BACnet Object General tab, you can set the name and description for the BACnet Object, and configure the communication settings for the device.

Figure 21: BACnet Object - General Tab

The screenshot shows a software window titled "BACnet Analog Input - My New Object 0". At the top, there are "Save and Close" and "Refresh" buttons. Below these are input fields for "Name" (containing "My New Object 0") and "Description". There are checkboxes for "Enabled" (checked) and "Maintenance Mode". Below these are tabs for "General", "Triggers", "Status", and "State Images", with "General" being the active tab. Under the "General" tab, there is a "BACnet" section containing: "Object Type" (a dropdown menu showing "OBJECT_ANALOG_INPUT"), "Device Type" (an empty text field), "Present Value" (a text field showing "4.5"), "High Limit" (a text field showing "3.402823E+38"), "Low Limit" (a text field showing "-3.402823E+38"), and "Units" (a dropdown menu showing "UNITS_NO_UNITS"). Below this is a "Data Update Mechanism" section with three radio buttons: "Subscribe COV/Event Notification" (selected), "Polling", and "None". Under "Subscribe COV/Event Notification", there is a checked checkbox for "Use Subscribe COV", an unchecked checkbox for "Use Subscribe COV Property", and an unchecked checkbox for "Use Event Notification". The "Use Subscribe COV" section includes a "Present Value" checkbox, a "COV Increment" dropdown menu (showing "1.0"), and a "Status Flag" checkbox. The "Use Event Notification" section includes a text field showing "0" and a button with three dots.

BACnet Object General Tab Definitions

The following table contains descriptions of the BACnet Object General tab fields.

Table 8: BACnet Object General Tab Definitions

Field	Description
Name	Enter a unique name up to 50 characters long for BACnet Device. If you enter the name of an existing object, the system will not save the object, and will display an error message indicating there is a conflict. Choose a different name.
Description	Enter a general comment about the BACnet device that will help you identify the device. This text is for information only.
Enabled	Click Enabled to allow the BACnet object to establish the communication with the physical device.
Object Type	BACnet object type. Valid value: ANALOG_INPUT, ANALOG_OUTPUT, ANALOG_VALUE, BINARY_INPUT, BINARY_OUTPUT, BINARY_VALUE, MULTI- STATE_INPUT, MULTI-STATE_OUTPUT, MULTI-STATE_VALUE. Read only.
Device Type	Text description of the physical device connected to the BACnet object. It will typically be used to describe the type of sensor attached to the BACnet object type. Read only.

Field	Description
Present Value	The current value in engineering units of the BACnet object being measured. The present value is writable when Outofservice status is True. Read only.
High Limit	A limit that present value must exceed before an event is generated. Read only.
Low Limit	A limit that present value must fall below before an event is generated. Read only.
Units	The measurement units of this object. Read only.
Data Update Mechanism	
Subscribe COV/Event Notification	<p>← Use Subscribe COV: Update data by subscribing COV service.</p> <p>When Use Subscribe COV, the subscription period is 28800 seconds (8 hours) by default. BMS integration will automatically re-subscribe before subscription expires. You can change it by the following line in ConnectedPro.HardwareInterface.BACnet.DriverService.exe configuration file located under Installation path\Tyco\CrossFire\ServerComponents.</p> <pre><add key="COVLifeTimeValue" value="28800"/></pre> <p>← Use Subscribe COV Property: Update Present Value and /or Status Flag by subscribe Present Value and /or Status Flag COV Property service. For Analog object, when check Present value, user can define COV Increment.</p> <p>← Use Event Notification: Update status by subscribe Event Notification. To use this mechanism, Notification Class should be pre-configured on real BACnet Device, If subscribed Event Notification Class Required Ack, then BMS integration will list Ack required Event Notification.</p> <p>BMS integration uses 12505 network ID to communicate, you can change it by the following line in ConnectedPro.HardwareInterface.BACnet.DriverService.exe configuration file located under installation path\Tyco\CrossFire\ServerComponents.</p> <pre><add key="LocalBACnetNetworkID" value="12505"/></pre>
Polling	Update data by poling the value and status. The polling period share the value with BACnet device.
None	None of above mechanism.

Configuring a BACnet Object

You can use the BACnet Object Editor to configure settings for BACnet Object.


To Configure a BACnet Object

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**.
2. From the **Building Automation** pane, expand the **BACnet Object** folder.
3. To edit the BACnet object, select one of the following methods:
 - Double-click a BACnet Object icon or name.
 - Right-click a BACnet Object and select **Edit** from context menu.
4. Type a unique name in the **Name** field.
5. Type a textual description for the BACnet Object in the **Description** field.
6. Select the **Enabled** option to connect to BACnet physical device.
7. to configure data Update Mechanism, see [BACnet Object - General Tab](#).
8. To configure Triggers for the BACnet Object, click the **Triggers** tab.
9. To view the state images for the BACnet Object, click the **State Images** tab , and optionally customize the state images.
10. After you edit the BACnet Object, save the BACnet Object configuration.

Configuring Data Update Mechanism for a BACnet Object

You can use the BACnet Object Editor to configure Data Update Mechanism for a BACnet Object.

To Use Subscribe COV/Event Notification to Update Data

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click Building Automation. The Building Automation pane opens.
2. Expand the **BACnet Object** folder.
3. Double-click a BACnet Object icon or name or right-click a BACnet Object and select **Edit** from context menu, the BACnet Object editor opens.
4. Check Subscribe COV/Event Notification radio button to use Alarm and Event services to update data. You can select one or more mechanisms to update data as needed.
 - Select the **Use Subscribe COV** check box to use Subscribe COV service to update data.
 - Select the **Use Subscribe COV Property** check box to use Subscribe COV Property service to update data, you can specify what properties should be subscribed. For now, only Present value and Status Flag properties supported.
 - Select the **Use Event Notification** check box to use Unconfirmed Event Notification service to update data. Click  to retrieve the available Notification Class list, then select the Notification Class ID used to notify events. If there is no Notification class ID available, it means no Notification Class created in real BACnet device.

NOTE


To use this mechanism, user should add the MAC Address and Network ID(12505 by default) of C•CURE 9000 server to the reception list of the subscribed Notification Class on real BACnet Device.

5. Click Save and Close.

BACnet Object - Triggers Tab

The trigger on BMS integration enhanced to support complex conditions. When the value change on BACnet object matches the particular pre-defined criteria, a trigger automatically executes a specified Action.

Figure 22: BACnet Object Triggers Tab

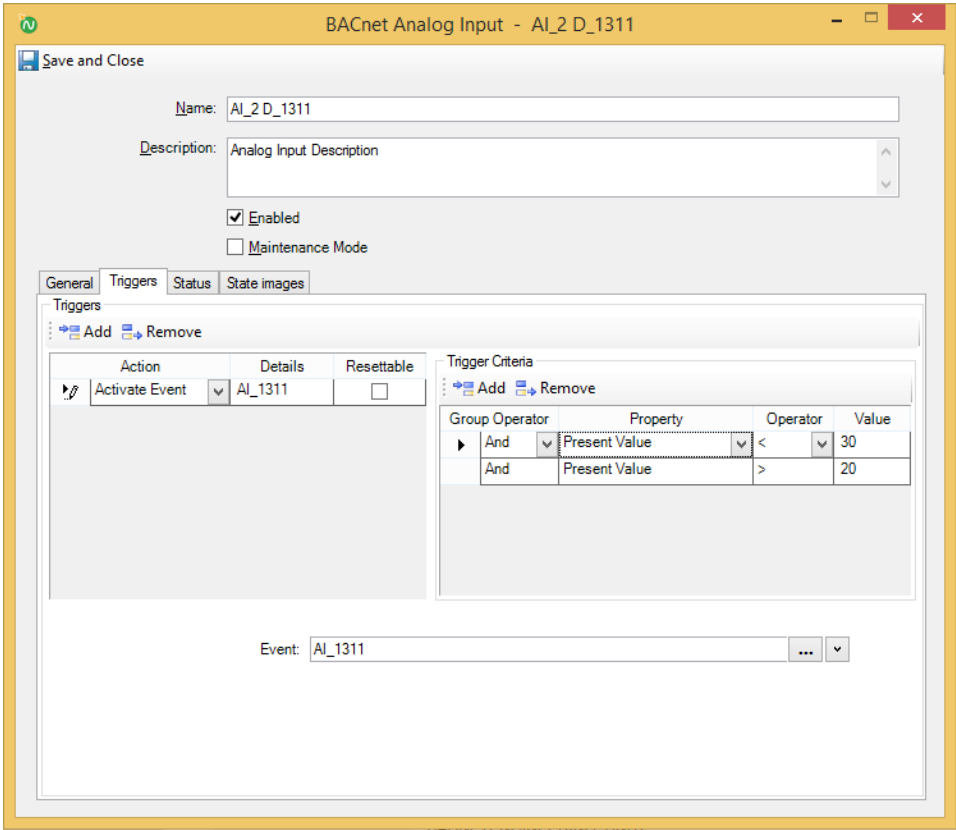

The following table contains an example of how a Trigger is configured.

Table 9: Trigger Tab Setting Example

The following Triggers tab settings			
Trigger Criteria	Action	Details	Schedule
When the Present Value>20 and the Present Value <30	Activate Event	AI_1311	Always
<p>Would create the following Trigger:</p> <p>Anytime (Always Schedule) the Present Value (Property) > 20 (Value) and the Present Value (Property) <30 (Value), activate the event (Action) named AI_1311 Event (Details).</p> <p>AI_1311 Event is an event that you would need to create using the Event Editor.</p> <p>For information about how to create and configure an event, see the <i>C•CURE 9000 User Software Configuration Guide</i>.</p>			

BACnet Object Triggers Tab Definitions

The following table provides definitions of BACnet Object Triggers tab.

Table 10: BACnet Object Triggers Tab Definitions

Field		Description	
Add		Click Add in the Triggers tab to create a new trigger.	
Remove		Click Remove in the Triggers tab to delete a new trigger.	
Action		Click within the Action column to display a drop-down list of valid actions. Click on Action that you want to include as a parameter for the trigger to add it to the column.	
Details		Displays details about how the Action was configured.	
Resettable		Select this check box to indicate that an operator responding to the Event can reset an Action without acknowledging the Event. This allows Monitoring Station personnel to manually reset the action caused by the event. Used to turn off output, such as a siren, activated by the event. Reset actions do not require event acknowledgment.	
Trigger Criteria			
Add		Click Add in the Triggers tab to create a new condition.	
Remove		Click Remove in the Triggers tab to delete a condition.	
Group Operator	Property	Operator	Value
Only support And operation among conditions. If Or is needed, the user can add another trigger instead.	Alarm Status	=, ≠	Alarm, Normal, Unknown
	Fault Status	=, ≠	Fault, Normal, Unknown
	Out of Service Status	=, ≠	True, False, Unknown
	Present Value	>, >=, =, ≠, <, <= except that =, ≠ for binary input, binary output, binary value	User defined value, except that BinaryActive, BinaryInactive, BinaryNull for binary input, binary output, binary value

Defining a Trigger for a BACnet Object

To Create a Trigger for BACnet Object

1. From the BACnet Object Editor, navigate to the **Triggers** tab.
2. Click **Add** in the Trigger tab to add a new row, and the Trigger Criteria grid is available to define trigger criteria.
3. Click the **Add** button on the right grid to add a condition.
4. Select a desired property from **Property** dropdown list, select the proper operator from **Operator** dropdown list, then select target value from **Value** dropdown list to create a condition.
5. If the trigger criteria are complex conditions, repeat step 3~4 to create other conditions. Now the Group Operator only support And, so the trigger criteria is true only when all conditions are met.
6. Click within the Action column to display a drop-down list of valid actions. Now only Activate Event is available.


When you select an Action, the lower pane in the Trigger box displays an Event field for you to define the Action details.

Click  to open Event Dialog. Select an Event that you want to associate with the trigger.

Once you define the Action details, the Details column displays information about how the Action has been configured.

7. Click **Save and Close** to save the BACnet Object with the Trigger you configured.

To Remove a Trigger

1. From the BACnet Object Editor, navigate to the **Trigger** tab.
2. Use  to select the row in the Trigger table for the Trigger you want to remove.
3. Click **Remove**.
4. Click **Save and Close**.

BACnet Object - Status Tab

The BACnet Object Status tab provides read-only status information about the BACnet Object.

Figure 23: BACnet Object Status Tab

The screenshot shows a software window titled "BACnet Analog Input - AI_2 D_1311". At the top left is a "Save and Close" button. Below it are input fields for "Name" (containing "AI_2 D_1311") and "Description" (containing "Analog Input Description"). There are two checkboxes: "Enabled" (checked) and "Maintenance Mode" (unchecked). Below these are four tabs: "General", "Triggers", "Status", and "State images". The "Status" tab is selected, displaying three status fields: "Alarm Status" with a value of "Normal", "Fault Status" with a value of "Normal", and "OutOfService Status" with a value of "False".

BACnet Object Status Tab Definitions

The following table provides BACnet Object Status tab definitions.


Table 11: BACnet Object Status Tab Definitions

Field	Definition
Alarm Status	Indicate the object is in alarm status. Valid value: Alarm or Normal.
Fault Status	Indicate the object is in fault status. Valid value: Fault or Normal
Out of service Status	Indicates the object is in service or not. Valid value: True or False.

BACnet Object - State Images Tab

From the BACnet Object State Images tab, you can change the default images that indicate the BACnet Object states on the Monitoring Station.

Figure 24: BACnet Object State Images Tab

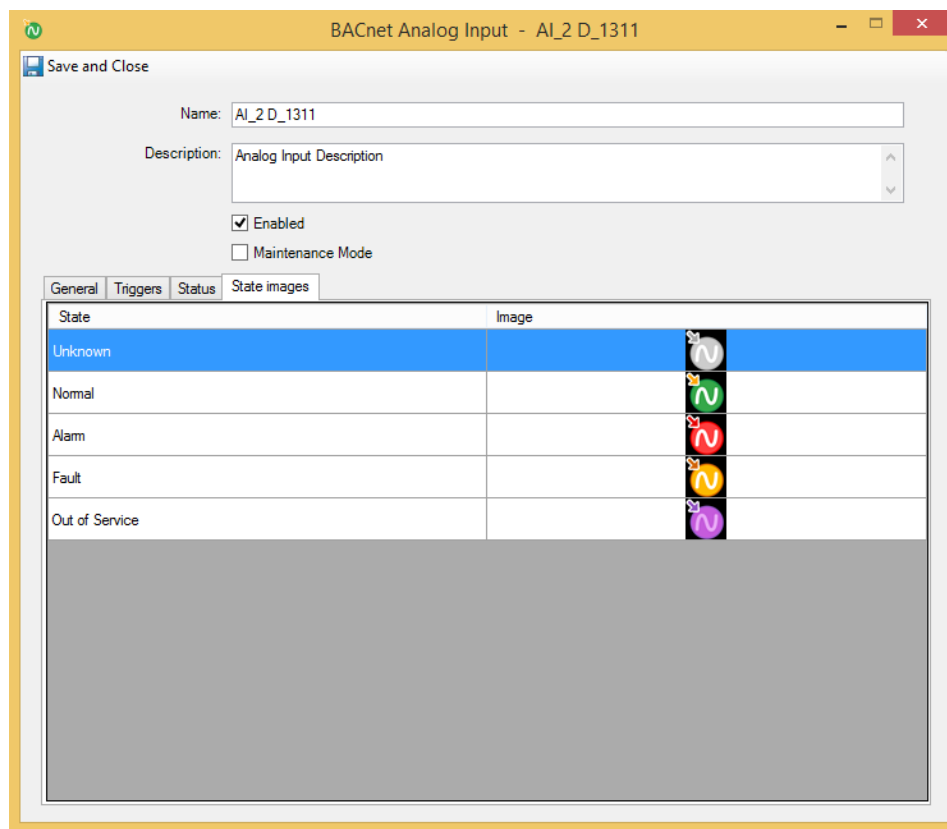

You can replace the default images with JPG formatted files of your choice, to uniquely identify your objects when activities are displayed on the Monitoring Station Client.

Customizing State Images for a BACnet Object

From the BACnet Object State Images tab, you can change the images that appear in the Monitoring Station to represent BACnet Objects.

To Customize BACnet Object State Images

1. From the **BACnet Object State Images** tab, double-click the existing image. A Windows Open dialog box appears allowing you to browse for a folder in which you have placed replacement images.
2. When you locate the replacement image, select it and click **Open** to replace the default image with this image.
3. When you are done editing the BACnet Object, click **Save and Close** to save the device configuration.


To Restore the Default State Image

1. From the **BACnet device State Image** tab, select an existing image.
2. Right-click the image and select **Restore Default**.
3. Click **Save and Close** to save the device configuration.

BACnet Schedule Object - Object Configuration Tab

From the BACnet Schedule Object - Object Configuration tab, you can set the name and description for the BACnet Schedule Object and configure the Object Property Reference settings for the device.


Figure 25: BACnet Schedule Object - Object Configuration Tab

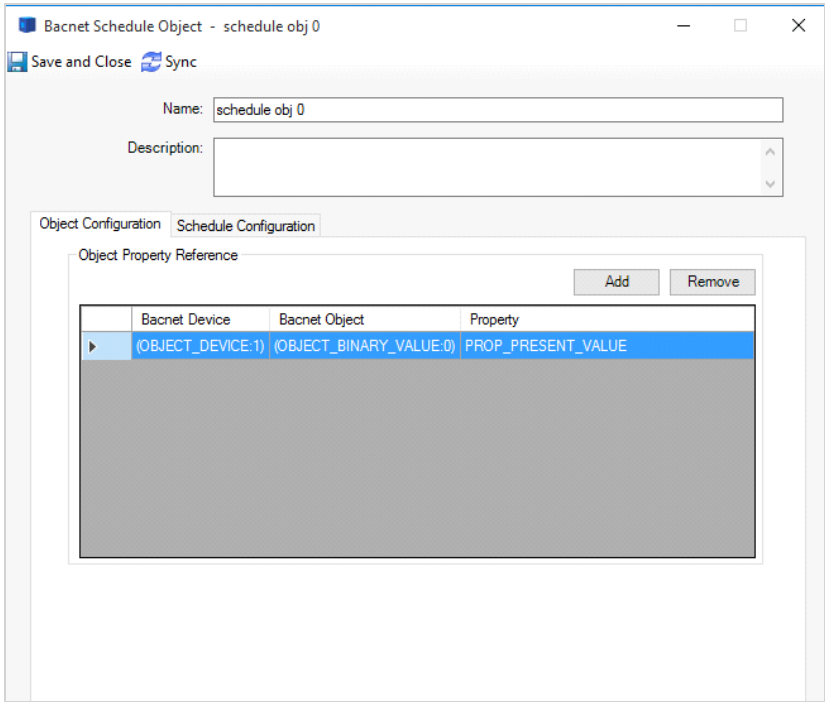

BACnet Schedule Object - Object Configuration Tab Definitions

The following table describes the fields on the BACnet Schedule Object - Object Configuration tab.

Table 12: BACnet Schedule Object - Object Configurations Tab Definitions

Field	Description
Name	Schedule Name is imported from BACnet device, user can update the Name with up to 50 characters and Name cannot be duplicated with the existing one.
Description	Enter a general comment about the BACnet device that will help you identify the device. This text is for information only.
Object Property Reference	This property specifies the Device Identifiers, Object Identifiers and Property Identifiers of the properties to be written with specific values at specific times on specific days.
BACnet Device	Display device name of the Schedule Objects.
Default Value	This property specifies the Device Identifiers, Object Identifiers and Property Identifiers of the properties to be written with specific values at specific times on specific days. The value must be comply with the object type in object property reference.
Sync Button 	Click the sync button: The Object configuration via victor synchronizes to BACnet Device. Note: If you click the save button not the sync button, the schedule date will only be saved to victor database.

BACnet Schedule Object - Schedule Configuration Tab

The BACnet Schedule Object - Schedule Configuration tab, lets you set the name and description for the BACnet Schedule Object, and configure the Period and Schedule settings for the device.


Figure 26: BACnet Schedule Object - Schedule Configuration Tab

BACnet Schedule Object - Schedule Configuration Tab Definitions

The following table describes the BACnet Schedule Configuration tab fields.

Table 13: BACnet Schedule Configurations Tab Definitions

Field	Description
Name	Schedule Name is imported from BACnet Device, user can update the Name with up to 50 characters and Name cannot be duplicated with the existing one.
Description	Enter a general comment about the BACnet Device that will help you identify the device. This text is for information only.
Effective Period	This property specifies the range of dates when the Schedule Object is active.
Weekly Schedule	This field corresponds to the days Monday – Sunday. Each day consists of a list of BACnet Time and Value pairs, which describe the sequence of schedule actions on one day of the week when no Exception Schedule is in effect. The value must be comply with the object type in object property reference.

Field	Description
Exception Schedule	This field describes a sequence of schedule actions that takes precedence over the normal day's behavior on a specific day or days. The value must be comply with the object type in object property reference.
Sync button 	Click the sync button: the Schedule configuration via victor synchronizes to BACnet Device. Note: If you click save button, not sync button, the schedule date will only be saved to victor database.

Acknowledge Ack required Event Notification

This chapter describes how to acknowledge Ack required event notification. In this chapter:

Acknowledge Ack required Event Notification Overview	60
Accessing the Ack required Event Notification List	61
Acknowledging Ack required Event Notification	62

Acknowledge Ack required Event Notification Overview


If BACnet objects use Event Notification mechanism to update data, and the subscribed Event Notification Class Required Acknowledgment, BMS integration can acknowledge Ack required event notifications from real BACnet device.

Accessing the Ack required Event Notification List

Perform the following steps to access Ack required event notification list.

To Access the Ack required Event Notification

- 1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
- 2. To open the Ack required Event Notification window, right-click the BACnet Devices folder, and select **Ack required** from the context menu.

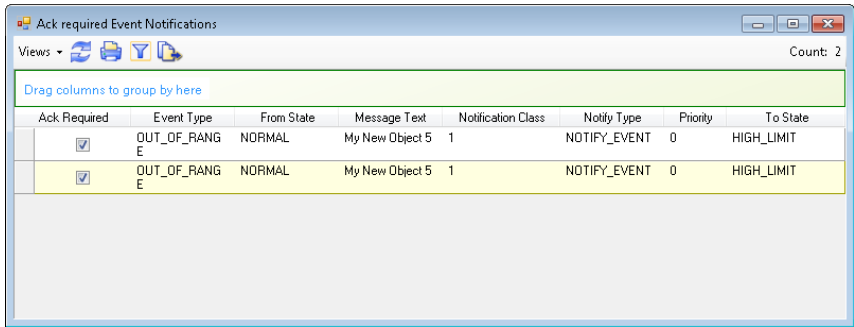

The screenshot shows a window titled "Ack required Event Notifications" with a toolbar and a table. The table has 8 columns: Ack Required, Event Type, From State, Message Text, Notification Class, Notify Type, Priority, and To State. There are 2 rows of data, both with "Ack Required" checked.

<input checked="" type="checkbox"/>	OUT_OF_RANGE	NORMAL	My New Object 5	1	NOTIFY_EVENT	0	HIGH_LIMIT
<input checked="" type="checkbox"/>	OUT_OF_RANGE	NORMAL	My New Object 5	1	NOTIFY_EVENT	0	HIGH_LIMIT

Acknowledging Ack required Event Notification

Perform the following steps to acknowledge Ack required event notification .



To Acknowledge the Ack required Event Notification

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. To open the Ack required Event Notification window, right-click the BACnet Devices folder, and select **Ack required** from the context menu.
3. Right click the desired Ack required event notification record, select **Acknowledgment** from the context menu. A confirmation message box is displayed.
4. Click **Yes** to acknowledge. After that, the selected record removed from the list.

Widget on Map

This chapter describes how to set animation for BACnet objects by widget on map. In this chapter:


Overview	64
Widget Descriptions	64
Adding a Widget on Map	71
Editing a Widget on Map	74

Overview

The integration support Fan, Boiler, Chiller, Cooler, Damper, Heater, Humidifier, Meter, Motor, Bargraph, Bulb Light, Green Pilot Light, Red Pilot Light, Yellow Pilot Light, Pump, Push Button, Sensor Controller, Sensor Display, Slider, Switch, Tank, Label, Multiple State, Text, Valve widgets.

After you install the BMS integration, on map editor, there is an additional menu item on the  dropdown list.

Figure 27: Add a widget menu













You can associate a C•CURE 9000 object with a widget, then the widget is able to display the real-time value, different animations for different state (refer to Animation column on [Table 7-1](#)), additional alarm/fault/disable markup for alarm/fault/disable state.









Alarm markup is , Fault markup is , Disable markup is . The priority of these state is Disable > Alarm > Fault.








Widget Descriptions











Table 14: Widget Descriptions



Name	Description	Properties	Options	Animation
Heater	The widget reflects heating output percent (0~100%).	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	 Heater is off.
				 Heater is on, and the red frame size will adjust according to the heating output.

Name	Description	Properties	Options	Animation
Cooler	The widget reflects cooling output percent (0~100%).	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	 Cooler is off.
				 Cooler is on, and the blue snowflake size will adjust according to the cooling output.
Boiler	The widget reflects boiler output percent (0~100%).	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	 Boiler is off.
				 Boiler is on and the red flame size will adjust according to the boiler output.
Chiller	The widget reflects chiller output percent (0~100%).	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	 Chiller is off.
				 Chiller is on.
Humidifier	The widget reflects humidifier output percent (0~100%).	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	 Humidifier is off.
				 Humidifier is on.

Name	Description	Properties	Options	Animation
Fan	The widget reflects fan output percent (0~100%).	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Rotation: 0~360 Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	 Fan is off.
				 When fan output is higher than 0, the fan leaf will go round. The speed will adjust according to the fan output.
Pump	The widget reflects pump output percent (0~100%).	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Rotation: 0~360 Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	 Pump is off.
				 When pump output is higher than 0, the pump leaf will go round. The speed will adjust according to the pump output.
Damper	The widget reflects damper output percent (0~100%).	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	 Damper is off.
				 When damper output is higher than 0, the grid of damper will sway. The speed will adjust according to the damper output.
Valve	The widget reflects valve position range of 0~100%.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Rotation: 0~360 Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	 Valve is closed.
				 When valve output is higher than 0, the valve will open. The valve position will adjust according to the valve output

Name	Description	Properties	Options	Animation
Motor	The widget reflects motor on/off state, and provides motor speed value, e.g. 1,800 rpm.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	 Motor is off.
				 Motor is on.
Tank	The widget reflects how many percent have been filled in tank (1~100%).	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Large Change: the value to be changed when presses the PAGE UP or PAGE DOWN key or clicks the track bar. Default value is 1. Maximum Value:100 Minimum Value: 0 Show Present Value: True or False. True means to display the present value in view mode. Default value is false. Small Change: the value to be changed when presses arrow key. Default value is 0.1.	 Tank is off.
				 Tank is on and the scale will adjust according to the tank output
Meter	The widget displays an analog value.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Maximum Value:180 Minimum Value: 0 Show Present Value: True or False. True means to display the present value in view mode. Default value is false.	
Sensor Controller	The widget displays the sensor analog value together with its unit. E.g. 72.9°F.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Maximum Value:100 Minimum Value: 0 Step Value: the increase or decrease step value. Default value is 1. Unit: the unit of value	 Click up arrow button to increase sensor value by one step, click down arrow button to decrease sensor value by one step.
Sensor Display	The widget displays the sensor analog value together with its unit. E.g. 72.9°F.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Maximum Value:100 Minimum Value: 0 Step Value: 1 Unit: the unit of value	

Name	Description	Properties	Options	Animation
Switch	The widget reflects on/off state of binary input/value. Click this widget is change the binary input/value status.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide	 Switch is off.
				 Switch is on.
BulbLight	The widget reflects on/off state of binary input/value. Click this widget is change the binary input/value status.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Rotation: 0~360	 Bulb is off.
				 Bulb is on.
Polit Light	The widget reflects on/off state of binary output/ value.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide	 Polit light is off.
				 Green polit light is on.
				 Yellow polit light is on.
				 Red polit light is on.
Push Button	The widget reflects on/off state of binary input/value. Click this widget is change the binary input/value status.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide	 Push button is off.
				 Push button is on.

Name	Description	Properties	Options	Animation
Bargraph	The widget displays an analog value together with Name. The user can change the value in text box.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Maximum Valve:100 Minimum Value: 0 Unit: the unit of value The unit/maximum/minimum is configurable.	
Slider	The widget displays an analog value. The user can change the value by slider or input the value in text box directly.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Large Change: the value to be changed when presses the PAGE UP or PAGE DOWN key or clicks the track bar. Default value is 1. Maximum Valve: 100 Minimum Value: 0 Small Change: the value to be changed when presses arrow key. Default value is 0.1. Unit: the unit of value The minimum/maximum is configurable.	
Label	The widget displays a read-only analog value together with Name.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Unit: the unit of value The unit/name is configurable.	AI_2 D_1221 : 8
MultipleState	The widget displays a read-only multistate value together with name. The name is configurable.	Alarm Status Enabled Fault Status Object Name Present Value Number of States	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide State Text: split with “,”.	MI_2 D_1221 : off

Name	Description	Properties	Options	Animation
Text	The widget displays an analog value together with Unit or Name. The user can change the value in text box.	Alarm Status Enabled Fault Status Object Name Present Value	Alarm Annunciation: Blink, Normal, Hide Fault Annunciation: Blink, Normal, Hide Maximum Value: 100 Minimum Value: 0 Unit: the unit of value The unit/name/maximum/minimum is configurable.	AI_2 D_1221 <input type="text" value="8"/>

Adding a Widget on Map

Perform the following steps to add a Widget on map.


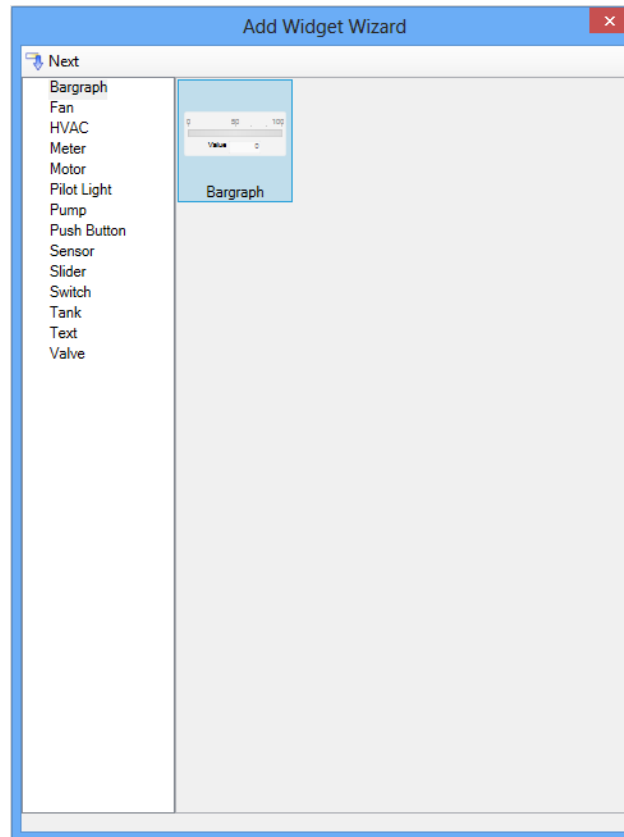
1. On a map editor, click the arrow on . The context menu for the button appears.
2. Select Add a Widget menu, open Add a Widget Wizard window.

Figure 28: Add Widget Wizard - Widget List



3. Select one Widget type from the list on the left, the available widgets will list on the right.
All widgets can be binding to input/value object. The widget is recommended to bind to output object if it can be operated, such as Sensor Controller, Switch, Tank, BulbLight, PushButton, Bargraph, Slider, Text.
4. Select the desired widget, click **Next**. The widget configuration form opens, and the wizard title includes the widget name.

Figure 29: Widget Configuration Form

Add Widget Wizard [Slider]

Save and Close

Layer for this icon:
0

Link to this Object Type

Type:

Object:

Tooltip to display on hover:

☒ Show context menu on right click

Assign Property

Property Name	Assigned Property

Widget Options

Misc

Alarm Annunciation	Blink
Fault Annunciation	Normal

Alarm Annunciation
Set how to annunciate alarm

5. Click in the **Type** field to open a **Select Type** dialog box that allows you to select a BACnet object type linking to this widget. Click the BACnet object type you want to link to this widget.

Once BACnet object type selected, system will assign properties automatically if the widget's property name equals object's property name. If name doesn't match, the corresponding Assigned Property is empty, and then manual assignment is needed. Click the cell, select desired property from drop-down list.

Every widget supports Alarm Status, Enabled, Fault Status, Object Name, Present Value properties.

Figure 30: Widget Configuration - Assign Property

Save and Close

Layer for this icon:
0

Link to this Object Type
Type:
BACnet Analog Output

Object:
...

Tooltip to display on hover:
...

☒ Show context menu on right click

Assign Property

Property Name	Assigned Property
Alarm Status	Alarm Status
Enabled	Enabled
Fault Status	Fault Status
Object Name	Name
* Present Value	Present Value

Widget Options

Misc


Alarm Annunciation	Blink
Fault Annunciation	Normal

Alarm Annunciation
Set how to annunciate alarm

6. Click in the **Object** field to open a dialog box that allow you to select an object of the type you just selected. Click the object you want to choose for this widget.
7. **Optional:** To display a tooltip message about the widget, type a tooltip in the **Tooltip to Display on Hover** field.
8. To configure the widget options, see [Widget Descriptions](#).
9. Click **Save and Close**. This widget is added into map with red frame.
10. Adjust the widget's position in the map by drag and drop.
11. Adjust the widget's size by mouse wheel.
12. To save this widget, right-click the widget and select **Save Widget** from context menu.
13. When completed map configuration, click **Save and Close** to save this map.

Editing a Widget on Map

Perform the following steps to edit a Widget on map.

1. Open an existing map, click . The cursor becomes a cross-hair.
2. Right-click the widget and choose **Edit Widget** from the context menu to configure widget.
3. Edit the widget as required.
4. Click **Save and Close**. This widget is added into map with red frame.
5. Adjust the widget's position in the map by drag and drop.
6. Adjust the widget's size by mouse wheel.
7. To save this widget, right-click the widget and select **Save Widget** from context menu.
8. When completed map configuration, click **Save and Close** to save this map.

BACnet Event and Action


This chapter describes BACnet event action that affects BACnet object. In this chapter:

BACnet Event Action	76
BACnet Object Action Definition	76
Configuring BACnet Object Action	78

BACnet Event Action

The BMS Integration supports a BACnet Object action that affects a BACnet object in a BACnet device. A BACnet Object Action is audited when created or deleted.

Figure 31: BACnet Specific Actions List

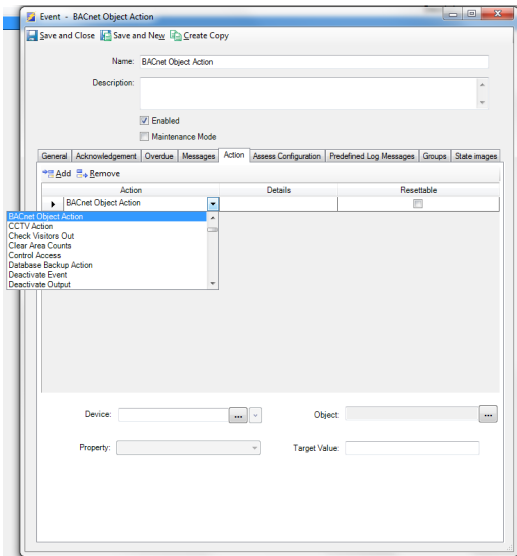

The following table provides the action and its target object respectively.


Table 15: Actions and Target object

Action	Target Object	Explanation
BACnet Object Action	BACnet Object	The BACnet object action will change the selected BACnet object's present value to the configured value.

BACnet Object Action Definition



When you select BACnet Object Action in the Action drop-down list, the related field and pane appears.

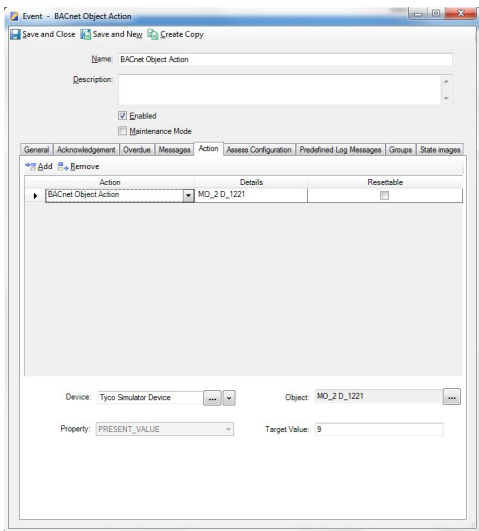Figure 32: BACnet Object Action



The following table provides BACnet Object Action definition:


Table 16: Action Tab-BACnet Object Action Definitions

Field	Description
Device	Click  to open the Device list. Select a BACnet device that the target object of this action belongs to.
Object	Click  to open the Object list. It will list all BACnet objects available on the selected BACnet device. Select a BACnet object as the target object of this action.
Property	Only support present value now.
Target Value	<p>Set the target value that this action will change to.</p> <p>For Binary Input/Output/Value object, the valid target value is Binary_Active, Binary_Inactive, Binary_Null. You can select desired target value from dropdown list.</p> <p>For Analog Input/Output/Value, Multistate Input/Output/Value, you can enter number directly on textbox.</p>

Configuring BACnet Object Action


Perform the following steps to configure a BACnet object action.

To Configure a BACnet Object Action

1. Create an Event named **Change AI Value**. For information about creating an event, refer to the *C•CURE 900 Software Configuration Guide*.
2. Open this Change AI Value event, select Action tab, and then select BACnet Object Action in the Action field.
 - a. In the Device field, click the  to open the BACnet device list. In the BACnet device list, select a BACnet device that the target object of this action belongs to.

Example:

Select **Tyco Simulator Device**.

- b. In the Object field, click the  to open the BACnet object list. In the BACnet object list, select a BACnet object as the target object of this action.

Example:


Select **AI_2 D_1221**.

- c. In the Target Value field, enter the target value for present value property.

Example:

Enter 9.

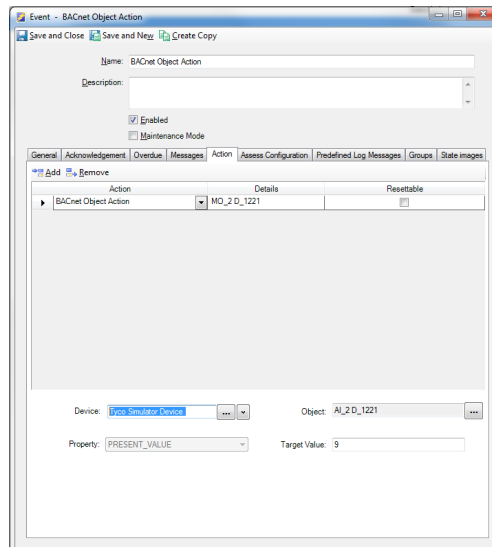


Figure 33: Action Configuration Example



3. Click **Save and Close**. The BACnet Object action is created. In the Audit Log report, you can find this audit as shown in below.

Object Created 12/2/2014 12:13:38 Action Item (Action: 1 - BACnet Object Command on 'AI_2 D_1221' when Active Status is Active) owned by Event ('Change AI Value') was created by 'Victor'.

4. Activate this Event, which will change present value of AI_2 D_1221 to 9, as shown in the following Journal.

	11/25/2014 3:17:56 PM	Manual action by 'victor': Activate Event 'BACnet Object Action' from 11/25/2014 3:17:54 PM to 11/25/2014 4:17:00 PM.
	11/25/2014 3:17:56 PM	Event 'BACnet Object Action' is active causer Manual Action by victor.
	11/25/2014 3:17:57 PM	PresentValue of AnalogInput 'AI_2_D_1221' on BACnet Device 'Tyco Simulator Device ' Changed to 9.

BACnet Gateway Template Editor

This chapter describes how to maintenance BACnet Gateway Templates. In this chapter:

- BACnet Gateway Template Overview 81
- Viewing the Available BACnet Gateway Template list 82
- Viewing the Mapping Definition of the BACnet Gateway Template 83
- Creating a New BACnet Gateway Template 84
- Editing a BACnet Gateway Template 85
- Removing a BACnet Gateway Template 86

BACnet Gateway Template Overview

The BACnet gateway template defines the mapping definition on how to map C•CURE 9000 objects to BACnet objects.

The BMS integration provides the default gateway templates and also provide the way to customize gateway template.

BMS Integration provides the following default gateway templates:

- iStar people counting gateway template - this template maps the UserCountStatus property of Area to the present value of BACnet Analog Input.
- Default Event Template - this template maps the ActiveStatus of Event to present value of BACnet Binary Input.

Viewing the Available BACnet Gateway Template list


Perform the following steps to view the available BACnet gateway template list.

To View the Available BACnet Gateway Template List

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Right-click the BACnet Gateways folder, and select **Manage Templates**.

The BACnet Gateway Template window opens. This window lists all available BACnet Gateway Templates, including default gateway templates.

Figure 34: BACnet Gateway Template

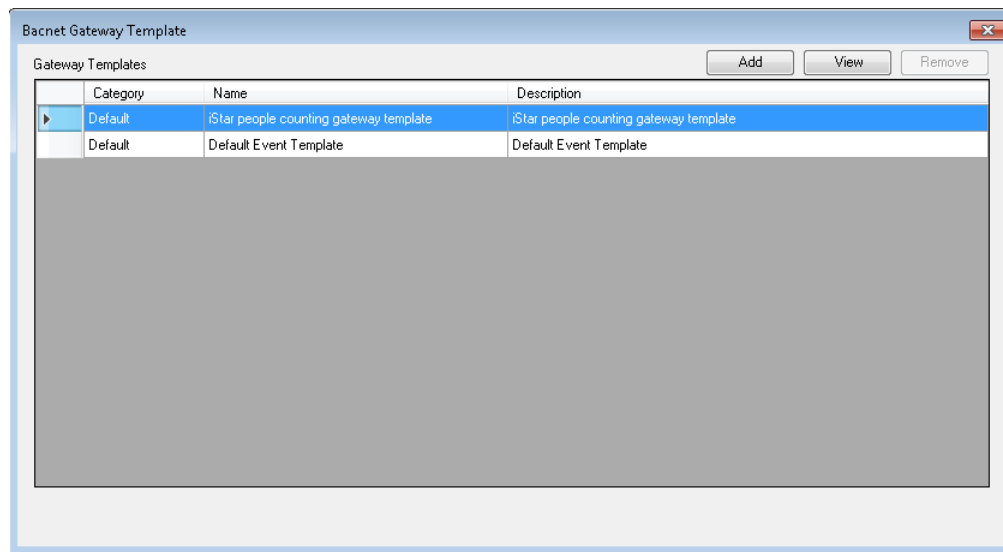

Viewing the Mapping Definition of the BACnet Gateway Template

Perform the following steps to view the mapping definition of the specific BACnet Gateway Template.

To View the Mapping Definition of the Specific BACnet Gateway Template

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Right-click the BACnet Gateways folder, and select **Manage Templates**.
3. From the **BACnet Gateway Template** window, select the desired template, click the **View** button to open a window that shows the mapping definition of this template.

Figure 35: Create Mapping and Binding

Create Mapping and Binding

Name: Demo

Description:

Mapping

Monitor Object Type: DSC Partition

Monitor Object Property: AlarmStatus

Gateway Object Type: BACnetGatewayAnalogInput

Gateway Object Property: PresentValue

Mapping Definitions:

Monitor Object Type	Monitor Object Property	Gateway Object Type	Gateway Object Property
DSC Partition	AlarmStatus	BACnetGatewayAnalogInput	PresentValue

OK Cancel

Creating a New BACnet Gateway Template

Perform the following steps to create a new BACnet Gateway Template.

To Create a New BACnet Gateway Template

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**.
2. From the **Building Automation** pane, right-click the **BACnet Gateways** folder and select **Manage Templates**.
3. From the **BACnet Gateway Template** window, click **Add**. The **Create Mapping and Binding** window opens.
4. Type a unique name in the **Name** field.
5. Type a description for the template in the **Description** field.
6. To configure a mapping definition, complete the following steps:
 - a. Select C•CURE 9000 object type from the **Monitor Object Type** drop-down list.
 - b. Select the object property for the selected object type from **Monitor Object Property** drop-down list.
 - c. Select the gateway object type from the **Gateway Object Type** drop-down list.
 - d. Select the object property for the selected gateway object type from the **Gateway Object Property** drop-down list.
 - e. Click **Add** to add the mapping definition to the **Mapping Definitions** list.

NOTE

You can add multiple mapping definitions to the BACnet Gateway Template.

7. **Optional:** To remove a mapping definition from the template, select a mapping definition from the **Mapping Definitions** list and then click the **Remove** button.
8. To save and exit, click **OK**.

Editing a BACnet Gateway Template

For the user-defined BACnet gateway template, if it has not been used yet, it can be changed if needed.

Perform the following steps to edit a BACnet Gateway Template.

NOTE

For the default gateway template and the template which has been used, there is no Edit button available.

To Edit a BACnet Gateway Template

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. From the **Building Automation** pane, right-click the **BACnet Gateways** folder and select **Manage Templates**.
3. From the **BACnet Gateway Template** window, select a BACnet Gateway Template and click **Edit**. The **Create Mapping and Binding** window opens.
4. Type a unique name in the **Name** field.
5. Type a description for the template in the **Description** field.
6. To configure a mapping definition, complete the following steps:
 - a. Select C•CURE 9000 object type from the **Monitor Object Type** drop-down list.
 - b. Select the object property for the selected object type from **Monitor Object Property** drop-down list.
 - c. Select the gateway object type from the **Gateway Object Type** drop-down list.
 - d. Select the object property for the selected gateway object type from the **Gateway Object Property** drop-down list.
 - e. Click **Add** to add the mapping definition to the **Mapping Definitions** list.

NOTE

You can add multiple mapping definitions to the BACnet Gateway Template.


7. **Optional:** To remove a mapping definition from the template, select a mapping definition from the **Mapping Definitions** list and then click the **Remove** button.
8. To save and exit, click **OK**.

Removing a BACnet Gateway Template

Perform the following steps to remove a BACnet Gateway Template.

To Remove a BACnet Gateway Template

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**.
2. From the **Building Automation** pane, right-click the **BACnet Gateways** folder and select **Manage Templates**.
3. From the **BACnet Gateway Template** window, select a BACnet Gateway Template and click **Remove**.
4. In the Confirmation dialog box, click **Yes**.

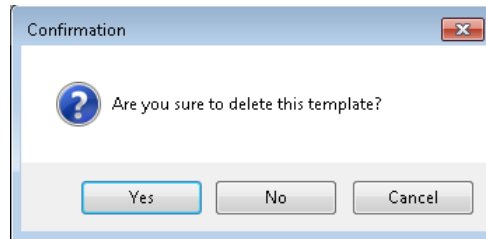

NOTE

For the default gateway template and the template which has been used, the remove button is grayed out.

BACnet Gateway Device Editor

This chapter describes BACnet Gateway Device Editor. In this chapter:

- BACnet Gateway Device Editor Overview88
- Accessing the BACnet Gateway Device Editor89
- Adding a BACnet Gateway Device Object90
- Deleting a BACnet Gateway Device Object91
- BACnet Gateway Device General Tab92
- BACnet Gateway Device General Tab Definitions92
 - Configuring a BACnet Gateway Device Object93
 - Creating Monitored Mapping for BACnet Gateway Device94
 - Viewing BACnet Gateway Monitored Objects95
 - Viewing the Mapping Reports for BACnet Gateway Device96

BACnet Gateway Device Editor Overview

The BACnet gateway device represents the device that contains BACnet objects mapping from C•CURE 9000 objects.

Accessing the BACnet Gateway Device Editor

Perform the following steps to access the BACnet Gateway Device editor.

To Access the BACnet Gateway Device Editor

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**.
2. From the **Building Automation** pane, right-click the BACnet Gateways folder and select **New**.

The BACnet Gateway Device Editor opens with the General tab visible.

Adding a BACnet Gateway Device Object

Perform the following steps to add a BACnet Gateway Device object.

To Add a BACnet Gateway Device Object

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**.
2. From the **Building Automation** pane, right-click the BACnet Gateways folder and select **New**.
The BACnet Gateway Device editor opens.
3. Type a unique name in the Name field.
4. Type a textual description for the BACnet Gateway device in the Description field.
5. See [BACnet Gateway Device General Tab](#) to configure communication information.

NOTE

If the Network ID of the BACnet gateway device is 0, MAC Address is not necessary, but if Network ID is not 0, you must enter MAC Address to identify device.


6. Check the **Enabled** option to make BACnet Gateway Device work.
7. If you are done editing the BACnet gateway device, click to save the BACnet gateway device configuration.

Deleting a BACnet Gateway Device Object

You can delete a BACnet gateway device from the Building Automation tree or from the dynamic view if you no longer need it.


To Delete a BACnet Gateway Device Object from the Building Automation Tree


1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click Building Automation. The Building Automation pane opens.
2. Expand the **BACnet Gateways** folder.

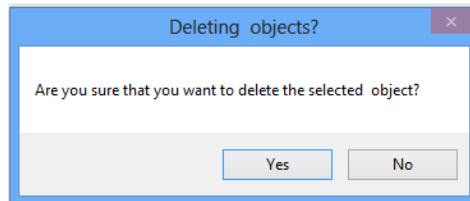

3. Right-click a BACnet gateway device object to be deleted and select **Delete** from context menu. A confirmation dialog box opens.
4. Click **Yes**. After a while, this BACnet gateway device object and all BACnet objects in this device are deleted from Building Automation tree and C•CURE 9000 database.

To Delete a BACnet Gateway Device Object from the Dynamic View

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Select **BACnet Gateways** from Building Automation pane drop-down list.
3. Click  to open a Dynamic View showing all BACnet Gateway Devices objects.

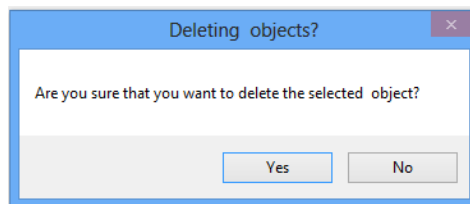

4. Right-click a BACnet gateway device object to be deleted and select **Delete** from context menu. A confirmation dialog box opens.
5. Click **Yes**. After a while, this BACnet gateway device object and all BACnet objects in this device are deleted from Building Automation tree and C•CURE 9000 database.

BACnet Gateway Device General Tab

From the BACnet Gateway Device General tab, you can set the name and description for the BACnet Gateway device, and configure the communication settings for the device.

Figure 36: BACnet Gateway Device - General Tab

BACnet Gateway Device General Tab Definitions

The following table describes the BACnet Gateway Device General tab fields.

Table 17: BACnet Gateway Device General Tab Definitions

Field	Description
Name	Enter a unique name up to 50 characters long for BACnet Gateway Device. If you enter the name of an existing object, the system will not save the object, and will display an error message indicating there is a conflict. Choose a different name.
Description	Enter a description of the BACnet gateway device that will help you identify the device. This text is for information only.
Enabled	Select the Enabled option to make BACnet gateway device work on system, or clear this option to disable the BACnet gateway Device. The default value is enabled. You can change BACnet Device ID, MAC Address, Network ID when disabled BACnet gateway device.
Configuration	
BACnet Device ID	BACnet gateway device ID, which must be unique on the network. Read only.
MAC Address	MAC address of BACnet gateway device. Read only.
Network ID	Network ID of BACnet gateway device. Read only.

Configuring a BACnet Gateway Device Object

You can use the BACnet Gateway Device Editor to configure settings for BACnet gateway device.

To Configure a BACnet Device Object


1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Expand the **BACnet Gateway** folder.
3. To edit the BACnet Gateway Device, select one of the following options:
 - Double-click a BACnet gate device icon or name
 - Right-click a BACnet gateway device and select **Edit**.The BACnet gateway device editor opens.
4. Type a unique name in the **Name** field.
5. Type a textual description for the BACnet gateway device in the **Description** field.
6. See [BACnet Gateway Device General Tab](#) to configure communication information.
7. Check the **Enabled** check box to make BACnet gateway device work.
8. If you are done editing the BACnet gateway device, click to save the BACnet gateway device configuration.

Creating Monitored Mapping for BACnet Gateway Device

Perform the following steps to create Monitored Mapping for BACnet Gateway Device.

To Create Monitored Mapping for BACnet Gateway Device

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Expand the **BACnet Gateways** folder.

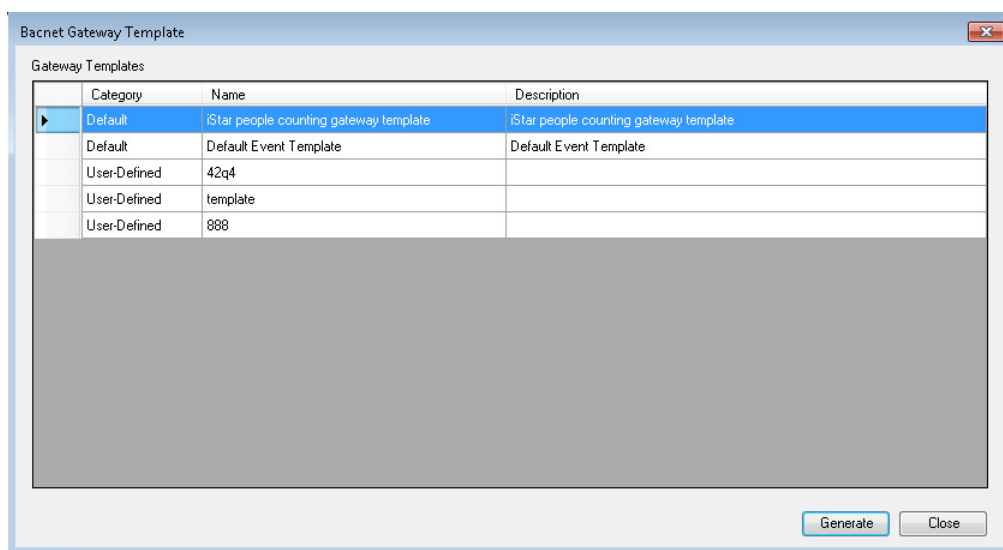


3. Right-click a BACnet Gateway device, select **Create Monitored Mapping** from context menu.
4. From the BACnet Gateway Template window, select a template and then click **Generate**.
The Create Mapping and Binding window opens. By default, one mapping definition is selected, and the corresponding monitored instances list on the Binding Instances frame.
5. Select a Mapping Definition, then select the instances to be monitored.
6. Click **Generate** to generate BACnet gateway objects. After a while, the output summary window opens to list all BACnet gateway objects and mapping results. The BACnet Gateway Object name is created automatically, following the rule: BACnet object type+instance name+object property.

Viewing BACnet Gateway Monitored Objects








Perform the following steps to view BACnet Gateway Monitored Objects.

To view the mapping reports for BACnet Gateway Device

- 1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
- 2. From **Building Automation** pane list, select **BACnet Gateways Monitored Objects**.
- 3. Click  to open a Dynamic View of all Monitored Objects that have been mapped.

The BACnet gateway monitor object grouped by Monitor Object Type by default.

BACnet Gateway Monitored Object

Views        Count: 4

Monitor Object Type

Area (2)				
Name	Monitor Object Property	Gateway Device Name	Gateway Object Type	Gateway Object Property
Area in	UserCountStatus	e	BACnet Gateway Analog Input	PresentValue
Area out	UserCountStatus	e	BACnet Gateway Analog Input	PresentValue


DSC Partition (2)

Viewing the Mapping Reports for BACnet Gateway Device

Perform the following steps to view the mapping reports for BACnet Gateway Device.

To view the mapping reports for BACnet Gateway Device

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Expand the **BACnet Gateways** folder.
3. Right-click a BACnet Gateway device and select **View Mapping Reports**.

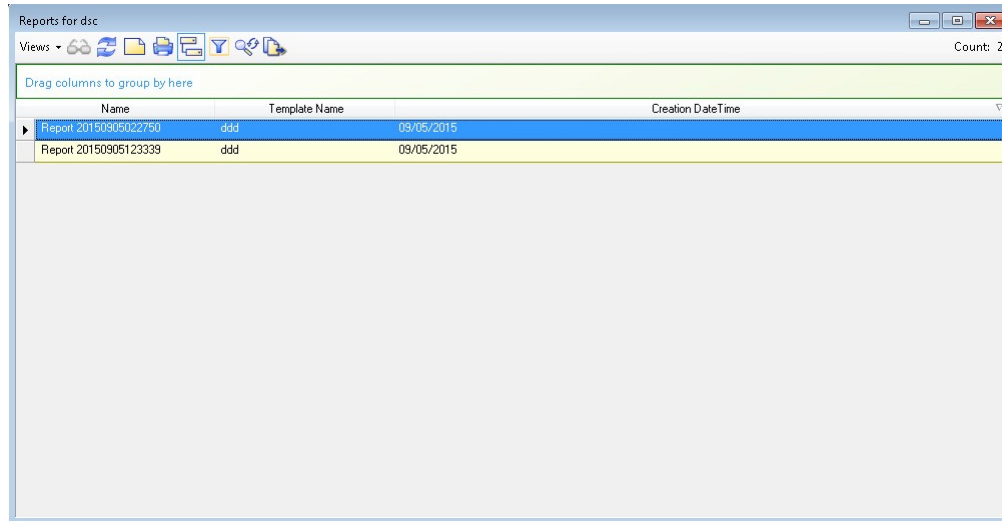

The screenshot shows a window titled "Reports for dsc" with a toolbar and a table. The table has three columns: Name, Template Name, and Creation DateTime. There are two rows of data. The first row is highlighted in blue, and the second row is highlighted in yellow. The table is part of a larger application window with standard Windows window controls and a toolbar with icons for various actions.

Name	Template Name	Creation DateTime
Report 20150905022750	ddd	09/05/2015
Report 20150905123339	ddd	09/05/2015

4. From the **Mapping Report** window, right-click a report and select **View Details**.
A window opens to display the detailed information, including Template Name, Template Definition, Mapping instances.

BACnet Gateway Object Editor

This chapter describes BACnet Gateway Object Editor. In this chapter:

- BACnet Gateway Object Editor Overview 98
- Accessing the BACnet Gateway Object Editor 99
- Deleting a BACnet Gateway Object 100
- BACnet Gateway Object General Tab 101
- BACnet Gateway Object General Tab Definitions 101
- Configuring a BACnet Gateway Object 102
- Viewing Monitor Object for this BACnet Gateway Object 103

BACnet Gateway Object Editor Overview

The BACnet Gateway Object represents the BACnet Gateway Object in the C•CURE 9000 database.

Accessing the BACnet Gateway Object Editor

Perform the following steps to access the BACnet Gateway Object editor.

To Access the BACnet Gateway Object Editor

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click Building Automation. The Building Automation pane opens.
2. Expand the **BACnet Gateways** folder.
3. Expand the Analog Input/AnalogOutput/Analog Value/Binary Input/Binary Output/ Binary Value/Multistate Input/Multistate Output/Multistate Value folder.
4. To open the BACnet Gateway Object editor to edit an existing BACnet Gateway Object, double-click a BACnet Gateway Object icon or name or right-click a BACnet Gateway Object and select Edit from context menu.


The BACnet Gateway Object Editor opens with the General tab visible.

Deleting a BACnet Gateway Object

You can delete a BACnet Gateway Object from the Building Automation tree or from the dynamic view if you no longer need it.


To Delete a BACnet Gateway Object from the Building Automation Tree


1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Expand the **BACnet Gateway Object** folder.
3. Right-click a BACnet Gateway Object to be deleted and select **Delete** from context menu. A confirmation dialog box opens.

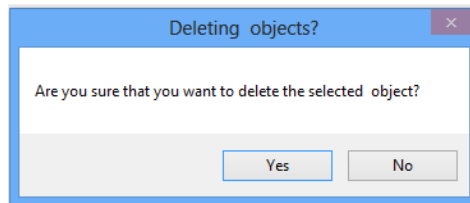

4. Click **Yes**. After a while, this BACnet Gateway Object is deleted from Building Automation tree and C•CURE 9000 database.

To Delete a BACnet Gateway Object from the Dynamic View

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Select **BACnet Gateway Object** from **Building Automation** pane drop-down list.
3. Click  to open a Dynamic View showing all BACnet Gateway Objects.
4. Right-click a BACnet Gateway Object to be deleted and select **Delete** from context menu. A confirmation dialog box opens.

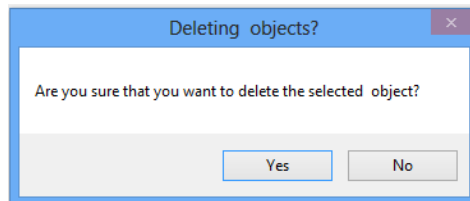

5. Click **Yes**. After a while, this BACnet Gateway Object is deleted from Building Automation tree and C•CURE 9000 database.

BACnet Gateway Object General Tab

From the BACnet Gateway Object General tab, you can set the name and description for the BACnet Gateway Object, and view present value of this object.

Figure 37: BACnet Gateway Object - General Tab

The screenshot shows a software window titled "BACnet Gateway Binary Input - BI_Audit LogBackup Event_ActiveStatus". Inside the window, there is a "Save and Close" button at the top left. Below it, the "Name" field contains the text "BI_Audit LogBackup Event_ActiveStatus". The "Description" field is empty. There are two checkboxes: "Enabled" (checked) and "Maintenance Mode" (unchecked). Below these is a tabbed interface with two tabs: "General" (selected) and "Monitor Object". Under the "General" tab, there is a section labeled "BACnet" containing four fields: "Object Type" with the value "OBJECT_BINARY_INPUT", "Object ID" with the value "5000", "Present Value" with the value "BINARY_INACTIVE", and "Status Flags" with the value "Normal".

BACnet Gateway Object General Tab Definitions

The following table describes the BACnet Gateway Object General tab fields.

Table 18: BACnet Gateway Object General Tab Definitions

Field	Description
Name	Enter a unique name up to 50 characters long for BACnet Gateway Object. If you enter the name of an existing object, the system will not save the object, and will display an error message indicating there is a conflict. Choose a different name.
Description	Enter a general comment about the BACnet Gateway Object that will help you identify the device. This text is for information only.
Enabled	Click Enabled to make this object work.
Object Type	BACnet Gateway object type. Valid value: ANALOG_INPUT , ANALOG_OUTPUT , ANALOG_VALUE , BINARY_INPUT , BINARY_OUTPUT , BINARY_VALUE , MULTI- STATE_INPUT , MULTI-STATE_OUTPUT , MULTI-STATE_VALUE. Read only.
Object ID	BACnet Gateway object ID. Read only.
Present Value	The current value of the BACnet gateway object. Read only.
Status Flags	Not Applicable in this release.

Configuring a BACnet Gateway Object

You can use the BACnet Gateway Object Editor to configure settings for BACnet Gateway Object.

To Configure a BACnet Gateway Object

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Expand the **BACnet Gateway Object** folder.
3. To edit a BACnet Gateway object, select one of the following options:
 - Double-click a BACnet Gateway Object icon or name
 - Right-click a BACnet Gateway Object and select **Edit**.
4. Type a unique name in the **Name** field.
5. Type a textual description for the BACnet Gateway Object in the **Description** field.
6. Check the **Enabled** option to make this object work.
7. If you are done editing the BACnet Gateway Object, click to save the BACnet Gateway Object configuration.

Viewing Monitor Object for this BACnet Gateway Object

Perform the following steps to view Monitor Object for this BACnet Gateway Object.

To view Monitor Object for this BACnet Gateway Object

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Expand the **BACnet Gateway Object** folder.
3. To edit a BACnet Gateway Object, select one of the following options:
 - Double-click a BACnet Gateway Object icon or name
 - Right-click a BACnet Gateway Object and select **Edit** from context menu.
4. Click the **Monitor Object** tab to view which monitor object is monitored by this BACnet gateway object.

Figure 38: Figure 11-2: BACnet Gateway Object - Monitor Object Tab

The screenshot shows a window titled "BACnet Gateway Analog Input - AI_Area in_UserCountStatus". At the top left is a "Save and Close" button. Below it are fields for "Name: AI_Area in_UserCountStatus" and "Description:". There are two checkboxes: "Enabled" (checked) and "Maintenance Mode" (unchecked). Below these are three tabs: "General", "Monitor Object" (selected), and "State images". The "Monitor Object" tab contains four rows of configuration:

Monitor Object Type:	SoftwareHouse.NextGen.Common.Security
Monitor Object ID:	5002
Monitor Object Property:	UserCountStatus
Gateway Object Property:	PresentValue

BACnet Broadcast Management Device

This chapter describes BACnet Broadcast Management Device. In this chapter:

BACnet/IP Broadcast Management Device Overview	105
Supported and Tested BBMD Network - First	106
Supported and Tested BBMD Network - Second	107
Accessing the BACnet Broadcast Management Device (BBMD)	108
Adding a BBMD	109
Editing a BBMD	110
Deleting a BBMD	111
BBMD General Tab	112
BACnet Object General Tab Definitions	112
Configuring a BBMD Network	113


BACnet/IP Broadcast Management Device Overview

The BACnet utilized broadcast messages for certain functions, when you try to discover BACnet Devices, your BACnet Devices are interconnected via IP routers then the IP routers normally blocks the broadcast messages. This may cause issues for your BACnet communications. BACnet solves the IP router issue by utilizing a BACnet/IP Broadcast Management Device (BBMD). The BBMD will send any received broadcast messages as directed messages through the IP router to its partner BBMD Devices.

Supported and Tested BBMD Network - First

The following image displays the Topology of first Supported and Test network of BBMD.


Figure 39: Supported and Test Network Topology - First

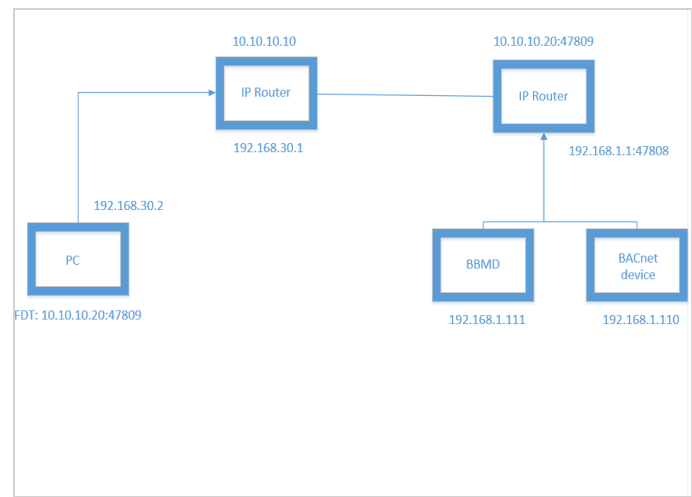

Supported and Tested BBMD Network - Second

The following image displays the Topology of second Supported and Test network of BBMD.


Figure 40: Supported and Test Network Topology - Second

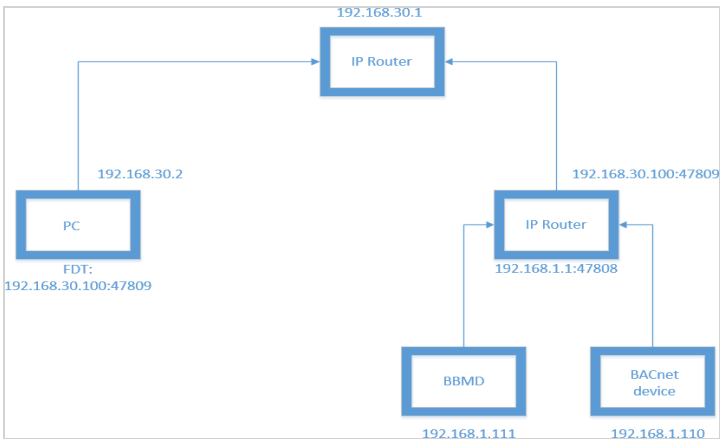

Accessing the BACnet Broadcast Management Device (BBMD)

Perform the following steps to access the BACnet Broadcast Management Device (BBMD).

Figure 41: BBMD

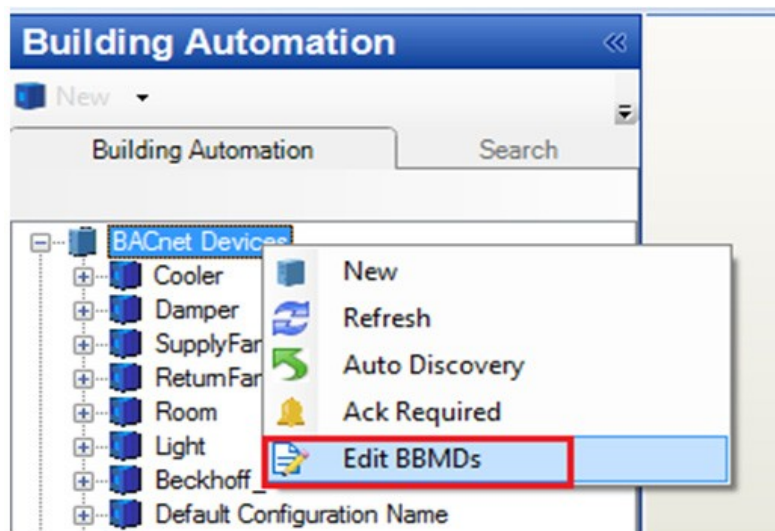

To Access the BBMD

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Expand the **BACnet Device** folder.
3. Right click the BACnet Device folder, select **Edit BBMDs**.


Adding a BBMD

Perform the following steps to add a BBMD.

To Add a BBMD

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Right-click the BACnet Device folder, then select **Edit BBMDs** from context menu, the BBMD pane lists all BBMDs.
3. On the BACnet BBMD pane, click **Add** button, the new BBMD pane opens.
4. Type a unique name in the **Name** field.
5. Type a textual description for the BACnet Device in the **Description** field.
6. To configure communication information, see [BBMD General Tab](#).
7. Select the **Enabled** check box.
8. Click **Add**.

Figure 42: BBMD Editor

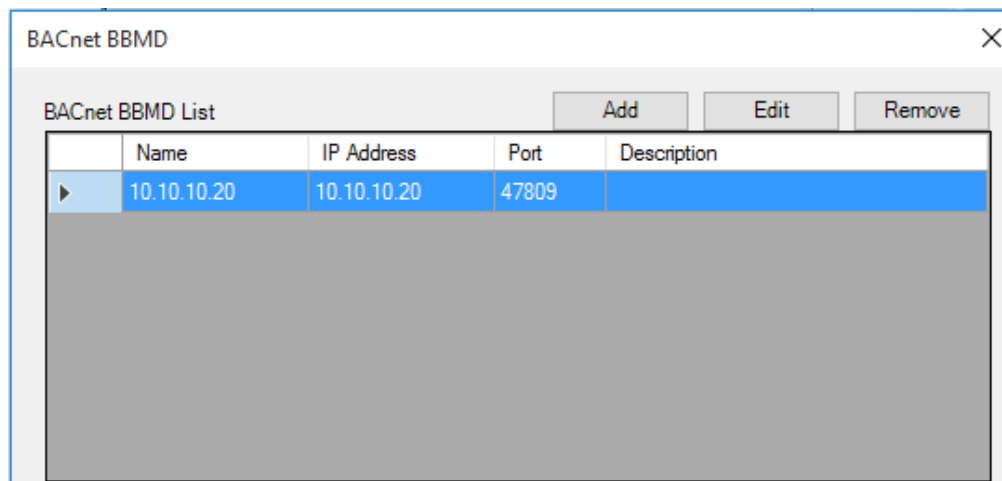

Editing a BBMD

Perform the following steps to edit a BBMD.

To Edit a BBMD

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Right-click the **BACnet Device** folder, and then select **Edit BBMDs** from context menu.
3. On the **BBMD** pane, click **Edit**.
4. Type a unique name in the **Name** field.
5. Type a textual description for the BACnet device in the **Description** field.
6. To configure communication information, see [BBMD General Tab](#).
7. Select the **Enabled** check box.
8. Save the BBMD configuration.

Deleting a BBMD

You can delete a BBMD from the Building Automation tree if you no longer need it.

To Delete a BBMD from the Building Automation Tree

1. In the Navigation pane of the C•CURE 9000 Administration Workstation, click **Building Automation**. The Building Automation pane opens.
2. Right-click the **BACnet Device** folder, and then select **Edit BBMDs**.
3. On the **BBMD** pane, select a BBMD and then click **Remove**.

BBMD General Tab

From the BBMD General tab, you can set the name and description for the BBMD, and configure the communication settings for the device.

Figure 43: BBMD - General Tab

The screenshot shows a configuration window titled "BACnet BBMD - 10.10.10.20". At the top left is a "Save and Close" button. Below it are the "Name" and "Description" fields. The "Name" field contains "10.10.10.20". Below the "Description" field is a "Maintenance Mode" checkbox, which is currently unchecked. A tab labeled "General" is selected, showing a sub-section titled "BACnet BBMD". Inside this section, the "IP Address" field contains "10.10.10.20" and the "UDP Port" field contains "47809".

BACnet Object General Tab Definitions

The following table describes the BBMD General tab fields.

Table 19: BBMD General Tab Definitions

Field	Description
Name	Enter a unique name up to 50 characters long for BACnet Device. If you enter the name of an existing object, the system will not save the object, and will display an error message indicating there is a conflict. Choose a different name.
Description	Enter a general comment about the BACnet device that will help you identify the device. This text is for information only.
IP Address	IP address of BACnet device.
UDP Port	UDP port of BACnet device used to communicate with the physical device. Editable when BACnet device is disabled.

Configuring a BBMD Network

The following configuration is an example of a Contemporary Controls BAS Router and NetGear IP Router. The BBMD device and IP Router from other vendor may have different configuration, which should follow the vendor's user guide.

The following images show the BBMD configuration steps and the BBMD Broadcast Distribution.

Figure 44: BBMD Configuration Steps

Secondary BACnet/IP UDP Port

BAC1

Secondary BACnet/IP Network

1313

Public IP Address

10.10.10.20

Figure 45: Broadcast Distribution

Broadcast Distribution Table	
Save Changes	
BBMD IP Address	Broadcast Distribution Mask
10.10.10.10	255.255.255.255
0.0.0.0	255.255.255.255
0.0.0.0	255.255.255.255
0.0.0.0	255.255.255.255
0.0.0.0	255.255.255.255

Perform the following steps to configure a BBMD Network.

BBMD Network Configuration

- Set BBMD local IP address to 192.168.30.111.
- Configure NAT IP Router 1
 - Set WAN IP address: 10.10.10.10.
 - Set LAN IP address: 192.168.30.1.
- Configure NAT IP Router 2
 - Set WAN IP address: 10.10.10.20.
 - Set LAN IP address: 192.168.30.111.
 - Set Port forward 47809 message to 192.168.30.111.BACnet Device
- Set BACnet device IP address to: 192.168.1.110.

BACnet Journal Messages

The BMS integration has customized Journal messages that are described here. In this chapter

BMS Integration Journal Message Definitions 115

BMS Integration Journal Message Definitions

The following tables list the Journal Messages that can be reported by the BMS Integration products to the C•CURE 9000 database. In the table, the symbol "#" represents an object such a BACnet device name, BACnet object name, or computer name. The actual value for the object property replaces the "#" in the Journal.

Table 20: BACnet State Change Journal Messages

Message Type	Object	State Change	Message
BACnet Device State Change	BACnet Device	Online	BACnet Device '#' communication restore.
		Offline	BACnet Device '#' communication failure.
		Operational	BACnet Device '#' is operational.
		Non-Operational	BACnet Device '#' is non-operational.

Table 21: BACnet COV Notification Journal Messages

Message Type	Object	State Change	Message
BACnet Object Value Change	Analog Input/ Output/ Value Object	Present Value Change	Present Value of Analog Input/Output/Value '#' on BACnet Device '#' changed to #.
	Binary Input/ Output/ Value Object	Active	Present Value of Binary Input '#' on BACnet Device '#' changed to active.
		Inactive	Present Value of Binary Input '#' on BACnet Device '#' changed to inactive.
	MultiState Input/ Output/ Value Object	Present Value Change	Present Value of MultiState Input/Output/Value '#' on BACnet Device '#' changed to #.

Message Type	Object	State Change	Message
BACnet Object State Change	Analog Input/ Output/ Value Object	Alarm	Alarm Status of Analog Input/Output/Value '#' on BACnet Device '#' changed to Alarm.
		Normal	Alarm Status of Analog Input/Output/Value '#' on BACnet Device '#' changed to Normal.
		Fault	Fault Status of Analog Input/Output/Value '#' on BACnet Device '#' changed to Fault.
		Normal	Fault Status of Analog Input/Output/Value '#' on BACnet Device '#' changed to Normal.
		Out Of Service	Out Of Service of Analog Input/Output/Value '#' on BACnet Device '#' changed to Out of Service.
		Normal	Out Of Service Status of Analog Input/Output/Value '#' on BACnet Device '#' changed to Normal.
	Binary Input/ Output/ Value Object	Alarm	Alarm Status of Binary Input/Output/Value '#' on BACnet Device '#' changed to Alarm.
		Normal	Alarm Status of Binary Input/Output/Value '#' on BACnet Device '#' changed to Normal.
		Fault	Fault Status of Binary Input/Output/Value '#' on BACnet Device '#' changed to Fault.
		Normal	Fault Status of Binary Input/Output/Value '#' on BACnet Device '#' changed to Normal.
		Out Of Service	Out Of Service of Binary Input/Output/Value '#' on BACnet Device '#' changed to Out of Service.
		Normal	Out Of Service Status of Binary Input/Output/Value '#' on BACnet Device '#' changed to Normal.
	MultiState Input/ Output/ Value Object	Alarm	Alarm Status of MultiState Input/Output/Value '#' on BACnet Device '#' changed to Alarm.
		Normal	Alarm Status of MultiState Input/Output/Value '#' on BACnet Device '#' changed to Normal.
		Fault	Fault Status of MultiState Input/Output/Value '#' on BACnet Device '#' changed to Fault.
		Normal	Fault Status of MultiState Input/Output/Value '#' on BACnet Device '#' changed to Normal.
		Out Of Service	Out Of Service of MultiState Input/Output/Value '#' on BACnet Device '#' changed to Out of Service.
		Normal	Out Of Service Status of MultiState Input/Output/Value '#' on BACnet Device '#' changed to Normal.

Table 22: BACnet Event Notification Journal Messages

Message Type	Object	State Change	Message
BACnet Event Notification	Event Notification	High limit	AnalogInput'#' on BACnet Device '#' Changed from EVENT_State_HIGH_Normal to EVENT_STATE_HIGH_LIMIT by EVENT_OUT_OF_RAGNE.
		High normal	AnalogInput'#' on BACnet Device '#' Changed from EVENT_State_HIGH_LIMIT to EVENT_STATE_HIGH_NORMAL by EVENT_OUT_OF_RAGNE.
		Low limit	AnalogInput'#' on BACnet Device '#' Changed from EVENT_State_LOW_Normal to EVENT_STATE_LOW_LIMIT by EVENT_OUT_OF_RAGNE.
		Low normal	AnalogInput'#' on BACnet Device '#' Changed from EVENT_State_LOW_LIMIT to EVENT_STATE_LOW_NORMAL by EVENT_OUT_OF_RAGNE.

Table 23: BACnet System Activity Journal Messages

Message Type	Object	State Change	Message
BACnet System Activity	Driver	Start	System Activity: SoftwareHouse CrossFire BACnet Driver Service started on computer #.
		Stop	System Activity: SoftwareHouse CrossFire BACnet Driver Service stopped on computer #.