

# SOFTWARE HOUSE

*From Tyco Security Products*

**C•CURE 9000**  
Version 2.80

**KONE Elevator System Integration Guide**  
**REVISION B0**



SOFTWARE HOUSE

C•CURE and Software House are registered trademarks of Johnson Controls.

The trademarks, logos, and service marks displayed on this document are registered in the United States [or other countries]. Any misuse of the trademarks is strictly prohibited and Johnson Controls will aggressively enforce its intellectual property rights to the fullest extent of the law, including pursuit of criminal prosecution wherever necessary. All trademarks not owned by Johnson Controls are the property of their respective owners, and are used with permission or allowed under applicable laws.

Product offerings and specifications are subject to change without notice. Actual products may vary from photos. Not all products include all features. Availability varies by region; contact your regional sales manager.

Software version: 2.80

Document Number: 8200-1191-1109

Revision Number: B0

Release Date: April 2021

This manual is proprietary information of Software House. Unauthorized reproduction of any portion of this manual is prohibited. The material in this manual is for information purposes only. It is subject to change without notice. Software House assumes no responsibility for incorrect information this manual may contain.

© 2021 Johnson Controls.

All rights reserved.

# Table of Contents

|  |           |
|--|-----------|
| <b>Preface</b>   | <b>7</b>  |
| How to Use this Manual .....   | 8         |
| Finding More Information .....   | 10        |
| Conventions .....  | 11        |
| Software House Customer Support Center .....                                 | 12        |
| <b>Chapter 1 - Introduction</b>  | <b>13</b> |
| KONE Elevator Integration Overview .....                                     | 14        |
| Traditional Destination Control System .....                                 | 14        |
| Elevator Locking Interface Example .....                                     | 14        |
| Global Landing Matrix and Default Landing Matrix Configuration Example ..... | 15        |
| KONE Direct Elevator Access Example .....                                    | 16        |
| Features .....   | 17        |
| Terminology .....  | 19        |
| <b>Chapter 2 - Installation</b>  | <b>20</b> |
| Installation Overview .....  | 21        |
| Before You Begin .....   | 23        |
| Getting the KONE Integration Software .....                                  | 24        |
| Installation .....   | 25        |
| Running the Setup Program .....  | 25        |
| Upgrading the KONE Elevator System Integration .....                         | 29        |
| Configuration File .....   | 30        |
| Licensing .....  | 31        |
| Starting the Server Services .....   | 32        |
| Uninstalling the KONE Elevator Integration .....                             | 33        |
| <b>Chapter 3 - KONE Elevator System Configuration</b>                        | <b>37</b> |
| Configuration Sequence Overview .....  | 38        |
| KONE Elevator System Configuration Sequence .....                            | 38        |
| Landing Matrix Configuration Sequence .....                                  | 38        |
| COP Configuration Sequence .....   | 39        |

|  |           |
|--|-----------|
| Landing Configuration Sequence .....                               | 40        |
| DOP Configuration Sequence .....                                   | 40        |
| KONE Direct Elevator Access Configuration Sequence .....           | 40        |
| Creating a KONE Elevator System Folder .....                       | 42        |
| Accessing the KONE Elevator System Editor Dialog Box .....         | 43        |
| KONE Elevator System Editor Dialog Box .....                       | 44        |
| KONE Elevator System Editor Dialog Box Definitions .....           | 45        |
| KONE Elevator System Editor Tasks .....                            | 47        |
| KONE Elevator System Editor Tabs .....                             | 50        |
| IP Configuration Tab .....   | 51        |
| Landing Tab .....  | 52        |
| Triggers Tab .....   | 53        |
| Triggers Tab Definitions .....                                     | 54        |
| Triggers Tab Tasks .....   | 55        |
| Status Tab .....   | 57        |
| Status Tab Descriptions .....                                      | 58        |
| Override Tab .....   | 60        |
| Override Tab Definitions .....                                     | 61        |
| Selecting an Exempt Personnel Group .....                          | 62        |
| State Images Tab .....   | 63        |
| State Images Tab Tasks .....                                       | 63        |
| Maintenance Mode .....   | 64        |
| <b>Chapter 4 - KONE Global Landing Matrix Configuration</b> .....  | <b>65</b> |
| Accessing the KONE Global Landing Matrix Dialog Box .....          | 66        |
| KONE Global Landing Matrix Dialog Box .....                        | 67        |
| KONE Global Landing Matrix Dialog Box Definitions .....            | 67        |
| KONE Global Landing Matrix Dialog Box Tasks .....                  | 68        |
| <b>Chapter 5 - KONE Default Landing Matrix Configuration</b> ..... | <b>70</b> |
| Accessing the KONE Default Landing Matrix Dialog Box .....         | 71        |
| KONE Default Landing Matrix Dialog Box .....                       | 72        |
| KONE Default Landing Matrix Dialog Box Definitions .....           | 72        |
| KONE Default Landing Matrix Tasks .....                            | 73        |
| <b>Chapter 6 - KONE Landing Configuration</b> .....                | <b>76</b> |
| Accessing the KONE Landing Dialog Box .....                        | 77        |
| KONE Landing Dialog Box .....                                      | 78        |
| KONE Landing Dialog Box Definitions .....                          | 78        |
| KONE Landing Dialog Box Tasks .....                                | 79        |
| KONE Landing Dialog Box Tabs .....                                 | 81        |

|  |            |
|--|------------|
| Landing Dialog Box - Override Tab .....                            | 82         |
| Landing Dialog Box - State Images Tab .....                        | 83         |
| State Images Tab Tasks .....                                       | 83         |
| KONE Landing Manual Actions .....                                  | 85         |
| Accessing KONE Landing Manual Actions .....                        | 85         |
| Using Manual Actions to Secure a Landing .....                     | 86         |
| Using Manual Actions to Un-Secure a Landing .....                  | 87         |
| <b>Chapter 7 - KONE COP Clearance Landing Matrix Configuration</b> | <b>89</b>  |
| Accessing the KONE COP Clearance Landing Matrix Dialog .....       | 90         |
| KONE COP Clearance Landing Matrix Dialog Box .....                 | 91         |
| KONE COP Clearance Landing Matrix Dialog Box Definitions .....     | 92         |
| <b>Chapter 8 - KONE COP Configuration</b>                          | <b>94</b>  |
| Accessing the COP Dialog Box .....                                 | 95         |
| KONE COP Dialog Box .....  | 96         |
| COP Dialog Box Definitions .....                                   | 97         |
| KONE COP Dialog Box Tasks .....                                    | 98         |
| KONE COP Dialog Box Tabs .....                                     | 99         |
| COP - Schedule Matrix Tab .....                                    | 101        |
| Schedule Matrix Tab Definitions .....                              | 101        |
| Schedule Matrix Tab Tasks .....                                    | 102        |
| COP Front Reader Tab .....   | 103        |
| Front Reader Tab Definitions .....                                 | 103        |
| Front Reader Tab Tasks .....                                       | 104        |
| COP Rear Reader Tab .....  | 105        |
| Rear Reader Tab Definitions .....                                  | 105        |
| Rear Reader Tab Tasks .....  | 106        |
| <b>Chapter 9 - KONE Direct Elevator Access Configuration</b>       | <b>107</b> |
| KONE Direct Elevator Access Dialog Box .....                       | 108        |
| KONE Direct Elevator Access Dialog Box Definitions .....           | 109        |
| KONE Direct Elevator Access Dialog Box Tasks .....                 | 110        |
| Accessing the KONE Direct Elevator Access Dialog Box .....         | 114        |
| <b>Chapter 10 - KONE DOP Configuration</b>                         | <b>115</b> |
| Accessing the KONE DOP Dialog Box .....                            | 116        |
| KONE DOP Dialog Box .....  | 117        |
| KONE DOP Dialog Box Definitions .....                              | 118        |
| KONE DOP Dialog Box Tasks .....                                    | 119        |
| KONE DOP Dialog Box Tabs .....                                     | 121        |

|   |            |
|---|------------|
| DOP - Landing Matrix Tab .....  | 122        |
| KONE DOP Dialog Box - Landing Matrix Tab Definitions .....                    | 122        |
| KONE DOP Dialog Box - Landing Matrix Tab Tasks .....                          | 123        |
| DOP - Schedule Matrix Tab .....   | 125        |
| Schedule Matrix Tab Definitions .....   | 125        |
| Schedule Matrix Tab Tasks .....   | 126        |
| <b>Chapter 11 - KONE DOP Clearance Landing Matrix Configuration</b>           | <b>128</b> |
| Accessing the KONE DOP Clearance Landing Matrix Dialog Box .....              | 129        |
| KONE DOP Clearance Landing Matrix Dialog Box .....                            | 130        |
| KONE DOP Clearance Landing Matrix Dialog Box Definitions .....                | 131        |
| KONE DOP Clearance Landing Matrix Dialog Box Tasks .....                      | 133        |
| <b>Chapter 12 - KONE Events and Actions</b>                                   | <b>138</b> |
| KONE Events .....   | 139        |
| KONE Actions and Target Objects .....   | 140        |
| Configuring C•CURE Events for KONE Actions .....                              | 141        |
| <b>Chapter 13 - Monitoring KONE Elevator Activity</b>                         | <b>143</b> |
| C•CURE 9000 Monitoring Station Activity Viewer .....                          | 144        |
| Cancelling Manual Actions .....   | 145        |
| <b>Chapter 14 - Journal and Audit Messages</b>                                | <b>148</b> |
| Journal and Audit Log Messages .....  | 149        |
| Locating KONE Objects in the Journal .....                                    | 150        |
| Locating KONE Audit Log Entries .....   | 151        |
| <b>Chapter 15 - Troubleshooting</b>   | <b>152</b> |
| Troubleshooting .....   | 153        |
| <b>Appendix A - Third-Party Copyright, Trademarks and License Information</b> | <b>154</b> |
| Microsoft Limited Public License Information .....                            | 155        |
| MICROSOFT LIMITED PUBLIC LICENSE version 1.1 .....                            | 155        |
| <b>Appendix B - Cache Loading Time and Card Swipe Dispatch Time</b>           | <b>157</b> |
| Cache Loading Time and Card Swipe Dispatch Time .....                         | 158        |
| Test Condition and Results .....  | 158        |

# Preface

The C•CURE KONE Elevator System Integration Guide is for new and experienced security system users who want to learn to use this product for the C•CURE 9000 Security Management System.

In this preface

|                                |    |
|--------------------------------|----|
| How to Use this Manual .....   | 8  |
| Finding More Information ..... | 10 |
| Conventions .....              | 11 |

## How to Use this Manual

This manual contains chapters that provide the following information about the C•CURE something-something.

### Chapter 1: Introduction

This chapter introduces the KONE Elevator Integration software that provides integration between KONE Elevator System and C•CURE 9000.

### Chapter 2: Installation

This chapter provides the instructions to install the KONE Integration software on a server or client system.

### Chapter 3: KONE Elevator System Configuration

This chapter provides the KONE Elevator System Editor configuration procedures.

### Chapter 4: KONE Global Landing Matrix Configuration

This chapter provides the global landing matrix configuration procedures.

### Chapter 5: KONE Default Landing Matrix Configuration

This chapter describes how to configure a default landing using the KONE Default Landing Matrix dialog box.

### Chapter 6: KONE Landing Configuration

This chapter describes how to configure a landing using the KONE Landing dialog box.

### Chapter 7: KONE COP Clearance Landing Matrix Configuration

This chapter describes to configure clearances using the KONE COP Clearance Landing Matrix dialog box.

### Chapter 8: KONE COP Configuration

This chapter describes to configure the COP (Car Operational Panel) using the KONE COP dialog box.

### Chapter 9: KONE Direct Elevator Access Configuration

This chapter describes to configure direct elevator access for VIPs (Very Important Persons) using the KONE Direct Elevator Access dialog box.



## **Chapter 10: KONE DOP Configuration**

This chapter describes to configure the DOP (Destination Operation Panel) using the KONE DOP dialog box.

## **Chapter 11: KONE DOP Clearance Landing Matrix Configuration**

This chapter describes to configure clearances using the KONE DOP Clearance Landing Matrix dialog box.

## **Chapter 12: KONE Events and Actions**

This chapter describes the C•CURE 9000 events which triggers KONE Actions and the steps to configure them.

## **Chapter 13: Monitoring KONE Elevator Activity**

This chapter describes the C•CURE 9000 Monitoring Station Activity Viewer and also provides the procedure to cancel KONE manual actions.

## **Chapter 14: Journal and Audit Messages**

This chapter discusses the Journal and the Audit messages and how to locate them.

## **Chapter 15: Troubleshooting**

This chapter helps to resolve problems you may encounter with C•CURE 9000 KONE Elevator Integration.

## **Appendix A: Third-Party Copyright, Trademarks and License Information**

This appendix contains the third-part copyright, trademarks and license information.

## **Appendix B: Cache Loading Time and Card Swipe Dispatch Time**

This appendix contains the information about the time taken to load cache and the Card Swipe Dispatch Time.

## Finding More Information

You can access C•CURE 9000 manuals and online Help for more information about C•CURE 9000.

### Manuals

C•CURE 9000 software manuals and Software House hardware manuals are available in Adobe PDF format on the C•CURE 9000 DVD.

You can access the manuals if you copy the appropriate PDF files from the C•CURE 9000 Installation DVD English\Manuals folder and install the Adobe Acrobat reader. Adobe Acrobat Reader can be installed from the C•CURE 9000 Installation DVD English\Reader folder.

The available C•CURE 9000 and Software House manuals are listed in the *C•CURE 9000 Installation and Upgrade Guide*, and appear as hyperlinks in the online.pdf file on the C•CURE 9000 DVD English\Manuals folder.

These manuals are also available from the Software House Member Center website (<http://www.swhouse.com/TechnicalLibrary/TechLibSW.aspx>).

### Online Help

You can access C•CURE 9000 Help by pressing F1 or clicking Help from the menu bar in the Administration/Monitoring Station applications.

## Conventions

This manual uses the following text formats and symbols.

| Convention                      | Meaning   |
|---------------------------------|---|
| <b>Bold</b>                     | This font indicates screen elements, and also indicates when you should take a direct action in a procedure.<br>Bold font describes one of the following items: <ul style="list-style-type: none"> <li>• A command or character to type, or</li> <li>• A button or option on the screen to press, or</li> <li>• A key on the keyboard to press</li> <li>• A screen element or name</li> </ul> |
| <a href="#">blue color text</a> | Indicates a hyperlink to a URL, or a cross-reference to a figure, table, or section in this guide.  |
| <i>Regular italic font</i>      | Indicates a new term.   |
| <text>                          | Indicates a variable.   |

The following items are used to indicate important information.

### NOTE

Indicates a note. Notes call attention to any item of information that may be of special importance.

### TIP

Indicates an alternate method of performing a task.



Indicates a caution. A caution contains information essential to avoid damage to the system. A caution can pertain to hardware or software.



Indicates a warning. A warning contains information that advises users that failure to avoid a specific action could result in physical harm to the user or to the hardware.



Indicates a danger. A danger contains information that users must know to avoid death or serious injury.

# Software House Customer Support Center

## Telephone Technical Support

During the period of the Agreement, the following guideline applies:

- Software House accepts service calls **only** from employees of the Systems Integrator of Record for the installation associated with the support inquiry.

## Before Calling

Ensure that you:

- Are the Dealer of record for this account.
- Are certified by Software House for this product.
- Have a valid license and current Software Support Agreement (SSA) for the system.
- Have your system serial number available.
- Have your certification number available.

|       |  |   |
|-------|--|---|
| Hours | Normal Support Hours   | Monday through Friday, 8:00 a.m. to 8:00 p.m., EST. Except holidays.  |
|       | Emergency Support Hours  | 24 hours/day, seven days a week, 365 days/year.<br><br>Requires Enhanced SSA "7 x 24" Standby Telephone Support (emergency) provided to Certified Technicians.<br><br>For all other customers, billable on time and materials basis.<br><br>Minimum charges apply – See MSRP. |
| Phone | U.S.<br><br>Puerto Rico<br><br>U.S. Virgin Islands   | +1-800-392-2873   |
|       | For other regions, see <a href="http://www.swhouse.com/support/contact_technical_support.aspx">http://www.swhouse.com/support/contact_technical_support.aspx</a> . |   |

## Introduction

This chapter introduces the KONE Elevator Integration software that provides integration between KONE Elevator System and C•CURE 9000.

In this chapter:

|  |    |
|--|----|
| KONE Elevator Integration Overview ..... | 14 |
| Features .....                           | 17 |
| Terminology .....                        | 19 |

## KONE Elevator Integration Overview


The KONE Elevator System Integration with the C•CURE 9000 provides security to particular landings (floors) in a multi-level building by ensuring that only those authorized may go to a particular landing, or exit on that landing. Access to particular landings is determined through a swipe of a card to a card reader called a Destination Operation Panel (DOP) outside of the elevator or a Car Operation Panel (COP) situated inside the Elevator Car. The card reader accesses the personnel privilege assigned to a specific KONE Elevator access configuration.

When the KONE Elevator is configured for Direct Elevator Access, the C•CURE 9000 makes direct calls to the elevator system.

### Traditional Destination Control System

Figure 1 on Page 14 shows the traditional destination control system used by the KONE Elevator System.


Figure 1: Traditional Destination Control System

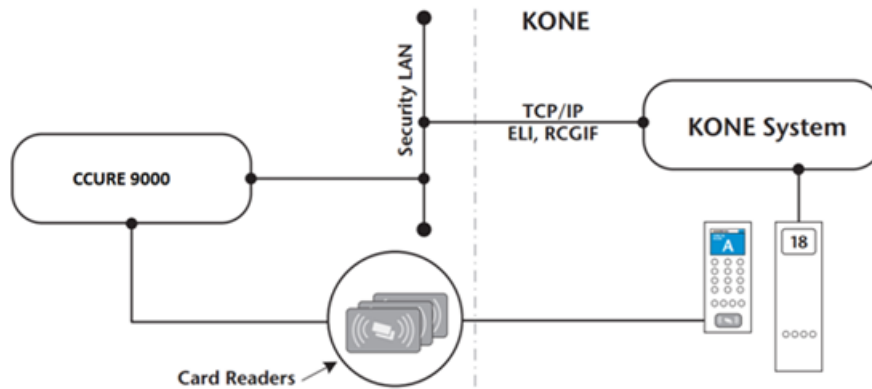

### Elevator Locking Interface Example

Figure 2 on Page 15 shows an example of an elevator interlocking interface configuration.

Figure 2: Elevator Locking Interface Example

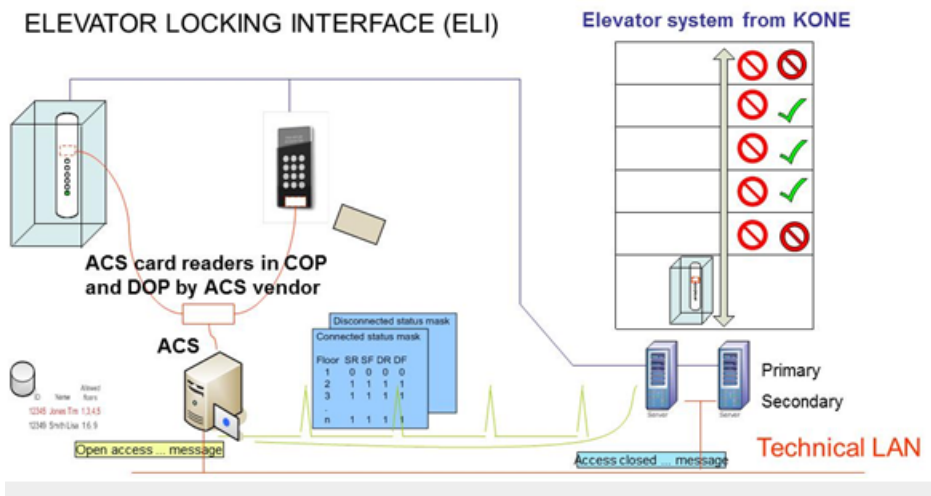

Global Landing Matrix and Default Landing Matrix Configuration Example

Table 1: Global Landing Matrix Configuration and Default Landing Matrix Example

| Global Landing Matrix |                   | Default Landing Matrix |                   | Clearance Landing Matrix | Floors Selectable in DOP/COP |                   |
|-----------------------|-------------------|------------------------|-------------------|--------------------------|------------------------------|-------------------|
| Connected Mask        | Disconnected Mask | Connected Mask         | Disconnected Mask |                          | Connected Mask               | Disconnected Mask |
| 1                     | 2                 | 4                      | 3                 | 5                        | 1, 4, 5                      | 2, 3              |
| 2                     | 6                 | 3                      | 5                 | 10                       | 2, 3, 10                     | 6, 5              |


In the above example (Table 1 on Page 15), if a card is swiped, then the open floors for that clearance (configured in the Clearance Landing Matrix) will be available to that individual on the DOP/COP.

If the connection is lost between the elevator system and the C•CURE server, the Disconnected Mask is used instead of the Connected Mask, but still functions the same way as the Global and Default Landing Matrix shown in Table 1 on Page 15.

Figure 3 on Page 16 shows an example of a KONE Direct Elevator Access configuration.

KONE Direct Elevator Access Example

Figure 3: KONE Direct Elevator Access Example

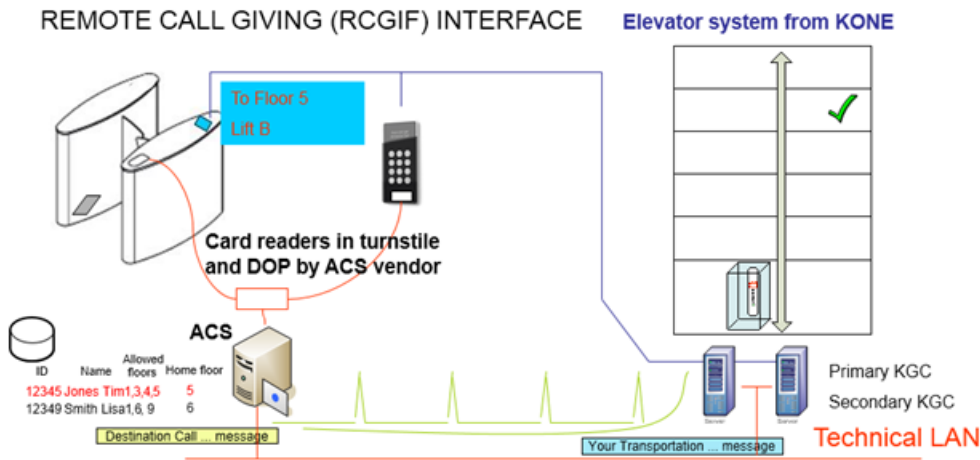



## Features

The following is the list of major features supported by C•CURE 9000 KONE Elevator Integration.

- Secure access to particular floors of multi-level buildings by ensuring that only authorized personnel may go to a particular floor or exit on that floor.
- Schedule-based floor access for all personnel.
- C•CURE 9000 event configuration based on elevator communication status.
- Journaling and reporting of floor selections by personnel.
- Remote monitoring using the C•CURE 9000 Monitoring Station.
- Support of up to 5 KONE Elevator systems/groups.
- Each elevator group controller is associated with the following IP addresses: (Integration supports a minimum of 1 controller and maximum of 5 controllers per group)
  - Server A (Mandatory)
  - Server B (Optional)
  - Server C (Optional)
  - Server D (Optional)
  - Server E (Optional)
- Communication Status supports five servers such as Server A, Server B, Server C, Server D and Server E.
- Trigger configurations used to activate C•CURE 9000 events are based on **Server A, Server B, Server C, Server D** and **Server E** communication status.
- Each elevator group supports a maximum of 8 elevator cabs per group – for a total of 240 elevator cabs on a C•CURE 9000 server.
- Each elevator group supports 255 floors, and the front and rear doors of each elevator cab.
- Each landing supports up to 6 DOP devices.
- Support for Elevator Direct Access.
- Home Floor configuration allows selection of only one floor (front or rear).
- Support for configuring Global Mask to COP using check box **Send Global Mask to COP** in KONE Elevator System.
- Support for configuring Global Mask to DOP using check box **Send Global Mask to DOP** in KONE Elevator System.
- For COP Global Landing Matrix, only Destination Front and Destination Rear data is sent to KONE elevator system.
- Enhancement of RCGIF call types: Default values are 20, 21 and 23.
  - Call type 20: For normal person, call type 20 is dispatched to the KONE server.
  - Call type 21: For an ADA, call type 21 is dispatched to the KONE server.
  - Call type 23: For a VIP, call type 23 (Empty car call type) is dispatched to the KONE server.

### NOTE

RCGIF call types 21 and 23 are configurable in Configuration File and RCGIF call type 20 is configurable in DOP Clearance Landing Matrix RCGIF field.

- Added check box **Start the Tyco CrossFire services** in the Completed KONE Integration Setup Wizard, which

enables the user to start the CrossFire services by default after the Setup is successful.

## NOTE

Check box **Start the Tyco CrossFire services** is selected by default, user can disable this option if not required.

- Support for Car Operating Panels(COP).
- Support for DOP without readers attached.
- Manual actions to secure or unsecure floors.
- Exemption Group can access Secured Floors.
- Supports TLS 1.2 for security.
- RCGIF normal call type selection option provided in the DOP clearance landing matrix UI.

## Terminology

on [Page 19](#) describes the terms and their definitions related to the KONE Elevator System integration.

**Table 2:** Terminology

| Term  | Definition   |
|-------|--|
| COP   | Car Operation Panel<br><br>In this integration, this is the floor control operation available inside the elevator. |
| DCS   | Distributed Control System   |
| DOP   | Destination Operator Panel   |
| ELI   | Elevator Locking Interface   |
| EDA   | Elevator Director Access   |
| ES    | Elevator System<br><br>ES is the KONE destination dispatch elevator system.  |
| RCGIF | Remote Call Giving Interface   |
| SS    | Security System<br><br>SS is the Access Control system. In this integration, SS is the C•CURE 9000.                |

Installation

This chapter provides the instructions to install the KONE Integration software on a server or client system.

In this chapter

Installation Overview .....21

Before You Begin .....23

Getting the KONE Integration Software .....24

Installation .....25

Configuration File .....30

Licensing .....31

Starting the Server Services .....32

Uninstalling the KONE Elevator Integration .....33

## Installation Overview

The C•CURE 9000 software must be installed before the KONE Elevator integration software is installed. For information on installing C•CURE 9000, see the C•CURE 9000 Installation and Upgrade Guide. Similar to the C•CURE 9000 system, the KONE Elevator Integration has client and server components. You must install the client components on every computer that runs C•CURE 9000 client applications, and you must install the server components on the server computer. The KONE Elevator Integration has the same hardware, software, and disk space requirements as C•CURE 9000; if the target computer meets the requirements for the C•CURE 9000, then it meets the KONE Elevator Integration requirements.

The installation wizard prompts you to install the KONE Elevator Integration software. You must perform the basic installation process on each computer in your C•CURE 9000 security system. Be sure to close all C•CURE 9000 and virus--checking applications on client workstations before performing the installation.

**Table 3** on **Page 21** provides an overview of the steps to install and register the KONE Elevator System on each computer in your C•CURE 9000 security system.

**Table 3:** Installation Tasks Overview

| Task  | See...   |
|---|--|
| 1. Install C•CURE 9000, if not already installed.   | C•CURE 9000 Installation and Upgrade Guide                                       |
| 2. Ensure that the Pre-installation requirements are met.   | <a href="#">Before You Begin</a> on <a href="#">Page 23</a>                      |
| 3. Get the KONE Elevator Integration software.  | <a href="#">Getting the KONE Integration Software</a> on <a href="#">Page 24</a> |
| 4. Install the KONE Elevator System Integration software.   | <a href="#">Getting the KONE Integration Software</a> on <a href="#">Page 24</a> |
| 5. Verify that a license exists for the KONE Elevator System.   |  |
| 6. If you did not select to restart the services during the installation, start the Server Services and the KONE Elevator Driver Service. | <a href="#">Starting the Server Services</a> on <a href="#">Page 32</a>          |

**Table 4** on **Page 21** provides the installation information on a MAS (Master Application Server) and SAS (Satellite Application Server) environment.

**Table 4:** Installation on MAS/SAS

| Installation on a .....                         | Installs...  |
|---|--|
| MAS (Master Application Server)                 | Nothing is installed.<br>Installation on MAS is not supported.   |
| MAS remote client and any other client systems. | <ul style="list-style-type: none"> <li>Only the KONE Elevator System client objects are installed</li> <li>No server or database objects are installed.</li> </ul> |
| SAS (Satellite Application Server)              | All KONE Elevator System components and database are installed.  |
| SAS remote client and any other client systems  | <ul style="list-style-type: none"> <li>Only the KONE Elevator System client objects are installed</li> <li>No server or database objects are installed.</li> </ul> |



## Before You Begin

You should perform the following pre-installation steps described below:

---

### Pre-installation Steps

- If you are installing KONE Integration on a corporate network, be sure to coordinate with your corporate network administrator.
- To perform the installation, you must have the appropriate Window's permissions. You must be in the local Administrators group, or have equivalent privileges. See the Microsoft Operating System documentation or your system administrator for more information.
- Ensure that you have two NIC (Network Interface Card) cards on the system where the C•CURE 9000 server is installed; one to communicate with the iSTAR panel and one to communicate with the KONE Elevator system.

## Getting the KONE Integration Software

The KONE Elevator System Integration software is located on the C•CURE 9000 2.40 DVD in the Integrations\Elevator\KONE folder, and can also be downloaded from the Software House website.

---

### To Download the KONE Elevator Integration Software from the Software House Website

1. Open a browser and navigate to [www.swhouse.com](http://www.swhouse.com).
2. Select **Products**, and then select **Software Downloads** in the list.
3. When the login page opens, log in. If you do not have account, you must create one.
4. On the Software Downloads page, select the “**Software House Connected**” link.
5. Select **Elevator** from the list.
6. When the Elevator Driver Downloads list is displayed on the right hand of the page, select the KONE driver link for the version of C•CURE 9000 that you have installed.
7. Unzip the files to the folder on your local computer, or to a shared drive on the network.



## Installation

You can install the C•CURE 9000 KONE Elevator Integration on a local computer from a shared drive over a network.

---

### To Install KONE Elevator Integration from a Local Drive (DVD or Download)

1. Log into the Server or Client machine with Administrative privileges.
2. Insert the C•CURE 9000 2.40 DVD into the system drive, or navigate to where you have downloaded the software.
3. Navigate to the **Integrations\Elevator\KONE** folder.

---

### To Install KONE Elevator Integration from a Network Drive

1. Log into the Server or Client machine with the Administrative privileges.
2. Map the shared drive (download area where you copied the KONE Elevator software integration folder).

---

### To Install KONE Elevator Integration from the Software House Portal

1. In the browser, Go to <http://www.swhouse.com/Support/Default.aspx>.
2. In the Software House home page, click **Login**.
3. In the Login page, enter the credentials and click **Login**.
4. Click **Software Downloads**.
5. Click **Software House Connected** and then click **Elevator**.
6. Download the KONE Integration software to a folder in your computer.


## Running the Setup Program

---

### To Run the Installation Program


1. Open the **KONE** folder and double-click the **KONE\_Integration.exe**. The **End User License Agreement** dialog box appears, as shown in [Figure 4](#) on [Page 26](#).

**Figure 4:** License Agreement Dialog Box

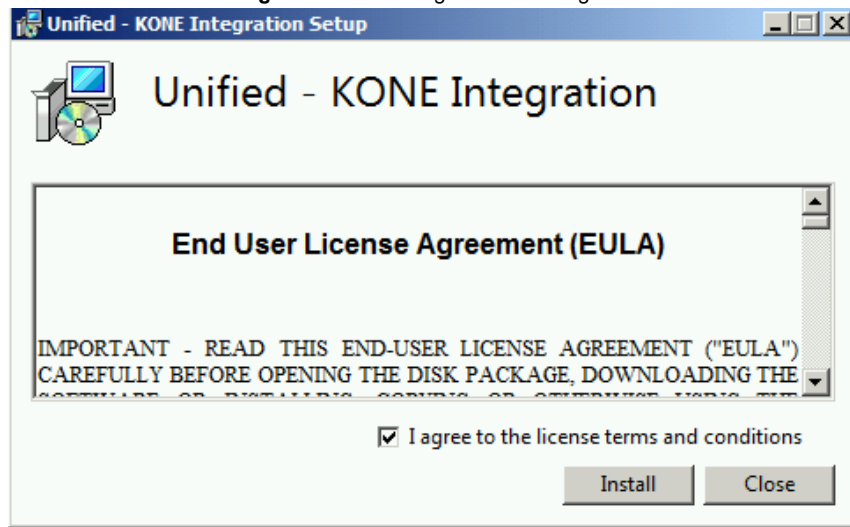


2. Select the **I agree to the license terms and conditions** check box, and then click **Install**. For server installations running CrossFire service, the **Tyco CrossFire Service Alert** dialog box appears, as shown in [Figure 5](#) on [Page 26](#).

**Figure 5:** Tyco CrossFire Service Alert Dialog Box

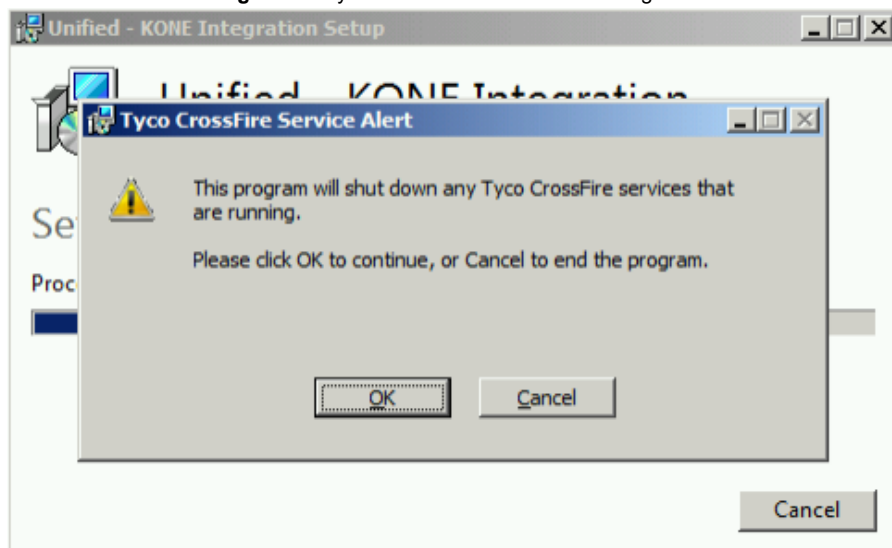


3. Click **OK** to continue with the installation. The **Welcome to the KONE Integration Setup Wizard** appears, as shown in [Figure 6](#) on [Page 27](#).

**Figure 6:** Welcome to the Integration Setup Wizard

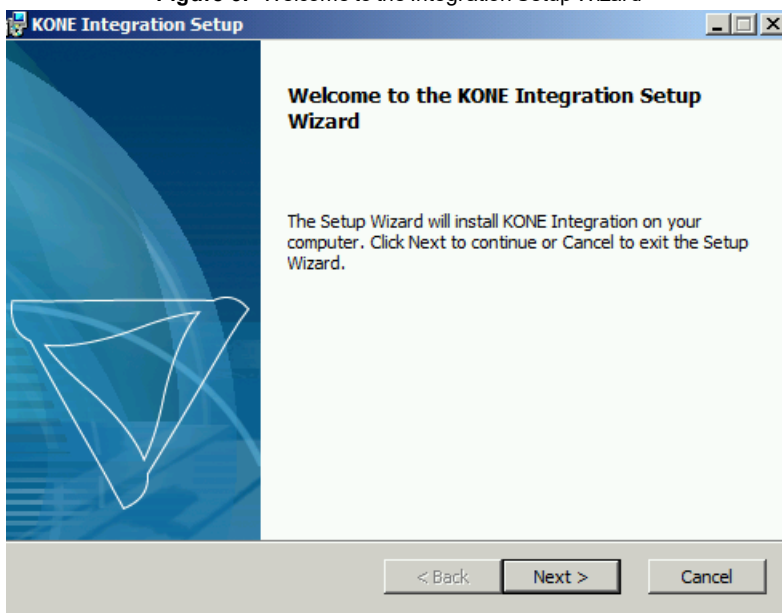


4. Click **Next** to continue with the installation. The **Installation Options** dialog box appears, as shown in [Figure 7](#) on [Page 27](#).


**Figure 7:** Installation Options

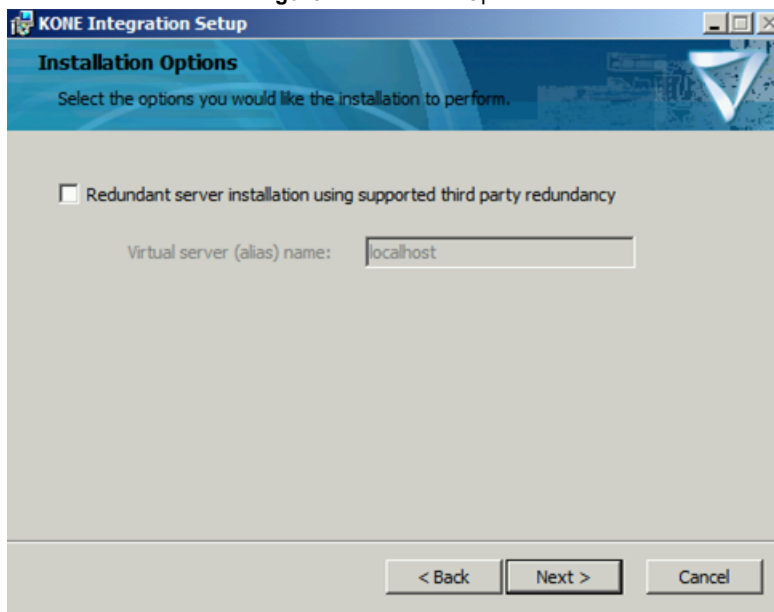

5. If you choose to enable the driver for redundancy, select the **Redundant server installation using supported third party redundancy** check box and enter the Virtual sever (alias) name.
6. Click **Next**. The **Ready to Install the Integration** dialog box appears, as shown, in [Figure 8](#) on [Page 28](#)

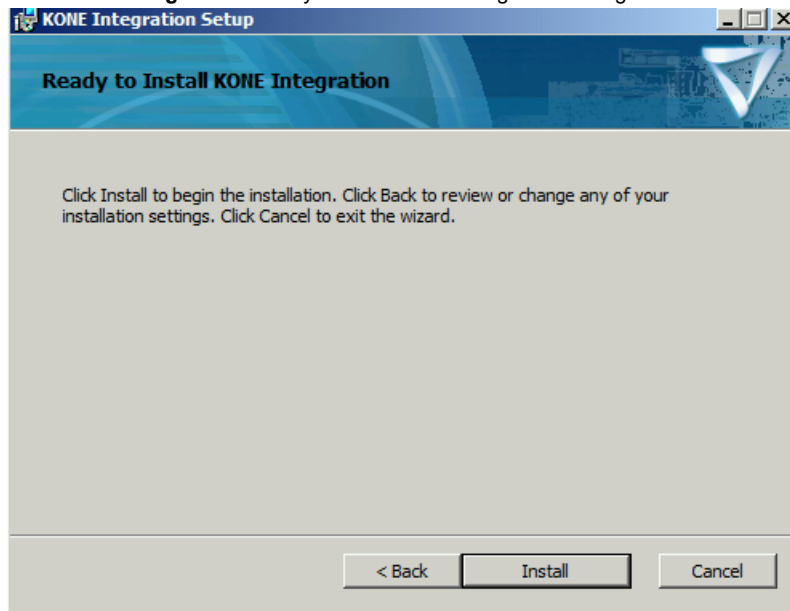**Figure 8:** Ready to Install KONE Integration Dialog box


7. Click **Install** to start the installation or click **Back** to modify the installation settings. After a few minutes, the **Completed the Kone Integration Setup Wizard**, as shown in [Figure 9](#) on [Page 28](#), appears. If you select **Cancel**, installation will roll back to clean state.

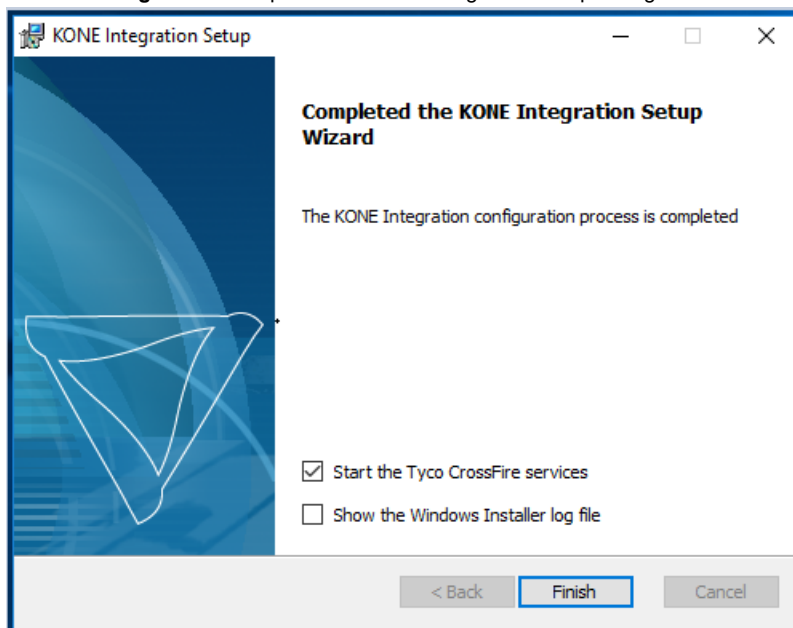**Figure 9:** Completed the KONE Integration Setup Dialog Box**NOTE**

Check box **Start the Tyco CrossFire services** is selected by default, user can disable this option if not required.

8. Click **Finish** to exit the Setup Wizard. The **Setup Successful** dialog box, as shown in [Figure 10](#) on [Page 29](#), appears.

Figure 10: Setup Successful Dialog Box

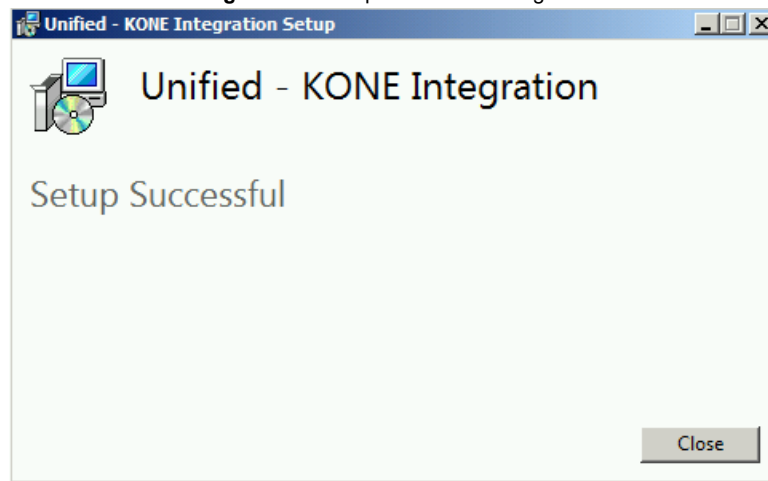

9. Click **Close** to exit the KONE Installation.

## NOTE

For the redundant environment, if you have not provided the Virtual sever (alias) name during installation or want to modify the Virtual sever (alias) name after installation, do the following:

1. Navigate to the folder **.../Tyco/CrossFire/ServerComponents**.
2. Open the file **KoneElevatorDriverService.exe** file.
3. Scroll down to the client section and change the localhost in all the endpoints to the required Virtual sever (alias) name except for the endpoint name="TraceViewerURI".

## Upgrading the KONE Elevator System Integration

- To upgrade the KONE Elevator integration from 2.61 to 2.80
  - Upgrade the C•CURE 9000 v2.61 to C•CURE 9000 v2.80 and then install the associated KONE Elevator 2.80 integration.
- To upgrade the KONE Elevator integration from 2.70 to 2.80
  - Upgrade the C•CURE 9000 v2.70 to C•CURE 9000 v2.80 and then install the associated KONE Elevator 2.80 integration.

## Configuration File

The KONE configuration file: KoneElevatorDriverService.exe is located at \Tyco\CrossFire\ServerComponents. This section describes the values that you can change in KoneElevatorDriverService.exe:

### NOTE

If you make any changes in the configuration file you must restart the driver.

Ensure that you change the values only after consulting with the product support team.

**ServerPortNo** - Use this variable to specify the ELI port number. This port is used for communication between the ELI server and Security Server. The default value is 2005.

**RCGIFServerPortNo** - Use this variable to specify the RCGIF port number. This port is used for communication between the RCGIF server and Security Server. The default value is 2004.

**RCGIFCallType** - Use this variable to specify the RCGIF Call Types in Configuration File. This call type is used for communication between the RCGIF Server and Security Server. Default values are 20, 21 and 23. The following are the description for the default values:

- Call type 20: For normal person, call type 20 is dispatched to the KONE server.
- Call type 21: For an ADA, call type 21 is dispatched to the KONE server.
- Call type 23: For a VIP, call type 23 (Empty car call type) is dispatched to the KONE server.

### NOTE

Call type 20 must be configured only in DOP Clearance Landing Matrix RCGIF field.

**OldTransactionsInSeconds** - Use this variable to specify the latency. Elevator drivers rely on card activity messages from iStar and listen to journal notification. After receiving journal notification, KONE Integration drivers authorize floors and dispatch it to the Elevator system. The default value is 5 seconds, any card swipe beyond 5 seconds of latency is ignored.

**DOPOpenTimeOut** - Use this variable to set the duration for which the landing matrix is displayed on the kiosk after a user swipes at the reader. The default value is 10000 milliseconds (10 sec).

**SendRetriesInterval** - Use this variable to specify the duration between the retries when the Security System receives no response from the KONE server for a particular request. The default value is 5000 milliseconds (5 Sec).

**HeartBeatTimeOut** - Use this variable to specify the timeout value for the heartbeat which is compared with the last successful heartbeat received time from the Elevator Server to the driver. This value is used to set the communication status of the Elevator server. The default value is 20000 milliseconds (20 sec).

**COPOpenTimeOut** - Use this variable to set the duration for which the landing matrix is displayed on the kiosk after a user swipes at the reader. The default value is 10000 milliseconds (10 sec).

**UsePerformanceCounters** - Use this variable to set performance counters for KONE integration. The default value is 0. Set this variable to 1 to turn on the performance counter.

## Licensing

You need a license to use the C•CURE 9000 KONE Elevator Integration software. Please contact your local Software House Sales Representative.

---

### To Verify That You Have a KONE License

1. Double-click on the Licensing icon on your desktop to open the C•CURE 9000 License dialog box (Alternately, you can select All Programs>Software House>Licensing.)
2. Click **Options** tab.
3. Scroll down the list to verify that **KONE Destination Control Integration** is listed.

## Starting the Server Services

Before you can configure KONE Elevator integration object, the CrossFire Framework Service, CrossFire Server Component Framework Service, and the KONE Elevator Driver Integration Service must be running.

### To Start the Server Services

1. From the Start Menu, select Start>All Programs>Tyco>Server Configuration. The Server Configuration Application opens.
2. Click **Services** tab.
3. If the Status is displayed as **Stopped** for the CrossFire Framework Service under Framework Services, click **Start**.
4. If the Status is displayed as **Stopped** for the CrossFire Server Component Framework Service under Framework Services, click **Start**.
5. After the CrossFire Framework Service and CrossFire Server Component Service displays a status of **Running**, click **Server Components** tab.
6. If the Status is displayed as **Stopped** for the KONE Elevator Driver Service in Extension Services, click in the **Enabled** check box and then click **Start**.
7. When the status of the KONE Driver Service changes to **Running** you can use the KONE Elevator System Integration software.



## Uninstalling the KONE Elevator Integration

The Uninstall removes all software components that were installed on the computer by the KONE Elevator integration installation. Once the uninstall process completes, the computer will be in **clean** state.

This section describes how to uninstall the KONE Elevator System integration from the Server computer and Client computers of your security system on a Windows 7 operating system. For additional operating systems, please refer to your Microsoft Windows documentation for instructions to access the Add and Remove programs.

### NOTE



Uninstalling this integration does not automatically removes objects that were configured in the C•CURE 9000 using it. Before you proceed with this uninstall, you **MUST** manually remove the objects from C•CURE 9000 to avoid potential issues with functions, such as partition deletion.

### NOTE




Please be advised that the KONE Elevator integration will shut down and restart the Server Services. Therefore, the KONE Elevator integration uninstall should be planned accordingly.

### To Uninstall the KONE Elevator System


1. From the Windows Start menu, select **Control Panel> Programs>Programs and Features**.
2. Right-click the C•CURE 9000 Kone Elevator Integration and select Uninstall. The Modify Setup dialog box, as shown in [Figure 11](#) on [Page 33](#), appears.

Figure 11: Modify Setup Dialog Box

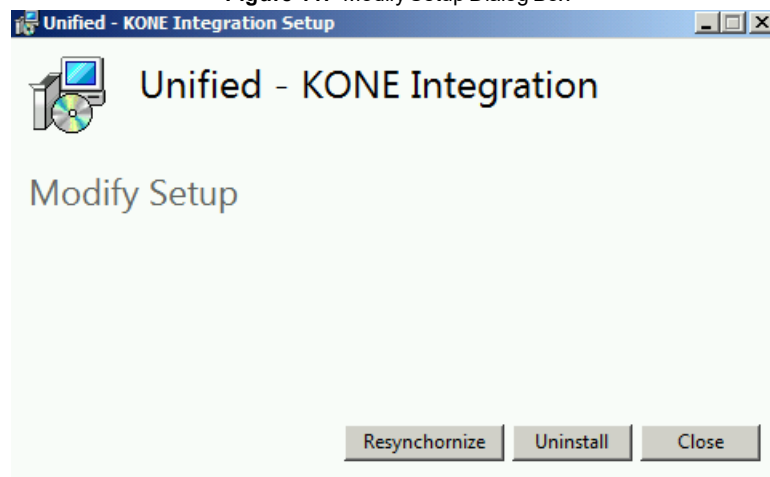


3. Click **Uninstall**. The **Tyco CrossFire Service Alert** dialog box, as shown in [Figure 12](#) on [Page 34](#), appears only for server installations running CrossFire service.

**Figure 12:** Tyco CrossFire Service Alert Dialog Box

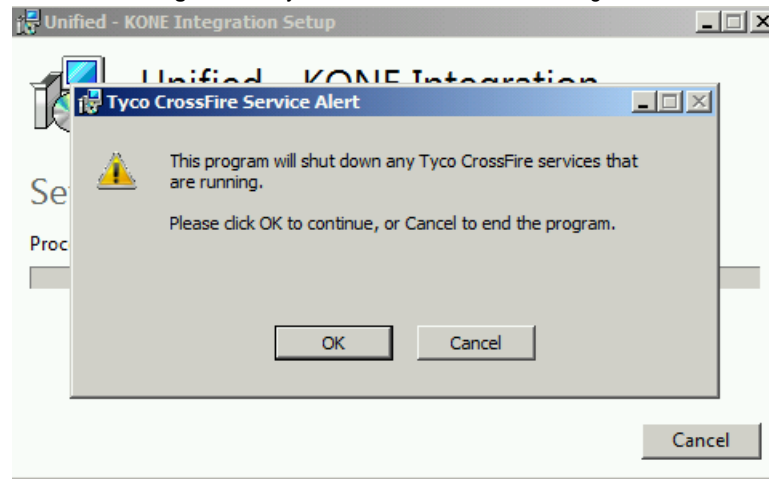


4. Click **OK** in the **Tyco CrossFire Service Alert** dialog box to continue with the uninstall. The **Welcome to the KONE Integration Setup Wizard** dialog box, as shown in [Figure 13](#) on [Page 34](#), appears.

**Figure 13:** Welcome to the KONE Integration Setup Wizard

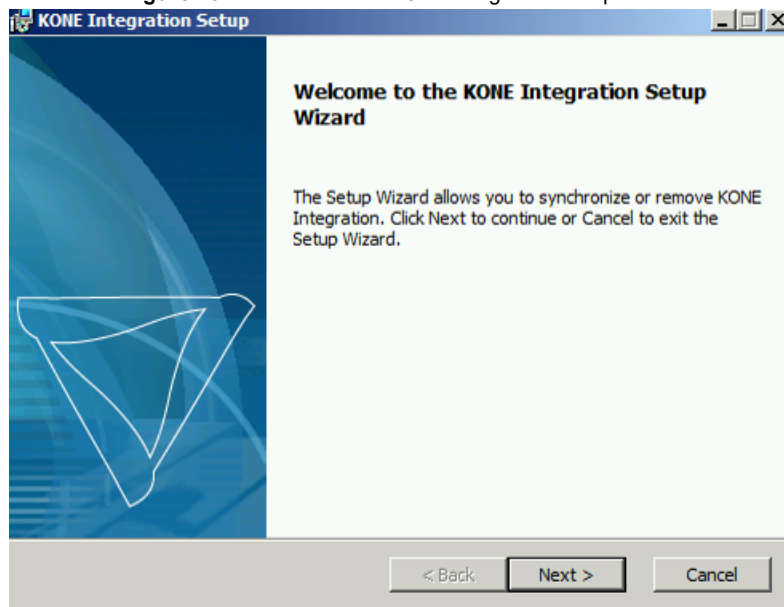

5. Click **Next** to continue the uninstallation. The **Ready to Remove the KONE Integration** dialog box, as shown in [Figure 14](#) on [Page 35](#), appears.

Figure 14: Ready to Remove the KONE Integration Dialog Box

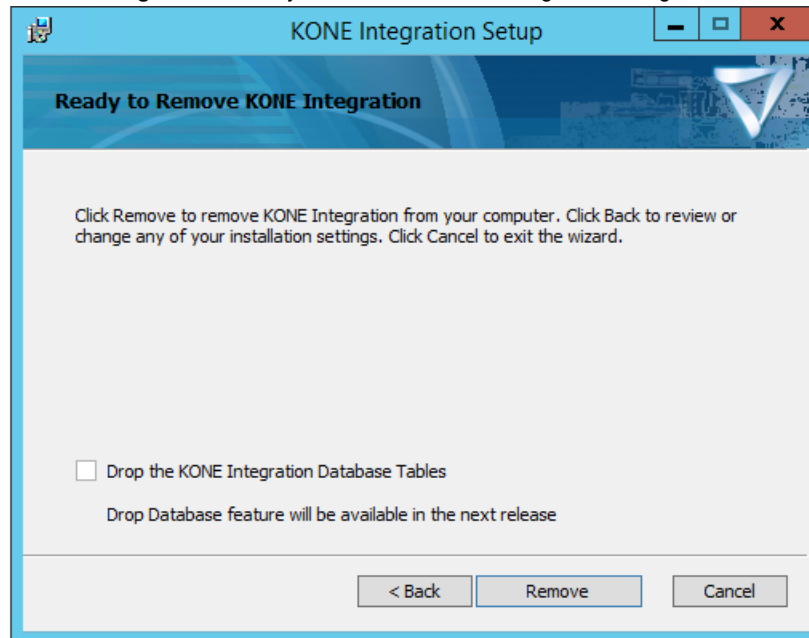


**NOTE**

Drop Database feature will be available in the next version of release (check box **Drop the KONE Integration Database Tables** will be enabled in next version of release if you choose to delete the database used in the KONE integration configuration).

6. Click **Remove** to remove the KONE Integration. After a few minutes, the **Completed the KONE Integration Setup Wizard**, as shown in Figure 15 on Page 35, appears.

Figure 15: Completed the KONE Integration Setup Wizard

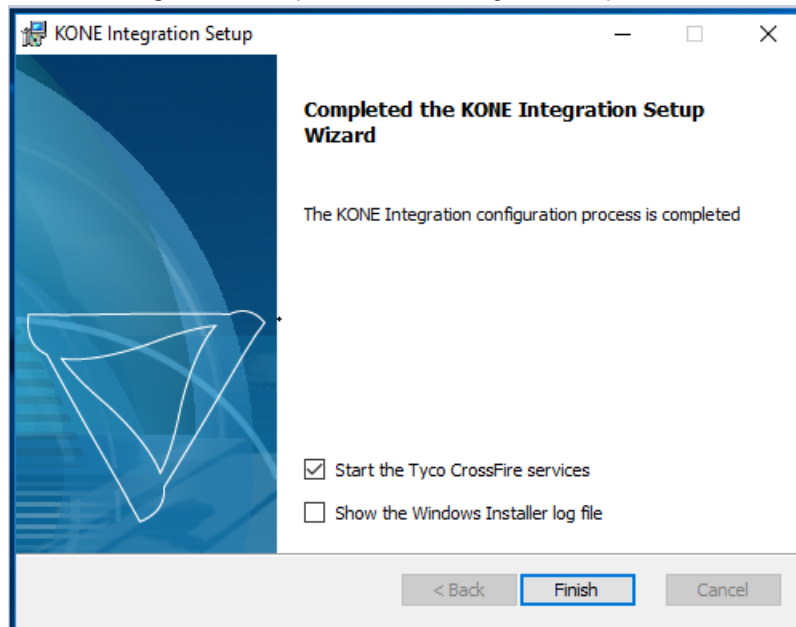


**NOTE**

Check box **Start the Tyco CrossFire services** is selected by default, user can disable this option if not required.

7. Click **Finish** to exit the uninstall program. The **Setup Successful** dialog box, as shown in [Figure 16](#) on [Page 36](#), appears.

**Figure 16:** Setup Successful Dialog Box

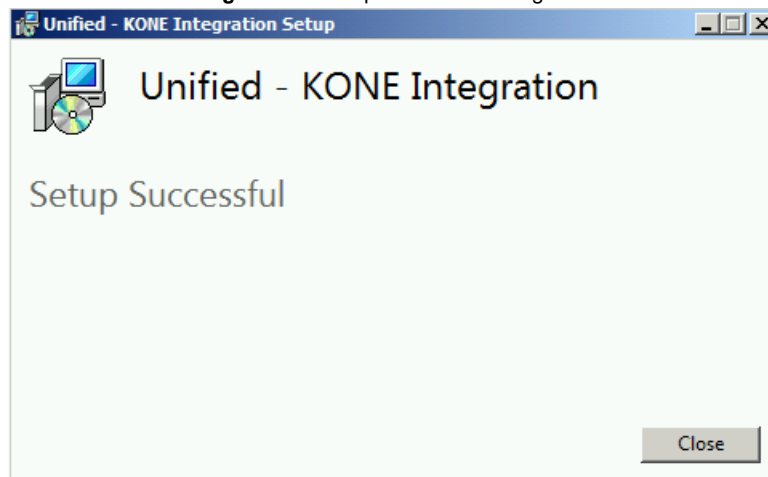

# KONE Elevator System Configuration

This chapter provides the KONE Elevator System Editor configuration procedures.

In this chapter:

- Configuration Sequence Overview ..... 38
- Creating a KONE Elevator System Folder ..... 42
- Accessing the KONE Elevator System Editor Dialog Box ..... 43
- KONE Elevator System Editor Dialog Box ..... 44
- IP Configuration Tab ..... 51
- Landing Tab ..... 52
- Triggers Tab ..... 53
- Status Tab ..... 57
- Override Tab ..... 60
- State Images Tab ..... 63

## Configuration Sequence Overview

This section provides the configuration sequences and where to find the configuration information.

See the following configuration sequences:

- [KONE Elevator System Configuration Sequence](#)
- [Landing Matrix Configuration Sequence](#)
- [COP Configuration Sequence](#)
- [Landing Configuration Sequence](#)
- [DOP Configuration Sequence](#)
- [KONE Direct Elevator Access Configuration Sequence](#)

### KONE Elevator System Configuration Sequence

**Table 5:** KONE Elevator System Configuration Sequence

| Order of Tasks   | See...   |
|--|--|
| Create a KONE Elevator System folder for the KONE Elevator System group. | See <a href="#">Creating a KONE Elevator System Folder</a> on <a href="#">Page 42</a>  |
| Create the KONE Elevator System.   | KONE Elevator System Editor dialog box.<br>See <a href="#">KONE Elevator System Editor Dialog Box</a> on <a href="#">Page 44</a> |
| Assign Global connected mask to KONE Elevator System.                    | KONE Global Landing Matrix dialog box. See <a href="#">KONE Global Landing Matrix Dialog Box</a> on <a href="#">Page 67</a>      |
| Assign Global disconnected mask to KONE Elevator System.                 | KONE Global Landing Matrix dialog box.<br>See <a href="#">KONE Global Landing Matrix Dialog Box</a> on <a href="#">Page 67</a>   |

### Landing Matrix Configuration Sequence

**Table 6:** Landing Matrix Configuration Sequence

| Order of Tasks                    | See...   |
|-----------------------------------|--|
| Create the Global Landing Matrix  | KONE Global Landing Matrix dialog box.<br>See <a href="#">KONE Global Landing Matrix Dialog Box</a> on <a href="#">Page 67</a>   |
| Create the Default Landing Matrix | KONE Default Landing Matrix dialog box.<br>See <a href="#">KONE Default Landing Matrix Dialog Box</a> on <a href="#">Page 72</a> |

| Order of Tasks                                      | See...   |
|---|--|
| Create COP Clearance Landing Matrix                 | KONE COP Clearance Landing Matrix dialog box.<br>See <a href="#">KONE DOP Clearance Landing Matrix Dialog Box</a> on <a href="#">Page 130</a>                      |
| Create DOP Clearance Landing Matrix                 | KONE DOP Clearance Landing Matrix dialog box.<br>See <a href="#">KONE DOP Clearance Landing Matrix Dialog Box</a> on <a href="#">Page 130</a>                      |
| Create DOP Clearance Landing Matrix with Home Floor | Creating a DOP Clearance Landing Matrix with the Home Floor.<br>See <a href="#">KONE DOP Clearance Landing Matrix Dialog Box Tasks</a> on <a href="#">Page 133</a> |

## COP Configuration Sequence

**Table 7:** COP Configuration Sequence

| Order of Tasks   | See...   |
|--|--|
| Create a KONE Elevator System folder for the KONE Elevator System group. | See <a href="#">Creating a KONE Elevator System Folder</a> on <a href="#">Page 42</a>  |
| Create the KONE Elevator System.   | KONE Elevator System Editor dialog box.<br>See <a href="#">KONE Elevator System Editor Dialog Box</a> on <a href="#">Page 44</a>   |
| Configure a COP  | KONE COP dialog box.<br>See <a href="#">KONE COP Dialog Box</a> on <a href="#">Page 96</a> .   |
| Assign a door to COP   | Selecting an iSTAR Door for the Front Reader<br>See <a href="#">COP Front Reader Tab</a> on <a href="#">Page 103</a><br>Selecting an iSTAR Door for the Rear Reader<br>See <a href="#">COP Rear Reader Tab</a> on <a href="#">Page 105</a> |
| Assign Default Connected Mask and Default Disconnected Mask to COP       | Configuring a COP<br>See <a href="#">KONE COP Dialog Box Tasks</a> on <a href="#">Page 98</a>  |

## Landing Configuration Sequence

**Table 8:** Landing Configuration Sequence

| Order of Tasks   | See...   |
|--|--|
| Create a KONE Elevator System folder for the KONE Elevator System group. | See <a href="#">Creating a KONE Elevator System Folder</a> on <a href="#">Page 42</a>  |
| Create the KONE Elevator System.   | KONE Elevator System Editor dialog box.<br>See <a href="#">KONE Elevator System Editor Dialog Box</a> on <a href="#">Page 44</a> |
| Create a Landing   | KONE Landing dialog box. See <a href="#">KONE Landing Dialog Box</a> on <a href="#">Page 78</a>                                  |

## DOP Configuration Sequence

**Table 9:** DOP Configuration Sequence

| Order of Tasks   | See...   |
|--|--|
| Create a KONE Elevator System folder for the KONE Elevator System group. | See <a href="#">Creating a KONE Elevator System Folder</a> on <a href="#">Page 42</a>  |
| Create the KONE Elevator System..  | KONE Elevator System Editor dialog box.<br>See <a href="#">KONE Elevator System Editor Dialog Box</a> on <a href="#">Page 44</a> |
| Create a Landing   | KONE Landing dialog box. See <a href="#">KONE Landing Dialog Box</a> on <a href="#">Page 78</a>                                  |
| Create a DOP   | KONE DOP dialog box. See <a href="#">KONE DOP Dialog Box</a> on <a href="#">Page 117</a> .                                       |

## KONE Direct Elevator Access Configuration Sequence

**Table 10:** KONE Direct Elevator Access Configuration Sequence

| Order of Tasks   | See...   |
|--|--|
| Create a KONE Elevator System folder for the KONE Elevator System group. | See <a href="#">Creating a KONE Elevator System Folder</a> on <a href="#">Page 42</a>  |
| Create the KONE Elevator System.   | KONE Elevator System Editor dialog box.<br>See <a href="#">KONE Elevator System Editor Dialog Box</a> on <a href="#">Page 44</a> |



| Order of Tasks                       | See...   |
|--------------------------------------|--|
| Create a KONE Direct Elevator Access | KONE Direct Elevator Access dialog box. See <a href="#">KONE Direct Elevator Access Dialog Box</a> on <a href="#">Page 108</a>             |
| Assign VIP Group                     | KONE Direct Elevator Access dialog box tasks. See <a href="#">KONE Direct Elevator Access Dialog Box Tasks</a> on <a href="#">Page 110</a> |

## Creating a KONE Elevator System Folder

---

### To Create a New KONE Elevator System Folder

1. Double-click on the Administration Workstation icon on the desktop to open it. (Alternately, you can select **All Programs>Software House>C•CURE 9000>Administration Station**).
2. Click **Hardware** pane button.
3. Right-click **Hardware** under the Hardware tree and select **Hardware Folder>New**.
4. Enter a name and description (optional) for the KONE Elevator System folder.
5. Click **Save and Close**. The new folder is listed under the Hardware tree.

## Accessing the KONE Elevator System Editor Dialog Box

This section explains how to access the KONE Elevator System Editor in the C•CURE 9000.

### NOTE

This section assumes that you already created a folder for the KONE Elevator System. See [Creating a KONE Elevator System Folder](#) on [Page 42](#) for more information.

### To Access the KONE Elevator System Editor

1. Open the C•CURE 9000 Administration Station.
2. Click **Hardware** Pane.
3. Click **Hardware** drop-down menu and select **Hardware Folder**.
4. Right-click the **KONE Elevator System** folder and select **KONE Elevator System>New**, as shown in [Figure 17](#) on [Page 43](#).

Figure 17: Access the KONE Elevator System Dialog Box



The KONE Elevator System dialog box, shown in [Figure 18](#) on [Page 45](#), opens with the General tab selected.

## KONE Elevator System Editor Dialog Box

The KONE Elevator System Editor dialog box, shown in [Figure 18](#) on [Page 45](#), is used to create an identity for the elevator system, enter IP addresses for the primary server (Server A) and back up servers (Servers B, C, D and E), select **Connected** or **Disconnected Mask** state, select the check box **Lock All Floors** or **Open All Floors**, configure triggers and events, view configured Landings in the elevator group, and optionally change state images.

For more information, see the following:

- [KONE Elevator System Editor Dialog Box Definitions](#) on [Page 45](#)
- [KONE Elevator System Editor Tasks](#) on [Page 47](#)
- [KONE Elevator System Editor Tabs](#) on [Page 50](#)

Figure 18: KONE Elevator System Editor Dialog Box

KONE Elevator System -

Save and Close

Name:

Description:

☐ Enabled

☐ Maintenance Mode

General

IP Configuration

Landing

Triggers

Status

Override

State images

Group ID

1

Poll Time (seconds)

6

Number Of Floors

0

☒ Send Global Mask to COP

☒ Send Global Mask to DOP

Connected Mask

Disconnected Mask

☒ Open All Floors

☐ Lock All Floors

KONE Elevator System Editor Dialog Box Definitions

Table 11 on Page 46 describes the KONE Elevator System Editor dialog box fields and buttons.

**Table 11:** KONE Elevator System Editor Dialog Box Definitions

| Field/Button            | Description  |
|-------------------------|--|
| Name                    | <p>A unique name identifying the KONE Elevator System.</p> <ul style="list-style-type: none"> <li>• The name is not case-sensitive</li> <li>• Minimum number of characters: 1</li> <li>• Maximum number of characters: 100</li> </ul>  |
| Description             | <p>Optional. A description for the KONE Elevator System.</p> <ul style="list-style-type: none"> <li>• The description is not case-sensitive</li> <li>• Minimum number of characters: None</li> <li>• Maximum number of characters: 500</li> </ul>  |
| Enabled                 | <p>Enables (checked) or disables (unchecked) communication between the C•CURE 9000 and the KONE Elevator system.</p> <p>Default: Disabled (unchecked).</p> <p><b>NOTE:</b> If the configuration is enabled and then disabled, it will be displayed in the Monitoring Station as <b>Unknown</b>. Also if the IP address is not configured, it displays as <b>Unknown</b>.</p> |
| Maintenance Mode        | <p>Select the Maintenance mode check box to limit information about the object, that is displayed on the Monitoring Station. Maintenance Mode only affects the information reported at the Monitoring Station. For more information see <a href="#">Maintenance Mode on Page 64</a>.</p>   |
| Save and Close          | Saves the configuration and closes the dialog box.   |
| <b>General Tab</b>      |  |
| Group ID                | A number, between 1 and 30, that identifies the elevator group.  |
| Server A                | (Mandatory) The IP address of the server A. <b>Note:</b> IPv6 addresses are not supported.   |
| Server B                | (Optional) The IP address of the server B. <b>Note:</b> IPv6 addresses are not supported.  |
| Server C                | (Optional) The IP address of the server C. <b>Note:</b> IPv6 addresses are not supported.  |
| Server D                | (Optional) The IP address of the server D. <b>Note:</b> IPv6 addresses are not supported.  |
| Server E                | (Optional) The IP address of the server E. <b>Note:</b> IPv6 addresses are not supported.  |
| Poll Time               | The time to poll. The value can be between 5 and 15 seconds. Default: 6 seconds.   |
| Number of Floors        | The number of floors required while sending the Landing Matrix to the KONE Elevator System.  |
| Send Global Mask to COP | This check box is selected by default. This is used to send Global Landing Mask data to COP. You can disable this option if not required.  |

| Field/Button   | Description   |
|--|---|
| Send Global Mask to DOP  | This check box is selected by default. This is used to send Global Landing Mask data to DOP. You can disable this option if not required.   |
| <b>The following fields and check boxes are not configurable until a KONE Global Landing Matrix is configured:</b> |   |
| Connected Mask   | The Connected Mask is used when the connection between the C•CURE 9000 and the KONE Elevator System is active. The KONE Elevator System automatically loads the pre-configured Global Landing Matrix to all the COP's and DOP's in the elevator system to enable the floors assigned in the connected mask.                 |
| Disconnected Mask  | The Disconnected Mask is used when the connection between the C•CURE 9000 and the KONE Elevator System is disconnected. The KONE Elevator System automatically loads the pre-configured Global Landing Matrix to all the COP's and DOP's in the elevator system to enable all the floors assigned to the disconnected mask. |

## KONE Elevator System Editor Tasks

This section describes the tasks performed in the KONE Elevator System Editor Dialog box.

### NOTE

The Landing and State Images tabs are not active until the Landing, DOP, and Clearance Landing Matrix are configured. See [KONE Elevator System Editor Tabs](#) on [Page 50](#).

The following tasks are performed in the KONE Elevator System Editor dialog box - General tab:

- [Creating a KONE Elevator System](#) on [Page 47](#)
- [Selecting a Connected Mask and a Disconnected Mask](#) on [Page 48](#)
- [Selecting Send Global Mask to COP or Send Global Mask to DOP](#) on [Page 48](#)
- [Selecting Open All Floors or Lock All Floors](#) on [Page 49](#)
- [Creating a KONE Elevator System Template](#) on [Page 49](#)
- [Editing a KONE Elevator System](#) on [Page 49](#)
- [Viewing KONE Elevator System Configurations](#) on [Page 50](#)
- [Deleting a KONE Elevator System](#) on [Page 50](#)

## Creating a KONE Elevator System

### To Create a KONE Elevator System

1. Open the C•CURE 9000 Administration Station.
2. Click **Hardware** pane.
3. Click on the drop-down menu located under Hardware and select **Hardware Folder**.
4. Right-click on the folder you created in the Hardware tree and select **KONE Elevator System>New**. (Alternately, you can create a new folder by clicking on **New** located next to the Hardware dropdown menu.)

### NOTE

KONE Elevator System is used for the folder name throughout this guide.



The KONE Elevator System Editor opens. See [KONE Elevator System Editor Dialog Box](#) on [Page 44](#).

5. Enter a name for the elevator group in the **Name** field.
6. Enter a description (optional) for the elevator group in the **Description** field.
7. Click on the IP Configuration tab and perform the following:
  - a. Enter the IP address of the C•CURE 9000 server in the **Server A** field (Server A is mandatory).
  - b. Enter the IP address of the C•CURE 9000 server in the **Server B** field (Server B is optional).
  - c. Enter the IP address of the C•CURE 9000 server in the **Server C** field (Server C is optional).
  - d. Enter the IP address of the C•CURE 9000 server in the **Server D** field (Server D is optional).
  - e. Enter the IP address of the C•CURE 9000 server in the **Server E** field (Server E is optional).
8. Click **Save and Close**. The Elevator System is listed under the KONE Elevator System folder in the Hardware tree.
9. Go to [KONE Default Landing Matrix Dialog Box](#) on [Page 72](#) to configure the default landing matrix.

### Selecting a Connected Mask and a Disconnected Mask

The global landing matrix must be configured before you can configure the connected mask and the disconnected mask. See [KONE Elevator System Editor Dialog Box](#) on [Page 44](#) for more information.

#### To Select a Connected Mask and a Disconnected Mask

1. (Optional) Click on the selection button  to the right of the Connected Mask field to open the KONE Global Landing Matrix selection box listing global landing matrix configurations.
2. Click on a global landing matrix configuration to select it.
3. (Optional) Click on the selection button  to the right of the Disconnected Mask field to open the KONE Global Landing Matrix selection box listing global landing matrix configurations.
4. Click on a global landing matrix configuration to select it.
5. Click Save and Close.

### Selecting Send Global Mask to COP or Send Global Mask to DOP

**Send Global Mask to Cop** - Sends the Global Mask Landing data to COP. This option is selected by default. You can disable this option if not required.

**Send Global Mask to DOP** - Sends the Global Mask Landing data to DOP. This option is selected by default. You can disable this option if not required.

#### To Select Send Global Mask to COP or Send Global Mask to DOP

1. Click in the check box next to **Send Global Mask to COP** to select it, or click in the checkbox next to **Send Global Mask to DOP** to select it.
2. Click **Save and Close**.



## Selecting Open All Floors or Lock All Floors

**Open All Floors** - Opens all floors as part of the Connected state. This option is used if you do not want to associate a global landing matrix to the elevator system.

**Lock All Floors** - Locks all floors as part of the Disconnected state. This option is used if you do not want to associate a global landing matrix to the elevator system.

---

### To Select Open All Floors or Lock All Floors

1. Click in the check box next to **Open All Floors** to select it, or click in the check box next to **Lock All Floors** to select it.
2. Click **Save and Close**.

## Creating a KONE Elevator System Template

Creating a template saves you time because you do not have to re-enter the same information again.

---

### To Create a Template

1. Click on the **Hardware** pane.
2. Click on the drop-down menu located under Hardware and select **Hardware Folder**.
3. Right-click on the KONE Elevator System folder in the Hardware tree and select **KONE Elevator System>New Template**.
4. Enter the information for the KONE Elevator System template.
5. Click **Save and Close**.
6. The new template is listed under **KONE Elevator System>Templates**.

## Editing a KONE Elevator System


---

### To Edit a KONE Elevator System

1. Double-click on the **Elevator System** under the KONE Elevator System folder in the Hardware tree to open the KONE Elevator System dialog box. (Alternately, you can right-click on the Elevator System and select **Edit** from the context menu)
2. Make the changes to the configuration.
3. Click **Save and Close**.

## Viewing KONE Elevator System Configurations

### To View KONE Elevator System Configurations

1. Select **KONE Elevator System** from the Hardware drop-down menu.
2. Click on the green right arrow  to open a Dynamic View displaying all KONE Elevator System Configurations. The KONE Elevator System tab opens in the Dynamic View displaying a list of KONE Elevator System configurations.

## Deleting a KONE Elevator System

### NOTE

The Elevator System DOP and Landing configurations must be deleted before you can delete the Elevator System.

### To Delete a KONE Elevator System

1. Click on the Elevator System under the KONE Elevator System folder in the Hardware tree.
2. Click on a Landing to expand the DOP configurations.
3. Right-click on the DOP configuration and select Delete from the context menu.
4. Repeat step 3 for all DOP configurations listed under the Landing.
5. Right-click on the Landing and select Delete from the context menu.
6. Right-click on the Elevator System and select Delete from the context menu.

## KONE Elevator System Editor Tabs

The following sections provide information about the KONE Elevator System Editor tabs:

- [IP Configuration Tab](#) on [Page 51](#)
- [Landing Tab](#) on [Page 52](#)
- [Triggers Tab](#) on [Page 53](#)
- [Status Tab](#) on [Page 57](#)
- [Override Tab](#) on [Page 60](#)
- [State Images Tab](#) on [Page 63](#)

## IP Configuration Tab

The IP Configuration tab, shown in [Figure 19](#) on [Page 51](#), lists the configured Servers for the elevator group. KONE Integration supports a minimum of one Server and a Maximum of 5 Servers.

IP address of Server A is Mandatory and the IP address of Servers B, C, D and E are optional.

**Figure 19:** KONE Elevator System Editor – IP Configuration Tab


The screenshot shows the 'KONE Elevator System Editor - IP Configuration Tab' window. The window has a title bar with the text 'KONE Elevator System -' and standard window controls (minimize, maximize, close). Below the title bar is a 'Save and Close' button. The main area contains the following elements:

- Name:** A text input field.
- Description:** A text input field with up and down arrow buttons on the right.
- Enabled:** A checkbox.
- Maintenance Mode:** A checkbox.
- Tabs:** A row of tabs: 'General', 'IP Configuration' (selected), 'Landing', 'Triggers', 'Status', 'Override', and 'State images'.
- Server Configuration:** A large white box containing five input fields, each preceded by a label:
  - Server A
  - Server B
  - Server C
  - Server D
  - Server E

## Landing Tab

The Landing tab, shown in [Figure 20](#) on [Page 52](#), lists the configured Landings for the elevator group. This tab is read-only.

**Figure 20:** KONE Elevator System Editor – Landing Tab

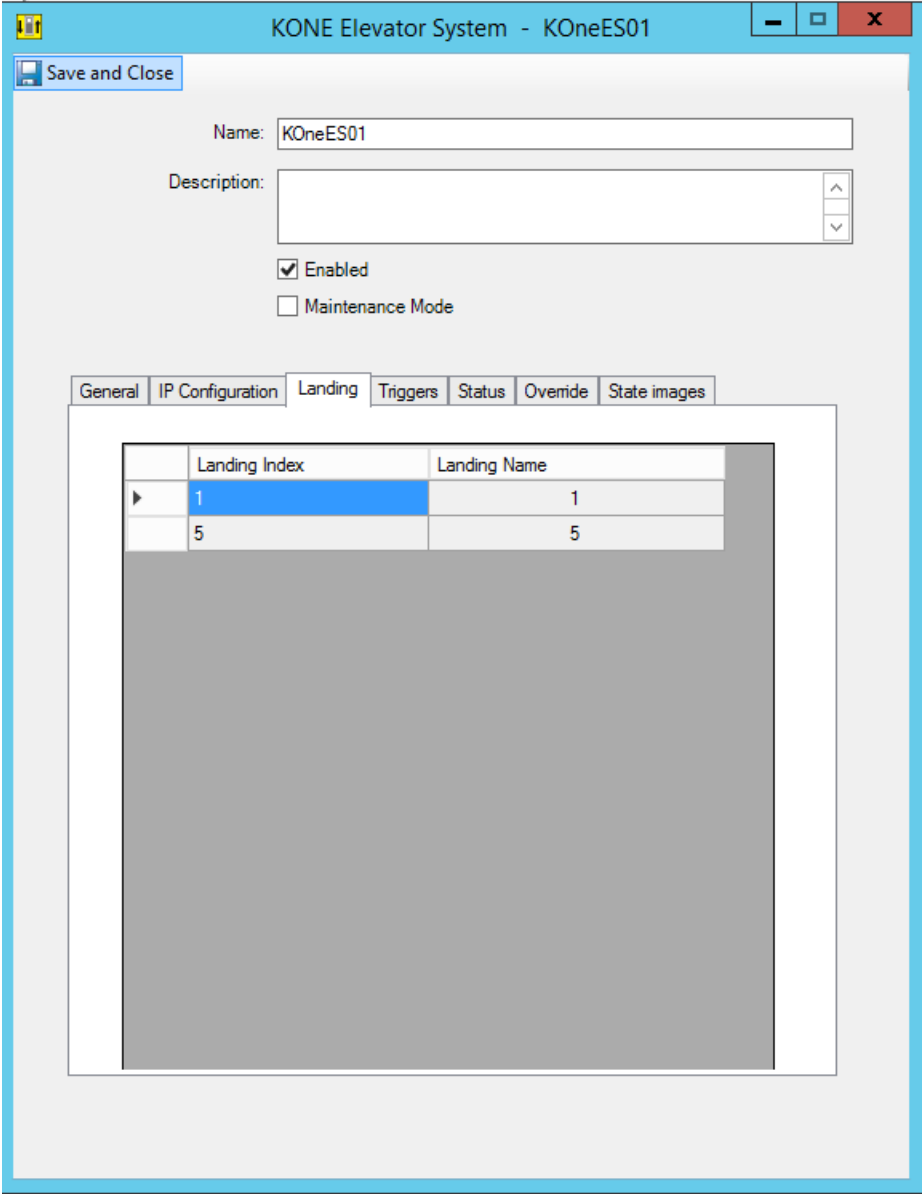

## Triggers Tab

The Triggers tab, shown in [Figure 21](#) on [Page 54](#), is used to configure triggers to activate events.

Triggers are configured procedures used by C•CURE 9000 to activate specific actions when a particular predefined condition occurs. Once the Elevator status matches one of these values, the linked Activate Event action is triggered and the user-specified event is set to an active state (if allowed by the event, which should be armed at the time). Typically, you would use the activated event to send messages to a security guard or administrator when an elevator has a particular status.


By creating new rows and selecting different values for each row, each value of the Status field can trigger its own event. It is also possible to trigger two different events for the same status value by creating two rows with the same value and then linking each row to its own event.

Supported triggers are Offline and Online.

For more information, see the following:

- [Triggers Tab Definitions](#) on [Page 54](#)
- [Triggers Tab Tasks](#) on [Page 55](#)

Figure 21: KONE Elevator System Editor – Triggers Tab

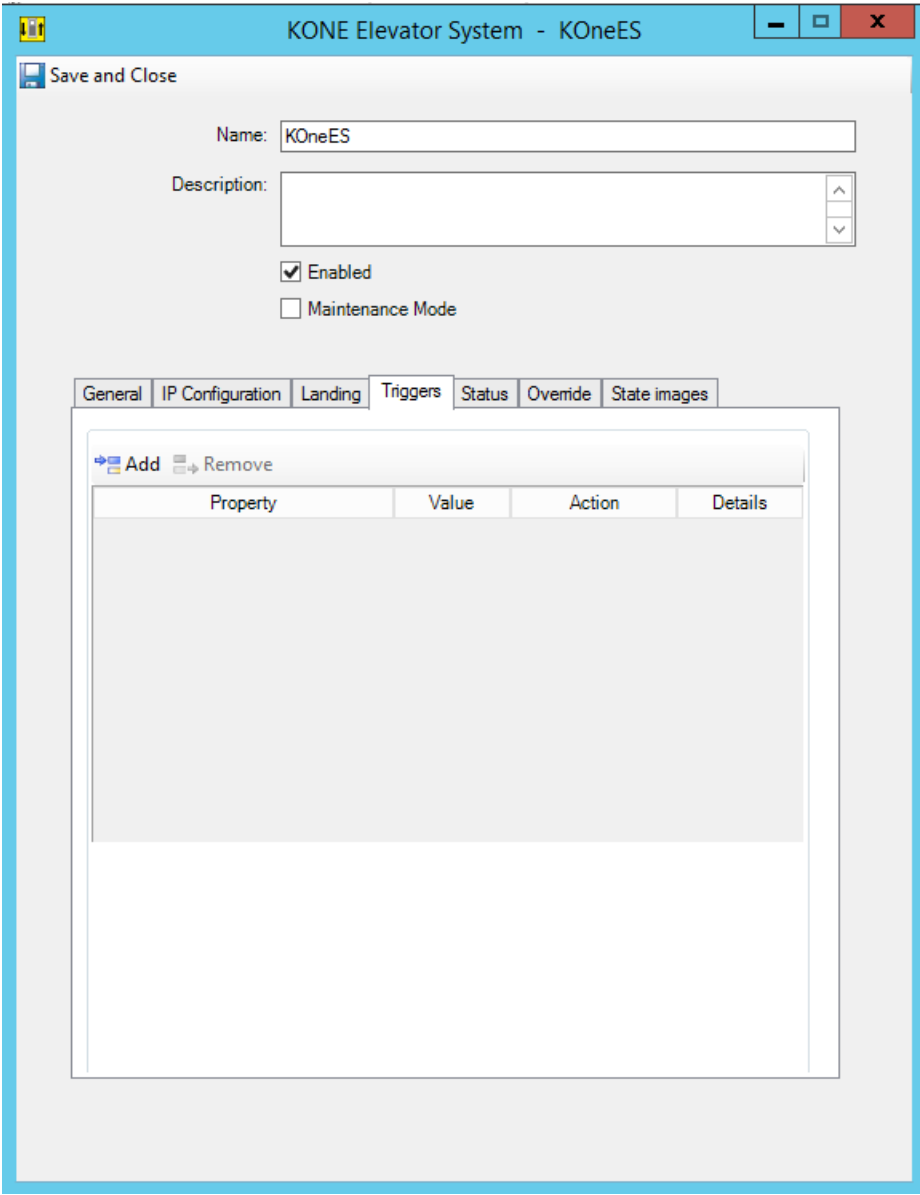




Triggers Tab Definitions

The KONE Elevator System Editor – Triggers tab fields and buttons are described in [Table 12](#) on [Page 54](#)

Table 12: KONE Elevator System Editor Dialog Box–Triggers Tab Definitions

| Field/Button | Description  |
|--------------|--|
| Add          | Click this button to create a new row in the Triggers table. You must configure all fields in the row to complete the Add operation. |

| Field/Button | Description   |
|--------------|---|
| Remove       | Click this button to remove a selected row from the Triggers table.   |
| Property     | Click in the Property field to display the selection button  , and then click  to select Status (the only selection available).           |
| Value        | Selections are Online and Offline.  |
| Action       | Click on the drop-down menu to select an action to occur. This action selected will occur when the object's selected Property receives the selected Value.  |
| Details      | The name of the event configured for the row (read-only) entered by the system.   |
| Event        | Click on the selection button  to select a Event that you want to associate with the trigger. Events are created in the C•CURE 9000 Configuration pane. See the C•CURE 9000 Software Configuration Guide for more information. |

## Triggers Tab Tasks

The following tasks are performed in the Triggers tab:

- [Selecting Triggers to Activate Events](#) on [Page 55](#)
- [Deleting Triggers and Events](#) on [Page 56](#)

### Selecting Triggers to Activate Events

#### To Select Triggers to Activate Events


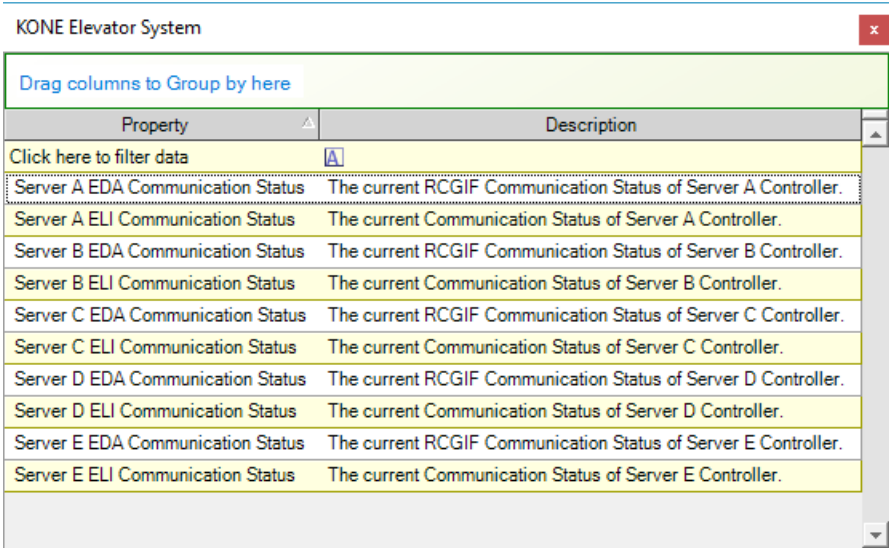
1. Click on the **Triggers** tab.
2. Click on the **Add** button.
3. Click in the blank row under **Property**, and then click on the selection button  to open the KONE Elevator System Server dialog box. KONE Elevator System Server dialog box appears, refer to [Figure 22](#) on [Page 56](#).

Figure 22: KONE Elevator System Server Dialog box



- 4. Click on the **ELI** or **EDA** Communication Status Servers A to E to select it.

**NOTE** Triggers support both ELI and RCGIF Servers from A to E.


- 5. Click in the blank field under **Value**.
- 6. Click on the drop-down menu and select **Offline** or **Online**.
- 7. Click on the drop-down menu under **Action** and select **Activate Event**. The Event field appears at the bottom of the dialog box.



- 8. Click on the selection button .
- 9. Click on a pre-configured event to activate.
- 10. Click **Save and Close**.

Deleting Triggers and Events

To Delete a Trigger and Event from the Elevator Group

- 1. Click on the row selector button  to select the row.
- 2. Click the **Remove** button.



## Status Tab

The Status tab, shown in [Figure 23](#) on [Page 58](#), provides read-only information about the operational status of Server A, Server B, Server C, Server D and Server E used by the KONE Elevator system.

Supported values are:

- Online
- Offline
- Unknown

For more information, see the following:

- [Status Tab Descriptions](#) on [Page 58](#)

Figure 23: KONE Elevator System Editor – Status Tab

KONE Elevator System - KOneES01

Save and Close

Name: KOneES01

Description:

☒ Enabled

☐ Maintenance Mode

GeneralIP ConfigurationLandingTriggersStatusOverrideState images

| Servers  | ELI Status | RCGIF Status |
|----------|------------|--------------|
| Server A | Offline    | Offline      |
| Server B | Offline    | Offline      |
| Server C | Unknown    | Unknown      |
| Server D | Unknown    | Unknown      |
| Server E | Unknown    | Unknown      |

Status Tab Descriptions

The KONE Elevator System Editor–Status tab fields are described in Table 13 on Page 59.

**Table 13:** Status Tab Definitions


| Elevator Inter-<br>face                      | Field/Button                     | Description   |
|--|----------------------------------|---|
| Elevator<br>Locking<br>Interface (ELI)       | Server A Communication<br>Status | <p>Value (Status):</p> <ul style="list-style-type: none"> <li>• Online: The KONE Elevator System is configured and communicating with the C•CURE 9000 server.</li> <li>• Offline: The KONE Elevator System is configured, but not communicating with the C•CURE 9000 server.</li> <li>• Unknown: The status cannot be determined, usually displayed after the initial KONE Elevator System configuration while waiting for the C•CURE 9000 server to update the status. Also if the KONE Controller IP Address is not configured then the communication status is displayed as <b>Unknown</b>.</li> </ul> |
|  | Server B Communication<br>Status |   |
|  | Server C Communication<br>Status |   |
|  | Server D Communication<br>Status |   |
|  | Server E Communication<br>Status |   |
| Remote Call Giv-<br>ing Interface<br>(RCGIF) | Server A Communication<br>Status |   |
|  | Server B Communication<br>Status |   |
|  | Server C Communication<br>Status |   |
|  | Server D Communication<br>Status |   |
|  | Server E Communication<br>Status |   |

## Override Tab

The Override tab, shown in [Figure 24](#) on [Page 61](#), is used to select a pre-configured personnel group that will be exempt from the manual secure landing action. The exempt personnel group selected allows the personnel in the group access to the landing when it is in the secured state.

For more information, see the following:


- [Override Tab Definitions](#) on [Page 61](#)
- [Selecting an Exempt Personnel Group](#) on [Page 62](#)

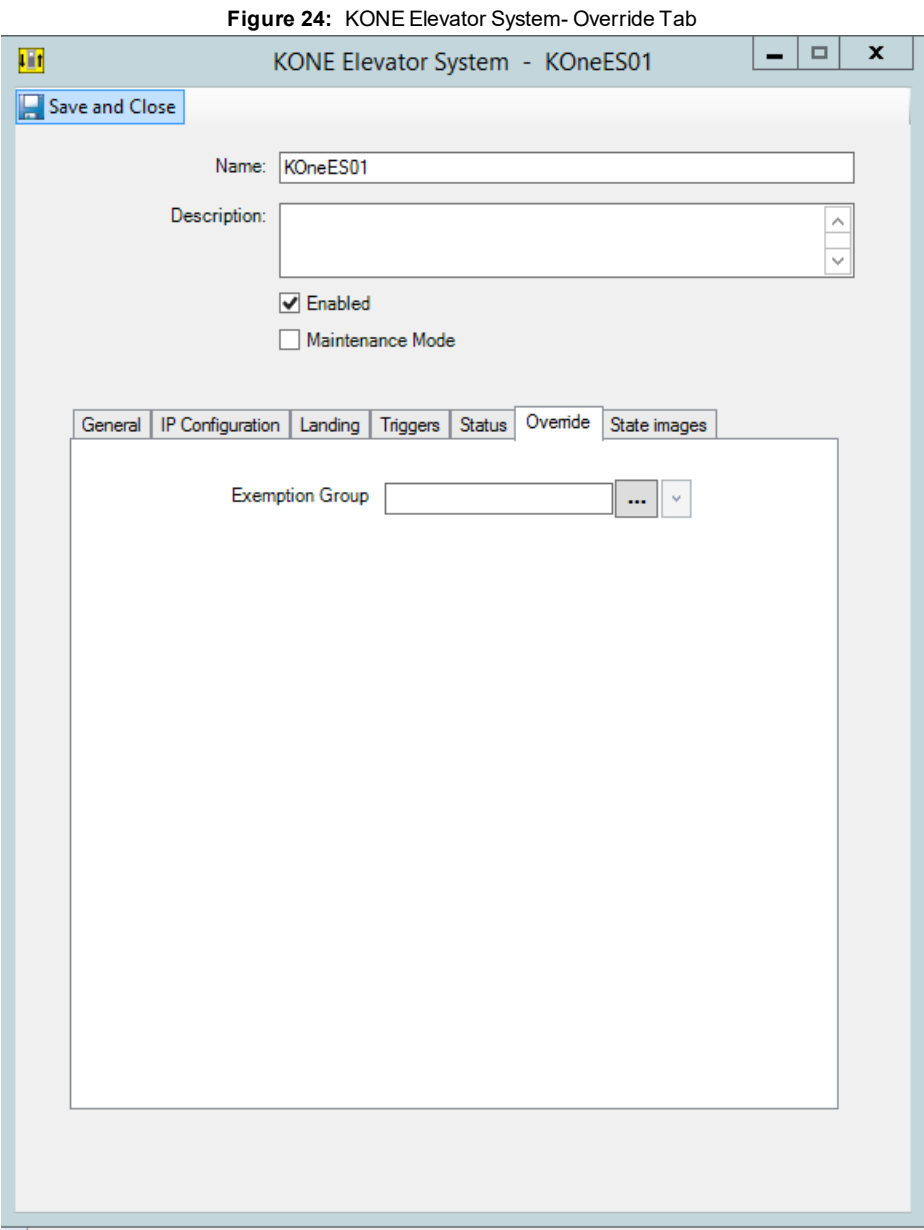

**Override Tab Definitions**


See [Table 14](#) on [Page 61](#) for more information on the KONE Elevator System **Override** Tab.

**Table 14:** KONE Elevator System- Override Tab

| Field           | Description   |
|-----------------|---|
| Exemption Group | Click on the selection button  to select the pre- configured personnel group. See the C•CURE 9000 Software Configuration Guide for information on creating personnel groups. |

## Selecting an Exempt Personnel Group

### To Select an Exempt Personnel Group


1. Click on the **Override** tab.
2. Click on the selection button  located to the right of Exception Group. The Group selection box opens.
3. Click in the row below the **Name** column.
4. Click on the drop-down arrow to select the exempt personnel group.
5. Click **Save and Close** to save the configuration.

## State Images Tab

The State Images tab, shown in [Figure 25](#) on [Page 63](#), displays the current elevator system images that display in the Monitoring Station to represent activities concerning the elevator system. You can select other images to display for this elevator system and return back to the default images, as described in this section.

See [State Images Tab Tasks](#) on [Page 63](#) for information about changing the state images.

**Figure 25:** KONE Elevator System- State Images Tab

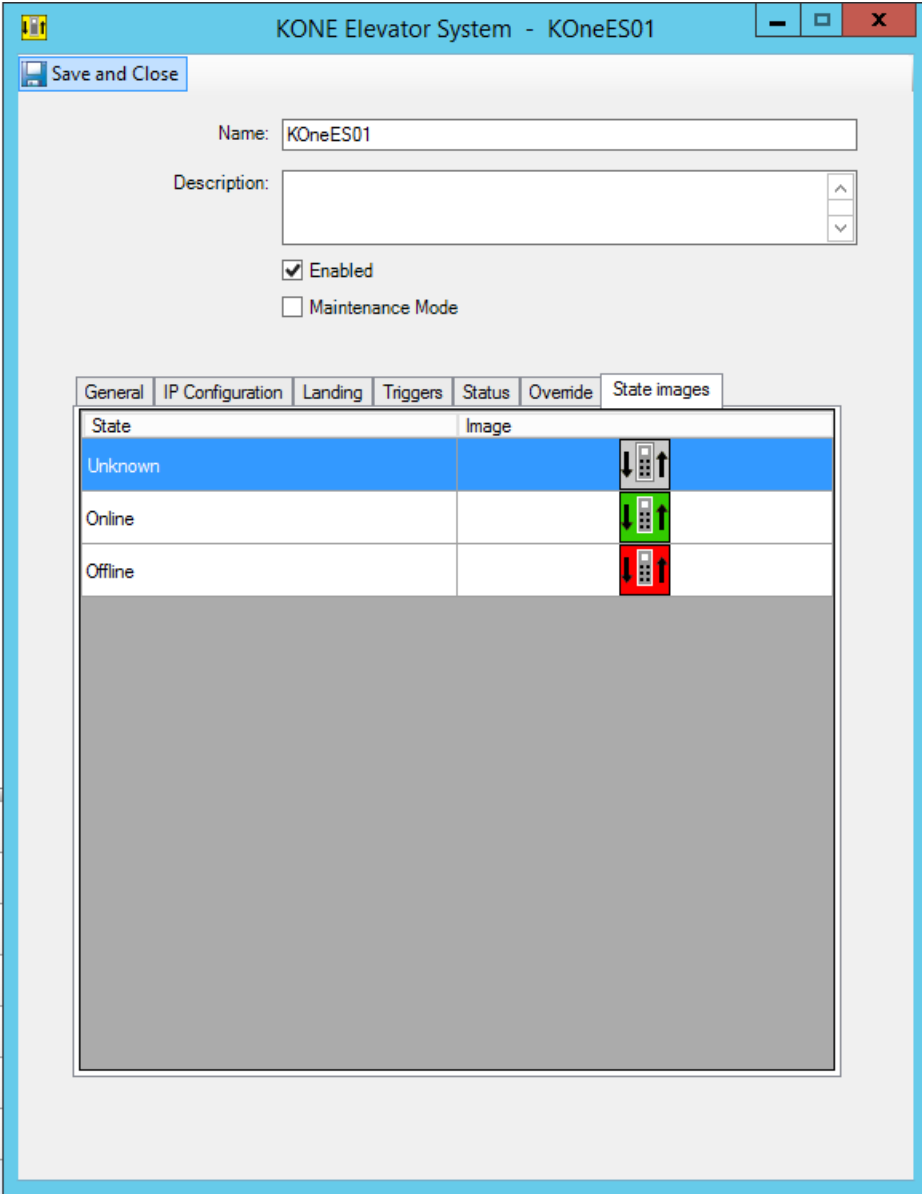

### State Images Tab Tasks

The following tasks are performed in the State Images tab:

- [Replace a State Image](#) on [Page 64](#)
- [Restore the Default State Image](#) on [Page 64](#)

## Replace a State Image

### To Replace an Image

1. Double-click the default image in the tab to open a Windows file selection dialog box.
2. If necessary, navigate to find the new image.
3. Select the desired replacement image and click **Open**. The new image replaces the default image and displays in the State Images tab.

## Restore the Default State Image

### To Restore the Default Image

- Right-click on the image in the State Images tab and select **Restore Default**.

## Maintenance Mode

Maintenance Mode is used to limit information about an object that is displayed on the Monitoring Station. Maintenance Mode only affects the information reported at the Monitoring Station.

A few examples for using the Maintenance Mode are:

- To prevent the display of information about:
  - Parts of the system being installed by an integrator
  - Hardware being serviced, requiring maintenance, or being tested.
- To only monitor information about hardware being serviced, requiring maintenance, or being tested.
- To view information about all objects, including those tagged to Maintenance Mode.

If you place an object in the Maintenance Mode, it does not prevent actions from occurring. For example, if an event assigned to an intrusion zone in Maintenance Mode activates an output that turns on the building-wide evacuation alarm, the activation of the output will still occur.

Maintenance Mode is only reported in Journal messages when an object is tagged to Maintenance Mode.

Operator Privilege and Application Layout Filtering assignments determine whether or not an object in Maintenance Mode is viewable, as being in Maintenance Mode, on the Monitoring Station.

Operators with the appropriate privileges and Application Layout Filtering can view objects in Maintenance Mode.



# KONE Global Landing Matrix Configuration

This chapter provides the global landing matrix configuration procedures.

In this chapter

|   |    |
|---|----|
| Accessing the KONE Global Landing Matrix Dialog Box ..... | 66 |
| KONE Global Landing Matrix Dialog Box .....               | 67 |

## Accessing the KONE Global Landing Matrix Dialog Box

This section describes how to access the KONE Global Landing Matrix dialog box.

### To Access the KONE Global Landing Matrix Dialog Box

1. Right-click on the KONE Elevator System folder and select **KONE Global Landing Matrix>New** as shown in [Figure 26](#) on [Page 66](#).

**Figure 26:** Access the KONE Global Landing Matrix Dialog Box



The KONE Global Landing Matrix dialog box, shown in [Figure 27](#) on [Page 67](#), opens.

## KONE Global Landing Matrix Dialog Box

The KONE Global Landing Matrix dialog box, shown in [Figure 27](#) on [Page 67](#), is used to configure the Destination Front, Destination Rear, Source Front, and Source Rear floors of the elevator system. User can configure Global Landing Matrix from 1 to 255.

If an elevator system configured is with a global landing matrix and a DOP/COP is associated with another landing matrix, the global landing matrix is used by all DOP's/COP's in the elevator system.

### NOTE

- COP Global Landing Matrix: only Destination Front and Destination Rear data is sent to KONE elevator system.
- DOP Global Landing Matrix: Destination Front, Destination Rear, Source Front, and Source Rear data is sent to the elevator system.

For more information see the following:

- [KONE Global Landing Matrix Dialog Box Definitions](#) on [Page 67](#)
- [KONE Global Landing Matrix Dialog Box Tasks](#) on [Page 68](#)

**Figure 27:** KONE Global Landing Matrix Dialog Box

| Source Front                | Source Rear                 | Destination Front           | Destination Rear            |
|-----------------------------|-----------------------------|-----------------------------|-----------------------------|
| <input type="checkbox"/> 1  | <input type="checkbox"/> 1  | <input type="checkbox"/> 1  | <input type="checkbox"/> 1  |
| <input type="checkbox"/> 2  | <input type="checkbox"/> 2  | <input type="checkbox"/> 2  | <input type="checkbox"/> 2  |
| <input type="checkbox"/> 3  | <input type="checkbox"/> 3  | <input type="checkbox"/> 3  | <input type="checkbox"/> 3  |
| <input type="checkbox"/> 4  | <input type="checkbox"/> 4  | <input type="checkbox"/> 4  | <input type="checkbox"/> 4  |
| <input type="checkbox"/> 5  | <input type="checkbox"/> 5  | <input type="checkbox"/> 5  | <input type="checkbox"/> 5  |
| <input type="checkbox"/> 6  | <input type="checkbox"/> 6  | <input type="checkbox"/> 6  | <input type="checkbox"/> 6  |
| <input type="checkbox"/> 7  | <input type="checkbox"/> 7  | <input type="checkbox"/> 7  | <input type="checkbox"/> 7  |
| <input type="checkbox"/> 8  | <input type="checkbox"/> 8  | <input type="checkbox"/> 8  | <input type="checkbox"/> 8  |
| <input type="checkbox"/> 9  | <input type="checkbox"/> 9  | <input type="checkbox"/> 9  | <input type="checkbox"/> 9  |
| <input type="checkbox"/> 10 | <input type="checkbox"/> 10 | <input type="checkbox"/> 10 | <input type="checkbox"/> 10 |
| <input type="checkbox"/> 11 | <input type="checkbox"/> 11 | <input type="checkbox"/> 11 | <input type="checkbox"/> 11 |
| <input type="checkbox"/> 12 | <input type="checkbox"/> 12 | <input type="checkbox"/> 12 | <input type="checkbox"/> 12 |
| <input type="checkbox"/> 13 | <input type="checkbox"/> 13 | <input type="checkbox"/> 13 | <input type="checkbox"/> 13 |
| <input type="checkbox"/> 14 | <input type="checkbox"/> 14 | <input type="checkbox"/> 14 | <input type="checkbox"/> 14 |
| <input type="checkbox"/> 15 | <input type="checkbox"/> 15 | <input type="checkbox"/> 15 | <input type="checkbox"/> 15 |

## KONE Global Landing Matrix Dialog Box Definitions

[Table 15](#) on [Page 68](#) describes the KONE Global Landing Matrix dialog box fields and buttons.

**Table 15:** KONE Global Landing Matrix Dialog Box Definitions

| Field/Button       | Description  |
|--------------------|--|
| Name               | <p>A unique name identifying the global landing matrix configuration.</p> <ul style="list-style-type: none"> <li>• The name is not case-sensitive</li> <li>• Minimum number of characters: 1</li> <li>• Maximum number of characters: 100</li> </ul>               |
| Description        | <p>(Optional) A description for the global landing matrix configuration.</p> <ul style="list-style-type: none"> <li>• The description is not case-sensitive.</li> <li>• Minimum number of characters: None</li> <li>• Maximum number of characters: 500</li> </ul> |
| Save and Close     | Saves the configuration and closes the dialog box  |
| <b>General Tab</b> |  |
| Source Front       | The front side of the floor from where the passenger can enter the elevator  |
| Source Rear        | The rear side of the floor from where the passenger can enter the elevator   |
| Destination Front  | Front side of the elevator where the passenger travels   |
| Destination Rear   | Destination side of the elevator where the passenger travels   |

## KONE Global Landing Matrix Dialog Box Tasks

This section describes the following tasks:

- [Creating a Global Landing Matrix Configuration](#) on [Page 68](#)
- [Editing a Global Landing Matrix Configuration](#) on [Page 69](#)
- [Viewing Global Landing Matrix Configurations](#) on [Page 69](#)
- [Deleting a Global Landing Matrix Configuration](#) on [Page 69](#)
- [Creating a Global Landing Matrix Configuration Template](#) on [Page 69](#)

### Creating a Global Landing Matrix Configuration

#### To Create a Global Landing Matrix Configuration


1. Right-click on the **KONE Elevator System** folder in the Hardware tree and select **KONE Global Landing Matrix>New**. Alternately, you can select **KONE Global Landing Matrix** from the Hardware drop-down menu, and

then click on the **New** icon.

2. Enter a name for the global landing matrix in the **Name** field.
3. Enter a description (optional) for the global landing matrix in the **Description** field.
4. Click in the check-boxes next to the floors in the Source and Destination columns that you want to include in the global landing matrix configuration.


## Editing a Global Landing Matrix Configuration

### To Edit a Global Landing Matrix Configuration

1. Double-click on the **Global Landing Matrix** in the hardware tree. Alternately, you can select **KONE Global Landing Matrix** from the Hardware drop-down menu, and then click on the green right-arrow  to open a Dynamic View displaying all global landing matrix configurations.
2. Make the changes to the configuration.
3. Click **Save and Close**.

## Viewing Global Landing Matrix Configurations

### To View Global Landing Matrix Configurations

1. Select **KONE Global Landing Matrix** from the Hardware drop-down menu.
2. Click on the green right-arrow  to open a Dynamic View displaying all Global Landing Matrix configurations.

## Deleting a Global Landing Matrix Configuration

### To Delete a Global Landing Matrix Configuration

1. Right-click on the **Global Landing Matrix** that you want to delete and select **Delete** from the context menu. The Deleting KONE Global Landing Matrix objects dialog box opens.
2. Click **Yes** to confirm the deletion. The object is deleted.
3. Click **OK** to confirm that the object was deleted.

## Creating a Global Landing Matrix Configuration Template

### To Create a Global Landing Matrix Configuration Template

1. Right-click on the **KONE Elevator System** folder and select **KONE Global Landing Matrix>New Template**. (Alternately, you can right-click on the **KONE Global Landing Matix** icon and select **New Template**.)
2. Enter a name for the template in the **Name** field.
3. Enter a description (optional) in the **Description** field.
4. Click in the check-boxes next to the floors in the Source and Destination columns that you want to include in the global landing matrix configuration template.
5. Click **Save and Close** when done. The new template is listed under **KONE Global Landing Matrix>Templates**.

# KONE Default Landing Matrix Configuration

This chapter describes how to configure a default landing using the KONE Default Landing Matrix dialog box.

In this chapter

|  |    |
|--|----|
| Accessing the KONE Default Landing Matrix Dialog Box ..... | 71 |
| KONE Default Landing Matrix Dialog Box .....               | 72 |


## Accessing the KONE Default Landing Matrix Dialog Box

This section describes how to access the KONE Default Landing Matrix dialog box.

### To Access the Dialog Box

1. Open the C•CURE 9000 Administration Station.
2. Click on the **Hardware Pane**.
3. Click on the Hardware drop-down menu and select Hardware Folder.
4. Right-click on the **KONE Elevator System** folder and select **KONE Default Landing Matrix>New**, as shown in [Figure 28](#) on [Page 71](#). (Alternately, you can right-click on the **KONE Default Landing Matrix** icon and select **New**.)

**Figure 28:** Access the KONE Default Landing Matrix Dialog Box

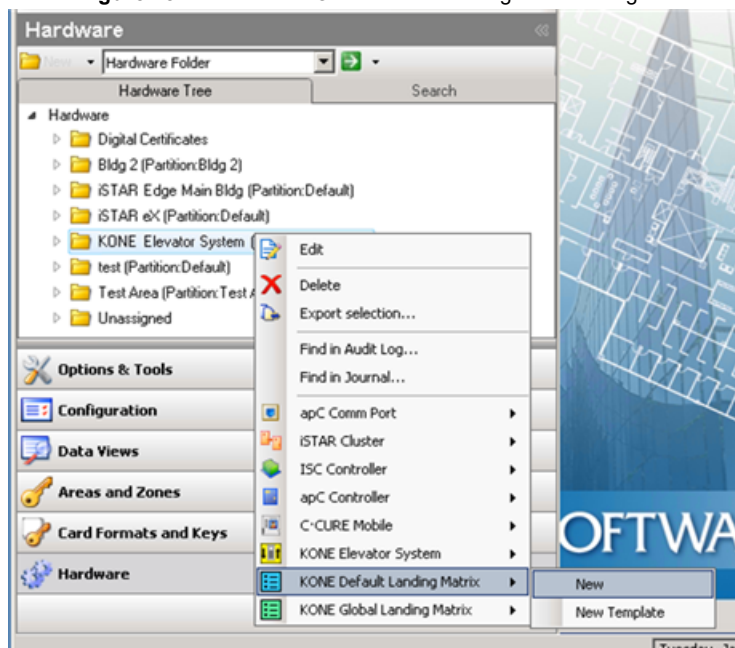

The KONE Default Landing Matrix dialog box, as shown in [Figure 29](#) on [Page 72](#), opens.

## KONE Default Landing Matrix Dialog Box

The KONE Default Landing Matrix dialog box, shown in [Figure 29](#) on [Page 72](#), is used to configure a common access Landing Matrix with no personnel clearances. User can configure up to 255 front and 255 rear doors.

For more information, see the following:

- [KONE Default Landing Matrix Dialog Box Definitions](#) on [Page 72](#)
- [KONE Default Landing Matrix Tasks](#) on [Page 73](#)

Figure 29: KONE Default Landing Matrix Dialog Box

| Floor | Front                    | Rear                     |
|-------|--------------------------|--------------------------|
| 1     | <input type="checkbox"/> | <input type="checkbox"/> |
| 2     | <input type="checkbox"/> | <input type="checkbox"/> |
| 3     | <input type="checkbox"/> | <input type="checkbox"/> |
| 4     | <input type="checkbox"/> | <input type="checkbox"/> |
| 5     | <input type="checkbox"/> | <input type="checkbox"/> |
| 6     | <input type="checkbox"/> | <input type="checkbox"/> |
| 7     | <input type="checkbox"/> | <input type="checkbox"/> |
| 8     | <input type="checkbox"/> | <input type="checkbox"/> |
| 9     | <input type="checkbox"/> | <input type="checkbox"/> |
| 10    | <input type="checkbox"/> | <input type="checkbox"/> |
| 11    | <input type="checkbox"/> | <input type="checkbox"/> |
| 12    | <input type="checkbox"/> | <input type="checkbox"/> |
| 13    | <input type="checkbox"/> | <input type="checkbox"/> |

### KONE Default Landing Matrix Dialog Box Definitions

The KONE Default Landing Matrix dialog box fields and buttons are described in [Table 16](#) on [Page 73](#).



**Table 16:** KONE Elevator System Default Landing Dialog Box Definitions

| Field/Button       | Description   |
|--------------------|---|
| Name               | A unique name identifying the default landing matrix configuration. <ul style="list-style-type: none"> <li>• The name is not case-sensitive</li> <li>• Minimum number of characters: 1</li> <li>• Maximum number of characters: 100</li> </ul>              |
| Description        | (Optional) A description for the default landing matrix configuration. <ul style="list-style-type: none"> <li>• The description is not case-sensitive</li> <li>• Minimum number of characters: None</li> <li>• Maximum number of characters: 500</li> </ul> |
| Save and Close     | Saves the configuration and closes the dialog box.  |
| <b>General Tab</b> |   |
| Landing Matrix     | Select the front and rear doors of the floors to be included in the configuration. <ul style="list-style-type: none"> <li>• Checked indicates selected</li> <li>• Unchecked indicates not selected</li> </ul>   |

## KONE Default Landing Matrix Tasks

This section describes the following tasks.

- [Creating a Default Landing Matrix](#) on [Page 73](#)
- [Editing a Default Landing Matrix Configuration](#) on [Page 74](#)
- [Viewing Default Landing Matrix Configurations](#) on [Page 74](#)
- [Creating a Default Landing Matrix Template](#) on [Page 74](#)
- [Deleting a Default Landing Matrix Configuration](#) on [Page 74](#)

## Creating a Default Landing Matrix

### To Create a Default Landing Matrix

1. Right-click on the **KONE Elevator System** folder in the Hardware tree and select **KONE Default Landing Matrix>New**. (Alternately, you can select **KONE Default Landing Matrix** from the Hardware drop-down menu, and then click on the **New** icon.
2. Enter a name for the default landing matrix in the **Name** field.
3. Enter a description (optional) for the default landing matrix in the **Description** field.
4. Click in the check-boxes next to the floors that you want to include in the default landing matrix. • F = Front • R = Rear

- Click **Save and Close** when done. The default landing matrix is listed under **KONE Default Landing Matrix** in the tree under the **KONE Elevator System** folder.

## Editing a Default Landing Matrix Configuration

### To Edit a Default Landing Matrix Configuration

- Click on the arrow located to the left of the **KONE Elevator System** folder.
- Click on the arrow located to the left of **KONE Default Landing Matrix** icon.
- Right-click on the **Default Landing Matrix** that you want to edit and select **Edit** from the context menu. (Alternately, you can double-click on the **KONE Default Landing Matrix** icon to open a Dynamic View displaying **KONE Default Landing Matrix** configurations. Then, either double-click on the **Default Landing Matrix** or right-click on the **Default Landing Matrix** that you want to edit to open the **KONE Default Landing Matrix** dialog box.) The **KONE Default Landing Matrix Dialog** box opens.
- Make your changes to the configuration.
- Click **Save and Close**.

## Viewing Default Landing Matrix Configurations

Default Landing Matrix configurations are viewed in the Dynamic View

### To View Default Landing Matrix Configurations

- Double-click on the **KONE Default Landing Matrix** icon under the **KONE Elevator System** folder. Default Landing Matrix configurations are displayed in the KONE Default Landing Matrix tab in the Dynamic View.

## Creating a Default Landing Matrix Template

### To Create a Default Landing Template

- Right-click on the **KONE Elevator System** folder and select **KONE Default Landing Matrix>New Template**. (Alternately, you can right-click on the **KONE Default Landing Matrix** icon and select **New Template**.)
- Enter a name for the template in the **Name** field.
- Enter a description (optional) in the **Description** field.
- Click in the check boxes next to the floors that you want to include in the Default Landing Matrix template.
  - F = Front
  - R = Rear
- Click **Save and Close** when done. The new template is listed under **KONE Default Landing Matrix>Templates**.

## Deleting a Default Landing Matrix Configuration

### NOTE

You cannot delete a Default Landing Matrix if there are DOP configurations associated with the Default Landing Matrix. You must delete the DOP configurations before you can delete the Default Landing Matrix.

---

### To Delete a Default Landing Matrix Configuration

1. Click on the arrow located to the left of the KONE Elevator System folder.
2. Click on the arrow located to the left of the **KONE Default Landing Matrix**.
3. Right-click on the **Default Landing Matrix** that you want to delete and select **Delete**. (Alternately, you can right-click on a **Default Landing Matrix** configuration in the Dynamic View and select **Delete**.) The Deleting KONE Default Landing Matrix objects dialog box opens.
4. Click **Yes** to confirm the deletion. The object is deleted.
5. Click **OK** to confirm that the object was deleted.

## KONE Landing Configuration

This chapter describes how to configure a landing using the KONE Landing dialog box.

In this chapter:

- Accessing the KONE Landing Dialog Box ..... 77
- KONE Landing Dialog Box ..... 78
- Landing Dialog Box - Override Tab ..... 82
- Landing Dialog Box - State Images Tab ..... 83
- KONE Landing Manual Actions ..... 85

## Accessing the KONE Landing Dialog Box


The KONE Landing dialog box is used to identify a Landing index to be used by the Elevator System.

**NOTE** The KONE Elevator System must be configured before you can access this dialog box. See [Chapter 3: KONE Elevator System Configuration](#) for more information.

### To Access the KONE Landing Dialog Box

1. Right-click on the **Elevator System** icon under the **KONE Elevator System** folder in the Hardware tree, and select **KONE Landing>New**, as shown in [Figure 30](#) on [Page 77](#).

**Figure 30:** Access the KONE Landing Dialog Box

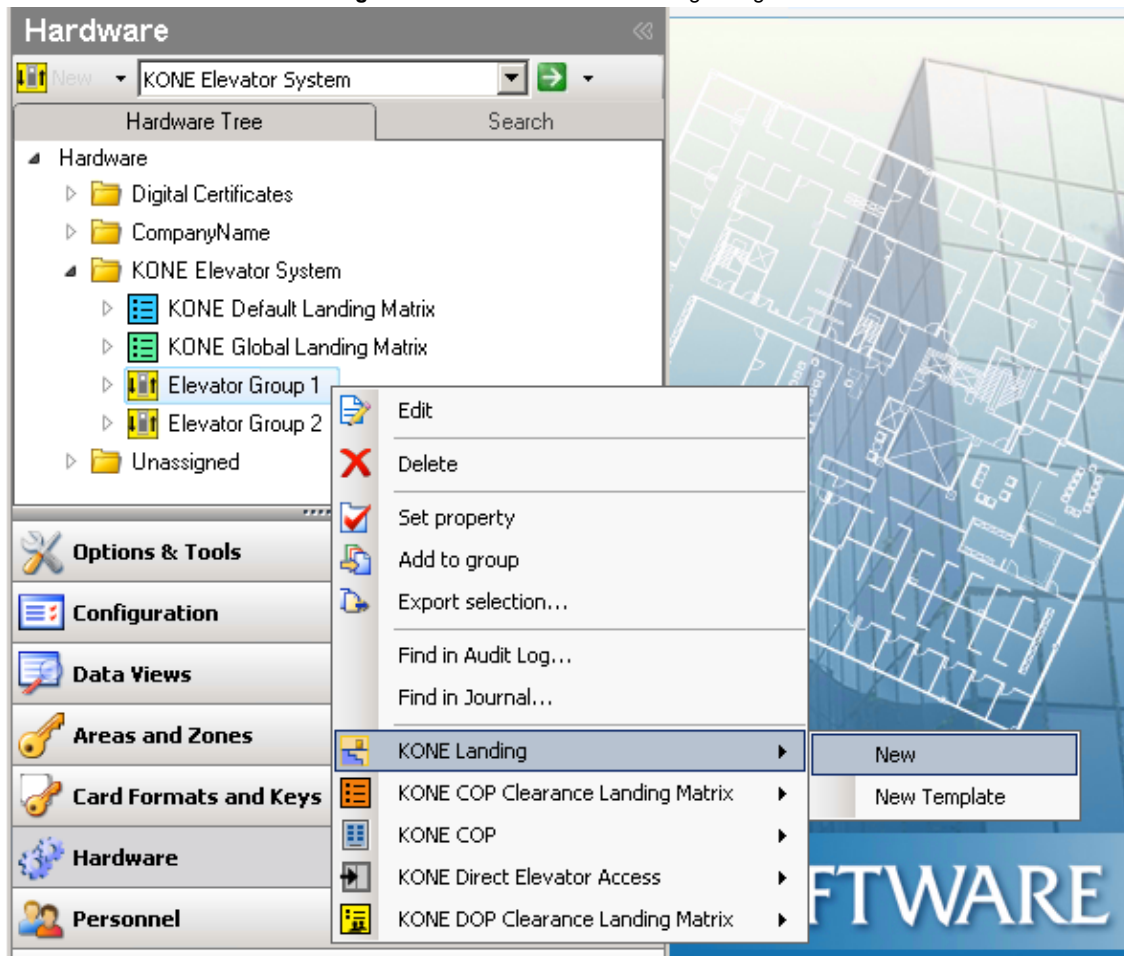


The KONE Landing dialog box, shown in [Figure 31](#) on [Page 78](#), opens.

## KONE Landing Dialog Box

The KONE Landing dialog box, shown in [Figure 31](#) on [Page 78](#), lets you create a landing to be used by the Elevator System.

For more information, see the following:

- [KONE Landing Dialog Box Definitions](#) on [Page 78](#)
- [KONE Landing Dialog Box Tasks](#) on [Page 79](#)

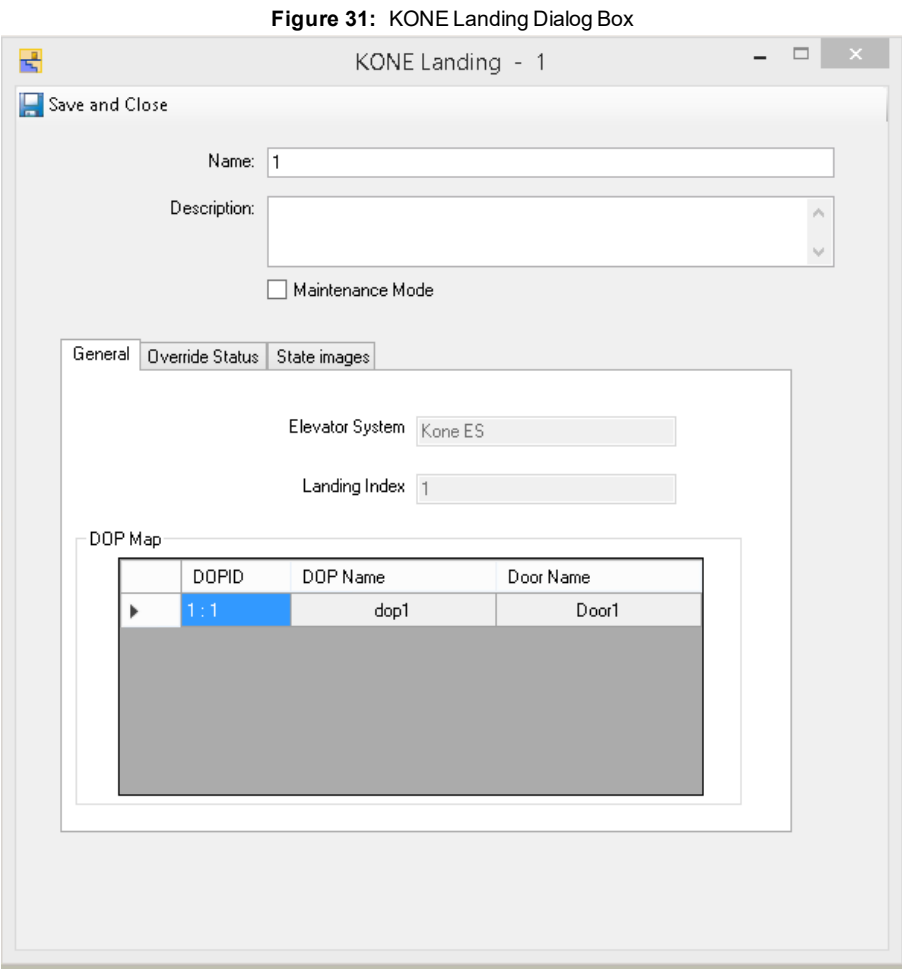

### KONE Landing Dialog Box Definitions

[Table 17](#) on [Page 79](#) describes the KONE Landing dialog box fields and buttons.

**Table 17:** KONE Elevator System Landing Dialog Box Definitions

| Field/Button               | Description  |
|----------------------------|--|
| Name                       | <p>The Landing Index value you enter appears in the Name field.</p> <ul style="list-style-type: none"> <li>• The name is not case-sensitive</li> <li>• Minimum number of characters: 1</li> <li>• Maximum number of characters: 100</li> </ul>   |
| Description                | <p>Optional. Enter a description for the landing.</p> <ul style="list-style-type: none"> <li>• The description is not case-sensitive.</li> <li>• Minimum number of characters: None</li> <li>• Maximum number of characters: 500</li> </ul>  |
| Maintenance Mode           | Select the Maintenance mode check box to limit information about the object, that is displayed on the Monitoring Station. Maintenance Mode only affects the information reported at the Monitoring Station. For more information see, <a href="#">Maintenance Mode</a> on <a href="#">Page 64</a> .  |
| Save and Close             | Saves the configuration and closes the dialog box  |
| <b>General Tab</b>         |  |
| Elevator System            | The name of the KONE Elevator System. This field is read-only.   |
| Landing Index              | Enter a numeric value of 1 to 255 to identify the Landing.   |
| DOP Map                    | <p>NOTE: The following read-only information is not available until the DOP Configuration and the Landing Matrix Configurations are complete.</p> <ul style="list-style-type: none"> <li>• DOPID – The unique identifier for the DOP, which contains the DOP ID and the Landing number.</li> <li>• DOP Name – The name of the configured DOP.</li> <li>• Door Name – The name of the assigned door.</li> </ul> |
| <b>Override Status Tab</b> |  |
| Override Status            | Displays the override details of the floor object. This field is read-only.  |

## KONE Landing Dialog Box Tasks

This section describes the following tasks:

- [Creating a Landing Configuration](#) on [Page 80](#)
- [Editing a Landing Configuration](#) on [Page 80](#)
- [Viewing Landing Configurations](#) on [Page 80](#)
- [Deleting a Landing Configuration](#) on [Page 80](#)

## Creating a Landing Configuration

### To Create a Landing Configuration

1. Click **Save and Close**.
2. Enter a description (optional) in the **Description** field for the Landing Index.
3. Enter a name for the landing in the **Name** field.
4. Enter a numeric value of 1 to 255 to uniquely identify the landing in the Landing Index field.
5. Right-click on the **Elevator System** in the tree and select **KONE Landing>New**.


## Editing a Landing Configuration

### To Edit a Landing Configuration

1. Double-click on the **Landing** configuration in the tree that you want to edit. (Alternately, you can right-click on the **Landing** configuration in the tree and select **Edit** from the context menu.)
2. Make the changes to the configuration.
3. Click **Save and Close**.

## Viewing Landing Configurations

### To View Landing Configurations


1. Select **KONE Landing** from the **Hardware** drop-down menu.
2. Click on the green right arrow  to open a Dynamic View displaying all Landings.
3. The KONE Landing tab opens in the Dynamic View displaying a list of KONE Landing configurations.

## Deleting a Landing Configuration

### NOTE

You cannot delete a landing if there are DOP configurations associated with the landing. You must delete the DOP configurations before you can delete the landing.

### To Delete a Landing Configuration

1. Right-click on the **Landing** configuration that you want to delete and select **Delete** from the context menu. (Alternately, you can select **KONE Landing** from the Hardware drop-down menu and click on the green right arrow  to open a Dynamic View displaying all Landings.)
2. The **Deleting KONE Landing** objects dialog box opens.



3. Click **Yes** to confirm the deletion. The object is deleted.
4. Click **OK** to confirm that the object was deleted.

## KONE Landing Dialog Box Tabs

The following sections provide information about the KONE Landing dialog box tabs:

- [Landing Dialog Box - Override Tab](#) on [Page 82](#)
- [Landing Dialog Box - State Images Tab](#) on [Page 83](#)

## Landing Dialog Box - Override Tab

The Override tab, shown in [Figure 32](#) on [Page 82](#), provides read-only information about override status of the landing for which manual action is performed. For a landing, the Override Status can be, Secure, Unsecure or Normal.

**Figure 32:** Landing Dialog Box - Override Tab

The screenshot shows a window titled "KONE Landing - 1". Inside the window, there is a "Save and Close" button at the top left. Below it, there are two text input fields: "Name:" with the value "1" and "Description:" which is empty. Below these fields is a checkbox labeled "Maintenance Mode" which is unchecked. At the bottom, there are three tabs: "General", "Override Status", and "State images". The "Override Status" tab is selected, showing a read-only field for "Override Status" with the value "Normal".


## Landing Dialog Box - State Images Tab

The State Images tab, shown in [Figure 33](#) on [Page 83](#), displays the current elevator system images that display in the Monitoring Station to represent the manual action activities concerning the elevator system. You can select other images to display for this elevator system and return back to the default images, as described in this section.

For information about manual actions, see [KONE Landing Manual Actions](#) on [Page 85](#).

See [State Images Tab Tasks](#) on [Page 83](#) for information about changing the state images.

**Figure 33:** Landing Dialog Box - State Images Tab

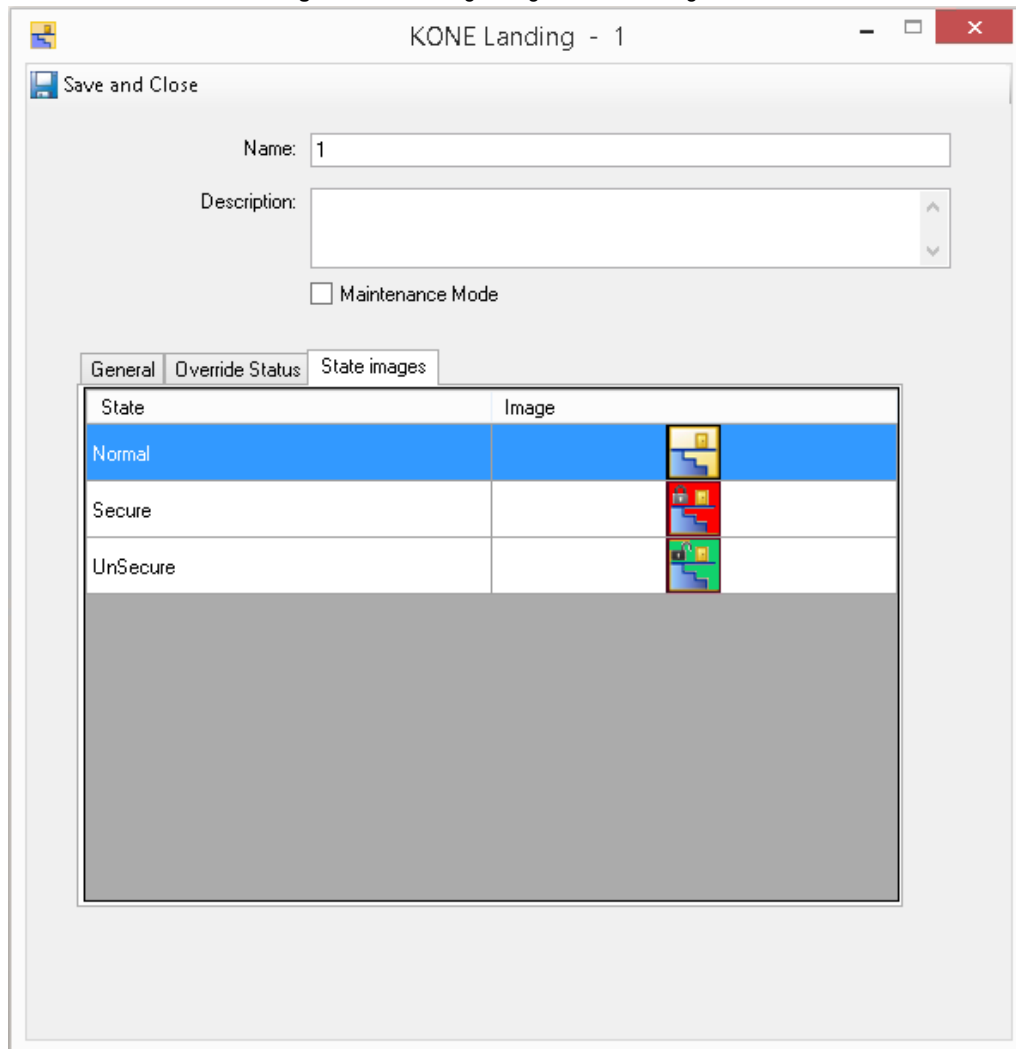

### State Images Tab Tasks

The following tasks are performed in the State Images tab:

- [Replace a State Image](#) on [Page 84](#)
- [Restore the Default State Image](#) on [Page 84](#)

## Replace a State Image

---

### To Replace an Image

1. Double-click the default image in the tab to open a Windows file selection dialog box.
2. If necessary, navigate to find the new image.
3. Select the desired replacement image and click **Open**. The new image replaces the default image and displays in the State Images tab.

## Restore the Default State Image

---

### To Restore the Default Image

- Right-click on the image in the State Images tab and select **Restore Default**.

## KONE Landing Manual Actions

A Manual Action is a specific type of action that the operator can perform on objects in the system. Manual Actions are those actions that open a Manual Action dialog box, and the actions are also logged in the Activity Viewer as “Manual Event by Operator Name,” along with the Name of the action, Name of the Event, Partition, date and time. Completed Manual actions are logged in the Activity Viewer.

KONE Landing Manual Actions are **Secure Landing** and **Un-secure Landing**.

For more information, see the following:

- [Accessing KONE Landing Manual Actions](#) on [Page 85](#)
- [Using Manual Actions to Secure a Landing](#) on [Page 86](#)
- [Using Manual Actions to Un-Secure a Landing](#) on [Page 87](#)
- [Cancelling Manual Actions](#) on [Page 145](#)

For information about configuring KONE events and actions, see [KONE Events](#) on [Page 139](#).

### Accessing KONE Landing Manual Actions


#### NOTE

The Landing (KONE Landing Dialog Box on [Page 99](#)) must be configured before you can secure or un-secure a landing.

#### To Access the KONE Landing Manual Actions

1. Click on the KONE Elevator System folder in the Hardware tree.
2. Right-click on the KONE Landing that you want to perform the Manual Action.
3. The Manual Action selections are Secure Landing and Un-Secure Landing as shown in [Figure 34](#) on [Page 86](#).

Figure 34: Accessing the KONE Landing Manual Actions

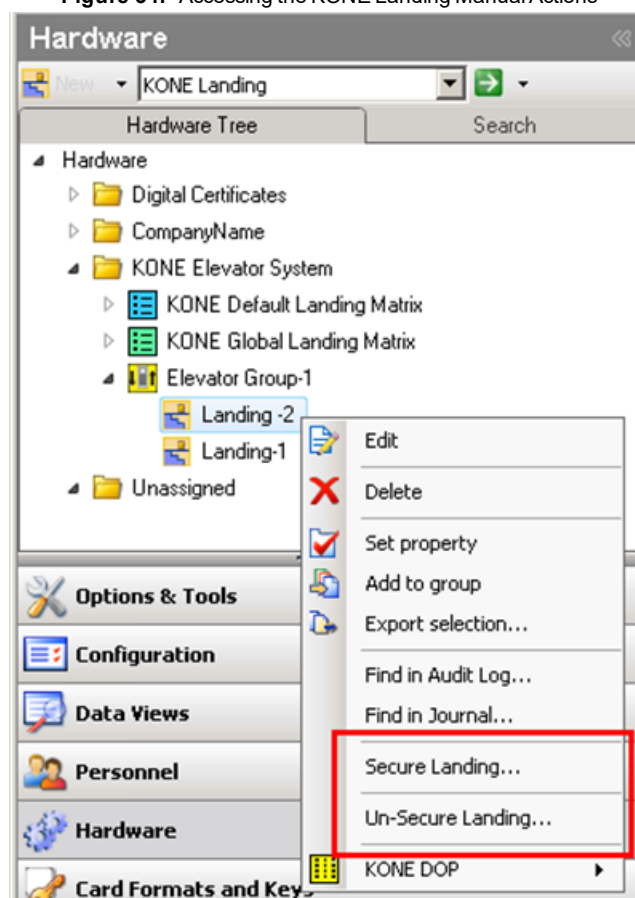

## Using Manual Actions to Secure a Landing

This action secures the Landing. There is no access to the Landing during the date and time value set except the personnel in the Exemption Group list. When a Landing is secured the associated floor of the Default Landing Matrix gets locked.



### To Secure a Landing

1. Right-click on the Landing configuration that you want to secure and select **Secure Landing** from the context menu. The Secure Landing dialog box opens.

Figure 35: KONE Secure Landing Dialog Box

The dialog box is titled "Secure Landing - Landing -2". It features a "Save and Close" button in the top-left corner. The main area contains the following fields:

- Start:** A date/time picker showing "05/23/2013 03:53 PM".
- End:** A date/time picker showing "05/23/2013 04:53 PM".
- Priority:** A spinner control with the value "75".
- Time Zone:** A dropdown menu with a "..." button to the right.
- Instructions:** A large, empty text area for entering notes.

2. Enter the time and date to secure the Landing in the **Start** field, or click  to use the calendar controls to set the date.
3. Enter the time and date to un-secure the Landing in the **End** field, or click  to use the calendar controls to set the date.
4. Select the **Priority**. This field indicates the priority level the system uses for sorting when displaying on the Monitoring Station and prioritizing actions associated with the event. The default priority is 75, Medium Low. Select a value from the drop-down list or type an integer from 0 to 200 to assign a priority to the Event. The lowest value is 0; the highest is 200.
5. Select the **Time Zone** for the secure and un-secure times.
6. Enter a note for future reference in the **Instructions** field.



## Using Manual Actions to Un-Secure a Landing

This action un-secures the Landing. Everyone will have access to the Landing during the date and time value set. When a Landing is unsecured, the Default Landing Matrix is also un-secured.

### To Un-Secure a Landing

1. Right-click on the Landing configuration that you want to un-secure and select Un-Secure Landing from the context menu. The Un-Secure Landing dialog box opens.

**Figure 36:** KONE Un-Secure Landing Dialog Box

2. Enter the time and date to un-secure the Landing in the **Start** field, or click  to use the calendar controls to set the date.
3. Enter the time and date to end the un-secure Landing in the **End** field, or click  to use the calendar controls to set the date.
4. Select the **Priority**. This field indicates the priority level the system uses for sorting when displaying on the Monitoring Station and prioritizing actions associated with the event. The default priority is 75, Medium Low. Select a value from the drop-down list or type an integer from 0 to 200 to assign a priority to the Event. The lowest value is 0; the highest is 200.
5. Select the **Time Zone** for the secure and un-secure times.
6. Enter a note for future reference in the **Instructions** field.

**NOTE**

Whenever the manual action (secure landing or un-secure landing) is triggered and in between KONE Elevator System integration restarts, the floor normal message is displayed first on the Monitoring station and then manual action (secure landing or un-secure landing) message is displayed.

**NOTE**

Manual Action which is triggered last will be processed irrespective of the Priority set.



## KONE COP Clearance Landing Matrix Configuration

This chapter describes to configure clearances using the KONE COP Clearance Landing Matrix dialog box.

In this chapter

|  |    |
|--|----|
| Accessing the KONE COP Clearance Landing Matrix Dialog ..... | 90 |
| KONE COP Clearance Landing Matrix Dialog Box .....           | 91 |


## Accessing the KONE COP Clearance Landing Matrix Dialog

This section describes how to access the KONE COP Clearance Landing Matrix dialog box.

### To Access the Dialog Box

1. Right-click on the Elevator System icon under the KONE Elevator System folder and select **KONE Clearance Landing Matrix>New**, as shown in [Figure 37](#) on [Page 90](#).

**Figure 37:** Access the KONE COP Clearance Landing Matrix Dialog Box

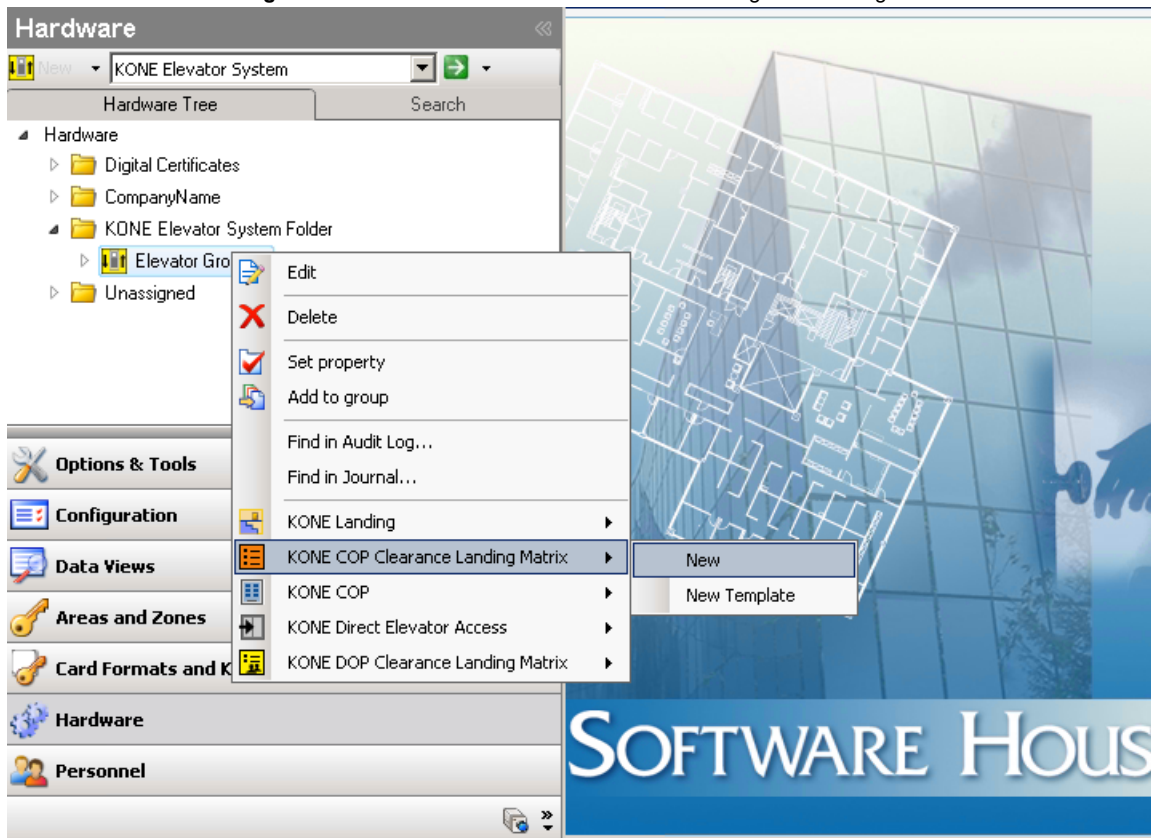

The KONE Clearance Landing Matrix dialog box, as shown in [Figure 38](#) on [Page 92](#), opens.

## KONE COP Clearance Landing Matrix Dialog Box

The KONE COP Clearance Landing Matrix dialog box, shown in [Figure 38](#) on [Page 92](#), is used to define up to 255 front and 255 rear doors that can be accessed by cardholders that have a clearance associated with the landing matrix.

For more information, see the following:

- [Accessing the KONE COP Clearance Landing Matrix Dialog](#) on [Page 90](#)
- [KONE COP Clearance Landing Matrix Dialog Box Definitions](#) on [Page 92](#)
- [KONE DOP Clearance Landing Matrix Dialog Box Tasks](#) on [Page 133](#)

Figure 38: KONE COP Clearance Landing Matrix Dialog Box

KONE COP Clearance Landing Matrix -

Save and Close

Name:

Description:

Description of COP Clearance Landing Matrix.

General

Elevator System

KOneES

Clearance Name

...

Landing Matrix

|   | Floor | Front                    | Rear                     |
|---|-------|--------------------------|--------------------------|
| ▶ | 1     | <input type="checkbox"/> | <input type="checkbox"/> |
|   | 2     | <input type="checkbox"/> | <input type="checkbox"/> |
|   | 3     | <input type="checkbox"/> | <input type="checkbox"/> |
|   | 4     | <input type="checkbox"/> | <input type="checkbox"/> |
|   | 5     | <input type="checkbox"/> | <input type="checkbox"/> |
|   | 6     | <input type="checkbox"/> | <input type="checkbox"/> |
|   | 7     | <input type="checkbox"/> | <input type="checkbox"/> |
|   | 8     | <input type="checkbox"/> | <input type="checkbox"/> |
|   | 9     | <input type="checkbox"/> | <input type="checkbox"/> |

KONE COP Clearance Landing Matrix Dialog Box Definitions

Table 18 on Page 93 describes the KONE COP Clearance Landing Matrix dialog box fields and buttons.

**Table 18:** KONE COP Clearance Landing Dialog Box Definitions

| Field/Button       | Description   |
|--------------------|---|
| Name               | <p>The name of the COP Clearance Landing Matrix</p> <ul style="list-style-type: none"> <li>• The name is not case-sensitive</li> <li>• Minimum number of characters: 1</li> <li>• Maximum number of characters: 100</li> </ul>                                  |
| Description        | <p>(Optional) Enter a description for the COP Clearance Landing Matrix</p> <ul style="list-style-type: none"> <li>• The description is not case-sensitive</li> <li>• Minimum number of characters: None</li> <li>• Maximum number of characters: 500</li> </ul> |
| Save and Close     | Saves the configuration and closes the dialog box.  |
| <b>General Tab</b> |   |
| Elevator System    | The name of the KONE Elevator System. This field is read-only.  |
| Clearance Name     | The pre-configured personnel clearance. This field is used to select the clearance that allows access to the Door with a reader that a person swipes their card to get authorization to use the landing.  |
| Landing Matrix     | Contains the selection of up to 255 front (F) and 255 rear (R) floors for the clearance landing matrix.   |

# KONE COP Configuration

This chapter describes to configure the COP (Car Operational Panel) using the KONE COP dialog box.

In this chapter:

|                                    |     |
|------------------------------------|-----|
| Accessing the COP Dialog Box ..... | 95  |
| KONE COP Dialog Box .....          | 96  |
| COP - Schedule Matrix Tab .....    | 101 |
| COP Front Reader Tab .....         | 103 |
| COP Rear Reader Tab .....          | 105 |

## Accessing the COP Dialog Box

This section explains how to access the KONE COP dialog box.


### NOTE

The KONE Elevator System must be configured before you can access this dialog box. See [Chapter 3: KONE Elevator System Configuration](#) for more information.

### To Access the COP Dialog Box

1. Right-click on the elevator system icon under the KONE Elevator System folder in the Hardware tree, and select **KONE COP>New**, as shown in [Figure 39](#) on [Page 95](#).

**Figure 39:** Access the COP Dialog Box

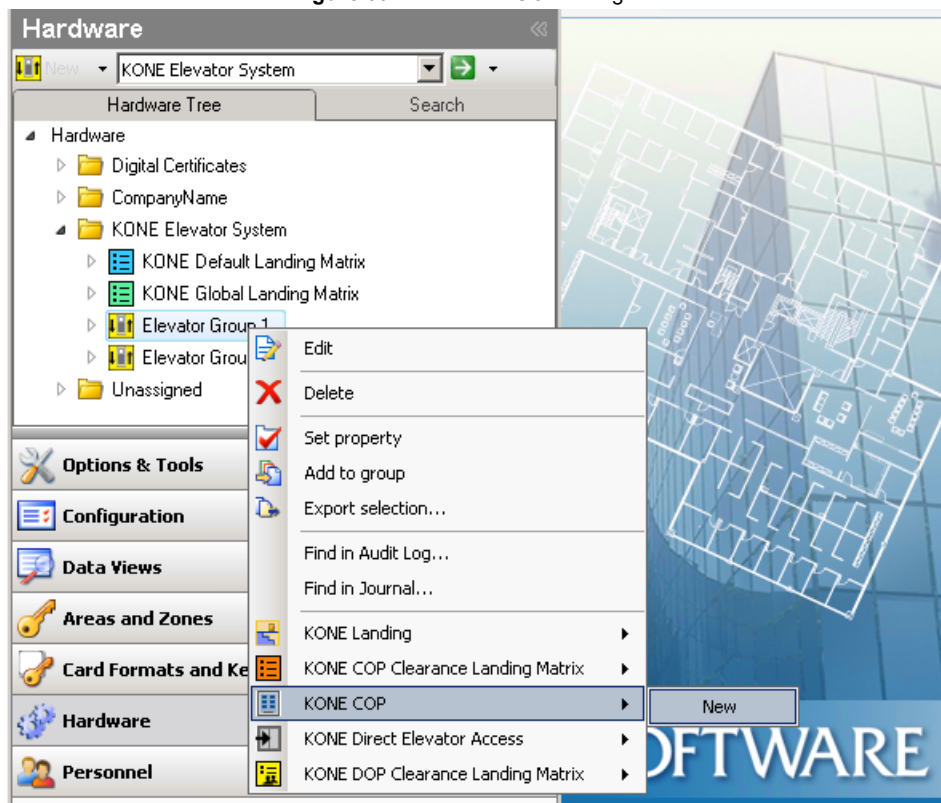

The KONE COP dialog box, shown in [Figure 40](#) on [Page 97](#) opens.

## KONE COP Dialog Box

The KONE COP dialog box, shown in [Figure 40](#) on [Page 97](#), is used to control door operations for each floor inside the elevator.


### NOTE

The KONE Elevator System ( [KONE Elevator System Editor Dialog Box](#) on [Page 44](#)), KONE Default Landing Matrix ([KONE Default Landing Matrix Dialog Box](#) on [Page 72](#)) and the KONE Landing ([KONE Landing Dialog Box](#) on [Page 78](#)) must be configured before you can configure the COP.

For more information, see the following:

- [Accessing the COP Dialog Box](#) on [Page 95](#)
- [COP Dialog Box Definitions](#) on [Page 97](#)
- [KONE COP Dialog Box Tasks](#) on [Page 98](#)



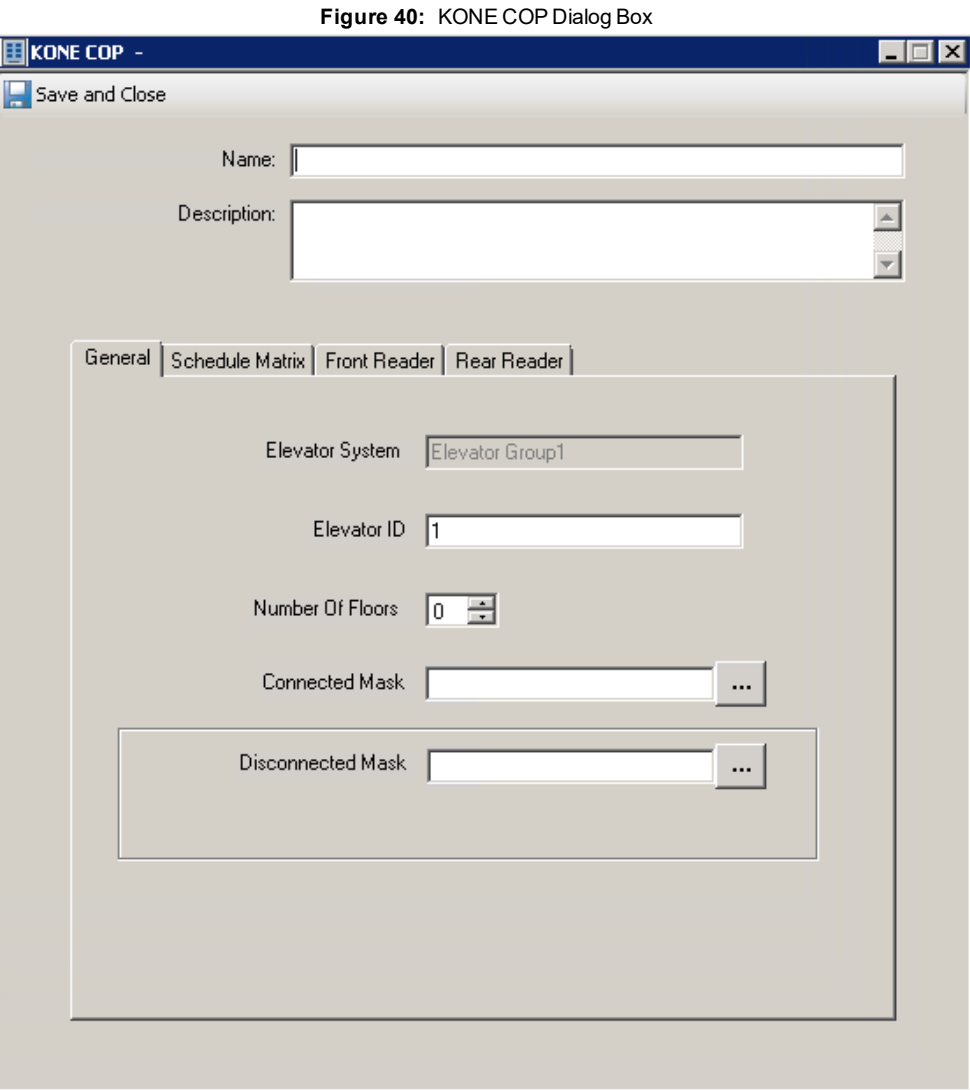



**COP Dialog Box Definitions**

Table 19 on Page 97 describes the KONE COP dialog box- General tab fields and buttons.

**Table 19:** KONE COP Dialog Box - General Tab Definitions

| Field/Button | Description   |
|--------------|---|
| Name         | <div>A unique name identifying the COP configuration.<ul style="list-style-type: none"><li>The name is not case-sensitive</li><li>Minimum number of characters: 1</li><li>Maximum number of characters: 100</li></ul></div> |

| Field/Button       | Description  |
|--------------------|--|
| Description        | Optional. A description for the COP configuration. <ul style="list-style-type: none"> <li>The description is not case-sensitive</li> <li>Minimum number of characters: None</li> <li>Maximum number of characters: 500</li> </ul>  |
| Save and Close     | Saves the configuration and closes the dialog box.   |
| <b>General Tab</b> |  |
| Elevator System    | The name of the KONE Elevator System. This field is read-only.   |
| Elevator ID        | ID of the Elevator (CAR). Enter the numeric value between 1 and 255.   |
| Number Of Floors   | The number of floors required while sending the Landing Matrix to the KONE Group configuration.  |
| Connected Mask     | The Connected Mask is used when the connection between the C•CURE 9000 and the KONE Elevator System is active. The KONE Elevator System automatically loads the selected pre-configured KONE Default Landing Matrix to specific COP's in the elevator system. Click on the selection button  to select a pre-configured KONE Default Landing Matrix.            |
| Disconnected Mask  | The Disconnected Mask is used when the connection between the C•CURE 9000 and the KONE Elevator System is disconnected. The KONE Elevator System automatically loads the selected pre-configured KONE Default Landing Matrix to specific COP's in the elevator system. Click on the selection button  to select a pre-configured KONE Default Landing Matrix. |

## KONE COP Dialog Box Tasks



This section describes the following tasks:

- [Configuring a COP](#) on [Page 98](#)
- [Editing a COP Configuration](#) on [Page 99](#)
- [Viewing All COP Configurations](#) on [Page 99](#)
- [Deleting a COP Configuration](#) on [Page 99](#)

## Configuring a COP

### To Configure a COP

1. Right-click on the elevator system icon under the KONE Elevator System folder in the Hardware tree and select **KONE COP>New**. The KONE COP dialog box opens.
2. Enter a name, of up to 100 characters, for the COP in the **Name** field.
3. Enter a description (optional), of up to 500 characters, in the **Description** field.

4. Enter a numeric value between 1 to 255 in the **Elevator ID** field.
5. Select the value for the **Number Of Floors**.
6. (Optional) Click on the selection button  located to the right of the **Connected Mask** field to open a selection box listing pre-configured KONE Default Landing Matrix configurations. Click on a **KONE Default Landing Matrix** configuration to select it.
7. (Optional) Click on the selection button  located to the right of the **Disconnected Mask** field to open a selection box listing pre-configured KONE Default Landing Matrix configurations. Click on a **KONE Default Landing Matrix** configuration to select it.
8. Click **Save and Close** to save the configuration.


## Editing a COP Configuration

### To Edit a COP Configuration

1. Double-click on the COP configuration in the tree that you want to edit. Alternately, you can right-click on the COP configuration in the tree and select **Edit** from the context menu.
2. Make the changes to the configuration.
3. Click **Save and Close**.

## Viewing All COP Configurations

### To View All COP Configurations

1. Click on the **Hardware** drop-down menu and select **KONE COP**.
2. Click on the green right arrow  located to the right of the **Hardware** drop-down menu. The KONE COP tab opens in the Dynamic View displaying a list of KONE COP configurations.

## Deleting a COP Configuration

### To Delete a COP Configuration

1. Right-click on the COP configuration that you want to delete and select **Delete** from the context menu. The Deleting KONE COP objects dialog box opens.
2. Click **Yes** to confirm the deletion. The object is deleted.
3. Click **OK** to confirm that the object was deleted.

## KONE COP Dialog Box Tabs

The following sections provide information about the KONE COP Dialog Box Tabs:

- [COP - Schedule Matrix Tab](#) on [Page 101](#)
- [COP Front Reader Tab](#) on [Page 103](#)


- [COP Rear Reader Tab](#) on [Page 105](#)

# COP - Schedule Matrix Tab

The KONE COP dialog box - Schedule Matrix tab, shown in [Figure 41](#) on [Page 101](#), is used to assign a pre-configured schedule to a pre-configured default landing matrix configuration.

For more information, see the following:

- [Schedule Matrix Tab Definitions](#) on [Page 101](#)
- [Schedule Matrix Tab Tasks](#) on [Page 102](#)

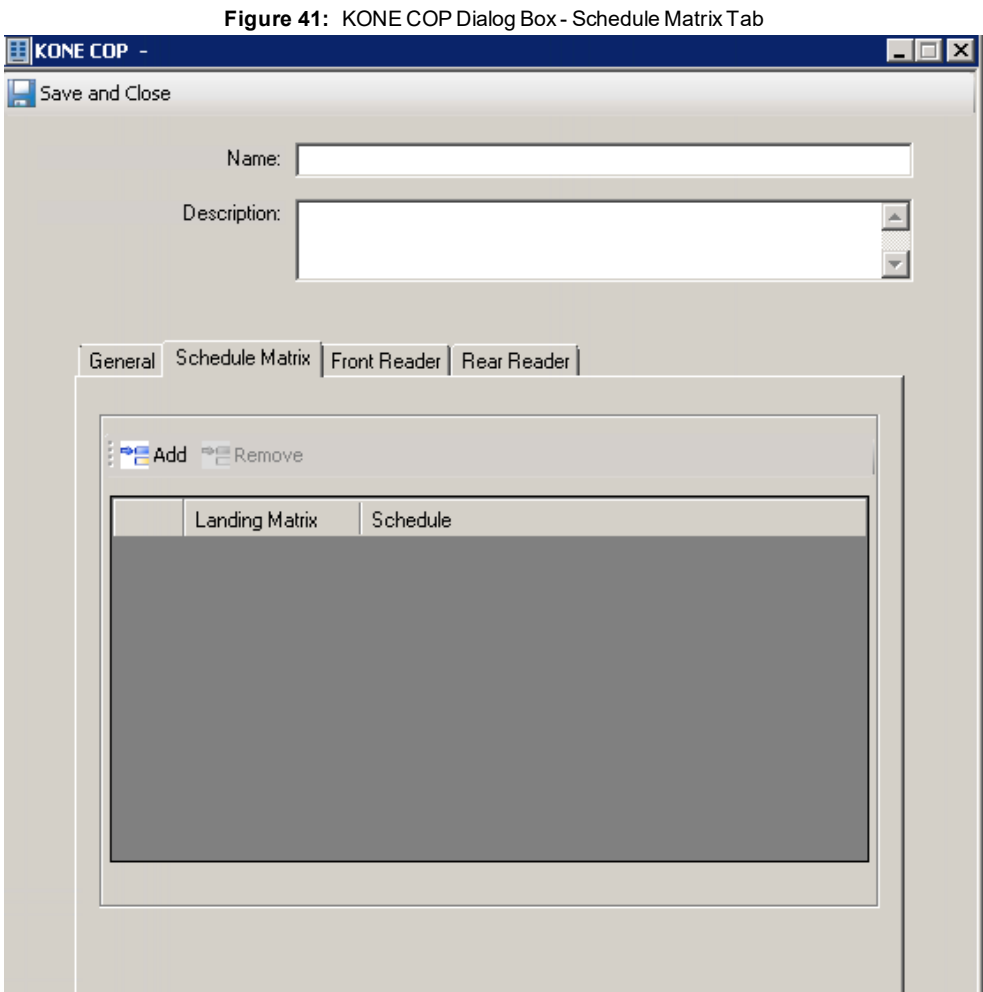

## Schedule Matrix Tab Definitions

[Table 20](#) on [Page 102](#) describes the Schedule Matrix tab fields and buttons.

**Table 20:** KONE COP Dialog Box - Schedule Matrix Tab Definitions

| Field/Button   | Description  |
|----------------|--|
| Add            | Adds an empty row to the table for selection of a default landing matrix configuration and to select a schedule to assign to it.                                       |
| Remove         | Removes and deletes the selected default landing matrix configuration and the assigned schedule from the table.  |
| Landing Matrix | The default landing matrix configuration selected.   |
| Schedule       | The schedule selected for the default landing matrix configuration. See the C•CURE 9000 Software Configuration Guide for more information about configuring schedules. |

## Schedule Matrix Tab Tasks

This section includes the following tasks:



- [Configuring a KONE Landing Schedule Matrix](#) on [Page 102](#)
- [Deleting a KONE Landing Schedule Matrix](#) on [Page 102](#)

### Configuring a KONE Landing Schedule Matrix

#### NOTE

Only seven Landing Schedule Matrix's are supported for a COP.

#### To Configure a KONE Landing Schedule Matrix

1. Click on the **Schedule Matrix** tab.
2. Click on the **Add** button.
3. Click on the selection button  in the empty row under **Landing Matrix** to open the KONE Default Landing Matrix selection box.
4. Click on a default landing matrix configuration to select it. The selection appears under Landing Matrix.
5. Click in blank field under Schedule, and then click on the selection button . The Schedule selection box opens.
6. Click on a Schedule to select it. The selection appears under Schedule.
7. Click **Save and Close**.

### Deleting a KONE Landing Schedule Matrix

#### To Delete a KONE Landing Schedule Matrix

1. Click in the row containing the default landing matrix schedule you want to delete.
2. Click the **Remove** button.


## COP Front Reader Tab

The KONE COP dialog box - Front Reader tab, shown in [Figure 42](#) on [Page 103](#), is used to assign a pre-configured iSTAR door to the front reader.

For more information, see the following:

- [Front Reader Tab Definitions](#) on [Page 103](#)
- [Front Reader Tab Tasks](#) on [Page 104](#)


**Figure 42:** KONE COP Dialog Box - Front Reader Tab

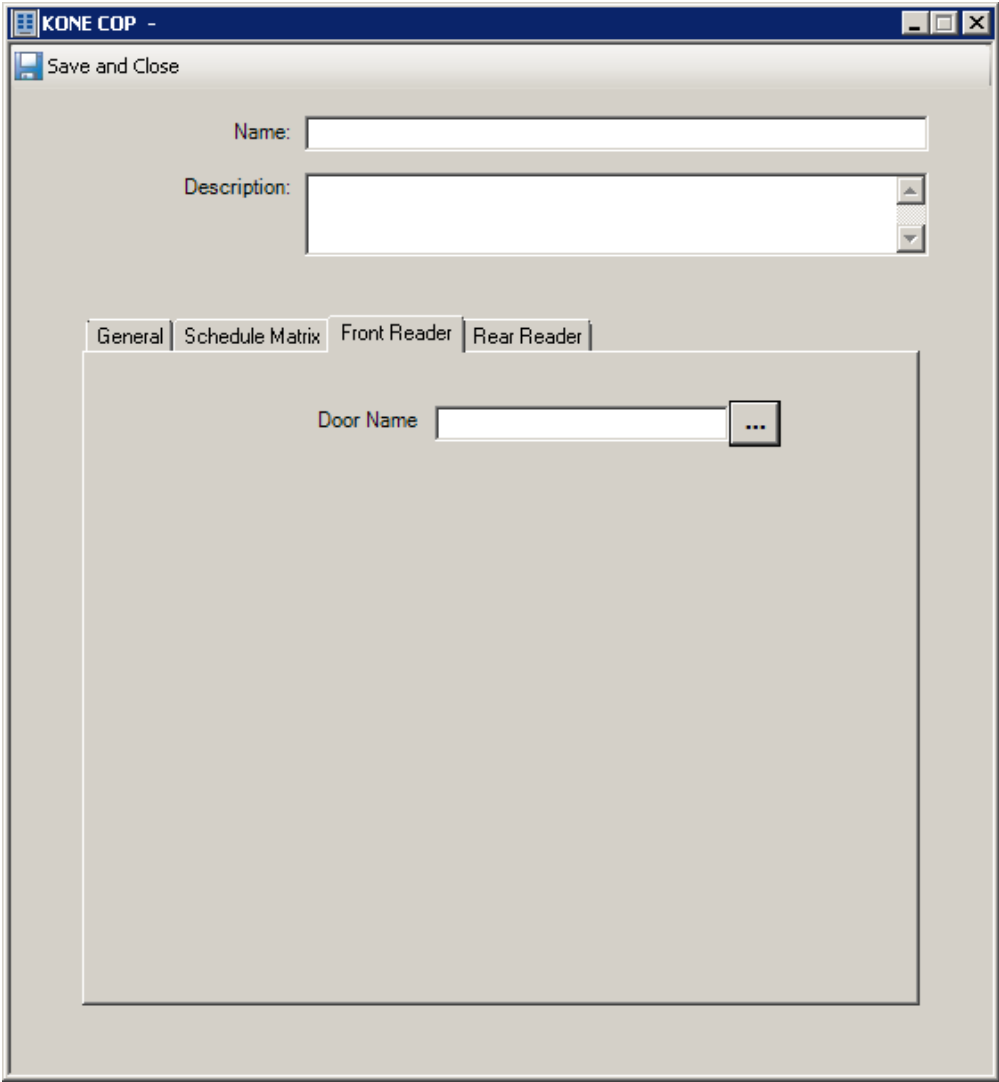

### Front Reader Tab Definitions

[Table 21](#) on [Page 104](#) describes the Front Reader tab field.

**Table 21:** KONE COP Dialog Box - Front Reader Tab Definitions

| Field | Description  |
|-------|--|
| Door  | Click on the selection button  . The iSTAR Doors selection box opens with a list of pre-configured doors. |


**Front Reader Tab Tasks**

This section includes the following tasks:

- [Selecting an iSTAR Door for the Front Reader](#) on [Page 104](#)
- Changing the iSTAR Door Selection for the Front Reader on [Page 126](#)


**Selecting an iSTAR Door for the Front Reader**

**To Select an iSTAR Door for the Front Reader**

1. Click on the **Front Reader** Tab.
2. Click on the Door Name selection button . The iSTAR Door selection box opens with a list a pre-configured iSTAR Doors.
3. Click on a pre-configured iSTAR door to select it. The selection appears in the Door Name field.
4. Click **Save and Close** to save the configuration.

**Changing the iSTAR Door Selection for the Front Reader**

**To Change the iSTAR Door Selection for the Front Reader**

1. Click on the Front Reader Tab.
2. Click on the Door Name selection button . The iSTAR Door selection box opens with a list a pre-configured iSTAR Doors.
3. Click on a pre-configured iSTAR door to select it. The new selection appears in the Door Name field.
4. Click **Save and Close** to save the configuration.




## COP Rear Reader Tab

The KONE COP dialog box - Rear Reader tab, shown in [Figure 43](#) on [Page 105](#), is used to assign a pre-configured iSTAR door to the rear reader.

For more information, see the following:


- [Rear Reader Tab Definitions](#) on [Page 105](#)
- [Rear Reader Tab Tasks](#) on [Page 106](#)

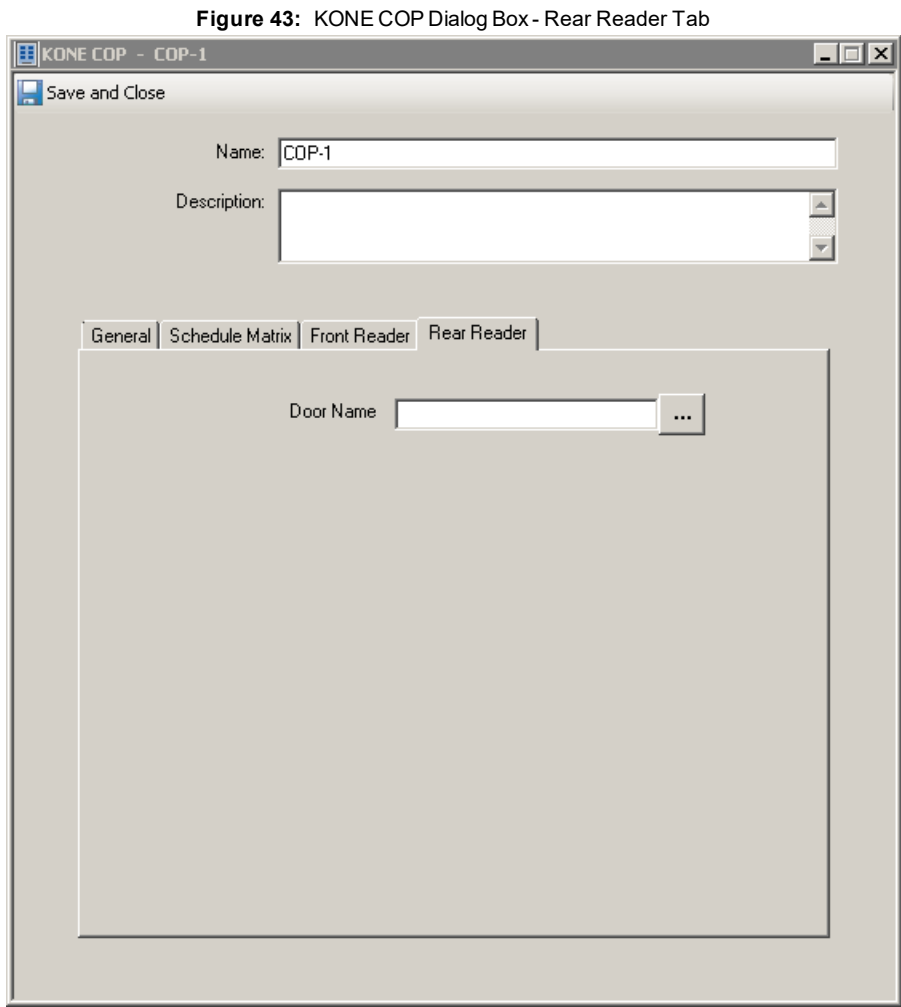

### Rear Reader Tab Definitions

[Table 22](#) on [Page 105](#) describes the Rear Reader tab field.

**Table 22:** KONE COP Dialog Box - Rear Reader Definitions

| Field | Description  |
|-------|--|
| Door  | Click on the selection button  . The iSTAR Doors selection box opens with a list of pre-configured doors. |


## Rear Reader Tab Tasks

This section includes the following tasks:

- [Selecting an iSTAR Door for the Rear Reader](#) on [Page 106](#)
- [Changing the iSTAR Door Selection for the Rear Reader](#) on [Page 106](#)


### Selecting an iSTAR Door for the Rear Reader

#### To Select an iSTAR Door for the Rear Reader

1. Click on the **Rear Reader** Tab.
2. Click on the Door Name selection button . The iSTAR Door selection box opens with a list a pre-configured iSTAR Doors.
3. Click on a pre-configured iSTAR door to select it. The selection appears in the Door Name field.
4. Click **Save and Close** to save the configuration.

### Changing the iSTAR Door Selection for the Rear Reader

#### To Change the iSTAR Door Selection for the Rear Reader

1. Click on the Rear Reader Tab.
2. Click on the Door Name selection button . The iSTAR Door selection box opens with a list a pre-configured iSTAR Doors.
3. Click on a pre-configured iSTAR door to select it. The new selection appears in the Door Name field.
4. Click **Save and Close** to save the configuration.

# KONE Direct Elevator Access Configuration

This chapter describes to configure direct elevator access for VIPs (Very Important Persons) using the KONE Direct Elevator Access dialog box.

In this chapter:

|  |     |
|--|-----|
| KONE Direct Elevator Access Dialog Box .....               | 108 |
| Accessing the KONE Direct Elevator Access Dialog Box ..... | 114 |

## KONE Direct Elevator Access Dialog Box

To facilitate Direct Access to pre-configured personnel group, the KONE Direct Elevator Access dialog box, shown in [Figure 44](#) on [Page 109](#), is used to send calls to KONE Elevator System. The call types can be Normal, ADA and VIP calls.

**NOTE**

Only one instance of direct elevator access can be assigned for each KONE group configuration.

### Remote Call Giving Interface (RCGIF)

KONE Elevator Integration supports custom call type which can be configured in Configuration File. The following default call types are supported by KONE Elevator Integration:

| Call Types | Description   |
|------------|---|
| 20         | For normal person, call type 20 is dispatched to the KONE server.               |
| 21         | For an ADA, call type 21 is dispatched to the KONE server.                      |
| 22         | KONE Elevator Integration does not support Priority call types.                 |
| 23         | For a VIP, call type 23 (Empty car call type) is dispatched to the KONE server. |
| 24         | KONE Elevator Integration does not support Space allocation call type.          |

For more information, see the following:

- [Accessing the KONE Direct Elevator Access Dialog Box](#) on [Page 114](#)
- [KONE Direct Elevator Access Dialog Box Definitions](#) on [Page 109](#)
- [KONE Direct Elevator Access Dialog Box Tasks](#) on [Page 110](#)

Figure 44: KONE Direct Elevator Access Dialog Box



The screenshot shows a software dialog box titled "KONE Direct Elevator Access". At the top left is a "Save and Close" button. Below it are two text input fields: "Name:" and "Description:". A "General" tab is active, containing an "Elevator System" dropdown menu currently set to "Elevator Group-1". Below this is a table with four columns: "Door Name", "Floor ID", "Terminal ID", and "Source Side". Above the table are "Add" and "Remove" buttons. At the bottom of the dialog is a "VIP Group" dropdown menu with an ellipsis button to its right.

KONE Direct Elevator Access Dialog Box Definitions

Table 23 on Page 109 describes the KONE Direct Elevator Access dialog box fields and buttons.

Table 23: KONE Direct Elevator Access Dialog Box Definitions

| Field/Button | Description  |
|--------------|--|
| Name         | <div>The name for the direct elevator access configuration.</div> <ul style="list-style-type: none"><li>The name is not case-sensitive</li><li>Minimum number of characters: 1</li><li>Maximum number of characters: 100</li></ul> |

| Field/Button       | Description   |
|--------------------|---|
| Description        | Optional. Enter a description for the direct elevator access configuration . <ul style="list-style-type: none"> <li>The description is not case-sensitive</li> <li>Minimum number of characters: None</li> <li>Maximum number of characters: 500</li> </ul>   |
| Save and Close     | Saves the configuration and closes the dialog box.  |
| <b>General Tab</b> |   |
| Elevator System    | The name of the KONE Elevator System. This field is read-only.  |
| Add                | Click to add a row for configuration.   |
| Remove             | Removes a selected row.   |
| Door Name          | Click on the selection button  to select a pre-configured door which is retrieved from the C•CURE 9000.  |
| Floor ID           | The floor from where the user is making the call. Enter a numeric value from 1 to 255.  |
| Terminal ID        | The identification of the passenger terminal. Enter a numeric value of 1 to 200.  |
| Source Side        | Select Front or Rear from the drop-down menu. <b>NOTE:</b> To configure the front and rear door to allow direct elevator access ,you must configure the Source Side front and the Source Side rear door separately.   |
| VIP Group          | Click on the selection button  to select a pre-configured C•CURE 9000 personnel group. The personnel in this group will be treated as VIP.<br><br><b>Note:</b> For a person who is a part of the VIP group, call type 3 (Empty car call type) is dispatched to KONE. |

**NOTE**

1. If personnel who belongs to neither VIP group nor ADA swipes at a reader, then Call Type Normal call is dispatched along with the Home Floor.
2. If personnel who belongs to ADA but not a part of VIP Group swipes at a reader, then Call Type Handicap Call is dispatched along with the Home Floor.
3. If personnel who belongs VIP group swipes at a reader, then Call Type Empty Car Call is dispatched along with the Home Floor.
4. If personnel who belongs to both ADA and VIP Group swipes at a reader, then Call Type EmptyCarCall is dispatched along with the Home Floor.

## KONE Direct Elevator Access Dialog Box Tasks


This section includes the following tasks:

- [Configuring Direct Elevator Access](#) on [Page 111](#)
- [Removing a Row from the Direct Elevator Access Configuration](#) on [Page 112](#)
- [Viewing All Direct Elevator Access Configurations](#) on [Page 112](#)
- [Editing a Direct Elevator Access Configuration](#) on [Page 113](#)
- [Deleting a Direct Elevator Access Configuration](#) on [Page 113](#)

## Configuring Direct Elevator Access


### To Configure Direct Elevator Access

1. Right-click on the **Elevator System** icon under the KONE Elevator System folder in the Hardware tree and select **KONE Direct Elevator Access>New**. The KONE Direct Elevator Access dialog box opens.
2. Enter a unique name, of up to 100 characters, for the Direct Elevator Access in the **Name** field.
3. Enter a description (optional), of up to 500 characters in the **Description** field.
4. Click **Add**. A blank row appears in the table.
5. Click in the blank space under the **Door Name** column.

6. Click on the selection button  located to the right of the blank column. The Door selection box opens.
7. Select the pre-configured Door configuration.

#### NOTE

Doors used with COP configurations cannot be used with Direct Elevator Access configurations.

8. Click in the row under **Floor ID** and enter the numeric value.
9. Click in the row under **Terminal ID** and enter a numeric value.
10. Click in the row under **Source ID** and select **Front** (front door) or **Rear** (rear door) from the drop-down menu.
11. Optional. Click on the selection button  located to the right of the **VIP Group** field to open a selection box listing pre-configured C•CURE 9000 personnel group. Click on a C•CURE 9000 personnel group to select it. The personnel in this group will be treated as VIP.
12. Click **Save and Close** to save the configuration.

**NOTE**

To assign ADA call type for people with disabilities, go to the Personnel dialogue box and select the Alternate Shunt (ADA) check box in the General tab. For people with disabilities, call type 1 is dispatched to the KONE server.

The screenshot shows the 'Personnel' dialog box with the 'General' tab selected. The 'Alternate Shunt (ADA)' checkbox is checked and highlighted with a red box. Other fields include First Name: John, Middle Name, Last Name: Martin, Object ID: 0, Personnel Type: None, Operator Name, Web Email and Login, Escort Options, PIN, and Modification History.


## Removing a Row from the Direct Elevator Access Configuration

### To Remove a Row from the Direct Elevator Access Configuration

1. Click in the row that you want to remove from the configuration to highlight it.
2. Click **Remove**.

## Viewing All Direct Elevator Access Configurations

### To View All Direct Elevator Access Configurations

1. Click on the **Hardware** drop-down menu and select **KONE Direct Elevator Access**.
2. Click on the green right arrow  located to the right of the **Hardware** drop-down menu. The **KONE Direct Elevator Access** tab opens in the Dynamic View displaying a list of KONE Direct Elevator Access configurations.



## Editing a Direct Elevator Access Configuration

---

### To Edit a Direct Elevator Access Configuration

1. Double-click on the **Direct Elevator Access configuration** in the tree that you want to edit. Alternately, you can right-click on the **Direct Elevator Access configuration** in the tree and select **Edit** from the context menu.
2. Make the changes to the configuration.
3. Click **Save and Close**.

## Deleting a Direct Elevator Access Configuration

---

### To Delete a Direct Elevator Access Configuration

1. Right-click on the **Direct Elevator Access** configuration that you want to delete and select **Delete** from the context menu. The **Deleting KONE Direct Elevator Access objects dialog** box opens.
2. Click **Yes** to confirm the deletion. The object is deleted.
3. Click **OK** to confirm that the object was deleted.


## Accessing the KONE Direct Elevator Access Dialog Box

This section explains how to access the KONE Direct Elevator Access dialog box.

**NOTE** The KONE Elevator System must be configured before you can access this dialog box. See [Chapter 3: KONE Elevator System Configuration](#) for more information.

### To Access the KONE Direct Elevator Access Dialog Box

1. Right-click on the elevator system icon under the **KONE Elevator System** folder and select **KONE Direct Elevator Access>New**, as shown in [Figure 45](#) on [Page 114](#).

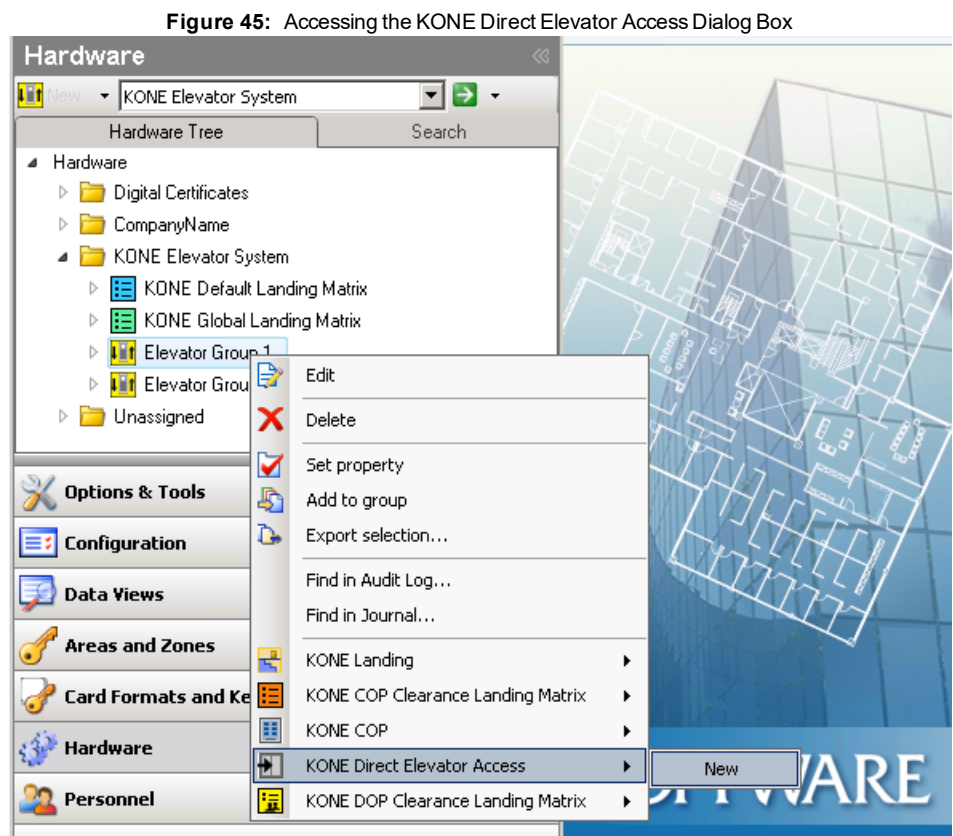

The KONE Direct Elevator Access dialog box, shown in [Figure 44](#) on [Page 109](#), opens.

KONE DOP Configuration

This chapter describes to configure the DOP (Destination Operation Panel) using the KONE DOP dialog box.

In this chapter:

Accessing the KONE DOP Dialog Box ..... 116

KONE DOP Dialog Box ..... 117

DOP - Landing Matrix Tab ..... 122

DOP - Schedule Matrix Tab ..... 125

## Accessing the KONE DOP Dialog Box

This section explains how to access the KONE dialog box.

### To Access the KONE DOP Dialog Box

1. Click on the elevator system icon in the KONE Elevator System folder under the Hardware tree.
2. Right-click on a Landing and select KONE DOP>New, as shown in [Figure 46](#) on [Page 116](#).

**Figure 46:** Access the KONE DOP Dialog Box



The KONE DOP dialog box, as shown in [Figure 47](#) on [Page 118](#), opens.

## KONE DOP Dialog Box


The KONE DOP dialog box, shown in [Figure 47](#) on [Page 118](#), is used to configure a DOP and to select a pre-configured door.

**NOTE**

The KONE Elevator System ( [KONE Elevator System Editor Dialog Box](#) on [Page 44](#)), KONE Default Landing Matrix ([KONE Default Landing Matrix Dialog Box](#) on [Page 72](#)) and the KONE Landing [KONE Landing Dialog Box](#) on [Page 78](#)) must be configured before you can configure the DOP.

For more information, see the following:

- [KONE DOP Dialog Box Definitions](#) on [Page 118](#)<sup>4</sup>
- [KONE DOP Dialog Box Tasks](#) on [Page 119](#)
- [KONE DOP Dialog Box Tabs](#) on [Page 121](#)

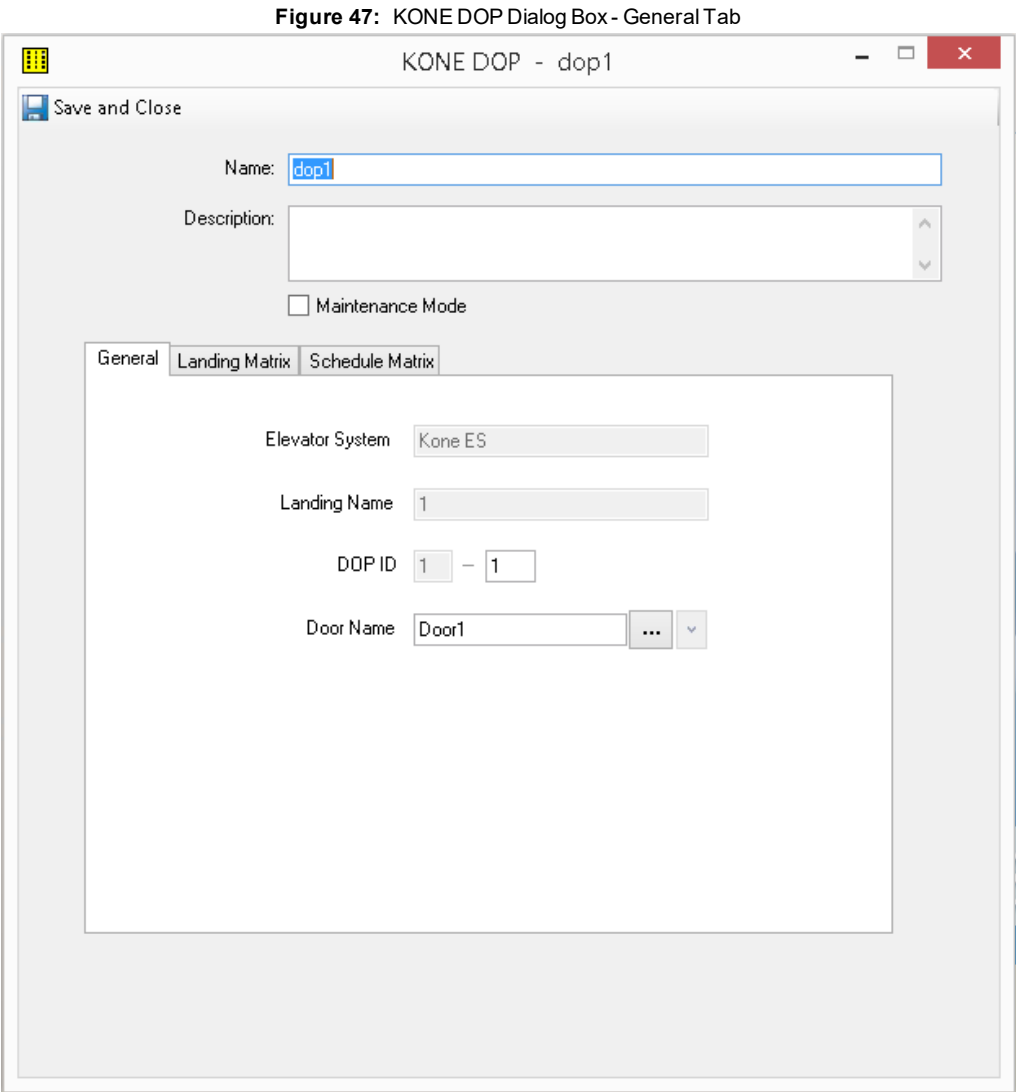


KONE DOP Dialog Box Definitions

Table 24 on Page 118 describes the KONE DOP dialog box- General tab fields and buttons.

Table 24: KONE DOP Dialog Box - General Tab Definitions

| Field/Button | Description   |
|--------------|---|
| Name         | <div>A unique name identifying the landing.</div> <div><ul style="list-style-type: none"><li>The name is not case-sensitive</li><li>Minimum number of characters: 1</li><li>Maximum number of characters: 100</li></ul></div> |

**Table 24:** KONE DOP Dialog Box - General Tab Definitions (continued)

| Field/Button       | Description   |
|--------------------|---|
| Description        | Optional. A description for the landing. <ul style="list-style-type: none"> <li>• The description is not case-sensitive.</li> <li>• Minimum number of characters: None</li> <li>• Maximum number of characters: 500</li> </ul>  |
| Maintenance Mode   | Select the Maintenance mode check box to limit information about the object, that is displayed on the Monitoring Station. Maintenance Mode only affects the information reported at the Monitoring Station. For more information see, <a href="#">Maintenance Mode</a> on <a href="#">Page 64</a> . |
| Save and Close     | Saves the configuration and closes the dialog box   |
| <b>General Tab</b> |   |
| Elevator System    | The name of the KONE Elevator System This field is read-only.   |
| Landing Name       | The textual description for the landing.  |
| DOP ID             | The DOP and the Floor ID. The first field is the Floor ID and the second field is the DOP ID (a unique numeric identifier between 1 and 255).   |
| Door Name          | Click on the selection button  to select a pre-configured door which is retrieved from the C•CURE 9000.  |

## KONE DOP Dialog Box Tasks



This section describes the following tasks:

- [Configuring a DOP](#) on [Page 119](#)
- [Editing a DOP Configuration](#) on [Page 120](#)
- [Viewing DOP Configurations](#) on [Page 120](#)
- [Deleting a DOP Configuration](#) on [Page 120](#)

## Configuring a DOP

### To Configure a DOP

1. Right-click on the Landing under the KONE Elevator system and select **KONE DOP>New**. The KONE DOP dialog box opens.
2. Enter a name for the DOP in the **Name** field.
3. Enter a description (optional) in the **Description** field.
4. Enter a numeric value of 1 to 255 in the **DOP ID** field.

5. Click on the selection button  to the right of the **Door Name** field to open a selection box listing iSTAR door configurations.
6. Click on a door configuration to select it. The selected door appears in the Door Name field.
7. Click on the selection button  to the right of the Default Landing Matrix field to open a selection box listing KONE Default Landing Matrix configurations.
8. Click on a **KONE Default Landing Matrix** configuration to select it.
9. Click **Add** to assign a schedule to a Default Landing Matrix.

**NOTE**

For information about setting up schedules, see the C•CURE 9000 Software Configuration Guide.

10. Click on the **Landing Matrix** tab to assign a connected mask and disconnected mask to the Call Types. For more information, [DOP - Landing Matrix Tab](#) on [Page 122](#).
11. Click on the **Schedule Matrix** tab, to assign a pre-configured schedule to a pre-configured default landing matrix configuration. For more information, see [DOP - Schedule Matrix Tab](#) on [Page 125](#).
12. Click **Save and Close**.

## Editing a DOP Configuration

---


### To Edit a DOP Configuration

1. Double-click on the **DOP** configuration in the tree that you want to edit. Alternately, you can right-click on the **DOP** configuration in the tree and select **Edit** from the context menu.
2. Make the changes to the configuration.
3. Click **Save and Close**.

## Viewing DOP Configurations

---

### To View DOP Configurations

1. Click on the **Hardware** drop-down menu and select **KONE DOP**.
2. Click on the green right arrow  located to the right of the **Hardware** drop-down menu. The KONE DOP tab opens in the Dynamic View displaying a list of KONE DOP configurations.

## Deleting a DOP Configuration

---

### To Delete a DOP Configuration

1. Right-click on the **DOP** configuration that you want to delete and select **Delete** from the context menu. The Deleting KONE DOP objects dialog box opens.



2. Click **Yes** to confirm the deletion. The object is deleted.
3. Click **OK** to confirm that the object was deleted.

## KONE DOP Dialog Box Tabs


The following sections provide information about the KONE Dialog Box Tabs:

- [DOP - Landing Matrix Tab](#) on [Page 122](#)
- [DOP - Schedule Matrix Tab](#) on [Page 125](#)

## DOP - Landing Matrix Tab

The KONE DOP dialog box - Landing Matrix tab, shown in [Figure 48](#) on [Page 122](#), is used to assign a connected mas and disconnected mask to a particular Call Type. For more information, see the following:

- [KONE DOP Dialog Box - Landing Matrix Tab Definitions](#) on [Page 122](#)
- [KONE DOP Dialog Box - Landing Matrix Tab Tasks](#) on [Page 123](#)

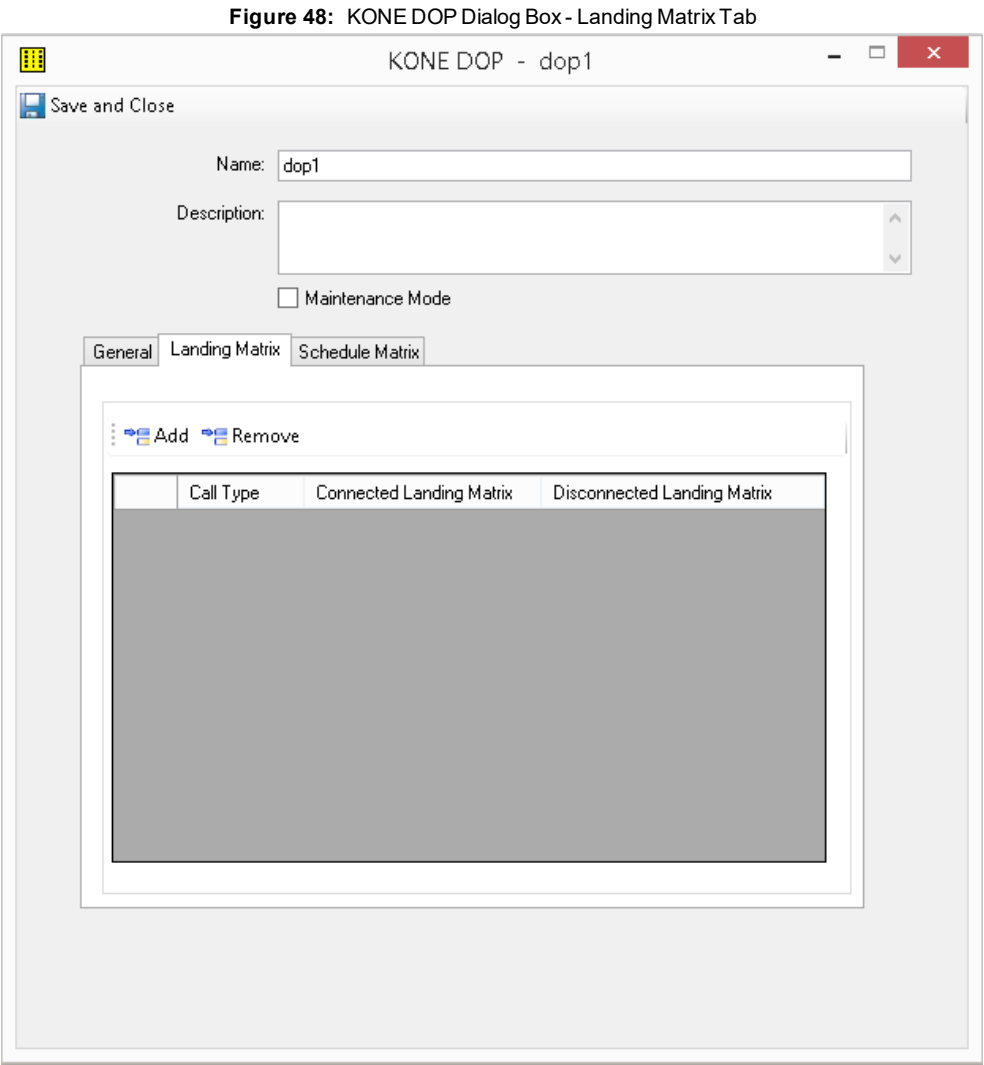

### KONE DOP Dialog Box - Landing Matrix Tab Definitions

[Table 25](#) on [Page 123](#) describes the Landing Matrix tab fields and buttons.

**Table 25:** KONE DOP Dialog Box - Landing Matrix Tab Definitions

| Field/Button                | Description   |
|-----------------------------|---|
| Call Types                  | <p>The Call Type number defines functions configured in KONE Group Controller.</p> <p>Enter the numeric value between 0 to 200.</p> <p>The common call types defined by KONE are:</p> <p>Type 0 – Normal</p> <p>Type 1 – ADA</p> <p>Type 2 – Priority</p> <p>Type 3 – Empty Car</p> <p>Call Types from 4 to 200 are configurable.</p> |
| Connected Landing Matrix    | The Connected Landing Matrix is used when the connection between the C•CURE 9000 and the KONE Elevator System is active. The KONE Elevator System automatically loads the selected default landing matrix to specific DOP's in the elevator system.   |
| Disconnected Landing Matrix | The Disconnected Landing Matrix is used when the connection between the C•CURE 9000 and the KONE Elevator System is disconnected. The KONE Elevator System automatically loads the selected default landing matrix to specific DOP's in the elevator system.  |

## KONE DOP Dialog Box - Landing Matrix Tab Tasks



This section describes the following task:

- [Selecting a Connected Mask and a Disconnected Mask](#) on [Page 123](#)

### Selecting a Connected Mask and a Disconnected Mask

The default landing matrix must be configured before you can configure the connected mask and the disconnected mask. See KONE Default Landing Matrix Dialog Box on [Page 92](#) for more information.

#### To Select a Connected Mask and a Disconnected Mask

1. Click on the **Landing Matrix** tab.
2. Optional. Click **Add** to assign a Connected Mask and Disconnected Mask to a particular Call Type.
3. Optional. Click on selection button  to the right of the Connected Mask field to open the KONE Default Landing Matrix selection box listing default landing matrix configurations.
4. Click on a **Default Landing Matrix** configuration to select it.
5. Optional. Click on the selection button  to the right of the Disconnected Mask field to open the KONE Default Landing Matrix selection box listing default landing matrix configurations.

6. Click on a **Default Landing Matrix** configuration to select it.
7. Click **Save and Close**.


# DOP - Schedule Matrix Tab

The KONE DOP dialog box - Schedule Matrix tab, shown in [Figure 49](#) on [Page 125](#), is used to assign a pre-configured schedule to a pre-configured default landing matrix configuration.

For more information, see the following:

- [Schedule Matrix Tab Definitions](#) on [Page 125](#)
- [Schedule Matrix Tab Tasks](#) on [Page 126](#)

**Figure 49:** KONE DOP Dialog Box - Schedule Matrix Tab

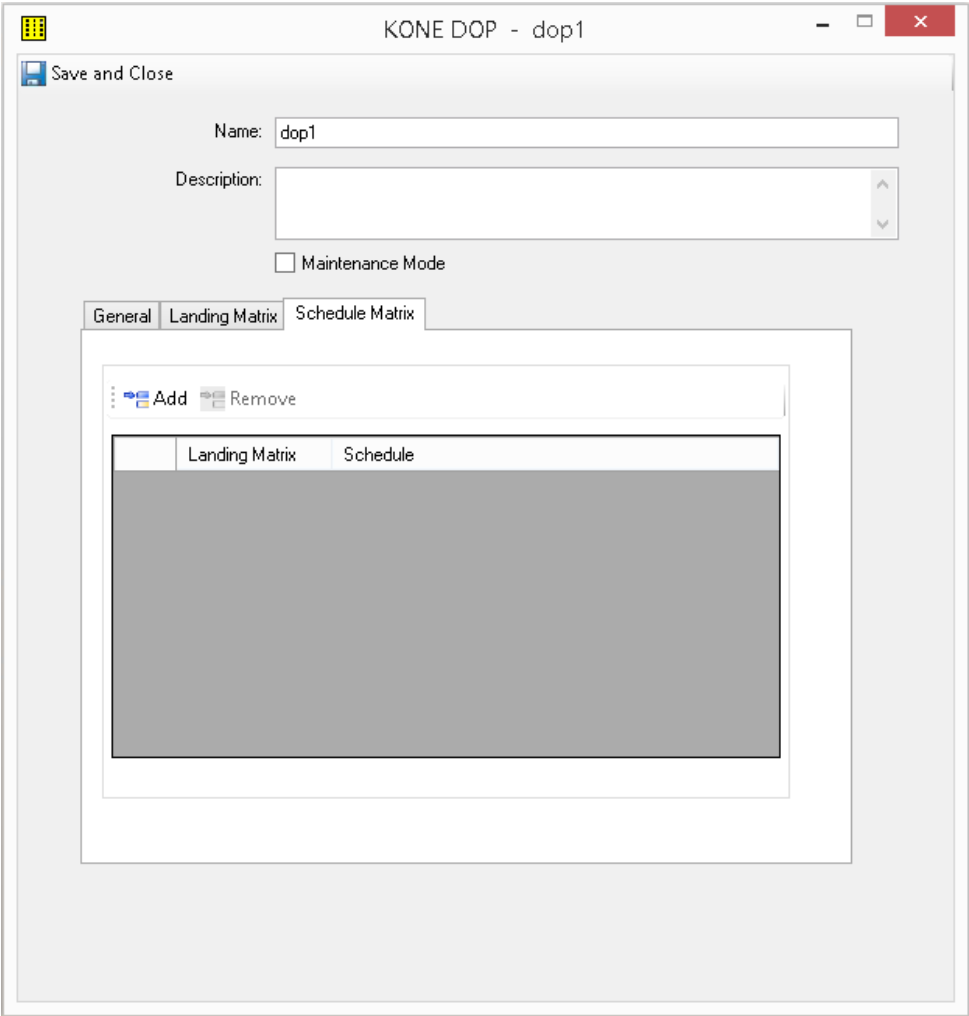

## Schedule Matrix Tab Definitions

[Table 26](#) on [Page 126](#) describes the Schedule Matrix tab fields and buttons.

**Table 26:** KONE DOP Dialog Box - Schedule Matrix Tab Definitions

| Field/Button   | Description  |
|----------------|--|
| Add            | Adds an empty row to the table for selection of a default landing matrix configuration and to select a schedule to assign to it.                                       |
| Remove         | Removes and deletes the selected default landing matrix configuration and the assigned schedule from the table.  |
| Landing Matrix | The default landing matrix configuration selected.   |
| Schedule       | The schedule selected for the default landing matrix configuration. See the C•CURE 9000 Software Configuration Guide for more information about configuring schedules. |

## Schedule Matrix Tab Tasks

This section describes the following task:



- [Configuring a KONE Landing Schedule Matrix](#) on [Page 126](#)
- [Deleting a KONE Landing Schedule Matrix](#) on [Page 127](#)

## Configuring a KONE Landing Schedule Matrix

### NOTE

Only seven Landing schedule matrix's are supported for a DOP.

### To Configure a KONE Landing Schedule Matrix

1. Click the **Schedule Matrix** tab.
2. Click the **Add** button.
3. Click the selection button  in the empty row under **Landing Matrix** to open the KONE Default Landing Matrix selection box.
4. Click on a **Default Landing Matrix** configuration to select it. The selection appears under Landing Matrix.
5. Click in blank field under Schedule, and then click on the selection button . The Schedule selection box opens.
6. Click on a **Schedule** to select it. The selection appears under Schedule.
7. Click **Save and Close**.

## Deleting a KONE Landing Schedule Matrix

### **To Delete a KONE Landing Schedule Matrix**

1. Click in the row containing the Default Landing Matrix schedule you want to delete.
2. Click the **Remove** button.

## KONE DOP Clearance Landing Matrix Configuration

This chapter describes to configure clearances using the KONE DOP Clearance Landing Matrix dialog box.

In this chapter:

|  |     |
|--|-----|
| Accessing the KONE DOP Clearance Landing Matrix Dialog Box ..... | 129 |
| KONE DOP Clearance Landing Matrix Dialog Box .....               | 130 |




## Accessing the KONE DOP Clearance Landing Matrix Dialog Box

This section describes how to access the KONE DOP Clearance Landing Matrix dialog box.

### To Access the Dialog Box

1. Right-click on the elevator system icon under the KONE Elevator System folder and select KONE DOP Clearance Landing Matrix>New, as shown in [Figure 50](#) on [Page 129](#).

**Figure 50:** Access the KONE DOP Clearance Landing Matrix Dialog Box

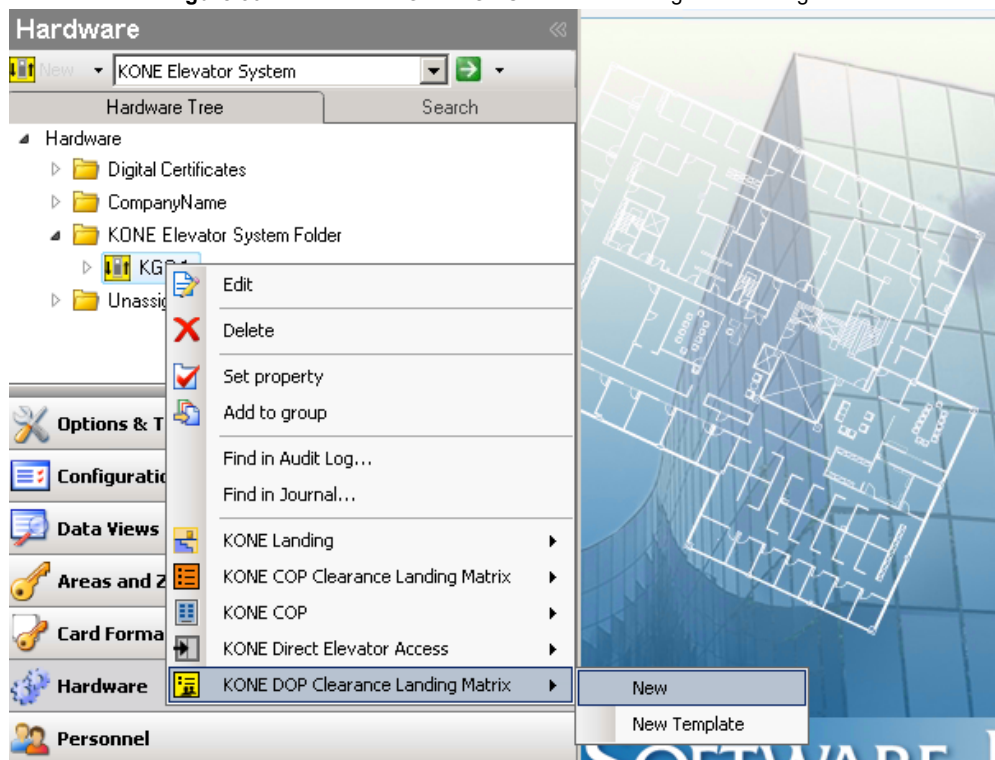

The KONE DOP Clearance Landing Matrix dialog box opens.

## KONE DOP Clearance Landing Matrix Dialog Box

The KONE DOP Clearance Landing Matrix dialog box, shown in [Figure 51](#) on [Page 131](#), is used to define up to 255 front and 255 rear doors that can be accessed by cardholders that have a clearance associated with the landing matrix. A call placed at a high priority is often configured in KONE to provide the next available elevator to the individual who places the priority elevator request.

Depending on the configuration of the KONE system, the priority request may automatically be part of the floor selected, or it may be an option to the individual at the time of floor selection to make that floor selection a priority request.

It is recommended:

- Not to configure disabled call type with any other call type.
- To have separate landing matrix for disabled call types based on the clearance.

**For example:** Call type 1 is assigned at a site for all people with disabilities.

John is disabled and he has the clearance: **clearance\_disabled**. The **clearance\_disabled** is assigned to a landing matrix which has the call type 1 and access to the 4th floor only. When John swipes, call type 1 with access to the 4th floor is dispatched to the KONE server.

Now, another landing matrix is assigned to **clearance\_disabled**, which has call type 2 and access to the 7th floor. When John swipes, call type 1 with access to the 4th floor and call type 2 with access to 7th floor are dispatched to the KONE server.

If a site has a requirement to only dispatch disabled call type to the KONE server, then you must not assign multiple call types to the disabled clearance. In this case **clearance\_disabled**.

For more information, see the following:

- [Accessing the KONE DOP Clearance Landing Matrix Dialog Box](#) on [Page 129](#)
- [KONE DOP Clearance Landing Matrix Dialog Box Definitions](#) on [Page 131](#)
- [KONE DOP Clearance Landing Matrix Dialog Box Tasks](#) on [Page 133](#)

**Figure 51: KONE DOP Clearance Landing Matrix Dialog Box**

**KONE DOP Clearance Landing Matrix - dop clm**

Name:

Description:

---

**General**

Elevator System

Clearance Name  ... ▼

RCGIF

CallType  Home Floor  ☐ Front ☒ Rear

ELI

+ Add - Remove

|   | Call Type | Lifts | Landing Matrix | Priority |
|---|-----------|-------|----------------|----------|
| ▶ | 1         | 2     | clm            | 255      |

## KONE DOP Clearance Landing Matrix Dialog Box Definitions

Table 27 on Page 132 describes the KONE DOP Clearance Landing Matrix dialog box fields and buttons.

**Table 27:** KONE DOP Clearance Landing Dialog Box Definitions

| Field/Button             | Description   |
|--------------------------|---|
| Name                     | <p>The unique name identifying the DOP Clearance Landing Matrix.</p> <ul style="list-style-type: none"> <li>• The name is not case-sensitive</li> <li>• Minimum number of characters: 1</li> <li>• Maximum number of characters: 100</li> </ul>   |
| Description              | <p>Optional. Enter a description for the DOP Clearance Landing Matrix.</p> <ul style="list-style-type: none"> <li>• The description is not case-sensitive</li> <li>• Minimum number of characters: None</li> <li>• Maximum number of characters: 500</li> </ul>   |
| Save and Close           | Saves the configuration and closes the dialog box.  |
| <b>General Tab</b>       |   |
| Elevator System          | The name of the KONE Elevator System. This field is read-only.  |
| Clearance Name           | The pre-configured personnel clearance. This field is used to select the clearance that allows access to the Door with a reader that a person swipes their card to get authorization to use the landing.  |
| Call Type (RCGIF field)  | <p>The RCGIF Call Type number defines functions configured in KONE Direct Elevator Access. Enter the numeric value between 0 to 200.</p> <p><b>Note:</b></p> <ol style="list-style-type: none"> <li>1. Normal user who does not belongs to VIP or ADA category can configure the Call Type on DOP Clearance Landing Matrix such that the user will have option to configure Normal Call Type at DOP Clearance Landing level.</li> <li>2. Normal call type values should not be over lapped with VIP or ADA call type values which are configured in configuration file.</li> <li>3. Default call type value is 20.</li> </ol> |
| Home Floor (RCGIF field) | Allows you to identify Clearance Landing Matrix Home Floor. You can select the Home Floor from 1 to 255. You must select either Front or Rear. This field is used while configuring KONE Direct Elevator Access.  |

| Field/Button               | Description   |
|----------------------------|---|
| Call Type (ELI field)      | <p>The Call Type number defines functions configured in KONE Group Controller. Enter the numeric value between 0 to 200.</p> <p>The common call types defined by KONE are:</p> <p>Type 0 – Normal</p> <p>Type 1 – ADA</p> <p>Type 2 – Priority</p> <p>Type 3- Empty Car Call</p> <p>Types from 4 to 200 are configurable.</p> |
| Lifts (ELI field)          | Allows you to select the lifts to be allowed for Call. You can add a maximum of 200 lifts. If the lift ID number is 0 or more than 200, then the following error message is displayed: <b>Range of lifts should be between 1 to 200.</b>  |
| Landing Matrix (ELI field) | Allows selection of a pre-configured Default Landing Matrix.  |
| Priority (ELI field)       | Range of priority is between 1 and 255. Priority value 1 defines highest and 255 is default.  |

## KONE DOP Clearance Landing Matrix Dialog Box Tasks

This section describes the following tasks:

- [Creating a DOP Clearance Landing Matrix](#) on [Page 133](#)
- [Creating a DOP Clearance Landing Matrix with Home Floor](#) on [Page 136](#)
- [Viewing DOP Clearance Landing Matrix Configurations](#) on [Page 136](#)
- [Editing a DOP Clearance Landing Matrix Configuration](#) on [Page 136](#)
- [Deleting a DOP Clearance Landing Matrix Configuration](#) on [Page 137](#)
- [Creating a DOP Clearance Landing Matrix Template](#) on [Page 137](#)

### Creating a DOP Clearance Landing Matrix

#### To Create a DOP Clearance Landing Matrix

1. Right-click the **Elevator System** icon under the KONE Elevator System folder in the Hardware tree and select **KONE DOP Clearance Landing Matrix>New**. The KONE DOP Clearance Landing Matrix window opens.

**Figure 52: KONE DOP Clearance Landing Matrix**

KONE DOP Clearance Landing Matrix - dop clm

Save and Close

Name:

Description:

General

Elevator System

Clearance Name  ... ▾

RGIF

CallType  ▴ ▾ Home Floor  ▴ ▾☐ Front ☒ Rear

ELI

Add Remove

|   | Call Type | Lifts | Landing Matrix | Priority |
|---|-----------|-------|----------------|----------|
| ▶ | 1         | 2     | clm            | 255      |
|   |           |       |                |          |

2. Enter a name for the Clearance Landing Matrix in the **Name** field. The name can have up to 100 characters.
3. (Optional) Enter a description, having up to 500 characters, in the **Description** field.
4. Follow the steps to select a Clearance Name:


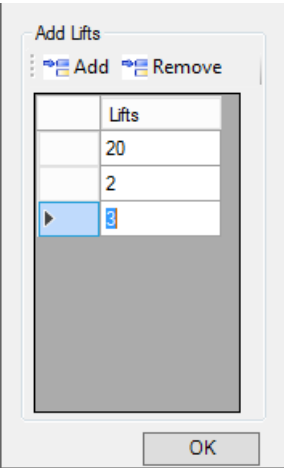
- a. Click the selection button  located on the right of the **Clearance Name** field. The Clearance Selection dialog box opens.
  - b. Click to select a clearance.
5. In the **Call Type** box of **RCGIF** field, type a call type number.
6. In the **Home Floor** box of **RCGIF** field, type a floor number.
7. Select either **Front** or **Rear** in the **RCGIF** field.
8. Click **Add** to add a new row.
9. In the ELI field, click in the **Call Type** column and type a desired number.
10. Follow the steps to add lifts in the ELI field :
- a. Click in the **Lifts column**, Add Lifts dialog box opens.


Figure 53: Add Lifts



- b. Add desired lift ID numbers and click **OK**.
- c. Click **Add**, a new row is added. The lifts are added and displayed in the Lifts column.

**NOTE**

To remove a row, select the row and click **Remove**.

11. Follow the steps to add a Landing Matrix in the ELI field:
- a. Click in the **Landing Matrix** column.
  - b. Click , the Name Selection window opens, click to select a default landing matrix.


**NOTE**

- You must have created a Default Landing Matrix to select is. For information about creating a default landing matrix, [KONE Default Landing Matrix Dialog Box](#) on [Page 72](#).
- To change the Default Landing Matrix, click the drop-down arrow and then click **Edit**. Kone Default Landing Matrix window opens, edit required details and click **Save and Close**.

12. In the ELI field, click the **Priority** column and type a desired number.
13. Click **Save and Close**.


## Creating a DOP Clearance Landing Matrix with Home Floor

### To Create a DOP Clearance Landing Matrix with Home Floor

1. Right-click on the **Elevator System** icon under the **KONE Elevator System** folder in the **Hardware** tree and select **KONE DOP Clearance Landing Matrix>New**.
2. Enter a name, of up to 100 characters, for the clearance landing matrix in the **Name** field.
3. Enter a description (optional) of up to 500 characters in the **Description** field.
4. Click on the selection button  located to the right of the Clearance Name field to open the Clearance selection dialog box.
5. Click on a clearance to select it.
6. Enter a value between 1 and 255 to identify **Clearance Landing Matrix Home Floor**. You must select either **Front** or **Rear**. This field is used while configuring KONE Direct Elevator Access.
7. Enter a value between 0 and 200 to identify **Clearance Landing Matrix Call Type**. This field is used while configuring KONE Direct Elevator Access and this values are configurable for Normal user.
8. Click **Save and Close** when done.


## Viewing DOP Clearance Landing Matrix Configurations

### To View DOP Clearance Landing Matrix Configurations

1. Click on the Hardware drop-down menu and select **KONE DOP Clearance Landing Matrix**.
2. Click on the green right arrow  located to the right of the **Hardware** drop-down menu. The KONE DOP Clearance Landing Matrix tab opens in the Dynamic View displaying a list of DOP Clearance Landing Matrix configurations.

## Editing a DOP Clearance Landing Matrix Configuration


### To Edit a DOP Clearance Landing Matrix Configuration

1. Click on the **Hardware** drop-down menu and select **KONE DOP Clearance Landing Matrix**.
2. Click on the green right arrow  located to the right of the Hardware drop-down menu. The KONE DOP Clearance Landing Matrix tab opens in the Dynamic View displaying a list of DOP Clearance Landing configurations.
3. Right-click on the **KONE DOP Clearance Landing Matrix** that you want to edit and select **Edit** from the context menu. Alternately, you can double-click on the **DOP Clearance Landing Matrix** configuration to open the KONE DOP Clearance Landing Matrix dialog box.
4. Make the changes to the configuration.
5. Click **Save and Close**.



## Deleting a DOP Clearance Landing Matrix Configuration

### To Delete a DOP Clearance Landing Matrix Configuration

1. Click on the **Hardware** drop-down menu and select **KONE DOP Clearance Landing Matrix**.
2. Click on the green right arrow  located to the right of the Hardware drop-down menu. The KONE DOP Clearance Landing Matrix tab opens in the Dynamic View displaying a list of DOP Clearance Landing configurations.
3. Right-click on the **KONE DOP Clearance Landing Matrix** configuration that you want to delete and select **Delete** from the context menu. The Deleting KONE DOP Clearance Landing Matrix objects dialog box opens.
4. Click **Yes** to confirm the deletion. The object is deleted.
5. Click **OK** to confirm that the object was deleted.

## Creating a DOP Clearance Landing Matrix Template

### To Create a DOP Clearance Landing Matrix Template

1. Right-click on the Elevator System icon under the KONE Elevator System folder and select **KONE DOP Clearance Landing Matrix>New Template**.
2. Enter the information for the clearance landing matrix template.
3. Click **Save and Close**. The new template is listed under KONE DOP Clearance Landing Matrix>Templates.

KONE Events and Actions

This chapter describes the C•CURE 9000 events which triggers KONE Actions and the steps to configure them.

In this chapter

KONE Events .....139

KONE Actions and Target Objects .....140

Configuring C•CURE Events for KONE Actions .....141

## KONE Events

An event is a software definition that you can create using C•CURE 9000 dialog boxes and options.

Anything that C•CURE 9000 can monitor can be used to generate an event, and the event can trigger any action. You can link an event directly to a single action or you can link it to multiple events and actions. In the C•CURE 9000 KONE Elevator Integration you can use an event to trigger event actions.

For more information, see the following:

- [KONE Actions and Target Objects](#) on [Page 140](#)
- [Configuring C•CURE Events for KONE Actions](#) on [Page 141](#)

## KONE Actions and Target Objects

An action is a series of tasks, or a single task, that's executed when an event occurs. The target object is an object on which the action is to be taken when an event occurs.

Table 28 on Page 140 describes the KONE action and target objects.

**Table 28:** KONE Action and Target Objects

| Actions           | Target Object | Description             |
|-------------------|---------------|-------------------------|
| Secure Landing    | KONE Landing  | Secure the landing.     |
| Un-secure Landing | KONE Landing  | Un-secures the landing. |

## Configuring C•CURE Events for KONE Actions


The two KONE event actions, Secure Landing and Un-secure Landing, are time-based events. You create a manual action and then schedule the time to secure or un-secure a landing.

This section describes the following tasks:

- [Configuring the Secure Landing Event](#) on [Page 141](#)
- [Configuring the Un-secure Landing Event](#) on [Page 142](#)



### Configuring the Secure Landing Event

#### To Configure the Secure Landing Event

1. In the Navigation pane of the Administration Workstation, click **Configuration** to open the Configuration Pane.
2. Select **Event** from the Configuration drop-down list.
3. Click **New** to create a new Event. The Event Editor opens.
4. Enter a name for this Event in the **Name** field.
5. Enter a description for this Event in the **Description** field.
6. Click **Enabled** to make the Event available to C•CURE 9000 operators.
7. Click on the **Actions** tab to define the action that you want to set for the Event.
8. Click **Add**.
9. Click in the **Action** column to display a drop-down list of valid actions.
10. Select **Secure Landing**. When you select Secure Landing option, the KONE Landing entry field appears at the bottom of the dialog box.
11. Click on the selection button  to select a pre-configured KONE Landing.
12. (Optional) Click in the **Resettable** check box if you want to allow an operator responding to the Event to reset the action without acknowledging the Event. This allows Monitoring Station personnel to manually reset the action caused by the event. Reset actions do not require even acknowledgment.
13. Click on the General tab.
14. In the Default State section, click Armed to arm the event as the default state.
15. In the **Priority** section, select a value from the drop-down to set the priority level the system uses for sorting when displaying on the Monitoring Station and prioritizing actions associated with the event.
16. In the **Scheduling** section, click on the **Activate on Schedule** selection button to open a selection box listing schedules.
17. Click on a **Schedule** to select it.
18. Click **Save and Close** to save the configuration.

## Configuring the Un-secure Landing Event

### To Configure the Un-secure Landing Event

1. In the Navigation pane of the Administration Workstation, click **Configuration** to open the Configuration Pane.
2. Select **Event** from the Configuration drop-down list.
3. Click **New** to create a new Event. The Event Editor opens.
4. Enter a name for this Event in the **Name** field.
5. Enter a description for this Event in the **Description** field.
6. Click **Enabled** to make the Event available to C•CURE 9000 operators.
7. Click on the **Actions** tab to define the action that you want to set for the Event.
8. Click **Add**.
9. Click in the **Action** column to display a drop-down list of valid actions.
10. Select **Un-secure Landing**. When you select the Un-secure Landing option, the KONE Landing entry field appears at the bottom of the dialog box.
11. Click on the selection button  to select a pre-configured KONE Landing.
12. (Optional) Click in the **Resettable** check box if you want to allow an operator responding to the Event to reset the action without acknowledging the Event. This allows Monitoring Station personnel to manually reset the action caused by the event. Reset actions do not require event acknowledgment.
13. Click on the **General** tab.
14. In the **Default State** section, click **Armed** to arm the event as the default state.
15. In the **Priority** section, select a value from the drop-down to set the priority level the system uses for sorting when displaying on the Monitoring Station and prioritizing actions associated with the event.
16. In the **Scheduling** section, click on the **Activate on Schedule** selection button  to open a selection box listing schedules.
17. Click on a schedule to select it.
18. Click **Save and Close** to save the configuration.

Monitoring KONE Elevator Activity

This chapter describes the C•CURE 9000 Monitoring Station Activity Viewer and also provides the procedure to cancel KONE manual actions.

In this chapter:

C•CURE 9000 Monitoring Station Activity Viewer .....144

Cancelling Manual Actions .....145

## C•CURE 9000 Monitoring Station Activity Viewer


The C•CURE 9000 Monitoring Station Activity Viewer, shown in [Figure 54](#) on [Page 144](#), displays the KONE access control activities.

Activities in the list are displayed in rows that contain an icon, the date and time of the activity, the type of activity or object, its name, the object’s partition name [in brackets], and an activity message.

You can click the activity icon to view additional information about the object, or right-click the icon to display the context menu for more options or to initiate a manual action.

See the C•CURE 9000 Monitoring Station Guide for more information about the Activity Viewer.

Figure 54: Monitoring Station Activity Viewer

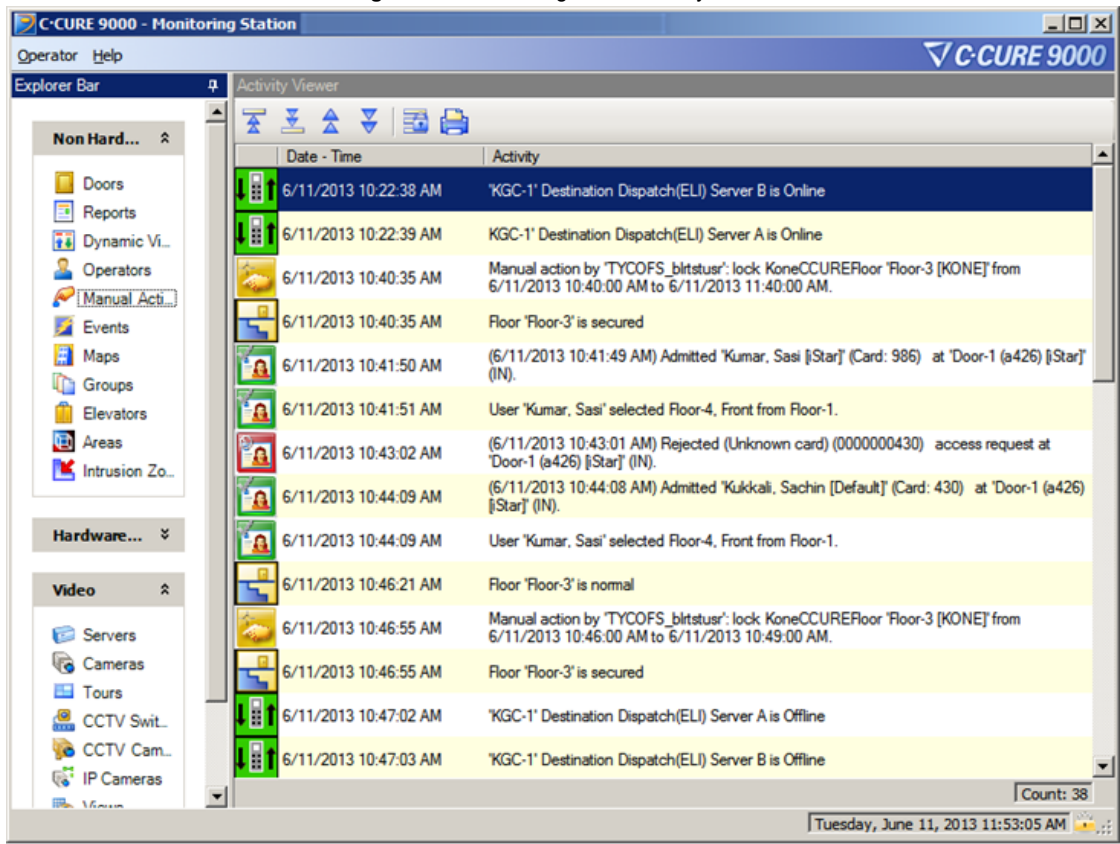




## Cancelling Manual Actions

This section describes how to cancel the Secure Landing and Un-Secure Landing manual actions in the Monitoring Station.

### To Cancel a Manual Action in the Activity Viewer

1. Go to the Monitoring Station Activity Viewer, as shown in [Figure 55](#) on [Page 145](#).


**Figure 55:** Monitoring Station Activity Viewer

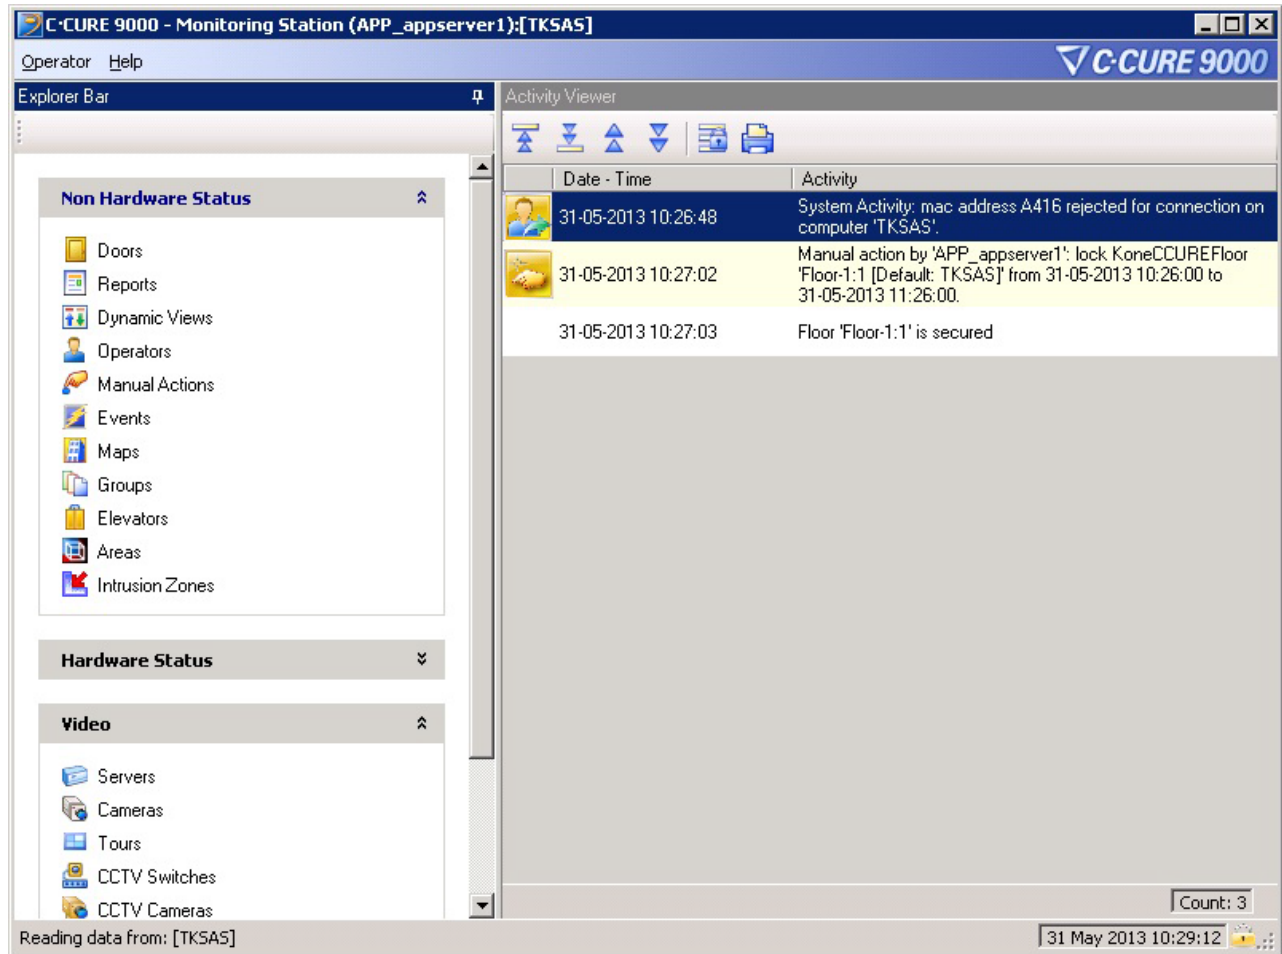

A list of all activities since the Monitoring Station was opened are displayed.


2. Click on Non-Hardware Status under the Explorer Bar.
3. Click on Manual Actions under Non-Hardware Status. The Status List - Manual Action dialog box, as shown in [Figure 56](#) on [Page 146](#), opens displaying a list of manual actions and their current status.

**Figure 56:** Status List Dialog Box

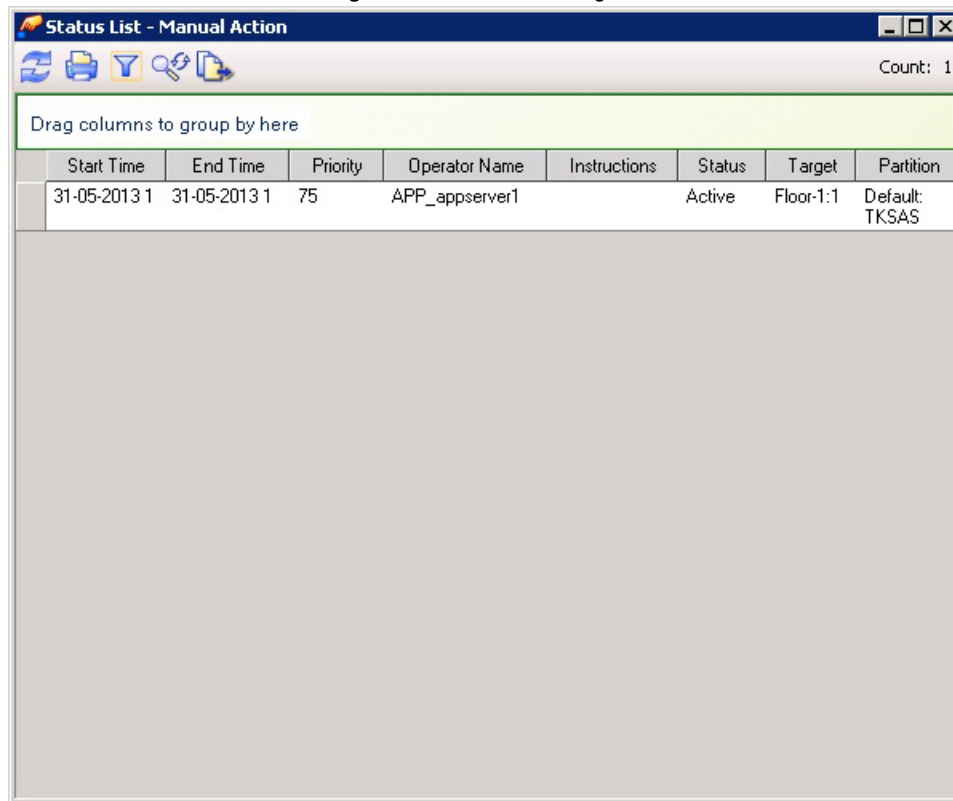

4. Right-click on the **Manual Action** in the dialog box that you want to cancel and select **Cancel** from the drop-down menu, as shown in Figure 55 on Page 177.

Figure 57: Cancelling the Manual Action

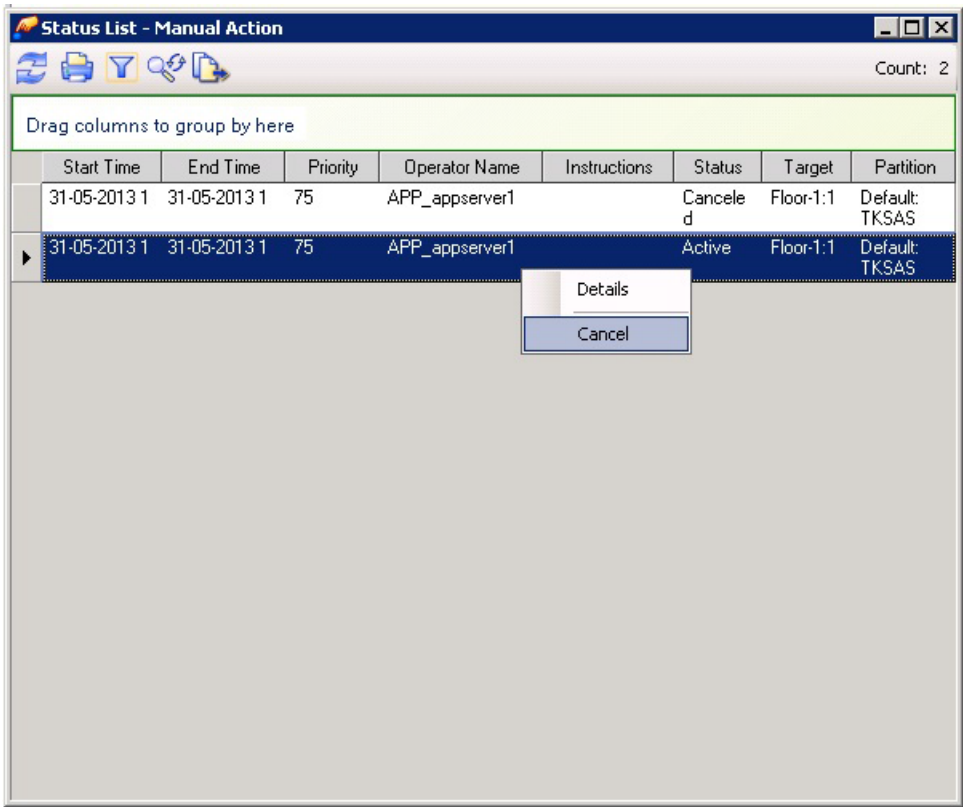

A new entry appears in the Activity Viewer to indicate that the manual action was cancelled.

## Journal and Audit Messages

This chapter discusses the Journal and the Audit messages and how to locate them.

In this chapter:

|  |     |
|--|-----|
| Journal and Audit Log Messages .....       | 149 |
| Locating KONE Objects in the Journal ..... | 150 |
| Locating KONE Audit Log Entries .....      | 151 |

## Journal and Audit Log Messages

Table 29 on Page 149 lists the journal messages reported by the KONE Elevator System to the C•CURE 9000 database.

All configuration changes to the C•CURE 9000 database are recorded to the Audit Log.

**Table 29:** Journal Log Messages

| Category               | Object          | State Changes   | Message Description   |
|------------------------|-----------------|-----------------|---|
| KONEObjectChange State | Elevator System | Online          | <name of the Elevator System> Server A is Online <name of the Elevator System> Server B is Online                 |
|                        |                 | Offline         | <name of the Elevator System> Server A is Offline <name of the Elevator System> Server B is Offline               |
|                        | RCGIF           | Online          | <name of the Elevator System> Elevator Direct Access (RCGIF) Server A is Online                                   |
|                        |                 | Offline         | <name of the Elevator System> Elevator Direct Access (RCGIF) Server B is Offline                                  |
| System Activity        | Driver          | Start           | System Activity: KONE Elevator Driver Service started on computer <computer name>                                 |
|                        |                 | Stop            | System Activity: KONE Elevator Driver Service stopped on computer <computer name>                                 |
| KONE Elevator Message  | Elevator System | Floor Selection | <personnel name> selected Landing # Front/Rear  |
| Manual Actions         | Landing         | Secure          | Manual action by <Operator Name> lock <KONE CCUREFloor <Landing Name> from <Date Start time> to <Date End Time>   |
|                        |                 | Unsecure        | Manual action by <Operator Name> unlock <KONE CCUREFloor <Landing Name> from <Date Start time> to <Date End Time> |

## Locating KONE Objects in the Journal

You can search for journal entries related to the KONE Elevator.

**NOTE**

DOP and Landing object types are listed in the Journal, in **Options and Tools**, because the DOP and Landing will not have any journal entries.

### To Locate Journal Entries for a KONE Elevator Object

1. Right click a KONE Elevator object in the Hardware Tree and select **Find in Journal** from the context menu. The Query Parameters dialog box opens. By default the query searches in the Journal for occurrences of the selected KONE Elevator System object within the last 7 days.
2. Click **Run**. A Query - Journal for dialog box opens displaying the Journal Entries for the KONE Elevator object. Alternatively, you can click **Modify** to modify the query definition, adding or removing query parameters.

**NOTE**

KONE objects, such as the KONE Clearance Landing Matrix, KONE Default Landing Matrix, and KONE Landing, KONE DOP, and the KONE Global Landing Matrix cannot be removed from the Journal Query due to a C•CURE 9000 limitation.

## Locating KONE Audit Log Entries

You can search for Audit Log Entries related to the KONE Elevator.

### NOTE

Default Landings configured with a schedule and Global Landing Matrix configurations do not capture Audit Logs. Audit Logs are captured for DOP ID, Door Name, and the Default Landing Matrix configurations without a schedule.

### To Locate Audit Log Entries for a KONE Elevator Object

1. Right click a KONE Elevator object in the Hardware Tree and select **Find in Audit Log** from the context menu. The Query parameters dialog box opens. By default the query searches in the Audit Log for occurrences of the selected KONE Elevator System object within the last 7 days.
2. Click **Run**. The Query - Audit Log opens displaying the Audit Log Entries for the KONE Elevator object. Alternatively, you can click **Modify** to modify the query definition, adding or removing query parameters.

Troubleshooting

This chapter helps to resolve problems you may encounter with C•CURE 9000 KONE Elevator Integration.

In this chapter:

Troubleshooting ..... 153



# Troubleshooting

This section provides troubleshooting information for issues that may occur in the KONE Integration.

## Problem


Sometimes the installation may fail if the CrossFire service does not stop on time and throws a time out error.

## Solution

Ensure that you have completed the following steps:

- Check if the CrossFire service is stopped from services panel in case of installation failure. Refer to [Figure 58](#) on [Page 153](#).
- Wait till the CrossFire service is stopped and then trigger the installation again. This will work fine as the service is stopped already.

Figure 58: CrossFire Services

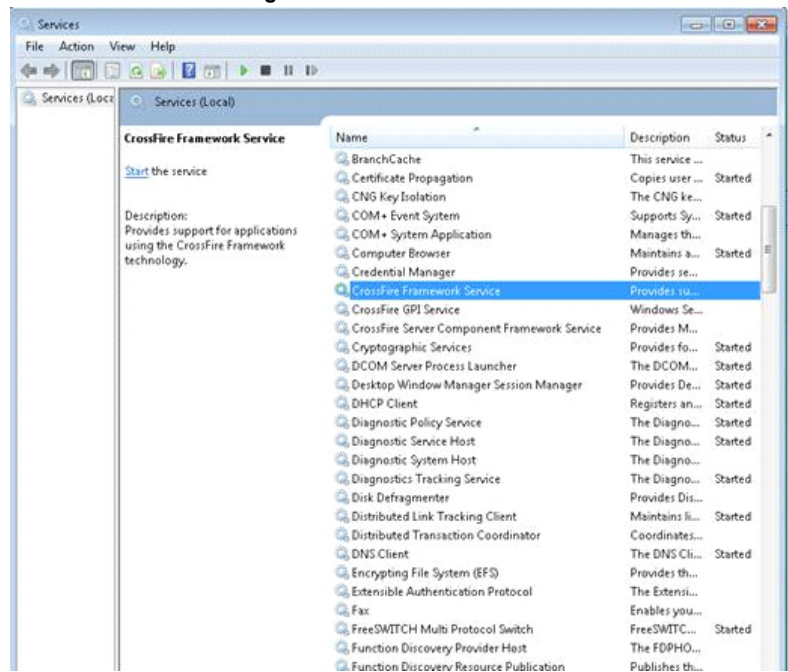

## Third-Party Copyright, Trademarks and License Information

This appendix contains the third-party copyright, trademarks and license information.

In this chapter:

|  |     |
|--|-----|
| Microsoft Limited Public License Information ..... | 155 |
|--|-----|

## Microsoft Limited Public License Information

This software uses QueuedTaskScheduler part of Microsoft Parallel Extensions Extra Library in assembly TSP.Enterprise.Server.ConcurrentTaskLibrary.dll under LPL 1.1 license.

### MICROSOFT LIMITED PUBLIC LICENSE version 1.1

This license governs use of code marked as “sample” or “example” available on this web site without a license agreement, as provided under the section above titled “

NOTICE SPECIFIC TO SOFTWARE AVAILABLE ON THIS WEB SITE.” If you use such code (the “software”), you accept this license. If you do not accept the license, do not use the software.

#### 1. Definitions

The terms “reproduce,” “reproduction,” “derivative works,” and “distribution” have the same meaning here as under U.S. copyright law.

A “contribution” is the original software, or any additions or changes to the software.

A “contributor” is any person that distributes its contribution under this license.

“Licensed patents” are a contributor’s patent claims that read directly on its contribution.

#### 2. Grant of Rights

(A) Copyright Grant - Subject to the terms of this license, including the license conditions and limitations in section 3, each contributor grants you a non-exclusive, worldwide, royalty-free copyright license to reproduce its contribution, prepare derivative works of its contribution, and distribute its contribution or any derivative works that you create.

(B) Patent Grant - Subject to the terms of this license, including the license conditions and limitations in section 3, each contributor grants you a non-exclusive, worldwide, royalty-free license under its licensed patents to make, have made, use, sell, offer for sale, import, and/or otherwise dispose of its contribution in the software or derivative works of the contribution in the software.

#### 3. Conditions and Limitations

(A) No Trademark License- This license does not grant you rights to use any contributors’ name, logo, or trademarks.

(B) If you bring a patent claim against any contributor over patents that you claim are infringed by the software, your patent license from such contributor to the software ends automatically.

(C) If you distribute any portion of the software, you must retain all copyright, patent, trademark, and attribution notices that are present in the software.

(D) If you distribute any portion of the software in source code form, you may do so only under this license by including a complete copy of this license with your distribution. If you distribute any portion of the software in compiled or object code form, you may only do so under a license that complies with this license.

(E) The software is licensed “as-is.” You bear the risk of using it. The contributors give no express warranties, guarantees or conditions. You may have additional consumer rights under your local laws which this license cannot change. To the extent permitted under your local laws, the contributors exclude the implied warranties of merchantability, fitness for a particular purpose and non-infringement.

(F) Platform Limitation - The licenses granted in sections 2(A) and 2(B) extend only to the software or derivative works that you create that run directly on a Microsoft Windows operating system product, Microsoft run-time technology (such as the .NET Framework or Silverlight), or Microsoft application platform (such as Microsoft Office or Microsoft Dynamics).

**Cache Loading Time and Card Swipe Dispatch Time**

This appendix contains the information about the time taken to load cache and the Card Swipe Dispatch Time.

In this chapter:

Cache Loading Time and Card Swipe Dispatch Time .....158

## Cache Loading Time and Card Swipe Dispatch Time

This section provides information about the time taken to load cache and the Card Swipe Dispatch Time based on the number of Personnel Clearance Pairs.

The following system configuration was used to test:

- System Type: VM
- RAM: 8 GB
- No. of Core: 4

### Test Condition and Results

**Condition 1:** Total number of personnel were 50 thousand, each person had 2 Clearances and the following KONE Integration configuration:

| No. of Elevator Servers | No. of DOP | No. of Clearance Landing Matrix | No of Landing | No. of RCGIF |
|-------------------------|------------|---------------------------------|---------------|--------------|
| 2                       | 4          | 15                              | 20            | 1            |

**Result:** Total Personnel Clearance pairs are 100 thousand (50 thousand \* 2). It takes 50 seconds(sec) to load 100 thousand records in cache. The card swipe dispatch time is 35 milli seconds (msec).

**Condition 2:** Total number of personnel were 50 thousand, each person had 5 Clearances and the following KONE Integration configuration:

| No. of Elevator Servers | No. of DOP | No. of Clearance Landing Matrix | No of Landing | No. of RCGIF |
|-------------------------|------------|---------------------------------|---------------|--------------|
| 2                       | 10         | 25                              | 20            | 1            |

**Result:** Total Personnel Clearance pairs are 250 thousand (50 thousand \* 5). It takes 1 minute 40 sec to load 250 thousand records in cache. The card swipe dispatch time is 75 msec.

**Condition 3:** Total number of personnel were 50 thousand, each person had 10 Clearances and the following KONE Integration configuration:

| No. of Elevator Servers | No. of DOP | No. of Clearance Landing Matrix | No of Landing | No. of RCGIF |
|-------------------------|------------|---------------------------------|---------------|--------------|
| 2                       | 10         | 50                              | 20            | 1            |

**Result:** Total Personnel Clearance pairs are 500 thousand (50 thousand \* 10). It takes 4 minutes 20 seconds(sec) to load 500 thousand records in cache. The card swipe dispatch time is 150 msec.

**Condition 4:** Total number of personnel were 50 thousand, each person had 15 Clearances and the following KONE Integration configuration:

| No. of Elevator Servers | No. of DOP | No. of Clearance Landing Matrix | No of Landing | No. of RCGIF |
|-------------------------|------------|---------------------------------|---------------|--------------|
| 2                       | 10         | 50                              | 20            | 1            |

**Result:** Total Personnel Clearance pairs are 750 thousand (50 thousand \* 15). It takes 12 minutes to load 750 thousand records in cache. The card swipe dispatch time is 360 (msec).

