SERVICE PARTS LIST FOR MITSUBISHI ELECTRIC PACKAGED AIR-CONDITIONERS

Series : PEFY-AF•CFM(R)-E

REVISED

Apr. 2016

BWE01419A

INDEX
PEFY-AF1200CFMR-E PEFY-AF1200CFM-E


Part information update day : 2016/04/18

MITSUBISHI ELECTRIC

Please change the old catalog (issued Oct. 2014, No.BWE014190) to this new catalog.
Content of revision : Some of parts are changed.


PEFY-AF1200CFMR-E
PEFY-AF1200CFM-E

EXTERNAL PARTS

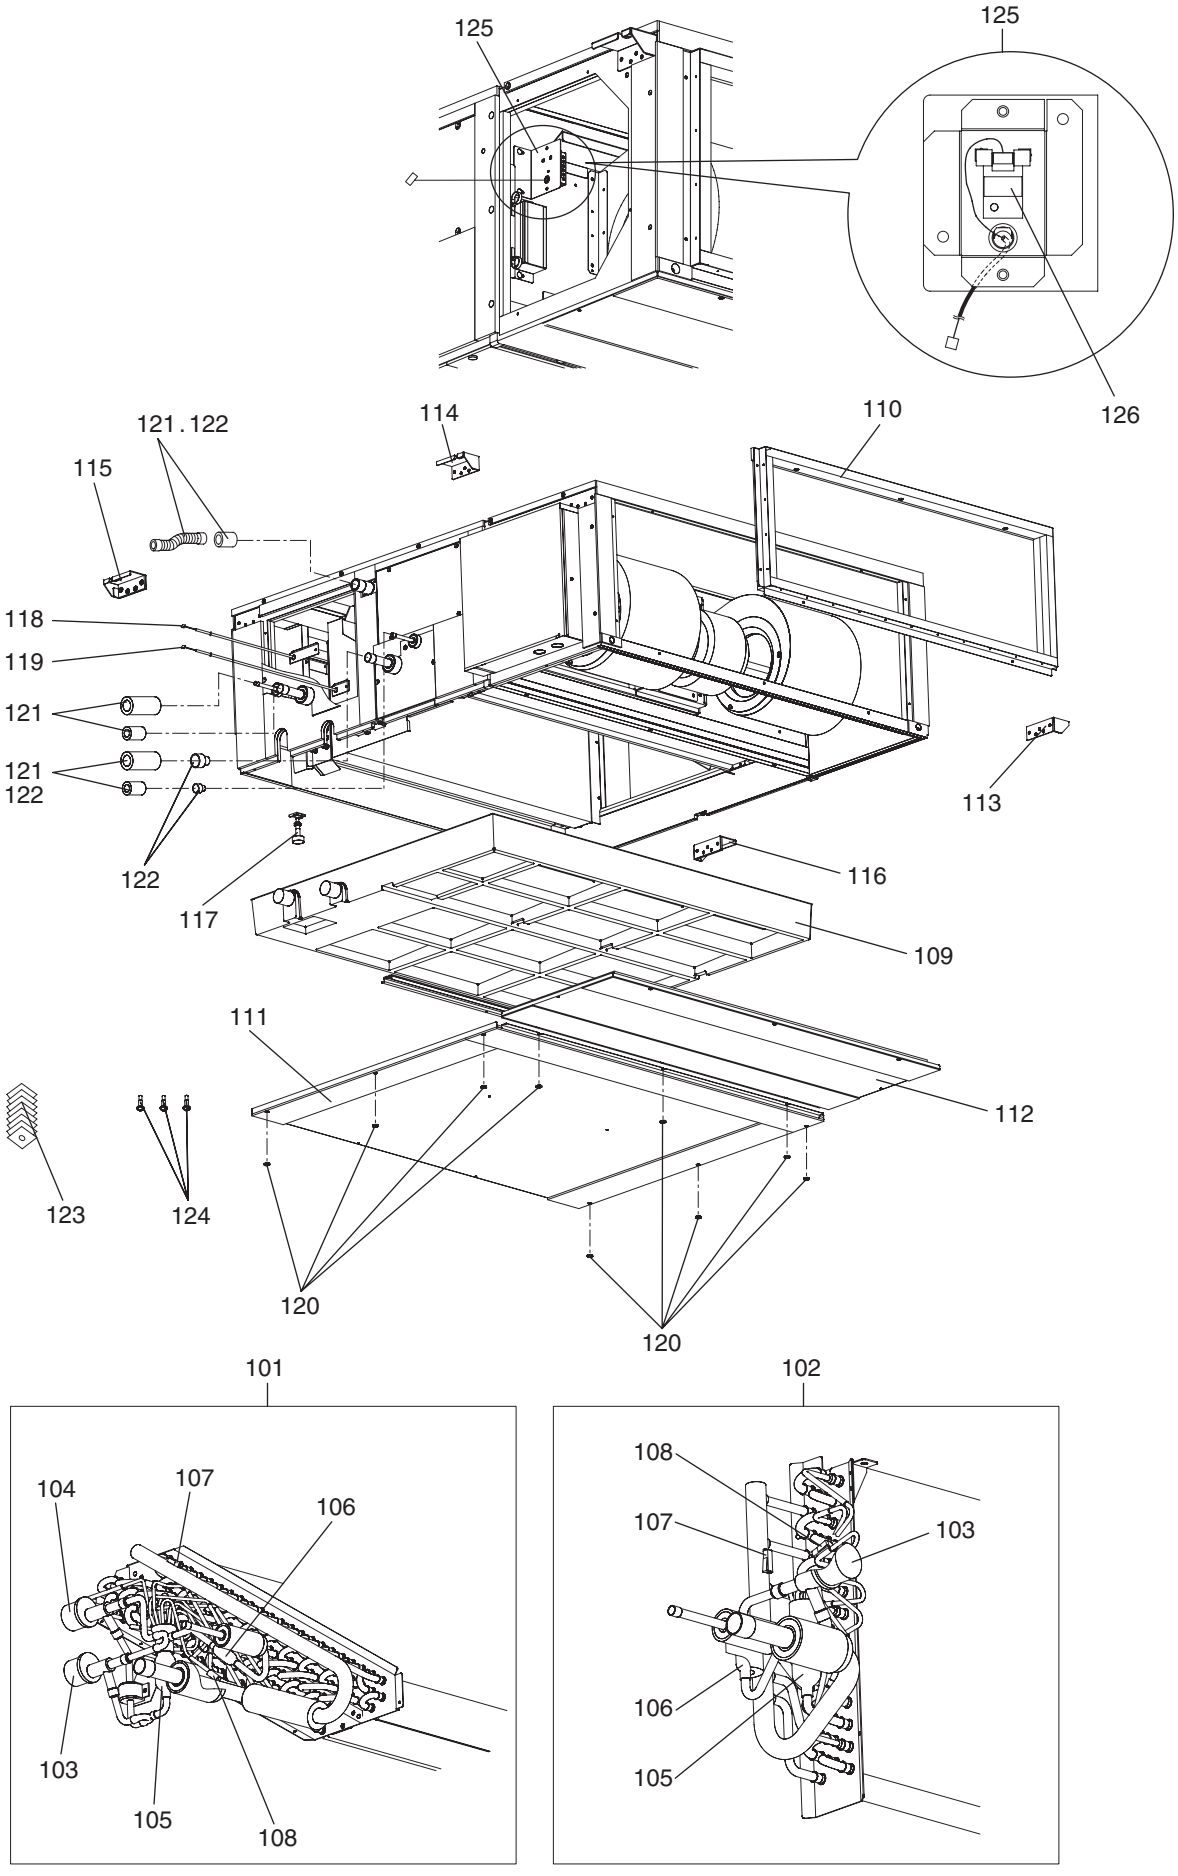


No.	Part No.	G : RoHS Apply Only W : RoHS Apply by Running Change	Part Name	Spec.	PEFY-AF1200CFMR-E	PEFY-AF1200CFM-E					Dwg. No.	Notes for the models	Revision info.
101	R61 326 480	G	Heat exchanger		1	1					KB00A198G07	<MAIN>	
102	R61 327 480	G	Heat exchanger		1						KB00A199G04	<REHEAT>	
103	R61 023 401	W	Linear expansion valve	EFM-80YGMD-9	2	1					P632477X01		
104	R61 025 401	G	Linear expansion valve	EFM-80YGMD-10	1	1					P632478X01		
105	R61 007 454	W	Strainer		2	1					W887585G01		
106	R63 A42 454	G	Strainer		2	1					W882823G01		
107	R61 013 287	W	Sensor		2	1					KB00M970G03	<gas>	
108	R61 037 287	G	Sensor		2	1					KB00U783G10	<liquid>	
109	R61 050 529	G	Drain pan assy		1	1					KB00J100G02		
110	R61 023 457	G	Duct		1	1					KB00R194G04		
111	R61 016 661	G	Panel under 1		1	1					KB00R999G02		
112	R61 017 661	G	Panel under 2		1	1					KB00R170G04		
113	R61 008 326	W	Plate hunger A		1	1					KB02M135H05		
114	R61 009 326	W	Plate hunger B		1	1					KB02M135H06		
115	R61 010 326	W	Plate hunger INS A		1	1					KB00M971G03		
116	R61 011 326	W	Plate hunger INS B		1	1					KB00M971G04		
117	R61 009 541	W	Float switch		1	1					KB00M931G01		
118	R61 098 200	W	Thermistor	MDW106H	1	1					KB78M742G04	<outlet>	
119	R61 099 200	W	Thermistor	MDW106H	1						KB78M742G02	<outlet>	
120	R61 007 600	W	Insulator		9	9					KB33M963H01		
121	R61 021 525	G	Drain hose		1						W650735G25		
122	R61 017 525	G	Drain hose			1					W650735G23		
123	R63 7E4 136	G	Washer		8	8					W909697G01		
124	R61 001 019	W	Shoulder screw	5×25	3	3					P517001X01		
125	R61 028 287	G	Humidity sensor assy		1	1					KB00R794G01		
126	R61 007 287	G	Humidity sensor		1	1					P419202X01		

BLOWER PARTS

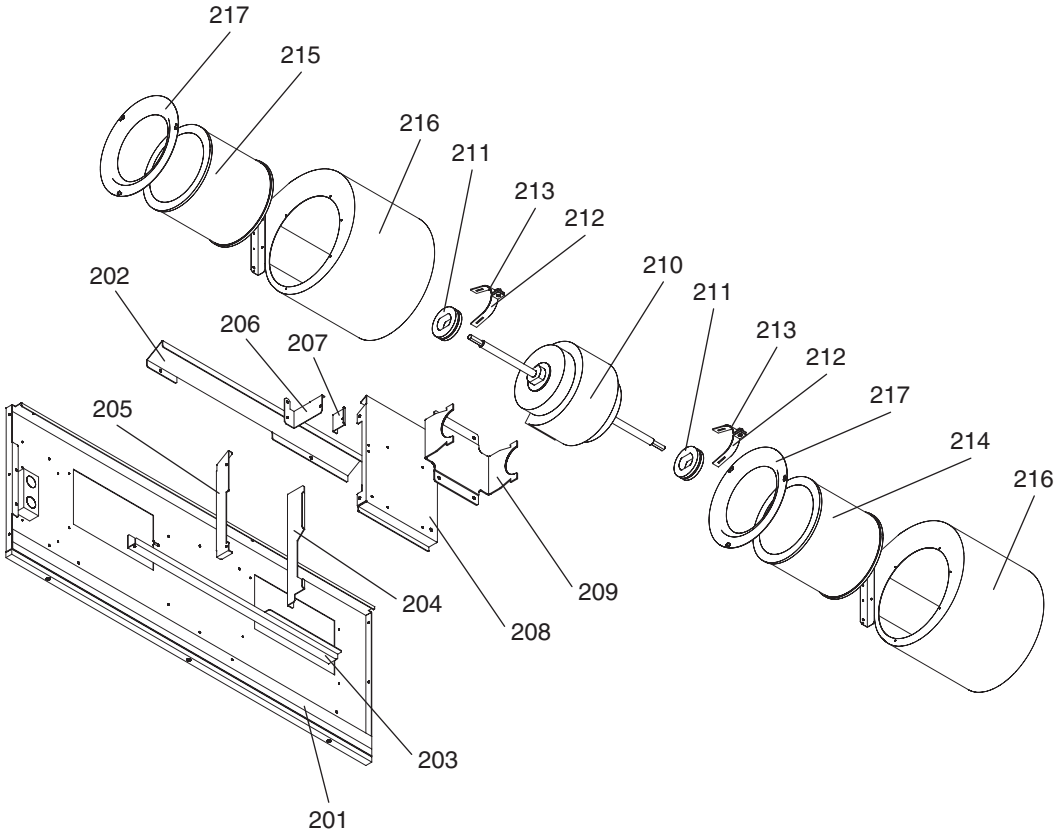

BLOWER PARTS


No.	Part No.	G : RoHS Apply Only W : RoHS Apply by Running Change	Part Name	Spec.	PEFY-AF1200CFMR-E	PEFY-AF1200CFM-E					Dwg. No.	Notes for the models	Revision info.
201	R61 014 140	G	Fan plate		1	1					KB00J128G05		
202	R61 021 128	G	Motor rail 1		1	1					KB02R180H01		
203	R61 022 128	G	Motor rail 2		1	1					KB02R182H01		
204	R61 018 128	W	Motor rail 3		1	1					KB02R183H01		
205	R61 019 128	W	Motor rail 4		1	1					KB02R184H01		
206	R61 035 668	G	Attachment		1	1					W867662G01		
207	R61 002 131	G	Attachment		1	1					KB02M539H01		
208	R61 020 128	W	Motor base		1	1					KB00R149G05		
209	R61 015 130	G	Leg		1	1					KP00K219G01		
210	R61 205 220	G	Motor		1	1					P780266X01		
211	R63 Y01 104	G	Rubber mount		2	2					W860050H02		
212	R61 002 136	G	Fixing plate		2	2					R302K338H02		
213	R61 001 136	G	Fixing plate	with the nut	2	2					R302K338G82		
214	R61 022 114	W	Sirocco fan R		1	1					P712422X01		
215	R61 023 114	W	Sirocco fan L		1	1					P712423X01		
216	R61 014 109	W	Fan case assy		2	2					KB00N716G01		
217	R61 009 119	G	Bell mouth		2	2					KD02R983H01		

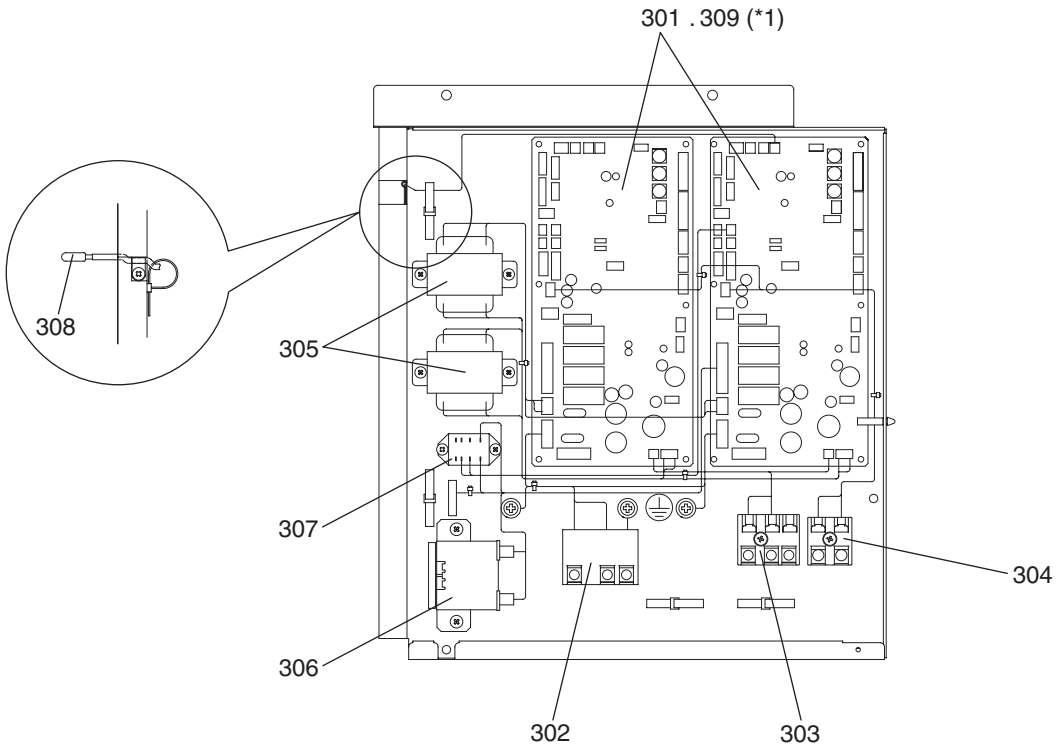

*1 For the products whose serial number is 5XW***** or later, be sure to use No.309.
For the products whose serial number is 59W***** or earlier, No.301 or No.309 can be used.
If the production number of the indoor unit is not available, procure parts No.309.
No.301 will be supplied as long as the stock is available,
and only No.309 will be supplied after the existing stock of No.301 is depleted.

	～59W*****	5XW*****～
No.301	USE	NOT USE
No.309	USE	USE

Serial No. of Air Conditioning & Refrigeration Systems Works.

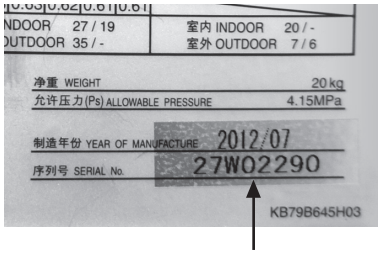

Serial No.

2 7 W 0 2 2 9 0

Serial number

Air Conditioning & Refrigeration Systems Works (Wakayama) identification.
W stands for W of WAKAYAMA.

Production month


Production **season** of Air Conditioning & Refrigeration Systems Works **April to March**
In this case, July / 2012

Production month / season

2 4 April / 2012
2 5 May / 2012
2 6 June / 2012
2 7 July / 2012
2 8 August / 2012
2 9 September / 2012
2 X October / 2012
2 Y November / 2012
2 Z December / 2012
2 1 January / 2013
2 2 February / 2013
2 3 March / 2013
3 4 April / 2013
3 5 May / 2013

PEFY-AF1200CFMR-E CONTROL BOX PARTS (1)


No.	Part No.	G : RoHS Apply Only W : RoHS Apply by Running Change	Part Name	Spec.	PEFY-AF1200CFMR-E						Dwg. No.	Notes for the models	Revision info.
301	R61 226 280	G	PCA board		2						KE00D204G41	*1	
302	R63 Y08 715	G	Terminal block		1						P436239X01	<TB2>	
303	R61 003 246	G	Terminal block		1						BG00R200G45	<TB5>	
304	R61 005 246	G	Terminal block		1						BG73J860G01	<TB15>	
305	R61 004 260	G	Transformer		2						P715419X01		Chg.
306	R61 003 252	W	Capacitor	440V	1						P412331X01		
307	R61 A59 215	W	Relay	MY-2F	1						P421239X01		
308	R61 020 287	W	Thermistor	M15-3D	1						KB00U783G08	<inlet>	
309	R61 433 280	G	PCA board		2						KE00D204G51	*1	Add

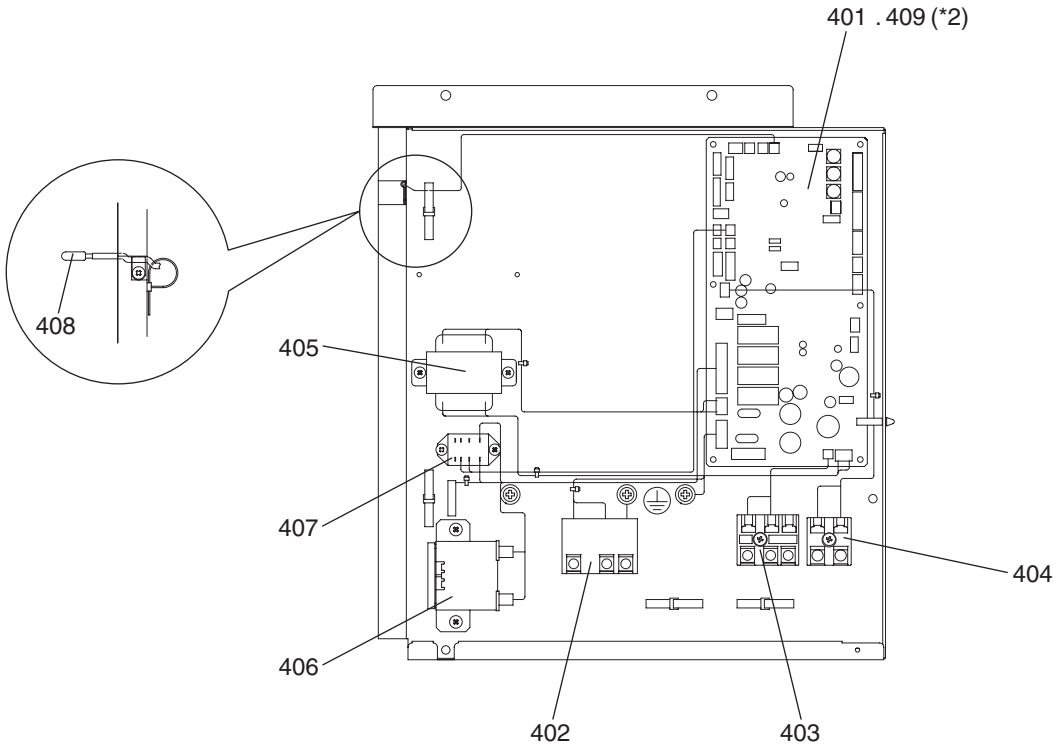

*2 For the products whose serial number is 5XW***** or later, be sure to use No.409.
For the products whose serial number is 59W***** or earlier, No.401 or No.409 can be used.
If the production number of the indoor unit is not available, procure parts No.409.
No.401 will be supplied as long as the stock is available,
and only No.409 will be supplied after the existing stock of No.401 is depleted.

	～59W*****	5XW*****～
No.401	USE	NOT USE
No.409	USE	USE

Serial No. of Air Conditioning & Refrigeration Systems Works.

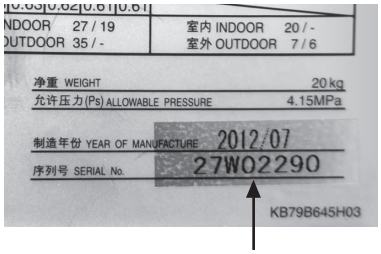

Serial No.

2 7 W 0 2 2 9 0

Serial number

Air Conditioning & Refrigeration Systems Works (Wakayama) identification.
W stands for W of WAKAYAMA.

Production month


Production **season** of Air Conditioning & Refrigeration Systems Works **April to March**
In this case, July / 2012

Production month / season

2 4 April / 2012
2 5 May / 2012
2 6 June / 2012
2 7 July / 2012
2 8 August / 2012
2 9 September / 2012
2 X October / 2012
2 Y November / 2012
2 Z December / 2012
2 1 January / 2013
2 2 February / 2013
2 3 March / 2013
3 4 April / 2013
3 5 May / 2013

No.	Part No.	G : RoHS Apply Only W : RoHS Apply by Running Change	Part Name	Spec.	PEFY-AF1200CFM-E					Dwg. No.	Notes for the models	Revision info.
401	R61 226 280	G	PCA board		1					KE00D204G41	*2	
402	R63 Y08 715	G	Terminal block		1					P436239X01	<TB2>	
403	R61 003 246	G	Terminal block		1					BG00R200G45	<TB5>	
404	R61 005 246	G	Terminal block		1					BG73J860G01	<TB15>	
405	R61 004 260	G	Transformer		1					P715419X01		Chg.
406	R61 003 252	W	Capacitor	440V	1					P412331X01		
407	R61 A59 215	W	Relay	MY-2F	1					P421239X01		
408	R61 020 287	W	Thermistor	M15-3D	1					KB00U783G08	<inlet>	
409	R61 433 280	G	PCA board		1					KE00D204G51	*2	Add

DRAIN PUMP PARTS

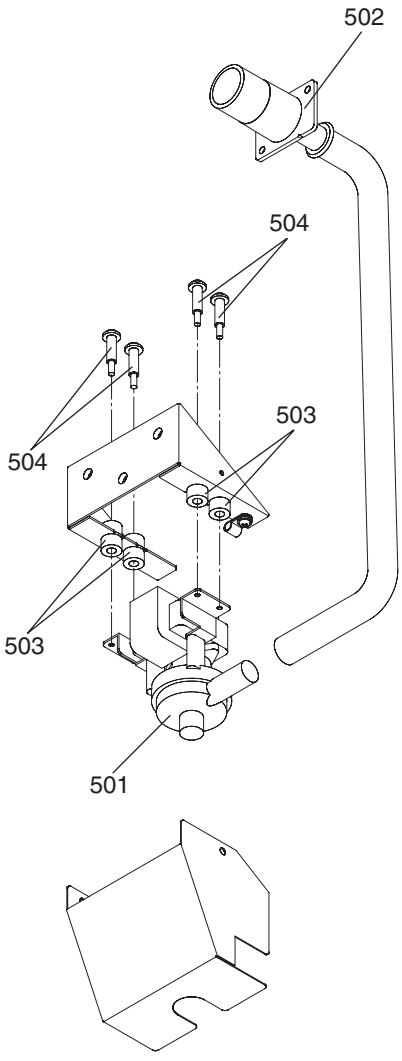

DRAIN PUMP PARTS

No.	Part No.	G : RoHS Apply Only W : RoHS Apply by Running Change	Part Name	Spec.	PEFY-AF1200CFMR-E	PEFY-AF1200CFM-E					Dwg. No.	Notes for the models	Revision info.
501	R61 010 539	G	Pump	PLD	1	1					P722125X02		
502	R61 041 525	G	Socket assy		1	1					KB00R979G02		
503	R61 018 104	G	Cushion		4	4					DB26F013L01		
504	R61 002 019	G	Screw special	M4×6	4	4					Y112J017H05		

MITSUBISHI ELECTRIC CORPORATION

BWE01419A (20160430)