

CITY MULTI® Outdoor Unit: 18-TON PURY-P216TSJMU-A-BS

(Consists of One PURY-P120TJMU-A-BS, One PURY-P96TJMU-A-BS, and One CMY-R100XLVBK Twinning Kit)

Job Name: _____ Location: _____

Drawing Reference: _____ Schedule No. _____

System No.: _____ Date: _____

OUTDOOR VRFZ HEAT RECOVERY SYSTEM FEATURES

- 3-phase, 208/230V
- Modular variable refrigerant flow zoning (VRFZ) systems; smaller capacity units can be piped together to form a single, large-capacity two-pipe system
- Required Twinning Kit allows for easy field piping connection
- Selectable fan static, 0.12 or 0.24"WG external static pressure; factory set to 0"WG
- Max. Total Refrigerant Piping Length: 1,804' (P72,96), 1,969' (P120,144,168), 2,461' (P192), 2,625' (P216,240), 3,280' (P264,288); Max. Refrigerant Line Length: 541'; Max. Control Wiring Length: 1,650'
- Connects to CITY MULTI indoor units; controlled via CITY MULTI Controls Network (CMCN)
- External finish: Pre-coated Galvanized-steel Sheets with thermoset polyester-resin
- Operating Temperature Range
 - Cooling (Outdoor): 23° ~ 115°F (-5° ~ +46°C) DB
 - Heating (Outdoor): -4° ~ +60°F (-20° ~ +16°C) WB



PURY-P120TJMU-A-BS PURY-P96TJMU-A-BS

INVERTER



OPTIONAL PARTS

- ☐ Twinning Kit* CMY-R100XLVBK
 - ☐ Branch Joint (T-Branch: ≤ 72,000 Btu/h).....CMY-Y102S-G2
 - ☐ Branch Joint (T-Branch: 73,000-144,000 Btu/h).....CMY-Y102L-G2
 - ☐ Branch Joint (T-Branch: 145,000-234,000 Btu/h).....CMY-Y202-G2
 - ☐ Joint Adapter (Port Connector > 54,000 Btu/h).....CMY-R160J
 - ☐ Main BC Controller.....CMB-P108/1010/1013/1016NU-GA/1016NU-HA
 - ☐ Sub BC Controller.....CMB-P104/108NU-GB/1016NU-HB
- * Twinning Kit is necessary to combine the refrigerant flows of the modules and is included in the outdoor unit set.

Specifications		System	Module 1	Module 2		
Unit Type		PURY-P216TSJMU-A-BS	PURY-P120TJMU-A-BS	PURY-P96TJMU-A-BS		
Nominal Cooling Capacity	Btu/h	216,000	120,000	96,000		
Nominal Heating Capacity	Btu/h	243,000	135,000	108,000		
External Dimensions (H x W x D)	In. / mm	Refer to Module Data	65 x 68-15/16 x 29-15/16 / 1,650 x 1,750 x 760	65 x 48-1/16 x 29-15/16 / 1,650 x 1,220 x 760		
Net Weight	Lbs. / kg	1,280 / 580	695 / 315	585 / 265		
Electrical Power Requirements	Voltage, Phase, Hertz	Refer to Module Data**	208 / 230V, 3-phase, 60Hz			
Cooling Power Input	kW	18.32	Refer to System Data			
Heating Power Input	kW	20.27				
Cooling Current (208/230V)	R.L.A.	56.5 / 51.0				
Heating Current (208/230V)	R.L.A.	62.5 / 56.5	Refer to System Data			
Minimum Circuit Ampacity (MCA)**	A	Refer to Module Data**			49 / 46**	35 / 32**
Recommended Fuse/Breaker Size **	A	Refer to Module Data**			50**	40**
Maximum Fuse Size**	A	Refer to Module Data**	70 / 70**	50 / 50**		
Piping Diameter			Refer to System Data			
From Twinning Kit to Indoor Units (Brazed) (In. / mm)	Liquid (High Pressure)	1-1/8 / 28.58				
	Gas (Low Pressure)	1-1/8 / 28.58				
From Modules to Twinning Kit (Brazed) (In. / mm)	Liquid (High Pressure)	Refer to Module Data	3/4 / 19.05	3/4 / 19.05		
	Gas (Low Pressure)		1-1/8 / 28.58	7/8 / 22.2		
Indoor Unit	Total Capacity	50 to 150% of ODUs	Refer to System Data			
	Model / Quantity	P06 ~ P96 / 2 to 50 (Max. No. Connectable Branches: 48)				
Sound Pressure Levels	dB(A)	62.5	60.0	58.0		
Fan		Refer to Module Data				
Type x Quantity			Propeller Fan x 2	Propeller Fan x 1		
Airflow Rate	CFM		10,600	6,180		
Direct-drive Inverter Motor Output	kW		0.92 + 0.92	0.92		
Compressor Operating Range		8 to 100%	Refer to System Data			
Compressor Type x Quantity		Refer to Module Data	Inverter-driven Scroll Hermetic x 1	Inverter-driven Scroll Hermetic x 1		
Compressor Motor Output	kW		8.1	7.0		
Compressor Crankcase Heater	kW		0.045	0.045		
Refrigerant		Refer to Module Data	R410A			
Lubricant			MEL32			
High-pressure Protection Device		Refer to Module Data	601 psi / 4.15 MPa	601 psi / 4.15 MPa		
Compressor / Fan Protection Device			Overheat Protection / Thermal Switch	Overheat Protection / Thermal Switch		
Inverter Protection Device			Overheat / Overcurrent Protection	Overheat / Overcurrent Protection		


Blue Fin Anti-corrosion Protection: Cellulose- and polyurethane-resin coating treatment applied to condenser coil that protects it from air contaminants; ≥1μm thick; Salt Spray Test Method - no unusual rust development to 960 hours.

** Each individual module requires a separate electrical connection. Reference electrical data for each individual module.

SEACOAST PROTECTION

- External Panel Base, External Front Panel, Pillar: Alloyed galvanized-steel sheets with thermoset polyester-resin coating on internal and external surfaces
- Compressor Cover: Galvanized-aluminum sheets with thermoset polyester-resin coating on internal and external surfaces
- Electrical Parts Box: Galvanized-aluminum sheets with thermoset polyester-resin coating on external surface
- Fan Motor Support: Galvanized-steel sheets with thermoset polyester-resin coating on internal and external surfaces
- Printed Circuit Board: Epoxy resin with polyurethane-coating on external surface

Outdoor Unit: PURY-P216TSJMU-A-BS – DIMENSIONS

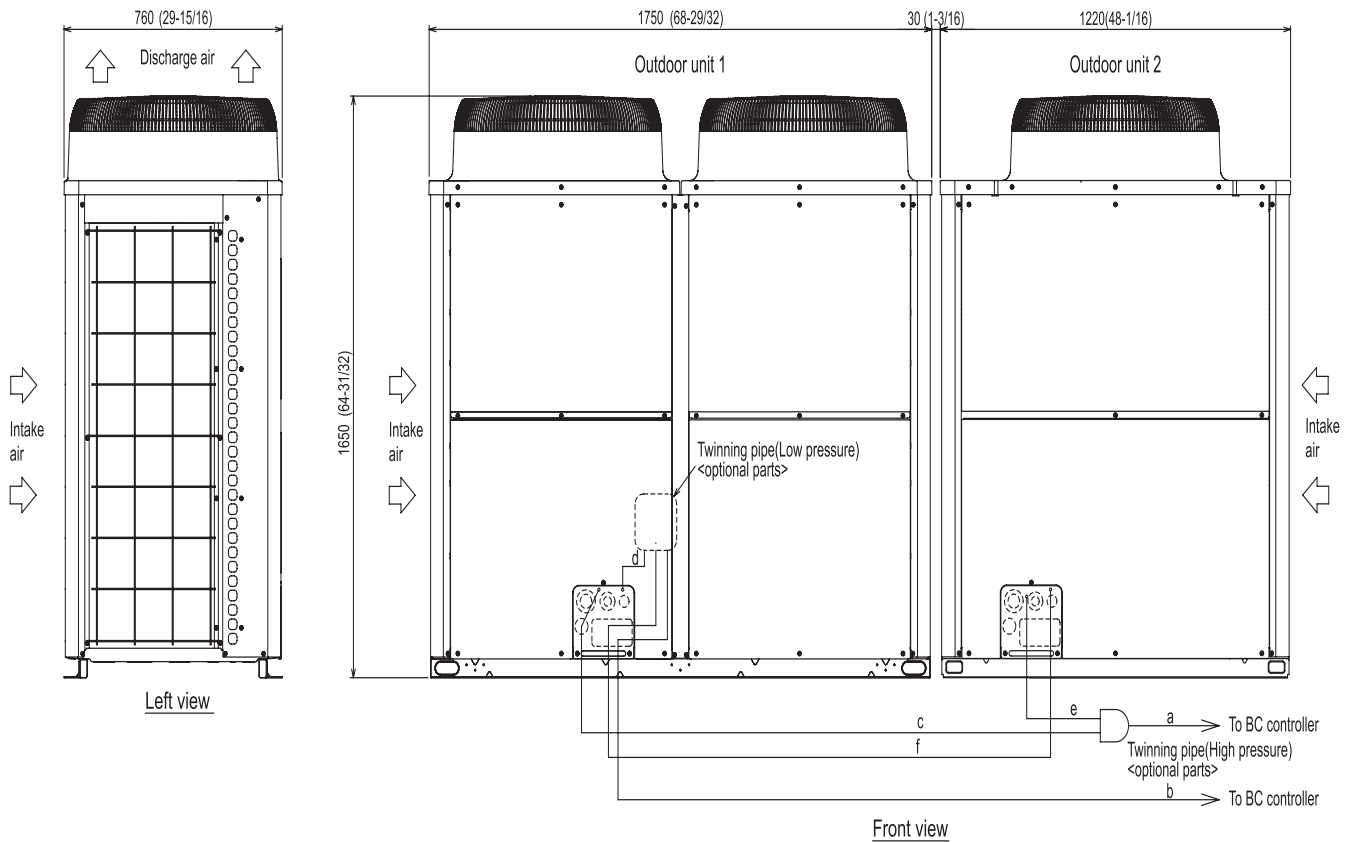

Twining pipe connection size

Package unit name		PURY-P216TSJMU-A(-BS)	
Component unit name	Outdoor unit 1	PURY-P120TJMU-A(-BS)	
	Outdoor unit 2	PURY-P96TSJMU-A(-BS)	
Outdoor Twining Kit(optional parts)		CMY-R100XLVBK	
BC controller-Twining pipe	High pressure	a	ø28.58(1-1/8)
	Low pressure	b	ø28.58(1-1/8)

	Unit model	High pressure	Low pressure
Twining pipe-Outdoor unit	P96	c or e ø19.05(3/4)	d or f ø22.2(7/8)
	P120	ø19.05(3/4)	ø28.58(1-1/8)

Note 1.Connect the pipes as shown in the figure above. Refer to the table above for the pipe size.

2.Twining pipe (High pressure) should not be tilted more than 15 degrees from the horizontal plane.

Be sure to see the Installation Manual for details of Twining pipe installation.

3.The pipe section before the Twining pipe (section "a" in the figure) must have at least 500mm(19-11/16) of straight section
(*including the straight pipe that is supplied with the Twining pipe).

4.Only use the Twining pipe by Mitsubishi (optional parts).


Unit : mm(in.)

Twinning Kit: CMY-R100XLVBK


CMY-R100XLVBK

unit : inch


Low-pressure pipe twinning kit

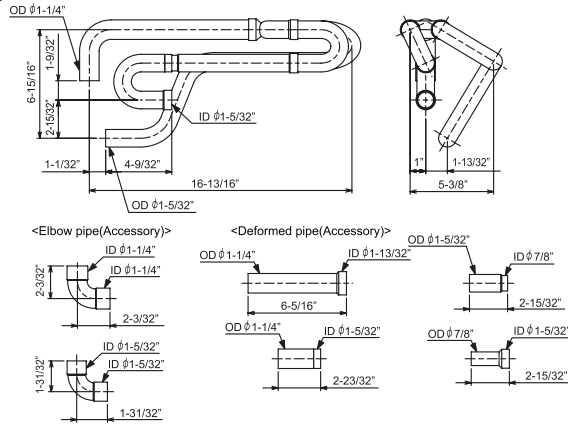

High-pressure twinning pipe

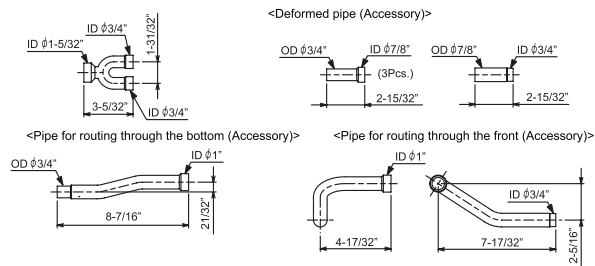

Module 1: PURY-P120TJMU-A-BS – DIMENSIONS

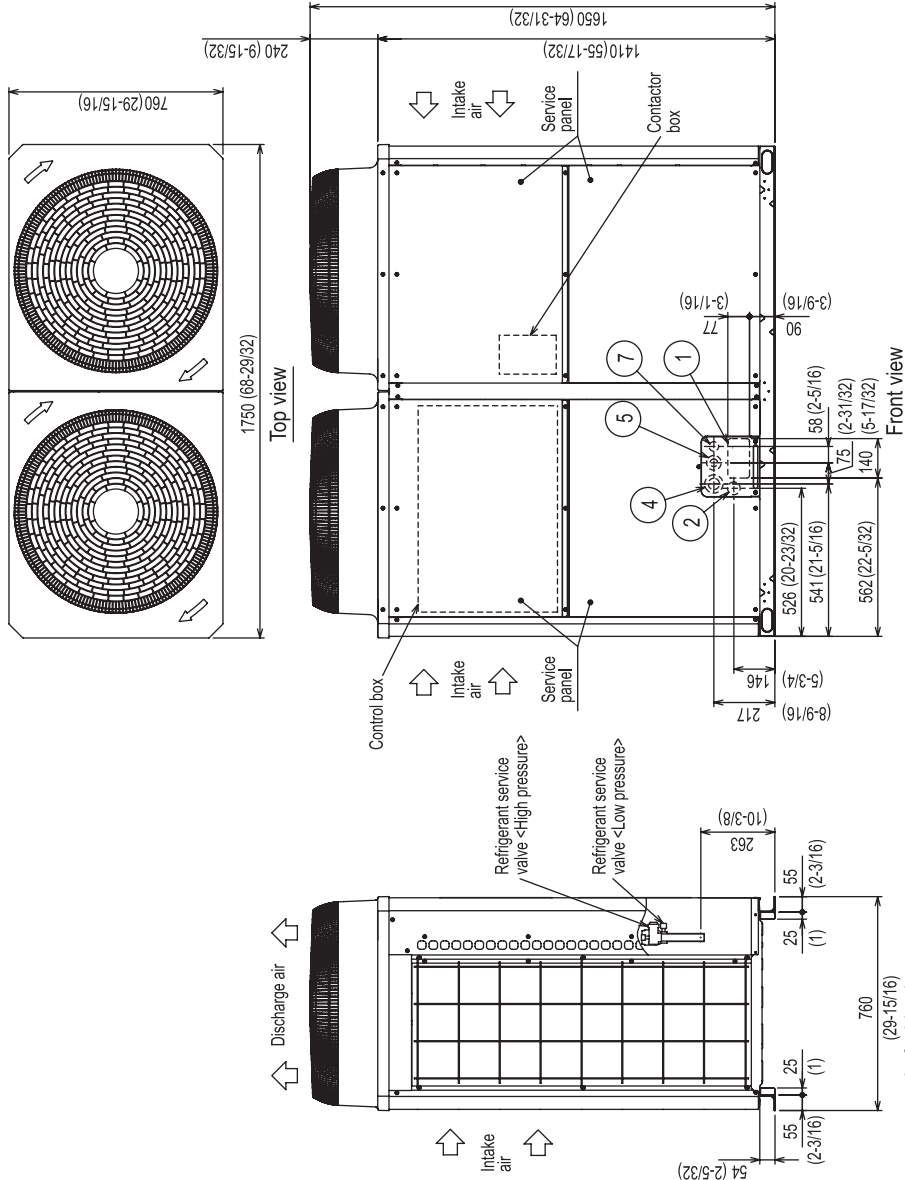

- <Optional parts>
- Connecting pipe
 - <High pressure>
 - Pipe (IDø25.4(1)XODø19.05(3/4)).....P120 1 pc.
 - Pipe (IDø25.4(1)XODø22.27(8)).....P144 1 pc.
 - Elbow (IDø19.05(3/4)XODø19.05(3/4)).....P120 1 pc.

Note 1 Please refer to (22) for information regarding necessary spacing around the unit and foundation work.

2. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).


NO.	Usage	Specifications
①	Front through hole	140 X 77 Knockout hole (5-17/32) (3-1/16)
②	Front through hole (Uses when twinning kit (optional parts) is mounted.)	ø45 Knockout hole (1-25/32)
③	Bottom through hole	150 X 94 Knockout hole (5-29/32) (3-23/32)
④	Front through hole	ø62.7 or ø34.5 Knockout hole (2-15/32) (1-3/8)
⑤	Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
⑥	Bottom through hole	ø65 Knockout hole (2-9/16)
⑦	For transmission cables	ø34 Knockout hole (1-11/32)

Connecting pipe specifications		
Connection specifications for the refrigerant service valve *1		
Model	High pressure	Low pressure
PURY-P120TJMU	ø19.05 Brazed (3/4)	ø28.58 Brazed (1-1/8)
PURY-P144TJMU	ø22.2 Brazed (7/8)	

*1. Connect by using the connecting pipes (for bottom piping and front piping) that are sold separately.

Unit : mm (in.)

Module 2: PURY-P96TJMU-A-BS – DIMENSIONS

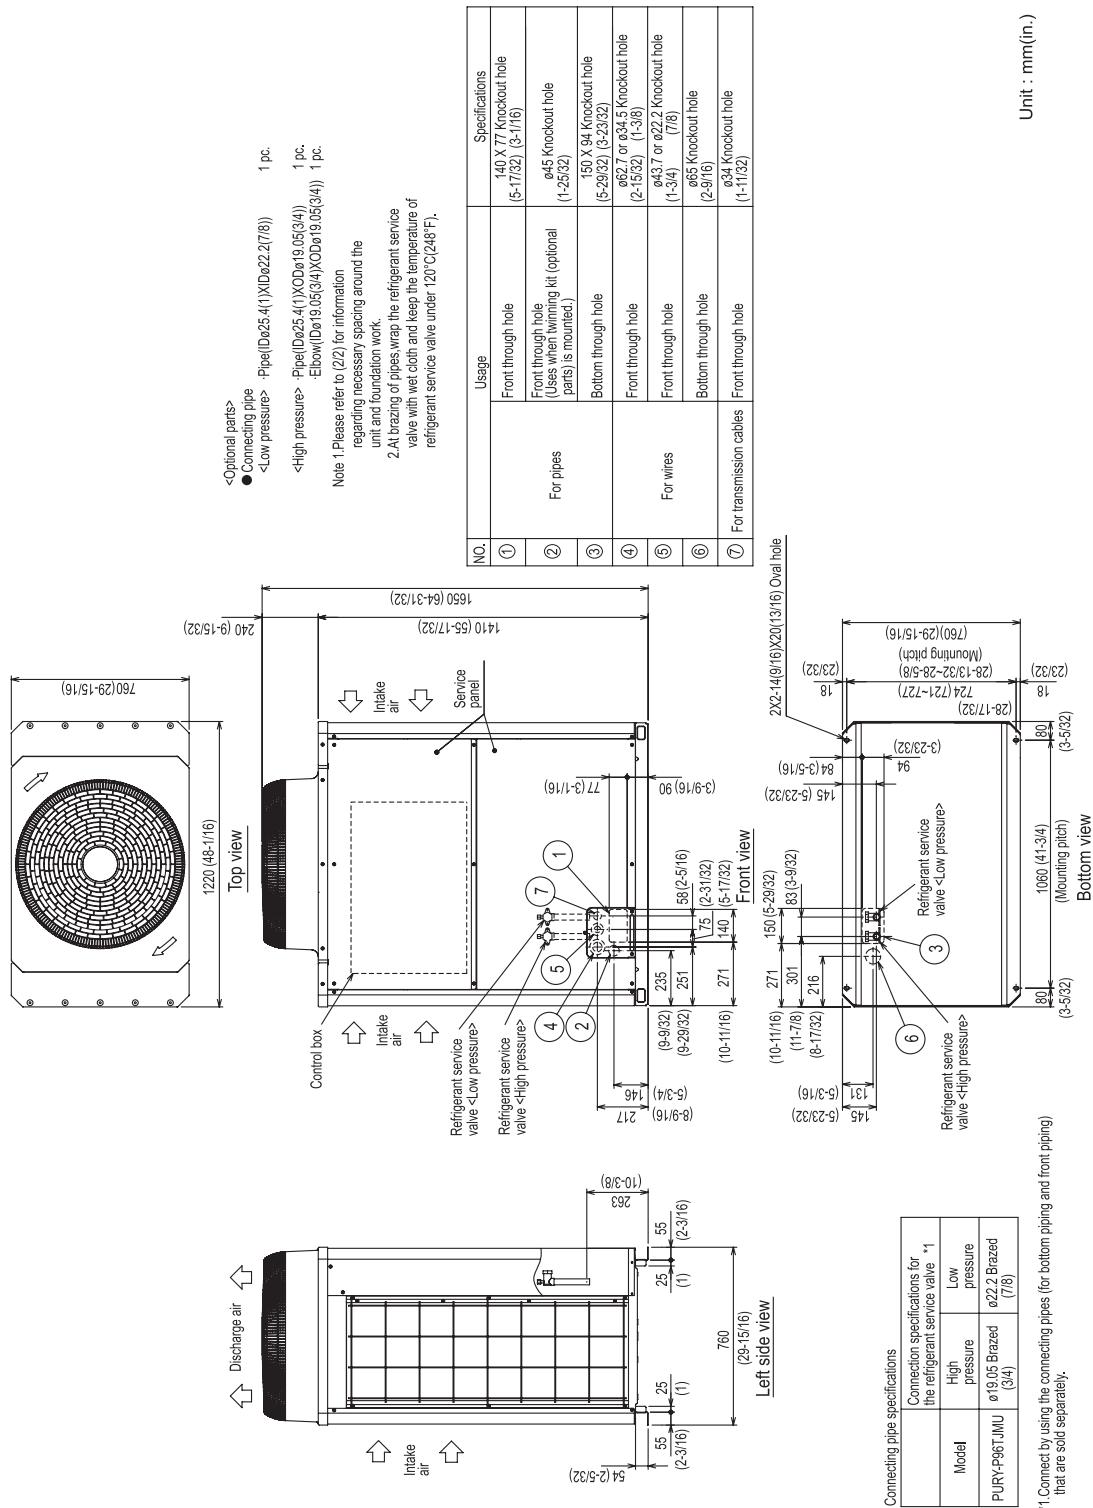

Connecting pipe specifications

Model	Connection specifications for the refrigerant service valve *	
	High pressure	Low pressure
PURY-P96TJMU	ø19.05 Braze (3/4)	ø22.2 Braze (7/8)

*1. Connect by using the connecting pipes (for bottom piping and front piping) that are sold separately.



Certificate Number FM33568

Mitsubishi Electric Air Conditioning & Refrigeration Systems Works acquired ISO 9001 certification under Series 9000 of the International Standard Organization (ISO) based on a review of quality warranties for the production of refrigeration and air conditioning equipment.

ISO Authorization System
The ISO 9000 series is a plant authorization system relating to quality warranties as stipulated by the ISO. ISO 9001 certifies quality warranties based on the "design, development, production, installation and auxiliary services" for products built at an authorized plant.

Mitsubishi Electric Air Conditioning & Refrigeration Systems Works acquired environmental management system standard ISO 14001 certification.

The ISO 14000 series is a set of standards applying to environmental protection set by the International Standard Organization (ISO).



Certificate Number EC97J1227

C SD - PURY-P216TSJMU-A-BS - 1 - 201006 © MITSUBISHI ELECTRIC / HVAC 2010



HVAC Advanced Products Division
Mitsubishi Electric & Electronics USA, Inc.

3400 Lawrenceville Suwanee Rd.
Suwanee, GA 30024
Tele: 678-376-2900 • Fax: 800-889-9904
Toll Free: 800-433-4822 (#4)
www.mehvac.com

Specifications are subject to change without notice.