CITYMULTI®

Outdoor Unit: 18-TON PURY-P216YSLMU-A (-BS)

(Consists of One PURY-P120YLMU-A (-BS), One PURY-P96YLMU-A (-BS), and One CMY-ER200CBK Twinning Kit)

MITSUBISHI ELECTRIC

Job Name:	
System Reference:	Date:



OUTDOOR VRF HEAT PUMP WITH HEAT RECOVERY SYSTEM

UNIT OPTION

- □ Standard Model……PURY-P216YSLMU-A
- □ Seacoast (BS) Model……PURY-P216YSLMU-A-BS

ACCESSORIES

- ■ Twinning Kit (required)……CMY-ER200CBK
- □ Joint Kit……for details see Pipe Accessories Submittal
- ■ BC Controller (required)……for details see BC Controller Submittals
- □ Low Ambient Kit ……for details see Low Ambient Kit Submittal
- □ Snow/Hail Guards Kit……for details see Snow/Hail Guards Kit Submittal
- □ Base Pan Heater Kit……for details see Base Pan Heater Kit Submittal

Specifications		System	Module 1	Module 2
Unit Type		PURY-P216YSLMU-A (-BS)	PURY-P120YLMU-A (-BS)	PURY-P96YLMU-A (-BS)
Nominal Cooling Capacity (460V)	Btu/h	216,000	120,000	96,000
Nominal Heating Capacity (460V)	Btu/h	243,000	135,000	108,000
Operating Temperature Range *1	Cooling (Outdoor) *2	Refer to Module Data	23~126° F (-5~52° C) DB	
	Heating (Outdoor)		-13~60° F (-25~15.5° C) WB	
External Dimensions (H x W x D)	In. (mm)	Refer to Module Data	64-31/32 x 68-29/32 x 29-5/32 (1,650 x 1,750 x 740)	64-31/32 x 48-1/16 x 29-5/32 (1,650 x 1,220 x 740)
Net Weight	Lbs. (kg)	1,264 (573)	730 (331)	534 (242)
External Finish		Refer to Module Data	Pre-coated galvanized steel sheet	
Electrical Power Requirements	Voltage, Phase, Hertz	Refer to Module Data**	460V, 3-Phase, 60Hz	
Minimum Circuit Ampacity (MCA)	A	Refer to Module Data**	19	15
Maximum Overcurrent Protection (MOP)	A	Refer to Module Data**	30	25
Piping Diameter (Brazed)				
From From Twinning Kit to BC Controller (In. / mm)	Liquid (High Pressure)	1-1/8 (28.58)	Refer to System Data	
	Gas (Low Pressure)	1-1/8 (28.58)		
Max. Total Refrigerant Line Length	Ft.	2,625	Refer to System Data	
Max. Refrigerant Line Length (Between ODU & IDU)	Ft.	541		
Max. Control Wiring Length	Ft.	1,640		
Indoor Unit	Total Capacity	50~150% of ODUs	Refer to System Data	
	Model / Quantity	P06~P96/2~50 (Max. No. Connectable Branches: 48)	Refer to System Data	
Sound Pressure Level	dB(A)	62.0	Refer to System Data	
Fan				
Type x Quantity		Refer to Module Data	Propeller fan x 2	Propeller fan x 1
Airflow Rate	CFM		11,300	6,550
External Static Pressure	In. WG	Refer to Module Data	Selectable; 0, 0.12 or 0.24"WG; factory set to 0"W.G.	
Compressor Operating Range		5% to 100%	Refer to System Data	
Compressor Type x Quantity		Refer to Module Data	Inverter-driven Scroll Hermetic x 1	Inverter-driven Scroll Hermetic x 1
Refrigerant		Refer to Module Data	R410A; 23 lbs. + 2 oz. (10.5 kg)	R410A; 17 lbs. + 10 oz. (8.0 kg)
Protection Devices	High Pressure	Refer to Module Data	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)	High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter Circuit (Comp. / Fan)		Over-current protection	Over-current protection
	Fan Motor		Thermal switch	Thermal switch
AHRI Ratings (Ducted/Non-Ducted)	EER	11.7 / 12.4	Refer to System Data	
	IEER	21.5 / 22.9		
	COP	3.52 / 3.59		
	SCHE	22.7 / 26.9		

NOTES:

*1. When applying product below -4° F, consult your design engineer for cold climate application best practices, including the use of a backup source for heating.

*2. For details on extended cooling operation range down to -10° F DB, see Low Ambient Kit Submittal.


** Each individual module requires a separate electrical connection. Refer to electrical data for each individual module.

Specifications are subject to change without notice.

© 2016 Mitsubishi Electric US, Inc.

Outdoor Unit: PURY-P216YSLMU-A (-BS) – DIMENSIONS

Unit: mm (in.)

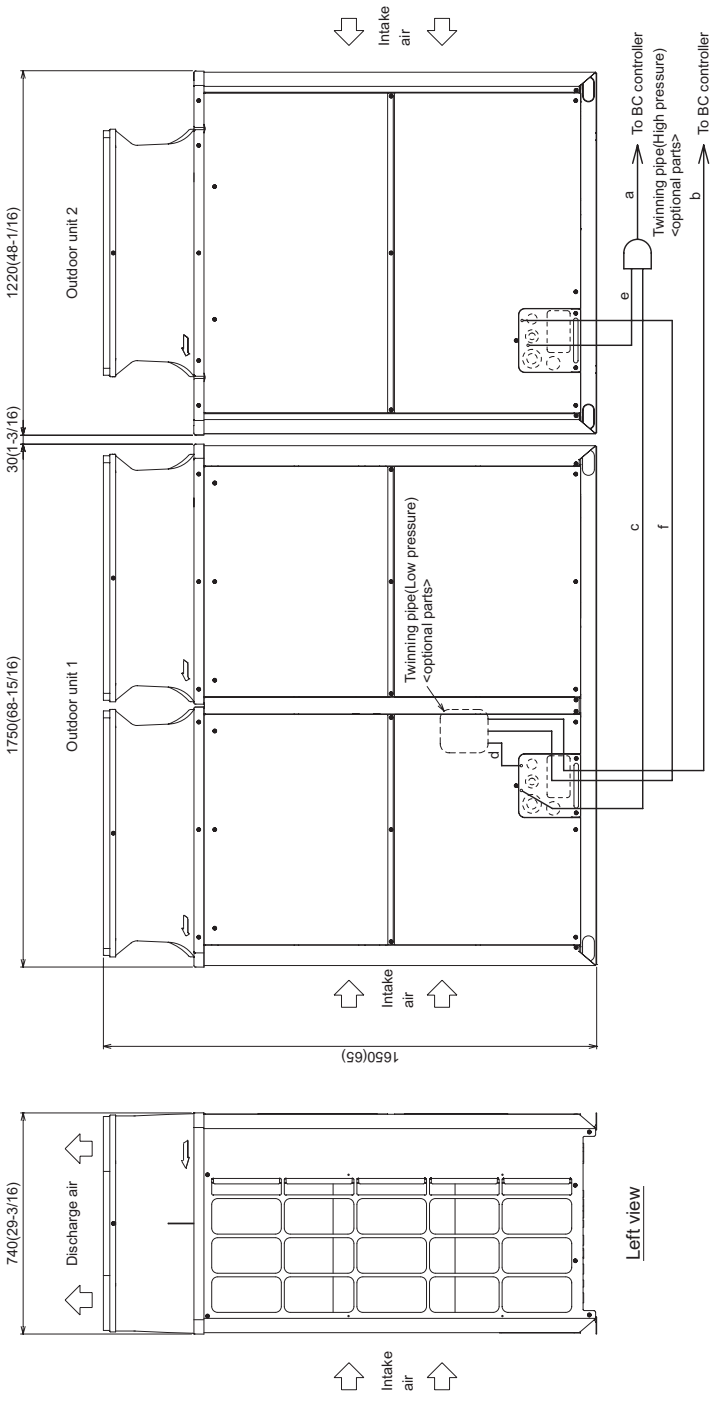

Twinning pipe connection size

Package unit name		PURY-P216YSLMU-A(-BS)	
Component unit name	Outdoor unit 1	PURY-P120YLMU-A(-BS)	
	Outdoor unit 2	PURY-P96YLMU-A(-BS)	
Outdoor Twinning Kit(optional parts)		CMY-ER200CBK	
BC controller~Twinning pipe	High pressure	a	ø28.58(1-1/8)
	Low pressure	b	ø28.58(1-1/8)

		Unit model	P216	
		Component unit model	P120	P96
Twinning Kit ~Outdoor unit	High pressure	c	ø19.05(3/4)	ø19.05(3/4)
	Low pressure	d	- (Note 5)	ø22.2(7/8)

Note 1. Connect the pipes as shown in the figure above. Refer to the table above for the pipe size.
2. Twinning pipe (High pressure) should not be tilted more than 15 degrees from the horizontal plane. Be sure to see the Installation Manual for details of Twinning pipe installation.
3. The pipe section before the Twinning pipe (section "a" in the figure) must have at least 500mm(19-11/16) of straight section ("including the straight pipe that is supplied with the Twinning pipe).
4. Only use the Twinning pipe by Mitsubishi (optional parts).
5. Connect the outdoor unit 1 with the Twinning pipe (Low pressure) (section "d" in the figure).

NOTES:
SEACOAST PROTECTION


- Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
- Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
- Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.

Specifications are subject to change without notice.

© 2016 Mitsubishi Electric US, Inc.

Module 1: PURY-P120YLMU-A (-BS) – DIMENSIONS

Unit: mm (in.)

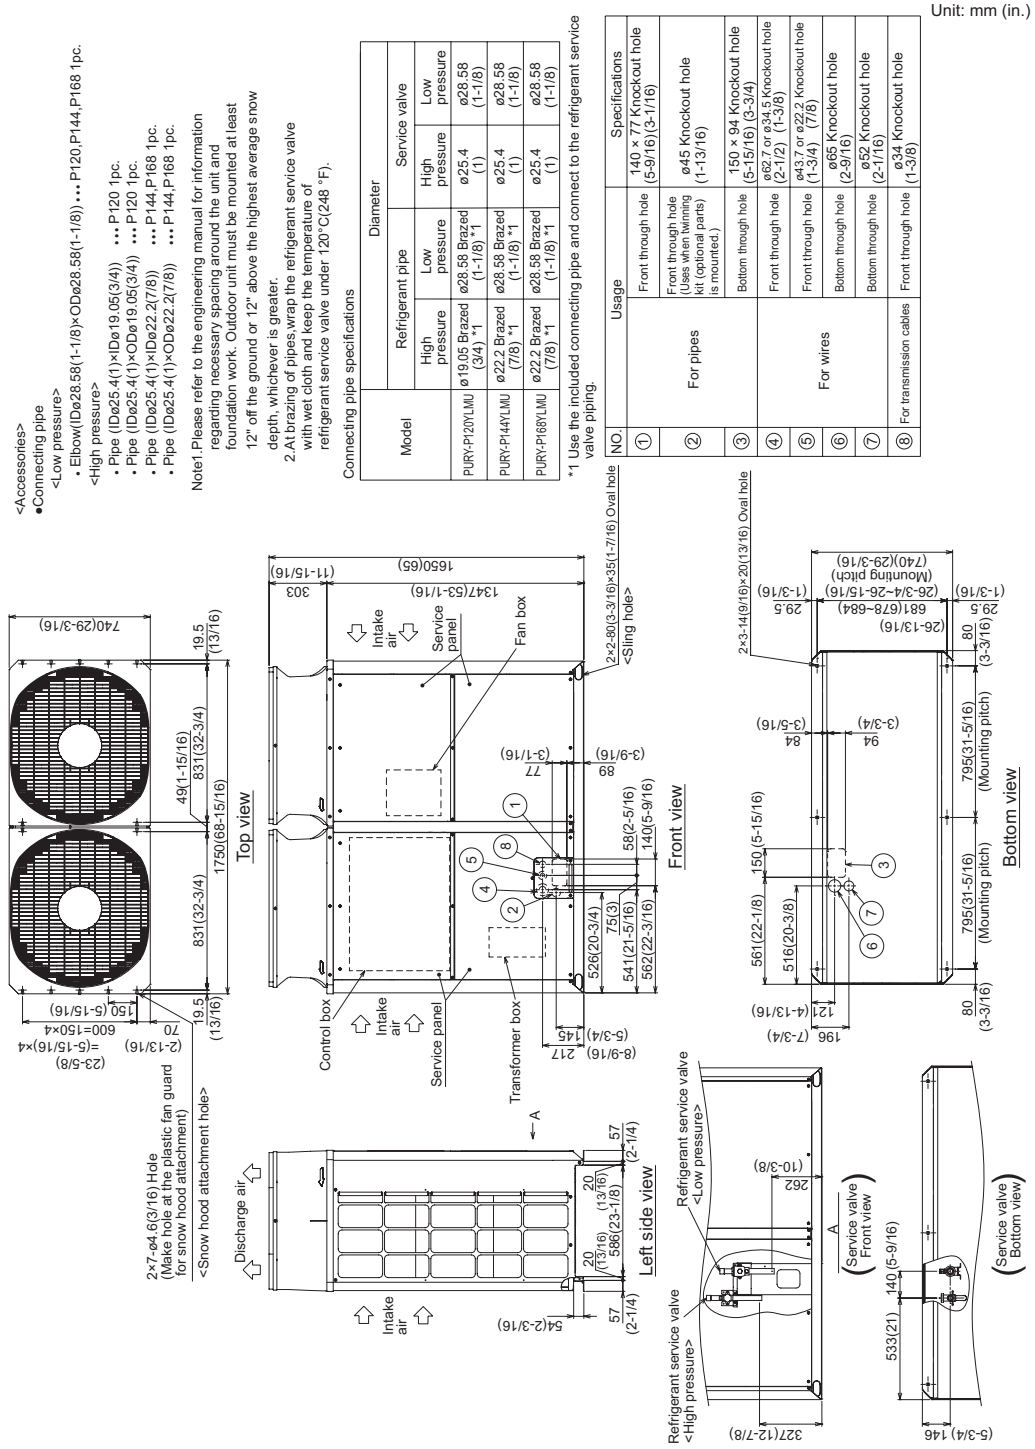

<Accessories>
●Connecting pipe
<Low pressure>
• Elbow(ID ø28.58(1-1/8)×OD ø28.58(1-1/8)) ••• P120,P144,P168 1pc.
<High pressure>
• Pipe (ID ø25.4(1)×ID ø19.05(3/4)) ••• P120 1pc.
• Pipe (ID ø25.4(1)×OD ø19.05(3/4)) ••• P120 1pc.
• Pipe (ID ø25.4(1)×ID ø22.2(7/8)) ••• P144,P168 1pc.
• Pipe (ID ø25.4(1)×OD ø22.2(7/8)) ••• P144,P168 1pc.

Note1.Please refer to the engineering manual for information regarding necessary spacing around the unit and foundation work. Outdoor unit must be mounted at least 12" off the ground or 12" above the highest average snow depth, whichever is greater.
2.At brazing of pipes,wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248 °F).

Connecting pipe specifications

Model	Diameter			
	Refrigerant pipe		Service valve	
	High pressure	Low pressure	High pressure	Low pressure
PURY-P120YLMU	ø19.05 Brazed (3/4) *1	ø28.58 Brazed (1-1/8) *1	ø25.4 (1)	ø28.58 (1-1/8)
PURY-P144YLMU	ø22.2 Brazed (7/8) *1	ø28.58 Brazed (1-1/8) *1	ø25.4 (1)	ø28.58 (1-1/8)
PURY-P168YLMU	ø22.2 Brazed (7/8) *1	ø28.58 Brazed (1-1/8) *1	ø25.4 (1)	ø28.58 (1-1/8)

*1 Use the included connecting pipe and connect to the refrigerant service valve piping.

NO.	Usage		Specifications
①	For pipes	Front through hole	140 × 77 Knockout hole (5-9/16)(3-1/16)
②		Front through hole (Uses when fanning kit (optional parts) is mounted.)	ø45 Knockout hole (1-13/16)
③		Bottom through hole	150 × 94 Knockout hole (5-15/16) (3-3/4)
④	For wires	Front through hole	ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
⑤		Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
⑥		Bottom through hole	ø65 Knockout hole (2-9/16)
⑦		Bottom through hole	ø52 Knockout hole (2-1/16)
⑧	For transmission cables	Front through hole	ø34 Knockout hole (1-3/8)

NOTES:
SEACOAST PROTECTION
- Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
- Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
- Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.

Specifications are subject to change without notice.

© 2016 Mitsubishi Electric US, Inc.

Module 2: PURY-P96YLMU-A (-BS) – DIMENSIONS

Unit: mm (in.)

<Accessories>
●Connecting pipe
<Low pressure>
• Pipe (ID⌀28.58(1-1/8)×OD⌀22.2(7/8)) ••• 1pc.
• Elbow(ID⌀28.58(1-1/8)×OD⌀28.58(1-1/8)) ••• 1pc.
<High pressure>
• Pipe (ID⌀25.4(1)×ID⌀19.05(3/4)) ••• 1pc.
• Pipe (ID⌀25.4(1)×OD⌀19.05(3/4)) ••• 1pc.


Note1.Please refer to the engineering manual for information regarding necessary spacing around the unit and foundation work. Outdoor unit must be mounted at least 12" off the ground or 12" above the highest average snow depth, whichever is greater.
2.At brazing of pipes,wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120˚C(248 ˚F).

Connecting pipe specifications

Model	Diameter			
	Refrigerant pipe		Service valve	
	High pressure	Low pressure	High pressure	Low pressure
PURY-P96YLMU	ø19.05 Brazed (3/4) *1	ø22.2 Brazed (7/8) *1	ø25.4 (1)	ø28.58 (1-1/8)

*1 Use the included connecting pipe and connect to the refrigerant service valve piping.

NO.	Usage		Specifications
①	For pipes	Front through hole	140 × 77 Knockout hole (5-9/16)(3-1/16)
②	For pipes	Front through hole (Uses when twinning kit (optional parts) is mounted.)	ø45 Knockout hole (1-13/16)
③	For pipes	Bottom through hole	150 × 94 Knockout hole (5-15/16) (3-3/4)
④	For wires	Front through hole	ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
⑤	For wires	Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
⑥	For wires	Bottom through hole	ø65 Knockout hole (2-9/16)
⑦	For wires	Bottom through hole	ø52 Knockout hole (2-1/16)
⑧	For transmission cables	Front through hole	ø34 Knockout hole (1-3/8)

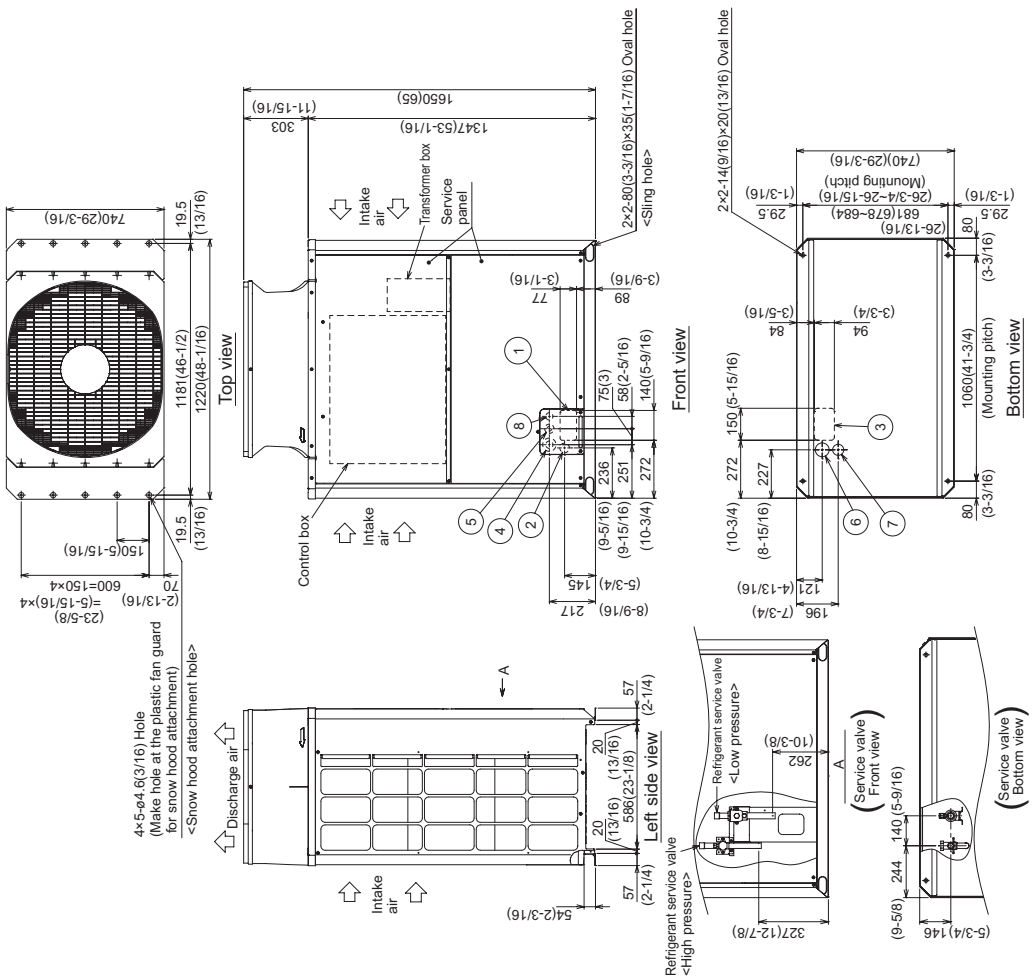


NOTES:
SEACOAST PROTECTION
- Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
- Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
- Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.

Specifications are subject to change without notice.

© 2016 Mitsubishi Electric US, Inc.

Twinning Kit: CMY-ER200CBK

Unit: mm (inch)

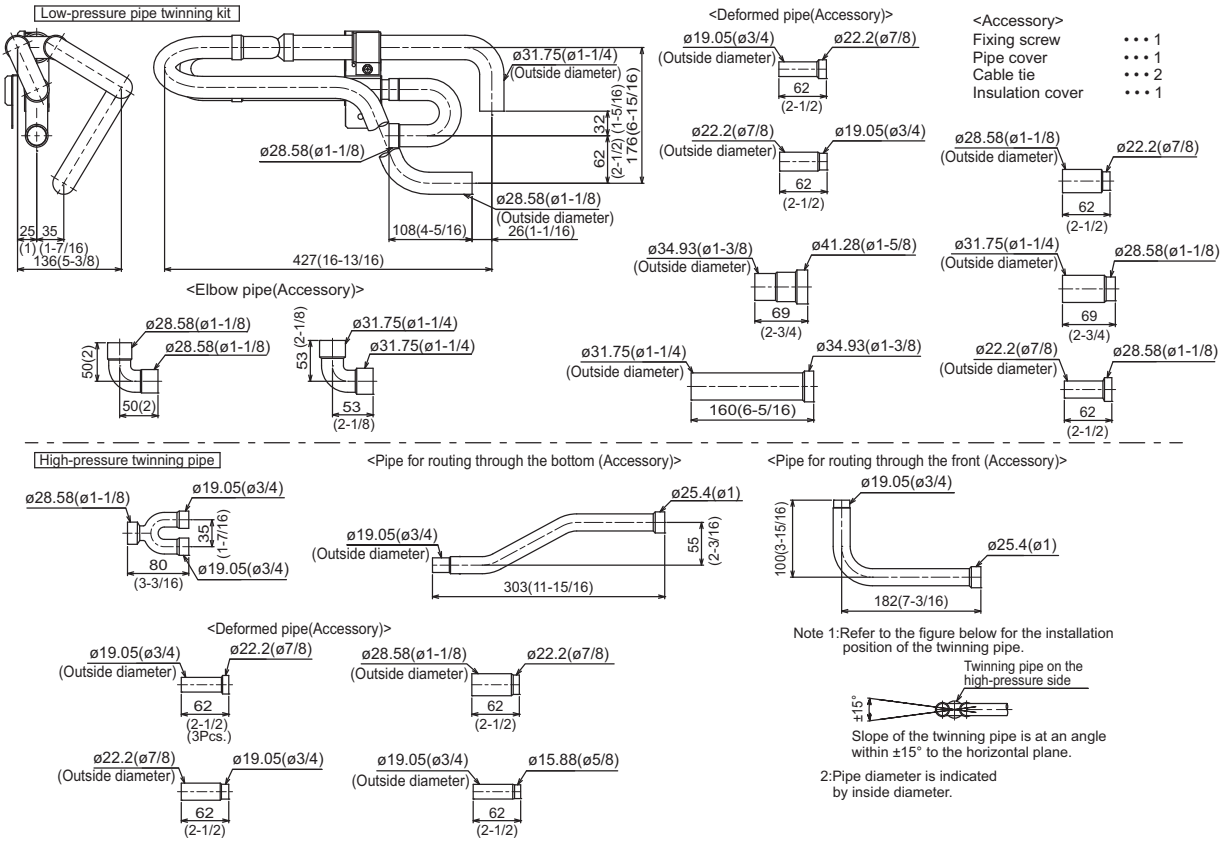

Note 1:Refer to the figure below for the installation position of the twinning pipe.

Slope of the twinning pipe is at an angle within ±15° to the horizontal plane.

2:Pipe diameter is indicated by inside diameter.

MITSUBISHI ELECTRIC
COOLING & HEATING
1340 Satellite Boulevard. Suwanee, GA 30024
Toll Free: 800-433-4822 www.mehvac.com

FORM# PURY-P216YSLMU-A (-BS) - 201605

Specifications are subject to change without notice.

© 2016 Mitsubishi Electric US, Inc.