CITYMULTI®

# Outdoor Unit: 26-TON PURY-P312YSLMU-A (-BS)

(Consists of One PURY-P168YLMU-A (-BS), One PURY-P144YLMU-A (-BS),and One CMY-ER200CBK Twinning Kit)

MITSUBISHI ELECTRIC

| Job Name: | |
|---|---|
| System Reference: | Date: |



OUTDOOR VRF HEAT PUMP WITH HEAT RECOVERY SYSTEM

## UNIT OPTION

- □ Standard Model……PURY-P312YSLMU-A
- □ Seacoast (BS) Model……PURY-P312YSLMU-A-BS

## ACCESSORIES

- ■ Twinning Kit (required)……CMY-ER200CBK
- □ Joint Kit……for details see Pipe Accessories Submittal
- ■ BC Controller (required)……for details see BC Controller Submittals
- □ Low Ambient Kit ……for details see Low Ambient Kit Submittal
- □ Snow/Hail Guards Kit……for details see Snow/Hail Guards Kit Submittal
- □ Base Pan Heater Kit……for details see Base Pan Heater Kit Submittal

| Specifications | | System | Module 1 | Module 2 |
|---|---|---|---|---|
| Unit Type | | PURY-P312YSLMU-A (-BS) | PURY-P168YLMU-A(-BS) | PURY-P144YLMU-A(-BS) |
| Nominal Cooling Capacity (460V) | Btu/h | 312,000 | 168,000 | 144,000 |
| Nominal Heating Capacity (460V) | Btu/h | 350,000 | 188,000 | 160,000 |
| Operating Temperature Range *1 | Cooling (Outdoor) *2 | Refer to Module Data | 23~126° F (-5~52° C) DB | |
| | Heating (Outdoor) | | -13~60° F (-25~15.5° C) WB | |
| External Dimensions (H x W x D) | In. (mm) | Refer to Module Data | 64-31/32 x 68-29/32 x 29-5/32 (1,650 x 1,750 x 740) | 64-31/32 x 68-29/32 x 29-5/32 (1,650 x 1,750 x 740) |
| Net Weight | Lbs. (kg) | 1,460 (662) | 730 (331) | 730 (331) |
| External Finish | | Refer to Module Data | Pre-coated galvanized steel sheet | |
| Electrical Power Requirements | Voltage, Phase, Hertz | Refer to Module Data** | 460V, 3-Phase, 60Hz | |
| Minimum Circuit Ampacity (MCA) | A | Refer to Module Data** | 31 | 24 |
| Maximum Overcurrent Protection (MOP) | A | Refer to Module Data** | 50 | 35 |
| *Piping Diameter (Brazed)* | | | | |
| From From Twinning Kit to BC Controller (In. / mm) | Liquid (High Pressure) | 1-1/8 (28.58) | Refer to System Data | |
| | Gas (Low Pressure) | 1-5/8 (41.28) | | |
| Max. Total Refrigerant Line Length | Ft. | 3,117 | Refer to System Data | |
| Max. Refrigerant Line Length (Between ODU & IDU) | Ft. | 541 | | |
| Max. Control Wiring Length | Ft. | 1,640 | | |
| Indoor Unit | Total Capacity | 50~150% of ODUs | Refer to System Data | |
| | Model / Quantity | P06~P96/2~50 (Max. No. Connectable Branches: 48) | Refer to System Data | |
| Sound Pressure Level | dB(A) | 64.0 | Refer to System Data | |
| *Fan* | | | | |
| Type x Quantity | | Refer to Module Data | Propeller fan x 2 | Propeller fan x 2 |
| Airflow Rate | CFM | | 11,300 | 11,300 |
| External Static Pressure | In. WG | Refer to Module Data | Selectable; 0, 0.12 or 0.24"WG; factory set to 0"W.G. | |
| Compressor Operating Range | | 7% to 100% | Refer to System Data | |
| Compressor Type x Quantity | | Refer to Module Data | Inverter-driven Scroll Hermetic x 1 | Inverter-driven Scroll Hermetic x 1 |
| Refrigerant | | Refer to Module Data | R410A; 23 lbs. + 2 oz. (10.5 kg) | R410A; 23 lbs. + 2 oz. (10.5 kg) |
| Protection Devices | High Pressure | Refer to Module Data | High pressure sensor, High pressure switch at 4.15 MPa (601 psi) | High pressure sensor, High pressure switch at 4.15 MPa (601 psi) |
| | Inverter Circuit (Comp. / Fan) | | Over-current protection | Over-current protection |
| | Fan Motor | | Thermal switch | Thermal switch |
| AHRI Ratings (Ducted/Non-Ducted) | EER | 10.5 / 11.0 | Refer to System Data | |
| | IEER | 16.9 / 19.7 | | |
| | COP | 3.24 / 3.27 | | |
| | SCHE | 20.6 / 23.8 | | |

**NOTES:**

*1. When applying product below -4° F, consult your design engineer for cold climate application best practices, including the use of a backup source for heating.


*2. For details on extended cooling operation range down to -10° F DB, see Low Ambient Kit Submittal.

** Each individual module requires a separate electrical connection. Refer to electrical data for each individual module.

Specifications are subject to change without notice.

© 2015 Mitsubishi Electric US, Inc.

# Outdoor Unit: PURY-P312YSLMU-A (-BS) – DIMENSIONS

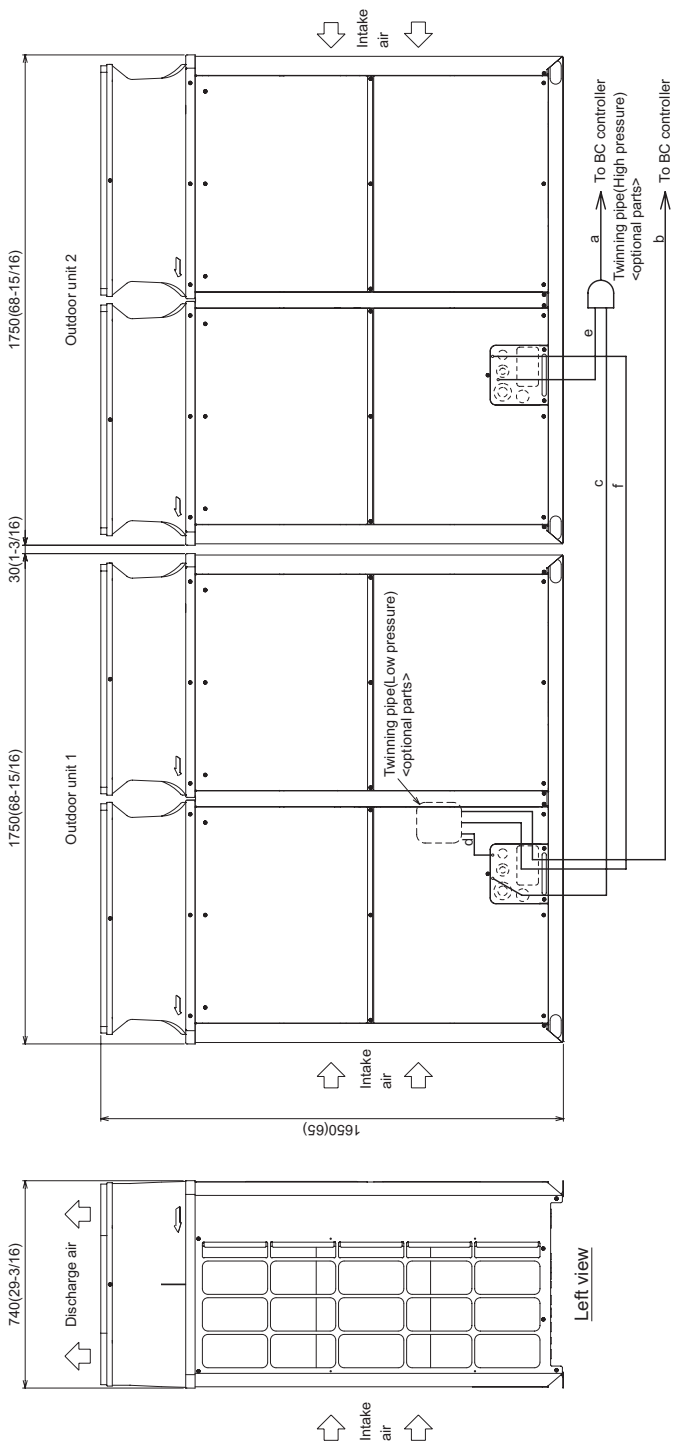


Unit: mm (in.)

| | Unit model | P240 | | | | P264 | | | | P288 | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | Component unit model | P120 | | P144 | | P120 | | P144 | | P144 | | | |
| Twinning Kit ~Outdoor unit | High pressure | c | ø19.05(3/4) | e | ø22.2(7/8) | c | ø19.05(3/4) | e | ø22.2(7/8) | c | ø22.2(7/8) | e | ø22.2(7/8) |
| | Low pressure | d | - (Note 5) | f | ø28.58(1-1/8) | d | - (Note 5) | f | ø28.58(1-1/8) | d | - (Note 5) | f | ø28.58(1-1/8) |

| | Unit model | P312 | | | | P336 | | | |
|---|---|---|---|---|---|---|---|---|---|
| | Component unit model | P168 | | P144 | | P168 | | P168 | |
| Twinning Kit ~Outdoor unit | High pressure | c | ø22.2(7/8) | e | ø22.2(7/8) | c | ø22.2(7/8) | e | ø22.2(7/8) |
| | Low pressure | d | - (Note 5) | f | ø28.58(1-1/8) | d | - (Note 5) | f | ø28.58(1-1/8) |

Twinning pipe connection size

| Package unit name | | PURY-P240(Y,S,M)U-A(-BS) | PURY-P264(Y,S,M)U-A(-BS) | PURY-P288(Y,S,M)U-A(-BS) | PURY-P312(Y,S,M)U-A(-BS) | PURY-P336(Y,S,M)U-A(-BS) |
|---|---|---|---|---|---|---|
| Component unit name | Outdoor unit 1 | PURY-P120YLMU-A(-BS) | PURY-P144YLMU-A(-BS) | PURY-P168YLMU-A(-BS) | PURY-P168YLMU-A(-BS) | PURY-P168YLMU-A(-BS) |
| | Outdoor unit 2 | PURY-P120YLMU-A(-BS) | PURY-P144YLMU-A(-BS) | PURY-P144YLMU-A(-BS) | PURY-P144YLMU-A(-BS) | PURY-P168YLMU-A(-BS) |
| Outdoor Twinning Kit(optional parts) | | CMY-R280-G | | | | |
| BC controller~Twinning pipe | High pressure (a) | ø34.93(1-3/8) | | | ø41.28(1-5/8) | |
| | Low pressure (b) | ø28.58(1-1/8) | | | | |

Note 1. Connect the pipes as shown in the figure above. Refer to the table above for the pipe size.
2. Twinning pipe (High pressure) should not be tilted more than 15 degrees from the horizontal plane. Be sure to see the Installation Manual for details of Twinning pipe installation.
3. The pipe section before the Twinning pipe (section "a" in the figure) must have at least 500mm(19-11/16) of straight section ("including the straight pipe that is supplied with the Twinning pipe).
4. Only use the Twinning pipe by Mitsubishi (optional parts).
5. Connect the outdoor unit 1 with the Twinning pipe (Low pressure) (section "d" in the figure).

NOTES:
SEACOAST PROTECTION

- Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
- Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
- Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.

Specifications are subject to change without notice.

© 2015 Mitsubishi Electric US, Inc.

# Modules 1 and 2: PURY-P168YLMU-A (-BS) & PURY-P144YLMU-A (-BS) – DIMENSIONS

Unit: mm (in.)

<Accessories>
●Connecting pipe
<Low pressure>
• Elbow(ID ø28.58(1-1/8)×OD ø28.58(1-1/8)) ... P120,P144,P168 1pc.
<High pressure>
• Pipe (ID ø25.4(1)×ID ø19.05(3/4)) ... P120 1pc.
• Pipe (ID ø25.4(1)×OD ø19.05(3/4)) ... P120 1pc.
• Pipe (ID ø25.4(1)×ID ø22.2(7/8)) ... P144,P168 1pc.
• Pipe (ID ø25.4(1)×OD ø22.2(7/8)) ... P144,P168 1pc.


Note1.Please refer to the engineering manual for information regarding necessary spacing around the unit and foundation work. Outdoor unit must be mounted at least 12" off the ground or 12" above the highest average snow depth, whichever is greater.
2.At brazing of pipes,wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248 °F).

Connecting pipe specifications

| Model | Diameter | | | |
|---|---|---|---|---|
| | Refrigerant pipe | | Service valve | |
| | High pressure | Low pressure | High pressure | Low pressure |
| PURY-P120YLMU | ø19.05 Brazed (3/4) *1 | ø28.58 Brazed (1-1/8) *1 | ø25.4 (1) | ø28.58 (1-1/8) |
| PURY-P144YLMU | ø22.2 Brazed (7/8) *1 | ø28.58 Brazed (1-1/8) *1 | ø25.4 (1) | ø28.58 (1-1/8) |
| PURY-P168YLMU | ø22.2 Brazed (7/8) *1 | ø28.58 Brazed (1-1/8) *1 | ø25.4 (1) | ø28.58 (1-1/8) |

*1 Use the included connecting pipe and connect to the refrigerant service valve piping.

| NO. | Usage | | Specifications |
|---|---|---|---|
| ① | For pipes | Front through hole | 140 × 77 Knockout hole (5-9/16)(3-1/16) |
| ② | | Front through hole (Uses when fanning kit (optional parts) is mounted.) | ø45 Knockout hole (1-13/16) |
| ③ | | Bottom through hole | 150 × 94 Knockout hole (5-15/16) (3-3/4) |
| ④ | For wires | Front through hole | ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8) |
| ⑤ | | Front through hole | ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8) |
| ⑥ | | Bottom through hole | ø65 Knockout hole (2-9/16) |
| ⑦ | | Bottom through hole | ø52 Knockout hole (2-1/16) |
| ⑧ | For transmission cables | Front through hole | ø34 Knockout hole (1-3/8) |

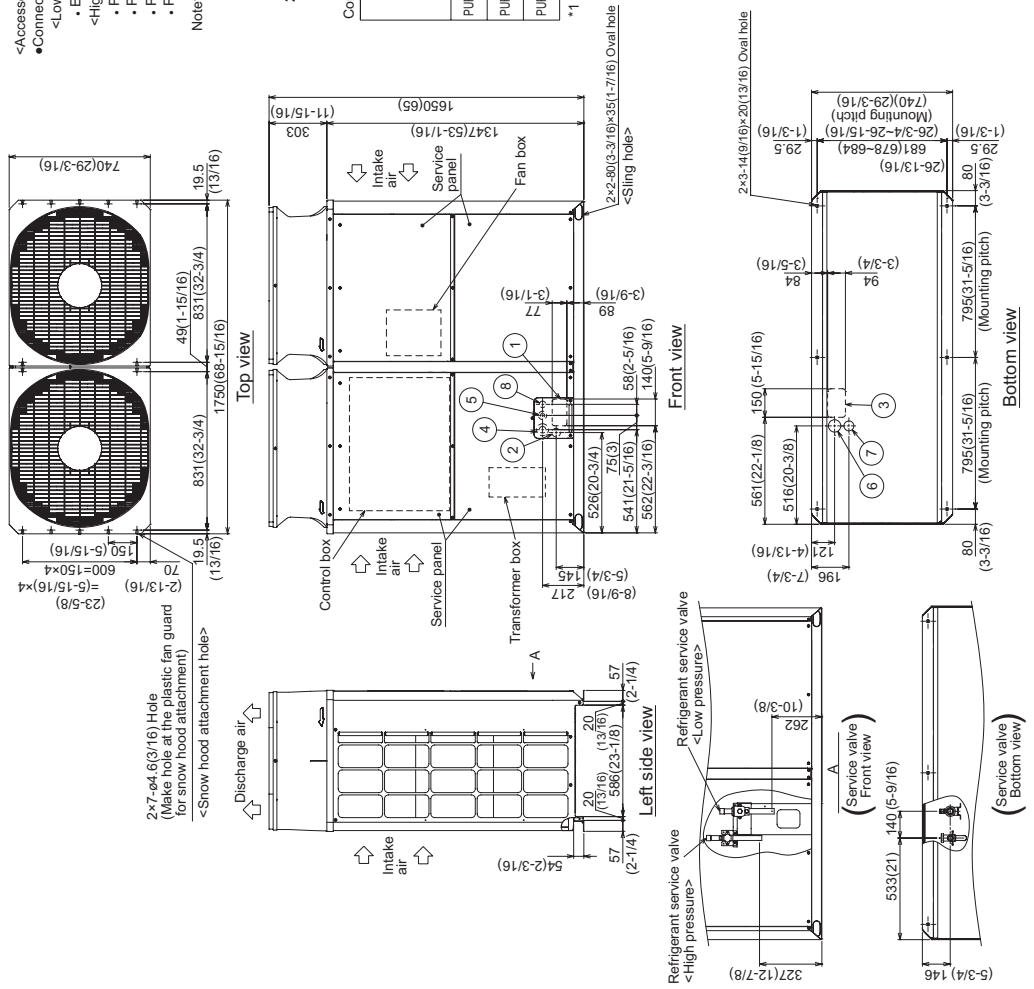



NOTES:
SEACOAST PROTECTION
- Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
- Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
- Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.

Specifications are subject to change without notice.

© 2015 Mitsubishi Electric US, Inc.

# Twinning Kit: CMY-ER200CBK

Unit: mm (inch)

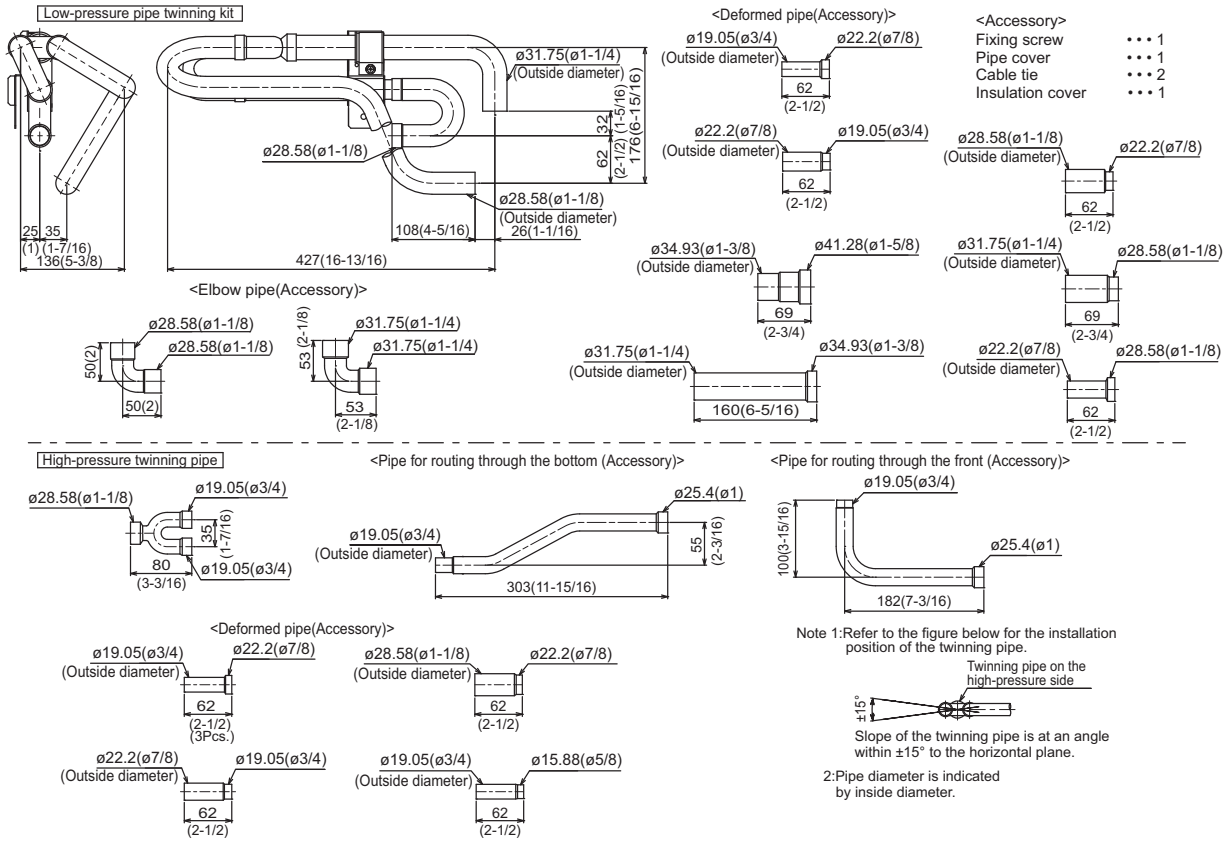


Note 1:Refer to the figure below for the installation position of the twinning pipe.

Slope of the twinning pipe is at an angle within ±15° to the horizontal plane.

2:Pipe diameter is indicated by inside diameter.


MITSUBISHI ELECTRIC
COOLING & HEATING
1340 Satellite Boulevard. Suwanee, GA 30024
Toll Free: 800-433-4822 www.mehvac.com



FORM# PURY-P312YSLMU-A (-BS) - 201605



Specifications are subject to change without notice.

© 2015 Mitsubishi Electric US, Inc.