

Job Name: _____ Location: _____

Drawing Reference: _____ Schedule No. _____

System No.: _____ Date: _____

OUTDOOR VRFZ HEAT RECOVERY SYSTEM FEATURES

- 3-phase, 208/230V
- Modular variable refrigerant flow zoning (VRFZ) systems; smaller capacity units can be piped together to form a single, large-capacity two-pipe system
- Selectable fan static, 0.12 or 0.24"WG external static pressure; factory set to 0"WG
- Max. Total Refrigerant Piping Length: 1,804' (P72,96), 1,969' (P120,144,168), 2,461' (P192), 2,625' (P216,240), 3,280' (P264,288); Max. Refrigerant Line Length: 541'; Max. Control Wiring Length: 1,650'
- Connects to CITY MULTI indoor units; controlled via CITY MULTI Controls Network (CMCN)
- External finish: Pre-coated Galvanized-steel Sheets with thermoset polyester-resin
- Operating Temperature Range
Cooling (Outdoor): 23° ~ 115°F (-5° ~ +46°C) DB
Heating (Outdoor): -4° ~ +60°F (-20° ~ +16°C) WB



PURY-P72TJMU-A-BS

INVERTER



OPTIONAL PARTS


- ☐ T-Branch Joint ($\leq 72,000$ Btu/h).....CMY-Y102S-G2
- ☐ T-Branch Joint (73,000 - 144,000 Btu/h).....CMY-Y102L-G2
- ☐ Joint Adapter (Port Connector > 54,000 Btu/h).....CMY-R160J
- ☐ BC Controller.....CMB-P105/106/108/1010/1013/1016NU-G
- ☐ Main BC Controller.....CMB-P108/1010/1013/1016-GA/1016NU-HA
- ☐ Sub BC Controller.....CMB-P104/108NU-GB/1016NU-HB

Specifications		Model Name
Unit Type		PURY-P72TJMU-A-BS
Nominal Cooling Capacity	Btu/h	72,000
Nominal Heating Capacity	Btu/h	80,000
External Dimensions (H x W x D)	In. / mm	65 x 36-1/4 x 29-15/16 / 1,650 x 920 x 760
Net Weight	Lbs. / kg	519 / 235
Electrical Power Requirements	Voltage, Phase, Hertz	208/230, 3-phase, 60Hz
Cooling Power Input	kW	5.66
Heating Power Input	kW	6.16
Cooling Current (208/230V)	R.L.A.	17.4 / 15.7
Heating Current (208/230V)	R.L.A.	18.9 / 17.1
Minimum Circuit Ampacity (MCA)	A	27 / 25
Recommended Fuse/Breaker Size	A	30
Maximum Fuse Size	A	40 / 30
Piping Diameter (Brazed) (In. / mm)	Liquid (High Pressure)	5/8 / 15.88
	Gas (Low Pressure)	3/4 / 19.05
Indoor Unit	Total Capacity	50 to 150% of Outdoor Unit Capacity
	Model / Quantity	P06 to P96 / 1 to 18
Sound Pressure Levels	dB(A)	58.0
Fan		
Type x Quantity		Propeller Fan x 1
Airflow Rate	CFM	6,180
Direct-drive Inverter Motor Output	kW	0.92
Compressor Operating Range		16% to 100%
Compressor Type x Quantity		Inverter-driven Scroll Hermetic x 1
Compressor Motor Output	kW	5.1
Compressor Crankcase Heater	kW	0.035
Refrigerant		R410A
Lubricant		MEL32
High-pressure Protection Device		601 psi / 4.15 MPa
Compressor / Fan Protection Device		Overheat Protection / Thermal Switch
Inverter Protection Device		Overheat / Overcurrent Protection
Blue Fin Anti-corrosion Protection: Cellulose- and polyurethane-resin coating treatment applied to condenser coil that protects it from air contaminants; $\geq 1\mu\text{m}$ thick; Salt Spray Test Method - no unusual rust development to 960 hours.		

SEACOAST PROTECTION

- External Panel Base, External Front Panel, Pillar: Alloyed galvanized-steel sheets with thermoset polyester-resin coating on internal and external surfaces
- Compressor Cover: Galvanized-aluminum sheets with thermoset polyester-resin coating on internal and external surfaces
- Electrical Parts Box: Galvanized-aluminum sheets with thermoset polyester-resin coating on external surface
- Fan Motor Support: Galvanized-steel sheets with thermoset polyester-resin coating on internal and external surfaces
- Printed Circuit Board: Epoxy resin with polyurethane-coating on external surface

Model: PURY-P72TJMU-A-BS – DIMENSIONS

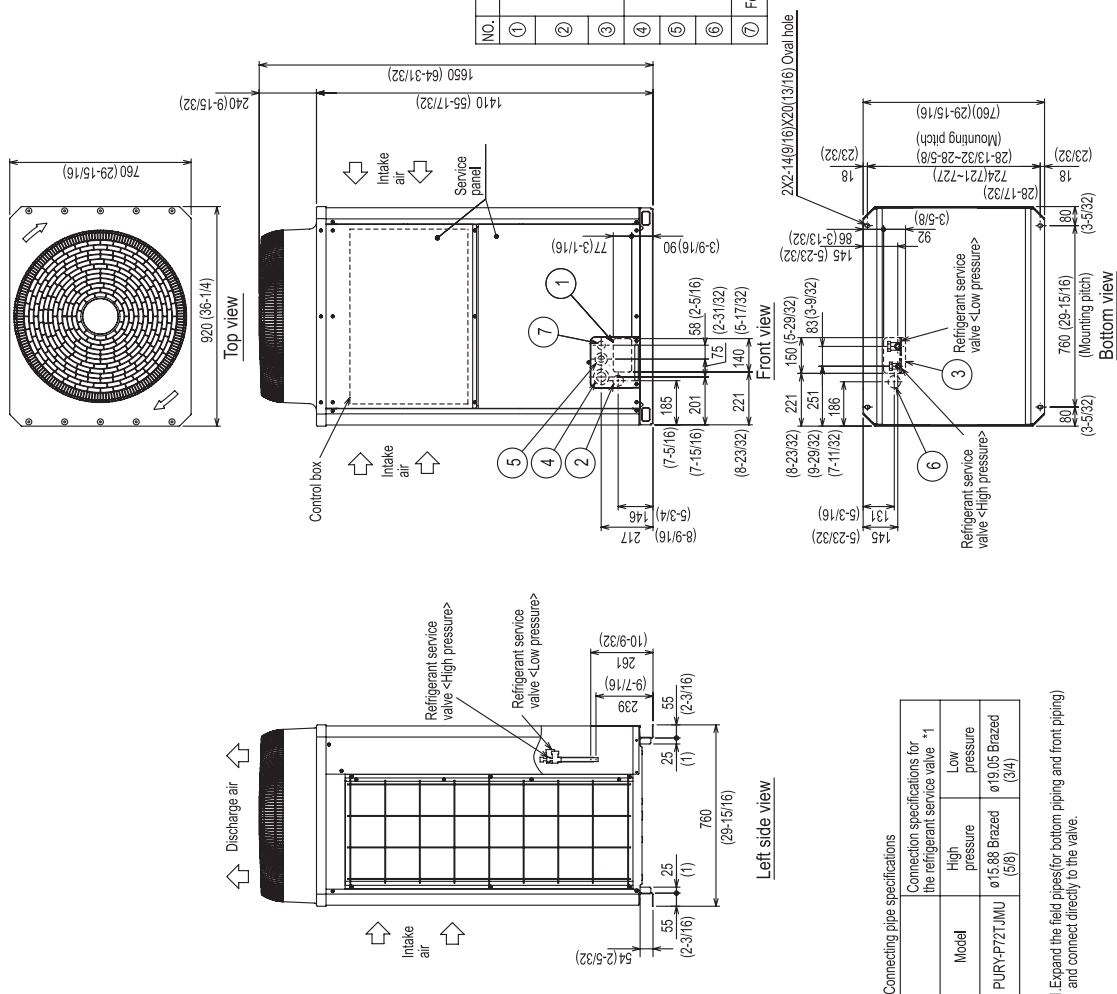

Connecting pipe specifications	
Model	Connection specifications for the refrigerant service valve *1
PURY-P72TJMU	High pressure ø15.88 Brazed (5/8)
	Low pressure ø19.05 Brazed (3/4)

*1 Expand the field pipes for bottom piping and front piping and connect directly to the valve.



Certificate Number FM33568

Mitsubishi Electric Air Conditioning & Refrigeration Systems Works acquired ISO 9001 certification under Series 9000 of the International Standard Organization (ISO) based on a review of quality warranties for the production of refrigeration and air conditioning equipment.

ISO Authorization System

The ISO 9000 series is a plant authorization system relating to quality warranties as stipulated by the ISO. ISO 9001 certifies quality warranties based on the "design, development, production, installation and auxiliary services" for products built at an authorized plant.

Mitsubishi Electric Air Conditioning & Refrigeration Systems Works acquired environmental management system standard ISO 14001 certification.

The ISO 14000 series is a set of standards applying to environmental protection set by the International Standard Organization (ISO).



Certificate Number EC97J1227

C SD - PURY-P72TJMU-A-BS - 1 - 201006 © MITSUBISHI ELECTRIC / HVAC 2010



MITSUBISHI ELECTRIC

HVAC Advanced Products Division

Mitsubishi Electric & Electronics USA, Inc.

3400 Lawrenceville Suwanee Rd.

Suwanee, GA 30024

Tele: 678-376-2900 • Fax: 800-889-9904

Toll Free: 800-433-4822 (#4)

www.mehvac.com

Specifications are subject to change without notice.