# Model: 8-TON PUHY-P96TKMU-A (-BS)



| Job Name: | |
|---|---|
| System Reference: | Date: |

## OUTDOOR VRF HEAT PUMP SYSTEM FEATURES


- INVERTER-driven compressor
- Air-source, heat pump system
- Long line lengths - for details see Engineering Manual
- Connects to CITY MULTI indoor units
- Controlled via CITY MULTI Controls Network

## UNIT OPTION

□ Standard Model……PUHY-P96TKMU-A
□ Sea Coast (BS) Model……PUHY-P96TKMU-A-BS

## OPTIONAL PARTS

□ Joint Kit……for details see Pipe Accesories Submittal
□ Header Kit……for details see Pipe Accesories Submittal
□ Low Ambient Kit ……for details see Low Ambient Kit Submittal
□ Snow/Hail Guards Kit……for details see Snow/Hail Guards Kit Submittal
□ Base Pan Heater Kit……for details see Base Pan Heater Kit Submittal

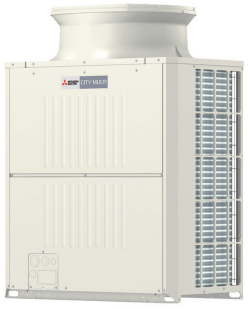

PUHY-P96TKMU-A (-BS)

INVERTER

R410A

| Specifications | | Model Name |
|---|---|---|
| Unit Type | | PUHY-P96TKMU-A (-BS) |
| Nominal Cooling Capacity (208/230V) | Btu/h | 96,000 |
| Nominal Heating Capacity (208/230V) | Btu/h | 108,000 |
| Operating Temperature Range *1 | Cooling (Outdoor) *2 | 23~115° F (-5~46° C) DB |
| | Heating (Outdoor) | 13~60° F (-25~15.5° C) WB |
| External Dimensions (H x W x D) | In. / mm | 64-31/32 x 48-1/16 x 29-5/32 / 1,650 x 1,220 x 740 |
| Net Weight | Lbs. / kg | 532 (241) |
| External Finish | | Pre-coated galvanized steel sheet |
| Electrical Power Requirements | Voltage, Phase, Hertz | 208 / 230V, 3-Phase, 60Hz |
| Minimum Circuit Ampacity (MCA) | A | 34 / 31 |
| Maximum Fuse Size | A | 40 |
| *Piping Diameter* | | |
| From ODU to first joint or header (Brazed) (In. / mm) | Liquid (High Pressure) | 3/8 (9.52) Brazed (1/2 [12.7] Brazed, if length from outdoor unit to farthest indoor unit is >= 295' [90m]) |
| | Gas (Low Pressure) | 7/8 (22.2) Brazed |
| Max. Total Refrigerant Line Length | Ft. | 3,280 |
| Max. Refrigerant Line Length (Between ODU & IDU) | Ft. | 541 |
| Max. Control Wiring Length | Ft. | 1,640 |
| Indoor Unit | Total Capacity | 50~130% of outdoor unit capacity |
| | Model / Quantity | P06~P96/1~20 |
| Sound Pressure Levels | dB(A) | 58 |
| *Fan* | | |
| Type x Quantity | | Propeller fan x 1 |
| Airflow Rate | CFM | 6,200 |
| External Static Pressure | In. WG (Pa) | Selectable; 0, 0.12 or 0.24"WG; factory set to 0"W.G. |
| Compressor Operating Range | | 16% to 100% |
| Compressor Type x Quantity | | Inverter scroll hermetic compressor x 1 |
| Refrigerant | | R410A; 25 lbs. + 6 oz. (11.5 kg) |
| Protection Devices | High Pressure | High pressure sensor, High pressure switch at 4.15 MPa (601 psi) |
| | Inverter Circuit (Comp. / Fan) | Over-current protection |
| | Fan Motor | Thermal switch |
| AHRI Ratings (Ducted/Non-Ducted) | EER | 12.6 / 13.7 |
| | IEER | 19.7 / 20.7 |
| | COP | 3.95 / 4.22 |
| **Blue Fin Anti-corrosion Protection:** Cellulose- and polyurethane-resin coating treatment applied to condenser coil that protects it from air contaminants<br>**Standard:** ≥1µm thick; Salt Spray Test Method - no unusual rust development to 480 hours.<br>**Sea Coast (BS):** ≥1µm thick; Salt Spray Test Method - no unusual rust development to 960 hours. | | |

**NOTES:**
*1. When applying product below -4° F, consult your design engineer for cold climate application best practices, including the use of a backup source for heating.
*2. For details on extended cooling operation range down to -10° F DB, see Low Ambient Kit Submittal.

Specifications are subject to change without notice.

© 2016 Mitsubishi Electric US, Inc.

# Model: PUHY-P96TKMU-A (-BS) – DIMENSIONS

Unit : mm(in.)


Note1. Please refer to the engineering manual for information regarding necessary spacing around the unit and foundation work. Outdoor unit must be mounted at least 12" off the ground or 12" above the highest average snow depth, whichever is greater."
2. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).

Connecting pipe specifications

| Model | Diameter | | | |
|---|---|---|---|---|
| | Refrigerant pipe | | Service valve | |
| | Liquid | Gas | Liquid | Gas |
| PUHY-P96TKMU | ø9.52 Brazed (3/8) *1<br>ø12.7 Brazed (1/2) *2 *3 | ø22.2 Brazed (7/8) *2 | ø9.52 (3/8) | ø28.58 (1-1/8) |

*1 Expand the on-site piping and connect to the refrigerant service valve piping.
*2 Use the pipe joint(field supply) and connect to the refrigerant service valve piping.
*3 Furthest piping length (OU from IU) ≤ 90m(295ft)

| NO. | Usage | | Specifications |
|---|---|---|---|
| ① | For pipes | Front through hole | 140 × 77 Knockout hole (5-17/32) (3-1/16) |
| ② | | Bottom through hole | 150 × 94 Knockout hole (5-29/32) (3-23/32) |
| ③ | For wires | Front through hole | ø62.7 or ø34.5 Knockout hole (2-15/32) (1-3/8) |
| ④ | | Front through hole | ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8) |
| ⑤ | | Bottom through hole | ø65 Knockout hole (2-9/16) |
| ⑥ | | Bottom through hole | ø52 Knockout hole (2-1/16) |
| ⑦ | For transmission cables | Front through hole | ø34 Knockout hole (1-11/32) |

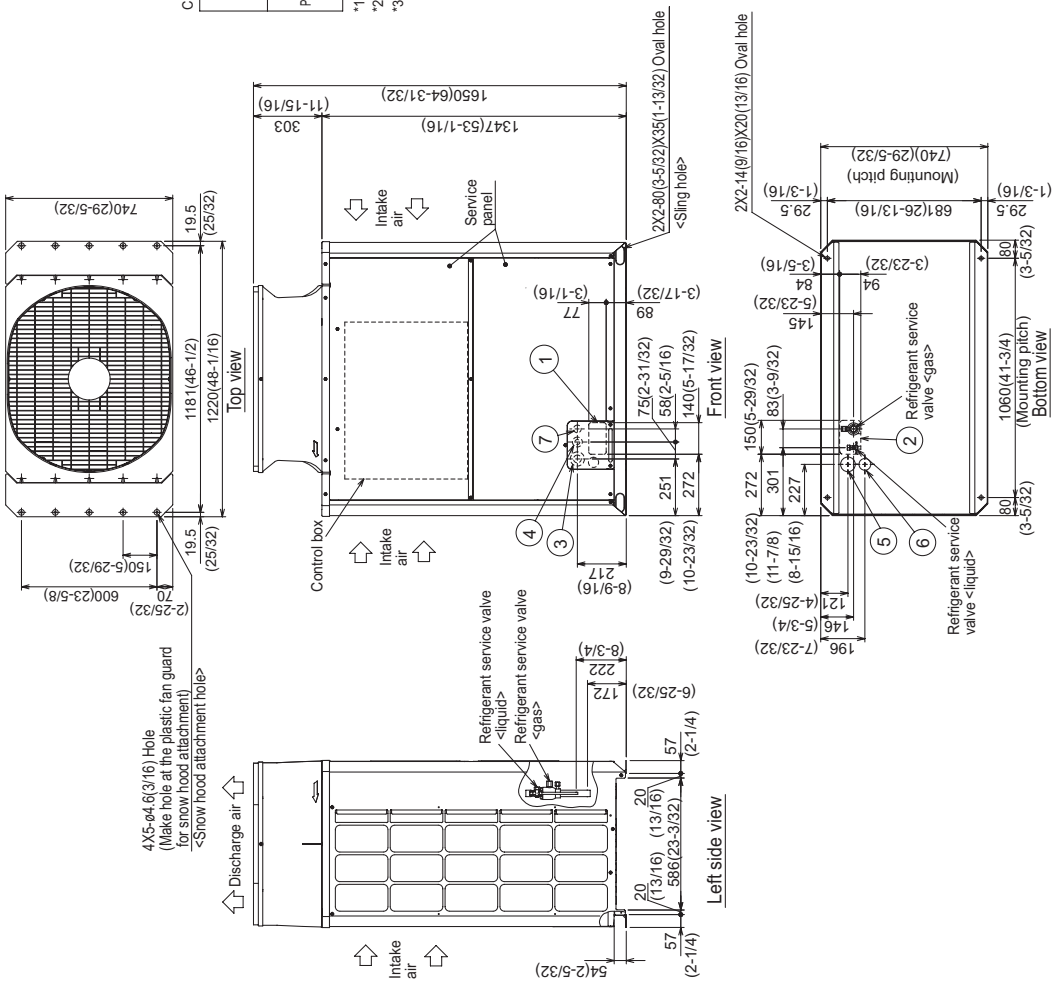



MITSUBISHI ELECTRIC
COOLING & HEATING
1340 Satellite Boulevard. Suwanee, GA 30024
Toll Free: 800-433-4822 www.mehvac.com


AHRI CERTIFIED www.ahridirectory.org Variable Refrigerant Flow (VRF) Multi-Split AC and HP AHRI Standard 1230

C ETL LISTED US Intertek


FORM# PUHY-P96TKMU-A (-BS) - 201605


Specifications are subject to change without notice.


© 2016 Mitsubishi Electric US, Inc.