CITYMULTI®

HYBRID VRF™ 14-TON PURY-EP168YNU-A(-BS)

MITSUBISHI ELECTRIC
HEATING & AIR CONDITIONING

Job Name:
System Reference: Date:

460V OUTDOOR VRF HEAT RECOVERY SYSTEM

UNIT OPTION

☑ Standard Model PURY-EP168YNU-A
☑ Seacoast (BS) Model PURY-EP168YNU-A-BS

ACCESSORIES

☑ Big Foot Stand ..... for details see Big Foot Stands submittals
☑ HBC Controller (Required) ..... for details see HBC Controller Submittals
☑ Joint Kit ..... for details see Pipe Accessories Submittal
☑ Low Ambient Kit ..... for details see Low Ambient Kit Submittal
☑ Panel Heater Kit ..... for details see Panel Heater Kit Submittal
☑ Snow/Hail Guards Kit ..... for details see Snow/Hail Guards Kit Submittal

Specifications			System
Unit Type			PURY-EP168YNU-A(-BS)
Cooling Capacity (Nominal)		BTU/H	168,000
Heating Capacity (Nominal)		BTU/H	188,000
Guaranteed Operating Range	Cooling	ºF [ºC]	23~126 [-5.0~52.0]
	Heating	ºF [ºC]	-13~60 [-25.0~15.5]
Extended Operating Range	Heating	ºF [ºC]	-27.4~60 [-33.0~15.5]
External Dimensions (H x W x D)		In. [mm]	71-5/8 x 68-15/16 x 29-3/16 [1,818 x 1,750 x 740]
Net Weight		Lbs. [kg]	807 [366]
External Finish			Pre-coated galvanized steel sheet (+powder coating for -BS type) [MUNSELL 5Y 8/1]
Electrical Power Requirements	Voltage, Phase, Hertz, Power Tolerance		460V, 3-phase, 60 Hz, ±10%
Minimum Circuit Ampacity		A	35.0
Maximum Overcurrent Protection		A	50
Recommended Fuse Size		A	40
Recommended Minimum Wire Size		AWG [mm]	8 [8.4]
SCCR		kA	5
Refrigerant Piping Diameter	Liquid (High Pressure)	In. [mm]	7/8 [22.2] Brazed
	Gas (Low Pressure)	In. [mm]	1-1/8 [28.58] Brazed
Max. Total Refrigerant Line Length		Ft.	370
Max. Refrigerant Line Length to HBC Controller		Ft.	370
Max. Equalization Line Length between Main HBC Controller		Ft.	131
Indoor Unit Connectable	Total Capacity		50.0~150.0% of outdoor unit capacity
	Model/Quantity		WL06~WL48/1.0~42.0
Sound Pressure Levels		dB(A)	62.5/66.5
Sound Power Levels		dB(A)	81.0/85.5
FAN[4]	Type x Quantity		Propeller fan x 2
	Fan Motor Output	kW	0.92+0.92
	Airflow Rate	CFM	14,850
	External Static Pressure	In. WG	Selectable; 0.00, 0.12, 0.24, 0.32, In. WG; factory set to 0 In. WG
Compressor Operating Range			15.0% to 100.0%
Compressor	Type x Quantity		Inverter scroll hermetic compressor x 1
Refrigerant	Type x Original Charge		R410A x 23.0 lbs + 12.0 oz [10.8 kg]
Protection Devices	High Pressure Protection		High pressure sensor, High pressure switch at 4.15 MPa (601 psi)
	Inverter Circuit (Comp./Fan)		Over-current protection
AHRI Ratings (Ducted/Non-ducted)	EER		10.0/10.1
	IEER		20.2/22.6
	COP		3.3/3.8
	SCHE		24.7/28.3

NOTES:
Nominal cooling conditions (Test conditions are based on AHRI 1230-2023)
Indoor: 80°FD.B./67°FW.B. (26.7°CD.B./19.4°CW.B.), Outdoor: 95°FD.B. (35°CD.B.)
Nominal heating conditions (Test conditions are based on AHRI 1230-2023)
Indoor: 70°FD.B. (21.1°CD.B.), Outdoor: 47°FD.B./43°FW.B. (8.3°CD.B./6.1°CW.B.)

[1]Harsh weather environments may demand performance enhancing equipment. Ask your Mitsubishi Electric representative for more details about your region
[2]For details on extended cooling operation range down to -10° F DB, see Low Ambient Kit Submittal
[3]When applying product below -4°F, consult your design engineer for cold climate application best practices, including the use of a backup source for heating
[4]Unit will continue to operate in extended operating range, but capacity is not guaranteed

Specifications are subject to change without notice.

© 2024 Mitsubishi Electric Trane HVAC US LLC. All rights reserved.

OUTDOOR UNIT: PURY-EP168YNU-A(-BS) – DIMENSIONS

PURY-EP168YNU-A(-BS)

Unit: mm(in)

Note 1. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).

Connecting pipe specifications

Model	Diameter			
	Refrigerant pipe		Service valve	
	High pressure	Low pressure	High pressure	Low pressure
EP168	ø22.2(7/8) Braze	ø28.58(1-1/8) Braze *1	ø28.58(1-1/8) Braze	ø28.58(1-1/8)

*1 Connect the refrigerant pipe to the service valve according to the Installation Manual.

NO.	Usage		Specifications
①	For pipes	Front through hole	148(5-7/8) × 84(3-5/16) Knockout hole
②		Bottom through hole	150(5-15/16) × 94(3-3/4) Knockout hole
③	For wires	Front through hole	ø62.7(2-1/2) or ø34.5(1-3/8) Knockout hole
④		Front through hole	ø43.7(1-3/4) or ø22.2(7/8) Knockout hole
⑤		Bottom through hole	ø65(2-9/16) Knockout hole
⑥		Bottom through hole	ø52(2-1/16) Knockout hole
⑦	For transmission cables	Front through hole	ø34(1-3/8) Knockout hole
⑧		Bottom through hole	ø34(1-3/8) Knockout hole

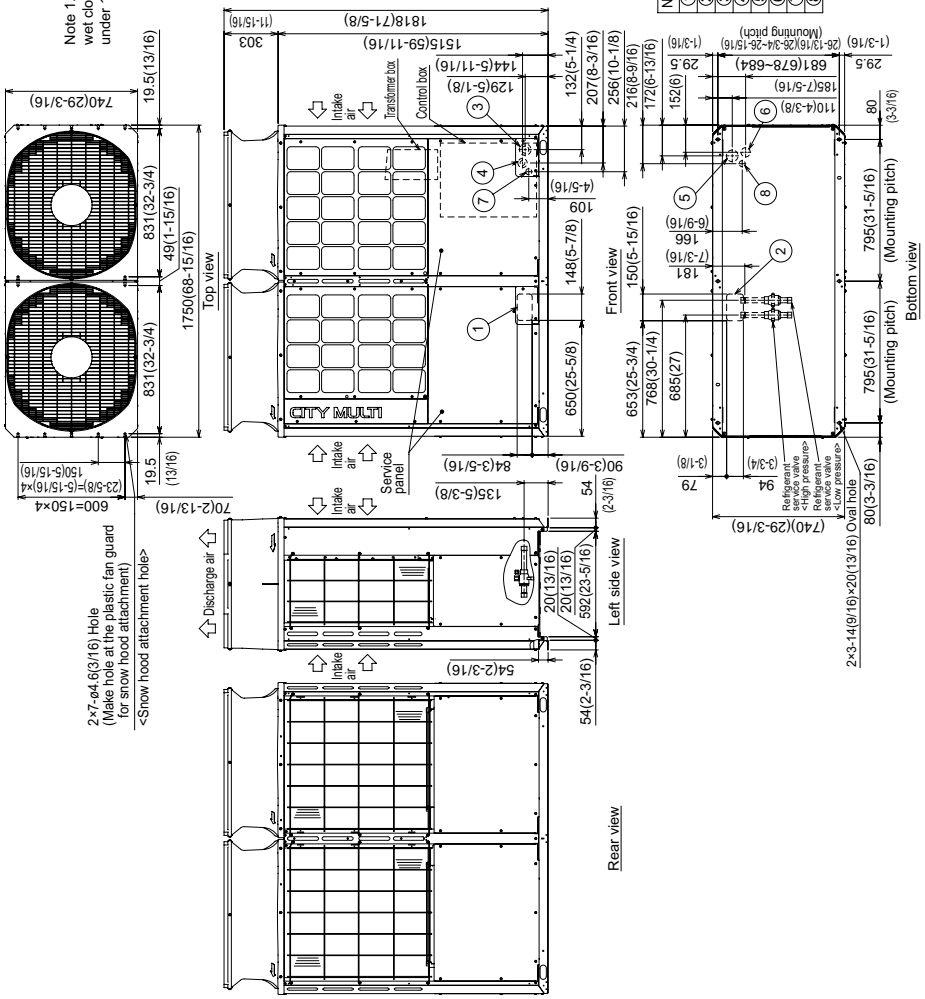

NOTES:
SEACOAST PROTECTION
Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.

1340 Satellite Boulevard Suwanee, GA 30024
Toll Free: 800-433-4822 www.mehvac.com

FORM# PURY-EP168YNU-A - 202405

Specifications are subject to change without notice.

© 2024 Mitsubishi Electric Trane HVAC US LLC. All rights reserved.