CITYMULTI®

20-TON PQRY-P240TSLMU-A1

MITSUBISHI ELECTRIC
HEATING & AIR CONDITIONING

Job Name:

System Reference: Date:

208/230V MODULAR WATER-SOURCE VRF HEAT PUMP SYSTEM



ACCESSORIES

- ☑ Twinning Kit (Required) CMY-Q100CBK2
- ☑ BC Controller (Required) ..... for details see BC Controller Submittals
- ☐ Joint Kit ..... for details see Pipe Accessories Submittal

Specifications			System
Unit Type			PQRY-P240TSLMU-A1
Cooling Capacity (Nominal)		BTU/H	240,000
Heating Capacity (Nominal)		BTU/H	270,000
Net Weight		Lbs. [kg]	764 [346]
Refrigerant Piping Diameter (From Twinning Kit to First Joint or Header)	Liquid (High Pressure)	In. [mm]	7/8 [22.2] Brazed (Pipe Size Dependent on Piping Length)
	Gas (Low Pressure)	In. [mm]	1-3/8 [34.93] Brazed
Max. Total Refrigerant Line Length		Ft.	2,460
Max. Refrigerant Line Length (Between ODU & IDU)		Ft.	541
Max. Control Wiring Length		Ft.	1,640
Indoor Unit Connectable	Total Capacity		50.0~150.0% of heatsource unit capacity
	Model/Quantity		P06~P96/2.0~50.0
Sound Pressure Level		dB(A)	57.0/57.0
Compressor Operating Range			7.0% to 100.0%
AHRI Ratings (Ducted/Non-ducted)	EER		12.5/13.8
	IEER		22.4/25.7
	COP		5.46/5.32
	SCHE		19.3/20.0


Specifications			Module 1	Module 2
Unit Type			PQRY-P120TLMU-A1	PQRY-P120TLMU-A1
Cooling Capacity (Nominal)		BTU/H	120,000	120,000
Heating Capacity (Nominal)		BTU/H	135,000	135,000
Operating Temperature Range	Cooling (Indoor)	°F WB [°C WB]	59~75 [15.0~ 24.0]	59~75 [15.0~ 24.0]
	Heating (Indoor)	°F DB [°C DB]	59~81 [15.0~27.0]	59~81 [15.0~27.0]
Operating Water Temperature Range[1]	Cooling/Heating	°F [°C]	50~113.0 [10~45.0]	50~113.0 [10~45.0]
External Dimensions (H x W x D)		In. [mm]	43-5/16 x 34-11/16 x 21-11/16 [1,100 x 880 x 550]	43-5/16 x 34-11/16 x 21-11/16 [1,100 x 880 x 550]
Net Weight		Lbs. [kg]	382 [173]	382 [173]
External Finish			Galvanized steel sheets	Galvanized steel sheets
Electrical Power Requirements	Voltage, Phase, Hertz, Power Tolerance		208/230, 3, 60, ±10	208/230, 3, 60, ±10
Minimum Circuit Ampacity		A	29.0/26.0	29.0/26.0
Maximum Overcurrent Protection		A	50/45	50/45
SCCR		kA	5	5
Flow Rate		G/min [gpm]	25.4	25.4
		L/min	96	96
Pressure Drop		psi	3.48	3.48
		Ft.	8.0	8.0
Operation Volume Range		G/min [gpm]	13.2~31.7	13.2~31.7
		m3/h	3.0~7.2	3.0~7.2
Refrigerant Piping Diameter (From Twinning Kit)	Liquid (High Pressure)	In. [mm]	3/4 [19.05] Brazed	3/4 [19.05] Brazed
	Gas (Low Pressure)	In. [mm]	7/8 [22.2] Brazed	7/8 [22.2] Brazed
Compressor	Type x Quantity		Inverter scroll hermetic x 1	Inverter scroll hermetic x 1
Compressor Motor Output		kW	7.7	7.7
Refrigerant	Type x Original Charge		R410A x 11.0 lbs. + 1.0oz. [5.0 kg]	R410A x 11.0 lbs. + 1.0oz. [5.0 kg]
Lubricant	Lubricant	Lubricant	MEL32	MEL32
Protection Devices	High Pressure Protection	High Pressure Protection	High pressure sensor, High pressure switch at 4.15 Mpa (601 psi)	High pressure sensor, High pressure switch at 4.15 Mpa (601 psi)
	Inverter Circuit	Inverter Circuit	Over-heat protection, Over-current protection	Over-heat protection, Over-current protection
	Compressor	Compressor	Over-heat protection	Over-heat protection

NOTES:
[1]23°F EWT (Entering water temperature) is possible with glycol.
Each individual module requires a separate electrical connection. Refer to electrical data for each individual module.

Specifications are subject to change without notice.

© 2022 Mitsubishi Electric Trane HVAC US LLC. All rights reserved.

OUTDOOR UNIT: PQRY-P240TSLMU-A1 – DIMENSIONS

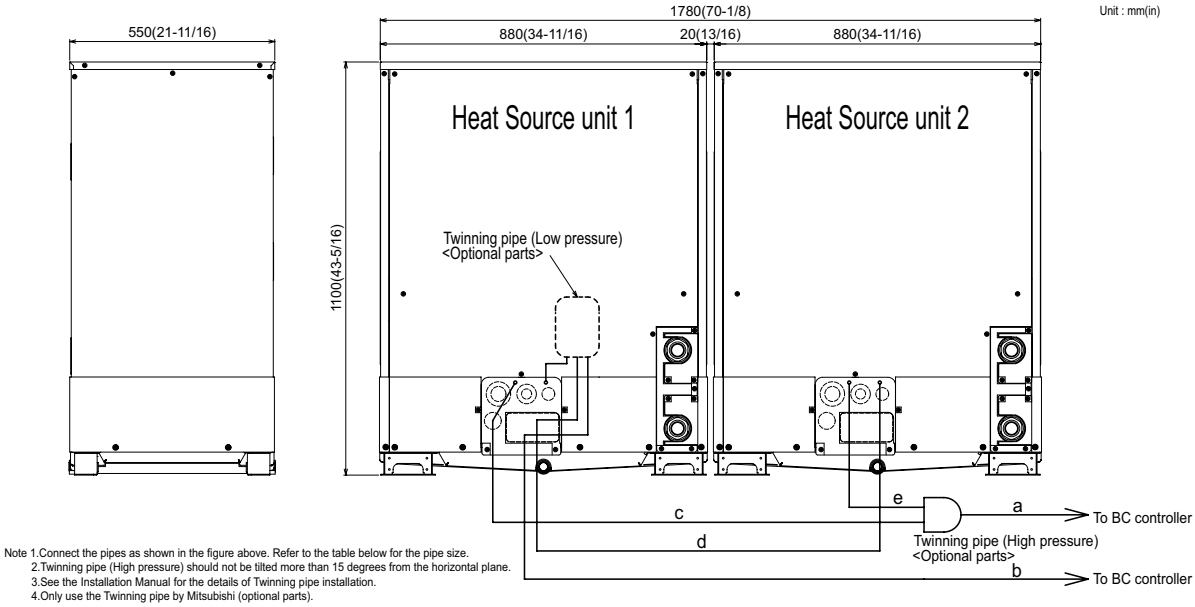

Note 1.Connect the pipes as shown in the figure above. Refer to the table below for the pipe size.
2.Twinning pipe (High pressure) should not be tilted more than 15 degrees from the horizontal plane.
3.See the Installation Manual for the details of Twinning pipe installation.
4.Only use the Twinning pipe by Mitsubishi (optional parts).

Twinning pipe connection size

Package unit name			PQRY-P144TSLMU-A1	PQRY-P168TSLMU-A1	PQRY-P192TSLMU-A1	PQRY-P216TSLMU-A1	PQRY-P240TSLMU-A1
Component unit name	Heat Source unit 1		PQRY-P72TLMU-A1	PQRY-P96TLMU-A1	PQRY-P96TLMU-A1	PQRY-P120TLMU-A1	PQRY-P120TLMU-A1
	Heat Source unit 2		PQRY-P72TLMU-A1	PQRY-P72TLMU-A1	PQRY-P96TLMU-A1	PQRY-P96TLMU-A1	PQRY-P120TLMU-A1
Twinning pipe Kit(optional parts)			CMY-Q100CBK2				
BC controller~Twinning pipe	High pressure	a	ø22.2(7/8)			ø22.2(7/8) *1	
	Low pressure	b	ø28.58(1-1/8)				ø34.93(1-3/8)

	Unit model	High pressure	Low pressure
		c or e	d
Twinning pipe~Heat source unit	P72	ø15.88(5/8) *2	ø19.05(3/4) *2
	P96	ø19.05(3/4)	ø22.2(7/8)
	P120		

*1.When the piping length is 65 m or longer, use the ø28.58(1-1/8) pipe for the part that exceeds 65 m.
*2.When the package unit name"PQRY-P168TSLMU-A", use the ø19.05(3/4) pipe for high pressure and the ø22.2(7/8) pipe for low pressure.

Specifications are subject to change without notice.

© 2022 Mitsubishi Electric Trane HVAC US LLC. All rights reserved.

MODULE 1: PQRY-P120TLMU-A1 – DIMENSIONS

Note1. Seal around the water piping, the refrigerant piping, the power supply, and the control wiring and plug unused knockout holes with putty, etc., to prevent moisture or dirt from entering cabinet.
Note2. At the time of product shipment, the front side piping serves as the local drainage connection.
When connecting on the rear side, please remove the rear side plug sealing corks, and attach on the front side.
Ensure there is no leak in piping system once connected.
Note3. See Fig. A and Fig. B for service clearances.
Note4. If piping is installed in front of the unit, provide clearances as shown in Fig. A and Fig. B.
Note5. Environmental condition for installation; -20~40°C(DB) (-4~104°F) for indoor installation.
Note6. In case the temperature around the heat source unit has possibility to drop under 0°C(32°F), be careful for the following point to prevent the pipe burst by the water pipe freeze-up.
•Circulate the water all the time even if heat source unit is not in operation and provide glycol for freeze protection.
•Drain the water from inside of the heat source unit when the heat source unit will not operate for a long term.
Note7. Ensure that the drain piping is downward with a pitch of more than 1/100.
Note8. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).



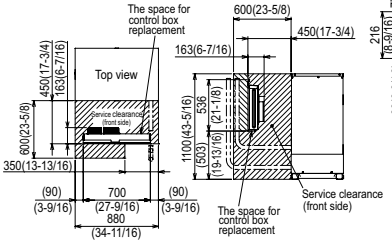



Fig.A Fig.B



Top view

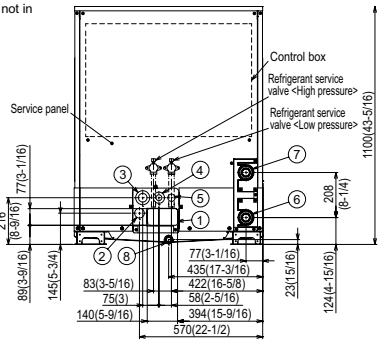

Front view

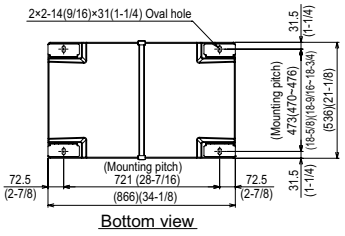

Bottom view

Connecting pipe specifications

Model	Diameter			
	Refrigerant pipe		Service valve	
	High pressure	Low pressure	High pressure	Low pressure
PQRY-P72TLMU-A1	ø15.88 Brazed (5/8) *1 *2	ø19.05 Brazed (3/4) *1 *2	ø19.05 (3/4)	ø25.4 (1)
PQRY-P96TLMU-A1 PQRY-P120TLMU-A1	ø19.05 Brazed (3/4) *1	ø22.2 Brazed (7/8) *1 *2		


*1. Connect by using the connecting pipes and elbow that are supplied.
*2. Use the pipe joint(field supply) and connect to the refrigerant service valve piping.

<Accessories>

Unit : mm(in)

- Refrigerant (high pressure) conn. pipe····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)
- Refrigerant (low pressure) conn. elbow····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)
- Water stopper····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)
- Sealing material for water stopper····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)
- Sealing material for field piping (high pressure, low pressure)····· 1pc. each (P72/P96/P120 ; Packaged in the accessory kit)
- Sealing material for drain socket····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)
- Pipe cover for low pressure····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)

Top of unit casing not suitable for supporting system modules stacked above - field framing required for stacking modules of additional systems

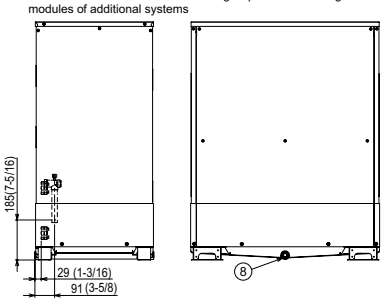

Right side view Back view

NO.	Usage		Specifications
①	For pipes	Front through hole	140 × 77 Knockout hole (5-9/16) (3-1/16)
②		Front through hole (Uses when twinning kit (optional parts) is mounted.)	ø45 Knockout hole (1-13/16)
③	For wires	Front through hole	ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
④		Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
⑤	For transmission cables	Front through hole	ø34 Knockout hole (1-3/8)
⑥	Water pipe	inlet	NPT1-1/2 Screw
⑦		outlet	NPT1-1/2 Screw
⑧	Drain pipe	Rc3/4 Screw	

Specifications are subject to change without notice.

© 2022 Mitsubishi Electric Trane HVAC US LLC. All rights reserved.

MODULE 2: PQRY-P120TLMU-A1 – DIMENSIONS

Note1. Seal around the water piping, the refrigerant piping, the power supply, and the control wiring and plug unused knockout holes with putty, etc., to prevent moisture or dirt from entering cabinet.
Note2. At the time of product shipment, the front side piping serves as the local drainage connection. When connecting on the rear side, please remove the rear side plug sealing corks, and attach on the front side. Ensure there is no leak in piping system once connected.
Note3. See Fig. A and Fig. B for service clearances.
Note4. If piping is installed in front of the unit, provide clearances as shown in Fig. A and Fig. B.
Note5. Environmental condition for installation; -20~40°C(DB) (-4~104°F) for indoor installation.
Note6. In case the temperature around the heat source unit has possibility to drop under 0°C(32°F), be careful for the following point to prevent the pipe burst by the water pipe freeze-up.
- •Circulate the water all the time even if heat source unit is not in operation and provide glycol for freeze protection.
- •Drain the water from inside of the heat source unit when the heat source unit will not operate for a long term.

Note7. Ensure that the drain piping is downward with a pitch of more than 1/100.
Note8. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).



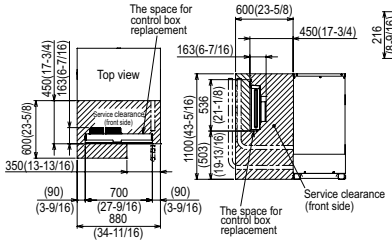



Fig.A Fig.B

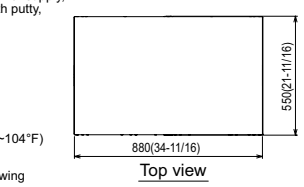

Top view

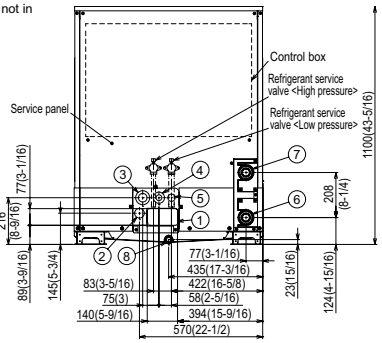

Front view

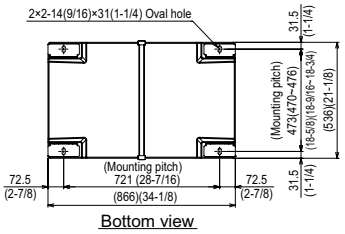

Bottom view

Connecting pipe specifications

Model	Diameter			
	Refrigerant pipe		Service valve	
	High pressure	Low pressure	High pressure	Low pressure
PQRY-P72TLMU-A1	ø15.88 Brazed (5/8) *1 *2	ø19.05 Brazed (3/4) *1 *2	ø19.05 (3/4)	ø25.4 (1)
PQRY-P96TLMU-A1 PQRY-P120TLMU-A1	ø19.05 Brazed (3/4) *1	ø22.2 Brazed (7/8) *1 *2		


*1. Connect by using the connecting pipes and elbow that are supplied.
*2. Use the pipe joint(field supply) and connect to the refrigerant service valve piping.

<Accessories>

Unit : mm(in)

- Refrigerant (high pressure) conn. pipe····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)
- Refrigerant (low pressure) conn. elbow····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)
- Water stopper····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)
- Sealing material for water stopper····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)
- Sealing material for field piping (high pressure, low pressure)····· 1pc. each (P72/P96/P120 ; Packaged in the accessory kit)
- Sealing material for drain socket····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)
- Pipe cover for low pressure····· 1pc. (P72/P96/P120 ; Packaged in the accessory kit)

Top of unit casing not suitable for supporting system modules stacked above - field framing required for stacking modules of additional systems

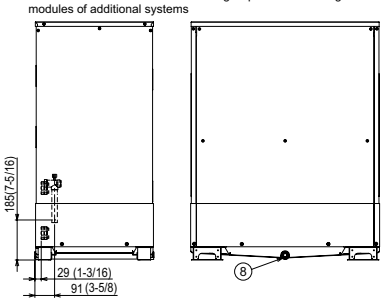

Right side view Back view

NO.	Usage		Specifications
①	For pipes	Front through hole	140 × 77 Knockout hole (5-9/16) (3-1/16)
②		Front through hole (Uses when twinning kit (optional parts) is mounted.)	ø45 Knockout hole (1-13/16)
③	For wires	Front through hole	ø62.7 or ø34.5 Knockout hole (2-1/2) (1-3/8)
④		Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
⑤	For transmission cables	Front through hole	ø34 Knockout hole (1-3/8)
⑥	Water pipe	inlet	NPT1-1/2 Screw
⑦		outlet	NPT1-1/2 Screw
⑧	Drain pipe	Rc3/4 Screw	


Specifications are subject to change without notice.

© 2022 Mitsubishi Electric Trane HVAC US LLC. All rights reserved.


TWINNING KIT: CMY-Q100CBK2 – DIMENSIONS

CMY-Q100CBK2

Low-pressure pipe twinning kit

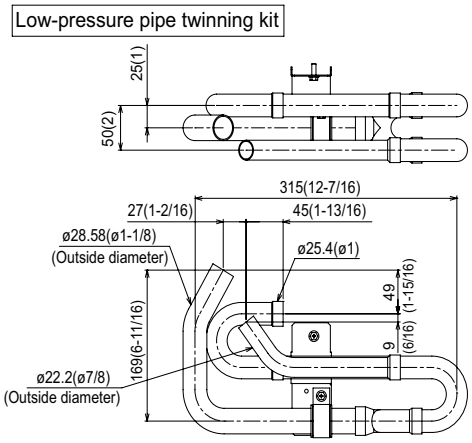


<Elbow pipe(Accessory)>

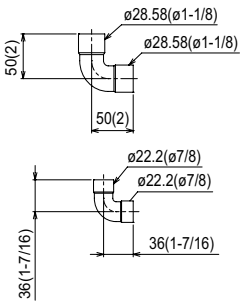


<Accessory>

Fixing screw	• • • 1
Insulation cover	• • • 1
Pipe cover (150mm(5-15/16) Length)	• • • 2
Pipe cover (60mm(2-3/8) Length)	• • • 1
Pipe cover (80mm(3-3/16) Length)	• • • 2
Cable tie	• • • 2
Water stopper	• • • 1
Sealing material (Small)	• • • 1
Sealing material (Large)	• • • 1


<Pipe for routing through the front (Accessory)>




High-pressure twinning pipe



<Pipe for routing through the front (Accessory)>

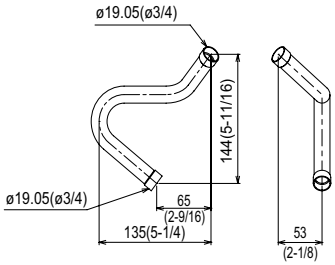

Note 1. Refer to the figure below for the installation position of the high-pressure twinning pipe.



Inclination tolerance of the high-pressure twinning pipe is ±15° relative to the ground.

2. Pipe diameter is indicated by inside diameter.

1340 Satellite Boulevard Suwanee, GA 30024
Toll Free: 800-433-4822 www.mehvac.com

FORM# PQRY-P240TSLMU-A1 - 202207

Specifications are subject to change without notice.

© 2022 Mitsubishi Electric Trane HVAC US LLC. All rights reserved.