

Job Name: _____ Location: _____

Drawing Reference: _____ Schedule No. _____

System No.: _____ Date: _____

OUTDOOR VRFZ HEAT PUMP SYSTEM FEATURES

- 3-phase, 208/230V
- Modular variable refrigerant flow zoning (VRFZ) systems; smaller capacity units can be piped together to form a single, large-capacity two-pipe system
- Selectable fan static, 0.12 or 0.24"WG external static pressure; factory set to 0"WG
- Max. Total Refrigerant Line Length: 3,280'; Max. Refrigerant Line Length: 541'; Max. Control Wiring Length: 1,640'
- Connects to CITY MULTI indoor units; controlled via CITY MULTI Controls Network
- External finish: Pre-coated Galvanized-steel Sheets
- Operating Temperature Range
 - Cooling (Outdoor): 23° ~ 115°F (-5° ~ +46°C) DB
 - Heating (Outdoor): -4° ~ +60°F (-20° ~ +16°C) WB



PUHY-P96TJMU-A

INVERTER



OPTIONAL PARTS

- ☐ T-Branch Joint (≤ 72,000 Btu/h).....CMY-Y102S-G2
- ☐ T-Branch Joint (73,000-144,000 Btu/h).....CMY-Y102L-G2
- ☐ Header - 4-Branch (Capacity: ≤ 72,000 Btu/h).....CMY-Y104-G
- ☐ Header - 8-Branch (Capacity: ≤ 144,000 Btu/h).....CMY-Y108-G
- ☐ Header - 10-Branch (Capacity: ≤ 234,000 Btu/h).....CMY-Y1010-G


Specifications		Model Name
Unit Type		PUHY-P96TJMU-A
Nominal Cooling Capacity	Btu/h	96,000
Nominal Heating Capacity	Btu/h	108,000
External Dimensions (H x W x D)	In. / mm	65 x 48-1/16 x 29-15/16 / 1,650 x 1,220 x 760
Net Weight	Lbs. / kg	497 / 225
Electrical Power Requirements	Voltage, Phase, Hertz	208 / 230V, 3-phase, 60Hz
Cooling Power Input	kW	7.95
Heating Power Input	kW	8.54
Cooling Current (208/230V)	R.L.A.	24.5 / 22.1
Heating Current (208/230V)	R.L.A.	26.3 / 23.8
Minimum Circuit Ampacity (MCA)	A	36 / 34
Recommended Fuse/Breaker Size	A	40
Maximum Fuse Size	A	50 / 50
Piping Diameter (Brazed) (In. / mm)	Liquid (High Pressure)	3/8 / 9.52 (1/2 / 12.7 if total length ≥ 295' / 90 m)
	Gas (Low Pressure)	7/8 / 22.2
Indoor Unit	Total Capacity	50 to 130% of Outdoor Unit Capacity
	Model / Quantity	P06 to P72 / 1 to 20
Sound Pressure Levels	dB(A)	58.0
Fan		
Type x Quantity		Propeller Fan x 1
Airflow Rate	CFM	6,180
Direct-drive Inverter Motor Output	kW	0.92
Compressor Operating Range		19% to 100%
Compressor Type x Quantity		Inverter-driven Scroll Hermetic x 1
Compressor Motor Output	kW	6.8
Compressor Crankcase Heater	kW	0.045
Refrigerant		R410A
Lubricant		MEL32
High-pressure Protection Device		601 psi / 4.15 MPa
Compressor / Fan Protection Device		Overheat Protection / Thermal Switch
Inverter Protection Device		Overheat / Overcurrent Protection
Blue Fin Anti-corrosion Protection: Cellulose- and polyurethane-resin coating treatment applied to condenser coil that protects it from air contaminants; ≥1µm thick; Salt Spray Test Method - no unusual rust development to 480 hours.		

Model: PUHY-P96TJMU-A – DIMENSIONS

- <Optional parts>
 ● Connecting pipe
 <Gas> · Elbow (Da25.4(1)XODa25.4(1)) 1pc.
 · Pipe (Da25.4(1)XODa22.2(7/8)) 1pc.
 <Liquid> · Pipe (Da9.52(3/8)XODa9.52(3/8)) 1pc.
 · Pipe (Da9.52(3/8)XODa12.7(1/2)) 1pc.

Note1. Please refer to (22) for information regarding necessary spacing around the unit and foundation work.
 2. At brazing of pipes, wrap the refrigerant service valve with wet cloth and keep the temperature of refrigerant service valve under 120°C(248°F).

NO.	Usage	Specifications
①	Front through hole	102 X 72 Knockout hole (4-1/32) (2-7/32)
②	Bottom through hole	150 X 94 Knockout hole (5-29/32) (3-23/32)
③	Front through hole	ø62.7 or ø34.5 Knockout hole (2-15/32) (1-3/8)
④	Front through hole	ø43.7 or ø22.2 Knockout hole (1-3/4) (7/8)
⑤	Bottom through hole	ø65 Knockout hole (2-9/16)
⑥	Front through hole	ø34 Knockout hole (1-11/32)

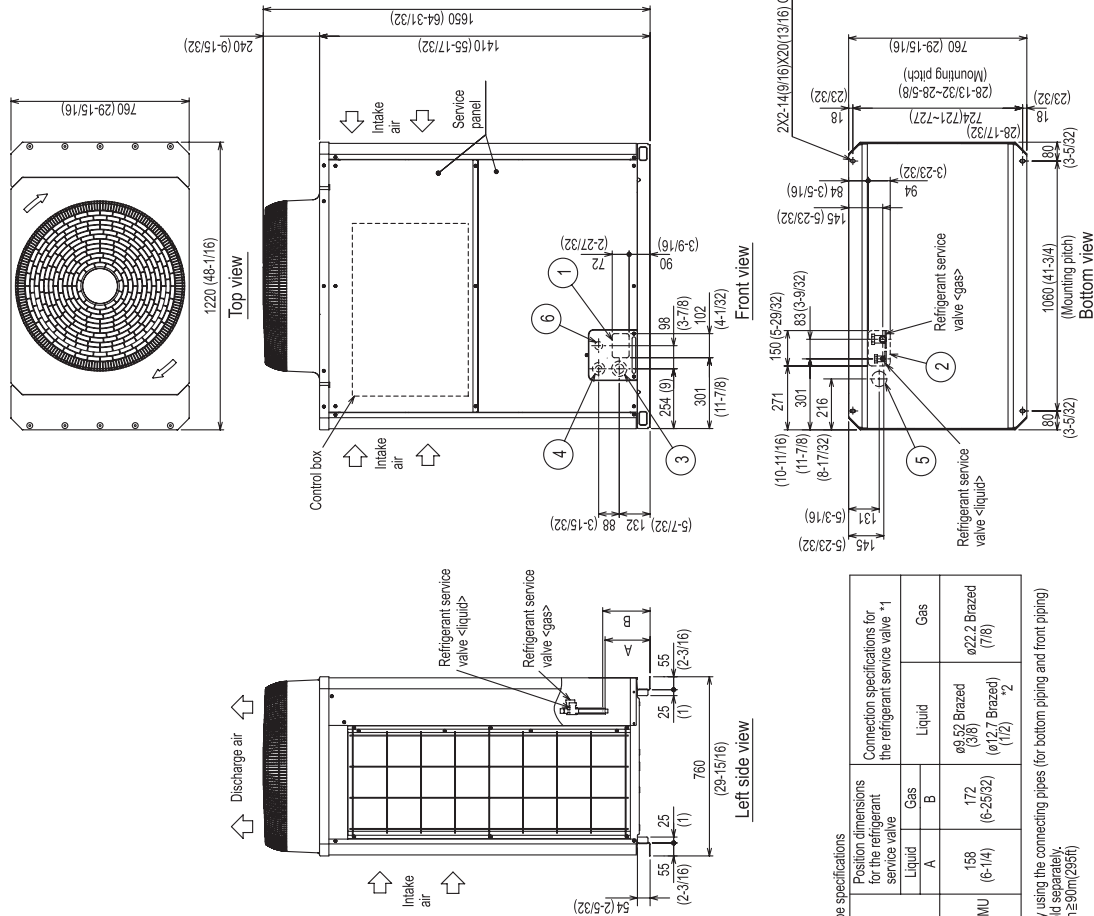

Unit : mm(in.)

Model	Position dimensions for the refrigerant service valve		Connection specifications for the refrigerant service valve *1	
	Liquid	Gas	Liquid	Gas
PUHY-P96TJMU	158 (6-1/4)	172 (6-25/32)	ø5.52 Braze (3/8) (ø12.7 Braze) *2	ø22.2 Braze (7/8)

*1 Connected by using the connecting pipes (for bottom piping and front piping) that are sold separately.
 *2 Total length ≤ 90m(295ft)



Certificate Number FM33568

Mitsubishi Electric Air Conditioning & Refrigeration Systems Works acquired ISO 9001 certification under Series 9000 of the International Standard Organization (ISO) based on a review of quality warranties for the production of refrigeration and air conditioning equipment.

ISO Authorization System
 The ISO 9000 series is a plant authorization system relating to quality warranties as stipulated by the ISO. ISO 9001 certifies quality warranties based on the "design, development, production, installation and auxiliary services" for products built at an authorized plant.

Mitsubishi Electric Air Conditioning & Refrigeration Systems Works acquired environmental management system standard ISO 14001 certification.

The ISO 14000 series is a set of standards applying to environmental protection set by the International Standard Organization (ISO).



Certificate Number EC97J1227

C SD - PUHY-P96TJMU-A - 1 - 201004 © MITSUBISHI ELECTRIC / HVAC 2010



HVAC Advanced Products Division

Mitsubishi Electric & Electronics USA, Inc.

3400 Lawrenceville Suwanee Rd.

Suwanee, GA 30024

Tele: 678-376-2900 • Fax: 800-889-9904

Toll Free: 800-433-4822 (#4)

www.mehvac.com

Specifications are subject to change without notice.