Changes for the Better

SERVICE PARTS LIST FOR MITSUBISHI ELECTRIC PACKAGED AIR-CONDITIONERS


Series : CMB

June 2008

BWE08040


INDEX
CMB-P1016NU-HB

MITSUBISHI ELECTRIC

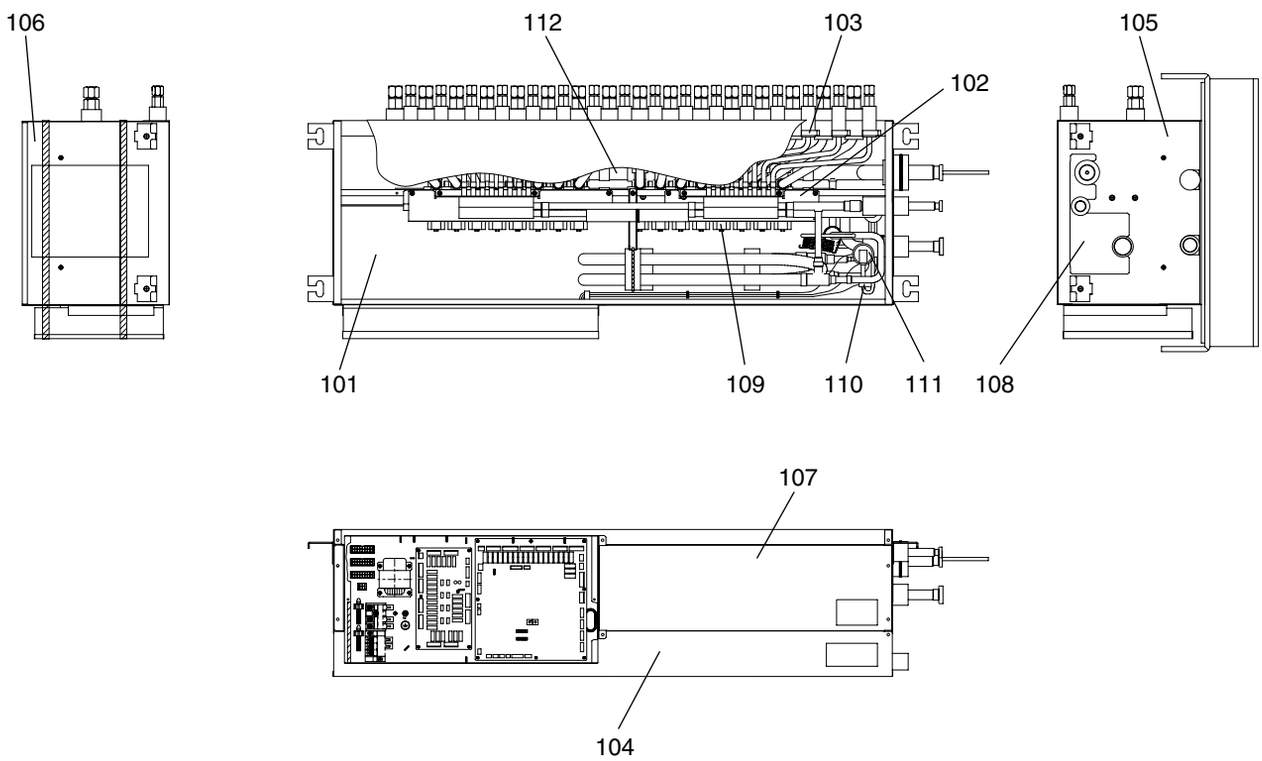
106
112
103
105
102
101
109
110
111
108
107
104

No.	Part No.	G : RoHS Apply Only W : RoHS Apply by Running Change	Part Name	Spec.	CMB-P1016NU-HB						Dwg. No.	Price	Revision History
101	R61 Y28 529	W	Drain pan	CMB-NUG	1						W663337G05		
102	R61 042 690		Wire cover assy	16HB	1						KB00G916G05		
103	R63 H35 306	G	Fixture		16						W875562H01		
104	R63 M82 653	G	Panel U	F1013	1						W646945H02		
105	R61 Y41 652	W	Panel SL		1						W662535H03		
106	R61 Y18 652	W	Panel SR		1						W648600H03		
107	R63 M82 690	G	Cover B	F1013	1						W893271H07		
108	R63 M88 668	G	Cover FB		1						W893270H01		
109	R61 2A1 243	W	Solenoid valve coil		48						P472011X01		
110	R61 060 200	G	Thermistor		2						P418065X01		
111	R61 009 401	G	Linear expansion valve	EFM-40YGMD-2	1						P632457X01		
112			Solenoid valve		1								

<Note> The number 112 do not set service parts.
Because,the quality securing of them when exchanging parts is difficult.

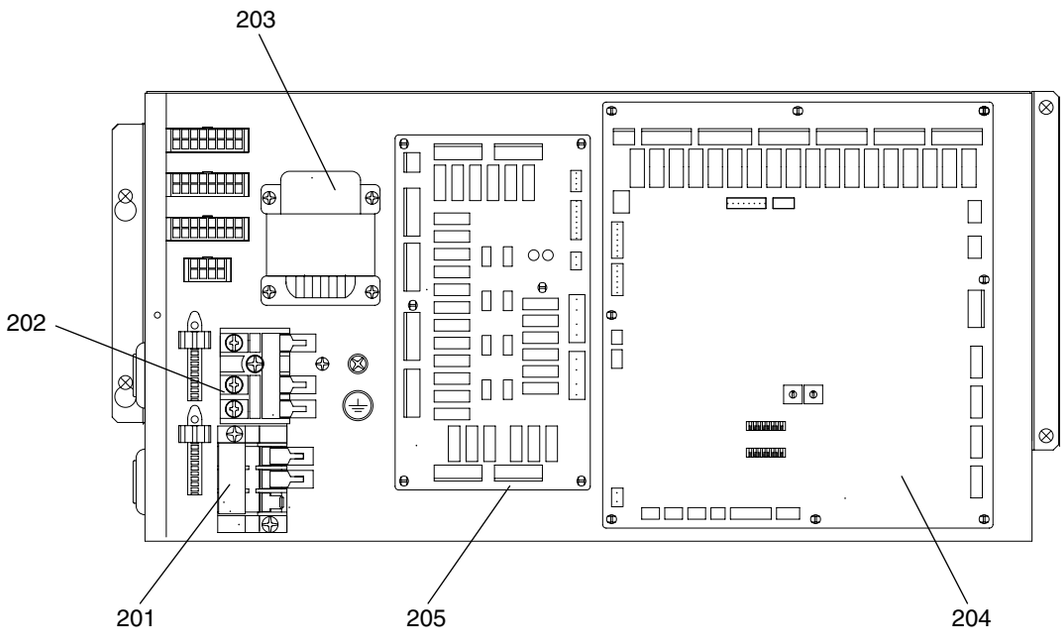

No.	Part No.	G : RoHS Apply Only W : RoHS Apply by Running Change	Part Name	Spec.	CMB-P1016NU-HB						Dwg. No.	Price	Revision History
201	R63 Y02 715	G	Terminal block		1						W834188H02		
202	R63 979 247	G	Terminal block		1						P436110X01		
203	R61 Y21 260	W	Transformer	230V/24.2V	1						P715355X01		
204	R63 044 280	G	Board assy	BC-M01	1						W266227G08		
205	R63 M82 280	G	Board assy	RELAY10-16	1						W629543G01		

MITSUBISHI ELECTRIC CORPORATION
HEAD OFFICE: TOKYO BLDG., 2-7-3, MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN

BWE08040 (20080630)