TRANE

MITSUBISHI ELECTRIC

October 2019

SERVICE MANUAL

R410A

No. OCHT721
REVISED EDITION-A

Outdoor unit
[Model Name]

TRUZH0241HA00NA

Revision:
- Some descriptions have been modified in REVISED EDITION-A.

OCHT721 is void.

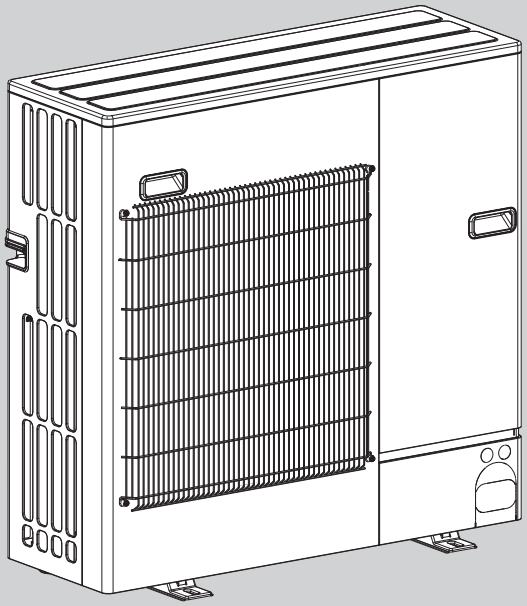

CONTENTS

1. REFERENCE MANUAL ····· 2
2. SAFETY PRECAUTION ····· 2
3. FEATURES ····· 6
4. SPECIFICATIONS ····· 7
5. DATA ····· 8
6. OUTLINES AND DIMENSIONS ····· 10
7. WIRING DIAGRAM ····· 11
8. WIRING SPECIFICATIONS ····· 12
9. REFRIGERANT SYSTEM DIAGRAM ····· 16
10. TROUBLESHOOTING ····· 17
11. EASY MAINTENANCE FUNCTION ····· 70
12. FUNCTION SETTING ····· 72
13. MONITORING THE OPERATION DATA BY THE REMOTE CONTROLLER ····· 77
14. DISASSEMBLY PROCEDURE ····· 87

PARTS CATALOG (OCBT721)

1 REFERENCE MANUAL

INDOOR UNIT

Model name	Service manual No. Parts catalog No.
TPLA0A0241EA70A	OCHT640 OCBT640
TPKA0A0241KA70A	OCHT639 OCBT639
TPCA0A0241KA70A	OCHT638 OCBT638
TPEADA0241AA70A	HWE19030
TPVA0A0241AA70A	-

2 SAFETY PRECAUTION

2-1. ALWAYS OBSERVE FOR SAFETY

Before obtaining access to terminal, all supply circuits must be disconnected.

Preparation before the repair service.

- Prepare the proper tools.
- Prepare the proper protectors.
- Provide adequate ventilation.
- After stopping the operation of the air conditioner, turn off the power-supply beaker.
- Discharge the condenser before the work involving the electric parts.

Precautions during the repair service.

- Do not perform the work involving the electric parts with wet hands.
- Do not pour water into the electric parts.
- Do not touch the refrigerant.
- Do not touch the hot or cold areas in the refrigerating cycle.
- When the repair or the inspection of the circuit needs to be done without turning off the power, exercise great caution not to touch the live parts.
- When opening or closing the valve below freezing temperatures, refrigerant may spurt out from the gap between the valve stem and the valve body, resulting in injuries.

2-2. CAUTIONS RELATED TO NEW REFRIGERANT

Cautions for units utilizing refrigerant R410A

Use new refrigerant pipes.

In case of using the existing pipes for R22, be careful with the following.
· Be sure to clean the pipes and make sure that the insides of the pipes are clean.
· Change flare nut to the one provided with this product. Use a newly flared pipe.
· Avoid using thin pipes.

**Make sure that the inside and outside of refrigerant piping is clean and it has no contaminants such as sulfur, oxides, dirt, shaving particles, etc. which are hazard to refrigerant cycle.
In addition, use pipes with specified thickness.**

Contamination inside refrigerant piping can cause deterioration of refrigerant oil, etc.

**Store the piping indoors, and both ends of the piping sealed until just before brazing.
(Leave elbow joints, etc. in their packaging.)**

If dirt, dust or moisture enters into refrigerant cycle, that can cause deterioration of refrigerant oil or malfunction of compressor.

The refrigerant oil applied to flare and flange connections must be ester oil, ether oil or alkylbenzene oil in a small amount.

If large amount of mineral oil enters, that can cause deterioration of refrigerant oil, etc.

Charge refrigerant from liquid phase of gas cylinder.

If the refrigerant is charged from gas phase, composition change may occur in refrigerant and the efficiency will be lowered.

Do not use refrigerant other than R410A.

If other refrigerant (R22, etc.) is used, chlorine in refrigerant can cause deterioration of refrigerant oil, etc.

Use a vacuum pump with a reverse flow check valve.

Vacuum pump oil may flow back into refrigerant cycle and that can cause deterioration of refrigerant oil, etc.

Use the following tools specifically designed for use with R410A refrigerant.

The following tools are necessary to use R410A refrigerant.

Tools for R410A	
Gauge manifold	Flare tool
Charge hose	Size adjustment gauge
Gas leak detector	Vacuum pump adaptor
Torque wrench	Electronic refrigerant charging scale

Handle tools with care.

If dirt, dust or moisture enters into refrigerant cycle, that can cause deterioration of refrigerant oil or malfunction of compressor.

Do not use a charging cylinder.

If a charging cylinder is used, the composition of refrigerant will change and the efficiency will be lowered.

Ventilate the room if refrigerant leaks during operation. If refrigerant comes into contact with a flame, poisonous gases will be released.

Use the specified refrigerant only.

Never use any refrigerant other than that specified.
Doing so may cause a burst, an explosion, or fire when the unit is being used, serviced, or disposed of.
Correct refrigerant is specified in the manuals and on the spec labels provided with our products.
We will not be held responsible for mechanical failure, system malfunction, unit breakdown or accidents caused by failure to follow the instructions.

[1] Cautions for service

(1) Perform service after recovering the refrigerant left in unit completely.
(2) Do not release refrigerant in the air.
(3) After completing service, charge the cycle with specified amount of refrigerant.
(4) When performing service, install a filter drier simultaneously.
Be sure to use a filter drier for new refrigerant.

[2] Additional refrigerant charge

When charging directly from cylinder

· Check that cylinder for R410A on the market is a syphon type.
· Charging should be performed with the cylinder of syphon stood vertically. (Refrigerant is charged from liquid phase.)

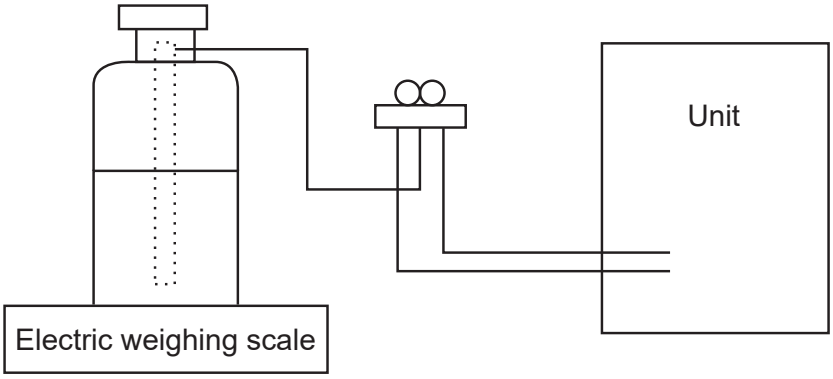

[3] Service tools

Use the below service tools as exclusive tools for R410A refrigerant.

No.	Tool name	Specifications
①	Gauge manifold	· Only for R410A
		· Use the existing fitting specifications.
		· Use high-tension side pressure of 5.3MPa·G or over.
②	Charge hose	· Only for R410A
		· Use pressure performance of 5.09MPa·G or over.
③	Electronic weighing scale	—
④	Gas leak detector	· Use the detector for R134a, R407C or R410A.
⑤	Adaptor for reverse flow check	· Attach on vacuum pump.
⑥	Refrigerant charge base	—
⑦	Refrigerant cylinder	· Only for R410A · Top of cylinder (Pink) · Cylinder with syphon
⑧	Refrigerant recovery equipment	—

2-3. CAUTIONS FOR REFRIGERANT PIPING WORK

New refrigerant R410A is adopted for replacement inverter series. Although the refrigerant piping work for R410A is same as for R22, exclusive tools are necessary so as not to mix with different kind of refrigerant. Furthermore as the working pressure of R410A is 1.6 time higher than that of R22, their sizes of flared sections and flare nuts are different.

①Thickness of pipes

Because the working pressure of R410A is higher compared to R22, be sure to use refrigerant piping with thickness shown below. (Never use pipes of 7/256 in [0.7 mm] or below.)

Nominal dimensions (in)	Outside diameter (mm)	Thickness: in (mm)	
		R410A	R22
1/4	6.35	1/32 [0.8]	1/32 [0.8]
3/8	9.52	1/32 [0.8]	1/32 [0.8]
1/2	12.70	1/32 [0.8]	1/32 [0.8]
5/8	15.88	5/128 [1.0]	5/128 [1.0]
3/4	19.05	—	5/128 [1.0]

②Dimensions of flare cutting and flare nut

The component molecules in HFC refrigerant are smaller compared to conventional refrigerants. In addition to that, R410A is a refrigerant, which has higher risk of leakage because its working pressure is higher than that of other refrigerants. Therefore, to enhance air tightness and strength, flare cutting dimension of copper pipe for R410A has been specified separately from the dimensions for other refrigerants as shown below. The dimension B of flare nut for R410A also has partly been changed to increase strength as shown below. Set copper pipe correctly referring to copper pipe flaring dimensions for R410A below. For 1/2 and 5/8 inch pipes, the dimension B changes.

Use torque wrench corresponding to each dimension.

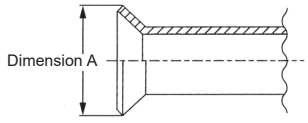



Flare cutting dimensions

Nominal dimensions (in)	Outside diameter (mm)	Dimension A ($^{+0}_{-0.4}$)	
		R410A (in[mm])	R22 (mm)
1/4	6.35	11/32-23/64 [9.1]	9.0
3/8	9.52	1/2-33/64 [13.2]	13.0
1/2	12.70	41/64-21/32 [16.6]	16.2
5/8	15.88	49/64-25/32 [19.7]	19.4
3/4	19.05	—	23.3

Flare nut dimensions

Nominal dimensions (in)	Outside diameter (mm)	Dimension B	
		R410A (in[mm])	R22 (mm)
1/4	6.35	43/64 [17.0]	17.0
3/8	9.52	7/8 [22.0]	22.0
1/2	12.70	1-3/64 [26.0]	24.0
5/8	15.88	1-9/64 [29.0]	27.0
3/4	19.05	—	36.0

③Tools for R410A (The following table shows whether conventional tools can be used or not.)

Tools and materials	Use	R410A tools	Can R22 tools be used?
Gauge manifold	Air purge, refrigerant charge and operation check	Tool exclusive for R410A	×
Charge hose		Tool exclusive for R410A	×
Gas leak detector	Gas leak check	Tool for HFC refrigerant	×
Refrigerant recovery equipment	Refrigerant recovery	Tool exclusive for R410A	×
Refrigerant cylinder	Refrigerant charge	Tool exclusive for R410A	×
Applied oil	Apply to flared section	Ester oil and alkylbenzene oil (minimum amount)	×
Safety charger	Prevent compressor malfunction when charging refrigerant by spraying liquid refrigerant	Tool exclusive for R410A	×
Charge valve	Prevent gas from blowing out when detaching charge hose	Tool exclusive for R410A	×
Vacuum pump	Vacuum drying and air purge	Tools for other refrigerants can be used if equipped with adopter for reverse flow check	△(Usable if equipped with adopter for reverse flow)
Flare tool	Flaring work of piping	Tools for other refrigerants can be used by adjusting flaring dimension	△(Usable by adjusting flaring dimension)
Bender	Bend the pipes	Tools for other refrigerants can be used	○
Pipe cutter	Cut the pipes	Tools for other refrigerants can be used	○
Welder and nitrogen gas cylinder	Weld the pipes	Tools for other refrigerants can be used	○
Refrigerant charging scale	Refrigerant charge	Tools for other refrigerants can be used	○
Vacuum gauge or thermistor vacuum gauge and vacuum valve	Check the degree of vacuum. (Vacuum valve prevents back flow of oil and refrigerant to thermistor vacuum gauge)	Tools for other refrigerants can be used	○
Charging cylinder	Refrigerant charge	Tool exclusive for R410A	×

× : Prepare a new tool. (Use the new tool as the tool exclusive for R410A.)
△ : Tools for other refrigerants can be used under certain conditions.
○ : Tools for other refrigerants can be used.

3 FEATURES

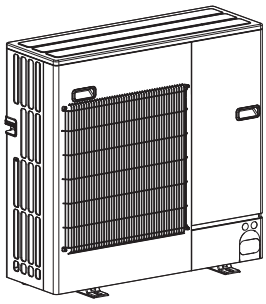

TRUZH0241HA00NA

HIGH HEATING CAPACITY

High capacity compressor is equipped, which enables to keep the equal capacity to the rating even when outside temperature is 5°F [−15°C].

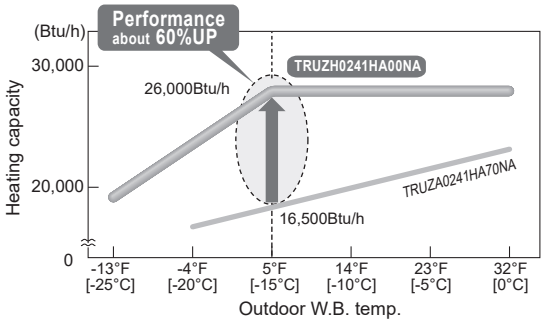

WIDE HEATING RANGE

The heating range is expanded to −13°F [−25°C] compared to TRUZA type which is up to 10°F [−12°C].

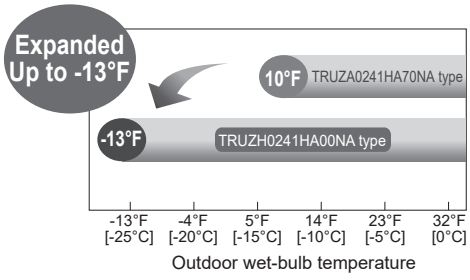

CHARGELESS SYSTEM
PRE-CHARGED REFRIGERANT IS SUPPLIED FOR PIPING LENGTH AT SHIPMENT.
Maximum 70 ft, 21m

The refrigerant circuit with LEV (Linear Expansion Valve) and power receiver always control the optimal refrigerant level regardless of the length (maximum: 70 ft [21 m] and minimum: 16 ft [5 m]) of piping. The additional refrigerant charging work during installation often causes problems. It is completely eliminated by chargeless system. This unique system improves the quality and reliability of the work done. It also helps to speed up the installation time.

4 SPECIFICATIONS

Service Ref.			TRUZH0241HA00NA
Power supply	Phase		Single
	Cycle		60 Hz
	Voltage		208/230 V
MCA		A	19
MOCP		A	26
Breaker size		A	25
External finish			Munsell 3Y 7.8/1.1
Heat exchanger			Plate fin coil
Defrost method			Reverse cycle
Crankcase heater		kW	—
Compressor			Hermetic
	Model		DNB28FBAMT
	Motor output	kW	4.7
	R.L.A.		9
	L.R.A.		18
	Starter type		Inverter
Fan	Fan(drive) × No.		Propeller fan x 1
	Fan motor output	kW	0.086
	Fan motor	F.L.A.	0.40
	Airflow	m3/min	55
		CFM	1940
Sound pressure level (SPL)	Cooling	dB	52
	Heating	dB	53
Protection devices			HP switch Comp. Surface thermistor
Dimensions	W	mm	950
	D	mm	330 + 30
	H	mm	943
	W	in	37 - 13/32
	D	in	13 + 1-3/16
	H	in	37 - 1/8
Weight		kg	85
		lb	188
Refrigerant			R410A
	Charged	kg	3.5
		lb	7 + 11/16
	Control		Linear expansion valve
	Oil Charged	Model	FVC68D
		L	1.0
		oz	33
Refrigerant piping	Pipe size O.D. Liquid	mm	9.52
		in	3/8
	Pipe size O.D. Gas	mm	15.88
		in	5/8
	Connection method Indoor		Flared
	Connection method Outdoor		Flared
	Height difference IU-OU	m	Maximum 30
		ft	Maximum 100
	Piping length	m	Maximum 50
		ft	Maximum 165

5 DATA

5-1. REFILLING REFRIGERANT CHARGE (R410A: oz, kg)

Service Ref.	Piping length (one way)													
TRUZH0241HA00NA	50 ft	60 ft	70 ft	80 ft	90 ft	100 ft	110 ft	120 ft	130 ft	140 ft	150 ft	160 ft	165 ft	Factory charged
	15 m	18 m	21 m	24 m	27 m	30 m	34 m	37 m	40 m	43 m	46 m	49 m	50 m	
	123 oz	123 oz	123 oz	130 oz	137 oz	144 oz	151 oz	158 oz	165 oz	172 oz	179 oz	186 oz	190 oz	123 oz
	3.5 kg	3.5 kg	3.5 kg	3.7 kg	3.9 kg	4.1 kg	4.3 kg	4.5 kg	4.7 kg	4.9 kg	5.1 kg	5.3 kg	5.4 kg	3.5 kg

Additional charge is required for pipes longer than 70 ft.

5-2. COMPRESSOR TECHNICAL DATA

(Winding resistance at 68°F [20°C])

Service Ref.		TRUZH0241HA00NA
Compressor model		DNB28FBAMT
Winding resistance (Ω)	U-V	0.74
	U-W	0.74
	W-V	0.74

5-3. NOISE CRITERION CURVES

TRUZH0241HA00NA

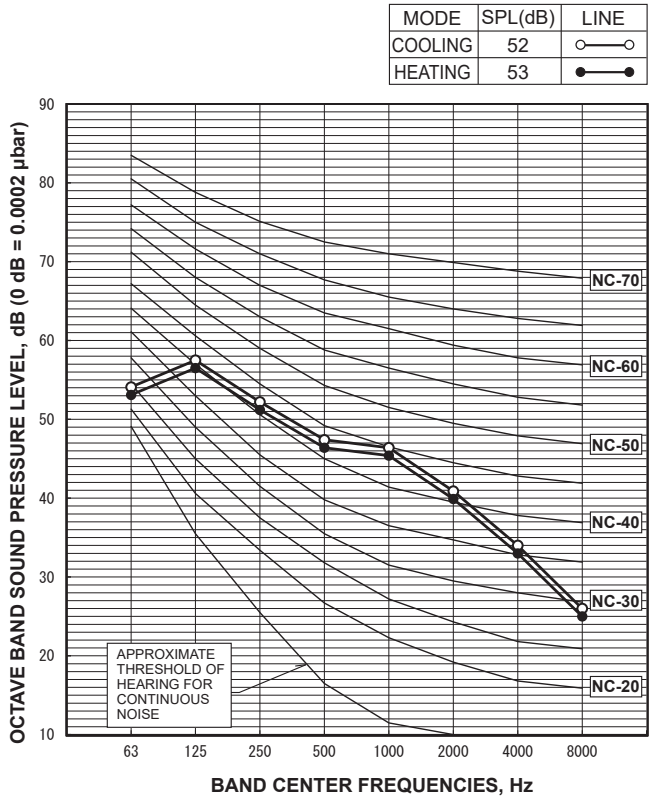

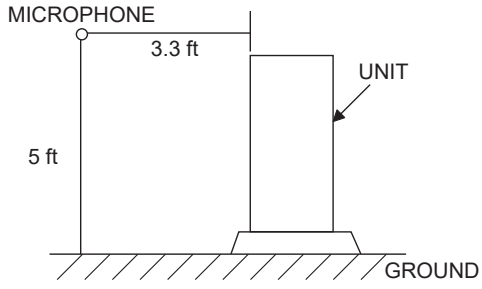

5-4. STANDARD OPERATION DATA

Representative matching			TPLA0A0241EA70A	
Mode			COOLING	HEATING
Total	Capacity	Btu/h	24,000	26,000
	Input	W	1,710	1,700
Electrical circuit	Indoor unit model		TPLA0A0241EA70A	
	Phase		Single	
	Cycle		60 Hz	
	Voltage		208/230 V	
	Current		0.49 A	
	Outdoor unit model		TRUZH0241HA00NA	
	Phase		Single	
	Cycle		60 Hz	
	Voltage		208/230 V	
	Current		7.40 A	
Refrigerant circuit	Discharge pressure	PSIG	383	325
	Suction pressure	PSIG	145	101
	Discharge temperature	°F	146	141
	Condensing temperature	°F	114	98
	Suction temperature	°F	57	40
	Ref. Pipe length	ft	25	25
	Discharge pressure	Mpa	2.64	2.24
	Suction pressure	Mpa	1	0.7
	Discharge temperature	°C	63.5	60.5
	Condensing temperature	°C	45.3	36.7
	Suction temperature	°C	14	4.4
	Ref. Pipe length	m	7.6	7.6
Indoor side	Intake air temperature D.B.	°F	80	70
	Intake air temperature W.B.	°F	67	60
	Discharge air temperature D.B.	°F	58	100
Outoor side	Intake air temperature D.B.	°F	95	47
	Intake air temperature W.B.	°F	75	43
Indoor side	Intake air temperature D.B.	°C	26.7	21.1
	Intake air temperature W.B.	°C	19.4	15.6
	Discharge air temperature D.B.	°C	14.3	37.5
Outoor side	Intake air temperature D.B.	°C	35	8.3
	Intake air temperature W.B.	°C	23.9	6.1
SHF			0.86	—
BF			0.05	—

6 OUTLINES AND DIMENSIONS

TRUZH0241HA00NA

Unit: mm<inch>

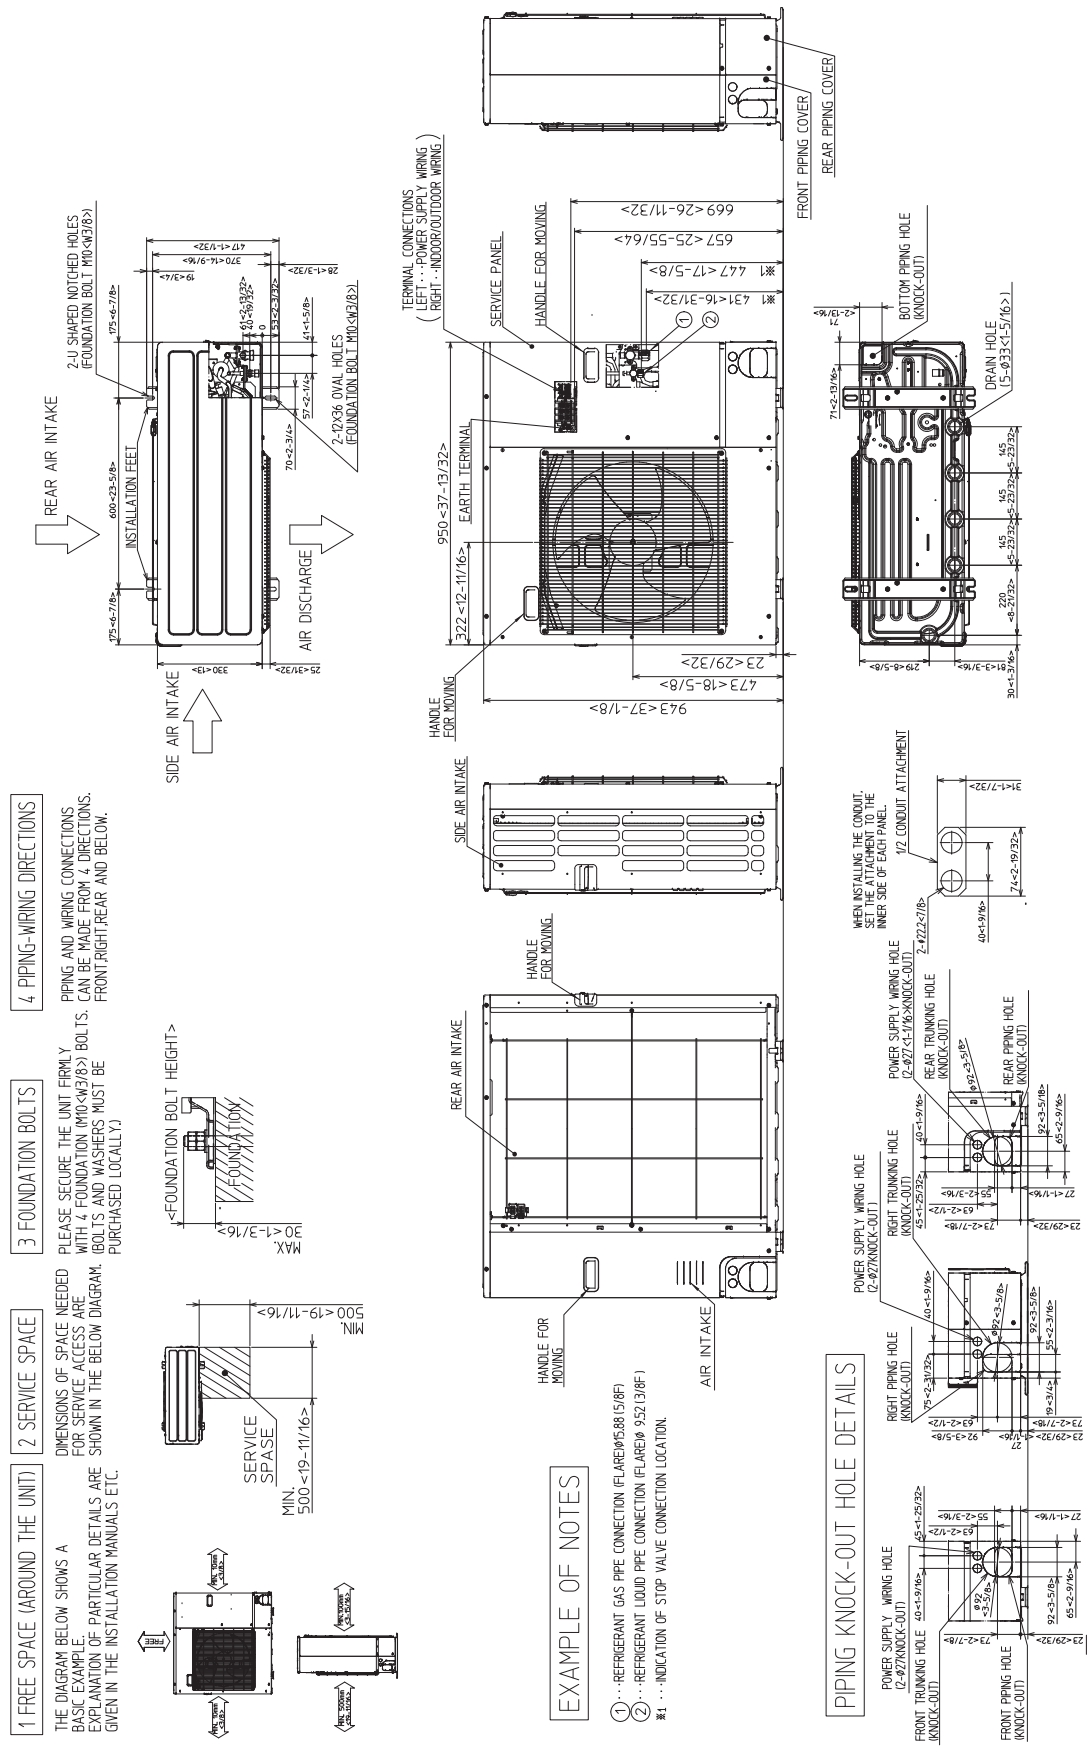

7 WIRING DIAGRAM

TRUZH0241HA00NA

SYMBOL	NAME	SYMBOL	NAME	SYMBOL	NAME
TB1	Terminal Block 〈Power Supply〉	TH33	Thermistor 〈Comp. Surface〉	SW5	Switch 〈Function Switch, Model Select〉
TB2	Terminal Block 〈Indoor/Outdoor〉	LEV-A, LEV-B	Linear Expansion Valve	SW6	Switch 〈Model Select〉
MC	Motor for Compressor	DCL	Reactor	SW7	Switch 〈Function Switch〉
MF1	Fan Motor	CY1, CY2	Capacitor	SW8	Switch 〈Function Switch〉
21S4	Solenoid Valve 〈4-Way Valve〉	P. B.	Power Circuit Board	SW9	Switch 〈Function Switch〉
63H	High Pressure Switch	C. B.	Controller Circuit Board	SWP	Switch 〈Pump Down〉
TH3	Thermistor 〈Liquid〉	F1, F2	Fuse 〈T10AL250V〉	CNM	Connector 〈Connection for Option〉
TH4	Thermistor 〈Discharge〉	F3, F4	Fuse 〈T6.3AL250V〉	CN31	Connector 〈Emergency Operation〉
TH6	Thermistor 〈2-Phase Pipe〉	SW1	Switch 〈Manual Defrost, Defect History Record Reset, Refrigerant Address〉	CNDM	Connector 〈Connection for Option〉
TH7	Thermistor 〈Ambient〉			SV3/SS	Connector 〈Connection for Option〉
TH8	Thermistor 〈Heat Sink〉	SW4	Switch 〈Function Switch〉		

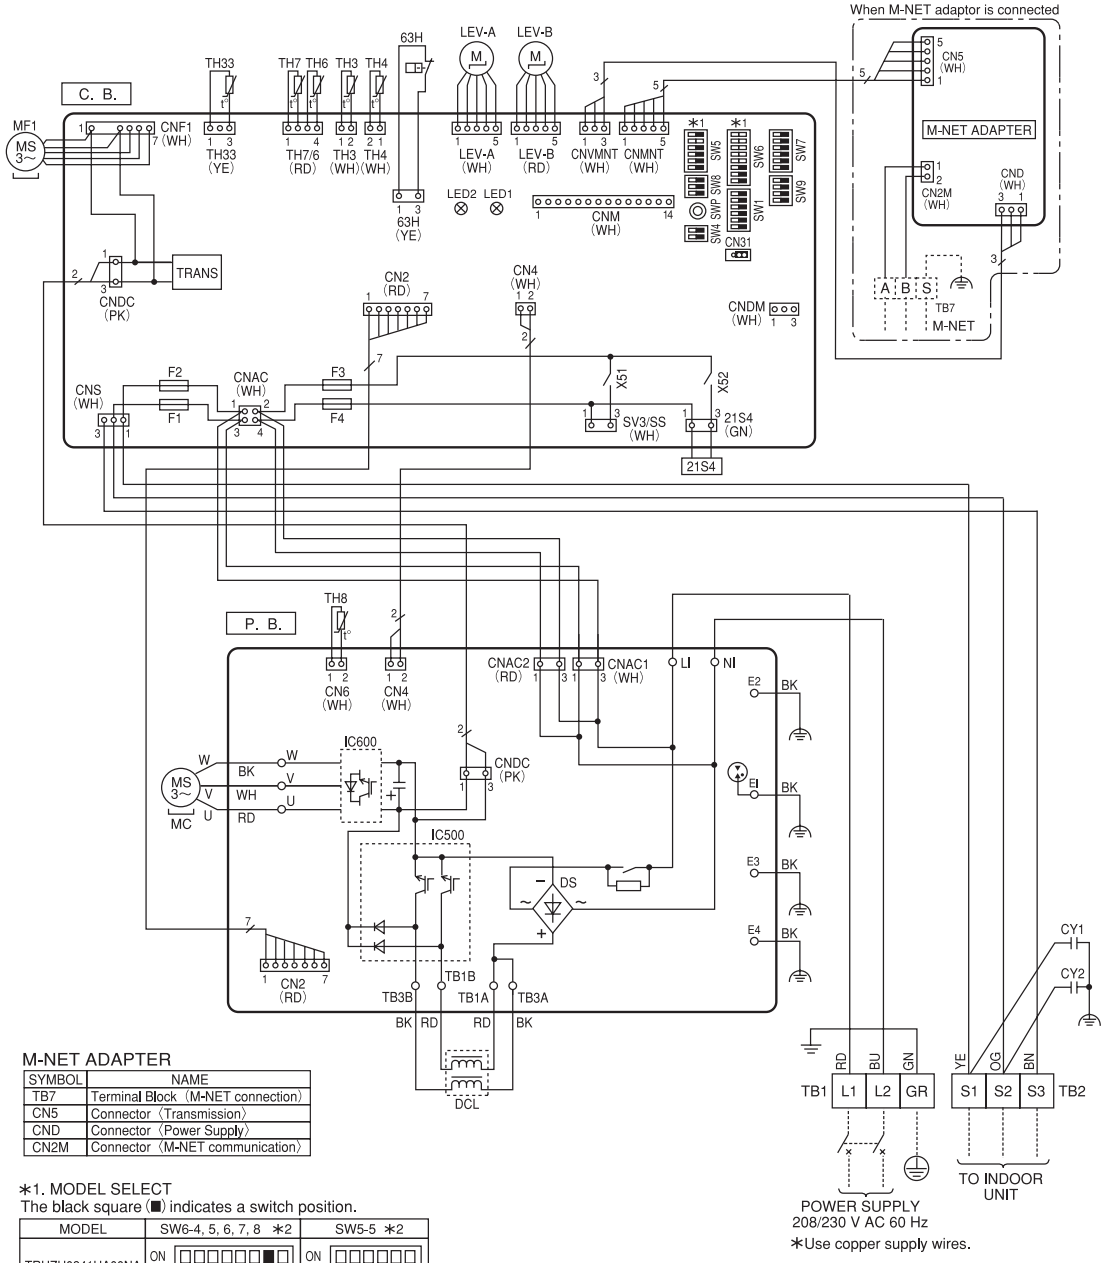

M-NET ADAPTER

SYMBOL	NAME
TB7	Terminal Block 〈M-NET connection〉
CN5	Connector 〈Transmission〉
CND	Connector 〈Power Supply〉
CN2M	Connector 〈M-NET communication〉

∗1. MODEL SELECT
The black square (■) indicates a switch position.

MODEL	SW6-4, 5, 6, 7, 8 ∗2	SW5-5 ∗2
TRUZH0241HA00NA	ON / OFF 1 2 3 4 5 6 7 8	ON / OFF 1 2 3 4 5 6

∗2. SW6 -1 to 3, SW5-1 to 4, 6 : Function Switch

8 WIRING SPECIFICATIONS

8-1. INDOOR UNIT POWER SUPPLIED FROM OUTDOOR UNIT

The following connection patterns are available.
The outdoor unit power supply patterns vary on models.

1:1 System

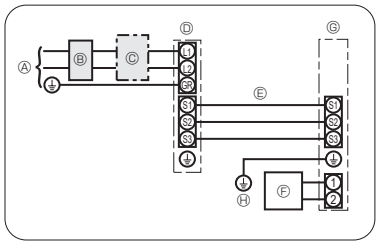

Ⓐ Outdoor unit power supply
Ⓑ Earth leakage breaker
Ⓒ Wiring circuit breaker or isolating switch
Ⓓ Outdoor unit
Ⓔ Indoor unit/outdoor unit connecting cords
Ⓕ Remote controller
Ⓖ Indoor unit
Ⓗ Indoor unit earth

Affix a label A that is included with the manuals near each wiring diagram for the indoor and outdoor units.

Outdoor unit model			TRUZH0241HA00NA
Outdoor unit power supply			Single, 208/230 V, 60 Hz
Breaker size		*4	25 A
Minimum circuit ampacity			19 A
Maximum rating of overcurrent protective device			26 A
Wiring Wire No. × size	Outdoor unit power supply		2 × Min AWG 12
	Outdoor unit power supply earth		1 × Min AWG 12
	Indoor unit-Outdoor unit	*1	3 × AWG 14 (polar)
	Indoor unit earth		1 × Min AWG 14
	Remote controller-Indoor unit	*2	2 × AWG 22 (Non-polar)
Circuit rating	Outdoor unit L1-L2	*3	208/230 VAC
	Indoor unit-Outdoor unit S1-S2	*3	208/230 VAC
	Indoor unit-Outdoor unit S2-S3	*3	24 VDC
	Remote controller-Indoor unit	*3	12 VDC

*1 Maximum 147 ft [45 m]
If AWG13 is used, maximum 164 ft [50 m].
If AWG13 is used and S3 is separated, maximum 262 ft [80 m].
*2 The 30 ft [10 m] wire is attached in the remote controller accessory. Maximum 1500 ft
*3 The figures are NOT always against the ground.
S3 terminal has 24 VDC against S2 terminal. However between S3 and S1, these terminals are NOT electrically insulated by the transformer or other device.
*4 Use earth leakage breaker (NV)

Notes:
1. Wiring size must comply with the applicable local and national code.
2. Use copper supply wires.
3. Use wires rated 600V or more for the power supply cables and the indoor/outdoor unit connecting cables.
4. Install an earth line longer than power cables.

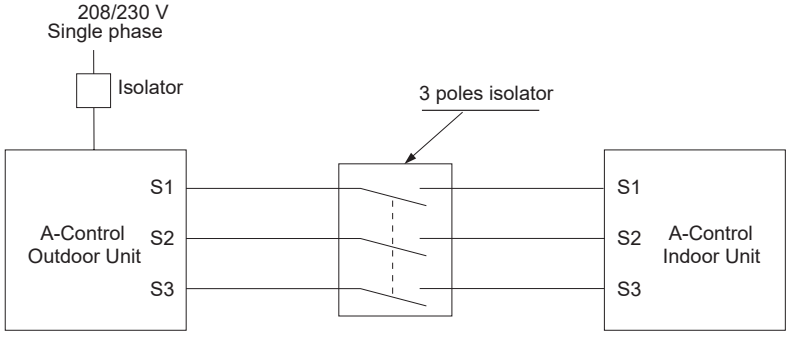

⚠ **Warning:**
In the case of A-control wiring, there is high voltage potential on the S3 terminal caused by electrical circuit design that has no electrical insulation between power line and communication signal line. Therefore, please turn off the main power supply when servicing. And do not touch the S1, S2, S3 terminals when the power isenergized. If isolator should be used between indoor unit and outdoor unit, please use 3-pole type.

- **Turn on the main power when the ambient temperature is −4°F [−20°C] or higher.**
- **In below −4°F [−20°C] condition, it needs at least 4 hr standby to operate in order to warm the electrical parts.**

8-2. SEPARATE INDOOR UNIT/OUTDOOR UNIT POWER SUPPLIES

The following connection patterns are available.
The outdoor unit power supply patterns vary on models.

1:1 System

The optional indoor power supply terminal kit is required.

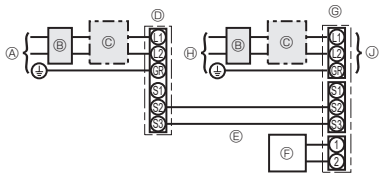

Ⓐ Outdoor unit power supply
Ⓑ Earth leakage breaker
Ⓒ Wiring circuit breaker or isolating switch
Ⓓ Outdoor unit
Ⓔ Indoor unit/outdoor unit connecting cords
Ⓕ Remote controller
Ⓖ Indoor unit
Ⓗ Indoor unit power supply
Ⓙ Option

Affix a label B that is included with the manuals near each wiring diagram for the indoor and outdoor units.

8-3. INDOOR – OUTDOOR CONNECTING CABLE

Outdoor power supply	Wire No. × Size		
	Max. 147 ft [45 m]	Max. 164 ft [50 m]	Max. 262 ft [80 m]
Indoor unit-Outdoor unit	3 × AWG15(polar)	3 × AWG13(polar)	3 × AWG13(polar) and S3 separated

Note: The Maximum cable length may vary depending on the condition of installation, humidity or materials, etc.

Indoor/Outdoor separate power supply	Wire No. × Size
	Max. 393 ft [120 m]
Indoor unit-Outdoor unit	2 × Min. AWG22

Note: The optional indoor power supply terminal kit is necessary.

Be sure to connect the indoor-outdoor connecting cables directly to the units (no intermediate connections). Intermediate connections can lead to communication errors if water enters the cables and causes insufficient insulation to ground or a poor electrical contact at the intermediate connection point.

8-4. M-NET WIRING METHOD

Points to notice:

(1) Outside the unit, transmission wires should stay away from electric wires in order to prevent electromagnetic noise from making an influence on the signal communication. Place them at intervals of more than 5cm. Do not put them in the same conduit tube.

(2) Terminal block (TB7) for transmission wires should never be connected to 208/230 V power supply. If it is connected, electronic parts on M-NET P.C. board may be burnt out.

(3) Use 2-core x AWG16 [1.25 mm²] shield wire (CVVS, CPEVS) for the transmission wire. Transmission signals may not be sent or received normally if different types of transmission wires are put together in the same multi-conductor cable. Never do this because this may cause a malfunction.

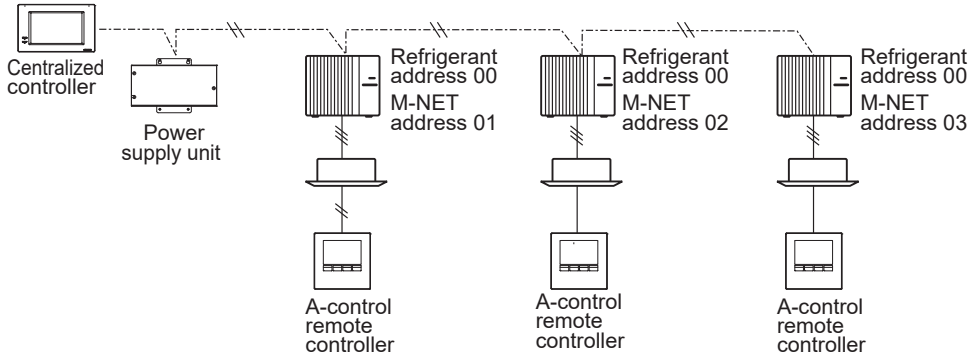

It is acceptable if M-NET wire (non-polar, 2-cores) is arranged in addition to the wiring for A-control.

(4) Ground only one of any appliances through M-NET transmission wire (shield wire). Communication error may occur due to the influence of electromagnetic noise.
"Ed" error will appear on the LED display of outdoor unit.
"0403" error will appear on the centralized remote controller.

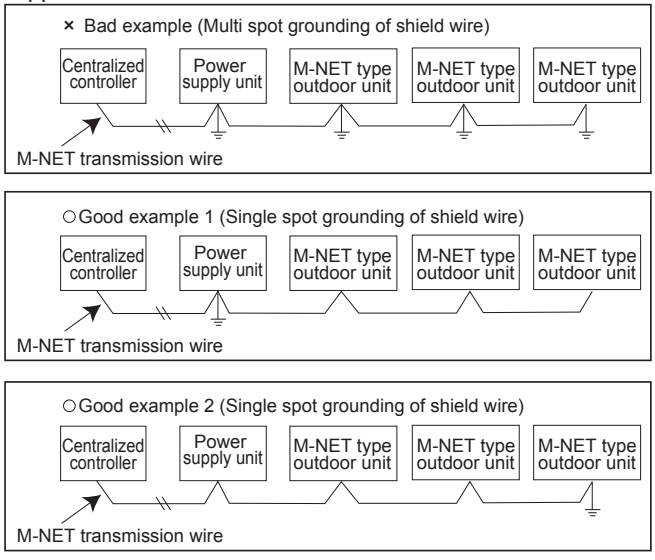

If there are more than 2 grounding spots on the shield wire, noise may enter into the shield wire because the ground wire and shield wire form one circuit and the electric potential difference occurs due to the impedance difference among grounding spots. In the case of single spot grounding, noise does not enter into the shield wire because the ground wire and shield wire do not form 1 circuit.
To avoid communication errors caused by noise, make sure to observe the single spot grounding method described in the installation manual.

● **M-NET wiring**

(1) Use 2-core x AWG16 [1.25 mm²] shield wire for electric wires.
(Excluding the case connecting to system controller.)

(2) Connect the wire to the M-NET terminal block. Connect one core of the transmission wire (non-polar) to A terminal and the other to B. Peel the shield wire, twist the shield part to a string and connect it to S terminal.

(3) In the system which several outdoor units are being connected, the terminal (A(M1), B(M2), S) on M-NET terminal block should be individually wired to the other outdoor unit's terminal, i.e. A to A, B to B and S to S. In this case, choose one of those outdoor units and drive a screw to fix an ground wire on the plate as shown on the right figure.

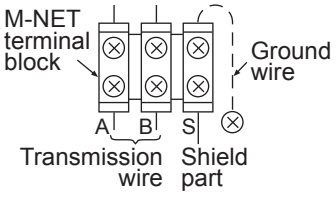

8-4-1. M-NET address setting

In A-control models, M-NET address and refrigerant address should be set only for the outdoor unit. Similar to CITY MULTI series, there is no need to set the address of outdoor unit and remote controller. To construct a central control system, the setting of M-NET address should be conducted only upon the outdoor unit. The setting range should be 1 to 50 (the same as that of the indoor unit in CITY MULTI system), and the address number should be consecutively set in a same group.

Address number can be set by using rotary switches (SW11 for ones digit and SW12 for tens digit), which is located on the M-NET board of outdoor unit.
(Initial setting: all addresses are set to “0”.)

<Setting example>

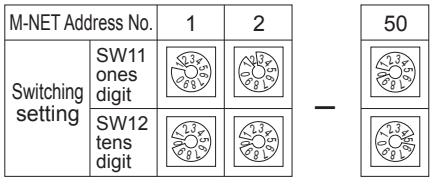

8-4-2. Refrigerant address setting

In the case of multiple grouping system (multiple refrigerant circuits in one group), indoor units should be connected by remote controller wiring (TB5) and the refrigerant address needs to be set. Leave the refrigerant addresses to “00” if the group setting is not conducted. Set the refrigerant address by using DIP SW1-3 to 1-6 on the outdoor controller board. [Initial setting: all switches are OFF. (All refrigerant addresses are “00”.)]

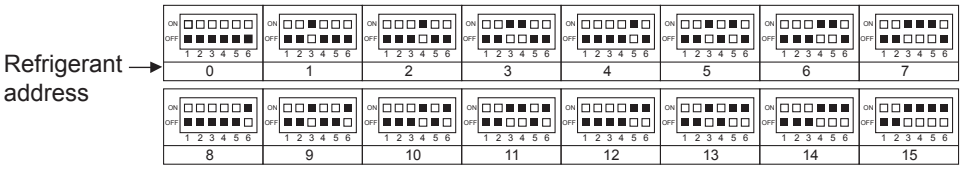

8-4-3. Regulations in address settings

In the case of multiple grouping system, M-NET and refrigerant address settings should be done as explained in the above section. Set the lowest number in the group for the outdoor unit whose refrigerant address is “00” as its M-NET address.

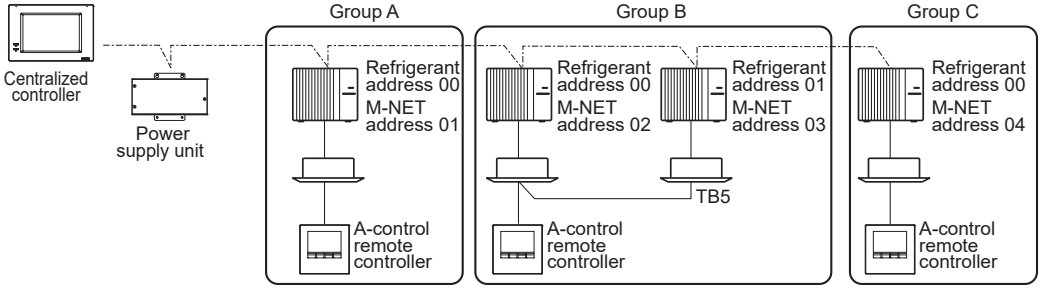

Note: Refrigerant addresses can be overlapped if they are in the different group.

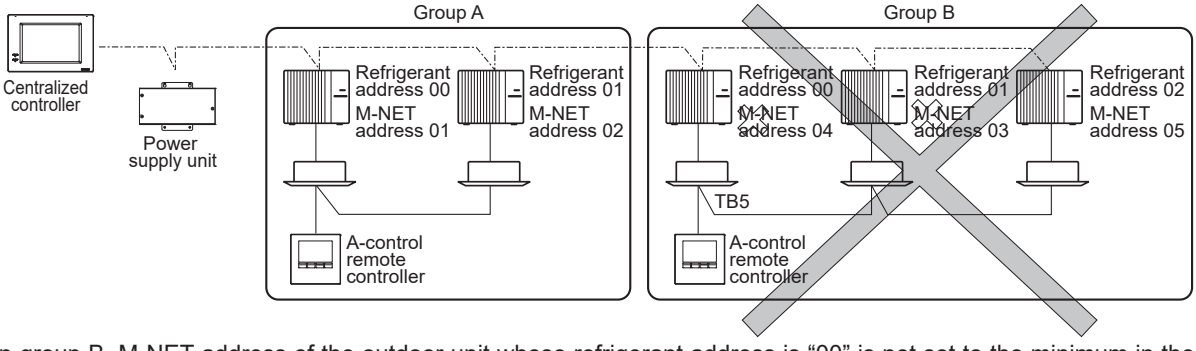

Note: In group B, M-NET address of the outdoor unit whose refrigerant address is “00” is not set to the minimum in the group. As “03” is right for this situation, the setting is wrong. Taking group A as a good sample, set the minimum M-NET address in the group for the outdoor unit whose refrigerant address is “00”.

9 REFRIGERANT SYSTEM DIAGRAM

TRUZH0241HA00NA

Unit: mm (in)

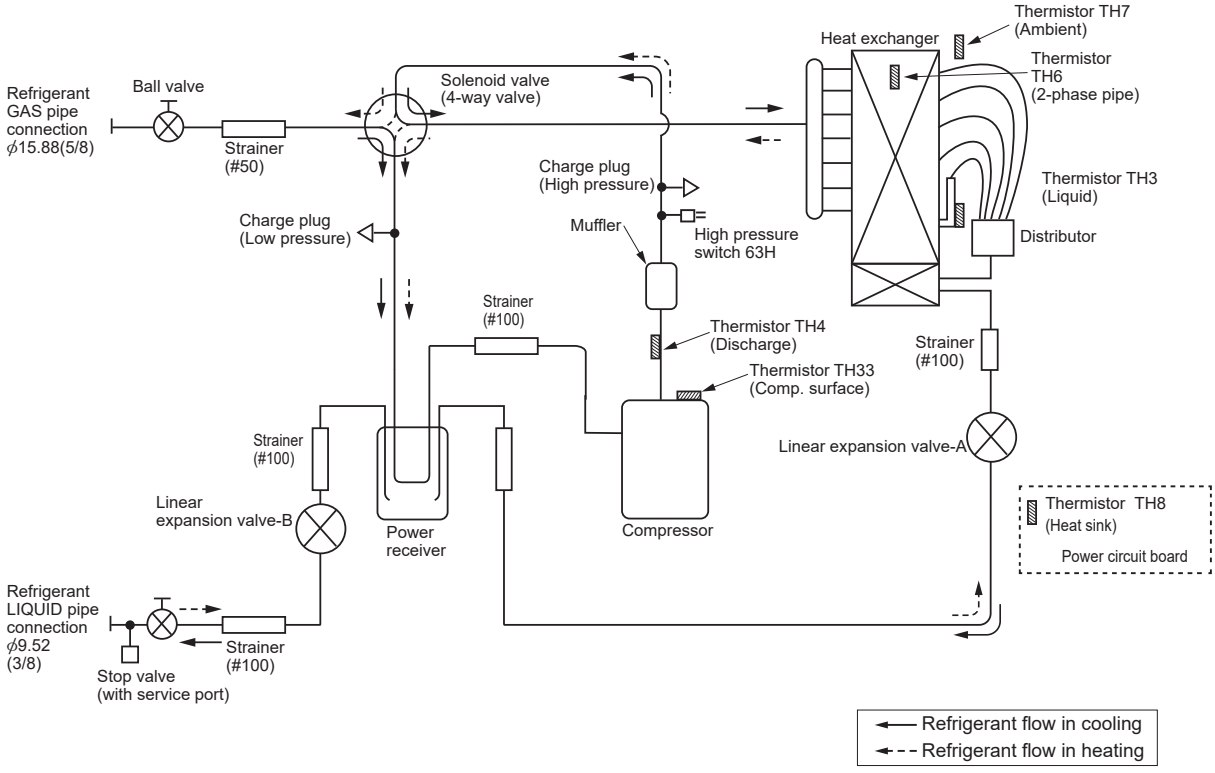

REFRIGERANT COLLECTING (PUMP DOWN)

When relocating or disposing of the indoor/outdoor unit, pump down the system following the procedures below so that no refrigerant is released into the atmosphere.

① Turn off the power supply (circuit breaker).
② Connect the low pressure valve on the gauge manifold to the charge plug (low pressure side) on the outdoor unit.
③ Close the liquid stop valve completely.
④ Supply power (circuit breaker).
- When power is supplied, make sure that “CENTRALLY CONTROLLED” is not displayed on the remote controller. If “CENTRALLY CONTROLLED” is displayed, the refrigerant collecting (pump down) cannot be completed normally.
- Startup of the indoor-outdoor communication takes about 3 minutes after the power (circuit breaker) is turned on. Start the pump-down operation 3 to 4 minutes after the power (circuit breaker) is turned on.

⑤ Perform the refrigerant collecting operation (cooling test run).
- Push the pump-down SWP switch (push-button type) on the control board of the outdoor unit. The compressor and ventilators (indoor and outdoor units) start operating (refrigerant collecting operation begins). (LED1 and LED2 on the control board of the outdoor unit are lit.)
- Only push the pump-down SWP switch if the unit is stopped. However, even if the unit is stopped and the pump-down SWP switch is pushed less than 3 minutes after the compressor stops, the refrigerant collecting operation cannot be performed. Wait until the compressor has been stopped for 3 minutes and then push the pump-down SWP switch again.

⑥ Fully close the ball valve on the gas pipe side of the outdoor unit when the pressure gauge on the gauge manifold shows 0.05 to 0 MPa [Gauge] (approx. 0.5 to 0 kgf/cm²) and quickly stop the air conditioner.
- Because the unit stops automatically in about 3 minutes when the refrigerant collecting operation is completed (LED1 off, LED2 lit), be sure to quickly close the gas ball valve. However, if LED1 is lit, LED2 is off, and the unit is stopped, open the liquid stop valve completely, close the valve completely after 3 minutes or more have passed, and then repeat step ⑤. (Open the gas ball valve completely.)
- If the refrigerant collecting operation has been completed normally (LED1 off, LED2 lit), the unit will remain stopped until the power supply is turned off.
- Note that when the extension piping is very long with a large refrigerant amount, it may not be possible to perform a pump-down operation. In this case, use refrigerant recovery equipment to collect all of the refrigerant in the system.

⑦ Turn off the power supply (circuit breaker), remove the gauge manifold, and then disconnect the refrigerant pipes.

⚠ Warning:

When pumping down the refrigerant, stop the compressor before disconnecting the refrigerant pipes.

- **If the refrigerant pipes are disconnected while the compressor is operating and the stop valve (ball valve) is open, the pressure in the refrigeration cycle could become extremely high if air is drawn in, causing the pipes to burst, personal injury, etc.**

10 TROUBLESHOOTING

10-1. TROUBLESHOOTING

<Check code displayed by self-diagnosis and actions to be taken for service (summary)>

Present and past check codes are logged, and they can be displayed on the wired remote controller and control board of outdoor unit. Actions to be taken for service, which depends on whether or not the trouble is reoccurring in the field, are summarized in the table below. Check the contents below before investigating details.

Unit conditions at service	Check code	Actions to be taken for service (summary)
The trouble is reoccurring.	Displayed	Judge the problem and take a corrective action according to “10-4. SELF-DIAGNOSIS ACTION TABLE”.
	Not displayed	Conduct troubleshooting and ascertain the cause of the trouble according to “10-5. TROUBLESHOOTING BY INFERIOR PHENOMENA”.
The trouble is not reoccurring.	Logged	①Consider the temporary defects such as the work of protection devices in the refrigerant circuit including compressor, poor connection of wiring, noise, etc. Re-check the symptom, and check the installation environment, refrigerant amount, weather when the trouble occurred, matters related to wiring, etc. ②Reset check code logs and restart the unit after finishing service. ③There is no abnormality in electrical component, controller board, remote controller, etc.
	Not logged	①Re-check the abnormal symptom. ②Conduct troubleshooting and ascertain the cause of the trouble according to “10-5. TROUBLESHOOTING BY INFERIOR PHENOMENA”. ③Continue to operate unit for the time being if the cause is not ascertained. ④There is no abnormality concerning of parts such as electrical component, controller board, remote controller, etc.

10-2. CHECK POINT UNDER TEST RUN

(1) Before test run

- After installation of indoor and outdoor units, piping work and electric wiring work, re-check that there is no refrigerant leakage, loosened connections and incorrect polarity.
- Measure impedance between the ground and the power supply terminal block (L1, L2) on the outdoor unit by 500 V Megger and check that it is 1.0 MΩ or over.

Note: Do not use 500 V Megger to indoor/outdoor connecting wire terminal block (S1, S2, S3) and remote controller terminal block (1, 2). This may cause malfunction.

- Make sure that test run switch (SW4) is set to OFF before turning on power supply.
- Turn on power supply 12 hours before test run in order to protect compressor.
- For specific models which requires higher ceiling settings or auto-recovery feature from power failure, make proper changes of settings referring to the description of “12. FUNCTION SETTING".

Make sure to read operation manual before test run. (Especially items to secure safety.)

10-2-1. Test run for wired remote controller <PAR-4xMAA, PAR-3xMAA ("x" represents 0 or later)>

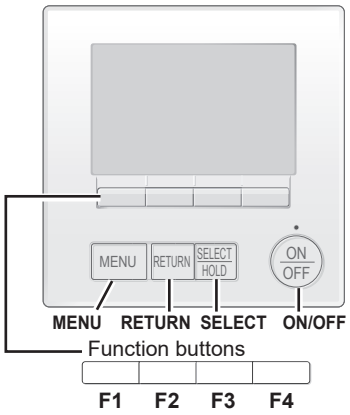

① Select "Service" from the Main menu, and press the [SELECT] button.

Select "Test run" with the F1 or F2 button, and press the [SELECT] button.

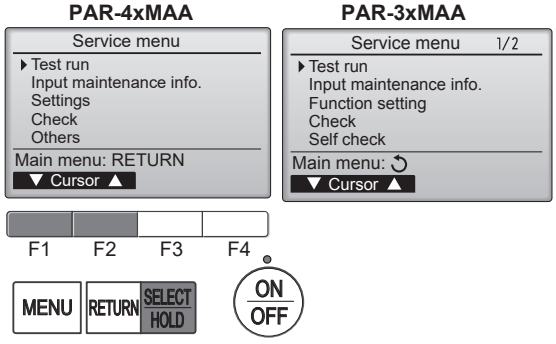

② Select "Test run" with the F1 or F2 button, and press the [SELECT] button.

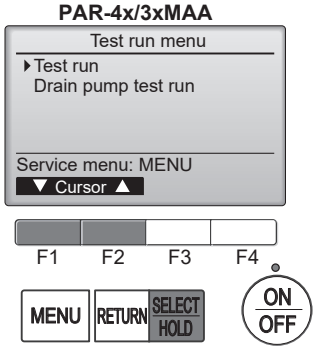

Test run operation

Press the F1 button to go through the operation modes in the order of "Cool and Heat".

Cool mode: Check the cold air blows out.
Heat mode: Check the heat blows out.

Check the operation of the outdoor unit's fan.

Press the [SELECT] button and open the Vane setting screen.

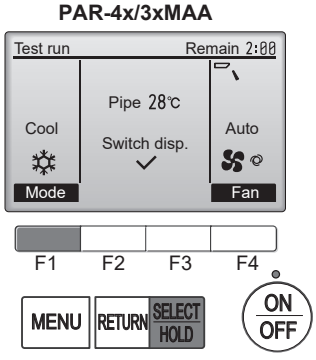

Auto vane check

Check the auto vane with the F1 F2 buttons.

Press the [RETURN] button to return to "Test run operation".

Press the [ON/OFF] button.

When the test run is completed, the "Test run menu" screen will appear.
The test run will automatically stop after 2 hours.

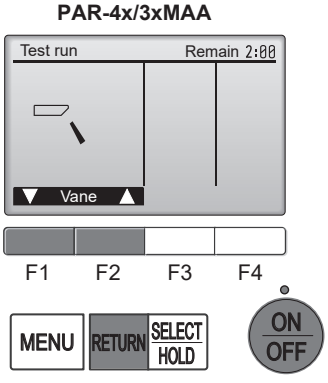

<Error information>

When an error occurs, the following screen will appear.
Check the error status, stop the operation, and consult your dealer.

① Check code, error unit, refrigerant address, unit model name, and serial number will appear. (Date and time of occurrence of the error will also appear on PAR-4xMAA.)
The model name and serial number will appear only if the information has been registered.

Press the F1 or F2 button to go to the next page.

PAR-4xMAA

Error information 1/2
Error code A3
Error unit IU 0 Unit#1
Time Occurred 02/01 4:48
Model name
Serial No.
Reset error: Reset button
▼ Page ▲ Reset

PAR-3xMAA

Error information 1/2
Error code E4
Error unit IU
Ref. address 0 Unt# 0
Model name
Serial No.
Reset error: Reset button
▼ Page ▲ Reset

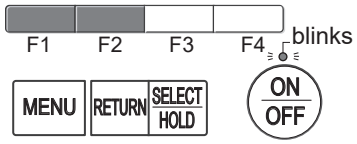

Contact information (dealer's phone number) will appear if the information has been registered.

PAR-4x/3xMAA

Error information 2/2
Contact information
Dealer
Tel
Reset error: Reset button
▼ Page ▲ Reset

② Press the F4 button or the [ON/OFF] button to reset the error that is occurring.

Errors cannot be reset while the ON/OFF operation is prohibited.

PAR-4xMAA

Error information 1/2
Error code A3
Error unit IU 0 Unit#1
Time Occurred 02/01 4:48
Model name
Serial No.
Reset error: Reset button
▼ Page ▲ Reset

PAR-3xMAA

Error information 1/2
Error code E4
Error unit IU
Ref. address 0 Unt# 0
Model name
Serial No.
Reset error: Reset button
▼ Page ▲ Reset

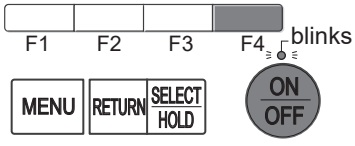

Select "OK" with the F4 button.

PAR-4x/3xMAA

Error reset
Reset current error?
Cancel OK



PAR-4x/3xMAA

Error reset
Error reset
Main menu: MENU

Navigating through the screens
• To go back to the Main menu ..... [MENU] button

<Checking the error information>

While no errors are occurring, page 2/2 of the error information can be viewed by selecting "Error information" from the Maintenance menu (PAR-4xMAA) or Main menu (PAR-3xMAA).
Errors cannot be reset from this screen.

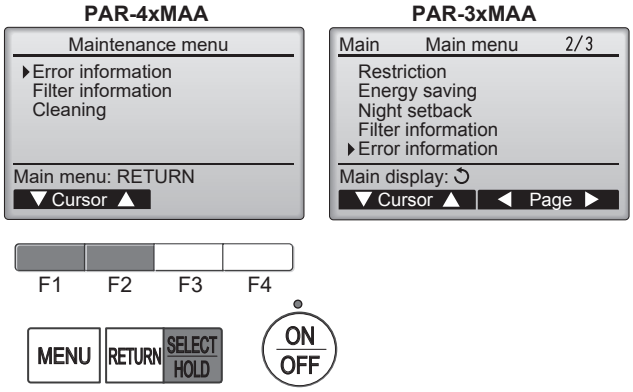

<Error history>

① Select "Service" from the Main menu, and press the [SELECT] button.

Select "Check" with the F1 or F2 button, and press the [SELECT] button.

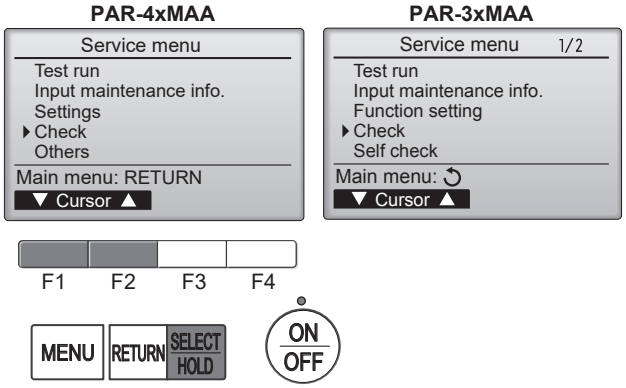

② Select "Error history" with the F1 or F2 button, and press the [SELECT] button.

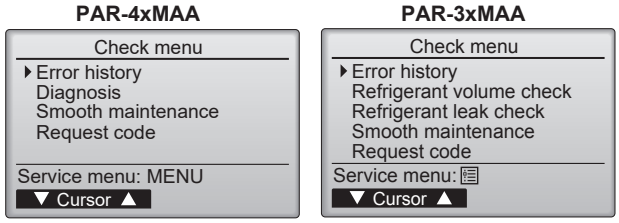

Error history

③ Select "Error history" from the Check menu, and press the [SELECT] button to view up to 16 error history records.

4 records are shown per page, and the top record on the first page indicates the latest error record.

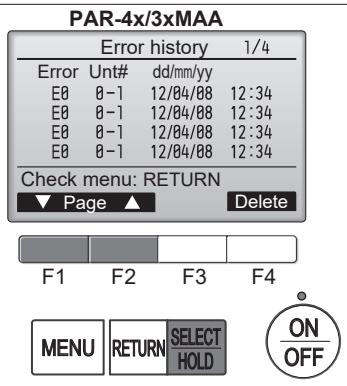

Deleting the error history

④ To delete the error history, press the F4 button (Delete) on the screen that shows error history.
A confirmation screen will appear asking if you want to delete the error history.

Press the F4 button (OK) to delete the history.

"Error history deleted" will appear on the screen.

Press the [RETURN] button to go back to the Check menu screen.

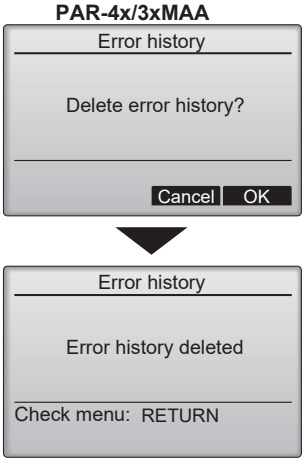

10-2-2. Test run for wireless remote controller

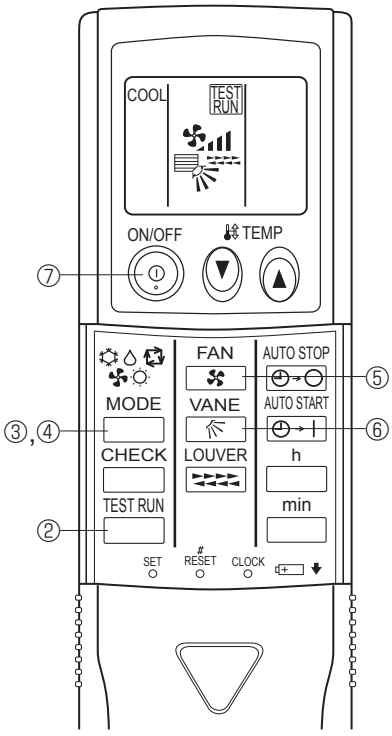

Test run [for IR wireless remote controller]

Measure an impedance between the power supply terminal block on the outdoor unit and ground with a 500 V Megger and check that it is equal to or greater than 1.0 MΩ.

① Turn on the main power to the unit.

② Press the TEST RUN button twice continuously.
(Start this operation from the turned off status of remote controller display.)
TEST RUN and current operation mode are displayed.

③ Press the MODE ( ) button to activate COOL mode, then check whether cool air blows out from the unit.

④ Press the MODE ( ) button to activate HEAT mode, then check whether warm air blows out from the unit.

⑤ Press the FAN button and check whether strong air blows out from the unit.

⑥ Press the VANE button and check whether the auto vane operates properly.

⑦ Press the ON/OFF button to stop the test run.

Notes:

- **Point the remote controller towards the indoor unit receiver while following steps ② to ⑦.**
- **It is not possible to run in FAN, DRY or AUTO mode.**

10-2-3. Start and finish of test run [For outdoor controller board]

- Operation from the indoor unit
  Execute the test run using the installation manual for the indoor unit.
- Operation from the outdoor unit
  By using the DIP switch SW4 on the control board of outdoor unit, test run can be started and finished, and its operation mode (cooling/heating) can be set up.
  ①Set the operation mode (cooling/heating) using SW4-2.
  ②Turn on SW4-1 to start test run with the operation mode set by SW4-2.
  ③Turn off SW4-1 to finish the test run.



- There may be a faint knocking sound around the machine room after power is supplied. However, this is not a problem with product because the linear expansion pipe is just moving to adjust opening pulse.
- There may be a knocking sound around the machine room for several seconds after compressor starts operating. However, this is not a problem with product because the check valve itself generates the sound because pressure difference is small in the refrigerant circuit.

Note:
The operation mode cannot be changed by SW4-2 during test run. (To change test run mode, stop the unit by SW4-1, change the operation mode and restart the test run by SW4-1.)

10-3. HOW TO PROCEED "SELF-DIAGNOSIS"

10-3-1. Self-diagnosis <PAR-4xMAA, PAR-3xMAA ("x" represents 0 or later)>

<PAR-4xMAA>

① Select "Service" from the Main menu, and press the [SELECT] button.

Select "Check" from the Service menu, and press the [SELECT] button.

Select "Diagnosis" from the Check menu, and press the [SELECT] button.

Select "Self check" with the F1 or F2 button, and press the [SELECT] button.

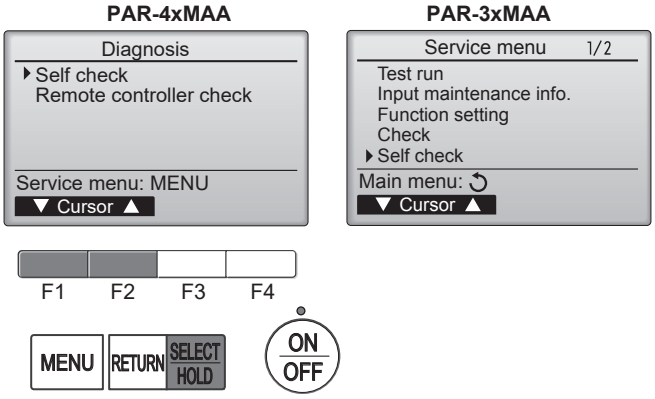

<PAR-3xMAA>

① Select "Service" from the Main menu, and press the [✓] button.

Select "Self check" with the F1 or F2 button, and press the [✓] button.

② With the F1 or F2 button, enter the refrigerant address, and press the [SELECT button.

PAR-4x/3xMAA

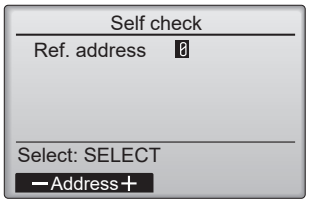

③ Check code, unit number, attribute will appear.
"-" will appear if no error history is available.

PAR-4x/3xMAA

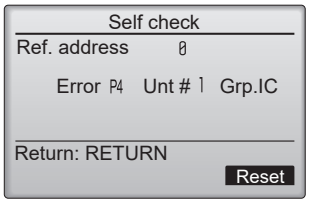

When there is no error history

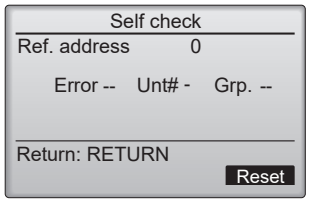

④ <u>Resetting the error history</u>

Press the F4 button (Reset) on the screen that shows the error history.

A confirmation screen will appear asking if you want to delete the error history.

Press the F4 button (OK) to delete the error history.

If deletion fails, "Request rejected" will appear.
"Unit not exist" will appear if no indoor units that are correspond to the entered address are found.

PAR-4x/3xMAA

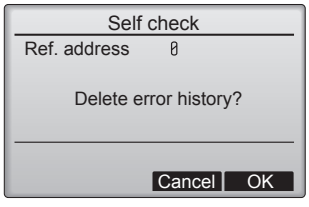

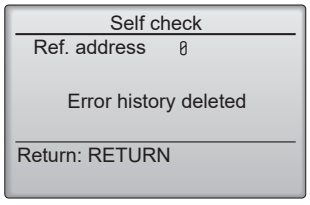

Navigating through the screens
- To go back to the Service menu ..... [MENU] button
- To return to the previous screen.....[RETURN] button

10-3-2. Remote controller check <PAR-4xMAA, PAR-3xMAA ("x" represents 0 or later)>

If operations cannot be completed with the remote controller, diagnose the remote controller with this function.

<PAR-4xMAA>

① Select "Service" from the Main menu, and press the [SELECT] button.

Select "Check" from the Service menu, and press the [SELECT] button.

Select "Diagnosis" from the Check menu, and press the [SELECT] button.

Select "Remote controller check" with the F1 or F2 button, and press the [SELECT] button.

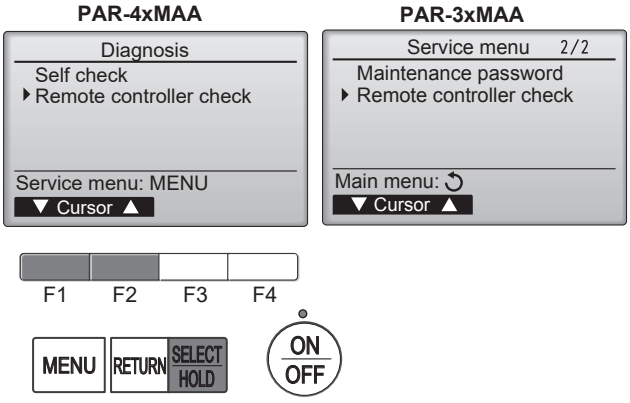

<PAR-3xMAA>

① Select "Service" from the Main menu, and press the [✓] button.

Select "Remote controller check" with the F1 or F2 button, and press the [✓] button.

---

② Select "Remote controller check" from the Diagnosis menu (PAR-4xMAA) or Service menu (PAR-3xMAA), and press the [SELECT] button to start the remote controller check and see the check results.

To cancel the remote controller check and exit the "Remote controller check" menu screen, press the [MENU] or the [RETURN] button.

The remote controller will not reboot itself.

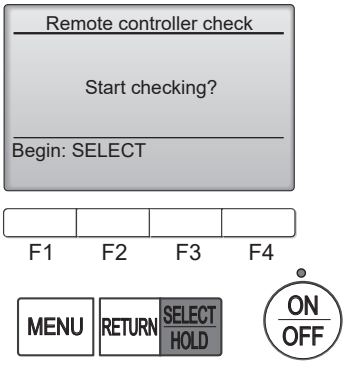

---

③

OK:	No problems are found with the remote controller. Check other parts for problems.
E3, 6832:	There is noise on the transmission line, or the indoor unit or another remote controller is faulty. Check the transmission line and the other remote controllers.
NG (ALL0, ALL1):	Send-receive circuit fault. The remote controller needs replacing.
ERC:	The number of data errors is the discrepancy between the number of bits in the data transmitted from the remote controller and that of the data that was actually transmitted over the transmission line. If data errors are found, check the transmission line for external noise interference.

Remote controller check results screen
PAR-4x/3xMAA

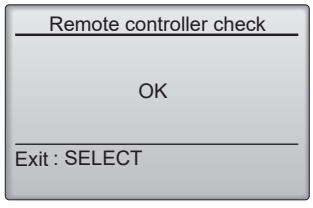

If the [SELECT] button is pressed after the remote controller check results are displayed, remote controller check will end, and the remote controller will automatically reboot itself.

Check the remote controller display and see if anything is displayed (including lines). Nothing will appear on the remote controller display if the correct voltage (8.5–12 VDC) is not supplied to the remote controller. If this is the case, check the remote controller wiring and indoor units.

10-3-4. Malfunction-diagnosis method by IR wireless remote controller

<In the case of trouble during operation>

When a malfunction occurs to air conditioner, both indoor unit and outdoor unit will stop and operation lamp blinks to inform unusual stop.

<Malfunction-diagnosis method at maintenance service>

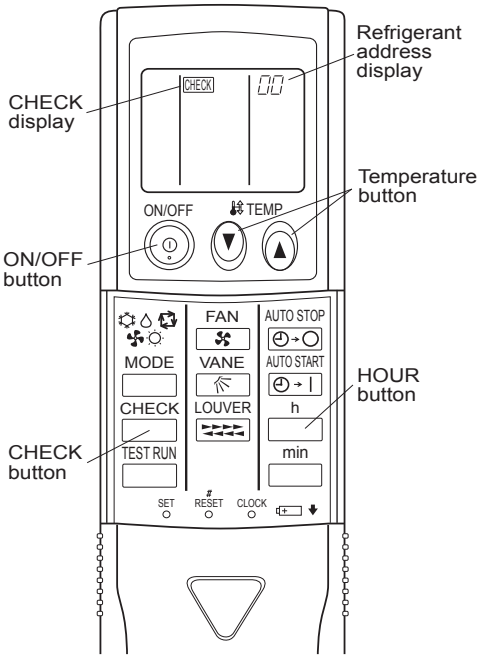

[Procedure]

1. Press the CHECK button twice.
• "CHECK" lights, and refrigerant address "00" blinks.
• Check that the remote controller's display has stopped before continuing.

2. Press the TEMP ▼ ▲ buttons.
• Select the refrigerant address of the indoor unit for the self-diagnosis.
Note: Set refrigerant address using the outdoor unit's DIP switch (SW1).
(For more information, see the outdoor unit installation manual.)

3. Point the remote controller at the sensor on the indoor unit and press the HOUR button.
• If an air conditioner error occurs, the indoor unit's sensor emits an intermittent buzzer sound, the operation lamp blinks, and the check code is output.
(It takes 3 seconds at most for check code to appear.)

4. Point the remote controller at the sensor on the indoor unit and press the ON/OFF button.
• The check mode is cancelled.

• Refer to the following tables for details on the check codes.

[Output pattern A]

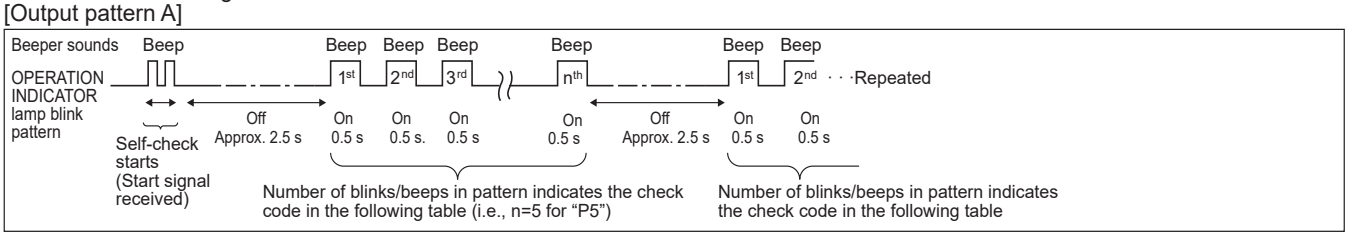

[Output pattern B]

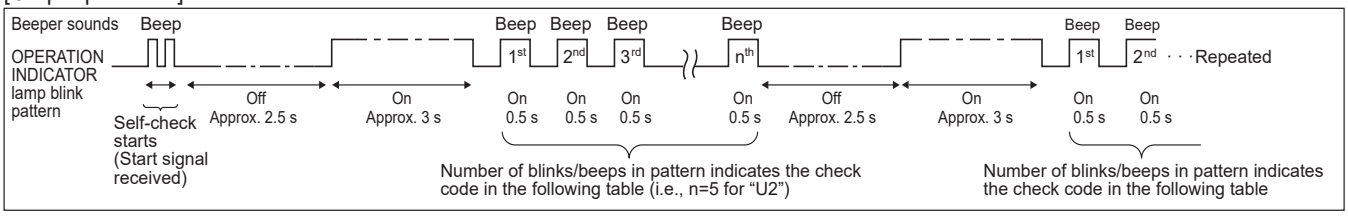

[Output pattern A] Errors detected by indoor unit

IR wireless remote controller Beeper sounds/OPERATION INDICATOR lamp blinks (Number of times)	Wired remote controller ① Check code	Symptom	Remark
1	P1	Intake sensor error	As for indoor unit, refer to indoor unit's service manual.
2	P2	Pipe (TH2) sensor error	
	P9	Pipe (TH5) sensor error	
3	E6, E7	Indoor/outdoor unit communication error	
4	P4	Drain sensor error/Float switch connector open	
5	P5	Drain pump error	
	PA	Forced compressor stop (due to water leakage abnormality)	
6	P6	Freezing/Overheating protection operation	
7	EE	Combination error between indoor and outdoor units	
8	P8	Pipe temperature error	
9	E4, E5	Remote controller signal receiving error	
10	–	–	
11	–	–	
12	Fb (FB)*	Indoor unit control system error (memory error, etc.)	
14	PL	Refrigerant circuit abnormal	
–	E0, E3	Remote controller transmission error	
–	E1, E2	Remote controller control board error	

[Output pattern B] Errors detected by unit other than indoor unit (outdoor unit, etc.)

IR wireless remote controller Beeper sounds/OPERATION INDICATOR lamp blinks (Number of times)	Wired remote controller Check code	Symptom	Remark
1	E9	Indoor/outdoor unit communication error (Transmitting error) (Outdoor unit)	For details, check the LED display of the outdoor controller board.
2	UP	Compressor overcurrent interruption	
3	U3, U4	Open/short of outdoor unit thermistors	
4	UF	Compressor overcurrent interruption (When compressor locked)	
5	U2	Abnormal high discharging temperature/49C worked/ insufficient refrigerant	
6	U1, Ud (UD)*	Abnormal high pressure (63H worked)/Overheating protection operation	
7	U5	Abnormal temperature of heat sink	
8	U8	Outdoor unit fan protection stop	
9	U6	Compressor overcurrent interruption/Abnormal of power module	
11	U9, UH	Abnormality such as overvoltage or voltage shortage and abnormal synchronous signal to main circuit/Current sensor error	
12	–	–	
13	–	–	
14	Others	Other errors	

Notes: 1. If the beeper does not sound again after the initial 2 beeps to confirm the self-check start signal was received and the OPERATION INDICATOR lamp does not come on, there are no error records.

2. If the beeper sounds 3 times continuously "beep, beep, beep (0.4 + 0.4 + 0.4 seconds)" after the initial 2 beeps to confirm the self-check start signal was received, the specified refrigerant address is incorrect.

*The check code in the parenthesis indicates PAR-3xMAA, PAR-4xMAA ("x" represents 0 or later).

10-4. SELF-DIAGNOSIS ACTION TABLE

<Abnormalities detected when the power is turned on>

Note: Refer to indoor unit section for code P and code E.

Check code	Abnormal points and detection method	Cause	judgment and action
None	—	① No voltage is supplied to terminal block (TB1) of outdoor unit. a) Power supply breaker is turned off. b) Contact failure or disconnection of power supply terminal c) Open phase (L1 or L2 phase)	① Check following items. a) Power supply breaker b) Connection of power supply terminal block (TB1) c) Connection of power supply terminal block (TB1)
		② Electric power is not charged to power supply terminal of outdoor power circuit board. a) Contact failure of power supply terminal b) Open phase on the outdoor power circuit board Disconnection of connector LI or NI	② Check following items. a) Connection of power supply terminal block (TB1) b) Connection of terminal on outdoor power circuit board Disconnection of connector LI or NI Refer to "10-9. TEST POINT DIAGRAM".
		③ Electric power is not supplied to outdoor controller circuit board. a) Disconnection of connector (CNDC)	③ Check connection of the connector (CNDC) on the outdoor controller circuit board. Check connection of the connector CNDC on the outdoor power circuit board. Refer to "10-9. TEST POINT DIAGRAM".
		④ Disconnection of reactor (DCL)	④ Check connection of reactor. (DCL) Check connection of "TB1A", "TB3A", "TB1B" and "TB3B" on the outdoor power circuit board. Refer to "10-9. TEST POINT DIAGRAM".
		⑥ Defective outdoor power circuit board	⑥ Replace outdoor power circuit board.
		⑦ Defective outdoor controller circuit board	⑦ Replace controller board (When items above are checked but the units cannot be repaired).

Check code	Abnormal points and detection method	Cause	judgment and action
F5 (5201)	**63H connector open** Abnormal if 63H connector circuit is open for 3 minutes continuously after power supply. 63H: High pressure switch	① Disconnection or contact failure of 63H connector on outdoor controller circuit board ② Disconnection or contact failure of 63H ③ 63H is working due to defective parts. ④ Defective outdoor controller circuit board	① Check connection of 63H connector on outdoor controller circuit board. Refer to "10-9. TEST POINT DIAGRAM". ② Check the 63H side of connecting wire. ③ Check continuity by tester. Replace the parts if the parts are defective. ④ Replace outdoor controller circuit board.
EA (6844)	**Miswiring of indoor/outdoor unit connecting wire** Outdoor controller circuit board can automatically check the number of connected indoor units. Abnormal if the number cannot be checked automatically due to miswiring of indoor/outdoor unit connecting wire, etc. after power is turned on for 4 minutes. Abnormal if outdoor controller circuit board recognizes excessive number of indoor units.	① Contact failure or miswiring of indoor/outdoor unit connecting wire ② Diameter or length of indoor/outdoor unit connecting wire is out of specified capacity. ③ Excessive number of indoor units are connected to 1 indoor unit. (4 units or more) ④ Defective transmitting receiving circuit of outdoor controller circuit board ⑤ Defective transmitting receiving circuit of indoor controller board ⑥ Defective indoor power board ⑦ 2 or more outdoor units have refrigerant address “0” . (In the case of group control) ⑧ Noise has entered into power supply or indoor/outdoor unit connecting wire.	① Check disconnection or looseness or polarity of indoor/outdoor unit connecting wire of indoor and outdoor units. ② Check diameter and length of indoor/outdoor unit connecting wire. Total wiring length: 262 ft [80 m] (including wiring connecting each indoor unit and between indoor and outdoor unit) Also check if the connection order of flat cable is S1, S2, S3. ③ Check the number of indoor units that are connected to one outdoor unit. (If EA is detected) ④–⑥ Turn the power off once, and on again to check. Replace outdoor controller circuit board, indoor controller board or indoor power board if abnormality occurs again. ⑦ Check if refrigerant addresses (SW1-3 to SW1-6 on outdoor controller circuit board) are overlapping in the case of group control system. ⑧ Check transmission path, and remove the cause. Note: The descriptions above, ①–⑧, are for EA, Eb and EC.
Eb (6845)	**Miswiring of indoor/outdoor unit connecting wire (reversed wiring or disconnection)** Outdoor controller circuit board can automatically set the unit number of indoor units. Abnormal if the indoor unit number cannot be set within 4 minutes after power on because of miswiring (reversed wiring or disconnection) of indoor/outdoor unit connecting wire.	① Contact failure or miswiring of indoor/outdoor unit connecting wire ② Diameter or length of indoor/outdoor unit connecting wire is out of specified capacity. ④ Defective transmitting receiving circuit of outdoor controller circuit board ⑤ Defective transmitting receiving circuit of indoor controller board ⑥ Defective indoor power board ⑦ 2 or more outdoor units have refrigerant address “0” . (In the case of group control) ⑧ Noise has entered into power supply or indoor/outdoor unit connecting wire.	
EC (6846)	**Startup time over** The unit cannot finish Startup process within 4 minutes after power on.	① Contact failure of indoor/outdoor unit connecting wire ② Diameter or length of indoor/outdoor unit connecting wire is out of specified capacity. ⑦ 2 or more outdoor units have refrigerant address “0” . (In the case of group control) ⑧ Noise has entered into power supply or indoor/outdoor unit connecting wire.	

Check code	Abnormal points and detection method	Cause	judgment and action
U1 (1302)	**High pressure (High pressure switch 63H operated)** Abnormal if High pressure switch 63H worked (*) during compressor operation. *602 PSIG [4.15 MPa] 63H: High pressure switch	① Short cycle of indoor unit ② Clogged filter of indoor unit ③ Decreased airflow caused by dirt of indoor fan ④ Dirt of indoor heat exchanger ⑤ Locked indoor fan motor ⑥ Malfunction of indoor fan motor ⑦ Defective operation of stop valve (Not full open) ⑧ Clogged or broken pipe ⑨ Locked outdoor fan motor ⑩ Malfunction of outdoor fan motor ⑪ Short cycle of outdoor unit ⑫ Dirt of outdoor heat exchanger ⑬ Decreased airflow caused by defective inspection of outside temperature thermistor (It detects lower temperature than actual temperature.) ⑭ Disconnection or contact failure of connector (63H) on outdoor controller board ⑮ Disconnection or contact failure of 63H connection ⑯ Defective outdoor controller board ⑰ Defective action of linear expansion valve ⑱ Malfunction of fan driving circuit	①–⑥Check indoor unit and repair the defect. ⑦ Check if stop valve is fully open. ⑧ Check piping and repair the defect. ⑨–⑫ Check outdoor unit and repair the defect. ⑬ Check the inspected temperature of outside temperature thermistor on LED display. (SW2 on A-Control Service Tool: Refer to "10-10. FUNCTION OF SWITCHES, CONNECTORS AND JUMPERS".) ⑭–⑯Turn the power off and check F5 is displayed when the power is on again. When F5 is displayed, refer to “Judgment and action” for F5. ⑰ Check linear expansion valve. Refer to "10-6. HOW TO CHECK THE PARTS" and "10-7. HOW TO CHECK THE COMPONENTS". ⑱ Replace outdoor controller board.
U2 (TH4: 1102) (TH33: 1132)	**High discharge temperature** **High comp. surface temperature** (1) Abnormal if discharge temperature thermistor (TH4) exceeds 248˚F [120℃] or 230˚F [110℃] continuously for 5 minutes. Abnormal if condenser/evaporator temperature thermistor (TH5) exceeds 104˚F [40℃] during defrosting and discharge temperature thermistor (TH4) exceeds 230˚F [110℃]. (2) Abnormal if discharge superheat (Cooling: TH4−TH5 Heating: TH4−TH6) increases. All the conditions in A or B are detected simultaneously for 10 minutes continuously after 6 minutes past from compressor Startup (including the thermostat indication or recovery from defrosting). <Condition A> • Heating mode • When discharge superheat is less than 126˚F [70℃]. • When the TH6 temp is more than the value obtained by TH7−9˚F [5℃]. • When the condensing temp of TH5 is less than 95˚F [35℃]. <Condition B> • During comp. operation (Cooling and Heating) • When discharge superheat is less than 144˚F [80℃] in cooling. • When discharge super heat is less than 162˚F [90℃] in heating. • When condensing temp of TH6 is more than −40˚F [−40℃] (In cooling only). (3) Abnormal if comp. surface temperature thermistor (TH33) exceeds 248˚F [120℃] or 230˚F [110℃] continuously for 5 minutes.	① Overheated compressor operation caused by shortage of refrigerant ② Defective operation of stop valve ③ Defective thermistor ④ Defective outdoor controller board ⑤ Defective action of linear expansion valve	① Check intake superheat. Check leakage of refrigerant. Charge additional refrigerant. ② Check if stop valve is fully open. ③④ Turn the power off and check if U3 is displayed when the power is on again. When U3 is displayed, refer to “Judgment and action” for U3. ⑤ Check linear expansion valve. Refer to "10-6. HOW TO CHECK THE PARTS" and "10-7. HOW TO CHECK THE COMPONENTS".

Check code	Abnormal points and detection method	Cause	judgment and action
U3 (5104)	**Open/short circuit of outdoor unit temperature thermistor (TH4, TH33)** Abnormal if open (−4˚F [−20℃] or less) or short (422˚F [217℃] or more) is detected during compressor operation. (Detection is inoperative for 10 minutes of compressor starting process and for 10 minutes after and during defrosting.) TH33: Thermistor <Comp. surface>	① Disconnection or contact failure of connectors (TH4, TH33) on the outdoor controller circuit board ② Defective thermistor ③ Defective outdoor controller circuit board	① Check connection of connector (TH4, TH33) on the outdoor controller circuit board. Check breaking of the lead wire for TH4 or TH33. Refer to "10-9. TEST POINT DIAGRAM". ② Check resistance value of TH4, TH33, or temperature by microprocessor. (Thermistor/TH4, TH33: Refer to "10-6. HOW TO CHECK THE PARTS".) (SW2 on A-Control Service Tool: Refer to "10-10. FUNCTION OF SWITCHES, CONNECTORS AND JUMPERS".) ③ Replace outdoor controller board.
U4 (TH3:5105) (TH6:5107) (TH7:5106) (TH8:5110)	**Open/short of outdoor unit thermistors (TH3, TH6, TH7 and TH8)** Abnormal if open or short is detected during compressor operation. Open detection of thermistors TH3 and TH6 is inoperative for 10 seconds to 10 minutes after compressor starting and 10 minutes after and during defrosting. Note: Check which unit has abnormality in its thermistor by switching the mode of SW2. (PAC-SK52ST) (Refer to "10-10. FUNCTION OF SWITCHES, CONNECTORS AND JUMPERS".)	① Disconnection or contact failure of connectors (Outdoor controller circuit board: TH3,TH6/TH7 Outdoor power circuit board: CN6) ② Defective thermistor ③ Defective outdoor controller circuit board	① Check connection of connector (TH3,TH6/TH7) on the outdoor controller circuit board. Check connection of connector (CN6) on the outdoor power circuit board. Check breaking of the lead wire for thermistor (TH3,TH6,TH7,TH8). Refer to "10-9. TEST POINT DIAGRAM". ② Check resistance value of thermistor (TH3,TH6,TH7,TH8) or check temperature by microprocessor. (Thermistor/TH3, TH6, TH7, TH8: Refer to "10-6. HOW TO CHECK THE PARTS".) (SW2 on A-Control Service Tool: Refer to "10-10. FUNCTION OF SWITCHES, CONNECTORS AND JUMPERS".) ③ Replace outdoor controller circuit board. Note: Emergency operation is available in the case of abnormalities of TH3, TH6 and TH7. Refer to "10-8. EMERGENCY OPERATION".

Thermistors		Open detection	Short detection
Symbol	Name		
TH3	Thermistor <Liquid>	−58°F [−50℃] or below	194°F [90℃] or above
TH6	Thermistor <2-phase pipe>	−58°F [−50℃] or below	194°F [90℃] or above
TH7	Thermistor <Ambient>	−58°F [−50℃] or below	194°F [90℃] or above
TH8	Thermistor <Heat sink>	−54°F [−48℃] or below	216°F [102℃] or above

U5 (4230)	**Temperature of heat sink** Abnormal if heat sink thermistor (TH8) detects temperature indicated below. 170˚F [77℃]	① The outdoor fan motor is locked. ② Failure of outdoor fan motor ③ Airflow path is clogged. ④ Rise of ambient temperature ⑤ Defective thermistor ⑥ Defective input circuit of outdoor power circuit board ⑦ Failure of outdoor fan drive circuit	①② Check outdoor fan. ③ Check airflow path for cooling. ④ Check if there is something which causes temperature rise around outdoor unit. (Upper limit of ambient temperature is 114˚F [46℃].) Turn off power, and on again to check if U5 is displayed within 30 minutes. If U4 is displayed instead of U5, follow the action to be taken for U4. ⑤ Check resistance value of thermistor (TH8) or temperature by microprocessor. (Thermistor/TH8: Refer to "10-6. HOW TO CHECK THE PARTS".) (SW2 on A-Control Service Tool: Refer to "10-10. FUNCTION OF SWITCHES, CONNECTORS AND JUMPERS". ⑥ Replace outdoor power circuit board. ⑦ Replace outdoor controller circuit board.
U6 (4250)	**Power module** Check abnormality by driving power module in case overcurrent is detected. (UF or UP error condition)	① Outdoor stop valve is closed. ② Decrease of power supply voltage ③ Looseness, disconnection or reversed of compressor wiring connection ④ Defective compressor ⑤ Defective outdoor power circuit board	① Open stop valve. ② Check facility of power supply. ③ Correct the wiring (U·V·W phase) to compressor. Refer to "10-9. TEST POINT DIAGRAM" (Outdoor power circuit board). ④ Check compressor referring to "10-6. HOW TO CHECK THE PARTS". ⑤ Replace outdoor power circuit board.
U8 (4400)	**Outdoor fan motor** Abnormal if the rotational frequency of fan motor is not detected during DC fan motor operation. Fan motor rotational frequency is abnormal if; • 100 rpm or below detected continuously for 15 seconds at 68˚F [20℃] or more outside air temperature. • 50 rpm or below or 1500 rpm or more detected continuously for 1 minute.	① Failure in the operation of the DC fan motor ② Failure in the outdoor circuit controller board	① Failure in the operation of the DC fan motor ② Failure in the outdoor circuit controller board

Check code	Abnormal points and detection method		Cause	judgment and action
U9 (4220)	Detailed codes	To find out the detail history (latest) about U9 error, turn ON SW2-1, 2-2, and 2-6. Refer to "10-10. FUNCTION OF SWITCHES, CONNECTORS AND JUMPERS".		
	01	**Overvoltage error** • Increase in DC bus voltage to: 430 V	① Abnormal increase in power source voltage ② Disconnection of compressor wiring ③ Defective outdoor power circuit board ④ Compressor has a ground fault.	① Check the field facility for the power supply. ② Correct the wiring (U·V·W phase) to compressor. Refer to "10-9. TEST POINT DIAGRAM" (Outdoor power circuit board). ③ Replace outdoor power circuit board. ④ Check compressor for electrical insulation. Replace compressor.
	02	**Undervoltage error** • Instantaneous decrease in DC bus voltage to 200 V	① Decrease in power source voltage, instantaneous stop. ② Defective converter drive circuit in outdoor power circuit board ③ Defective 52C drive circuit in outdoor power circuit board ④ Disconnection or loose connection of CN2 on the outdoor power circuit board/ controller circuit board ⑤ Power circuit failure on DC supply for 15 VDC output on outdoor controller circuit board	① Check the field facility for the power supply. ② Replace outdoor power circuit board. ③ Replace outdoor power circuit board. ④ Check CN2 wiring. ⑤ Replace outdoor controller circuit board.
	04	**Input current sensor error** • Decrease in input current through outdoor unit to 0.1 A only if operation frequency is more than or equal to 40 Hz or compressor current is more than or equal to 6 A.	① Defective input current detection circuit in outdoor power circuit board ② Defective outdoor controller circuit board	① Replace outdoor power circuit board. ② Replace outdoor controller circuit board.
	08	**Abnormal power synchronous signal** • No input of power synchronous signal to power circuit board • Power synchronous signal of 44 Hz or less, or 65 Hz or more is detected on power circuit board.	① Distortion of power source voltage, noise superimposition ② Disconnection or loose connection of earth wiring ③ Disconnection or loose connection of CN2 on the outdoor power circuit board/ controller circuit board ④ Defective power synchronous signal in outdoor controller circuit board ⑤ Defective power synchronous signal circuit in outdoor power circuit board	① Check the field facility for the power supply. ② Check earth wiring. ③ Check CN2 wiring. ④ Replace outdoor controller circuit board. ⑤ Replace outdoor power circuit board.
	10	**PFC error (Overvoltage/ Undervoltage/Overcurrent)** • PFC detected any of the following: a) Increase of DC bus voltage as follows: 430 V b) Decrease in PFC control voltage to 13 VDC or lower c) Increase in input current as follows: 42 A peak	① Abnormal increase in power source voltage ② Decrease in power source voltage, instantaneous stop ③ Disconnection of compressor wiring ④ Misconnection of reactor (DCL) ⑤ Defective outdoor power circuit board ⑥ Defective reactor (DCL) ⑦ Disconnection or loose connection of CN2 on the outdoor power circuit board/ controller circuit board	①② Check the field facility for the power supply. ③ Correct the wiring (U·V·W phase) to compressor. Refer to "10-9. TEST POINT DIAGRAM". ④ Correct the wiring (U·V·W phase) or reactor (DCL). ⑤ Replace outdoor power circuit board. ⑥ Replace reactor (DCL). ⑦ Check CN2 wiring.

Check code	Abnormal points and detection method	Cause	judgment and action
UF (4100)	**Compressor overcurrent interruption (When compressor locked)** Abnormal if overcurrent of DC bus or compressor is detected within 30 seconds after compressor starts operating.	① Stop valve is closed. ② Decrease of power supply voltage ③ Looseness, disconnection or reversed of compressor wiring connection ④ Defective compressor ⑤ Defective outdoor power board ⑥ DIP Switch setting for selecting model is incorrect on the outdoor power circuit board.	① Open stop valve. ② Check facility of power supply. ③ Correct the wiring (U·V·W phase) to compressor. Refer to "10-9. TEST POINT DIAGRAM".(Outdoor power circuit board). ④ Check compressor. Refer to "10-6. HOW TO CHECK THE PARTS". ⑤ Replace outdoor power circuit board. ⑥ Check that the DIP Switch setting is correct on the outdoor controller circuit board by referring to "Model Select" in "1) Function of switches" in "10-10. FUNCTION OF SWITCHES, CONNECTORS AND JUMPERS".
UH (5300)	**Current sensor error** • It is abnormal for 38A the input current or 10 seconds continuous 34A or more.	① Defective circuit of current sensor on outdoor power circuit board ② Decrease of power supply voltage	① Replace outdoor power circuit board. ② Check the facility of power supply.
UL (1300)	**Low pressure** Abnormal if the following conditions are detected for continuously 3 minutes after compressor starts heating operating for 10 minutes. 1. Heating mode Detection mode 1 TH7−TH3 ≦ 4°C and TH5−Indoor room temperature ≦ 2°C Detection mode 2 TH7−TH3 ≦ 2°C and TH5−Indoor room temperature ≦ 4°C and TH2−Indoor room temperature ≦ 4°C Detection mode 3 TH7−TH3 ≦ 4°C and TH5−Indoor room temperature ≦ 2°C and TH4−TH5 ≧ 20°C 2. Cooling mode TH6−TH7 ≦ 2°C and TH3−TH7 ≦ 2°C and Indoor room temperature - Indoor liquid pipe temperature (TH2) ≦ 5°C Note that it applies when the compressor accumulated operating time is under 30 minutes, and 7 minutes has passed after the compressor operation. Thermistors: TH3: Liquid pipe temperature TH4: Discharge temperature TH5: Indoor 2-phase pipe temperature TH7: Ambient temperature Thermistor TH3: Outdoor liquid pipe temperature TH4: Discharge temperature TH5: Indoor cond./eva. temperature TH6: Outdoor 2-phase pipe temperature TH7: Outdoor temperature	① Stop valve of outdoor unit is closed during operation. ② Leakage or shortage of refrigerant ③ Malfunction of linear expansion valve ④ Clogging with foreign objects in refrigerant circuit Note: If water enters in refrigerant circuit, clogging may occur where the part becomes below freezing point.	① Check stop valve. ② Check intake superheat. Check leakage of refrigerant. Check additional refrigerant. ③ Check linear expansion valve. Refer to "10-6. HOW TO CHECK THE PARTS". ④ After recovering refrigerant, remove water from entire refrigerant circuit under vacuum more than 1 hour.
UP (4210)	**Compressor overcurrent interruption** Abnormal if overcurrent DC bus or compressor is detected after compressor starts operating for 30 seconds.	① Stop valve of outdoor unit is closed. ② Decrease of power supply voltage ③ Looseness, disconnection or reversed of compressor wiring connection ④ Defective fan of indoor/outdoor units ⑤ Short cycle of indoor/outdoor units ⑥ Defective input circuit of outdoor power circuit board ⑦ Defective compressor	① Open stop valve. ② Check facility of power supply. ③ Correct the wiring (U·V·W phase) to compressor. Refer to "10-9. TEST POINT DIAGRAM" (Outdoor power circuit board). ④ Check indoor/outdoor fan. ⑤ Solve short cycle. ⑥ Replace Outdoor power circuit board. ⑦ Check compressor. Refer to "10-6. HOW TO CHECK THE PARTS". Note: Before the replacement of the outdoor controller circuit board, disconnect the wiring to compressor from the outdoor power circuit board and check the output voltage among phases, U, V, W, during test run. No defect on board if voltage among phases (U-V, V-W and W-U) is same. Make sure to perform the voltage check with same performing frequency.

Check code	Abnormal points and detection method	Cause	judgment and action
E0 or E4 (6831, 6834)	**Remote controller transmission error (E0)/signal receiving error (E4)** ① Abnormal if main or sub remote controller cannot receive normally any transmission from indoor unit of refrigerant address “0” for 3 minutes. (Check code : E0) ② Abnormal if sub-remote controller could not receive for any signal for 2 minutes. (Check code: E0) ① Abnormal if indoor controller board cannot receive any data normally from remote controller board or from other indoor controller board for 3 minutes. (Check code: E4) ② Indoor controller board cannot receive any signal from remote controller for 2 minutes. (Check code: E4)	① Contact failure at transmission wire of remote controller ② All remote controllers are set as “sub” remote controller. In this case, E0 is displayed on remote controller, and E4 is displayed at LED (LED1, LED2) on the outdoor controller circuit board. ③ Miswiring of remote controller ④ Defective transmitting receiving circuit of remote controller ⑤ Defective transmitting receiving circuit of indoor controller board of refrigerant address “0”. ⑥ Noise has entered into the transmission wire of remote controller.	① Check disconnection or looseness of indoor unit or transmission wire of remote controller. ② Set one of the remote controllers “main”. If there is no problem with the action above. ③ Check wiring of remote controller. • Total wiring length: max. 500 m [1640ft] (Do not use cable with 3 or more cores.) • The number of connecting indoor units: max. 16 units • The number of connecting remote controller: max. 2 units If the cause of trouble is not in above ①–③, ④ Diagnose remote controllers. a) When “RC OK” is displayed, remote controllers have no problem. Turn the power off, and on again to check. If abnormality occurs again, replace indoor controller board. b) When “RC NG” is displayed, replace remote controller. c) When “RC E3” or "ERC 00-66" is displayed, noise may be causing abnormality. Note: If the unit is not normal after replacing indoor controller board in group control, indoor controller board of address “0” may be abnormal.
E1 or E2 (6832, 6833)	**Remote controller control board** ① Abnormal if data cannot be normally read from the nonvolatile memory of the remote controller control board. (Check code: E1) ② Abnormal if the clock function of remote controller cannot be normally operated. (Check code: E2)	① Defective remote controller	① Replace remote controller.
E3 or E5 (6201, 6203)	**Remote controller transmission error (E3)/signal receiving error (E5)** ① Abnormal if remote controller could not find blank of transmission path for 6 seconds and could not transmit. (Check code: E3) ② Remote controller receives transmitted data at the same time, compares the data, and when detecting it, judges different data to be abnormal 30 continuous times. (Check code: E3) ① Abnormal if indoor controller board could not find blank of transmission path. (Check code: E5) ② Indoor controller board receives transmitted data at the same time, compares the data, and when detecting it, judges different data to be abnormal 30 continuous times. (Check code: E5)	① 2 remote controller are set as “main.” (In the case of 2 remote controllers) ② Remote controller is connected with 2 indoor units or more. ③ Repetition of refrigerant address ④ Defective transmitting receiving circuit of remote controller ⑤ Defective transmitting receiving circuit of indoor controller board ⑥ Noise has entered into transmission wire of remote controller.	① Set a remote controller to main, and the other to sub. ② Remote controller is connected with only one indoor unit. ③ The address changes to a separate setting. ④–⑥ Diagnose remote controller. a) When “RC OK” is displayed, remote controllers have no problem. Turn the power off, and on again to check. When becoming abnormal again, replace indoor controller board. b) When “RC NG”is displayed, replace remote controller. c) When “RC E3”or “ERC 00-66”is displayed, noise may be causing abnormality.
E6 (6840)	**Indoor/outdoor unit communication error (Signal receiving error)** ① Abnormal if indoor controller board could not receive any signal normally for 6 minutes after turning the power on. ② Abnormal if indoor controller board could not receive any signal normally for 3 minutes. ③ Consider the unit as abnormal under the following condition; When 2 or more indoor units are connected to an outdoor unit, indoor controller board could not receive a signal for 3 minutes from outdoor controller circuit board, a signal which allows outdoor controller circuit board to transmit signals.	① Contact failure, short circuit or miswiring (reversed wiring) of indoor/outdoor unit connecting wire ② Defective transmitting receiving circuit of outdoor controller circuit board ③ Defective transmitting receiving circuit of indoor controller board ④ Noise has entered into indoor/outdoor unit connecting wire. ⑤ Defective fan motor ⑥ Defective rush current resistor	Note: Check LED display on outdoor controller circuit board. (Connect A-Control service tool (PAC-SK52ST)) Refer to EA–EC item if LED displays EA–AC. ① Check disconnecting or looseness of indoor/outdoor unit connecting wire of indoor unit or outdoor unit. Check all the units in the case of twin indoor unit system. ②–④ Turn the power off, and on again to check. If abnormality occurs again, replace indoor controller board or outdoor controller circuit board. ⑤ Turn the power off, and detach fan motor from connector (CNF1). Then turn the power on again. If abnormality is not displayed, replace fan motor. If abnormality is displayed, replace outdoor controller circuit board. ⑥ Check PTC1 and PTC2 on outdoor power circuit board with tester. If open is detected, replace the board. Note: Other indoor controller board may have defect in the case of twin indoor unit system.

Check code	Abnormal points and detection method	Cause	judgment and action
E8 (6840)	**Indoor/outdoor unit communication error (Signal receiving error) (Outdoor unit)** (1) Abnormal if outdoor controller circuit board could not receive anything normally for 3 minutes.	① Contact failure of indoor/outdoor unit connecting wire ② Defective communication circuit of outdoor controller circuit board ③ Defective communication circuit of indoor controller board ④ Noise has entered into indoor/outdoor unit connecting wire.	① Check disconnection or looseness of indoor/outdoor unit connecting wire of indoor or outdoor units. ②–④ Turn the power off, and on again to check. Replace indoor controller board or outdoor controller circuit board if abnormality is displayed again.
E9 (6841)	**Indoor/outdoor unit communication error (Transmitting error) (Outdoor unit)** (1) Abnormal if "0" receiving is detected 30 times continuously though outdoor controller circuit board has transmitted "1". (2) Abnormal if outdoor controller circuit board could not find blank of transmission path for 3 minutes.	① Indoor/outdoor unit connecting wire has contact failure. ② Defective communication circuit of outdoor controller circuit board ③ Noise has entered power supply. ④ Noise has entered indoor/outdoor unit connecting wire.	① Check disconnection or looseness of indoor/outdoor unit connecting wire. ②–④ Turn the power off, and on again to check. Replace outdoor controller circuit board if abnormality is displayed again.
EF (6607 or 6608)	**Non defined check code** This code is displayed when non defined check code is received.	① Noise has entered transmission wire of remote controller. ② Noise has entered indoor/outdoor unit connecting wire. ③ Outdoor unit is not a power-inverter models.	①② Turn the power off, and on again to check. Replace indoor controller board or outdoor controller circuit board if abnormality is displayed again. ③ Replace outdoor unit with power-inverter type outdoor unit.
Ed (0403)	**Serial communication error** 1. Abnormal if serial communication between outdoor controller circuit board and outdoor power circuit board is defective.	① Breaking of wire or contact failure of connector CN2 between the outdoor controller circuit board and the outdoor power circuit board ② Breaking of wire or contact failure of connector CN4 between the outdoor controller circuit board and the outdoor power circuit board ③ Defective communication circuit of outdoor power circuit board ④ Defective communication circuit of outdoor controller circuit board for outdoor power circuit board	①② Check connection of each connector CN2 and CN4 between the outdoor controller circuit board and the outdoor power circuit board. ③ Replace outdoor power circuit board. ④ Replace outdoor controller circuit board.
	2. Abnormal if communication between outdoor controller circuit board and M-NET board is not available.	① Breaking of wire or contact failure of connector between outdoor controller circuit board and M-NET board ② Contact failure of M-NET board power supply line ③ Noise has entered into M-NET transmission wire.	① Check disconnection, looseness, or breaking of connection wire between outdoor controller circuit board (CNMNT) and M-NET board (CN5). ② Check disconnection, looseness, or breaking of connection wire between outdoor controller circuit board (CNVMNT) and M-NET board (CND). ③ Check M-NET transmission wiring method.
P8	**Pipe temperature** <Cooling mode> Detected as abnormal when the pipe temperature is not in the cooling range 3 minutes after compressor start and 6 minutes after the liquid or condenser/evaporator pipe is out of cooling range. Note 1: It takes at least 9 minutes to detect. Note 2: Abnormality P8 is not detected in drying mode. Cooling range: Indoor pipe temperature (TH2 or TH5) − intake temperature (TH1) ≦ −5.4˚F [−3℃] TH: Lower temperature between liquid pipe temperature and condenser/evaporator temperature <Heating mode> When 10 seconds have passed after the compressor starts operation and the hot adjustment mode has finished, the unit is detected as abnormal when condenser/evaporator pipe temperature is not in heating range within 20 minutes. Note 3: It takes at least 27 minutes to detect abnormality. Note 4: It excludes the period of defrosting (Detection restarts when defrosting mode is over) Heating range: 5.4˚F [3℃] ≦ (Condenser/evaporator temperature (TH5) − intake temperature (TH1))	① Slight temperature difference between indoor room temperature and pipe <liquid or condenser/evaporator> temperature thermistor • Shortage of refrigerant • Disconnected holder of pipe <liquid or condenser/evaporator> thermistor • Defective refrigerant circuit ② Reversed connection of extension pipe (on plural units connection) ③ Reversed wiring of indoor/outdoor unit connecting wire (on plural units connection) ④ Defective detection of indoor room temperature and pipe <condenser/evaporator> temperature thermistor ⑤ Stop valve is not opened completely.	①–④ Check pipe <liquid or condenser/evaporator> temperature with room temperature display on remote controller and outdoor controller circuit board. Pipe <liquid or condenser/evaporator> temperature display is indicated by setting SW2 of outdoor controller circuit board as follows. (Conduct temperature check with outdoor controller circuit board after connecting 'A-Control Service Tool (PAC-SK52ST)'.) 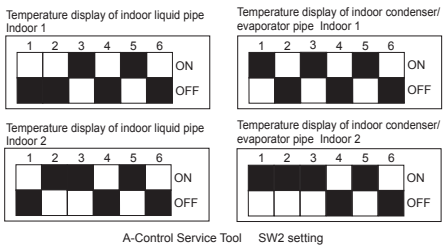 A-Control Service Tool SW2 setting ②③Check reversed connection of extension pipe or reversed wiring of indoor/outdoor unit connecting wire.

Check code	Abnormal points and detection method	Cause	judgment and action
PL	**Abnormal refrigerant circuit** During Cooling, Dry, or Auto Cooling operation, the following conditions are regarded as failures when detected for 1 second. a)The compressor continues to run for 30 or more seconds. b)The liquid pipe temperature or the condenser/evaporator temperature is 167˚F [75℃] or more. **These detected errors will not be cancelled until the power source is reset.**	① Abnormal operation of 4-way valve ② Disconnection of or leakage in refrigerant pipes ③ Air into refrigerant piping ④ Abnormal operation (no rotation) of indoor fan · Defective fan motor. · Defective indoor control board. ⑤ Defective refrigerant circuit (clogging)	① **When this error occurs, be sure to replace the 4-way valve.** ② Check refrigerant pipes for disconnection or leakage. ③ After the recovery of refrigerant, vacuum dry the whole refrigerant circuit. ④ Refer to “10-6. HOW TO CHECK THE PARTS”. ⑤ Check refrigerant circuit for operation. **To avoid entry of moisture or air into refrigerant circuit which could cause abnormal high pressure, purge air in refrigerant circuit or replace refrigerant.**

<M-NET communication error>

Note: “Indoor unit” in the text indicates M-NET board in outdoor unit.

Check code	Abnormal points and detection method	Cause	judgment and action
A0 (6600)	**Address duplicate definition** This error is displayed when transmission from the units of same address is detected. Note: The address and attribute displayed at remote controller indicate the controller that detected abnormality.	① There are 2 or more same address of controller of outdoor unit, indoor unit, FRESH MASTER, or LOSSNAY. ② Noise has entered into transmission signal and signal was transformed.	Search the unit with same address as abnormality occurred. If the same address is found, turn off the power supply of outdoor unit and indoor unit and FRESH MASTER or LOSSNAY at the same time for 2 minutes or more after the address is corrected, and turn the power on again. Check transmission waveform or noise on transmission wire.
A2 (6602)	**Hardware error of transmission processor** Transmission processor intended to transmit “0”, but “1” appeared on transmission wire. Note: The address and attribute display at remote controller indicate the controller that detected abnormality.	① Error is detected if waveform is transformed when wiring works of transmission wire of outdoor unit, indoor unit, FRESH MASTER or LOSSNAY are done, or polarity is changed with the power on and transmission data collide each other. ② Defective transmitting receiving circuit of transmission processor ③ Transmission data is changed by the noise on transmission.	① If the works of transmission wire is done with the power on, turn off the power supply of outdoor unit and indoor unit and FRESH MASTER or LOSSNAY at the same time for 2 minutes or more, and turn the power on again. ② Check transmission waveform or noise on transmission wire.
A3 (6603)	**BUS BUSY** 1. Overtime error by collision damage Abnormal if transmitting signal is not possible for 8–10 minutes continuously because of collision of transmission. 2. Data could not reach transmission wire for 8–10 minutes continuously because of noise, etc. Note: The address and attribute displayed at remote controller indicate the controller that detected abnormality.	① Transmission processor could not transmit signal because short cycle voltage of noise and the like have entered into transmission wire continuously. ② Transmission quantity has increased and transmission is not possible because there was wiring mistake of terminal block for transmission wire (TB3) and terminal block for central control (TB7) in outdoor unit. ③ Transmission are mixed with others and occupation rate on transmission wire rose because of defective repeater (a function to connector or disconnect transmission of control and central control system) of outdoor unit, then abnormality is detected.	① Check if transmission wire of indoor unit, FRESH MASTER, LOSSNAY, or remote controller is not connected to terminal block for central control (TB7) of outdoor unit. ② Check if transmission wire of indoor unit, FRESH MASTER or LOSSNAY is not connected to terminal block for transmission wire of outdoor unit. ③ Check if terminal block for transmission wire (TB3) and terminal block for central control (TB7) are not connected. ④ Check transmission waveform or noise on transmission wire.
A6 (6606)	**Communication error with communication processor** Defective communication between unit processor and transmission processor Note: The address and attribute display at remote controller indicate the controller that detected abnormality.	① Data of transmission processor or unit processor is not transmitted normally because of accidental trouble such as noise or lightning surge. ② Address forwarding from unit processor is not transmitted normally because of defective transmission processor hardware.	Turn off the power supply of outdoor unit and indoor unit and FRESH MASTER or LOSSNAY at the same time for 2 minutes or more, and turn the power on again. System returns to normal if abnormality was accidental malfunction. If the same abnormality generates again, abnormality-generated controller may be defective.

Check code	Abnormal points and detection method	Cause	judgment and action
A7 (6607)	**NO ACK signal** 1. Transmitting side controller detects abnormal if a message was transmitted but there is no reply (ACK) that a message was received. Transmitting side detects abnormality every 30 seconds, 6 times continuously. Note: The address and attribute displayed at remote controller is indicate the controller that did not reply (ACK).	Common factor that has no relation with abnormality source. ① The unit of former address does not exist as address switch has changed while the unit was energized. ② Voltage drop and weak signal which lead communication error are caused by over-range transmission wire. • Maximum distance ····· 656 ft [200 m] • Remote controller line·· (39ft [12 m]) ③ Voltage drop and weak signal which lead communication error are caused by type-unmatched transmission wire. Type····· With shield wire- CVVS, CPEVS With normal wire (no shield)- VCTF, VCTFK, CVV CVS, VVR, VVF, VCT Diameter ··· 1.25 mm^2 [AWG16] or more ④ Voltage drop and weak signal which lead communication error are caused by over-numbered units. ⑤ Accidental malfunction of abnormality-detected controller (noise, lightning surge) ⑥ Defective of abnormality detected controller	**Always try the following when the error "A7" occurs.** ① Turn off the power supply of outdoor unit and indoor unit and FRESH MASTER or LOSSNAY at the same time for 2 minutes or more, and turn the power on again. If malfunction was accidental, the unit returns to normal. ② Check address switch of abnormality detected address. ③ Check disconnection or looseness of abnormality-detected transmission wire (terminal block and connector) ④ Check if tolerance range of transmission wire is not exceeded. ⑤ Check if type of transmission wire is correct or not. If the cause of trouble is in ①–⑤ above, repair the defective, then turn off the power supply of outdoor unit and indoor unit and FRESH MASTER or LOSSNAY at the same time for 2 minutes or more, and turn the power on again. • If the cause of trouble is not in ①–⑤ above in single refrigerant system (one outdoor unit), controller of displayed address or attribute is defective. • If the cause of trouble is not in ①–⑤ above in different refrigerant system (2 or more outdoor units), judge with ⑥. ⑥ If address of abnormality source is the address that should not exist, there is the unit that memorizes nonexistent address information. Delete unused address information with manual setting function of remote controller. Only the system FRESH MASTER or LOSSNAY are connected to, or the system that is equipped with group setting of different refrigerant system. If the cause of trouble is not any of ①–⑥ above, replace the controller board of displayed address or attribute. If the unit does not return to normal, multi controller board of outdoor unit may be defective (repeater circuit). Replace multi-controller board one by one to check if the unit returns to normal.
	2. If displayed address or attribute is outdoor unit, Indoor unit detects abnormality when indoor unit transmitted to outdoor unit and there was no reply (ACK).	① Contact failure of transmission wire of outdoor unit or indoor unit ② Disconnection of transmission connector (CN2M) of outdoor unit ③ Defective transmitting receiving circuit of outdoor unit or indoor unit	
	3. If displayed address or attribute is indoor unit, remote controller detects abnormality when remote controller transmitted to indoor unit and there was no reply (ACK).	① During group operation with indoor unit of multi- refrigerant system, if remote controller transmit to indoor unit while outdoor unit power supply of one refrigerant system is turned off or within 2 minutes of restart, abnormality is detected. ② Contact failure of transmission wire of remote controller or indoor unit ③ Disconnection of transmission connector (CN2M) of indoor unit ④ Defective transmitting receiving circuit of indoor unit or remote controller	
	4. If displayed address or attribute is remote controller, Indoor unit detects abnormality when indoor unit transmitted to remote controller and there was no reply (ACK).	① During group operation with indoor unit of multi- refrigerant system, if indoor unit transmit to remote controller while outdoor unit power supply of one refrigerant system is turned off or within 2 minutes of restart, abnormality is detected. ② Contact failure of transmission wire of remote controller or indoor unit ③ Disconnection of transmission connector (CN2M) of indoor unit ④ Defective transmitting receiving circuit of indoor unit or remote controller	

Continued to the next page.

From the previous page.

Check code	Abnormal points and detection method	Cause	judgment and action
A7 (6607)	5. If displayed address or attribute is FRESH MASTER, Indoor unit detects abnormality when indoor unit transmitted to FRESH MASTER and there was no reply (ACK).	① During sequential operation of indoor unit and FRESH MASTER of other refrigerant system, if indoor unit transmits to FRESH MASTER while outdoor unit power supply of same refrigerant system with FRESH MASTER is turned off or within 2 minutes of restart, abnormality is detected. ② Contact failure of transmission wire of indoor unit or FRESH MASTER ③ Disconnection of transmission connector (CN2M) of indoor unit or FRESH MASTER ④ Defective transmitting receiving circuit of indoor unit or FRESH MASTER	**Same as mentioned in "A7" of the previous page.**
	6. If displayed address or attribute is LOSSNAY, Indoor unit detects abnormality when indoor unit transmitted to LOSSNAY and there was no reply (ACK).	① If the power supply of LOSSNAY is turned off, indoor unit detects abnormality when it transmits to LOSSNAY. ② During sequential operation of indoor unit and LOSSNAY of other refrigerant system, if indoor unit transmits to LOSSNAY while outdoor unit power supply of same refrigerant system with LOSSNAY is turned off or within 2 minutes of restart, abnormality is detected. ③ Contact failure of transmission wire of indoor unit of LOSSNAY ④ Disconnection of transmission connector (CN2M) of indoor unit ⑤ Defective transmitting receiving circuit of indoor unit or LOSSNAY	
	7. If displayed address or attribute is nonexistent,	① The unit of former address does not exist as address switch has changed while the unit was energized. ② Abnormality is detected when indoor unit transmitted because the address of FRESH MASTER and LOSSNAY are changed after sequential operation of FRESH MASTER and LOSSNAY by remote controller.	
A8 (6608)	**M-NET NO RESPONSE** Abnormal if a message was transmitted and there were reply (ACK) that message was received, but response command does not return. Transmitting side detects abnormality every 30 seconds, 6 times continuously. Note: The address and attribute displayed at remote controller indicate the controller that did not reply (ACK).	① Transmitting condition is repeated fault because of noise and the like. ② Extension of transmission wire voltage and signal is caused by over-range transmission wire. • Maximum distance ····· 656 ft [200 m] • Remote controller line ···(39 ft [12 m]) ③ Extension of transmission wire voltage and signal is caused by type-unmatched transmission wire. Type····· With shield wire- CVVS, CPEVS With normal wire (no shield)- VCTF, VCTFK, CVV CVS, VVR, VVF, VCT Diameter···1.25 mm^2 [AWG16] or more ④ Accidental malfunction of abnormality-detected controller	① Check transmission waveform or noise on transmission wire. ② Turn off the power supply of outdoor unit and indoor unit and FRESH MASTER or LOSSNAY at the same time for 2 minutes or more, and turn the power on again. If malfunction was accidental, the unit returns to normal. If the same abnormality occurs again, controller of displayed address and attribute may be defective.

10-5. TROUBLESHOOTING OF PROBLEMS

Phenomena	Factor	Countermeasure
1. Remote controller display does not work.	① 12 VDC is not supplied to remote controller. (Power supply display ⦿ is not indicated on LCD.) ② 12–15 VDC is supplied to remote controller, however, no display is indicated. • “PLEASE WAIT” is not displayed. • “PLEASE WAIT” is displayed.	①Check LED2 on indoor controller board. (1) When LED2 is lit, check the remote controller wiring for breaking or contact failure. (2) When LED2 is blinking, check short circuit of remote controller wiring. (3) When LED2 is not lit, refer to phenomena No.3 below. ② Check the following. • Failure of remote controller if “PLEASE WAIT” is not displayed • Refer to phenomena No.2 below if “PLEASE WAIT” is displayed.
2. “PLEASE WAIT” display is remained on the remote controller.	① At longest 2 minutes after the power supply “PLEASE WAIT” is displayed to startup. ② Communication error between the remote controller and indoor unit ③ Communication error between the indoor and outdoor unit ④ Outdoor unit protection device connector is open.	① Normal operation ② Self-diagnosis of remote controller ③ ”PLEASE WAIT” is displayed for 6 minutes at most in the case of indoor/outdoor unit communication error. Check LED3 on indoor controller board. (1) When LED3 is not blinking, check indoor/outdoor connecting wire for miswiring. (Reversed wiring of S1 and S2, or break of S3 wiring.) (2) When LED3 is blinking, indoor/outdoor connecting wire is normal. ④ Check LED display on outdoor controller circuit board. Refer to "10-10. FUNCTION OF SWITCHES, CONNECTORS AND JUMPERS". Check protection device connector (63H) for contact failure. Refer to "10-9. TEST POINT DIAGRAM".
3. When pressing the remote controller operation switch the OPERATION display is appeared but it will be turned off soon.	① After cancelling to select function from the remote controller, the remote controller operation switch will not be accepted for approx. 30 seconds.	① Normal operation
4. Even controlling by the IR wireless remote controller no beep is heard and the unit does not start operating. Operation display is indicated on IR wireless remote controller.	① The pair number settings of the IR wireless remote controller and indoor controller board are mismatched.	① Check the pair number settings.
5. When operating by the IR wireless remote controller, beep sound is heard, however, unit does not start operating.	① No operation for 2 minutes at most after the power supply ON. ② Hand-held remote controller operation is prohibited. • Remote controlling adaptor is connected to CN32 on the indoor controller board. • Hand-held remote controller operation is prohibited by centralized controller etc. since it is connected to MELANS. ③ Refer to factor of phenomena No.2.	① Normal operation ② Normal operation ③ Check the details of phenomena No.2.

Phenomena	Factor	Countermeasure
6. Remote controller display works normally and the unit performs cooling operation, however, the capacity cannot be fully obtained. (The air does not cool well.)	① Refrigerant shortage ② Filter clogging ③ Heat exchanger clogging ④ Air duct short cycle	① If refrigerant leaks, discharging temperature rises and LEV opening increases. Inspect leakage by checking the temperature and opening. Check pipe connections for gas leakage. ② Open intake grille and check the filter. Clean the filter by removing dirt or dust on it. ③ If the filter is clogged, indoor pipe temperature rises and discharging pressure increases. Check if heat exchanger is clogged by inspecting discharging pressure. Clean the heat exchanger. ④ Remove the blockage.
7. Remote controller display works normally and the unit performs heating operation, however, the capacity cannot be fully obtained.	① Linear expansion valve fault Opening cannot be adjusted well due to linear expansion valve fault. ② Refrigerant shortage ③ Lack of insulation for refrigerant piping ④ Filter clogging ⑤ Heat exchanger clogging ⑥ Air duct short cycle ⑦ Bypass circuit of outdoor unit fault	① Discharging temperature and indoor heat exchanger temperature does not rise. Inspect the failure by checking discharging pressure. Replace linear expansion valve. ② If refrigerant leaks, discharging temperature rises and LEV opening increases. Inspect leakage by checking the temperature and opening. Check pipe connections for gas leakage. ③ Check the insulation. ④ Open intake grill and check the filter. Clean the filter by removing dirt or dust on it. ⑤ If the filter is clogged, indoor pipe temperature rises and discharging pressure increases. Check if heat exchanger is clogged by inspecting discharging pressure. Clean the heat exchanger. ⑥ Remove the blockage. ⑦ Check refrigerant system during operation.
8. ① For 3 minutes after temperature adjuster turns off, the compressor will not start operating even if temperature adjuster is turned on. ② For 3 minutes after temperature adjuster turns on, the compressor will not stop operating even if temperature adjuster is turned off. (Compressor stops operating immediately when turning off by the remote controller.)	①② Normal operation (For protection of compressor)	①② Normal operation

Symptoms: “PLEASE WAIT” is kept being displayed on the remote controller.

Diagnosis flow	Cause	Inspection method and troubleshooting
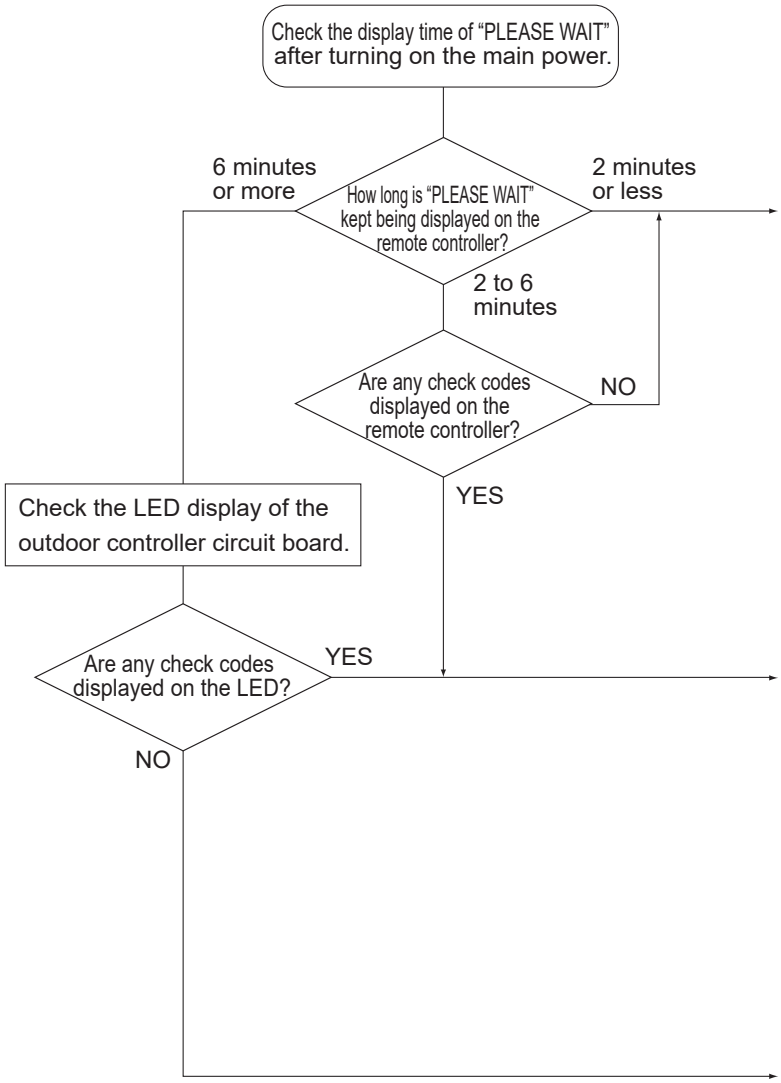	• “PLEASE WAIT” will be displayed during the startup diagnosis after turning on the main power.	• Normal The startup diagnosis will be over in around 2 minutes.
	• Miswiring of indoor/ outdoor connecting wire • Breaking of indoor/ outdoor connecting wire (S3) • Defective indoor controller board • Defective outdoor controller circuit board	• Refer to “Self-diagnosis action table” in order to solve the trouble. • In the case of communication errors, the display of remote controller may not match the LED display of the outdoor unit.
	• Defective indoor controller board • Defective remote controller	

Symptoms: Nothing is displayed on the remote controller. ①	LED display of the indoor controller board LED1: ○ LED2: ○ LED3: ○

Diagnosis flow	Cause	Inspection method and troubleshooting
Check the voltage between S1 and S2 on the terminal block of the indoor unit.		
198 to 253 VAC? NO → Check the voltage among L1 and L2 on the terminal block of the outdoor power circuit board.		
198 to 253 VAC? NO	• Troubles concerning power supply	• Check the power wiring to the outdoor unit. • Check the breaker.
YES → Check the voltage between S1 and S2 on the terminal block of the outdoor unit which is used to connect the indoor unit and the outdoor unit.		
198 to 253 VAC? NO	• Bad wiring of the outdoor controller board • The fuses on the outdoor controller circuit board are blown.	• Check the wiring of the outdoor unit. • Check if the wiring is bad. Check if the fuses are blown. The fuses on the outdoor controller circuit board will be blown when the indoor /outdoor connecting wire short-circuits.
YES → Check the voltage of indoor controller board (CN2D).		
12 to 16 VDC? YES	• Bad wiring of the outdoor controller board • The fuses on the outdoor controller circuit board are blown.	• Check if miswiring, breaking or poor contact is causing this problem. Indoor/outdoor connecting wire is polarized 3-core type. Connect the indoor unit and the outdoor unit by wiring each pair of S1, S2 and S3 on the both side of indoor/outdoor terminal blocks.
NO → Check the voltage of the unit after removing the indoor power board (CN2S).		
	• Defective indoor controller board	• Replace the indoor controller board.
12 to 16 VDC? YES	• Miswiring, breaking or poor connection of indoor/outdoor connecting wire	• Check if there is miswiring or breaking of wire.
NO	• Defective indoor power board	• Replace the indoor power board.

Symptoms: Nothing is displayed on the remote controller. ②	LED display of the indoor controller board LED1: ● LED2: ○ LED3: ○ or ◐

Diagnosis flow	Cause	Inspection method and troubleshooting
Check the voltage between S1 and S2 on the terminal block of the indoor unit.		
198 to 253 VAC? — NO → Check the looseness or disconnection of the indoor/outdoor connecting wire.		
198 to 253 VAC? — YES → Check the status of the indoor controller board LED3 display.		
Check the status of the indoor controller board LED3 display. — Not lighting. → Check the looseness or disconnection of the indoor/outdoor connecting wire.		
Check the status of the indoor controller board LED3 display. — Blinking → Check the refrigerant address of the outdoor unit. (SW1-3 to 1-6)		
Are there looseness or disconnection of the indoor/outdoor connecting wire? — YES	• Breaking or poor contact of the indoor/outdoor connecting wire	• Fix the breaking or poor contact of the indoor/outdoor connecting wire.
Are there looseness or disconnection of the indoor/outdoor connecting wire? — NO → Check the refrigerant address of the outdoor unit. (SW1-3 to 1-6)		
Is the refrigerant address "0"? — NO	• Normal Only the unit which has the refrigerant address "0" supplies power to the remote controller.	• Set the refrigerant address to "0". In the case of the multiple grouping system, recheck the refrigerant address again.
Is the refrigerant address "0"? — YES → Check the LED display of the outdoor unit after turning on the main power again.		
Is anything displayed? — NO	• Defective outdoor controller circuit board	• Replace the outdoor controller circuit board.
Is anything displayed? — YES → Is "EA" or "Eb" displayed?		
Is "EA" or "Eb" displayed? — NO → Is "E8" displayed?		
Is "E8" displayed? — YES	• Defective outdoor controller circuit board	• Replace the outdoor controller circuit board.
Is "E8" displayed? — NO → Can the unit be restarted?		
Can the unit be restarted? → Can all the indoor unit be operated?		
Can all the indoor unit be operated? — NO	• Defective indoor controller board	• Replace the indoor controller board of the indoor unit which does not operate.
Can all the indoor unit be operated? — YES	• Influence of electromagnetic noise	• Not abnormal. There may be the influence of electromagnetic noise. Check the transmission wire and get rid of the causes.
Is "EA" or "Eb" displayed? — YES → Check the voltage between S2 and S3 on the terminal block of the outdoor unit.		
17 to 28 VDC? — NO	• Defective outdoor power circuit board	• Replace the outdoor power circuit board.
17 to 28 VDC? — YES	• Defective indoor power board	• Replace the indoor power board.

Symptoms: Nothing is displayed on the remote controller. ③	LED display of the indoor controller board LED1: ● LED2: ◐ or ● LED3: —

Diagnosis flow	Cause	Inspection method and troubleshooting
Check the voltage of the terminal block (TB6) of the indoor unit.		
10 to 16 VDC? — YES →	• Defective remote controller	• Replace the remote controller.
10 to 16 VDC? — NO		
Check the status of the LED2. — Lighting →	• Breaking or poor contact of the remote controller wire	• Check if there is breaking or poor contact of the remote controller wire. Check the voltage of the terminal block (TB5) connecting the remote controller wire. If it is not between 10 and 16 VDC, the indoor controller board must be defective.
Check the status of the LED2. — Blinking		
Check the status of the LED2 after disconnecting the remote controller wire from the terminal block (TB5) of the indoor unit.		
Check the status of the LED2. — Lighting →	• The remote controller wire short-circuits	• Check if the remote controller wire is short-circuited.
Check the status of the LED2. — Blinking →	• Defective indoor controller board	• Replace the indoor controller board.

• **Before repair**
Frequent calls from customers

Phone Calls From Customers		How to Respond	Note
Unit does not operate at all.	① The operating display of remote controller does not come on.	① Check if power is supplied to air conditioner. Nothing appears on the display unless power is supplied.	————
	② Unit cannot be restarted for a while after it's stopped.	② Wait around 3 minutes to restart unit. The air conditioner is in a state of being protected by the microprocessor's directive. Once the compressor is stopped, the unit cannot be restarted for 3 minutes. This control is also applied when the unit is turned on and off by remote controller or thermostat.	————
	③ Check code appears and blinks on the display of remote controller.	③ Check code will be displayed if any protection devices of the air conditioner are actuated. What is check code? ----------→	Refer to "SELF-DIAGNOSIS ACTION TABLE". Check if servicing is required for the error.
Remote controller	① "PLEASE WAIT" is displayed on the screen.	① Wait around 2 minutes. An automatic startup test will be conducted for 2 minutes when power is supplied to the air conditioner. "PLEASE WAIT" will be kept displayed while that time.	————
	② "FILTER" is displayed on the screen.	② This indicates that it is time to clean the air filters. Clean the air filters. Press the FILTER button on the remote controller twice to clear "FILTER" from the display. See the operation manual that came with the product for how to clean the filters.	Display time of "FILTER" depends on the model. Long life filter: 2500 hrs Regular filter: 100 hrs
	③ "STANDBY" is displayed on the screen.	③ This is displayed when the unit starts HEAT operation, when the thermostat puts the compressor in operation mode, or when the outdoor unit ends DEFROST operation and returns to HEAT operation. The display will automatically disappear around 10 minutes later. While "STANDBY" is displayed on the remote controller, the airflow amount will be restricted because the indoor unit's heat exchanger is not fully heated up. In addition to that, the up/down vane will be automatically set to horizontal blow in order to prevent cold air from directly blowing out to human body. The up/down vane will return to the setting specified by the remote controller when "STANDBY" is released.	————
	④ "DEFROST" is displayed on the screen. (No air comes out of the unit.)	④ The outdoor unit gets frosted when the outside temperature is low and the humidity is high. "DEFROST" indicates the DEFROST operation is being performed to melt this frost. The DEFROST operation ends in around 10 minutes (at most 15 minutes). During the DEFROST operation, the indoor unit's heat exchanger becomes cold, so the blower is stopped. The up/down vane will be automatically set to horizontal blow in order to prevent cold air from directly blowing out to human body. The display will turn into "STANDBY" when DEFROST operation ends.	————

Phone Calls From Customers		How to Respond	Note
The room cannot be cooled or heated sufficiently.		① Check the set temperature of remote controller. The outdoor unit cannot be operated if the set temperature is not appropriate. The outdoor unit operates in the following modes. COOL: When the set temperature is lower than the room temperature. HEAT: When the set temperature is higher than the room temperature.	———
		② Check if filters are not dirty and clogged. If filters are clogged, the airflow amount will be reduced and the unit capacity will be lowered. See the instruction manual that came with the product for how to clean the filters.	———
		③ Check there is enough space around the air conditioner. If there are any obstacles in the air intake or air outlet of indoor/outdoor units, they block the airflow direction so that the unit capacity will be lowered.	———
Sound comes out from the air conditioner.	① An gas escaping sound is heard sometimes.	① This is not a malfunction. This is the sound when the flow of refrigerant in the air conditioner is switched.	———
	② A cracking sound is heard sometimes.	② This is not a malfunction. This is the sound when internal parts of units expand or contract when the temperature changes.	———
	③ A buzzing sound is heard sometimes.	③ This is not a malfunction. This is the sound when the outdoor unit starts operating.	———
	④ A ticking sound is heard from the outdoor unit sometimes.	④ This is not a malfunction. This is the sound when the blower of the outdoor unit is controlling the airflow amount in order to keep the optimum operating condition.	———
	⑤ A sound, similar to water flowing, is heard from the unit.	⑤ This is not a malfunction. This is the sound when the refrigerant is flowing inside the indoor unit.	———
Something is wrong with the blower…..	① The fan speed does not match the setting of the remote controller during DRY operation.(No air comes out sometimes during DRY operation.)	① This is not a malfunction. During the DRY operation, the blower's ON/OFF is controlled by the microprocessor to prevent overcooling and to ensure efficient dehumidification. The fan speed cannot be set by the remote controller during DRY operation.	———
	② The fan speed does not match the setting of the remote controller in HEAT operation.	② This is not a malfunction. 1) When the HEAT operation starts, to prevent the unit from blowing cold air, the fan speed is gradually increased from zero to the set speed, in proportion to the temperature rise of the discharged air. 2) When the room temperature reaches the set temperature and the outdoor unit stops, the unit starts the LOW AIR operation. 3) During the HEAT operation, the DEFROST operation is performed to defrost the outdoor unit. During the DEFROST operation, the blower is stopped to prevent cold air coming out of the indoor unit.	The up/down vane will be automatically set to horizontal blow in these cases listed up on the left (①–③). After a while, the up/down vane will be automatically moved according to the setting of the remote controller.

Phone Calls From Customers		How to Respond	Note
Something is wrong with the blower…..	③ Air blows out for a while after HEAT operation is stopped.	③ This is not a malfunction. The blower is operating just for cooling down the heated-up air conditioner. This will be done within 1 minute. This control is conducted only when the HEAT operation is stopped with the electric heater ON.	However, this control is also applied to the models which has no electric heater.
Something is wrong with the airflow direction….	① The airflow direction is changed during COOL operation.	① If the up/down vane is set to downward in COOL operation, it will be automatically set to horizontal blow by the microprocessor in order to prevent water from dropping down. "1 Hr" will be displayed on the remote controller if the up/down vane is set to downward with the fan speed set to be less than "LOW".	———
	② The airflow direction is changed during HEAT operation. (The airflow direction cannot be set by remote controller.)	② In HEAT operation, the up/down vane is automatically controlled according to the temperature of the indoor unit's heat exchanger. In the following cases written below, the up/down vane will be set to horizontal blow, and the setting cannot be changed by remote controller. 1) At the beginning of the HEAT operation 2) While the outdoor unit is being stopped by thermostat or when the outdoor unit gets started to operate. 3) During DEFROST operation The airflow direction will be back to the setting of remote controller when the above situations are released.	"STANDBY" will be displayed on the remote controller in the case of 1) and 2). "DEFROST" will be displayed on the screen in the case of 3).
	③ The airflow direction does not change. (Up/down vane, left/right louver)	③ 1) Check if the vane is set to a fixed position. (Check if the vane motor connector is removed.) 2) Check if the air conditioner has a function for switching the air direction. 3) If the air conditioner does not have that function, "NOT AVAILABLE" will be displayed on the remote controller when "AIR DIRECTION" or "LOUVER" button is pressed.	———
The air conditioner starts operating even though any buttons on the remote controller are not pressed.		① Check if you set ON/OFF timer. The air conditioner starts operating at the time designated if ON timer has been set before.	———
		② Check if any operations are ordered by distant control system or the central remote controller. While "CENTRALLY CONTROLLED INDICATOR" is displayed on the remote controller, the air conditioner is under the control of external directive.	There might be a case that "CENTRALLY CONTROLLED INDICATOR" will not be displayed.
		③ Check if power is recovered from power failure (black out). The units will automatically start operating when power is recovered after power failure (black out) occurs. This function is called "auto recovery feature from power ".	———
The air conditioner stops even though any buttons on the remote controller are not pressed.		① Check if you set ON/OFF timer. The air conditioner stops operating at the time designated if OFF timer has been set before. ② Check if any operations are ordered by distant control system or the central remote controller. While "CENTRALLY CONTROLLED INDICATOR" is displayed on the remote controller, the air conditioner is under the control of external directive.	There might be a case that "CENTRALLY CONTROLLED INDICATOR" will not be displayed.

Phone Calls From Customers	How to Respond	Note
A white mist is expelled from the indoor unit.	This is not a malfunction. This may occur when the operation is started in the room of high humidity.	_____
Water or moisture is expelled from the outdoor unit.	COOL: When pipes or piping joints are cooled, they sweat and water drips down. HEAT: Water drips down from the heat exchanger. Note: Use optional parts “Drain Socket” and “Drain pan” if these water needs to be collected and drained out for once.	_____
The display of the IR wireless remote controller gets dim or does not come on. The indoor unit does not receive a signal from remote controller at a long distance.	Batteries are being exhausted. Replace them and press the reset button of remote controller.	_____

10-6. HOW TO CHECK THE PARTS
TRUZH0241HA00NA

<table>
<tr><th>Parts name</th><th>Checkpoints</th></tr>
<tr><td>Thermistor (TH3)
<Liquid>
Thermistor (TH4)
<Discharge>
Thermistor (TH6)
<2-phase pipe>
Thermistor (TH7)
<Ambient>
Thermistor (TH8)
<Heat sink>
Thermistor (TH33)
<Comp. surface></td><td>Disconnect the connector then measure the resistance with a tester.
(Ambient temperature 50 to 86°F [10 to 30°C])
<table>
<tr><th></th><th>Normal</th><th>Abnormal</th></tr>
<tr><td>TH4
TH33</td><td>160 to 410 kΩ</td><td rowspan="3">Open or short</td></tr>
<tr><td>TH3
TH6
TH7</td><td>4.3 to 9.6 kΩ</td></tr>
<tr><td>TH8</td><td>39 to 105 kΩ</td></tr>
</table></td></tr>
<tr><td>Fan motor(MF1)</td><td>Refer to the next page.</td></tr>
<tr><td>Solenoid valve coil
<4-way valve>
(21S4)</td><td>Measure the resistance between the terminals with a tester.
(Ambient temperature 68°F [20°C])
<table>
<tr><th>Normal</th><th>Abnormal</th></tr>
<tr><td>1435 ± 150 Ω</td><td>Open or short</td></tr>
</table></td></tr>
<tr><td>Motor for compressor
(MC)
 
</td><td>Measure the resistance between the terminals with a tester.
(Winding temperature 68°F [20°C])
<table>
<tr><th>Normal</th><th>Abnormal</th></tr>
<tr><td>0.188 Ω</td><td>Open or short</td></tr>
</table></td></tr>
<tr><td>Linear expansion valve
(LEV-A/LEV-B/LEV-C)
 
</td><td>Disconnect the connector then measure the resistance with a tester.
(Winding temperature 68°F [20°C])
<table>
<tr><th colspan="4">Normal</th><th>Abnormal</th></tr>
<tr><td>Gray - Black</td><td>Gray - Red</td><td>Gray - Yellow</td><td>Gray - Orange</td><td rowspan="2">Open or short</td></tr>
<tr><td colspan="4">46 ± 3 Ω</td></tr>
</table></td></tr>
</table>

Check method of DC fan motor (fan motor/outdoor controller circuit board)

① Notes

· High voltage is applied to the connector (CNF1) for the fan motor. Pay attention to the service.

· Do not pull out the connector (CNF1) for the motor with the power supply on.
(It causes trouble of the outdoor controller circuit board and fan motor.)

② Self check

Symptom: The outdoor fan cannot rotate.

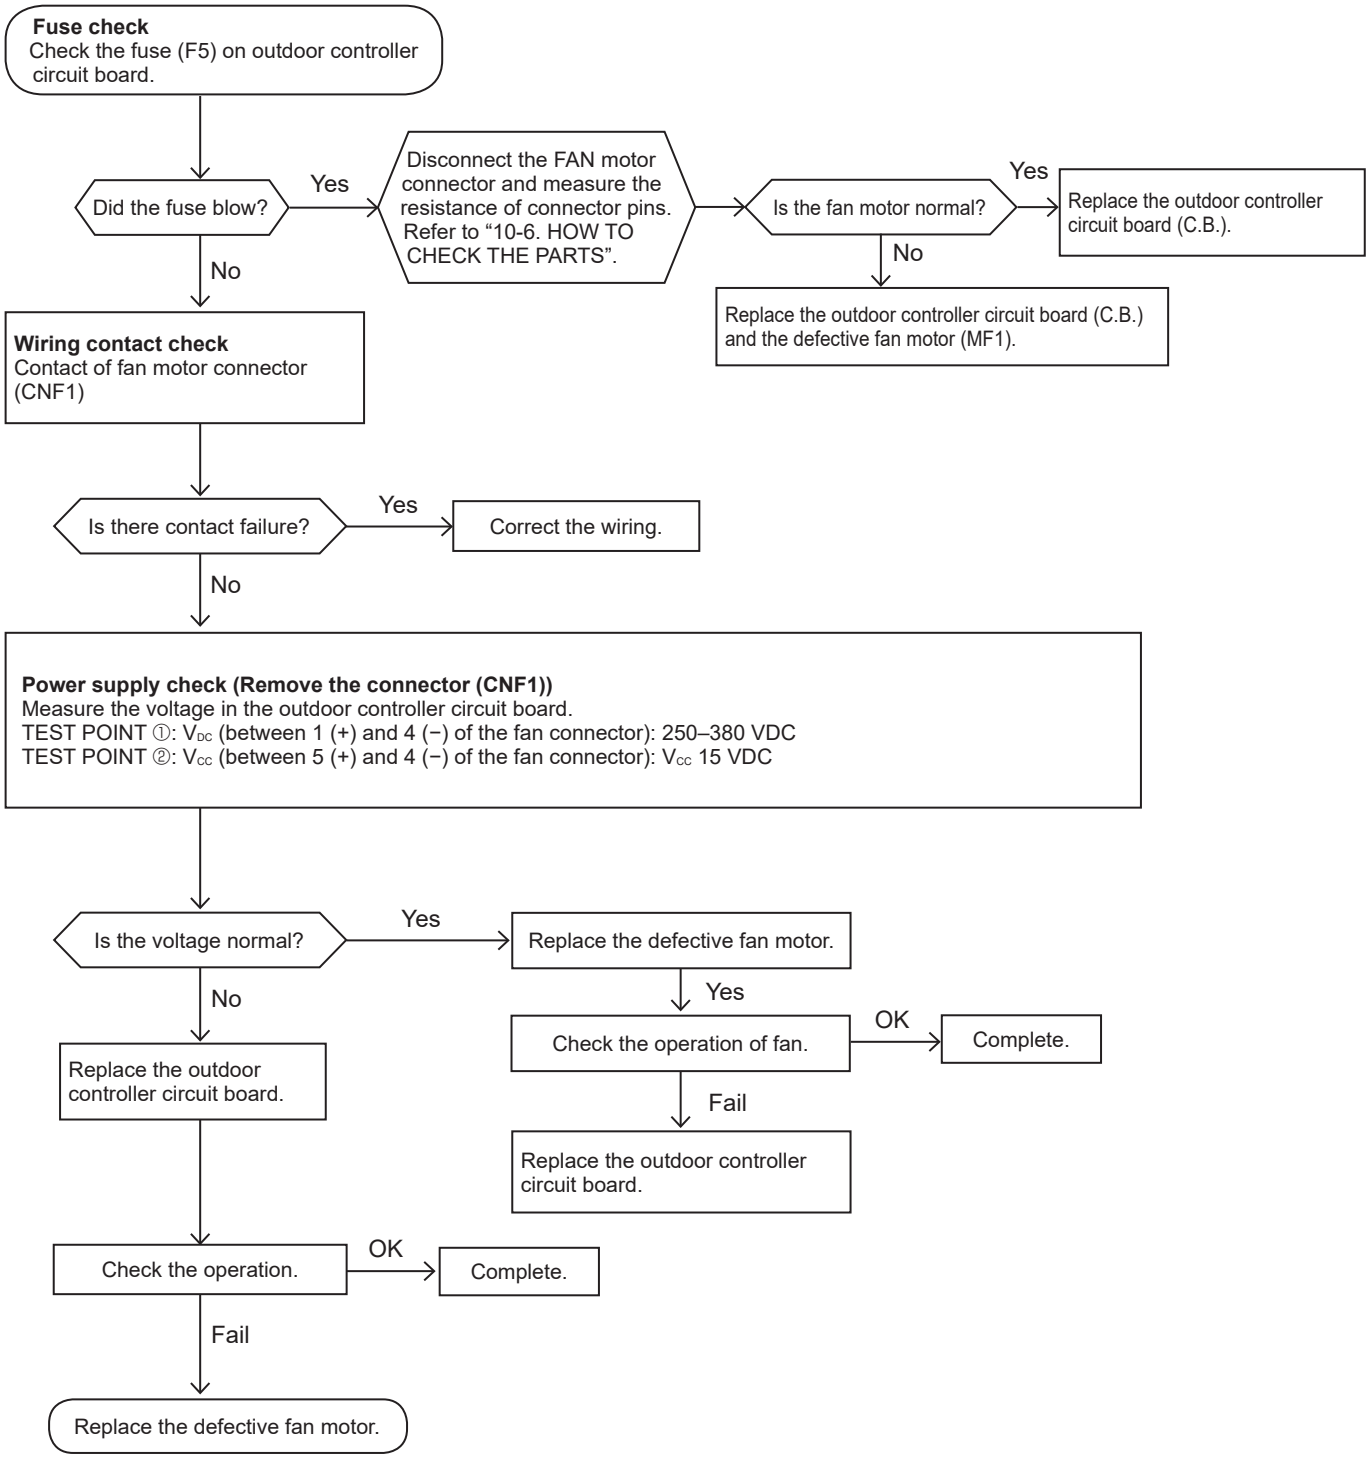

10-7. HOW TO CHECK THE COMPONENTS

<Thermistor feature chart>

Low temperature thermistors

- Thermistor <Liquid> (TH3)
- Thermistor <2-phase pipe> (TH6)
- Thermistor <Ambient> (TH7)

Thermistor R0 = 15 kΩ ± 3%
B constant = 3480 ± 2%

t (°C): $R_t = 15\exp\{3480(\frac{1}{273+t} - \frac{1}{273})\}$

T (°F): $R_T = 15\exp\{3480(\frac{1}{273+(T-32)/1.8} - \frac{1}{273})\}$

32°F [0°C]	15 kΩ	86°F [30°C]	4.3 kΩ
50°F [10°C]	9.6 kΩ	104°F [40°C]	3.0 kΩ
68°F [20°C]	6.3 kΩ		
77°F [25°C]	5.2 kΩ		

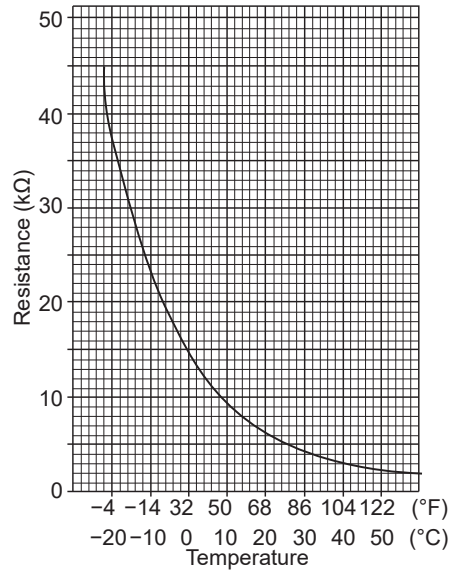

Medium temperature thermistor

- Thermistor <Heat sink> (TH8)

Thermistor R50 = 17 kΩ ± 2%
B constant = 4150 ± 3%

t (°C): $R_t = 17\exp\{4150(\frac{1}{273+t} - \frac{1}{323})\}$

T (°F): $R_T = 17\exp\{4150(\frac{1}{273+(T-32)/1.8} - \frac{1}{323})\}$

32°F [0°C]	180 kΩ
77°F [25°C]	50 kΩ
122°F [50°C]	17 kΩ
158°F [70°C]	8 kΩ
194°F [90°C]	4 kΩ

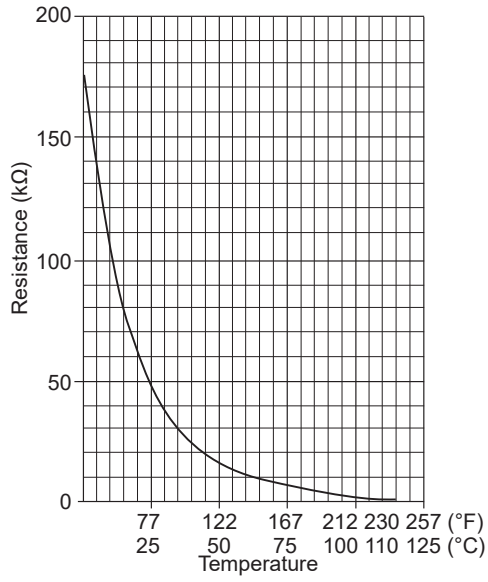

High temperature thermistor

- Thermistor <Comp. surface> (TH33)
- Thermistor <Discharge> (TH4)

Thermistor R120 = 7.465 kΩ ± 2%
B constant = 4057 ± 2%

t (°C): $R_t = 7.465\exp\{4057(\frac{1}{273+t} - \frac{1}{393})\}$

T (°F): $R_T = 7.465\exp\{4057(\frac{1}{273+(T-32)/1.8} - \frac{1}{393})\}$

68°F [20°C]	250 kΩ	158°F [70°C]	34 kΩ
86°F [30°C]	160 kΩ	176°F [80°C]	24 kΩ
104°F [40°C]	104 kΩ	194°F [90°C]	17.5 kΩ
122°F [50°C]	70 kΩ	212°F [100°C]	13.0 kΩ
140°F [60°C]	48 kΩ	230°F [110°C]	9.8 kΩ

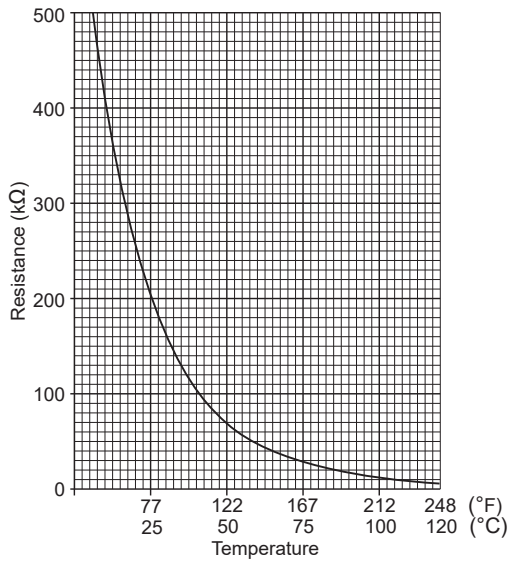

Linear expansion valve

(1) Operation summary of the linear expansion valve

- Linear expansion valve opens/closes through stepping motor after receiving the pulse signal from the outdoor controller board.
- Valve position can be changed in proportion to the number of pulse signal.

<Connection between the indoor controller board and the linear expansion valve>

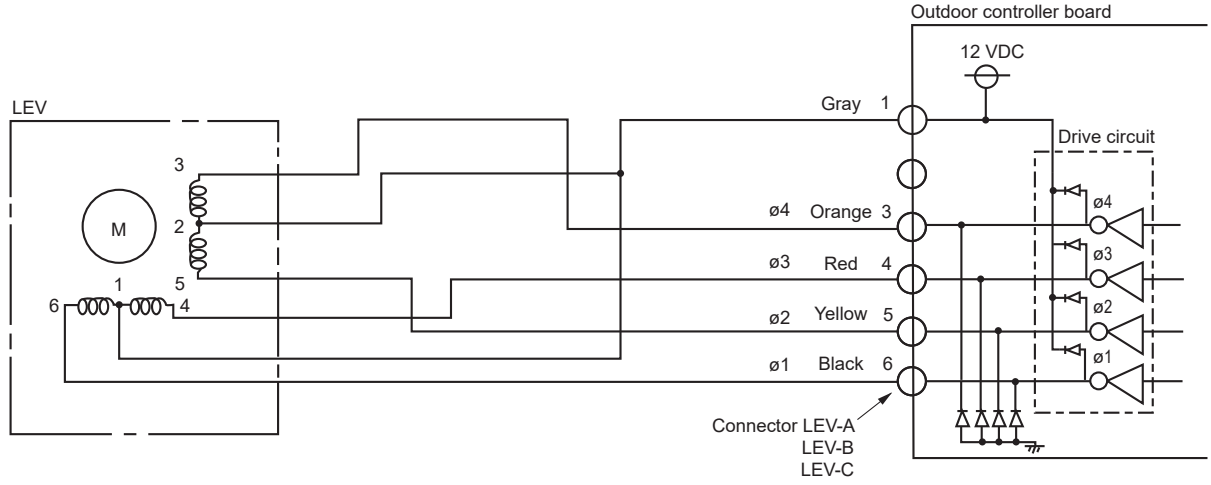

<Output pulse signal and the valve operation>

Output (Phase)	Output							
	1	2	3	4	5	6	7	8
ø1	ON	ON	OFF	OFF	OFF	OFF	OFF	ON
ø2	OFF	ON	ON	ON	OFF	OFF	OFF	OFF
ø3	OFF	OFF	OFF	ON	ON	ON	OFF	OFF
ø4	OFF	OFF	OFF	OFF	OFF	ON	ON	ON

The output pulse shifts in below order.
Opening a valve: 8 → 7 → 6 → 5 → 4 → 3 → 2 → 1 → 8
Closing a valve: 1 → 2 → 3 → 4 → 5 → 6 → 7 → 8 → 1

- When linear expansion valve operation stops, all output phases become OFF.

(2) Linear expansion valve operation

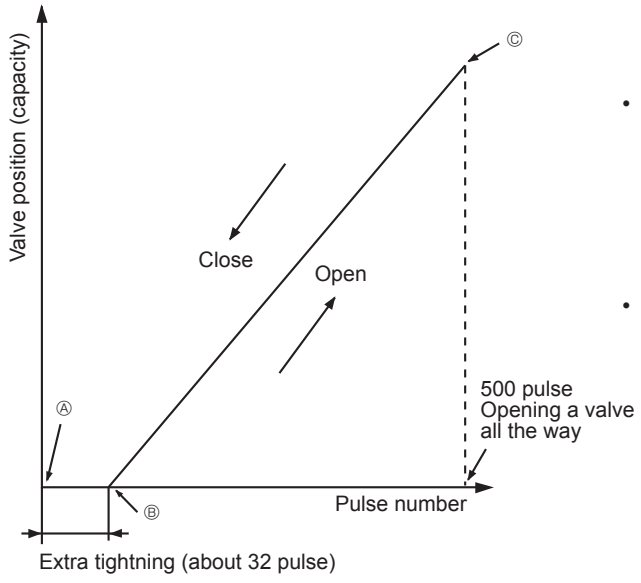

- When the power is turned on, 700 pulse closing valve signal will be sent till it goes to Ⓐ point in order to define the valve position. (The pulse signal is being sent for about 20 seconds.)
- When the valve moves smoothly, there is no sound or vibration occurring from the linear expansion valve ; however, when the pulse number moves from Ⓑ to Ⓐ or when the valve is locked, sound can be heard.
  No sound is heard when the pulse number moves from Ⓑ to Ⓐ in case coil is burnt out or motor is locked by open-phase.
- Sound can be detected by placing the ear against the screw driver handle while putting the screw driver to the linear expansion valve.

(3) How to attach and detach the coil of linear expansion valve

<Composition>

Linear expansion valve is separable into the main body and the coil as shown in the diagram below.

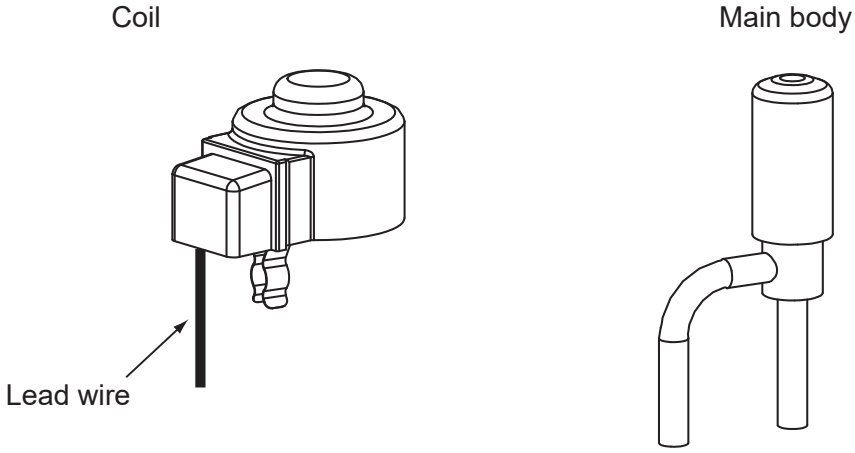

<How to detach the coil>

Hold the lower part of the main body (shown as A) firmly so that the main body does not move and detach the coil by pulling it upward.
Be sure to detach the coil holding main body firmly. Otherwise pipes can bend due to stress.

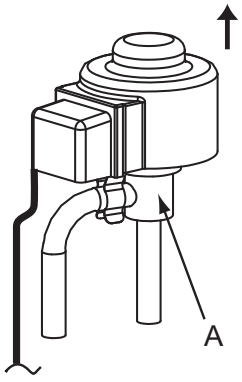

<How to attach the coil>

Hold the lower part of the main body (shown as A) firmly so that the main body does not move and attach the coil by inserting it downward into the main body. Then securely attach the coil stopper to main body. (At this time, be careful that stress is not added to lead wire and main body is not wound by lead wire.) If the stopper is not firmly attached to main body, coil may be detached from the main body and that can cause defective operation of linear expansion valve.
To prevent piping stress, be sure to attach the coil holding the main body of linear expansion valve firmly. Otherwise pipe may break.

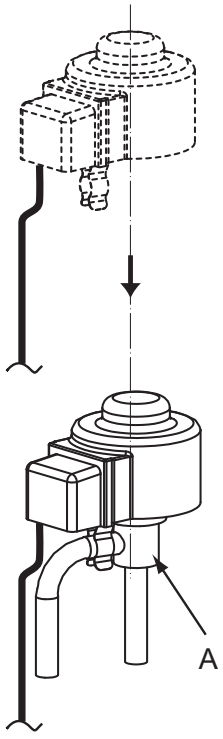

10-8. EMERGENCY OPERATION

(1) When any check codes shown below is displayed on outdoor unit, or microprocessor for wired remote controller or indoor unit has a failure while no other problems are found, emergency operation will be available by setting the emergency operation switch (SWE) ON and short-circuiting the connector (CN31) on outdoor controller board.

●When following abnormalities occur, emergency operation will be available.

Check code	Inspected content
U4	Open/short of thermistor (TH3/TH6/TH7/TH8)
E8	Indoor/outdoor unit communication error •Signal receiving error (Outdoor unit)
E9	Indoor/outdoor unit communication error •Transmitting error (Indoor unit)
E0–E7	Communication error other than outdoor unit
Ed	Communication error between outdoor controller board and M-NET board (Serial communication error)

(2) Check the following items and cautions for emergency operation

① Make sure that there is no abnormality in outdoor unit other than the above abnormalities. (Emergency operation will not be available when check codes other than the above are indicated.)
② For emergency operation, it is necessary to set the emergency operation switch (SWE) on indoor controller board. Refer to the electrical wiring diagram of indoor unit for how to set the indoor unit.)
③ During emergency operation, the air-conditioner will continuously be operated by supplying power and stopping it. It can not be turned on or off by remote control, and temperature control is not possible.
④ Do not perform emergency heating operation for an extended period of time. If the outdoor unit starts defrosting during this period, cold air will blow out from the indoor unit.
⑤ Do not perform emergency cooling operation for more than 10 hours. Neglecting this could result in freezing the heat exchanger in indoor unit.

(3) Emergency operation procedure

① Turn the main power supply off.
② Turn on the emergency operation switch (SWE) on indoor controller board.
③ Set the shorting pins of emergency operation connector (CN31) on outdoor controller board to ON.
④ Use SW4-2 on outdoor controller board to set the operation mode (cooling or heating). (SW4-1 is not used.)
⑤ Turning the main power supply on will start the emergency operation.

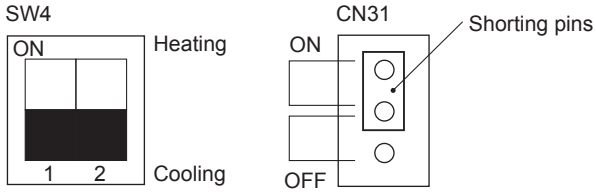

(4) Releasing emergency operation

① Turn the main power supply off.
② Set the emergency operation switch (SWE) on indoor controller board to OFF.
③ Set the shorting pins of emergency operation connector (CN31) on outdoor controller board to OFF.
④ Set SW4-2 on outdoor controller board as shown in the right.

Note: If shorting pins are not set on emergency operation connector (CN31), the setting remains OFF.



(5) Operation data during emergency operation

During emergency operation, no communication is performed with the indoor unit, so the data items needed for operation are set to the following values:

Operation data	Operation mode		Remarks
	COOL	HEAT	
Intake temperature (TH1)	81°F [27°C]	69°F [20.5°C]	
Indoor liquid temperature (TH2)	41°F [5°C]	113°F [45°C]	
Indoor 2-phase pipe temperature (TH5)	41°F [5°C]	122°F [50°C]	
Set temperature	77°F [25°C]	72°F [22°C]	
Outdoor liquid temperature (TH3)	113°F [45°C]	41°F [5°C]	*1
Outdoor 2-phase pipe temperature (TH6)	122°F [50°C]	41°F [5°C]	*1
Outdoor ambient temperature (TH7)	95°F [35°C]	45°F [7°C]	*1
Temperature difference code (intake temperature−set temperature) (Tj)	5	5	*1
Discharge superheat (SHd)	54°F [30°C]	54°F [30°C]	
Sub-cool (SC)	9°F [5°C]	9°F [5°C]	*2

*1 If the thermistor temperature data is normal (not open/short), that data is loaded into the control as valid data. If the unit enters emergency operation because TH values have become mismatched, setting the thermistors to open/short corrects the settings.

*2 If one thermistor is set to open/short, the values for each will be different.
[Example] When pipe temperature thermistor (TH3) has an open or short circuit.

Thermistor	COOL	HEAT
TH3	113°F [45°C]	41°F [5°C]
TH6	Ta	Tb
	Regard normal figure as effective data.	
TH4	Tc	Td
	Regard normal figure as effective data.	
TH5	41°F [5°C]	122°F [50°C]
TH2	41°F [5°C]	122°F [50°C]

Discharge superheat (SHd)
Cooling = TH4−TH6 = Tc−Ta
Heating = TH4− TH5 = Td−(122°F [50°C])

Degree of subcooling (SC)
Cooling = TH6−TH3 = Ta−(113°F[45°C])
Heating = TH5−TH2 = 122°F−113°F = 9°F
[50°C−45°C = 5°C]

10-9. TEST POINT DIAGRAM
Outdoor controller circuit board
TRUZH0241HA00NA

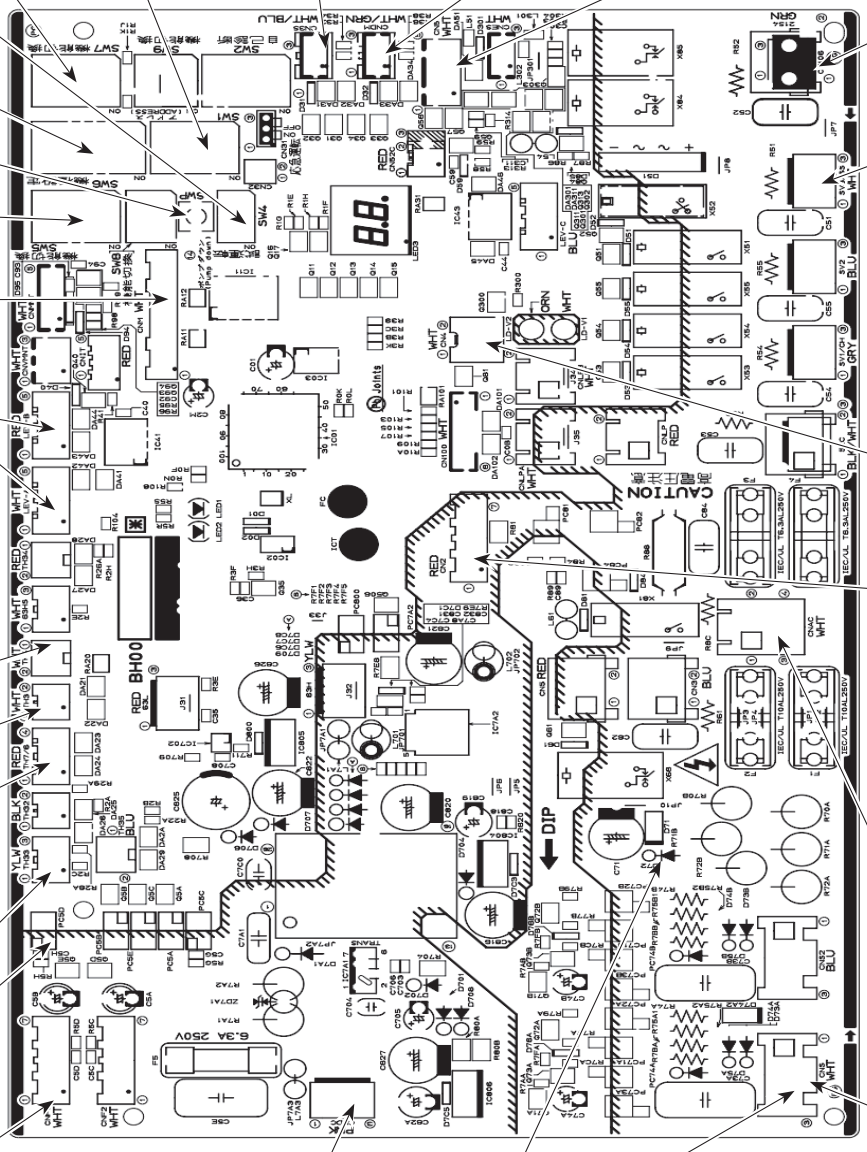

SW7
Demand control setting
Model select

SW1
Manual defrost, detect history record reset, refrigerant address

CN3S
Water heater

CNDM
① to ②: Input of low-level sound priority mode
① to ③: Input of external contact point

CN51
Water heater Comp protect

SW4
Test operation

SW6
Model select

SWP
Pump down

SW5
Function switch
Model select

CNM
Connect to A control service tool

LEV-A,B
Linear expansion valve

21S4
4-way valve

SV3
Solenoid valve

CN4
Transmission to outdoor power circuit board (CN4)

CN2
Connect to the outdoor power circuit board (CN2)
①–⑤: Reception from power circuit board
②–⑤: Zero cross signal (0–5 VDC)
③,④: Not used
⑥–⑤: 15 VDC
⑦–⑤: 15 VDC

TH4
Thermistor
<Discharge>

TH3
Thermistor
<Liquid>

TH7/6
Thermistor
<Outdoor/Outdoor 2-phase pipe>

TH33
Thermistor
<Comp. surface>

V_{FG}
(Voltage between right pins of PC5D, pin 3 and pin 4)
(Same as (CNF1⑦(+)–④(−))

CNAC
② to ④: Power supply for outdoor controller circuit board (230 VAC)
① to ③: Power supply for indoor and outdoor unit connection wire (230 VAC)

CNS
S1-S2: 230 VAC

CNF1
Connect to the fan motor
①-④: 250–380 VDC
⑤-④: 15 VDC
⑥-④: 0–6.5 VDC
⑦-④: 15 VDC (When stopped)
7.5 VDC (When operated, 0–15 V pulse)

CNDC
250–380 VDC
(①+, ③−)
Outdoor power circuit board

+ − (+: D72 Cathode, −: CNS-A 2pin)
Communication power supply
DC Voltage
24 VDC

Outdoor power circuit board
TRUZH0241HA00NA

Brief Check of POWER MODULE
If they are short-circuited, it means that they are broken.
Measure the resistance in the following points (connectors, etc.).
1. Check POWER MODULE
① Check of DIODE circuit
R – P1 S – P1 R – N1 S – N1
② Check of CONVERTER circuit
P2 – L1 P2 – L3 N2 – L1 N2 – L3
③ Check of INVERTER circuit
P3 – U , P3 – V , P3 – W , N3 – U , N3 – V , N3 – W
Note: The marks R , S , L1 , L3 , P1 , P2 , P3 , N1 , N2 , N3 , U , V and W show in the diagram are not actually printed on the board.

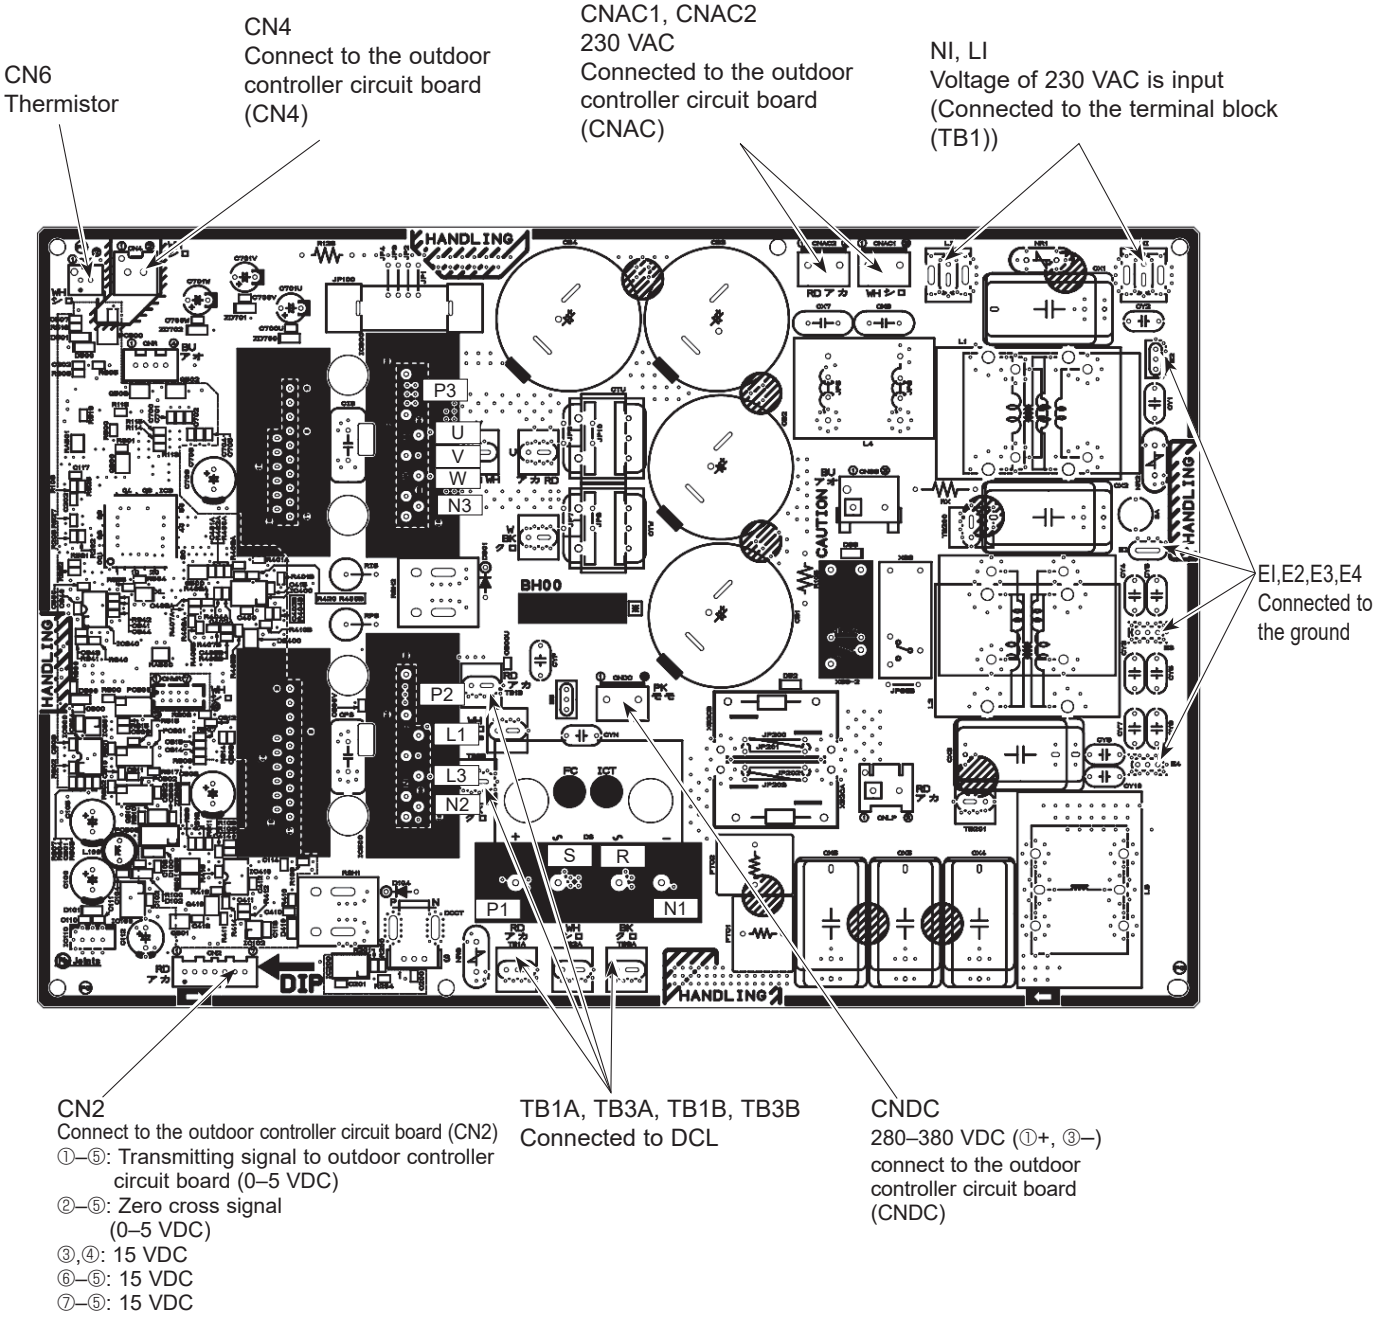

10-10. FUNCTION OF SWITCHES, CONNECTORS AND JUMPERS

(1) Function of switches

Type of switch	Switch	No.	Function	Action by the switch operation		Effective timing
				ON	OFF	
DIP switch	SW1	1	Manual defrost *1	Start	Normal	When compressor is working in heating operation.*1
		2	Abnormal history clear	Clear	Normal	off or operating
		3	Refrigerant address setting	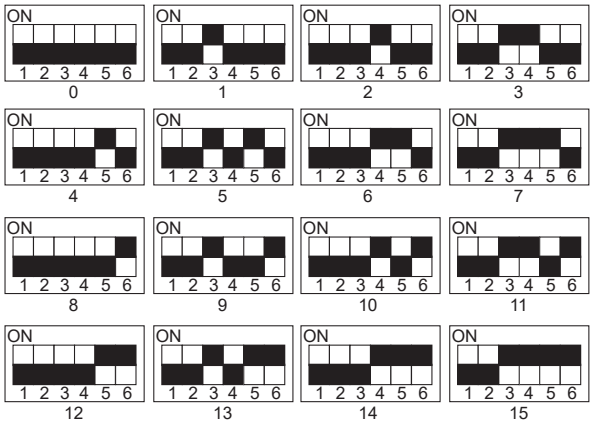		When power supply ON
		4				
		5				
		6				
	SW4	1	Test run	Operating	OFF	Under suspension
		2	Test run mode setting	Heating	Cooling	
	SW8	1	Use of existing pipe	Used	Not used	Always
		2	No function	—	—	—
		3	Separate indoor/outdoor unit power supplies	Used	Not used	When power supply ON
Push switch	SWP		Pump down	Start	Normal	Under suspension

*1 Manual defrost should be done as follows.

① Change the DIP SW1-1 on the outdoor controller board from OFF to ON.

② Manual defrost will start by the above operation ① if all these conditions written below are satisfied.

- Heat mode setting
- 10 minutes have passed since compressor started operating or previous manual defrost is finished.
- Pipe temperature is less than or equal to 46ºF [8ºC].

Manual defrost will finish if certain conditions are satisfied.

Manual defrost can be done if above conditions are satisfied when DIP SW1-1 is changed from OFF to ON.

After DIP SW1-1 is changed from OFF to ON, there is no problem if DIP SW1-1 is left ON or changed to OFF again.

This depends on the service conditions.

Continue to the next page.

Type of Switch	Switch	No.	Function	Action by the switch operation		Effective timing
				ON	OFF	
DIP switch	SW5	1	No function	—	—	—
		2	Power failure automatic recovery *2	Auto recovery	No auto recovery	When power supply ON
		3,4,5	No function	—	—	—
		6	Mode select	Following SW5-6 reference		
	SW7*4	1	Mode select *3	Demand function	Low noise mode	Always
		2	No function	—	—	—
		3	Max Hz setting (cooling)	Max Hz (cooling) × 0.8	Normal	Always
		4	Max Hz setting (heating)	Max Hz (heating) × 0.8	Normal	Always
		5	No function	—	—	—
		6	Defrost setting	For high humidity	Normal	Always
	SW9	1	No function	—	—	—
		2	Function switch	Valid	Normal	Always
		3, 4	No function	—	—	—
	SW6	1	No function	—	—	—
		2				
		3				
		4	Model select			
		5				
		6				
		7				
		8				
	SW5	6				

MODEL	SW6-4, 5, 6, 7, 8 *	SW5-5 *
TRUZH0241HA00NA	ON OFF 1 2 3 4 5 6 7 8	ON OFF 1 2 3 4 5 6

* SW6-1 to 3, SW5-1 to 4, 6: Function Switch

*2 “Power failure automatic recovery” can be set by either remote controller or this DIP SW. If one of them is set to ON, “Auto recovery” activates. Please set “Auto recovery” basically by remote controller because all units do not have DIP SW. Please refer to the indoor unit installation manual.

*3 SW7-1 is setting change over of Demand/Low noise. It is effective only in the case of external input. (Local wiring is necessary. Refer to the next page: Special function)

*4 Please do not use SW7-3 to 7-6 usually. Trouble might be caused by the usage condition.

(2) Function of connector

Types	Connector	Function	Action by open/ short operation		Effective timing
			Short	Open	
Connector	CN31	Emergency operation	Start	Normal	When power supply ON

Special function

(a) Low-level sound priority mode (Local wiring)

Unit enters into Low-level sound priority mode by external signal input setting.
Inputting external signals to the outdoor unit decreases the outdoor unit operation sound 3 to 4 dB lower than that of usual.
Adding a commercial timer or on-off switch contactor setting to the CNDM connector which is optional contactor for demand input located on the outdoor controller board enables to control compressor operation frequency.
Note: The performance depends on the load of conditioned outdoor temperature.

How to wire

<Low-level sound priority mode circuit>

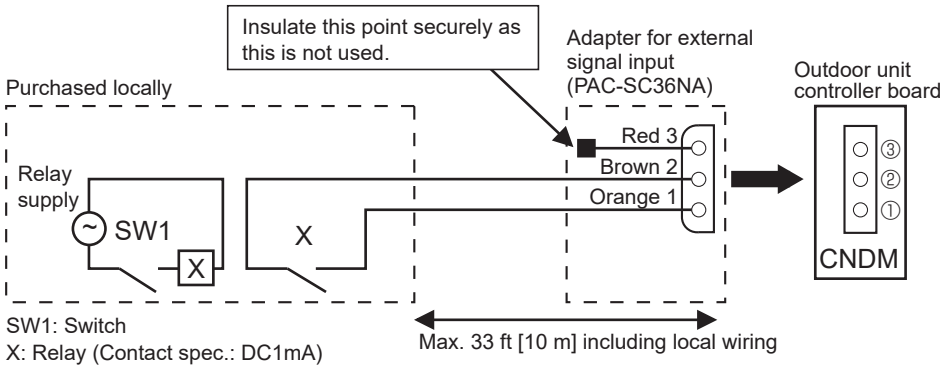

1) Make the circuit as shown above with adapter for external signal input (PAC-SC36NA).
2) Turn SW1 to on for Low-level sound priority mode.
   Turn SW1 to off to release Low-level sound priority mode and normal operation.

(b) On demand control (Local wiring)

By performing the following modification, energy consumption can be reduced to 0–100% of the normal consumption.
The demand function will be activated when a commercially available timer or the contact input of an ON/OFF switch is added to the CNDM connector (option) on the control board of the outdoor unit.

①Complete the circuit as shown when using the external input adapter (PAC-SC36NA-E). (Option)
②By setting SW7-1 on the control board of the outdoor unit, the energy consumption (compared to the normal consumption) can be limited as shown below.

	SW7-1	SW2	SW3	Energy consumption
Demand function	ON	OFF	OFF	100%
		ON	OFF	75%
		ON	ON	50%
		OFF	ON	0% (Stop)

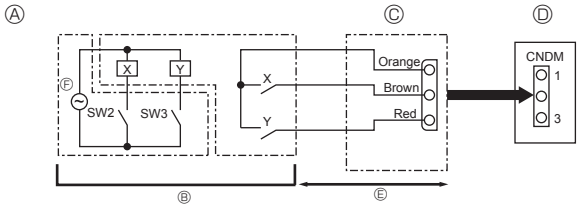

Ⓐ Circuit diagram example (Demand function)
Ⓑ On-site arrangement
X, Y: Relay

Ⓒ External input adapter (PAC-SC36NA-E)
Ⓓ Outdoor unit control board
Ⓔ Maximum 10 m
Ⓕ Power supply for relay

<Display function of inspection for outdoor unit>
The blinking patterns of both LED1 (green) and LED2 (red) indicate the types of abnormality when it occurs. Types of abnormality can be indicated in details by connecting an optional part “A-Control Service Tool (PAC-SK52ST)” to connector CNM on outdoor controller board.

[Display]
(1) Normal condition

Unit condition	Outdoor controller board		A-Control Service Tool	
	LED1 (Green)	LED2 (Red)	Check code	Indication of the display
When the power is turned on	Lit	Lit	—⇔—	Alternately blinking display
When unit stops	Lit	Not lit	00, etc.	Operation mode
When compressor is warming up	Lit	Not lit	08, etc.	
When unit operates	Lit	Lit	C5, H7, etc.	

(2) Abnormal condition

Indication		Error			
Outdoor controller board		Contents	Check code*1	Inspection method	Detailed reference page
LED (Green)	LED2 (Red)				
1 blinking	2 blinking	Connector (63H) is open.	F5	① Check if connector (63H) on the outdoor controller board is not disconnected. ② Check continuity of pressure switch (63H) by tester.	P.27
2 blinking	1 blinking	Miswiring of indoor/outdoor unit connecting wire, excessive number of indoor units (4 units or more)	—	① Check if indoor/outdoor connecting wire is connected correctly. ② Check if 4 or more indoor units are connected to outdoor unit. ③ Check if noise entered into indoor/outdoor connecting wire or power supply. ④ Re-check error by turning off power, and on again.	P.27 (EA)
		Miswiring of indoor/outdoor unit connecting wire (converse wiring or disconnection)	—		P.27 (Eb)
		Startup time over	—		P.27 (EC)
	2 blinking	Indoor/outdoor unit communication error signal receiving error) is detected by indoor unit.	E6	① Check if indoor/outdoor connecting wire is connected correctly. ② Check if noise entered into indoor/outdoor connecting wire or power supply. ③ Check if noise entered into indoor/outdoor controller board. ④ Re-check error by turning off power, and on again.	*2
		Indoor/outdoor unit communication error (transmitting error) is detected by indoor unit.	E7		*2
		Indoor/outdoor unit communication error (signal receiving error) is detected by outdoor unit.	—		P.33 (E8)
		Indoor/outdoor unit communication error (transmitting error) is detected by outdoor unit.	—		P.33 (E9)
	3 blinking	Remote controller signal receiving error is detected by remote controller.	E0	① Check if connecting wire of indoor unit or remote controller is connected correctly. ② Check if noise entered into transmission wire of remote controller. ③ Re-check error by turning off power, and on again.	P.32
		Remote controller transmitting error is detected by remote controller.	E3		P.32
		Remote controller signal receiving error is detected by indoor unit.	E4		P.32
		Remote controller transmitting error is detected by indoor unit.	E5		P.32
	4 blinking	Check code is not defined.	EF	① Check if remote controller is MA remote controller(PAR-21MAA). ② Check if noise entered into transmission wire of remote controller. ③ Check if noise entered into indoor/outdoor connecting wire. ④ Re-check error by turning off power, and on again.	P.33
			PL	① Be sure to replace the 4-way valve. ② Check refrigerant pipes for disconnection or leakage. ③ After the recovery of refrigerant, vacuum dry the whole refrigerant circuit. ④ Refer to “10-6. HOW TO CHECK THE PARTS”. ⑤ Check refrigerant circuit for operation.	P.34

*1 Check code displayed on remote controller
*2 Refer to the indoor unit service manual.

Continue to the next page.

Indication		Error			
Outdoor controller board		Contents	Check code*1	Inspection method	Detailed reference page
LED (Green)	LED2 (Red)				
2 blinking	5 blinking	Serial communication error <Communication between outdoor controller board and outdoor power board> <Communication between outdoor controller board and M-NET P.C. board>	Ed	① Check if connector (CN4) on outdoor controller board and outdoor power board is not disconnected. ② Check if there is poor connection of connector on outdoor controller board(CNMNT and CNVMNT). ③ Check M-NET communication signal.	P.33
		Communication error of M-NET system	A0–A8		P.34–P.36
3 blinking	1 blinking	Abnormality of shell thermistor (TH33) and discharging temperature (TH4)	U2	① Check if stop valves are open. ② Check if connectors (TH4, TH33, LEV-A, and LEV-B) on outdoor controller board are not disconnected. ③ Check if unit is filled with specified amount of refrigerant. ④ Measure resistance values among terminals on indoor valve and outdoor linear expansion valve using a tester.	P.28
	2 blinking	Abnormal high pressure (High pressure switch 63H operated.)	U1	① Check if indoor/outdoor units have a short cycle on their air ducts. ② Check if connector (63H) on outdoor controller board is not disconnected. ③ Check if heat exchanger and filter is not dirty. ④ Measure resistance values among terminals on linear expansion valve using a tester.	P.28
	3 blinking	Abnormality of outdoor fan motor rotational speed	U8	① Check the outdoor fan motor.	P.29
	4 blinking	Compressor overcurrent breaking (Startup locked)	UF	① Check if stop valves are open. ② Check looseness, disconnection, and converse connection of compressor wiring. ③ Measure resistance values among terminals on compressor using a tester. ④ Check if outdoor unit has a short cycle on its air duct.	P.31
		Compressor overcurrent breaking	UP		P.31
		Abnormality of current sensor (P.B.)	UH		P.31
		Abnormality of power module	U6		P.29
	5 blinking	Open/short of discharge thermistor (TH4)	U3	① Check if connectors (TH3, TH4, TH6 and TH7) on outdoor controller board and connector (CN6) on outdoor power board are not disconnected. ② Measure resistance value of outdoor thermistors	P.29
		Open/short of outdoor thermistors (TH3, TH6, TH7, and TH8)	U4		P.29
	6 blinking	Abnormality of Heat sink temperature	U5	① Check if indoor/outdoor units have a short cycle on their air ducts. ② Measure resistance value of outdoor Heat sink thermistor(TH8).	P.29
	7 blinking	Abnormality of voltage	U9	① Check looseness, disconnection, and converse connection of compressor wiring. ② Measure resistance value among terminals on compressor using a tester. ③ Check if power supply voltage decreases. ④ Check the wiring of CN2.	P.30
4 blinking	1 blinking	Abnormality of room temperature thermistor (TH1)	P1	① Check if connectors (CN20, CN21, CN29, and CN44) on indoor controller board are not disconnected. ② Measure resistance value of indoor thermistors.	*2
		Abnormality of pipe temperature thermistor/Liquid (TH2)	P2		*2
		Abnormality of pipe temperature thermistor/Condenser-Evaporator (TH5)	P9		*2
	2 blinking	Abnormality of drain sensor (DS) Float switch connector open(FS)	P4	① Check if connector (CN31)(CN4F) on indoor controller board is not disconnected. ② Measure resistance value of indoor thermistors.	*2
		Indoor drain overflow protection	P5	③ Measure resistance value among terminals on drain pump using a tester. ④ Check if drain pump works. ⑤ Check drain function.	*2
	3 blinking	Freezing (cooling)/overheating (heating) protection	P6	① Check if indoor unit has a short cycle on its air duct. ② Check if heat exchanger and filter is not dirty. ③ Measure resistance value on indoor and outdoor fan motors. ④ Check if the inside of refrigerant piping is not clogged.	*2
	4 blinking	Abnormality of pipe temperature	P8	① Check if indoor thermistors (TH2 and TH5) are not disconnected from holder. ② Check if stop valve is open. ③ Check converse connection of extension pipe. (on plural units connection) ④ Check if indoor/outdoor connecting wire is connected correctly. (on plural units connection)	*2
	5 blinking	Abnormality of indoor controller board	Fb	① Replace indoor controller board.	*2
		Inndoor fan motor trouble	Pb	① Check the winding of an indoor unit fan motor.	*2
—	—	Abnormality of remote controller board	E1 E2	① Replace remote controller.	P.32

*1 Check code displayed on remote controller
*2 Refer to the indoor unit service manual.

<Outdoor unit operation monitor function>
[When optional part "A-Control Service Tool(PAC-SK52ST)" is connected to outdoor controller board(CNM)]
Digital indicator LED1 displays 2 digit number or code to inform operation condition and the meaning of check code by controlling DIP SW2 on "A-Control Service Tool".

Operation indicator SW2: Indicator change of self-diagnosis

SW2 setting	Display detail	Explanation for display	Unit
ON 1 2 3 4 5 6			

<Digital indicator LED1 working details>
(Be sure that 1 to 6 in the SW2 are set to OFF.)

(1) Display when the power supply ON
When the power supply ON, blinking displays by turns.
Wait for 4 minutes at the longest.

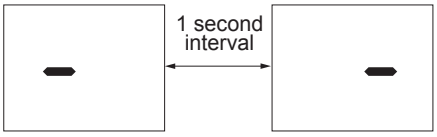

(2) When the display lights (Normal operation)
①Operation mode display

LED1



(Lighting)

SW2



(Initial setting)

The tens digit: Operation mode

Display	Operation Model
O	OFF/FAN
C	COOLING/DRY
H	HEATING
d	DEFROSTING

②Display during error postponement
Postponement code is displayed when compressor stops due to the work of protection device.
Postponement code is displayed while error is being postponed.

The ones digit: Relay output

Display	Warming-up Compressor	Compressor	4-way valve	Solenoid valve
0	—	—	—	—
1	—	—	—	ON
2	—	—	ON	—
3	—	—	ON	ON
4	—	ON	—	—
5	—	ON	—	ON
6	—	ON	ON	—
7	—	ON	ON	ON
8	ON	—	—	—
A	ON	—	ON	—

(3) When the display blinks
Inspection code is displayed when compressor stops due to the work of protection devices.

Display	Contents to be inspected (During operation)
U1	Abnormal high pressure (63H worked)
U2	Abnormal high discharging temperature, shortage of refrigerant
U3	Open/short circuit of discharging thermistor (TH4)
U4	Open/short of outdoor unit thermistors (TH3, TH6, TH7 and TH8)
U5	Abnormal temperature of heatsink
U6	Abnormality of power module
U7	Abnormality of superheat due to low discharge temperature
U8	Abnormality in outdoor fan motor
Ud	Overheat protection
UF	Compressor overcurrent interruption (When Comp. locked)
UH	Current sensor error
UL	Abnormal low pressure(63L worked)
UP	Compressor overcurrent interruption
P1–P8	Abnormality of indoor units
A0–A7	Communication error of M-NET system

Display	Inspection unit
0	Outdoor unit
1	Indoor unit 1
2	Indoor unit 2

Display	Contents to be inspected (When power is turned on)
F3	63L connector (red) is open.
F5	63H connector (yellow) is open.
F9	2 connectors (63H/63L) are open.
E8	Indoor/outdoor communication error (Signal receiving error) (Outdoor unit)
E9	Indoor/outdoor communication error (Transmitting error) (Outdoor unit)
EA	Miswiring of indoor/outdoor unit connecting wire, excessive number of indoor units (4 units or more)
Eb	Miswiring of indoor/outdoor unit connecting wire (reversed wiring or disconnection)
EC	Startup time over
E0–E7	Communication error except for outdoor unit

SW2 setting	Display detail	Explanation for display	Unit
ON 1 2 3 4 5 6	Pipe temperature/Liquid (TH3) −40–194	−40–194 (−40–90°C) (When the coil thermistor detects 0˚F or below, "–" and temperature are displayed by turns.) (Example) When −10˚F; 0.5 s 0.5 s 2 s -□ →10 →□□	°F [°C]
ON 1 2 3 4 5 6	Discharge temperature (TH4) 37–327	37–327 (3–164°C) (When the discharge thermistor detects 100˚F or more, hundreds digit, tens digit and ones digit are displayed by turns.) (Example) When 105˚F; 0.5 s 0.5 s 2 s □1 →05 →□□	°F [°C]
ON 1 2 3 4 5 6	Output step of outdoor FAN 0–10	0–10	Step
ON 1 2 3 4 5 6	The number of ON/OFF times of compressor 0–9999	0–9999 (When the number of times is 100 or more, hundreds digit, tens digit and ones digit are displayed by turns.) (Example) When 42500 times (425 ×100 times); 0.5 s 0.5 s 2 s □4 →25 →□□	100 times
ON 1 2 3 4 5 6	Compressor integrating operation times 0–9999	0–9999 (When it is 100 hours or more, hundreds digit, tens digit and ones digit are displayed by turns.) (Example) When 2450 hours (245 ×10 hours); 0.5 s 0.5 s 2 s □4 →25 →□□	10 hours
ON 1 2 3 4 5 6	Compressor operating current 0–50	0–50 Note: Omit the figures after the decimal fractions.	A
ON 1 2 3 4 5 6	Compressor operating frequency 0–255	0–255 (When it is 100 Hz or more, hundreds digit, tens digit and ones digit are displayed by turns. (Example) When 125 Hz; 0.5 s 0.5 s 2 s □1 →25 →□□	Hz
ON 1 2 3 4 5 6	LEV-A opening pulse 0–480	0–480 (When it is 100 pulse or more, hundreds digit, tens digit and ones digit are displayed by turns. (Example) When 150 pulse; 0.5 s 0.5 s 2 s □1 →50 →□□	Pulse
ON 1 2 3 4 5 6	Error postponement code history (1) of outdoor unit	Postponement code display Blinking: During postponement Lighting: Cancellation of postponement "00" is displayed in the case of no postponement.	Code display
ON 1 2 3 4 5 6	Operation mode on error occurring	Operation mode of when operation stops due to error is displayed by setting SW2 like below. (SW2) ON 1 2 3 4 5 6	Code display

SW2 setting	Display detail	Explanation for display	Unit
	Pipe temperature/Liquid (TH3) on error occurring −40–194	−40–194 (–40–90°C) (When the coil thermistor detects 0˚F or below, “–” and temperature are displayed by turns.) (Example) When –15˚F; 0.5 s 0.5 s 2 s -□ →15 →□□	°F [°C]
	Compressor temperature (TH4) or discharge temperature (TH4) on error occurring 37–327	37–327 (3–164°C) (When the temperature is 100˚F or more, the hundreds digit, tens digit and ones digit are displayed by turns.) (Example) When 130˚F; 0.5 s 0.5 s 2 s □1 →30 →□□	°F [°C]
	Compressor operating current on error occurring 0–50	0–50	A
	Error history (1) (latest) Alternate display of abnormal unit number and code	When no error history, “ 0 ” and “– –” are displayed by turns.	Code display
	Error history (2) Alternate display of error unit number and code	When no error history, “ 0 ” and “– –” are displayed by turns.	Code display
	Thermostat ON time 0–999	0–999 (When it is 100 minutes or more, the hundreds digit, tens digit and ones digit are displayed by turns.) (Example) When 245 minutes; 0.5 s 0.5 s 2 s □2 →45 →□□	Minute
	Test run elapsed time 0–120	0–120 (When it is 100 minutes or more, the hundreds digit, tens digit and ones digit are displayed by turns.) (Example) When 105 minutes; 0.5 s 0.5 s 2 s □1 →05 →□□	Minute

<table>
<tr><th>SW2 setting</th><th>Display detail</th><th>Explanation for display</th><th>Unit</th></tr>
<tr><td> 
</td><td>The number of connected indoor units</td><td>0–3
(The number of connected indoor units are displayed.)</td><td>Unit</td></tr>
<tr><td> 
</td><td>Capacity setting display</td><td>Displayed as an outdoor capacity code
<table><tr><th>Capacity</th><th>Code</th></tr><tr><td>TRUZH0241HA00NA</td><td>11</td></tr></table></td><td>Code display</td></tr>
<tr><td> 
</td><td>Outdoor unit setting information</td><td>• The tens digit (Total display for applied setting)
<table><tr><th>Setting details</th><th>Display details</th></tr><tr><td>H·P/Cooling only</td><td>0: H·P 1: Cooling only</td></tr><tr><td>Single phase/3 phase</td><td>0: Single phase 2: 3 phase</td></tr></table>• The ones digit
<table><tr><th>Setting details</th><th>Display details</th></tr><tr><td>Defrosting switch</td><td>0: Normal 1: For high humidity</td></tr></table>(Example) When heat pump, 3 phase and defrosting (normal) are set up, “20” is displayed.</td><td>Code display</td></tr>
<tr><td> 
</td><td>Indoor pipe temperature/Liquid (TH2(1))
Indoor 1
−38–190</td><td>−38–190 (−39–88°C)
(When the temperature is 0ºF or less, “–” and temperature are displayed by turns.)</td><td>°F
[°C]</td></tr>
<tr><td> 
</td><td>Indoor pipe temperature/Cond./Eva.
(TH5(1))
Indoor 1
−38–190</td><td>−38–190 (−39–88°C)
(When the temperature is 0˚F or less, “–” and temperature are displayed by turns.)</td><td>°F
[°C]</td></tr>
<tr><td> 
</td><td>Indoor pipe temperature/Liquid (TH2(2))
Indoor 2
−38–190</td><td>−38–190 (−39–88°C)
(When the temperature is 0˚F or less, “–” and temperature are displayed by turns.)</td><td>°F
[°C]</td></tr>
<tr><td> 
</td><td>Indoor pipe temperature/Cond./Eva.
(TH5(2))
Indoor 2
−38–190</td><td>−38–190 (−39–88°C)
(When the temperature is 0˚F or less, “–” and temperature are displayed by turns.)</td><td>°F
[°C]</td></tr>
<tr><td> 
</td><td>Indoor room temperature (TH1)
46–102</td><td>46–102 (8–39°C)</td><td>°F
[°C]</td></tr>
</table>

SW2 setting	Display detail	Explanation for display	Unit
ON 1 2 3 4 5 6	Indoor setting temperature 62–86	62–86 (17–30°C)	°F [°C]
ON 1 2 3 4 5 6	Outdoor pipe temperature/2-phase (TH6) −38–190	−38–190 (−39–88°C) (When the temperature is 0˚F or less, “–” and temperature are displayed by turns.)	°F [°C]
ON 1 2 3 4 5 6	Outdoor ambient temperature (TH7) −38–190	−38–190 (−39–88°C) (When the temperature is 0˚F or less, “–” and temperature are displayed by turns.)	°F [°C]
ON 1 2 3 4 5 6	Outdoor heat sink temperature (TH8) −40–327	−40–327 (−40–164°C) (When the temperature is 0˚F or less, “–” and temperature are displayed by turns.) (When the thermistor detects 100˚F or more, hundreds digit, tens digit and ones digit are displayed by turns.)	°F [°C]
ON 1 2 3 4 5 6	Discharge superheat. SHd 0–327 [Cooling = TH4−TH6 Heating = TH4−TH5]	0–327 (0–182°C) (When the temperature is 100˚F or more, hundreds digit, tens digit and ones digit are displayed by turns.)	°F [°C]
ON 1 2 3 4 5 6	Sub cool. SC 0–234 [Cooling = TH6-TH3 Heating = TH5-TH2]	0–234 (0–130°C) (When the temperature is 100˚F or more, hundreds digit, tens digit and ones digit are displayed by turns.)	°F [°C]
ON 1 2 3 4 5 6	Input current of outdoor unit	0–500 (When it is 100 or more, hundreds digit, tens digit and ones digit are displayed by turns.)	0.1 A
ON 1 2 3 4 5 6	U9 error detail history (latest)	Error details / Code Normal: 00 Overvoltage error: 01 Undervoltage error: 02 Input current sensor error: 04 Abnormal power synchronous signal: 08 PFC error (Overvoltage/Undervoltage/Overcurrent): 10 Display examples for multiple errors: Overvoltage (01) + Undervoltage (02) = 03 Undervoltage (02) + Power-sync signal error (08) = 0A L_1-phase open error (04) + PFC error (10) = 14	Code display
ON 1 2 3 4 5 6	DC bus voltage 180–760	180–760 (When it is 100V or more, hundreds digit, tens digit and ones digit are displayed by turns.)	V

SW2 setting	Display detail	Explanation for display	Unit
ON 1 2 3 4 5 6	Capacity save 0–100 When air conditioner is connected to M-NET and capacity save mode is demanded, a value from “0” to “100” is displayed. [When there is no setting of capacity save “100” is displayed.]	0–100 (When the capacity is 100%, hundreds digit, tens digit and ones digit are displayed by turns.) (Example) When 100%; 0.5 s 0.5 s 2 s □1 →00 →□□	%
ON 1 2 3 4 5 6	Error postponement code history (2) of outdoor unit	Postponement code display Blinking: During postponement Lighting: Cancellation of postponement “00” is displayed in the case of no postponement.	Code display
ON 1 2 3 4 5 6	Error postponement code history (3) of outdoor unit	Postponement code display Blinking: During postponement Lighting: Cancellation of postponement “00” is displayed in the case of no postponement.	Code display
ON 1 2 3 4 5 6	Error history (3) (Oldest) Alternate display of abnormal unit number and code.	When no error history, “0” and “– –“ are displayed by turns.	Code display
ON 1 2 3 4 5 6	Error thermistor display [When there is no error thermistor, “–“ is displayed.]	3: Outdoor pipe temperature/Liquid (TH3) 6: Outdoor pipe temperature/2-phase (TH6) 7: Outdoor ambient temperature (TH7) 8: Outdoor heat sink (TH8)	Code display
ON 1 2 3 4 5 6	Operation frequency on error occurring 0–255	0–255 (When it is 100 Hz or more, hundreds digit, tens digit and ones digit are displayed by turns.) (Example) When 125 Hz; 0.5 s 0.5 s 2 s □1 →25 →□□	Hz
ON 1 2 3 4 5 6	Fan step on error occurring 0–10	0–10	Step

SW2 setting	Display detail	Explanation for display	Unit
	LEV-A opening pulse on error occurring 0–480	0–480 (When it is 100 pulse or more, hundreds digit, tens digit and ones digit are displayed by turns.) (Example) When 130 pulse; 0.5 s 0.5 s 2 s □1 →30 →□□	Pulse
	Indoor room temperature (TH1) on error occurring 46–102	46–102 (8–39°C)	°F [°C]
	Indoor pipe temperature/Liquid (TH2) on error occurring −38–190	−38–190 (−39–88°C) (When the temperature is 0˚F or less, "–" and temperature are displayed by turns.) (Example) When −15˚F; 0.5 s 0.5 s 2 s □1 →05 →□□	°F [°C]
	Indoor pipe temperature/Cond./Eva. (TH5) on error occurring −38–190	−38–190 (−39–88°C) (When the temperature is 0˚F or less, "–" and temperature are displayed by turns.) (Example) When –15˚F; 0.5 s 0.5 s 2 s □1 →05 →□□	°F [°C]
	Outdoor pipe temperature/2-phase (TH6) on error occurring −38–190	−38–190 (−39–88°C) (When the temperature is 0˚F or less, "–" and temperature are displayed by turns.) (Example) When –15˚F; 0.5 s 0.5 s 2 s □1 →05 →□□	°F [°C]
	Outdoor ambient temperature (TH7) on error occurring −38–190	−38–190 (−39–88°C) (When the temperature is 0˚F or less, "–" and temperature are displayed by turns.) (Example) When –15˚F; 0.5 s 0.5 s 2 s □1 →05 →□□	°F [°C]
	Outdoor heat sink temperature (TH8) on error occurring −40–392	−40–392 (−40–200°C) (When the temperature is 0˚F or less, "–" and temperature are displayed by turns.) (When the temperature is 100˚F or more, hundreds digit, tens digit and ones digit are displayed by turns.)	°F [°C]

<table>
<tr><th>SW2 setting</th><th>Display detail</th><th>Explanation for display</th><th>Unit</th></tr>
<tr><td> 
</td><td>Discharge superheat on error occurring
SHd
0–327

[Cooling = TH4−TH6
Heating = TH4−TH5]</td><td>0–327 (0–182°C)
(When the temperature is 100˚F or more, hundreds digit, tens digit and ones digit are displayed by turns.)
(Example) When 150°F;
0.5 s 0.5 s 2 s
□1 →50 →□□</td><td>°F
[°C]</td></tr>
<tr><td> 
</td><td>Sub cool on error occurring. SC
0–234

[Cooling = TH6−TH3
Heating = TH5−TH2]</td><td>0–234 (0–130°C)
(When the temperature is 100˚F or more, hundreds digit, tens digit and ones digit are displayed by turns.)
(Example) When 115°F;
0.5 s 0.5 s 2 s
□1 →15 →□□</td><td>°F
[°C]</td></tr>
<tr><td> 
</td><td>Thermo-ON time until error stops
0–999</td><td>0–999
(When it is 100 minutes or more, hundreds digit, tens digit and ones digit are displayed by turns.)
(Example) When 415 minutes;
0.5 s 0.5 s 2 s
□4 →15 →□□</td><td>Minute</td></tr>
<tr><td> 
</td><td>U9 Error details (To be shown while error call is deferred.)</td><td><table><tr><th>Error details</th><th>Code</th></tr><tr><td>Normal</td><td>00</td></tr><tr><td>Overvoltage error</td><td>01</td></tr><tr><td>Undervoltage error</td><td>02</td></tr><tr><td>Input current sensor error</td><td>04</td></tr><tr><td>Abnormal power synchronous signal</td><td>08</td></tr><tr><td>PFC error
(Overvoltage/Undervoltage/Overcurrent)</td><td>10</td></tr></table>
Display examples for multiple errors:
Overvoltage (01) + Undervoltage (02) = 03
Undervoltage (02) + Power-sync signal error (08) = 0A
L_1-phase open error (04) + PFC error (10) = 14</td><td></td></tr>
<tr><td> 
</td><td>LEV-B opening pulse
0–480</td><td>0–480
(When it is 100 pulse or more, hundreds digit, tens digit and ones digit are displayed by turns.)</td><td>Pulse</td></tr>
<tr><td> 
</td><td>Comp. surface temperature (TH33)
−4–422</td><td>−4–422 (−20–217°C)
(When the comp. surface thermistor detects 100˚F or more, hundreds digit, tens digit and ones digit are displayed by turns.)
(Example) When 105°C;
0.5 s 0.5 s 2 s
□1 →05 →□□</td><td>°F
[°C]</td></tr>
</table>

<table>
<tr><th>SW2 setting</th><th>Display detail</th><th>Explanation for display</th><th>Unit</th></tr>
<tr>
<td> 
</td>
<td>Controlling status of compressor operating frequency</td>
<td>The following code will be a help to know the operating status of unit.

•The tens digit
<table>
<tr><th>Display</th><th>Compressor operating frequency control</th></tr>
<tr><td>1</td><td>Primary current control</td></tr>
<tr><td>2</td><td>Secondary current control</td></tr>
</table>

•The ones digit (In this digit, the total number of activated control is displayed.)
<table>
<tr><th>Display</th><th>Compressor operating frequency control</th></tr>
<tr><td>1</td><td>Preventive control for excessive temperature rise of discharge temperature</td></tr>
<tr><td>2</td><td>Preventive control for excessive temperature rise of condensing temperature</td></tr>
<tr><td>4</td><td>Frosting preventing control</td></tr>
<tr><td>8</td><td>Preventive control for excessive temperature rise of heat sink</td></tr>
</table>

(Example)
The following controls are activated.
• Primary current control
• Preventive control for excessive temperature rise of condensing temperature
• Preventive control for excessive temperature rise of heat sink
LED
</td>
<td>Code display</td>
</tr>
</table>

11 EASY MAINTENANCE FUNCTION

11-1. SMOOTH MAINTENANCE

Maintenance data, such as the indoor/outdoor unit's heat exchanger temperature and compressor operation current can be displayed with "Smooth maintenance".

This cannot be executed during test operation.
Depending on the combination with the outdoor unit, this may not be supported by some models.

① Select "Service" from the Main menu, and press the [SELECT] button.

Select "Check" with the F1 or F2 button, and press the [SELECT] button.

Select "Smooth maintenance" with the F1 or F2 button, and press the [SELECT] button.

PAR-4xMAA



PAR-3xMAA





---

② Set each item.

Select the item to be changed with the F1 or F2 button.

Select the required setting with the F3 or F4 button.

■<Ref.address>setting [0] – [15]
■<Stable mode>setting [Cool] / [Heat] / [Normal]

Press the [SELECT] button, Fixed operation will start.

Note: Stable mode will take approx. 20 minutes.

PAR-4x/3xMAA

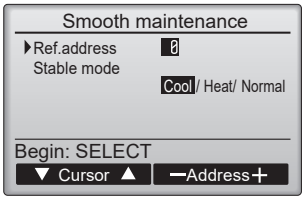

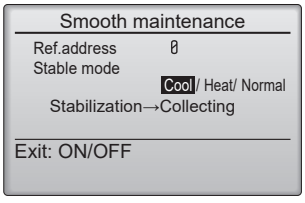

---

③ The operation data will appear.

The Compressor-Accumulated operating (COMP. run) time is 10-hour unit, and the Compressor-Number of operation times (COMP. ON/OFF) is a 100-time unit (fractions discarded).

PAR-4x/3xMAA

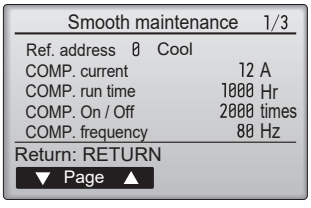

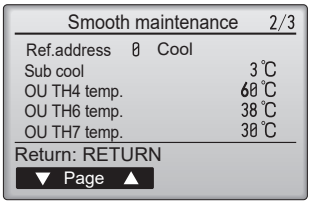

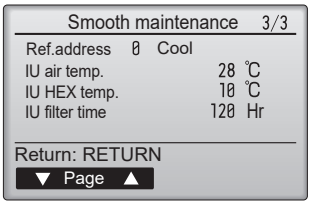

Navigating through the screens
- To go back to the Service menu ..... [MENU] button
- To return to the previous screen ..... [RETURN] button

11-2. GUIDE FOR OPERATION CONDITION

Check Points

Enter the temperature differences between ⑤, ④, ⑦ and ⑧ into the graph given below.
Operation state is determined according to the plotted areas on the graph.
For data measurements, set the fan speed to "Hi" before activating maintenance mode.

Inspection item				Result	
Power supply	Loose connection	Terminal block	Breaker	Good	Retightened
			Outdoor Unit	Good	Retightened
			Indoor Unit	Good	Retightened
		(Insulation resistance)			MΩ
		(Voltage)			V
Compressor		① Accumulated operating time			Time
		② Number of ON/OFF times			Times
		③ Current			A
Outdoor Unit	Temperature	④ Refrigerant/heat exchanger temperature		COOL °F	HEAT °F
		⑤ Refrigerant/discharge temperature		COOL °F	HEAT °F
		⑥ Air/outside air temperature		COOL °F	HEAT °F
		(Air/discharge temperature)		COOL °F	HEAT °F
	Cleanliness	Appearance		Good	Cleaning required
		Heat exchanger		Good	Cleaning required
		Sound/vibration		None	Present
Indoor Unit	Temperature	⑦ Air/intake air temperature		COOL °F	HEAT °F
		(Air/discharge temperature)		COOL °F	HEAT °F
		⑧ Refrigerant/heat exchanger temperature		COOL °F	HEAT °F
		⑨ Filter operating time *1			Time
	Cleanliness	Decorative panel		Good	Cleaning required
		Filter		Good	Cleaning required
		Fan		Good	Cleaning required
		Heat exchanger		Good	Cleaning required
		Sound/vibration		None	Present

*1 The filter operating time is the time that has elapsed since the filter was reset.

Classification		Item	Result	
Cool	Inspection	Is "000" displayed stably in Display Ⓓ on the remote controller?	Stable	Unstable
	Temperature difference	(⑤ Discharge temperature) – (④ Outdoor heat exchanger temperature)	°F	
		(⑦ Indoor intake air temperature) – (⑧ Indoor heat exchanger temperature)	°F	
Heat	Inspection	Is "000" displayed stably in Display Ⓓ on the remote controller?	Stable	Unstable
	Temperature difference	(⑤ Discharge temperature) – (⑧ Indoor heat exchanger temperature)	°F	
		(⑧ Indoor heat exchanger temperature) – (⑦ Indoor intake air temperature)	°F	

Notes:
1. Fixed Hz operation may not be possible under the following temperature ranges.
   A) In cool mode, outdoor intake air temperature is 104°F or higher or indoor intake air temperature is 73°F or lower.
   B) In heat mode, outdoor intake air temperature is 68 °F or higher or indoor intake air temperature is 77 °F or lower.
2. If the air conditioner is operated at a temperature range other than the ones above but operation is not stabilized after 30 minutes or more have elapsed, carry out inspection.
3. In heat mode, the operation state may vary due to frost forming on the outdoor heat exchanger.

Cool mode

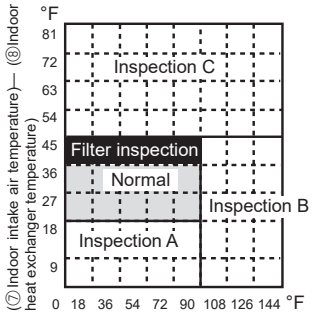

[⑤ Discharge temperature] – [④ Outdoor heat exchanger temperature)

Heat mode

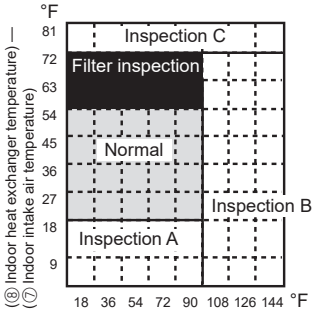

[⑤ Discharge temperature] – [⑧ Indoor heat exchanger temperature)

Result

Area	Check item	Judgment	
		Cool	Heat
Normal	Normal operation state		
Filter inspection	Filter may be clogged. *2		
Inspection A	Performance has dropped. Detailed inspection is necessary.		
Inspection B	Refrigerant amount is dropping.		
Inspection C	Filter or indoor heat exchanger may be clogged.		

Note: The above judgment is just guide based on Japanese standard conditions.
It may be changed depending on the indoor and outdoor temperature.

*2 It may be judged as "filter inspection" due to the outdoor and indoor temperature, even though it is not clogged.

12 FUNCTION SETTING

12-1. UNIT FUNCTION SETTING BY THE REMOTE CONTROLLER

Each function can be set as necessary using the remote controller. The setting of function for each unit can only be done by the remote controller. Select function available from the table 1.

(1) Functions available when setting the unit number to 00 (Select 00 referring to ④ setting the indoor unit number.)

<Table 1> Function selections

Function	Settings	Mode No. Wired remote controller (RF thermostat)	Setting No.	●: Initial setting (when sent from the factory)	Remarks
Power failure automatic recovery	Not available	01 (101)	1		The setting is applied to all the units in the same refrigerant system.
	Available		2	●	
Indoor temperature detection	Average data from each indoor unit	02 (–)	1	●	
	Data from the indoor unit with remote controllers		2		
	Data from main remote controller		3		
LOSSNAY connectivity	Not supported	03 (103)	1	●	
	Supported (indoor unit dose not intake outdoor air through LOSSNAY)		2		
	Supported (indoor unit intakes outdoor air through LOSSNAY)		3		
Power supply voltage	230 V	04 (104)	1	●	
	208 V		2		
Frost prevention temperature	36°F [2°C] (Normal)	15 (115)	1	●	
	37°F [3°C]		2		
Humidifier control	When the compressor operates, the humidifier also operates.	16 (116)	1	●	
	When the fan operates, the humidifier also operates.		2		
Change of defrosting control	Standard	17 (117)	1	●	
	For high humidity		2		

Meaning of "Function setting"

mode02: indoor temperature detecting

No.	Indoor temperature(ta)=					
No.1	Average data of the sensor on all the indoor units	Initial setting	ta=(A+B)/2	ta=(A+B)/2	ta=A	ta=A
No.2	Data of the sensor on the indoor unit that connected with remote controller	Initial setting	ta=A	ta=B	ta=A	ta=A
No.3	Data of the sensor on main remote controller	Initial setting	ta=C	ta=C	ta=C	ta=C

12-1-1. Selecting functions using the wired remote controller

<Service menu>

Maintenance password is required

① Select "Service" from the Main menu, and press the [SELECT] button.

*At the main display, the menu button and select "Service" to make the maintenance setting.





② When the Service menu is selected, a window will appear asking for the password.

To enter the current maintenance password (4 numerical digits), move the cursor to the digit you want to change with the F1 or F2 button.

Set each number (0 through 9) with the F3 or F4 button.

Then, press the [SELECT] button.

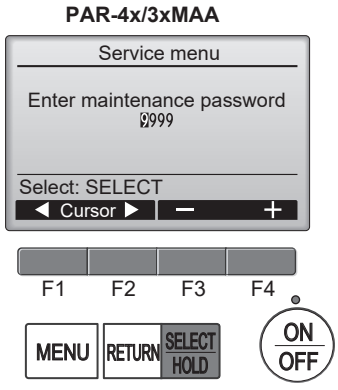

Note: The initial maintenance password is "9999". Change the default password as necessary to prevent unauthorized access. Have the password available for those who need it.

: If you forget your maintenance password, you can initialize the password to the default password "9999" by pressing and holding the F1 button for 10 seconds (PAR-4xMAA) or F1 and F2 buttons simultaneously for 3 seconds (PAR-3xMAA) on the maintenance password setting screen.

③ If the password matches, the Service menu will appear.

The type of menu that appears depends on the connected indoor units' type.







Note: Air conditioning units may need to be stopped to make certain settings. There may be some settings that cannot be made when the system is centrally controlled. (As for PAR-4xMAA, the units need to be stopped only at "Settings".)

A screen will appear that indicates the setting has been saved.



Navigating through the screens

- To go back to the Service menu ..... [MENU] button
- To return to the previous screen..... [RETURN] button

<Function setting>

<PAR-4xMAA>

① Select "Service" from the Main menu, and press the [SELECT] button.

Select "Setting" from the Service menu, and press the [SELECT] button.

Select "Function setting", and press the [SELECT] button.

PAR-4xMAA



PAR-3xMAA



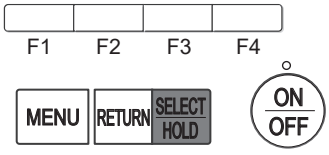

<PAR-3xMAA>

① Select "Service" from the Main menu, and press the [✓] button.

Select "Function setting" with the F1 or F2 button, and press the [✓] button.

② Set the indoor unit refrigerant addresses and unit numbers with the F1 through F4 buttons, and then press the [SELECT] button to confirm the current setting.

Note: Checking the indoor unit No.
When the [SELECT] button is pressed, the target indoor unit will start fan operation. If the unit is common or when running all units, all indoor units for the selected refrigerant address will start fan operation.

PAR-4x/3xMAA

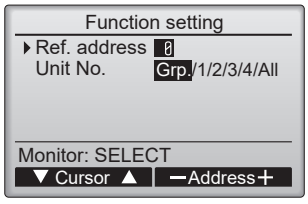

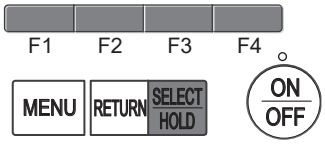

③ When data collection from the indoor units is completed, the current settings appears highlighted.
Non-highlighted items indicate that no function settings are made.
Screen appearance varies depending on the "Unit No." setting.

PAR-4x/3xMAA

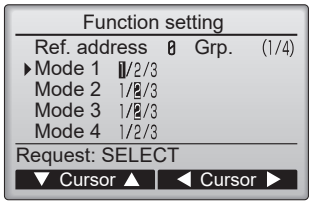

④ Use the F1 or F2 button to move the cursor to select the mode number, and change the setting number with the F3 or F4 button.

PAR-4x/3xMAA

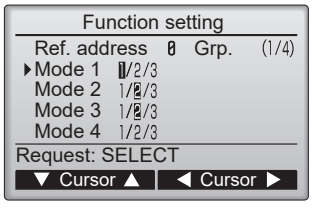

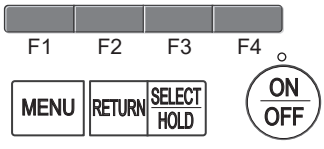

⑤ When the settings are completed, press the [SELECT] button to send the setting data from the remote controller to the indoor units.
When the transmission is successfully completed, the screen will return to the Function setting screen.

Note:
- **Make the above settings only on Mr. Slim units as necessary.**
- **The above function settings are not available for the CITY MULTI units.**
- **Table 1 summarizes the setting options for each mode number. Refer to the indoor unit Installation Manual for the detailed information about initial settings, mode numbers, and setting numbers for the indoor units.**
- **Be sure to write down the settings for all functions if any of the initial settings has been changed after the completion of installation work.**

PAR-4x/3xMAA

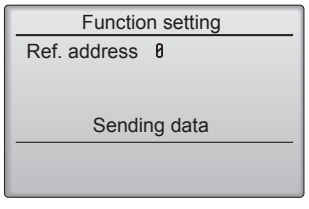

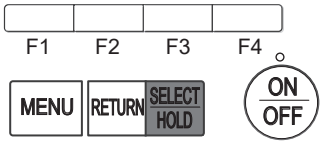

12-1-2. Selecting functions using the IR wireless remote controller (Type C)

Functions can be selected with the IR wireless remote controller. Function selection using the IR wireless remote controller is available only for refrigerant system with wireless function. Refrigerant address cannot be specified by the IR wireless remote controller.

[Flow of function selection procedure]

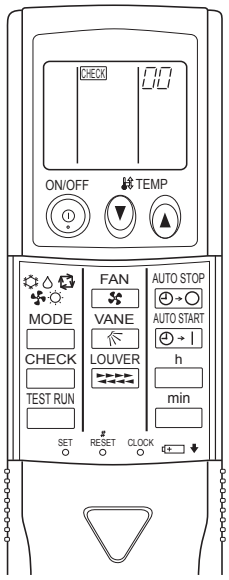

The flow of the function selection procedure is shown below. This example shows how to turn off the function that raises the set temperature by 4 degrees during HEAT operation.
The procedure is given after the flow chart.

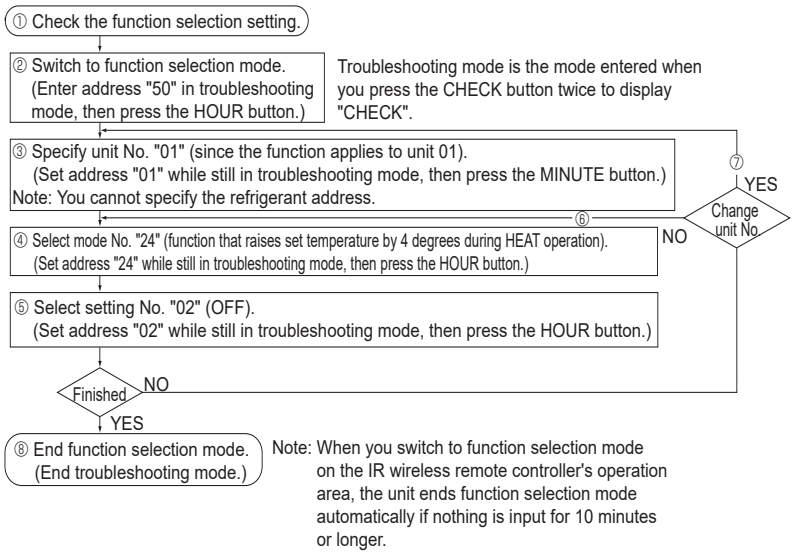

[Operating instructions]

① Check the function settings.

② Press the CHECK button twice continuously. → CHECK is lit and "00" blinks.
Press the TEMP button once to set "50". Direct the IR wireless remote controller toward the receiver of the indoor unit and press the h button.

③ Set the unit number.
Press the TEMP button to set the unit number. (Press "01" to specify the indoor unit whose unit number is 01.)
Direct the IR wireless remote controller toward the receiver of the indoor unit and press the min button.
(By setting unit number with the min button, specified indoor unit starts performing fan operation.
Detect which unit is assigned to which number using this function. If unit number is set to AL, all the indoor units in same refrigerant system start performing fan operation simultaneously.)

Notes:
1. If a unit number that cannot be recognized by the unit is entered, 3 beeps of 0.4 seconds will be heard. Reenter the unit number setting.
2. If the signal was not received by the sensor, you will not hear a beep or a "double ping sound" may be heard. Reenter the unit number setting.

④ Select a mode.
Press the TEMP button to set a mode. Press "24" to turn on the function that raises the set temperature by 4 degrees during heat operation. Direct the IR wireless remote controller toward the sensor of the indoor unit and press the h button.
→ The sensor-operation indicator will blink and beeps will be heard to indicate the current setting number.

Current setting number: 1 = 1 beep (one second)
2 = 2 beeps (one second each)
3 = 3 beeps (one second each)

Notes:
1. If a mode number that cannot be recognized by the unit is entered, 3 beeps of 0.4 seconds will be heard. Reenter the mode number.
2. If the signal was not received by the sensor, you will not hear a beep or a "double ping sound" may be heard. Reenter the mode number.

⑤ Select the setting number.
Press the TEMP button to select the setting number. (02: Not available)
Direct the IR wireless remote controller toward the receiver of the indoor unit and press the h button.
→ The sensor-operation indicator will blink and beeps will be heard to indicate the setting number.

Setting number: 1 = 2 beeps (0.4 seconds each)
2 = 2 beeps (0.4 seconds each, repeated twice)
3 = 2 beeps (0.4 seconds each, repeated three times)

Notes:
1. If a setting number that cannot be recognized by the unit is entered, the setting will turn back to the original setting.
2. If the signal was not received by the sensor, you will not hear a beep or a "double ping sound" may be heard. Reenter the setting number.

⑥ Repeat steps ④ and ⑤ to make an additional setting without changing unit number.

⑦ Repeat steps ③ to ⑤ to change unit number and make function settings on it.

⑧ Complete the function settings
Press button.
Note: Do not use the IR wireless remote controller for 30 seconds after completing the function setting.

12-2. Function selection of the IR wireless remote controller
TEMPERATURE DISPLAY °C/°F SETTING (Change of temp mode from °F to °C)

① Press the set button with something sharp at the end. MODEL SELECT blinks.

② Press the AUTO START button. "°F" blinks.

③ Press the ▼ button. "°C" blinks.

④ Press the set button with something sharp at the end. MODEL SELECT is lit for 3 seconds, then turned off.

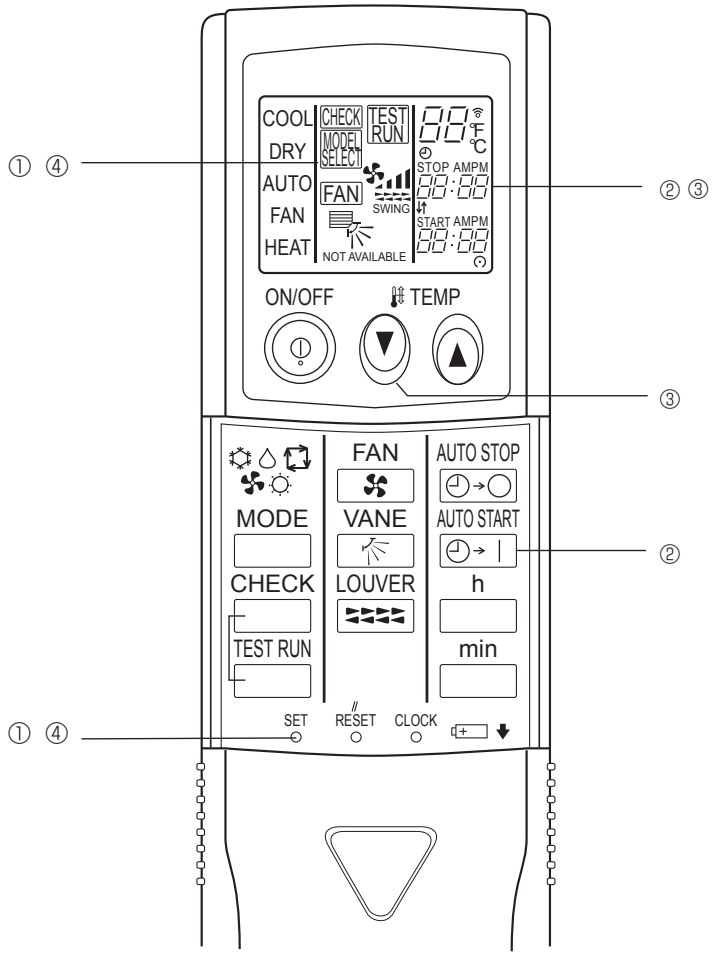

13-1. HOW TO "MONITOR THE OPERATION DATA"

13-1-1. <PAR-4xMAA, PAR-3xMAA ("x" represents 0 or later)>

Details on the operation data including each thermistor temperature and error history can be confirmed with the remote controller.

① Select "Service" from the Main menu, and press the [SELECT] button.

Select "Check" with the F1 or F2 button, and press the [SELECT] button.

Select "Request code" with the F1 or F2 button, and press the [SELECT] button.

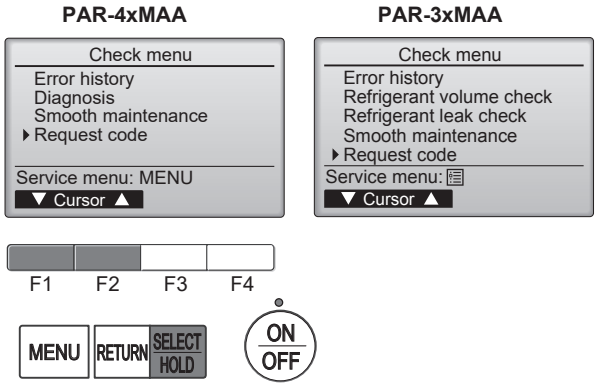

② Set the Refrigerant address and Request code.

Select the item to be changed with the F1 or F2 button.

Select the required setting with the F3 or F4 button.

■<Ref.address>setting [0] – [15]
■<Request code>setting

Press the [SELECT] button, Data will be collected and displayed.

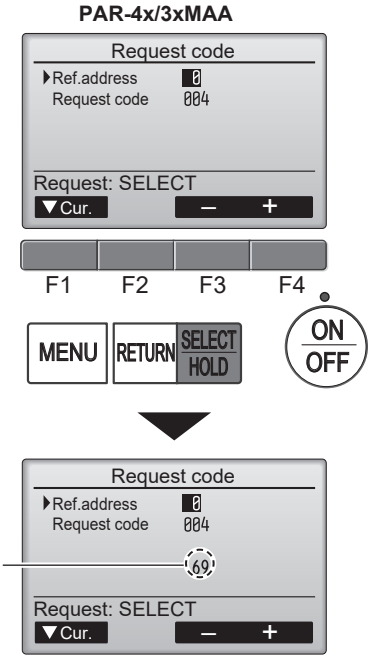

Request code: 004
Discharge temperature: 69˚C

13-2. REQUEST CODE LIST

Certain indoor/outdoor combinations do not have the request code function; therefore, no request codes are displayed.

Request code	Request content	Description (Display range)	Unit	Remarks
0	Operation state	Refer to "13-2-1. Detail Contents in Request Code".	–	
1	Compressor-Operating current (rms)	0–50	A	
2	Compressor-Accumulated operating time	0–9999	10 hours	
3	Compressor-Number of operation times	0–9999	100 times	
4	Discharge temperature (TH4)	37–327	°F	
5	Outdoor unit - Liquid pipe 1 temperature (TH3)	−40–194	°F	
6	Outdoor unit - Liquid pipe 2 temperature	−40–194	°F	
7	Outdoor unit-2-phase pipe temperature (TH6)	−38–190	°F	
8				
9	Outdoor unit-Ambient air temperature (TH7)	−38–190	°F	
10	Outdoor unit-Heatsink temperature (TH8)	−40–327	°F	
11				
12	Discharge superheat (SHd)	0–327	°F	
13	Sub-cool (SC)	0–234	°F	
14				
15				
16	Compressor-Operating frequency	0–255	Hz	
17	Compressor-Target operating frequency	0–255	Hz	
18	Outdoor unit-Fan output step	0–10	Step	
19	Outdoor unit-Fan 1 speed (Only for air conditioners with DC fan motor)	0–9999	rpm	
20	Outdoor unit-Fan 2 speed (Only for air conditioners with DC fan motor)	0–9999	rpm	"0" is displayed if the air conditioner is a single-fan type.
21				
22	LEV (A) opening	0–500	Pulses	
23	LEV (B) opening	0–500	Pulses	
24	LEV (C) opening	0–500	Pulses	
25	Primary current	0–50	A	
26	DC bus voltage	180–760	V	
27				
28				
29	Number of connected indoor units	0–4	Units	
30	Indoor unit-Setting temperature	62–86	°F	
31	Indoor unit-Intake air temperature <Measured by thermostat>	46–102	°F	
32	Indoor unit-Intake air temperature (Unit No. 1) <Heat mode-4-degree correction>	46–102	°F	"32" is displayed if the target unit is not present.
33	Indoor unit-Intake air temperature (Unit No. 2) <Heat mode-4-degree correction>	46–102	°F	↑
34	Indoor unit-Intake air temperature (Unit No. 3) <Heat mode-4-degree correction>	46–102	°F	↑
35	Indoor unit-Intake air temperature (Unit No. 4) <Heat mode-4-degree correction>	46–102	°F	↑
36				
37	Indoor unit - Liquid pipe temperature (Unit No. 1)	−38–190	°F	"Not available. Unsupported function." is displayed if the target unit is not present.
38	Indoor unit - Liquid pipe temperature (Unit No. 2)	−38–190	°F	↑
39	Indoor unit - Liquid pipe temperature (Unit No. 3)	−38–190	°F	↑
40	Indoor unit - Liquid pipe temperature (Unit No. 4)	−38–190	°F	↑
41				
42	Indoor unit-Cond./Eva. pipe temperature (Unit No. 1)	−38–190	°F	"Not available. Unsupported function." is displayed if the target unit is not present.
43	Indoor unit-Cond./Eva. pipe temperature (Unit No. 2)	−38–190	°F	↑
44	Indoor unit-Cond./Eva. pipe temperature (Unit No. 3)	−38–190	°F	↑
45	Indoor unit-Cond./Eva. pipe temperature (Unit No. 4)	−38–190	°F	↑
46				
47				
48	Thermostat ON operating time	0–999	Minutes	
49	Test run elapsed time	0–120	Minutes	← Not possible to activate maintenance mode during the test run.

Request code	Request content	Description (Display range)	Unit	Remarks
50	Indoor unit-Control state	Refer to “13-2-1.Detail Contents in Request Code”.	–	
51	Outdoor unit-Control state	Refer to “13-2-1.Detail Contents in Request Code”.	–	
52	Compressor-Frequency control state	Refer to “13-2-1.Detail Contents in Request Code”.	–	
53	Outdoor unit-Fan control state	Refer to “13-2-1.Detail Contents in Request Code”.	–	
54	Actuator output state	Refer to “13-2-1.Detail Contents in Request Code”.	–	
55	Error content (U9)	Refer to “13-2-1.Detail Contents in Request Code”.	–	
56				
57				
58				
59				
60	Signal transmission demand capacity	0–255	%	
61	Contact demand capacity	Refer to “13-2-1.Detail Contents in Request Code”.	–	
62	External input state (silent mode, etc.)	Refer to “13-2-1.Detail Contents in Request Code”.	–	
63				
64				
65				
66				
67				
68				
69				
70	Outdoor unit-Capacity setting display	Refer to “13-2-1.Detail Contents in Request Code”.	–	
71	Outdoor unit-Setting information	Refer to “13-2-1.Detail Contents in Request Code”.	–	
72				
73	Outdoor unit-SW1 setting information	Refer to “13-2-1.Detail Contents in Request Code”.	–	
74	Outdoor unit-SW2 setting information	Refer to 13-2-1.Detail Contents in Request Code.	–	
75				
76	Outdoor unit-SW4 setting information	Refer to “13-2-1.Detail Contents in Request Code”.	–	
77	Outdoor unit-SW5 setting information	Refer to “13-2-1.Detail Contents in Request Code”.	–	
78	Outdoor unit-SW6 setting information	Refer to “13-2-1.Detail Contents in Request Code”.	–	
79	Outdoor unit-SW7 setting information	Refer to “13-2-1.Detail Contents in Request Code”.	–	
80	Outdoor unit-SW8 setting information	Refer to “13-2-1.Detail Contents in Request Code”.	–	
81	Outdoor unit-SW9 setting information	Refer to “13-2-1.Detail Contents in Request Code”.	–	
82	Outdoor unit-SW10 setting information	Refer to “13-2-1.Detail Contents in Request Code”.	–	
83				
84	M-NET adapter connection (presence/absence)	"0000": Not connected "0001": Connected	–	
85				
86				
87				
88				
89	Display of execution of replace/wash operation	"0000": Not washed "0001": Washed	–	
90	Outdoor unit-Microprocessor version information	Examples) Ver 5.01 → "0501"	Ver	
91	Outdoor unit-Microprocessor version information (sub No.)	Auxiliary information (displayed after version information) Examples) Ver 5.01 A000 → "A000"	–	
92				
93				
94				
95				
96				
97				
98				
99				
100	Outdoor unit - Error postponement history 1 (latest)	Displays postponement code. (" - - " is displayed if no postponement code is present)	Code	
101	Outdoor unit - Error postponement history 2 (previous)	Displays postponement code. (" - - " is displayed if no postponement code is present)	Code	
102	Outdoor unit - Error postponement history 3 (last but one)	Displays postponement code. (" - - " is displayed if no postponement code is present)	Code	

Request code	Request content	Description (Display range)	Unit	Remarks
103	Error history 1 (latest)	Displays error history. ("--" is displayed if no history is present.)	Code	
104	Error history 2 (second to last)	Displays error history. ("--" is displayed if no history is present.)	Code	
105	Error history 3 (third to last)	Displays error history. ("--" is displayed if no history is present.)	Code	
106	Abnormal thermistor display (TH3/TH6/TH7/TH8)	3: TH3 6: TH6 7: TH7 8: TH8 0: No thermistor error	Sensor number	
107	Operation mode at time of error	Displayed in the same way as request code "0".	–	
108	Compressor-Operating current at time of error	0–50	A	
109	Compressor-Accumulated operating time at time of error	0–9999	10 hours	
110	Compressor-Number of operation times at time of error	0–9999	100 times	
111	Discharge temperature at time of error	37–327	˚F	
112	Outdoor unit - Liquid pipe 1 temperature (TH3) at time of error	−40–194	˚F	
113	Outdoor unit - Liquid pipe 2 temperature at time of error	−40–194	˚F	
114	Outdoor unit-2-phase pipe temperature (TH6) at time of error	−38–190	˚F	
115				
116	Outdoor unit-Outside air temperature (TH7) at time of error	−38–190	˚F	
117	Outdoor unit-Heat sink temperature (TH8) at time of error	−40–327	˚F	
118	Discharge super heat (SHd) at time of error	0–327	˚F	
119	Sub-cool (SC) at time of error	0–234	˚F	
120	Compressor-Operating frequency at time of error	0–255	Hz	
121	Outdoor unit at time of error · Fan output step	0–10	Step	
122	Outdoor unit at time of error · Fan 1 speed (Only for air conditioners with DC fan)	0–9999	rpm	
123	Outdoor unit at time of error · Fan 2 speed (Only for air conditioners with DC fan)	0–9999	rpm	"0"is displayed if the air conditioner is a single-fan type.
124				
125	LEV (A) opening at time of error	0–500	Pulses	
126	LEV (B) opening at time of error	0–500	Pulses	
127				
128				
129				
130	Thermostat ON time until operation stops due to error	0–999	Minutes	
131				
132	Indoor - Liquid pipe temperature at time of error	−38–190	˚F	Average value of all indoor units is displayed if the air conditioner consists of 2 or more indoor units (twin).
133	Indoor-Cond./Eva. pipe temperature at time of error	−38–190	˚F	Average value of all indoor units is displayed if the air conditioner consists of 2 or more indoor units (twin).
134	Indoor at time of error · Intake air temperature <Thermostat judge temperature>	−38–190	˚F	
135				
136				
137				
138				
139				
140				
~				
146				
147				
148				
149				
150	Indoor-Actual intake air temperature	−38–190	˚F	
151	Indoor - Liquid pipe temperature	−38–190	˚F	
152	Indoor-Cond./Eva. pipe temperature	−38–190	˚F	

Request code	Request content	Description (Display range)	Unit	Remarks
153				
154	Indoor-Fan operating time (After filter is reset)	0–9999	1 hour	
155	Indoor-Total operating time (Fan motor ON time)	0–9999	10 hours	
156				
157	Indoor fan output value (Sj value)	0–255 Fan control data	–	For indoor fan phase control
158	Indoor fan output value (Pulsation ON/OFF)	"00 **" "**" indicates fan control data.	–	For indoor fan pulsation control
159	Indoor fan output value (duty value)	"00 **" "**" indicates fan control data.	–	For indoor DC brushless motor control
160				
161				
162	Indoor unit-Model setting information	Refer to "13-2-1 Detail Contents in Request Code".	–	
163	Indoor unit-Capacity setting information	Refer to "13-2-1 Detail Contents in Request Code".	–	
164	Indoor unit-SW3 information	Undefined	–	
165	Wireless pair No. (indoor control board side) setting	Refer to "13-2-1 Detail Contents in Request Code".	–	
166	Indoor unit-SW5 information	Undefined	–	
167				
~				
189				
190	Indoor unit-Microprocessor version information	Examples) Ver 5.01 → "0501"	Ver	
191	Indoor unit-Microprocessor version information (sub No.)	Auxiliary information (displayed after version information) Examples) Ver 5.01 A000 → "A000"	–	
192				
~				
764				
765	Stable operation (Heat mode)	This request code is not provided to collect data. It is used to fix the operation state.		
766	Stable operation (Cool mode)	This request code is not provided to collect data. It is used to fix the operation state.		
767	Stable operation cancellation	This request code is not provided to collect data. It is used to cancel the operation state that has been fixed by request codes "765" and "766".		

13-2-1. Detail Contents in Request Code



Example) Request code "004"
Discharge temperature 156°F
Refrigerant address "00"

[Operation state] (Request code: 0)

Data display



Operation mode

Display	Operation mode
0	STOP • FAN
C	COOL • DRY
H	HEAT
d	DEFROST

Relay output state

Display	Power currently supplied to compressor	Compressor	4-way valve	Solenoid valve
0	–	–	–	–
1				ON
2			ON	
3			ON	ON
4		ON		
5		ON		ON
6		ON	ON	
7		ON	ON	ON
8	ON			
A	ON		ON	

[Indoor unit – Control state] (Request code: 50)

Data display

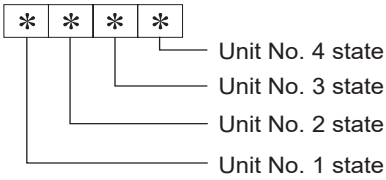

Display	State
0	Normal
1	Preparing for heat operation.
2	–
3	–
4	Heater is ON.
5	Anti-freeze protection is ON.
6	Overheat protection is ON.
7	Requesting compressor to turn OFF.
F	There are no corresponding units.

[Outdoor unit – Control state] (Request code: 51)

Data display				State
0	0	0	0	Normal
0	0	0	1	Preparing for heat operation.
0	0	0	2	Defrost

[Compressor – Frequency control state] (Request code: 52)

Data display



Frequency control state ①

Display	Current limit control
0	No current limit
1	Primary current limit control is ON.
2	Secondary current limit control is ON.

Frequency control state ②

Display	Discharge temperature overheat prevention	Condensation temperature overheat prevention	Anti-freeze protection control	Heat sink temperature overheat prevention
0				
1	Controlled			
2		Controlled		
3	Controlled	Controlled		
4			Controlled	
5	Controlled		Controlled	
6		Controlled	Controlled	
7	Controlled	Controlled	Controlled	
8				Controlled
9	Controlled			Controlled
A		Controlled		Controlled
b	Controlled	Controlled		Controlled
C			Controlled	Controlled
d	Controlled		Controlled	Controlled
E		Controlled	Controlled	Controlled
F	Controlled	Controlled	Controlled	Controlled

[Fan control state] (Request code: 53)

Data display

0	0	*	*

Fan step correction value by heatsink temperature overheat prevention control

Fan step correction value by cool condensation temperature overheat prevention control

Display	Correction value
- (minus)	– 1
0	0
1	+1
2	+2

[Actuator output state] (Request code: 54)

Data display

0	0	*	*

Actuator output state ①

Actuator output state ②

Actuator output state ①

Display	SV1	Four-way valve	Compressor	Compressor is warming up
0				
1	ON			
2		ON		
3	ON	ON		
4			ON	
5	ON		ON	
6		ON	ON	
7	ON	ON	ON	
8				ON
9	ON			ON
A		ON		ON
b	ON	ON		ON
C			ON	ON
d	ON		ON	ON
E		ON	ON	ON
F	ON	ON	ON	ON

Actuator output state ②

Display	52C	SV2	SS
0			
1	ON		
2		ON	
3	ON	ON	
4			ON
5	ON		ON
6		ON	ON
7	ON	ON	ON

[Error content (U9)] (Request code: 55)

Data display

0	0	*	*

Error content ①

Error content ②

Error content ① ●: Detected

Display	Overvoltage error	Undervoltage error	L_1-phase open error	Power synchronizing signal error
0				
1	●			
2		●		
3	●	●		
4			●	
5	●		●	
6		●	●	
7	●	●	●	
8				●
9	●			●
A		●		●
b	●	●		●
C			●	●
d	●		●	●
E		●	●	●
F	●	●	●	●

Error content ② ●: Detected

Display	Converter Fo error	PAM error
0		
1	●	
2		●
3	●	●

[Contact demand capacity] (Request code: 61)

Data display

0	0	0	✻

Setting content

Setting content

Display	Setting value
0	0%
1	50%
2	75%
3	100%

[External input state] (Request code: 62)

Data display

0	0	0	✻

Input state

Input state

●: Input present

Display	Contact demand input	Silent mode input	Spare 1 input	Spare 2 input
0				
1	●			
2		●		
3	●	●		
4			●	
5	●		●	
6		●	●	
7	●	●	●	
8				●
9	●			●
A		●		●
b	●	●		●
C			●	●
d	●		●	●
E		●	●	●
F	●	●	●	●

[Outdoor unit – Capacity setting display] (Request code: 70)

Data display	Capacity
9	12
10	18
11	24
14	30
20	36
25	42

[Outdoor unit – Setting information] (Request code: 71)

Data display

0	0	✻	✻

Setting information ①

Setting information ②

Setting information ①

Display	Defrost mode
0	Standard
1	For high humidity

Setting information ②

Display	Single-/ three-phase	Heat pump/ cooling only
0	Single-phase	Heat pump
1		Cooling only
2	Three-phase	Heat pump
3		Cooling only

[Outdoor unit switch setting display (SW1 to SW10, except SW3)] Request codes: 73 to 82

0: Switch OFF 1: Switch ON

SW1, SW2, SW6, SW7						Data display
1	2	3	4	5	6	
0	0	0	0	0	0	00 00
1	0	0	0	0	0	00 01
0	1	0	0	0	0	00 02
1	1	0	0	0	0	00 03
0	0	1	0	0	0	00 04
1	0	1	0	0	0	00 05
0	1	1	0	0	0	00 06
1	1	1	0	0	0	00 07
0	0	0	1	0	0	00 08
1	0	0	1	0	0	00 09
0	1	0	1	0	0	00 0A
1	1	0	1	0	0	00 0b
0	0	1	1	0	0	00 0C
1	0	1	1	0	0	00 0d
0	1	1	1	0	0	00 0E
1	1	1	1	0	0	00 0F
0	0	0	0	1	0	00 10
1	0	0	0	1	0	00 11
0	1	0	0	1	0	00 12
1	1	0	0	1	0	00 13
0	0	1	0	1	0	00 14
1	0	1	0	1	0	00 15
0	1	1	0	1	0	00 16
1	1	1	0	1	0	00 17
0	0	0	1	1	0	00 18
1	0	0	1	1	0	00 19
0	1	0	1	1	0	00 1A
1	1	0	1	1	0	00 1B
0	0	1	1	1	0	00 1C
1	0	1	1	1	0	00 1D
0	1	1	1	1	0	00 1E
1	1	1	1	1	0	00 1F
0	0	0	0	0	1	00 20
1	0	0	0	0	1	00 21
0	1	0	0	0	1	00 22
1	1	0	0	0	1	00 23
0	0	1	0	0	1	00 24
1	0	1	0	0	1	00 25
0	1	1	0	0	1	00 26
1	1	1	0	0	1	00 27
0	0	0	1	0	1	00 28
1	0	0	1	0	1	00 29
0	1	0	1	0	1	00 2A
1	1	0	1	0	1	00 2B
0	0	1	1	0	1	00 2C
1	0	1	1	0	1	00 2D
0	1	1	1	0	1	00 2E
1	1	1	1	0	1	00 2F
0	0	0	0	1	1	00 30
1	0	0	0	1	1	00 31
0	1	0	0	1	1	00 32
1	1	0	0	1	1	00 33
0	0	1	0	1	1	00 34
1	0	1	0	1	1	00 35
0	1	1	0	1	1	00 36
1	1	1	0	1	1	00 37
0	0	0	1	1	1	00 38
1	0	0	1	1	1	00 39
0	1	0	1	1	1	00 3A
1	1	0	1	1	1	00 3B
0	0	1	1	1	1	00 3C
1	0	1	1	1	1	00 3D
0	1	1	1	1	1	00 3E
1	1	1	1	1	1	00 3F

0: Switch OFF 1: Switch ON

SW5				Data display
1	2	3	4	
0	0	0	0	00 00
1	0	0	0	00 01
0	1	0	0	00 02
1	1	0	0	00 03
0	0	1	0	00 04
1	0	1	0	00 05
0	1	1	0	00 06
1	1	1	0	00 07
0	0	0	1	00 08
1	0	0	1	00 09
0	1	0	1	00 0A
1	1	0	1	00 0b
0	0	1	1	00 0C
1	0	1	1	00 0d
0	1	1	1	00 0E
1	1	1	1	00 0F

0: Switch OFF 1: Switch ON

SW8			Data display
1	2	3	
0	0	0	00 00
1	0	0	00 01
0	1	0	00 02
1	1	0	00 03
0	0	1	00 04
1	0	1	00 05
0	1	1	00 06
1	1	1	00 07

0: Switch OFF 1: Switch ON

SW4, SW9, SW10		Data display
1	2	
0	0	00 00
1	0	00 01
0	1	00 02
1	1	00 03

[Indoor unit – Model setting information] (Request code : 162)

Data display

0	0	*	*

See the table on the right.

Display	Model setting state	Display	Model setting state
00	TPEADA***1AA	20	
01	TPEADA***1AA	21	
02		22	
03	TPVA0A***1AA	23	
04		24	
05		25	
06		26	
07		27	
08		28	
09		29	
0A		2A	
0b		2b	
0C		2C	
0d		2d	
0E		2E	
0F		2F	
10		30	
11		31	TPCA0A***1KA
12		32	TPKA0A***1KA
13		33	
14		34	
15		35	
16		36	
17		37	
18		38	TPEADA***1AA
19		39	TPEADA***1AA
1A		3A	
1b		3b	
1C		3C	
1d		3d	
1E		3E	
1F		3F	

[Indoor unit – Capacity setting information] (Request code 163)

Data display

0	0	*	*

See the table on the right.

Display	Capacity setting state	Display	Capacity setting state
00		10	42
01		11	
02		12	
03		13	
04		14	
05		15	
06	12	16	
07		17	
08		18	
09	18	19	
0A		1A	
0b	24	1b	
0C		1C	
0d	30	1d	
0E		1E	
0F	36	1F	

[Wireless pair No. (indoor control board side) setting] (Request code 165)

Data display

0	0	*	*

See the table on the right.

Display	Pair No. setting state
00	No. 0
01	No. 1 J41 disconnected
02	No. 2 J42 disconnected
03	No. 3 J41, J42 disconnected

14 DISASSEMBLY PROCEDURE

TRUZH0241HA00NA

→ : Indicates the visible parts in the photos/figures.

OPERATING PROCEDURE	PHOTOS/FIGURES
1. Removing the service panel and top panel (1) Remove 3 service panel fixing screws (5 × 12) and slide the hook on the right downward to remove the service panel. (2) Remove screws (3 for front, 3 for rear/5 × 12) of the top panel and remove it.	**Photo 1** 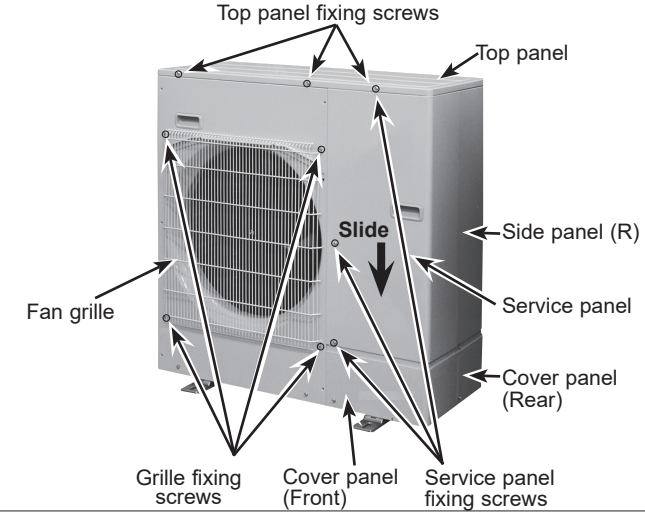
2. Removing the fan motor (MF1) (1) Remove the service panel. (See Photo 1) (2) Remove the top panel. (See Photo 1) (3) Remove 4 fan grille fixing screws (5 × 12) to detach the fan grille. (See Photo 1) (4) Remove a nut (for right handed screw of M6) to detach the propeller. (See Photo 2) (5) Disconnect the connector CNF1 on controller circuit board in electrical parts box. (6) Remove 4 fan motor fixing screws (5 × 20) to detach the fan motor. (See Photo 3)	**Photo 2** 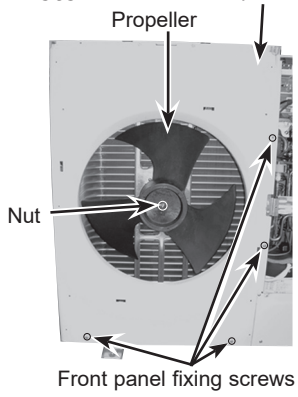 **Photo 3** 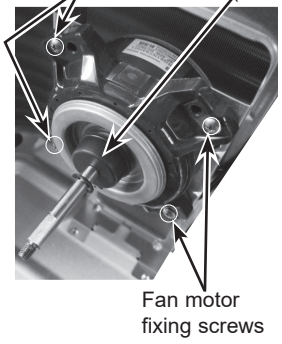
3. Removing the electrical parts box (1) Remove the service panel. (See Photo 1) (2) Remove the top panel. (See Photo 1) (3) Disconnect the indoor/outdoor connecting wire from terminal block. (4) Disconnect the connector CNF1, LEV-A and LEV-B on the controller circuit board. <Symbols on the board> • CNF1 : Fan motor • LEV-A, LEV-B : LEV (5) Disconnect the pipe-side connections of the following parts. • Thermistor <Liquid> (TH3) • Thermistor <Discharge> (TH4) • Thermistor <2-phase pipe, Ambient> (TH7/6) • High pressure switch (63H) • 4-way valve coil (21S4) • Thermistor <Comp. surface> (TH33) (6) Remove the terminal cover and disconnect the compressor lead wire. (7) Remove an electrical parts box fixing screw (4 × 10) and detach the electrical parts box by pulling it upward. The electrical parts box is fixed with 2 hooks on the left and 1 hook on the right.	**Photo 4** 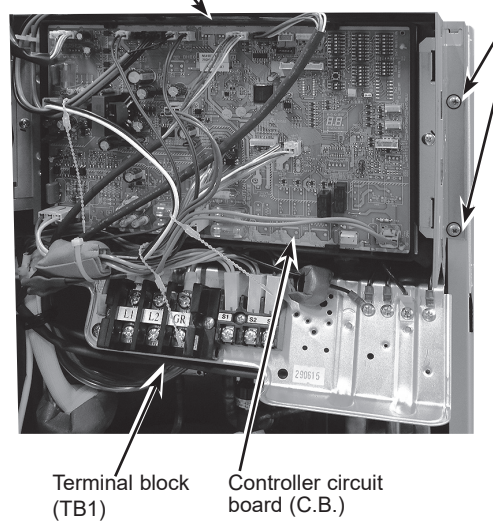

OPERATING PROCEDURE	PHOTOS/FIGURES
4. Removing the thermistor <Liquid> (TH3) and thermistor <2-phase pipe> (TH6) (1) Remove the service panel. (See Photo 1) (2) Remove the top panel. (See Photo 1) (3) Disconnect the connector TH7/6 (red) and TH3 (white) on the controller circuit board in the electrical parts box. (4) Loosen the 2 clamps for the lead wires on the top of the electrical parts box. (5) Pull out the thermistor <2-phase pipe> (TH6) and the thermistor <Liquid> (TH3) from each sensor holders. **Note: When replacing thermistor <2-phase pipe> (TH6), replace it together with thermistor <Ambient> (TH7), since they are combined together. Refer to procedure No.5 below to remove thermistor <Ambient>.**	**Photo 5** 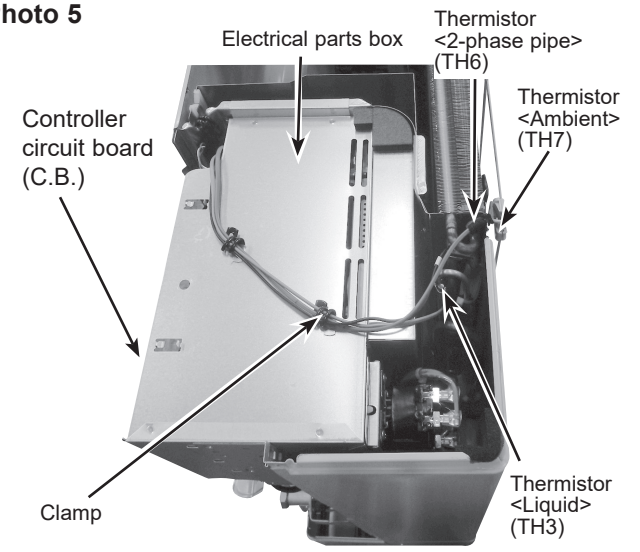
5. Removing the thermistor <Ambient> (TH7) (1) Remove the service panel. (See Photo 1) (2) Remove the top panel. (See Photo 1) (3) Disconnect the connector TH7/6 (red) on the controller circuit board in the electrical parts box. (4) Loosen the clamp for the lead wire in the rear of the electrical parts box. (See Photo 5) (5) Pull out the thermistor <Ambient> (TH7) from the sensor holder. **Note: When replacing thermistor <Ambient> (TH7), replace it together with thermistor <2-phase pipe> (TH6), since they are combined together. Refer to procedure No.4 above to remove thermistor <2-phase pipe>.**	**Photo 6** 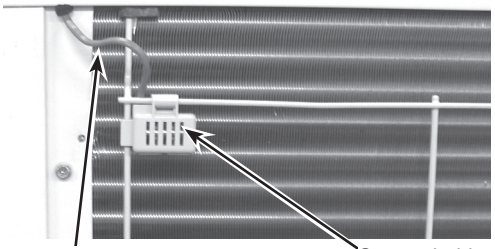
6. Removing the thermistor <Discharge> (TH4) and thermistor <Comp. surface> (TH33) (1) Remove the service panel. (See Photo 1) (2) Disconnect the connectors, TH4 (white) and TH33 (yellow), on the controller circuit board in the electrical parts box. (3) Loosen the clamp for the lead wire in the rear of the electrical parts box. (See Photo 5) (4) Pull out the thermistor <Discharge> (TH4) from the sensor holder. [Removing the thermistor<Comp. surface> (TH33)] (5) Remove the compressor cover (upper) and pull out the thermistor <Comp. surface> (TH33) from the holder of the compressor shell.	**Photo 7** 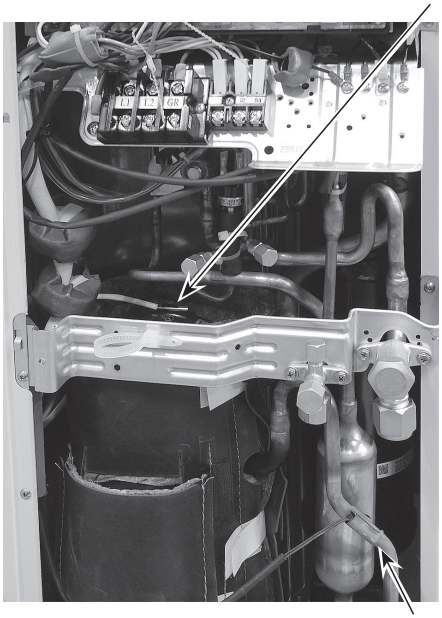

OPERATING PROCEDURE	PHOTOS/FIGURES

7. Removing the 4-way valve coil (21S4), LEV coil (LEV(A), LEV(B))

(1) Remove the service panel. (See Photo 1)
(2) Remove the top panel. (See Photo 1)
(3) Remove the electrical parts box. (See Photo 4)

[Removing the 4-way valve coil]

(4) Remove 4-way valve coil fixing screw (M4 × 6).
(5) Remove the 4-way valve coil by sliding the coil toward you.
(6) Disconnect the connector 21S4 (green) on the controller board in the electrical parts box.

[Removing the LEV coil]

(4) Remove the LEV coil by sliding the coil upward.
(5) Disconnect the connectors, LEV A (white) and LEV B (red), on the controller circuit board in the electrical parts box.

Photo 8

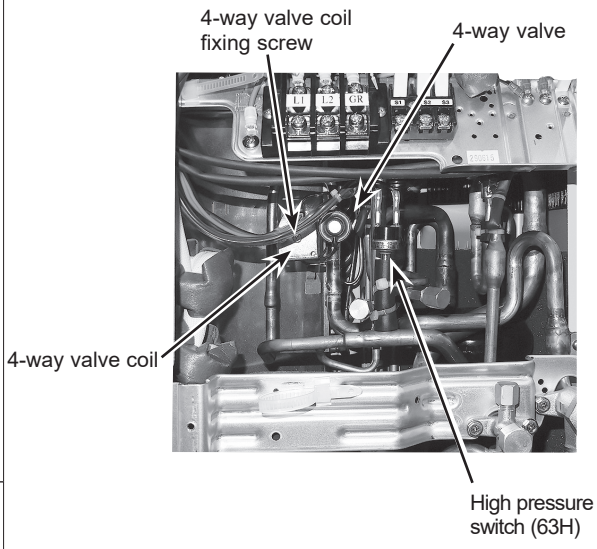

8. Removing the 4-way valve

(1) Remove the service panel. (See Photo 1)
(2) Remove the top panel. (See Photo 1)
(3) Remove the electrical parts box. (See Photo 4)
(4) Remove 3 valve bed fixing screws (4 × 10) and 4 ball valve and stop valve fixing screws (5 × 16) and then remove the valve bed.
(5) Remove 3 right side panel fixing screws (5 × 12) in the rear of the unit and then remove the right side panel.
(6) Remove the 4-way valve coil. (See Photo 8)
(7) Recover refrigerant.
(8) Remove the welded part of 4-way valve.

Note 1: Recover refrigerant without spreading it in the air.
Note 2: The welded part can be removed easily by removing the right side panel.
Note 3: When installing the 4-way valve, cover it with a wet cloth to prevent it from heating (120°C or more), then braze the pipes so that the inside of pipes are not oxidized.

Figure 1

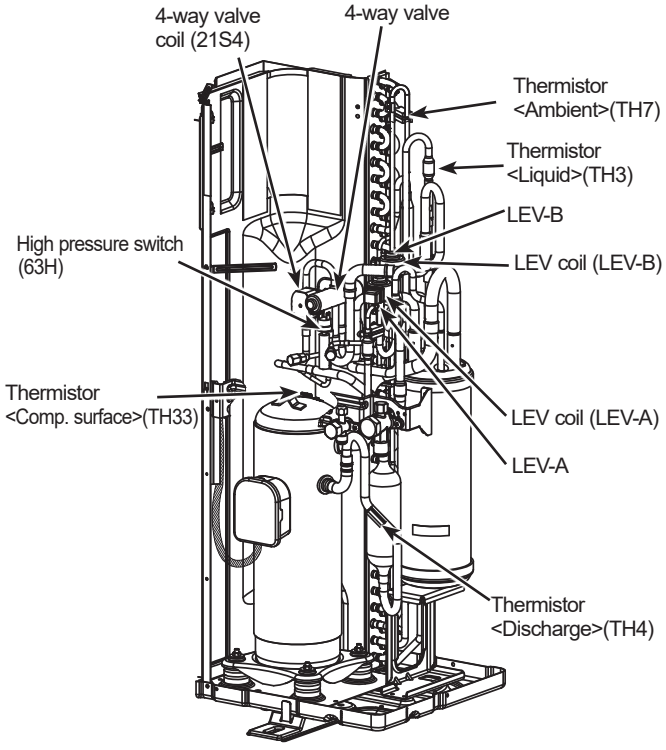

9. Removing the LEV

(1) Remove the service panel. (See Photo 1)
(2) Remove the top panel. (See Photo 1)
(3) Remove the electrical parts box. (See Photo 4)
(4) Remove 3 valve bed fixing screws (4 × 10) and 4 ball valve and stop valve fixing screws (5 × 16) and then remove the valve bed.
(5) Remove 3 right side panel fixing screws (5 × 12) in the rear of the unit and then remove the right side panel.
(6) Remove the LEV.
(7) Recover refrigerant.
(8) Remove the welded part of linear expansion valve.

Note 1: Recover refrigerant without spreading it in the air.
Note 2: The welded part can be removed easily by removing the right side panel.
Note 3: When installing the LEV, cover it with a wet cloth to prevent it from heating (120°C or more), then braze the pipes so that the inside of pipes are not oxidized.

OPERATING PROCEDURE	PHOTOS/FIGURES
10. Removing the high pressure switch (63H) (1) Remove the service panel. (See Photo 1) (2) Remove the top panel. (See Photo 1) (3) Remove the electrical parts box. (See Photo 4) (4) Remove 3 right side panel fixing screws (5 × 12) in the rear of the unit and remove the right side panel. (5) Pull out the lead wire of high pressure switch. (6) Recover refrigerant. (7) Remove the welded part of high pressure switch. **Note 1: Recover refrigerant without spreading it in the air.** **Note 2: The welded part can be removed easily by removing the right side panel.** **Note 3: When installing the high pressure switch, cover it with a wet cloth to prevent it from heating (100°C or more), then braze the pipes so that the inside of pipes are not oxidized.**	**Photo 9** 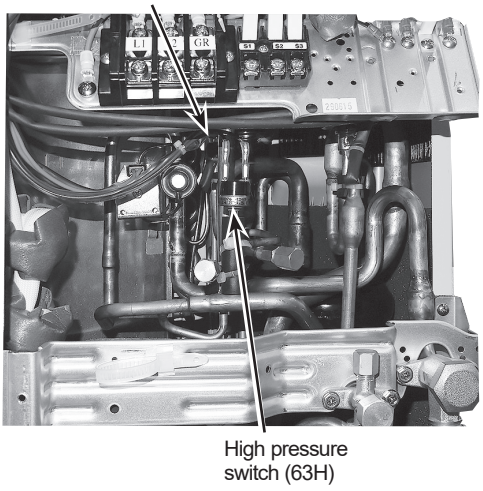
11. Removing the reactor (DCL) (1) Remove the service panel. (See Photo 1) (2) Remove the top panel. (See Photo 1) (3) Remove the electrical parts box. (See Photo 4) (4) Remove the reactor fixing screws (4 places, 4 × 10) **Note: The reactor is attached to the rear of the electrical parts box.**	**Photo10** 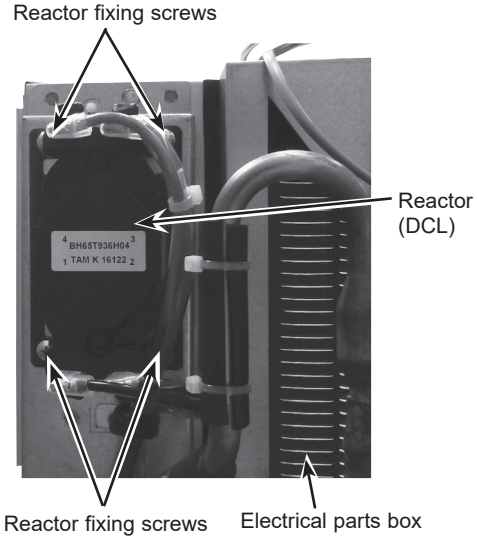

OPERATING PROCEDURE	PHOTOS/FIGURES
12. Removing the compressor (MC) (1) Remove the service panel. (See Photo 1) (2) Remove the top panel. (See Photo 1) (3) Remove 2 front cover panel fixing screws (5 × 12) and remove the front cover panel. (See Photo 1) (4) Remove 2 back cover panel fixing screws (5 × 12) and remove the back cover panel. (5) Remove the electrical parts box. (See Photo 4) (6) Remove 3 valve bed fixing screws (4 × 10) and 4 ball valve and stop valve fixing screws (5 × 16) and then remove the valve bed. (7) Remove 3 right side panel fixing screws (5 × 12) in the rear of the unit then remove the right side panel. (8) Remove 2 separator fixing screws (4 × 10) and remove the separator. (9) Recover refrigerant. (10) Remove the 3 points of the compressor fixing nut using a spanner or a adjustable wrench. (11) Remove the welded pipe of compressor inlet and outlet then remove the compressor. **Note: Recover refrigerant without spreading it in the air.**	**Photo 11** 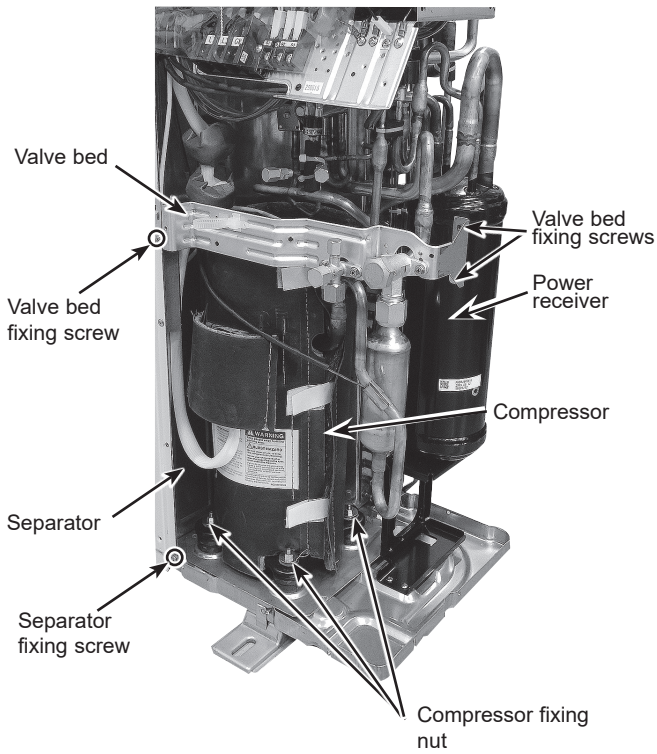
13. Removing the power receiver (1) Remove the service panel. (See Photo 1) (2) Remove the top panel. (See Photo 1) (3) Remove 2 front cover panel fixing screws (5 × 12) and remove the front cover panel. (See Photo 1) (4) Remove 2 back cover panel fixing screws (5 × 12) and remove the back cover panel. (5) Remove the electrical parts box. (See Photo 4) (6) Remove 3 valve bed fixing screws (4 × 10) and 4 ball valve and stop valve fixing screws (5 × 16) then remove the valve bed. (7) Remove 3 right side panel fixing screws (5 × 12) in the rear of the unit then remove the right side panel. (8) Recover refrigerant. (9) Remove 4 welded pipes of power receiver inlet and outlet. (10) Remove 2 receiver leg fixing screws (4 × 10). **Note: Recover refrigerant without spreading it in the air.**	**Photo 12** 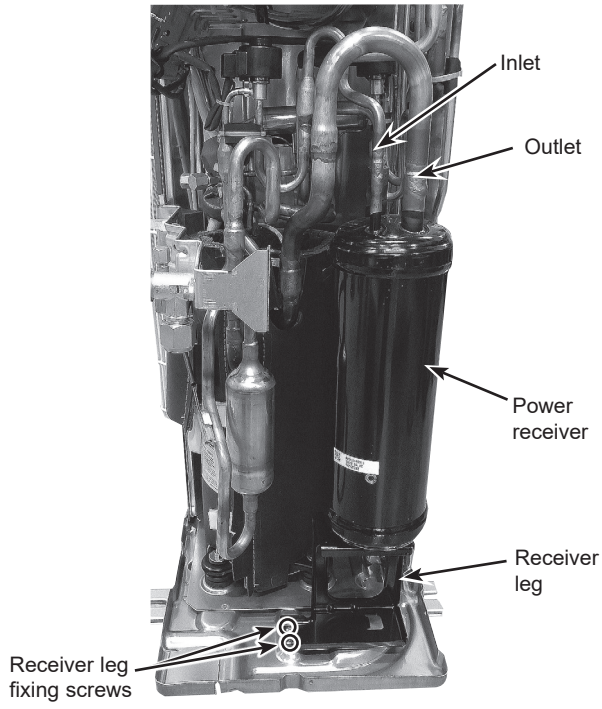

MITSUBISHI ELECTRIC TRANE HVAC US LLC

HEAD OFFICE: 1340 SATELLITE BOULEVARD, SUWANEE, GA 30024, USA

©Copyright 2019 MITSUBISHI ELECTRIC CORPORATION
Issued: Oct. 2019 No. OCHT721 REVISED EDITION-A
Published: Sep. 2019 No.OCHT721
Made in Japan

Specifications are subject to change without notice.