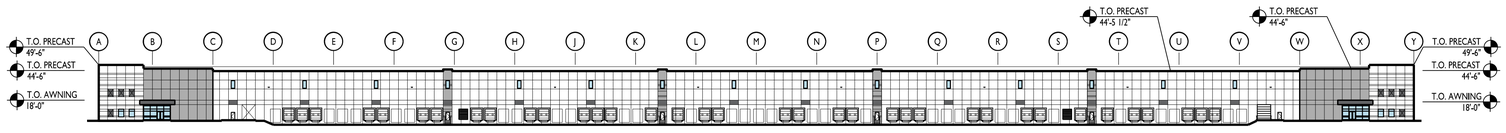

SOUTH ELEVATION **1**

1/64" = 1'-0"

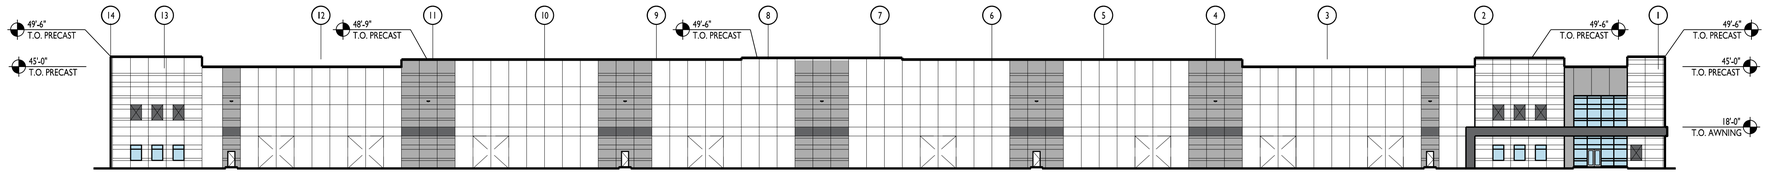

EAST ELEVATION **2**

1/32" = 1'-0"

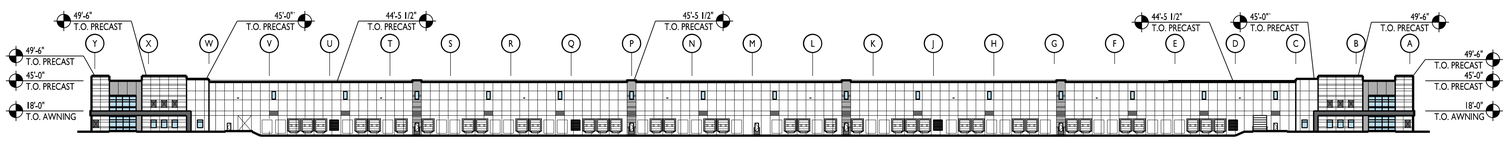

NORTH ELEVATION **3**

1/64" = 1'-0"

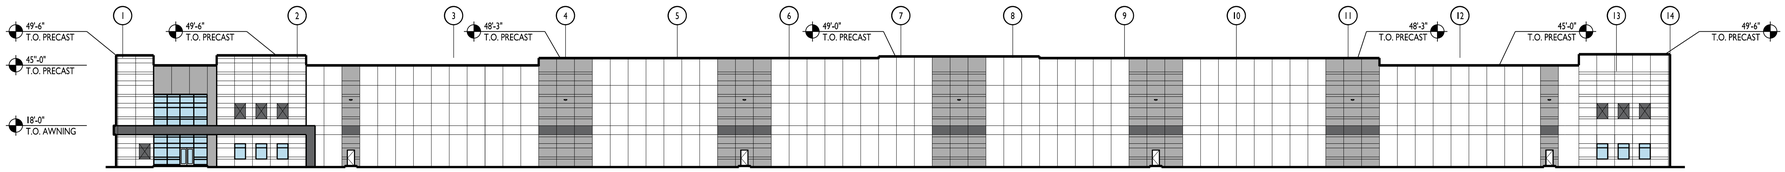

WEST ELEVATION **4**

1/32" = 1'-0"

GENERAL PRECAST PAINT NOTES

A. CONCRETE TO CURE 30 DAYS PRIOR TO PAINT OR VERIFY PH LEVEL IS BETWEEN 6-8. IF PH IS HIGHER THAN 8, A PRIMER THAT IS TOLERANT OF A HIGH ALKALINE SUBSTRATE IS REQUIRED. VERIFY PRODUCT WITH PAINT MANUFACTURER DATA SHEETS FOR ACCEPTABLE MATERIALS TO MEET THE PH OF THE PANELS. TYPICAL LOXON PRIMERS. PROVIDE REPORT STATING PH LEVEL OF PANEL PRIOR TO PAINT APPLICATION.

B. PRECASTER TO VERIFY AND CONFIRM TO GENERAL CONTRACTOR THAT ALL BOND BREAKERS HAVE BEEN REMOVED FROM THE FACE OF THE CONCRETE VIA PRESSURE WASHING OR SAND BLASTING. PROCESS IS DEPENDENT ON THE TYPE OF BOND BREAKER USED. PRECASTER TO SUPPLY A LETTER CONFIRMING THAT BOND BREAKER IS REMOVED.

C. PRIOR TO PAINTING, VERIFY THAT PRECAST CONCRETE MOISTURE LEVEL IS 15% OR LOWER.

D. ALL ACRYLIC PAINTS TO BE 100% ACRYLIC SHERWIN WILLIAMS A-100, SUPER PAINT OR EQUAL.

E. PAINT TO BE MIN 1 PRIMER COAT, 2 FINISH COATS. FINISH COAT TO BE ACRYLIC COATING DAN-TEX OR THOROCOAT FINE TEXTURE.

F. ELASTOMERIC PAINTS WILL BE ACCEPTABLE. CONFLEX OR SHERLASTIC OR EQUAL. MUST BE APPLIED AT 10 MILS RO 30 + MILS WET. MUST APPLY TWO COATS. VERIFY PH REQUIREMENTS WITH DATA SHEETS.

PAINT LEGEND

PAINT COLOR #1
SHERWIN WILLIAMS
PLD-9
PURE WHITE

PAINT COLOR #2
SHERWIN WILLIAMS
PLD-7
LIQUORICE TINT

PAINT COLOR #3
SHERWIN WILLIAMS
PLD-8
DRAKE



N

KEY PLAN

Browning

CURRAN
ARCHITECTURE
5719 LAWTON LOOP E. DR.
SUITE 212
INDIANAPOLIS, IN 46216
O :: 317 . 288 . 0681
F :: 317 . 288 . 0753

CERTIFICATION

THIS DRAWING AND THE IDEAS, DESIGNS AND CONCEPTS CONTAINED HEREIN ARE THE EXCLUSIVE INTELLECTUAL PROPERTY OF CURRAN ARCHITECTURE, AND ARE NOT TO BE USED OR REPRODUCED, WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF CURRAN ARCHITECTURE.
© *COPYRIGHT 2020, CURRAN ARCHITECTURE*

PROJECT INFORMATION

APM 14

SPECULATIVE WAREHOUSE

--

PLAINFIELD, IN 46168

ISSUE DATES

DESIGN DEVELOPMENT SET	00.00.2021

210004

OVERALL EXTERIOR ELEVATIONS

A201