


BOARDWALK

4-5 Bedrooms | 2.5-3 Bathrooms | 2,662+ sq. ft.
Multiple Flex Spaces | Open-Concept Layout | Everyday Entry®




Boardwalk Home Exteriors



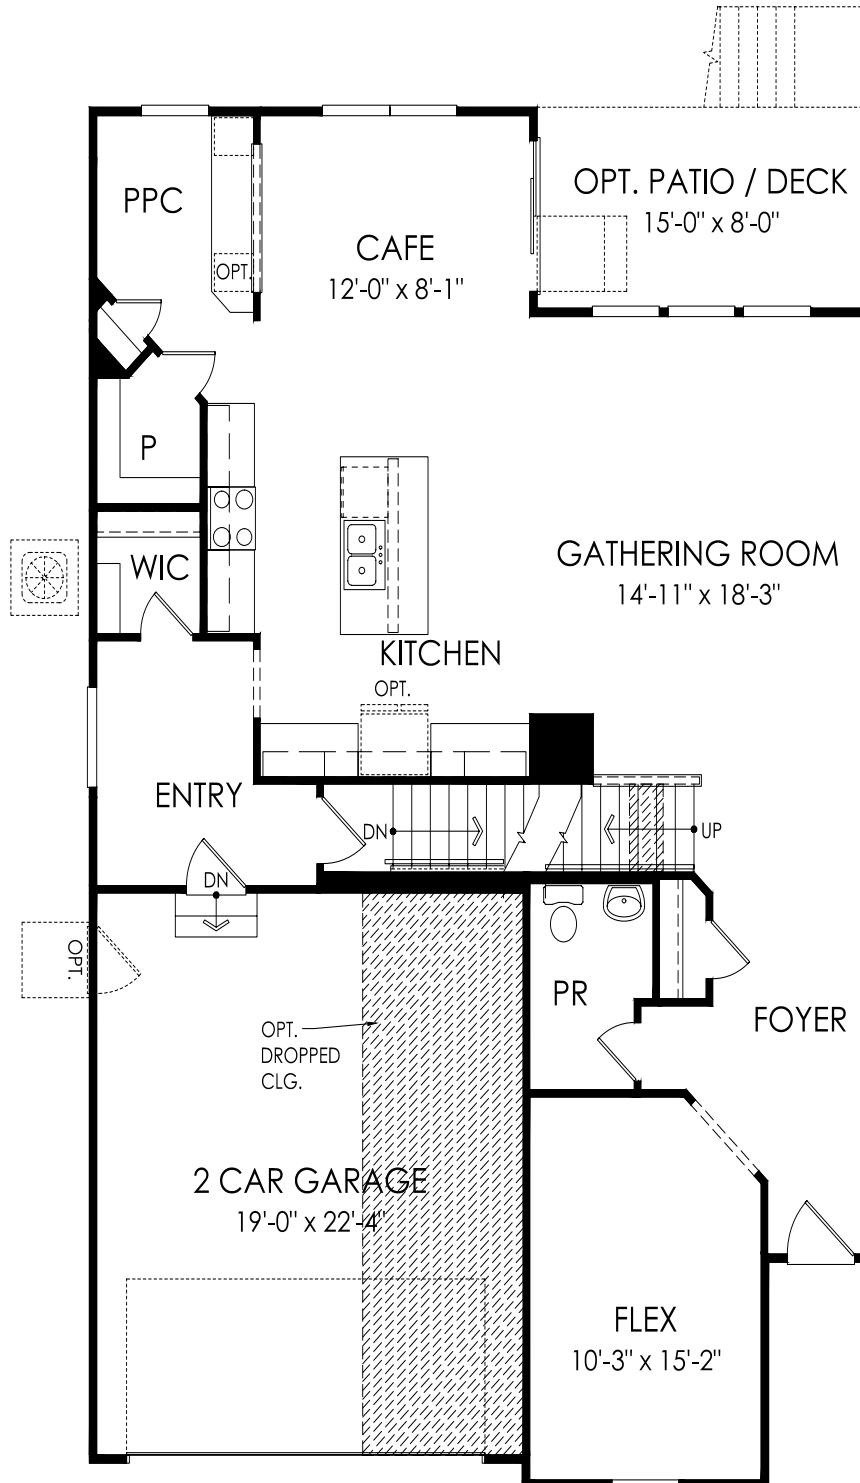

AVAILABLE OPTIONS


Speak with a sales consultant to review all options available for this home design at your community. Interactive floorplans are available on Pulte.com.

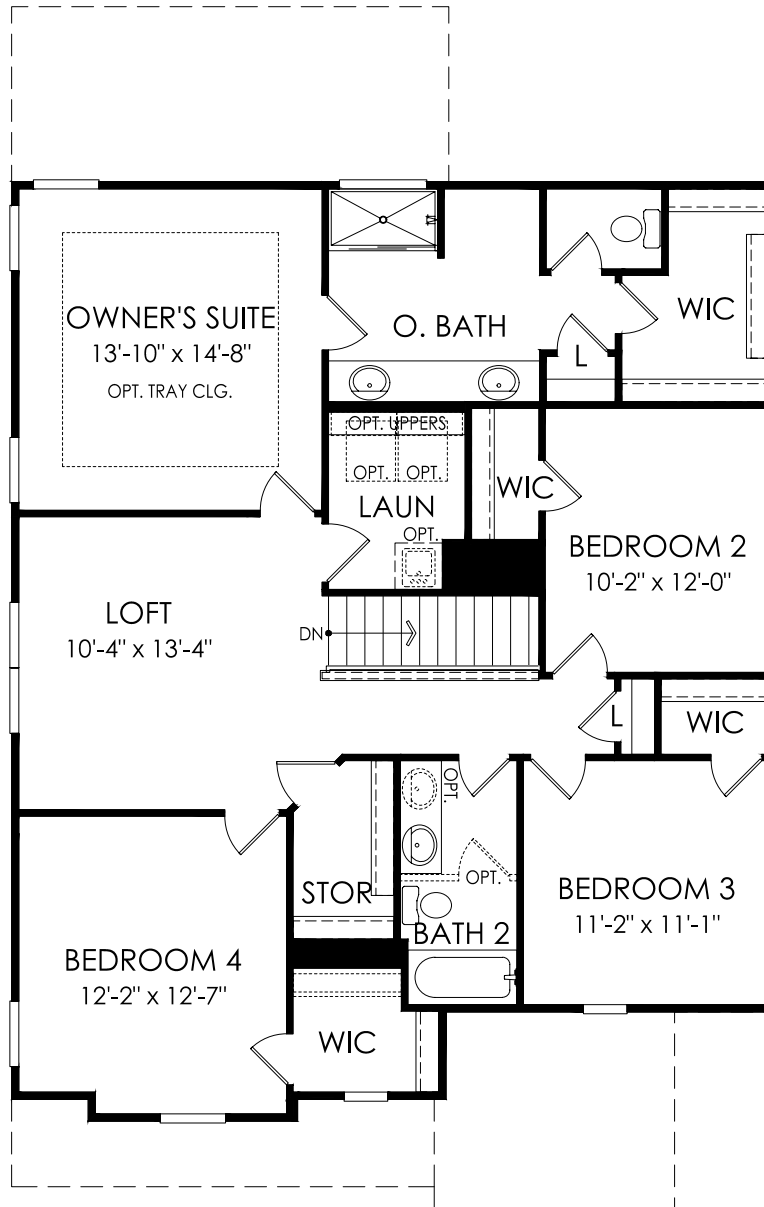

FLOORPLAN NOTES

GENERAL SPECIFICATIONS

- ALL ANGLED WALLS (OTHER THAN THOSE AT 90°) SHALL BE CONSIDERED TO BE AT 45° UNLESS NOTED OTHERWISE
- ALL STUDS AT EXTERIOR AND INTERIOR WALLS SHALL BE 2x4 UNLESS OTHERWISE NOTED
- ALL STUDS AT EXTERIOR WALLS AND INTERIOR BEARING WALLS TO BE FRAMED AT 16" O.C. UNLESS NOTED OTHERWISE
- ALL NON-BEARING WALLS, OTHER THAN IN THE KITCHEN AND PLANNING CENTERS, TO BE 2x4 STUDS AT 24" O.C. UNLESS OTHERWISE NOTED OR RESTRICTED BY LOCAL CODES OR ORDINANCES. KITCHEN AND PLANNING CENTER WALLS WHERE WALL CABINETS ARE TO BE HUNG SHALL BE FRAMED AT 16" O.C.
- PROVIDE DOUBLE 2x4 TOP PLATES AT ALL LOAD BEARING WALLS.
- PROVIDE SINGLE TOP PLATE AT ALL INTERIOR NON-LOADING BEARING WALLS.
- PROVIDE A 1-3/8" OR LARGER SOLID CORE WOOD DOOR, SOLID CORE STEEL DOOR OR HONEYCOMB CORE STEEL DOOR, OR 20 MINUTE FIRE-RATED DOOR EQUIPPED WITH A SELF-CLOSING DEVICE BETWEEN GARAGE AND LIVING SPACE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- PROVIDE FIRE SEPARATION BETWEEN DWELLING AND GARAGE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- PROVIDE 1/2" DRYWALL AT WALLS, CEILING AND UNDERSIDE OF STAIR ASSEMBLY ACCESSIBLE SPACE UNDER STAIRS IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- ALL GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED BY THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE SHALL HAVE A PERMANENT DESIGNATION OR LABEL AFFIXED TO EACH PANE OF GLAZING BEARING THE MANUFACTURER'S LABEL SHOWING THE TYPE AND THICKNESS OF GLASS. FOR OTHER THAN TEMPERED GLASS, LABELS MAY BE OMITTED PROVIDED THE BUILDING OFFICIAL APPROVES THE USE OF A CERTIFICATE, AFFIDAVIT OR OTHER EVIDENCE CONFIRMING COMPLIANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- ALL BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBENT SURFACE, SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT NOT LESS THAN 72" ABOVE THE FLOOR PER THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- PROVIDE THERMO-PLY SHEATHING AND BATT INSULATION FILLING ALL CAVITIES AT EXTERIOR WALLS SURROUNDING TUBS AND SHOWERS.
- ALL REQUIRED GUARDRAILS AND GUARDWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. GUARDS SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE AND NOT LESS THAN 34" HIGH MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS.
- ALL REQUIRED HANDRAILS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. HANDRAILS SHALL BE PROVIDED ON AT LEAST ONE SIDE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHT WITH 4 OR MORE RISERS. HANDRAIL HEIGHT SHALL NOT BE LESS THAN 34" OR MORE THAN 38" AS MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJOINS THE TREAD NOSINGS AND SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL.
- BASEMENTS, HABITABLE ATTICS AND EVERY SLEEPING ROOM MUST HAVE AT LEAST ONE EMERGENCY ESCAPE OR RESCUE OPENING IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. WHERE THE BASEMENT CONTAINS 1 OR MORE SLEEPING ROOMS, EMERGENCY ESCAPE OR RESCUE OPENINGS SHALL BE REQUIRED IN EACH SLEEPING ROOM. THE EMERGENCY ESCAPE OR RESCUE OPENING SHALL HAVE A CLEAR 5.7 SQUARE FEET OF OPEN AREA WITH A SILL HEIGHT OF NO MORE THAN 44" ABOVE THE FLOOR OR 5.0 SQUARE FEET OF OPEN AREA FOR GRADE-LEVEL WINDOWS. THE CLEAR OPENING SHALL A MINIMUM OF 24" OF OPENING HEIGHT AND 20" OPENING WIDTH. EMERGENCY ESCAPE AND RESCUE OPENINGS WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GROUND LEVEL ELEVATION SHALL BE PROVIDED WITH A WINDOW WELL AND LADDER IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES.
- FOR ADDITIONAL INFORMATION SEE STRUCTURAL DRAWINGS AND NOTES

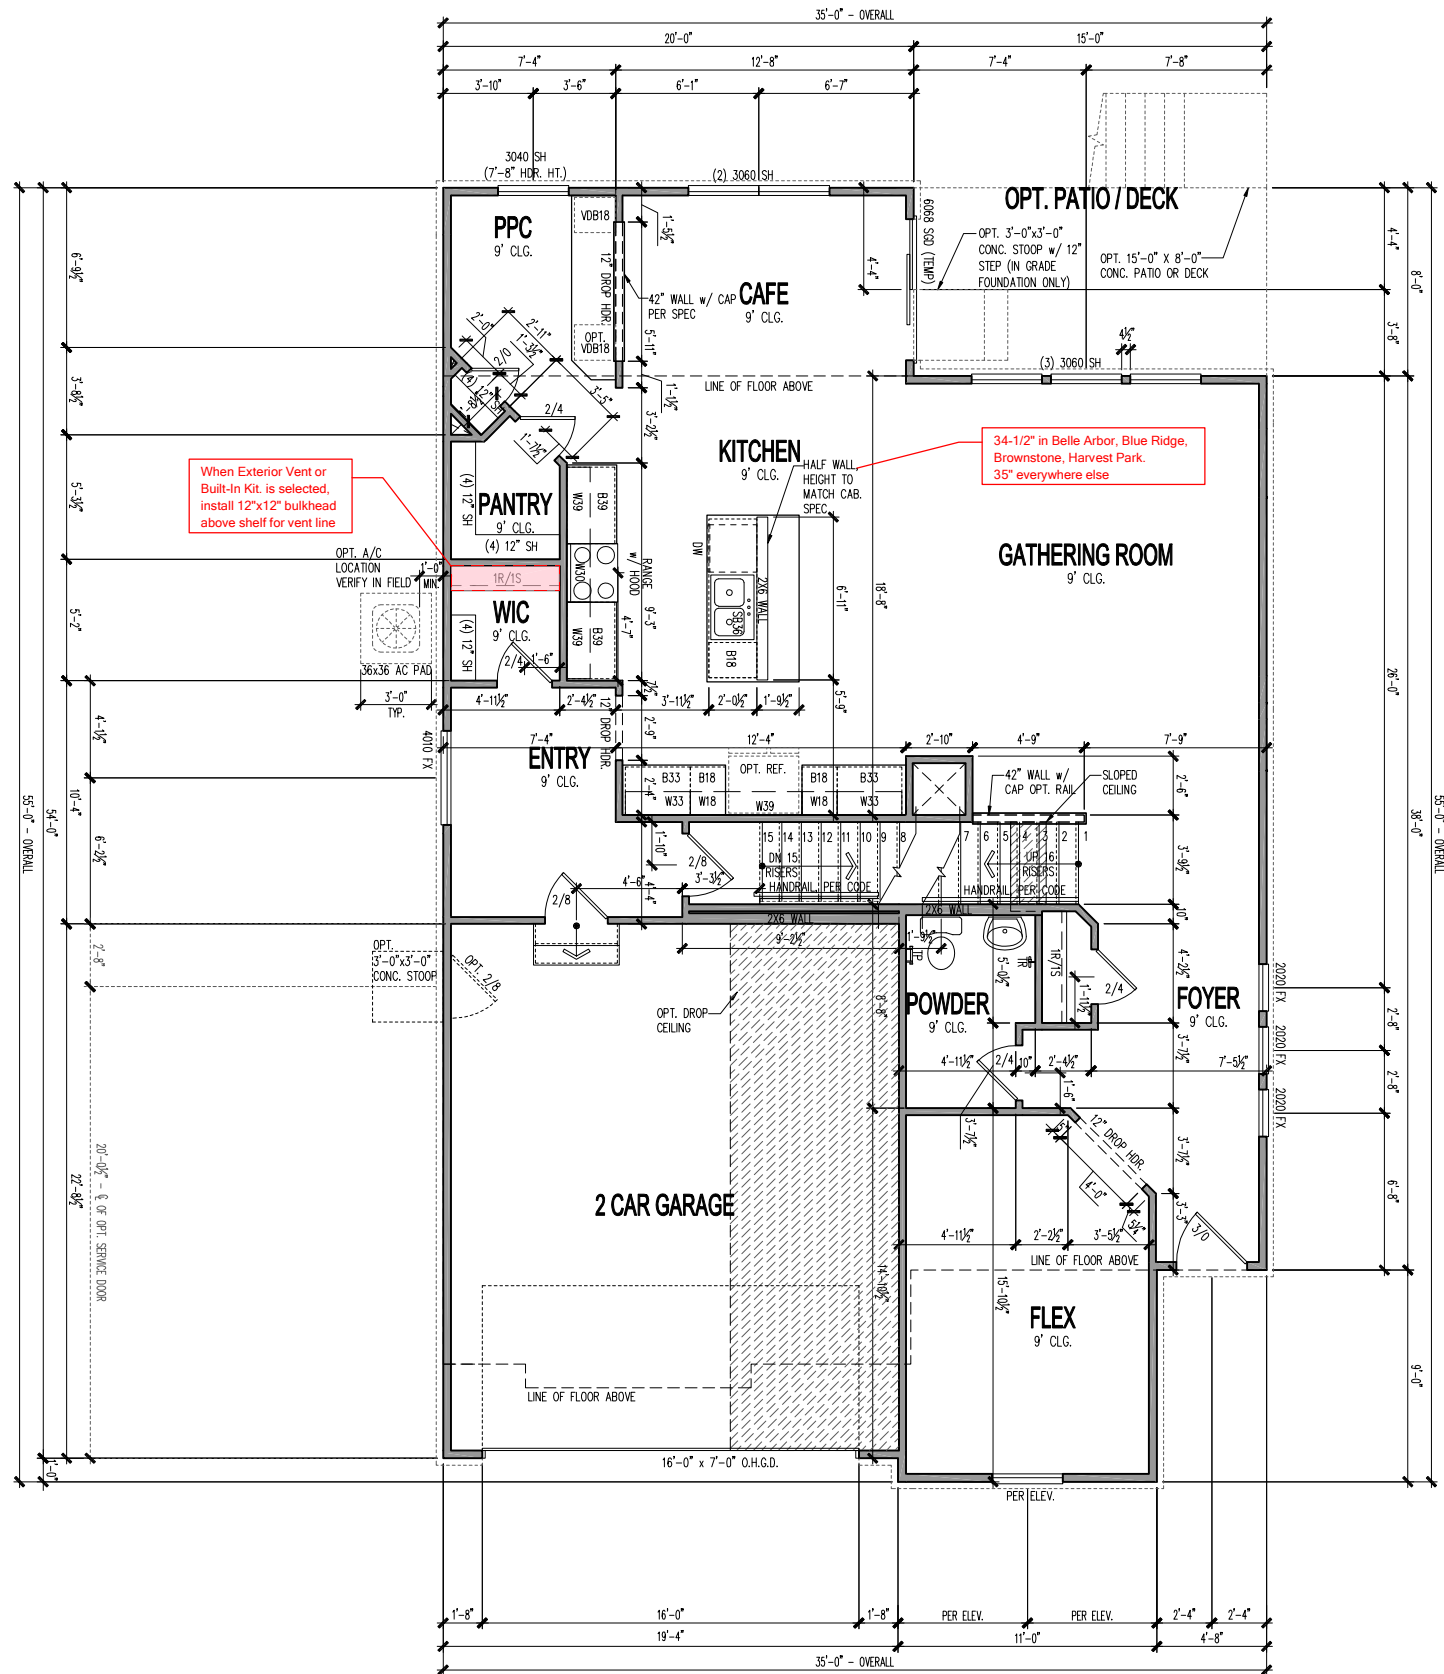

FIRST FLOOR PLAN - 4" WALLS

SCALE: 1/4" = 1'-0"

PRODUCTION MANAGER	Rick Starkey
INITIAL RELEASE DATE:	09/30/2014
CURRENT RELEASE DATE:	08/01/2017

REV #	DATE	DESCRIPTION
△	12/21/2015	
△	01/11/2016	PLAN REVISIONS
△	08/19/2016	PCR REVISIONS
△	08/01/2017	PLAN REVISIONS
△	09/14/2018	PCR REVISIONS
△	09/20/2019	PCR REVISIONS

GARAGE HANDING
LEFT


PLAN NAME
BOARDWALK
NPS PLAN NUMBER
1956.300
LAWSON PLAN ID

SHEET
A1
4-1.1

FLOORPLAN NOTES

GENERAL SPECIFICATIONS

- ALL ANGLED WALLS (OTHER THAN THOSE AT 90°) SHALL BE CONSIDERED TO BE AT 45° UNLESS NOTED OTHERWISE
- ALL STUDS AT EXTERIOR AND INTERIOR WALLS SHALL BE 2x4 UNLESS OTHERWISE NOTED
- ALL STUDS AT EXTERIOR WALLS AND INTERIOR BEARING WALLS TO BE FRAMED AT 16" O.C. UNLESS NOTED OTHERWISE
- ALL NON-BEARING WALLS, OTHER THAN IN THE KITCHEN AND PLANNING CENTERS, TO BE 2x4 STUDS AT 24" O.C. UNLESS OTHERWISE NOTED OR RESTRICTED BY LOCAL CODES OR ORDINANCES. KITCHEN AND PLANNING CENTER WALLS WHERE WALL CABINETS ARE TO BE HUNG SHALL BE FRAMED AT 16" O.C.
- PROVIDE DOUBLE 2x TOP PLATES AT ALL LOAD BEARING WALLS.
- PROVIDE SINGLE TOP PLATE AT ALL INTERIOR NON-LOADING BEARING WALLS.
- PROVIDE A 1-3/8" OR LARGER SOLID CORE WOOD DOOR, SOLID CORE STEEL DOOR OR HONEYCOMB CORE STEEL DOOR, OR 20 MINUTE FIRE-RATED DOOR EQUIPPED WITH A SELF-CLOSING DEVICE BETWEEN GARAGE AND LIVING SPACE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- PROVIDE FIRE SEPARATION BETWEEN DWELLING AND GARAGE IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- PROVIDE 1/2" DRYWALL AT WALLS, CEILING AND UNDERSIDE OF STAIR ASSEMBLY ACCESSIBLE SPACE UNDER STAIRS IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- ALL GLAZING INSTALLED IN HAZARDOUS LOCATIONS AS DEFINED BY THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE SHALL HAVE A PERMANENT DESIGNATION OR LABEL AFFIXED TO EACH PANE OF GLAZING BEARING THE MANUFACTURER'S LABEL SHOWING THE TYPE AND THICKNESS OF GLASS. FOR OTHER THAN TEMPERED GLASS, LABELS MAY BE OMITTED PROVIDED THE BUILDING OFFICIAL APPROVES THE USE OF A CERTIFICATE, AFFIDAVIT OR OTHER EVIDENCE CONFIRMING COMPLIANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- ALL BATHUBS AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON-ABSORBENT SURFACE, SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT NOT LESS THAN 72" ABOVE THE FLOOR PER THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODE.
- PROVIDE THERMO-PLY SHEATHING AND BATT INSULATION FILLING ALL CAVITIES AT EXTERIOR WALLS SURROUNDING TUBS AND SHOWERS.
- ALL REQUIRED GUARDRAILS AND GUARDWALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. GUARDS SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE AND NOT LESS THAN 34" HIGH MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJUNS THE TREAD NOSINGS.
- ALL REQUIRED HANDRAILS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. HANDRAILS SHALL BE PROVIDED ON AT LEAST ONE SIDE OF EACH CONTINUOUS RUN OF TREADS OR FLIGHT WITH 4 OR MORE RISERS. HANDRAIL HEIGHT SHALL NOT BE LESS THAN 34" OR MORE THAN 38" AS MEASURED VERTICALLY FROM THE SLOPED PLANE THAT ADJUNS THE TREAD NOSINGS AND SHALL BE CONTINUOUS FOR THE FULL LENGTH OF THE FLIGHT. HANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL.
- BASEMENTS, HABITABLE ATTICS AND EVERY SLEEPING ROOM MUST HAVE AT LEAST ONE EMERGENCY ESCAPE OR RESCUE OPENING IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES. WHERE THE BASEMENT CONTAINS 1 OR MORE SLEEPING ROOMS, EMERGENCY ESCAPE OR RESCUE OPENINGS SHALL BE REQUIRED IN EACH SLEEPING ROOM. THE EMERGENCY ESCAPE OR RESCUE OPENING SHALL HAVE A CLEAR 5.7 SQUARE FEET OF OPEN AREA WITH A SILL HEIGHT OF NO MORE THAN 44" ABOVE THE FLOOR OR 5.0 SQUARE FEET OF OPEN AREA FOR GRADE-FLOOR WINDOWS. THE CLEAR OPENING SHALL A MINIMUM OF 24" OF OPENING HEIGHT AND 20" OPENING WIDTH. EMERGENCY ESCAPE AND RESCUE OPENINGS WITH A FINISHED SILL HEIGHT BELOW THE ADJACENT GROUND LEVEL ELEVATION SHALL BE PROVIDED WITH A WINDOW WELL AND LADDER IN ACCORDANCE WITH THE CURRENTLY ADOPTED EDITION OF THE IRC OR APPLICABLE LOCAL CODES.
- FOR ADDITIONAL INFORMATION SEE STRUCTURAL DRAWINGS AND NOTES

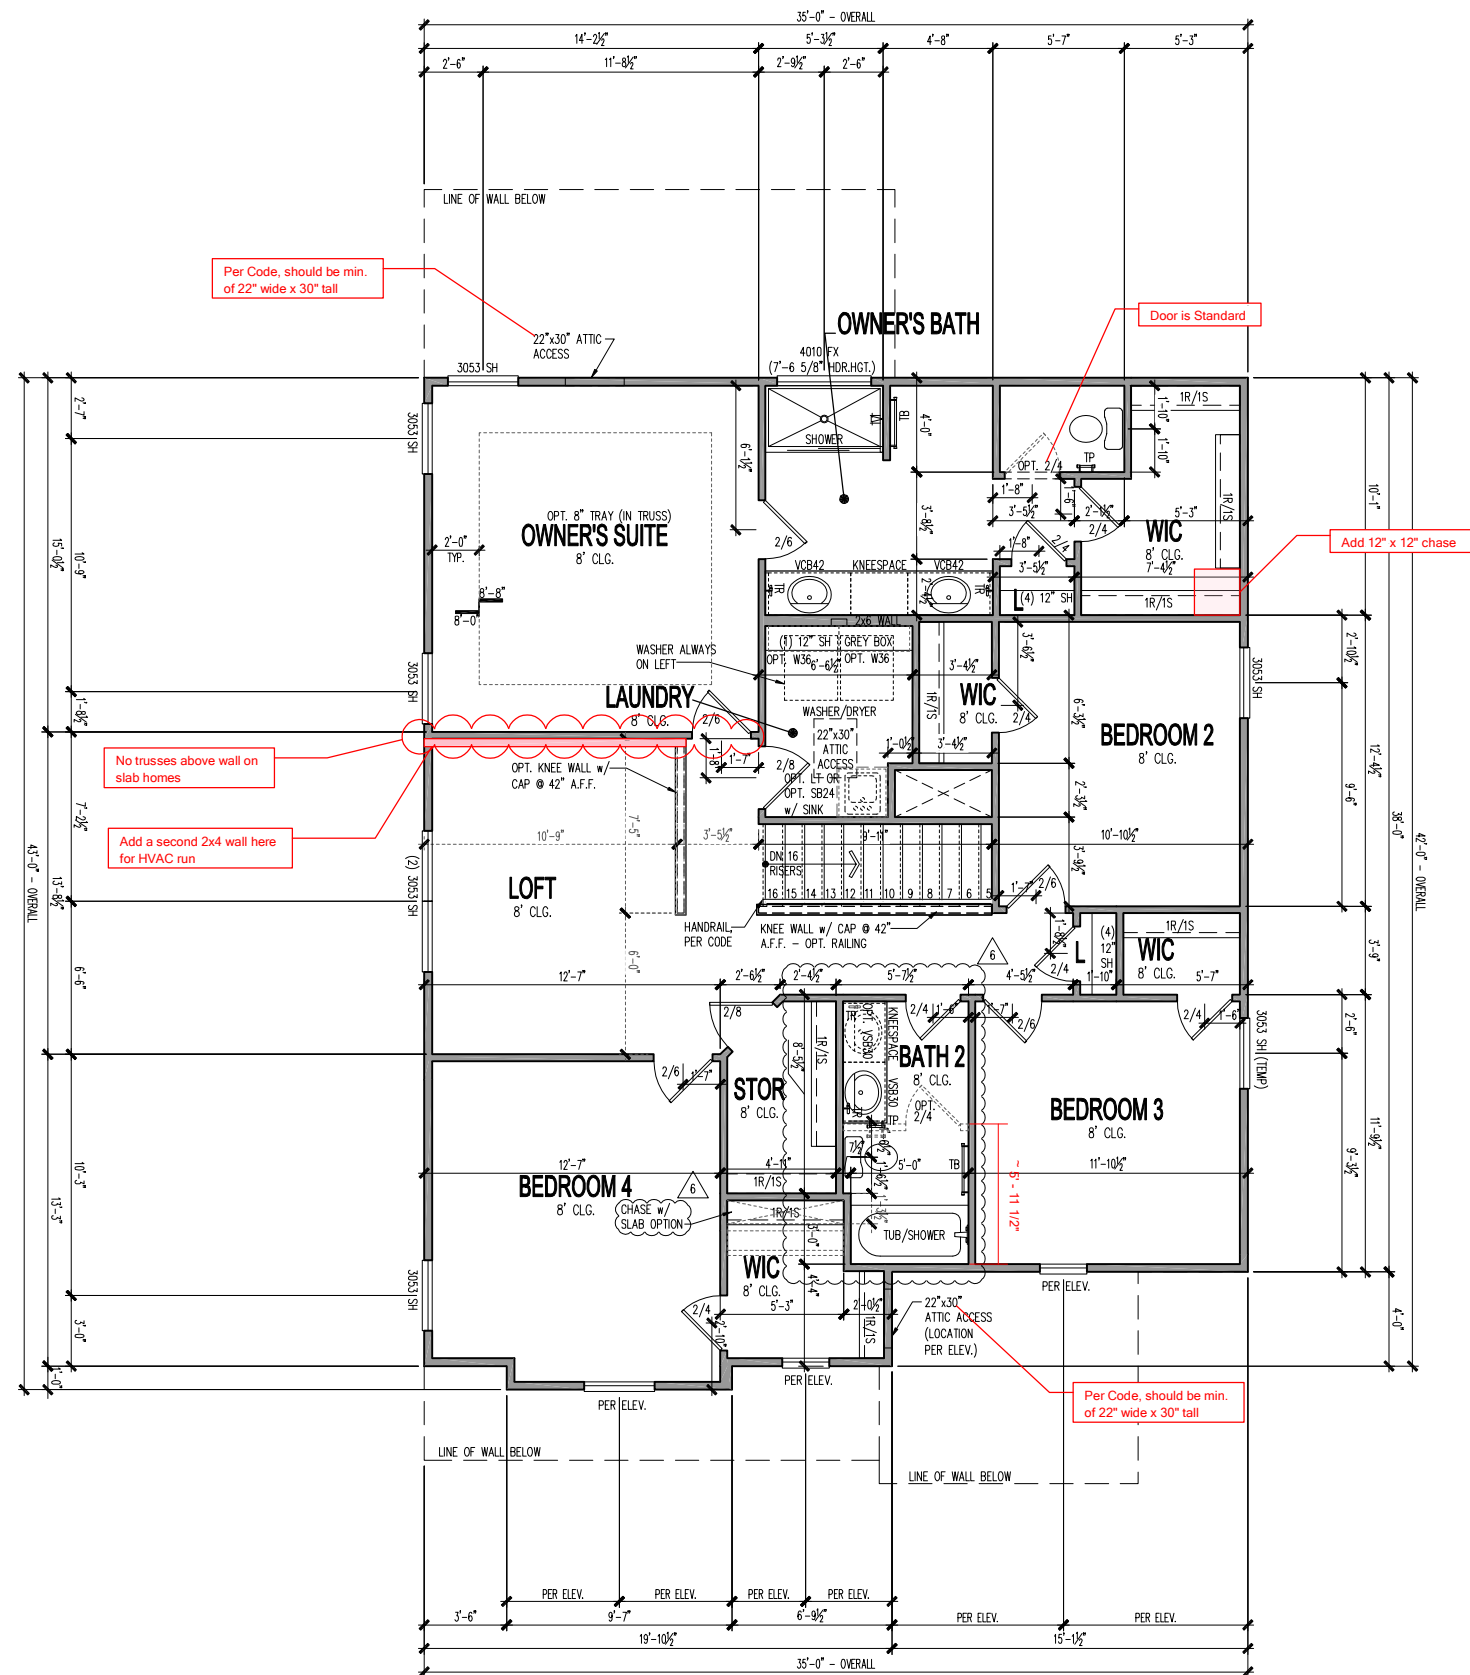

SECOND FLOOR PLAN - 4" WALLS

SCALE: 1/4" = 1'-0"

PRODUCTION MANAGER	Rick Starkey
INITIAL RELEASE DATE:	09/30/2014
CURRENT RELEASE DATE:	08/01/2017

REV #	DATE	DESCRIPTION
1	12/21/2015	
2	01/11/2016	PLAN REVISIONS
3	08/19/2016	PCR REVISIONS
4	08/01/2017	PLAN REVISIONS
5	09/14/2018	PCR REVISIONS
6	09/20/2019	PCR REVISIONS

GARAGE HANDING
LEFT

PLAN NAME
BOARDWALK
NPS PLAN NUMBER
1956.300
LAWSON PLAN ID

SHEET
A1
42.1

ATTIC VENT SCHEDULE


VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE
 **CONTRACTORS INSTALLING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS
 *SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50-50% OF TOTAL AND RIDGE AT 40-50% OF TOTAL REQUIRED VENTILATION

Low Country 2G


ROOF AREA "A"		SQ FTG		1419		AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. IN. MIN)	POT SMALL (SQ. IN. MIN)	RIDGE VENT (SQ. IN. PER LF)	EAVE VENT (SQ. IN. PER LF)	CONT. VENT (SQ. IN. PER SF)			
HIGH - POT VENTS ONLY	1.89 - 2.37	2.54	48.41	6	0						
AT EAVE	2.84 - 2.37	2.71	51.89			18.00	28.00	10.00		0	39.00
TOTAL (MIN)	4.73	4.73	5.25	100.00							
HIGH - RIDGE VENT	1.89 - 2.37	2.30	48.00	0	0	20.00					
AT EAVE	2.84 - 2.37	2.71	52.00							0	39.00
TOTAL (MIN)	4.73	4.73	5.21	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE						

ROOF AREA "B"		SQ FTG		160		AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. IN. MIN)	POT SMALL (SQ. IN. MIN)	RIDGE VENT (SQ. IN. PER LF)	EAVE VENT (SQ. IN. PER LF)	CONT. VENT (SQ. IN. PER SF)			
HIGH - POT VENTS ONLY	0.21 - 0.27	0.42	46.56	1	0						
AT EAVE	0.32 - 0.27	0.49	53.44			61.00	40.00	18.00	28.00	10.00	
TOTAL (MIN)	0.53	0.53	0.91	100.00							
HIGH - RIDGE VENT	0.21 - 0.27	0.38	43.55	0	0	3.00					
AT EAVE	0.32 - 0.27	0.49	56.45							0	7.00
TOTAL (MIN)	0.53	0.53	0.86	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE						


ROOF AREA "C"		SQ FTG		209		AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. IN. MIN)	POT SMALL (SQ. IN. MIN)	RIDGE VENT (SQ. IN. PER LF)	EAVE VENT (SQ. IN. PER LF)	CONT. VENT (SQ. IN. PER SF)			
HIGH - POT VENTS ONLY	0.28 - 0.35	0.42	46.56	1	0						
AT EAVE	0.42 - 0.35	0.49	53.44			61.00	40.00	18.00	28.00	10.00	
TOTAL (MIN)	0.70	0.70	0.91	100.00							
HIGH - RIDGE VENT	0.28 - 0.35	0.38	43.55	0	0	3.00					
AT EAVE	0.42 - 0.35	0.49	56.45							0	7.00
TOTAL (MIN)	0.70	0.70	0.86	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE						




SIDE AND REAR WINDOWS PER COMMUNITY SPECS
SCALE: 1/4" = 1'-0"

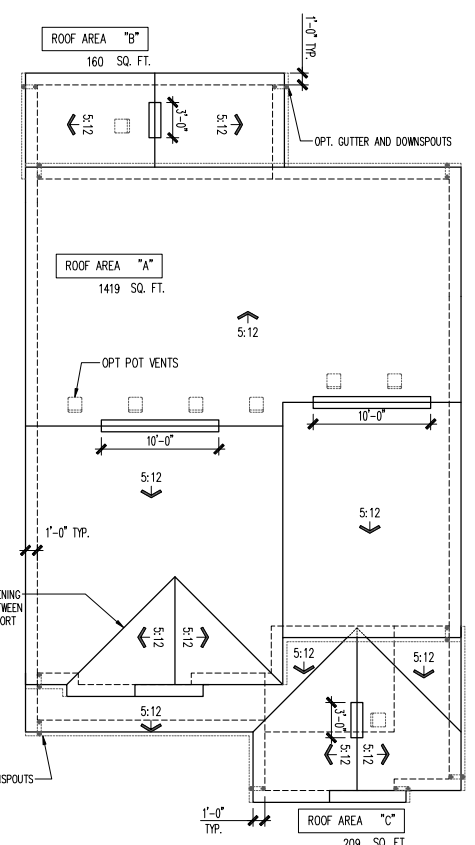


ROOF PLAN
SCALE: 1/8" = 1'-0"

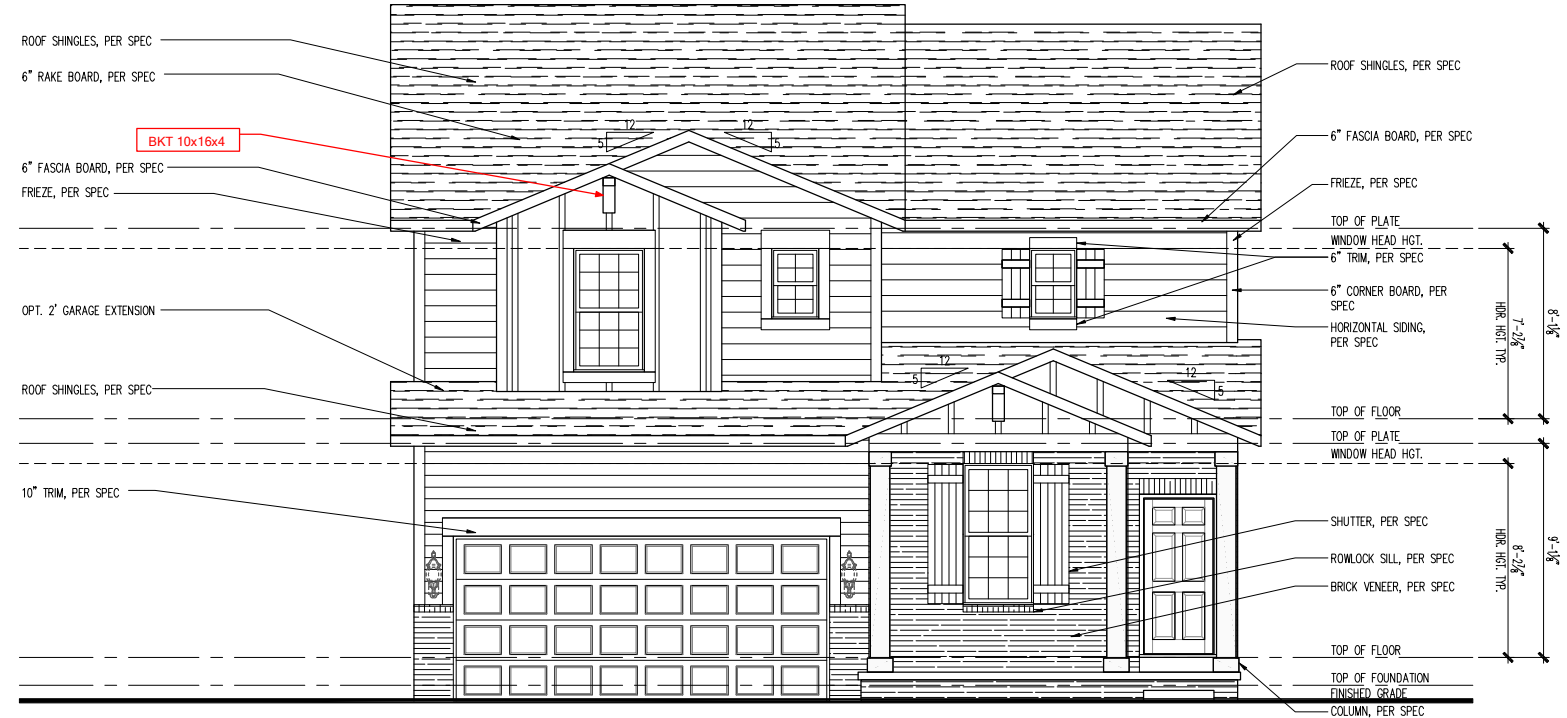


FRONT ELEVATION
SCALE: 1/4" = 1'-0"

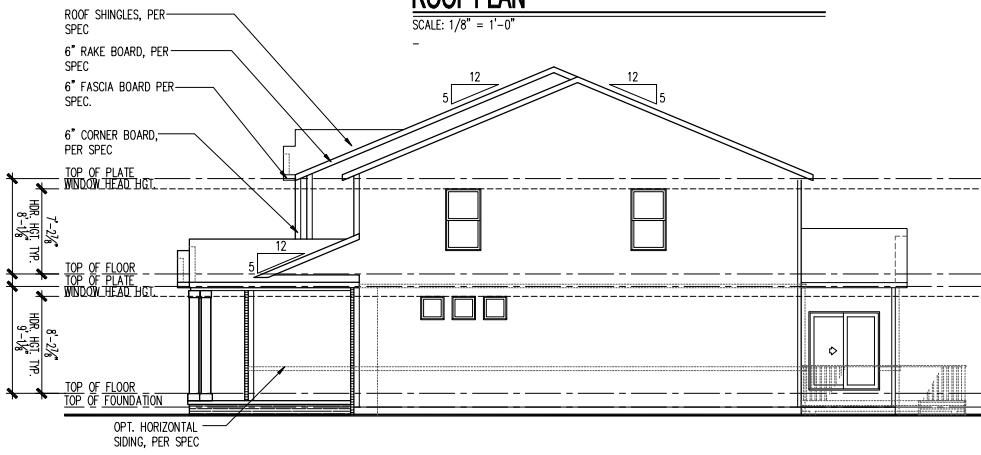

RIGHT ELEVATION
SCALE: 1/8" = 1'-0"

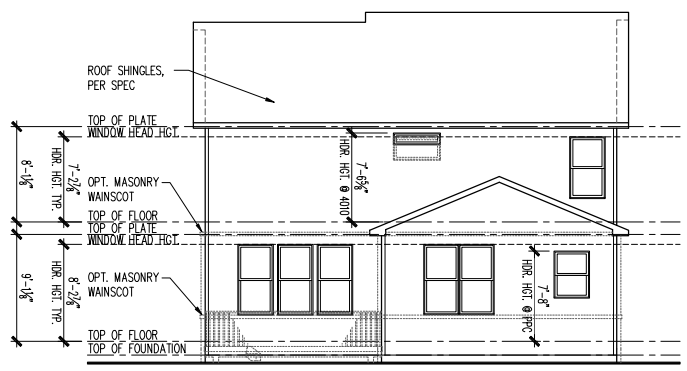

REAR ELEVATION
SCALE: 1/8" = 1'-0"

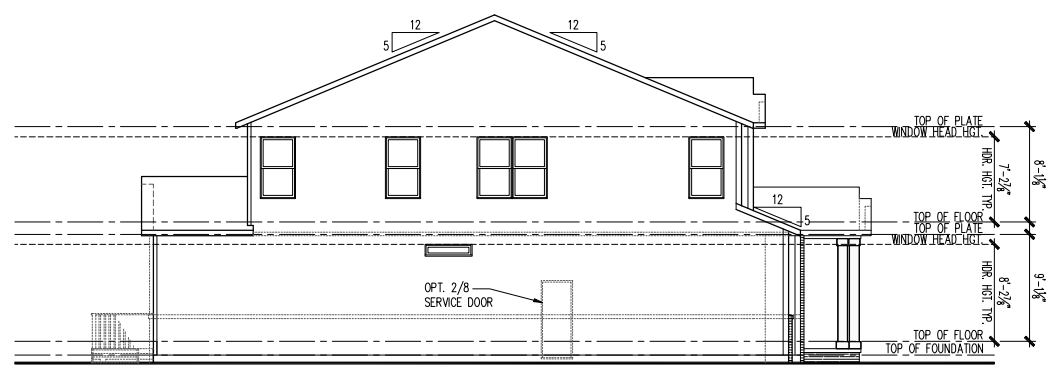

LEFT ELEVATION
SCALE: 1/8" = 1'-0"

Midwest Zone Office
1900 E. Golf Road, - Suite 300
Schaumburg, Illinois 60173



Elevation L2G
2 Car Front Entry
Front, Side and Rear Elevations, Roof Plan and Ventilation Schedule

PRODUCTION MANAGER
Rick Storkewitz
INITIAL RELEASE DATE: 09/30/2014
CURRENT RELEASE DATE: 08/01/2017

REV #	DATE	DESCRIPTION
1	12/21/2015	
2	01/11/2016	PLAN REVISIONS
3	08/19/2016	PCR REVISIONS
4	08/01/2017	PLAN REVISIONS
5	09/14/2018	PCR REVISIONS
6	09/20/2019	PCR REVISIONS

GARAGE HANDING
LEFT



PLAN NAME
BOARDWALK
NPC PLAN NUMBER
1956.300
LAWSON PLAN ID

SHEET
A3-LC2G
2FB.1

SCHEDULE of AREAS

BASE HOUSE - HEATED	
FIRST FLOOR	1257
SECOND FLOOR	1405
TOTAL BASE HEATED	2662
BASE HOUSE - UNDER ROOF	
GARAGE - 2 CAR FRONT ENTRY	487
BASEMENT	1207
TOTAL BASE UNDER ROOF	1744
BASE OPTIONS - HEATED	
SUNROOM	120
MODERN FIREPLACE	18
MECHANICAL CLOSET AT SLAB OPTION	12
FINISHED BASEMENT OPTIONS	
FINISHED BASEMENT	801
MECHANICAL / STORAGE	221
STORAGE W/ FINISHED BASEMENT	153
ADDITIONAL AREA W/ SUNROOM	120
BASE OPTIONS	
HOUSE SLAB	1257
BASEMENT / SUNROOM	120
SLAB / SUNROOM	120
COVERED PORCH	120
COVERED PORCH W/ FIREPLACE	120
WOOD DECK	120
WOOD DECK W/ SUNROOM	150
CONCRETE PATIO	120
CONCRETE PATIO W/ SUNROOM	150
3 CAR FRONT GARAGE	200

ELEVATION LC2G	
ADDITIONAL 1ST FLOOR - HEATED	0
TOTAL 1ST FLOOR	1257
ADDITIONAL 2ND FLOOR - HEATED	5
TOTAL 2ND FLOOR	1410
TOTAL ELEV. HEATED	2667
ADDITIONAL GARAGE - 2 CAR FRONT	0
TOTAL GARAGE	487
ADDITIONAL HOUSE SLAB	0
TOTAL HOUSE SLAB	1257
FRONT PORCH	121
TOTAL ELEV. FOOTPRINT	1865

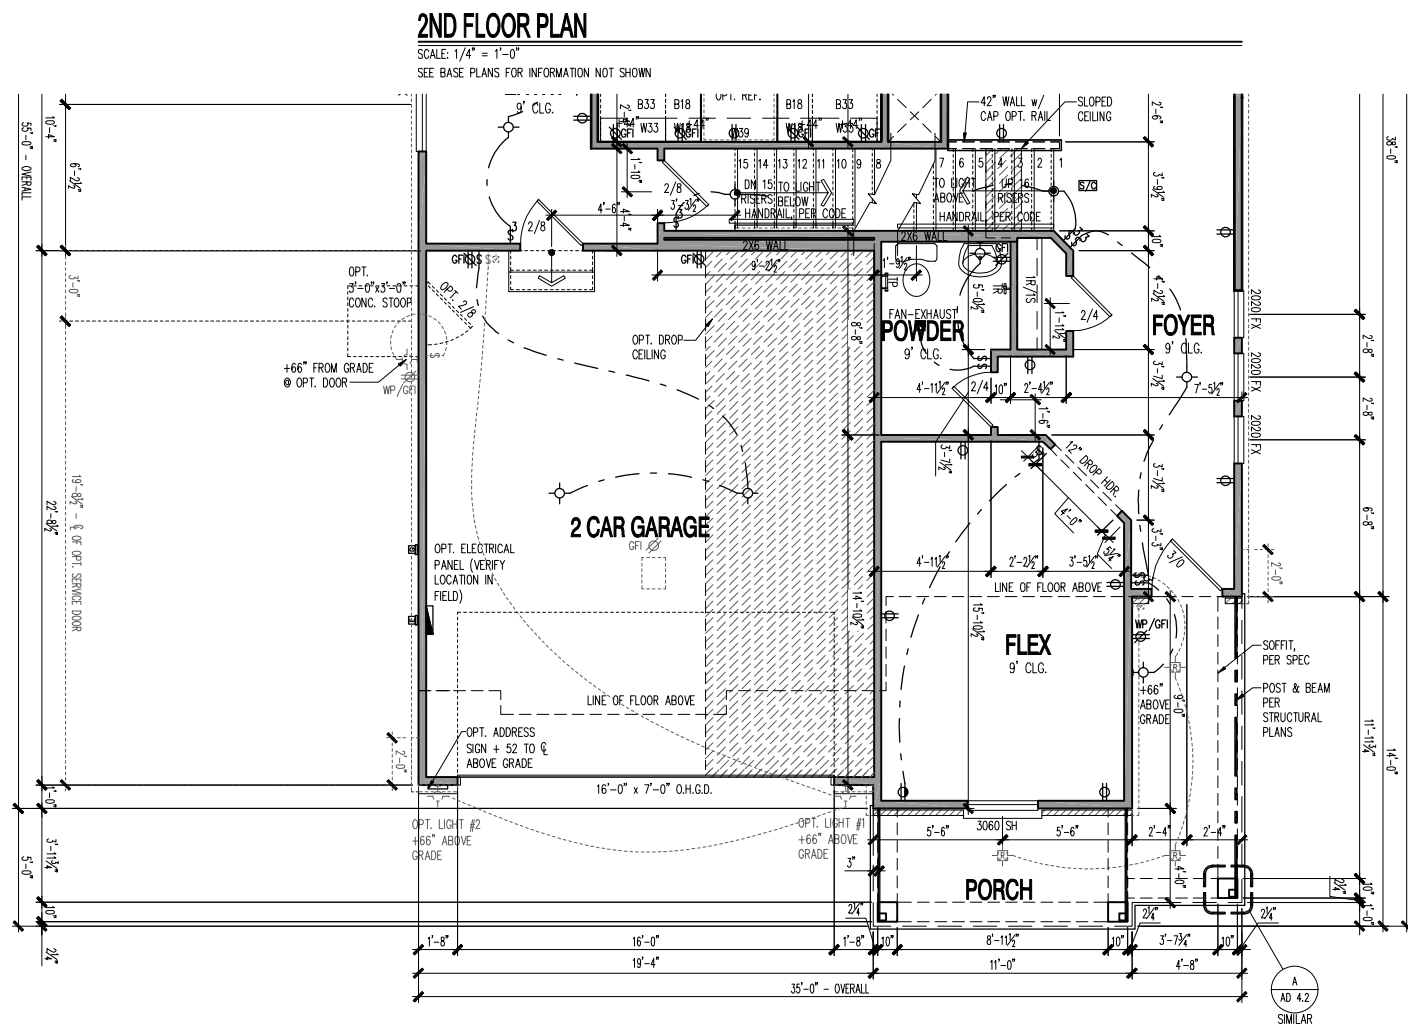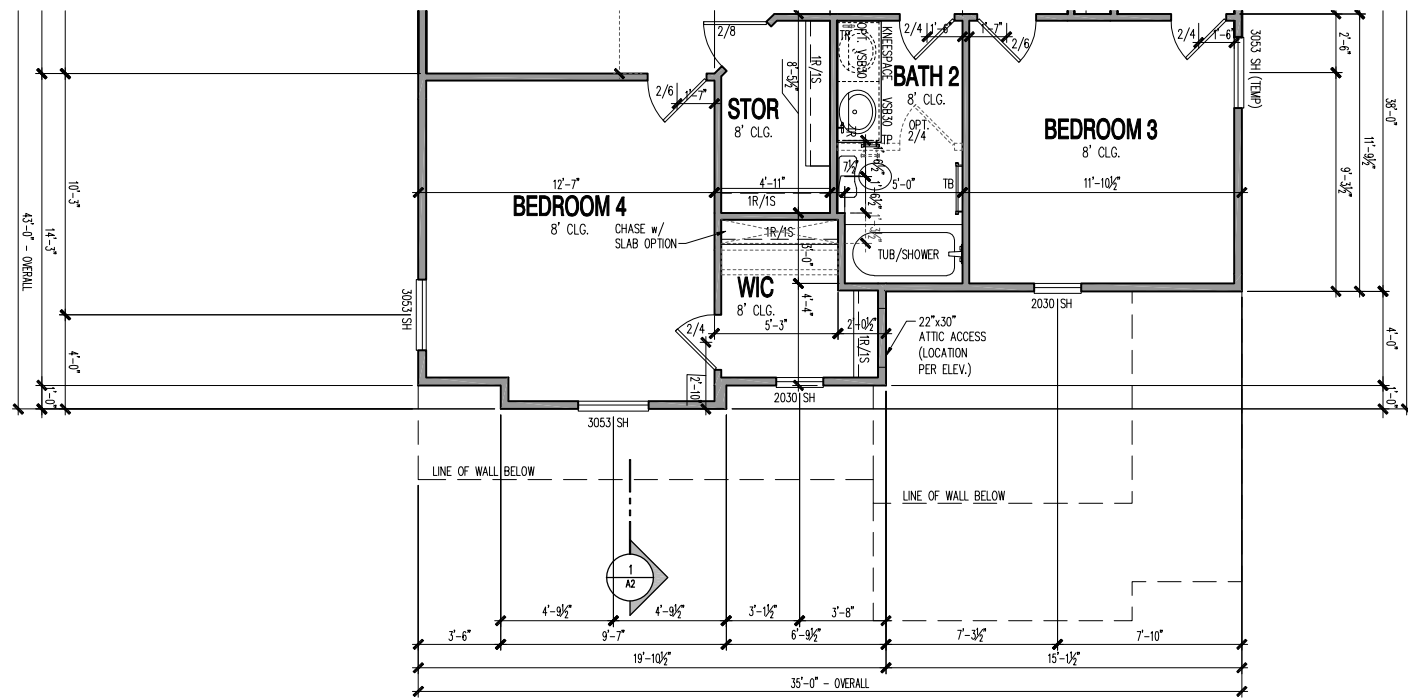

(c) Copyright Pulite Home Corporation - 2019

Midwest Zone Office
1900 E. Golf Road, - Suite 300
Schaumburg, Illinois 60173



Elevation LC2G
2 Car Front Entry
Partial Floor and Utility Plans

PRODUCTION MANAGER
Rick Stupkev
INITIAL RELEASE DATE:
09/30/2014
CURRENT RELEASE DATE:
08/01/2017

REV #	DATE / DESCRIPTION
1	12/21/2015
2	01/11/2016
3	08/19/2016
4	08/01/2017
5	09/14/2018
6	09/20/2019

GARAGE HANDING
LEFT

PLAN NAME
BOARDWALK
NPC PLAN NUMBER
1966.300
LAWSON PLAN ID

SHEET
A3-LC2G
2FB4.3

NOTE: SCALES NOTED ON DRAWINGS RELATE TO FULL SIZE PLOTS ON 22x34 SHEETS - 11x17 SHEETS REPRESENT 1/2 SCALE PLOTS

ATTIC VENT SCHEDULE


VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE
 **CONTRACTOR INSTALLING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS
 *SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 45-DEG. OF TOTAL AND RIDGE AT 45-DEG. OF TOTAL REQUIRED VENTILATION

Heartland 2C

ROOF AREA "A"		1419		AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. IN. EACH)	POT SMALL (SQ. IN. EACH)	RIDGE VENT (SQ. IN. PER LF)	EAVE VENT (SQ. IN. EACH)	CONT. VENT (SQ. IN. PER LF)	
HIGH - POT VENTS ONLY	1.89 - 2.37	2.34	48.41	4	0				
AT EAVE	2.84 - 2.37	2.71	51.59				0	39.00	
TOTAL (MIN)	4.73 - 4.73	5.25	100.00						
HIGH - RIDGE VENT	1.89 - 2.37	2.30	48.00	0	0	20.00			
AT EAVE	2.84 - 2.37	2.71	52.00				0	39.00	
TOTAL (MIN)	4.73 - 4.73	5.21	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE					


ROOF AREA "B"		160		AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. IN. EACH)	POT SMALL (SQ. IN. EACH)	RIDGE VENT (SQ. IN. PER LF)	EAVE VENT (SQ. IN. EACH)	CONT. VENT (SQ. IN. PER LF)	
HIGH - POT VENTS ONLY	0.21 - 0.27	0.42	46.56	1	0				
AT EAVE	0.32 - 0.27	0.49	33.44				0	7.00	
TOTAL (MIN)	0.53 - 0.53	0.91	100.00						
HIGH - RIDGE VENT	0.21 - 0.27	0.38	43.55	0	0	3.00			
AT EAVE	0.32 - 0.27	0.49	56.45				0	7.00	
TOTAL (MIN)	0.53 - 0.53	0.86	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE					

ROOF AREA "C"		276		AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. IN. EACH)	POT SMALL (SQ. IN. EACH)	RIDGE VENT (SQ. IN. PER LF)	EAVE VENT (SQ. IN. EACH)	CONT. VENT (SQ. IN. PER LF)	
HIGH - POT VENTS ONLY	0.37 - 0.44	0.42	43.26	1	0				
AT EAVE	0.55 - 0.44	0.56	56.74				0	8.00	
TOTAL (MIN)	0.92 - 0.92	0.98	100.00						
HIGH - RIDGE VENT	0.37 - 0.44	0.38	40.30	0	0	3.00			
AT EAVE	0.55 - 0.44	0.56	59.70				0	8.00	
TOTAL (MIN)	0.92 - 0.92	0.93	100.00	ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE					

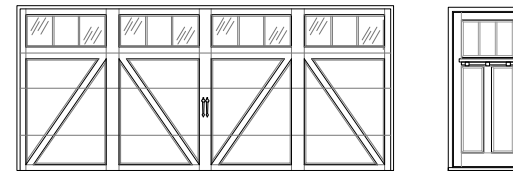


UPGRADED DOOR OPTION

SCALE: 1/4" = 1'-0"




SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"

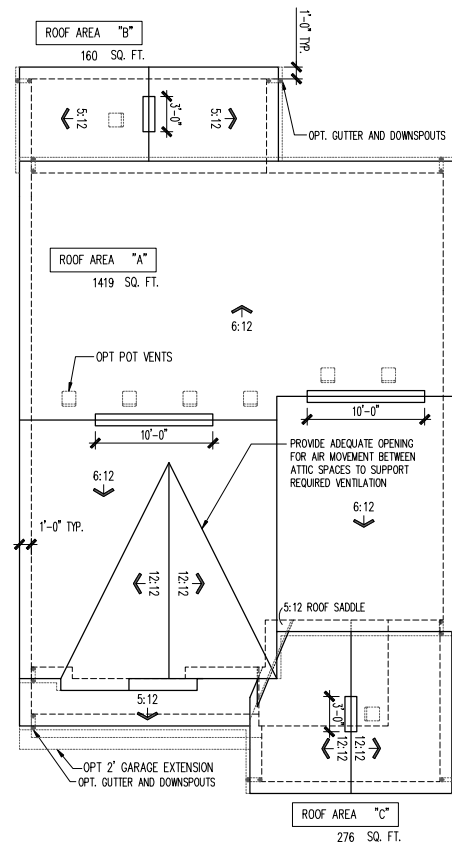


ROOF PLAN

SCALE: 1/8" = 1'-0"

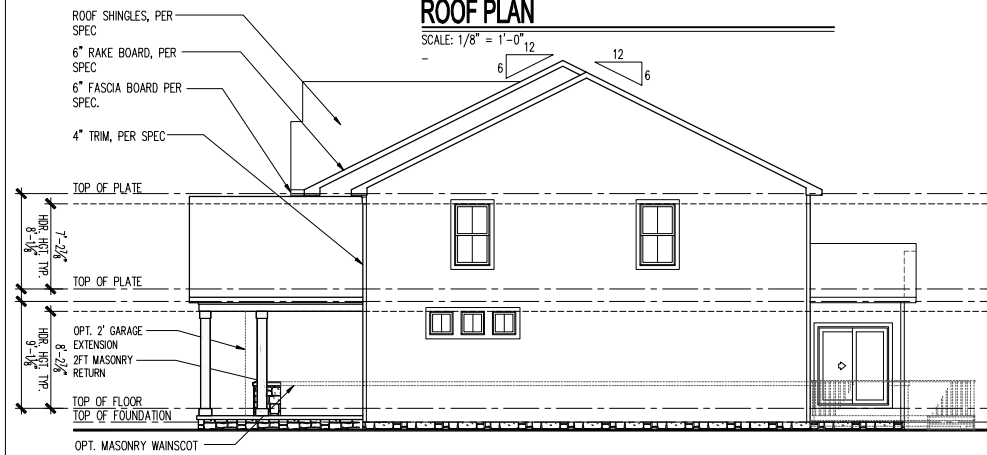

RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

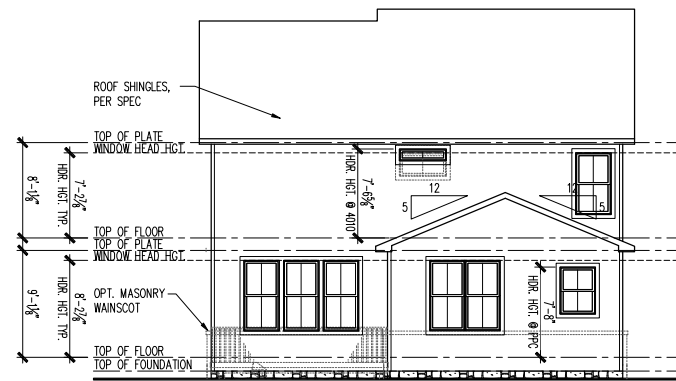


REAR ELEVATION

SCALE: 1/8" = 1'-0"



FRONT ELEVATION

SCALE: 1/4" = 1'-0"

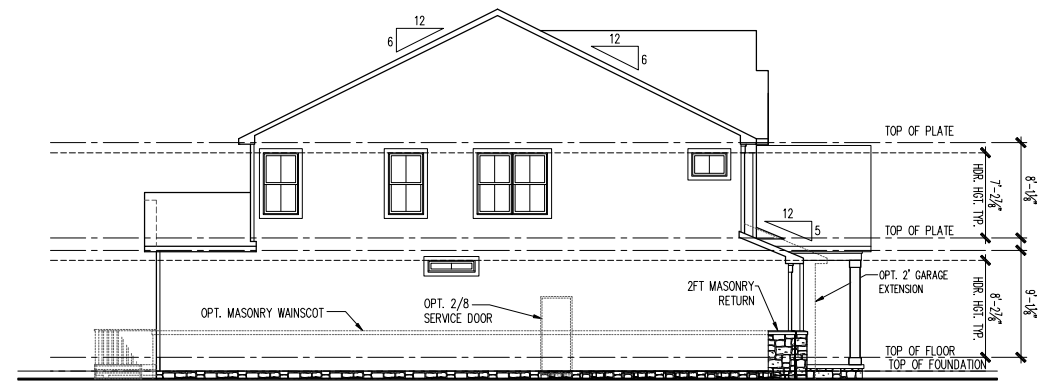

LEFT ELEVATION

SCALE: 1/8" = 1'-0"

NO WINDOW GRIDS OR TRIM ON/AROUND SIDE OR REAR WINDOWS unless noted in community specs.

PLOTTED: October 27, 2021 / Nhi Nguyen Van / A3-HR2C_2FB.1.DWG

© Copyright Pulite Home Corporation - 2019

Midwest Zone Office
1900 E. Golf Road, - Suite 300
Schaumburg, Illinois 60173



Elevation HR2C - Farmhouse w/ Masonry Wainscot Option
2 Car Front Entry
Front, Side and Rear Elevations, Roof Plan and Ventilation Schedule

PRODUCTION MANAGER Rick Storkewitz INITIAL RELEASE DATE: 09/30/2014 CURRENT RELEASE DATE: 08/01/2017	
REV #	DATE / DESCRIPTION
1	12/21/2015
2	01/11/2016
3	08/19/2016
4	08/01/2017
5	09/14/2018
6	09/20/2019
7	06/04/2021
8	12/31/2021
9	
GARAGE HANDING LEFT	
PLAN NAME BOARDWALK	
NPC PLAN NUMBER 1956.300	
LAWSON PLAN ID -	
SHEET A3-HR2C	
2FB.11	

NOTE: SCALES NOTED ON DRAWINGS RELATE TO FULL SIZE PLOTS ON 22x34 SHEETS - 11x17 SHEETS REPRESENT 1/2 SCALE PLOTS


ELEVATION HR2C

ADDITIONAL 1ST FLOOR - HEATED	0
TOTAL 1ST FLOOR	1304
ADDITIONAL 2ND FLOOR - HEATED	14
TOTAL 2ND FLOOR	1419
TOTAL ELEV. HEATED	2723
ADDITIONAL GARAGE - 2 CAR FRONT	0
TOTAL GARAGE	440
ADDITIONAL HOUSE SLAB	0
TOTAL HOUSE SLAB	1257
FRONT PORCH	120
TOTAL ELEV. FOOTPRINT	1864

LIGHT & VENT SCHEDULE


ROOM NAME	AREA	REQUIRED		SUPPLIED	
		LIGHT	VENT	LIGHT	VENT
FLEX	151.62	12.13	6.06	27.40	11.80
BEDROOM 3	125.63	10.05	5.03	11.70	5.00
BEDROOM 4	163.41	13.07	6.54	35.10	15.00

** REFER TO LIGHT & VENT SCHEDULE ON COVER SHT. FOR INFORMATION NOT SHOWN HERE.

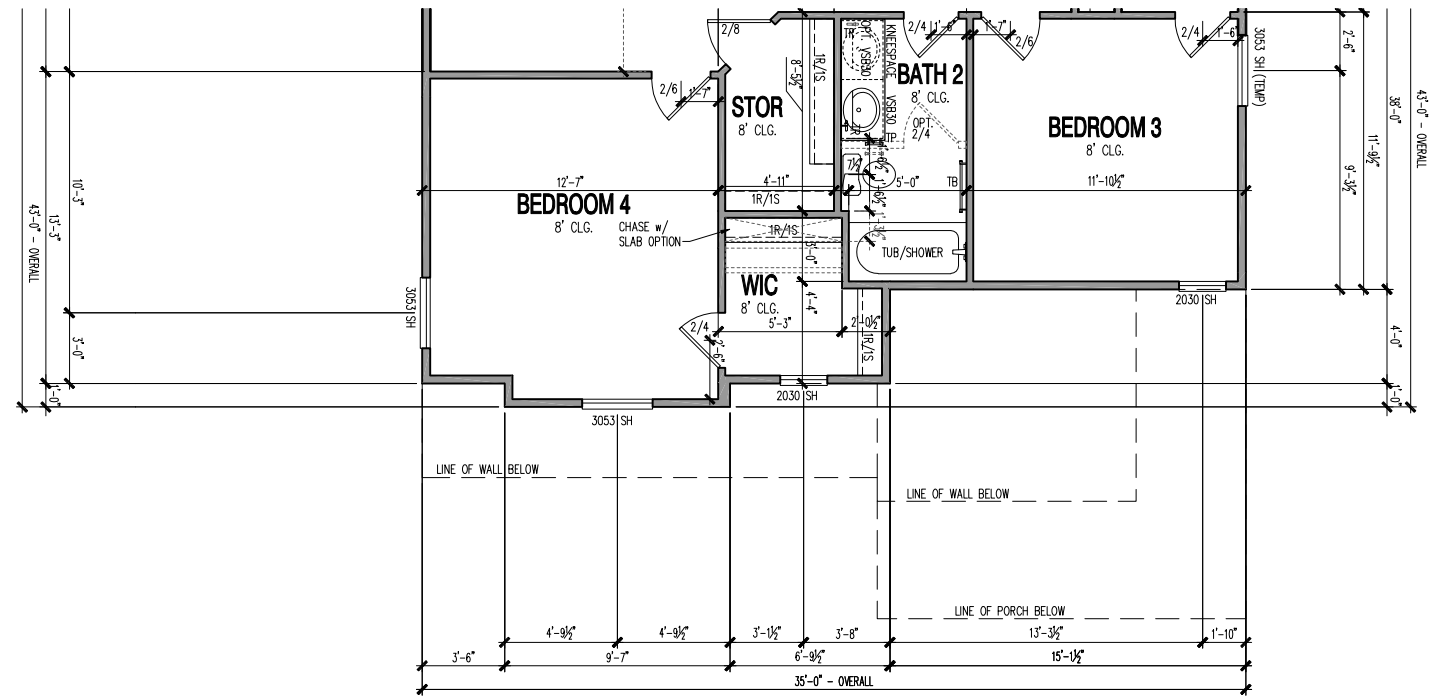

2ND FLOOR PLAN

SCALE: 1/4" = 1'-0"
SEE BASE PLANS FOR INFORMATION NOT SHOWN

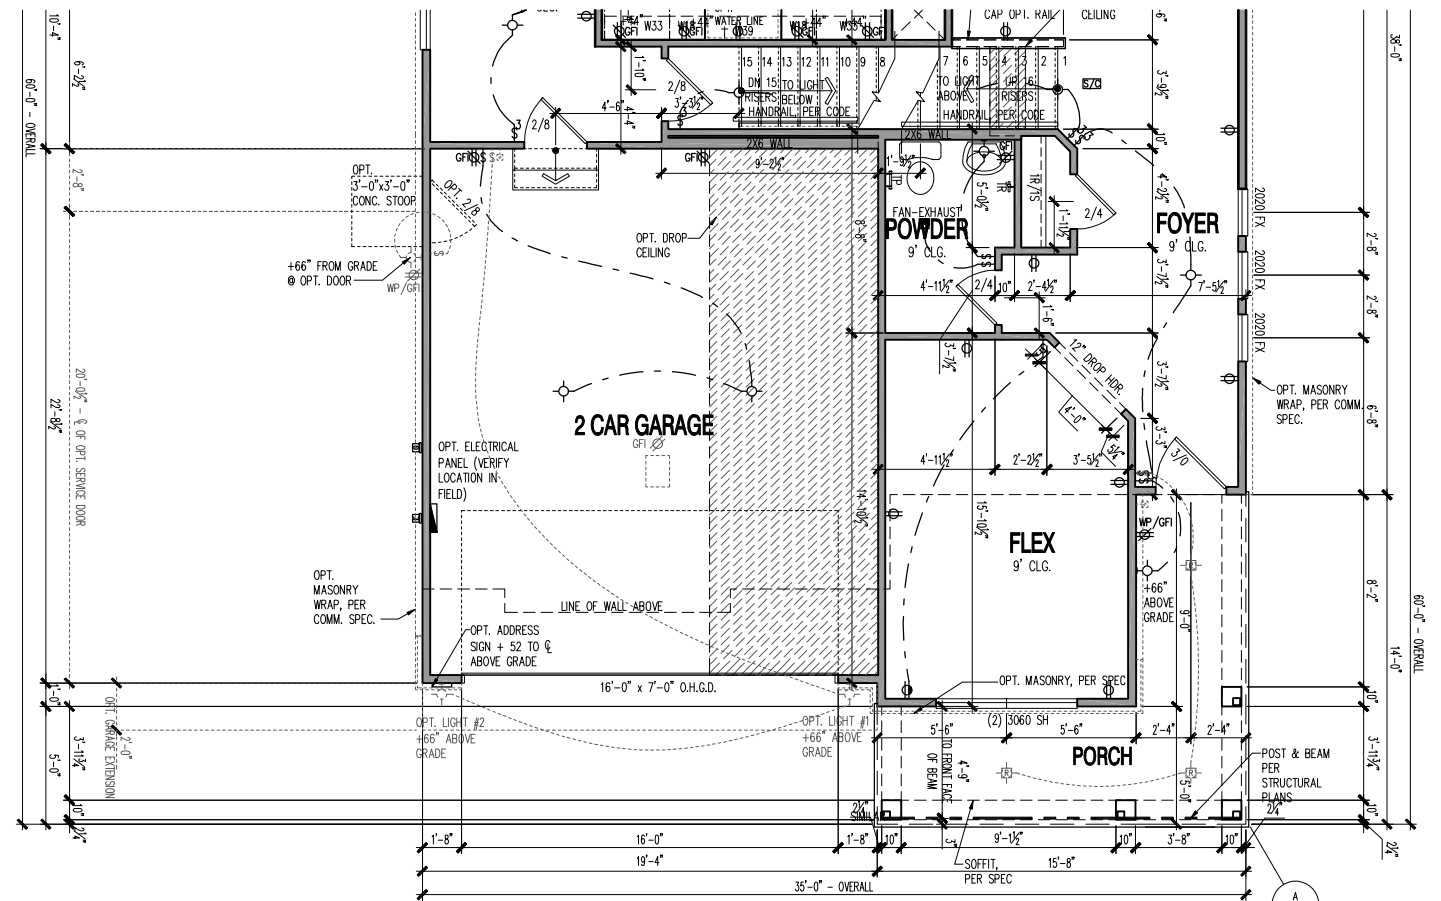

1ST FLOOR PLAN

SCALE: 1/4" = 1'-0"
SEE BASE PLANS FOR INFORMATION NOT SHOWN

Midwest Zone Office
1900 E. Golf Road, - Suite 300
Schaumburg, Illinois 60173



Elevation HR2C - Farmhouse
2 Car Front Entry
Partial Floor and Utility Plans - 6' Exterior Walls

PRODUCTION MANAGER	Rich Stimpney
INITIAL RELEASE DATE:	09/30/2014
CURRENT RELEASE DATE:	08/01/2017

REV #	DATE / DESCRIPTION
1	12/21/2015
2	01/11/2016
3	08/19/2016
4	08/01/2017
5	09/14/2018
6	09/20/2019
7	06/04/2021
8	12/31/2021
9	06/04/2021
10	12/31/2021


GARAGE HANDING
LEFT

PLAN NAME
BOARDWALK
NPC PLAN NUMBER
1956.300
LAWSON PLAN ID

SHEET
A3-HR2C
2FB4.3


ATTIC VENT SCHEDULE									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE									
* CONTRACTORS INSTALLING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS									
** SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT SIDES OF TOTAL AND RIDGE AT 45-DEGREE TOTAL REQUIRED VENTILATION									
Euro Country 2H									
ROOF AREA "A"		SQ. FTG	1683	AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. IN. PER SQ. FT.)	POT SMALL (SQ. IN. PER SQ. FT.)	RIDGE VENT (SQ. IN. PER SQ. FT.)	EAVE VENT (SQ. IN. PER SQ. FT.)	CONT. VENT (SQ. IN. PER SQ. FT.)	
HIGH - POT VENTS ONLY	2.24 - 2.81	3.39	49.39	8	0	18.00	28.00	10.00	
AT EAVE	3.37 - 2.81	3.47	50.61				0	80.00	
TOTAL (MIN)	5.61	5.61	6.86	100.00					
HIGH - RIDGE VENT	2.24 - 2.81	3.39	49.39	8	0	0.00			
AT EAVE	3.37 - 2.81	3.47	50.61				0	80.00	
TOTAL (MIN)	5.61	5.61	6.86	100.00					ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE

ROOF AREA "B"		SQ. FTG	160	AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. IN. PER SQ. FT.)	POT SMALL (SQ. IN. PER SQ. FT.)	RIDGE VENT (SQ. IN. PER SQ. FT.)	EAVE VENT (SQ. IN. PER SQ. FT.)	CONT. VENT (SQ. IN. PER SQ. FT.)	
HIGH - POT VENTS ONLY	0.21 - 0.27	0.42	46.56	1	0				
AT EAVE	0.32 - 0.27	0.49	53.44				0	7.00	
TOTAL (MIN)	0.53	0.53	0.91	100.00					
HIGH - RIDGE VENT	0.21 - 0.27	0.38	43.55	0	0	3.00			
AT EAVE	0.32 - 0.27	0.49	56.45				0	7.00	
TOTAL (MIN)	0.53	0.53	0.86	100.00					ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE



SIDE AND REAR WINDOWS PER COMMUNITY SPECS


SCALE: 1/4" = 1'-0"

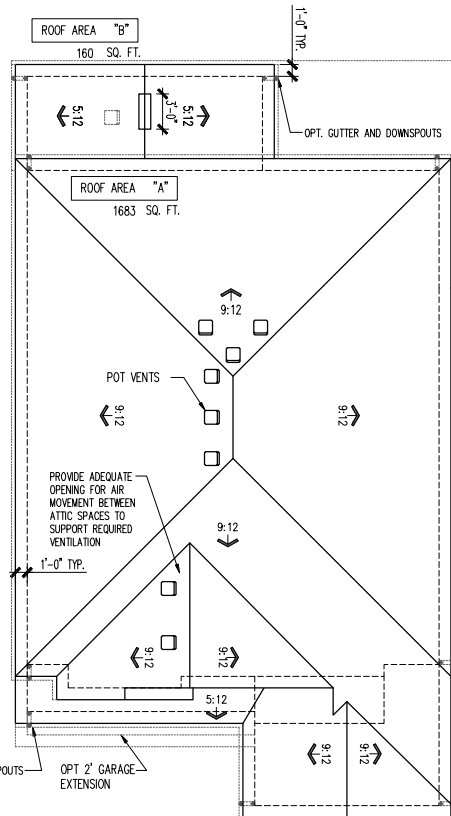

ROOF PLAN


SCALE: 1/8" = 1'-0"

NO WINDOW GRIDS OR TRIM ON/AROUND SIDE OR REAR WINDOWS unless noted in community specs.

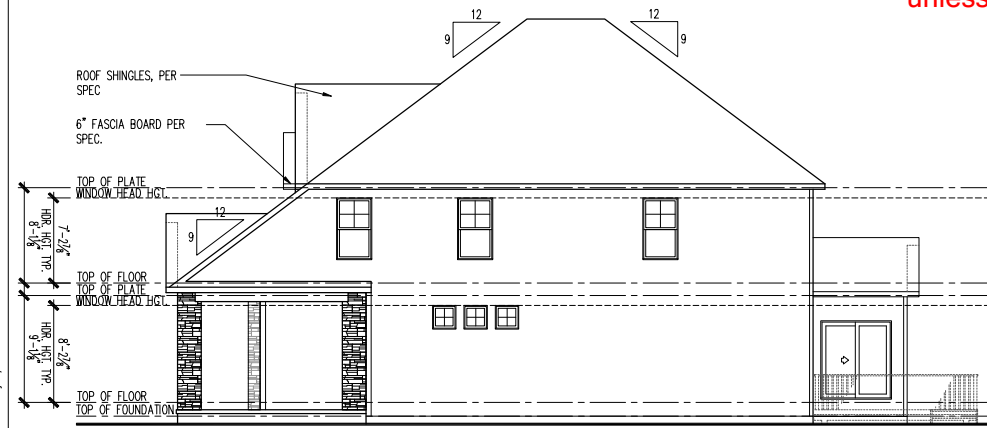


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

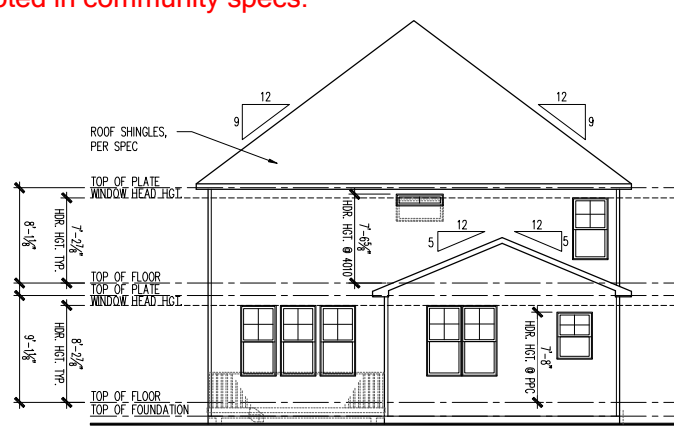

REAR ELEVATION

SCALE: 1/8" = 1'-0"

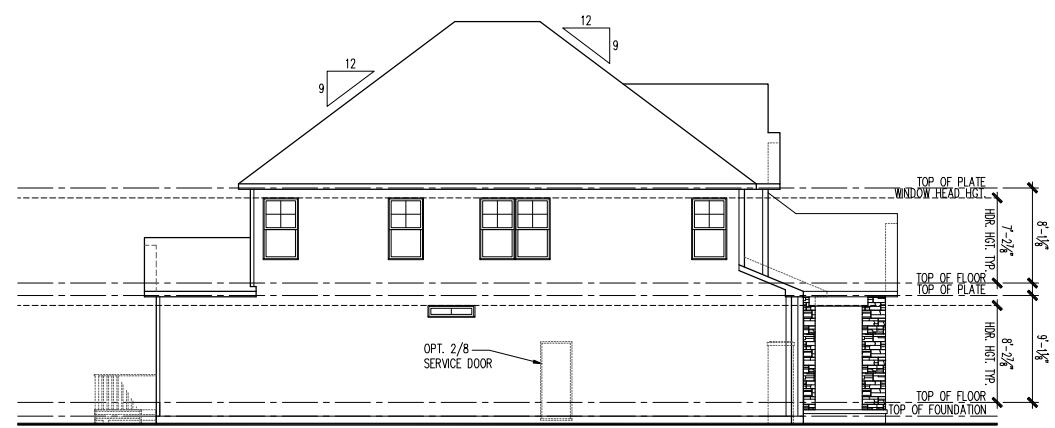

LEFT ELEVATION

SCALE: 1/8" = 1'-0"



FRONT ELEVATION

SCALE: 1/4" = 1'-0"

PLOTTED: September 11, 2019 / Sean Leheny / A3-EC2H_ZFB1.DWG

(c) Copyright: Pulte Home Corporation - 2019

Midwest Zone Office
1900 E. Golf Road, - Suite 300
Schaumburg, Illinois 60173



Euro Country 2H
2 Car Front Entry
Front, Side and Rear Elevations, Roof Plan and Ventilation Schedule

PRODUCTION MANAGER
Rick Starkey
INITIAL RELEASE DATE:
09/30/2014
CURRENT RELEASE DATE:
08/01/2017

REV #	DATE / DESCRIPTION
1	12/21/2015
2	01/11/2016
3	08/19/2016
4	08/01/2017
5	09/14/2018
6	09/20/2019

GARAGE HANDING
LEFT

PLAN NAME
BOARDWALK
NPS PLAN NUMBER
1956.300
LAWSON PLAN ID

SHEET
A3-EC2H
2FB.1

NOTE: SCALES NOTED ON DRAWINGS RELATE TO FULL SIZE PLOTS ON 22x34 SHEETS - 11x17 SHEETS REPRESENT 1/2 SCALE PLOTS


SCHEDULE of AREAS

BASE HOUSE - HEATED	
FIRST FLOOR	1257
SECOND FLOOR	1405
TOTAL BASE HEATED	2662
BASE HOUSE - UNDER ROOF	
GARAGE - 2 CAR FRONT ENTRY	487
BASEMENT	1207
TOTAL BASE UNDER ROOF	1744
BASE OPTIONS - HEATED	
SUNROOM	120
MODERN FIREPLACE	18
MECHANICAL CLOSET AT SLAB OPTION	12
FINISHED BASEMENT OPTIONS	
FINISHED BASEMENT	801
MECHANICAL / STORAGE	221
STORAGE W/ FINISHED BASEMENT	153
ADDITIONAL AREA W/ SUNROOM	120
BASE OPTIONS	
HOUSE SLAB	1257
BASEMENT / SUNROOM	120
SLAB / SUNROOM	120
COVERED PORCH	120
COVERED PORCH W/ FIREPLACE	120
WOOD DECK	120
WOOD DECK W/ SUNROOM	150
CONCRETE PATIO	120
CONCRETE PATIO W/ SUNROOM	150
3 CAR FRONT GARAGE	200

LIGHT & VENT SCHEDULE


ROOM NAME	AREA	REQUIRED		SUPPLIED	
		LIGHT	VENT	LIGHT	VENT
FLEX	151.62	12.13	6.06	27.40	11.80
BEDROOM 3	177.21	14.18	7.09	23.40	10.00
BEDROOM 4	172.16	13.77	6.89	23.40	10.00

** REFER TO LIGHT & VENT SCHEDULE ON COVER SHIT. FOR INFORMATION NOT SHOWN HERE.

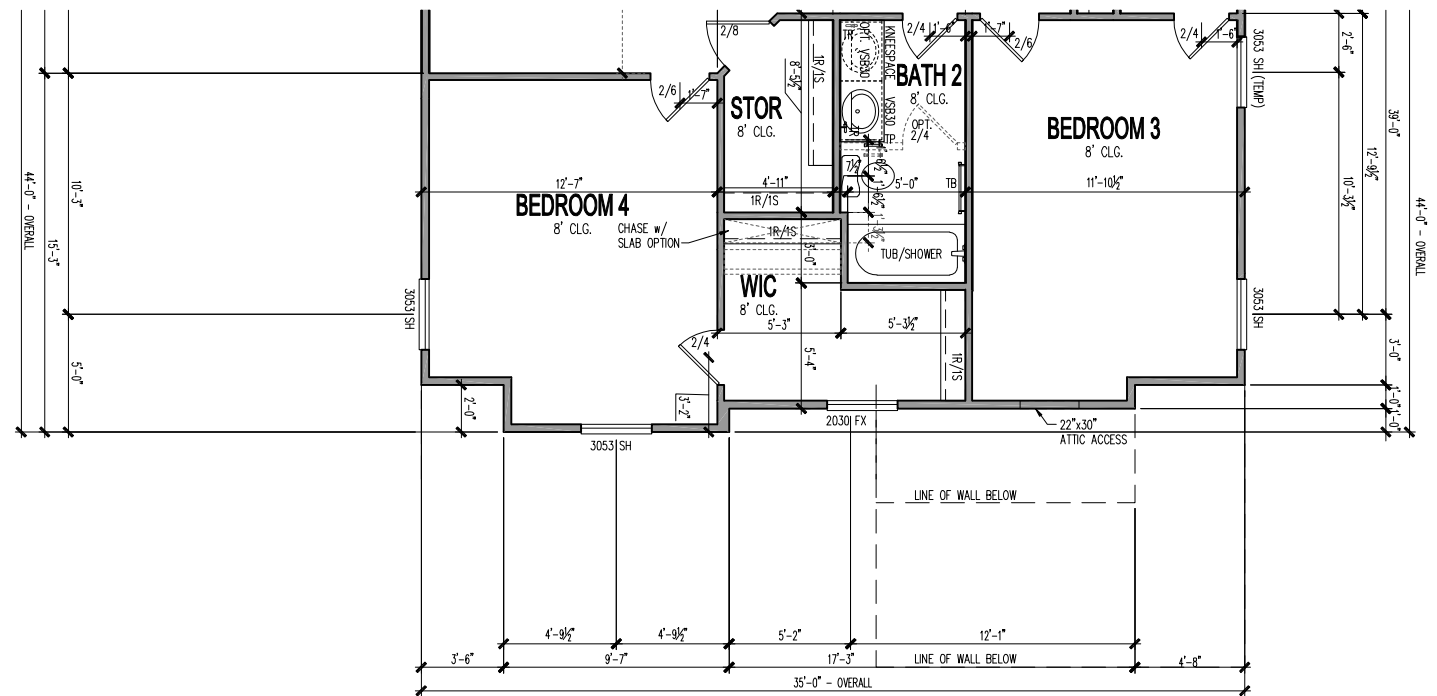

2ND FLOOR PLAN

SCALE: 1/4" = 1'-0"
SEE BASE PLANS FOR INFORMATION NOT SHOWN

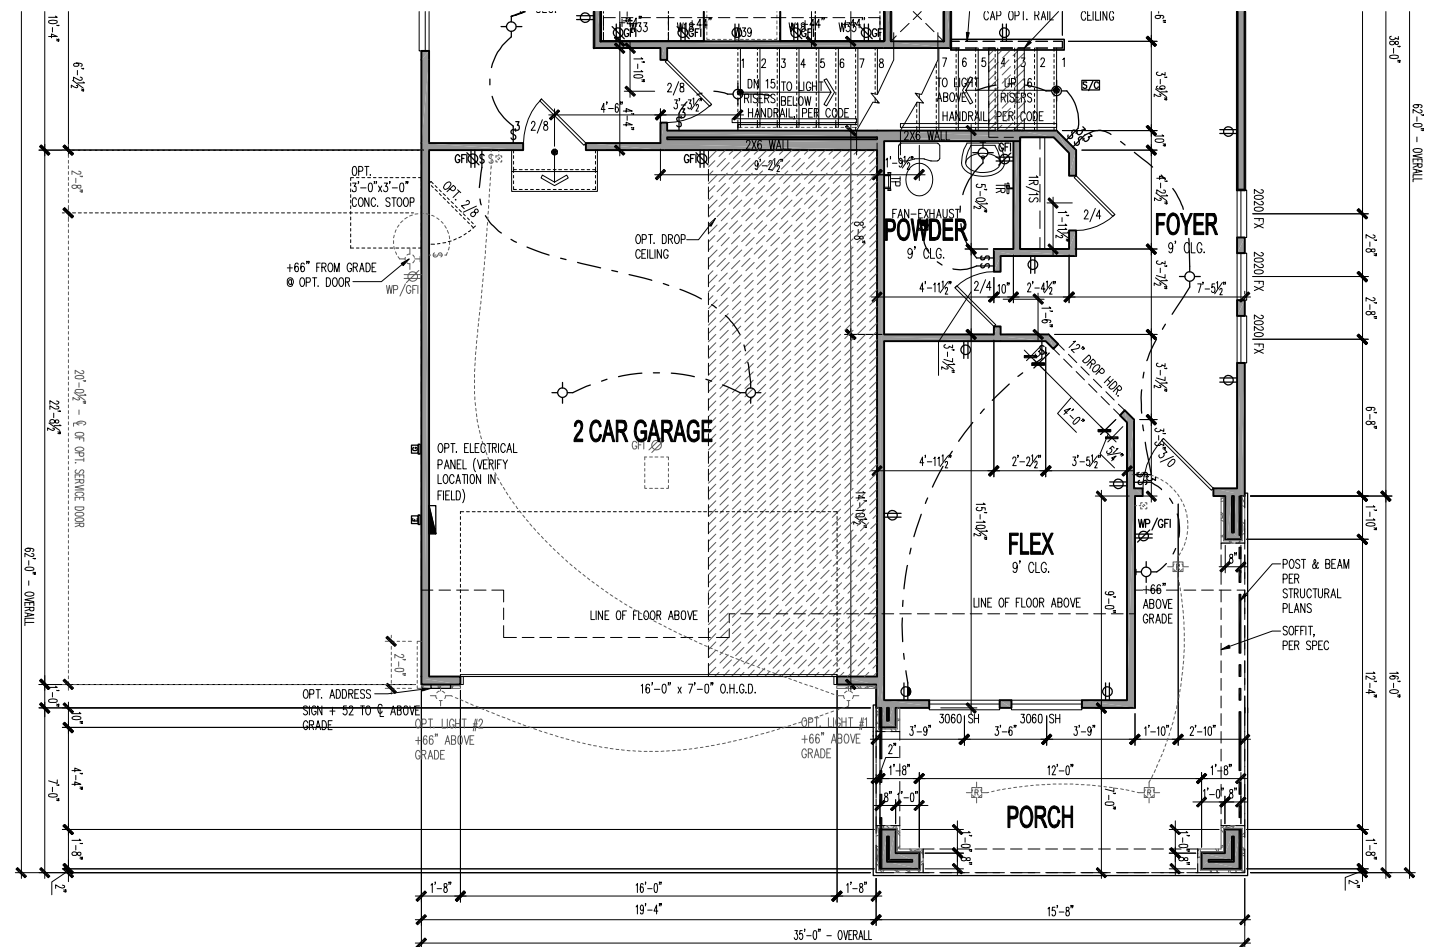

1ST FLOOR PLAN

SCALE: 1/4" = 1'-0"
SEE BASE PLANS FOR INFORMATION NOT SHOWN

ELEVATION EC2H

ADDITIONAL 1ST FLOOR - HEATED	0
TOTAL 1ST FLOOR	1257
ADDITIONAL 2ND FLOOR - HEATED	5
TOTAL 2ND FLOOR	1410
TOTAL ELEV. HEATED	2667
ADDITIONAL GARAGE - 2 CAR FRONT	0
TOTAL GARAGE	487
ADDITIONAL HOUSE SLAB	0
TOTAL HOUSE SLAB	1257
FRONT PORCH	121
TOTAL ELEV. FOOTPRINT	1865

(c) Copyright Pulte Home Corporation - 2019

Midwest Zone Office
1900 E. Golf Road, - Suite 300
Schaumburg, Illinois 60173



Euro Country 2H
2 Car Front Entry
Partial Floor and Utility Plans - 6" Exterior Walls

PRODUCTION MANAGER
Rick Starkey
INITIAL RELEASE DATE:
09/30/2014
CURRENT RELEASE DATE:
08/01/2017

REV #	DATE / DESCRIPTION
1	12/21/2015
2	01/11/2016
3	08/19/2016
4	08/01/2017
5	09/14/2018
6	09/20/2019

GARAGE HANDING
LEFT

PLAN NAME
BOARDWALK
NPS PLAN NUMBER
1956.300
LAWSON PLAN ID


SHEET
A3-EC2H
2FB4.3

NOTE: SCALES NOTED ON DRAWINGS RELATE TO FULL SIZE PLOTS ON 22x34 SHEETS - 11x17 SHEETS REPRESENT 1/2 SCALE PLOTS

ATTIC VENT SCHEDULE									
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE									
** CONTRACTORS INSTALLING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS									
* SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50% OF TOTAL AND RIDGE AT 40% OF TOTAL REQUIRED VENTILATION									
Northern Craftsman 2H									
ROOF AREA "A"		SQ FTG	1419	AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. FT. PER 100)	POT SMALL (SQ. FT. PER 100)	RIDGE VENT (SQ. FT. PER 100)	EAVE VENT (SQ. FT. PER 100)	CONTI. VENT (SQ. FT. PER 100)	TOTAL (SQ. FT. PER 100)
HIGH - POT VENTS ONLY	1.89 - 2.37	2.54	48.41	61.00	40.00	18.00	28.00	10.00	
AT EAVE	2.84 - 2.37	2.71	51.89				0	39.00	
TOTAL (MIN)	4.73	4.73	5.25	100.00					
HIGH - RIDGE VENT	1.89 - 2.37	2.80	48.00	0	0	20.00			
AT EAVE	2.84 - 2.37	2.71	52.00				0	39.00	
TOTAL (MIN)	4.73	4.73	5.21	100.00					ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE


ROOF AREA "B"		SQ FTG	160	AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. FT. PER 100)	POT SMALL (SQ. FT. PER 100)	RIDGE VENT (SQ. FT. PER 100)	EAVE VENT (SQ. FT. PER 100)	CONTI. VENT (SQ. FT. PER 100)	TOTAL (SQ. FT. PER 100)
HIGH - POT VENTS ONLY	0.21 - 0.27	0.42	46.56	41.00	40.00	18.00	28.00	10.00	
AT EAVE	0.32 - 0.27	0.49	53.44				0	7.00	
TOTAL (MIN)	0.53	0.53	0.91	100.00					
HIGH - RIDGE VENT	0.21 - 0.27	0.38	43.55	0	0	3.00			
AT EAVE	0.32 - 0.27	0.49	56.45				0	7.00	
TOTAL (MIN)	0.53	0.53	0.86	100.00					ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE

ROOF AREA "C"		SQ FTG	217	AT / NEAR RIDGE			AT / NEAR EAVE		
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. FT. PER 100)	POT SMALL (SQ. FT. PER 100)	RIDGE VENT (SQ. FT. PER 100)	EAVE VENT (SQ. FT. PER 100)	CONTI. VENT (SQ. FT. PER 100)	TOTAL (SQ. FT. PER 100)
HIGH - POT VENTS ONLY	0.29 - 0.34	0.42	46.56	61.00	40.00	18.00	28.00	10.00	
AT EAVE	0.43 - 0.34	0.49	53.44				0	7.00	
TOTAL (MIN)	0.72	0.72	0.91	100.00					
HIGH - RIDGE VENT	0.29 - 0.34	0.38	43.55	0	0	3.00			
AT EAVE	0.43 - 0.34	0.49	56.45				0	7.00	
TOTAL (MIN)	0.72	0.72	0.86	100.00					ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE




SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"

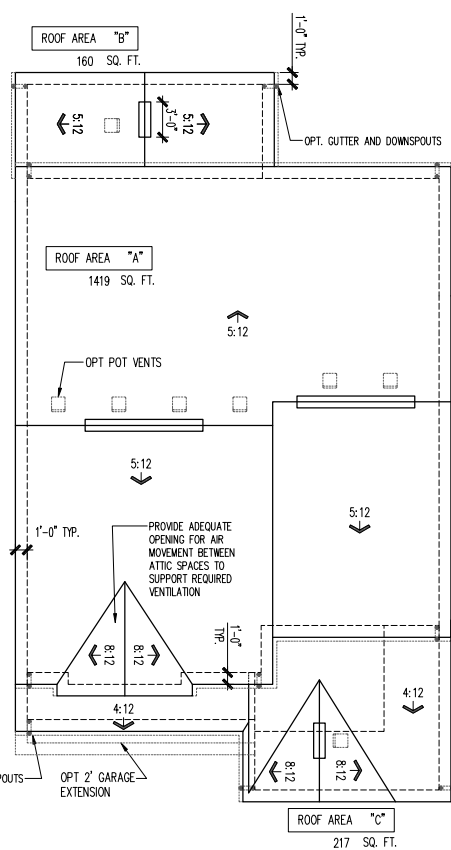

ROOF PLAN

SCALE: 1/8" = 1'-0"

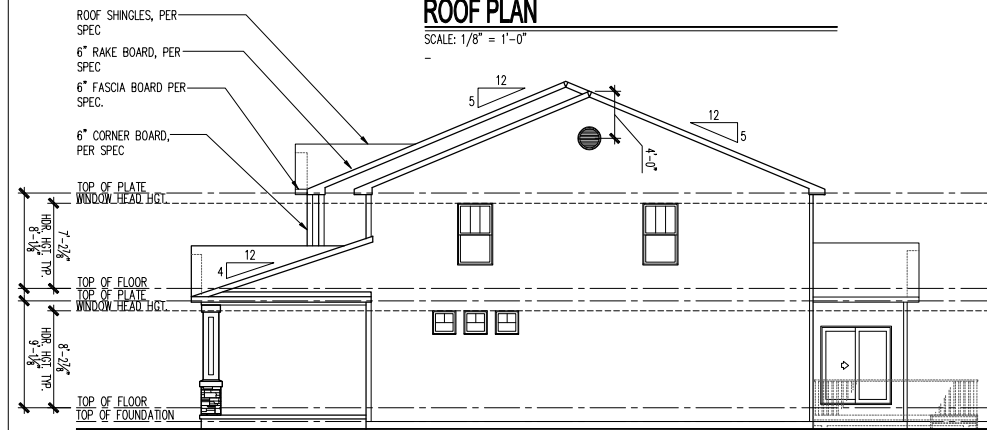


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"




FRONT ELEVATION

SCALE: 1/4" = 1'-0"

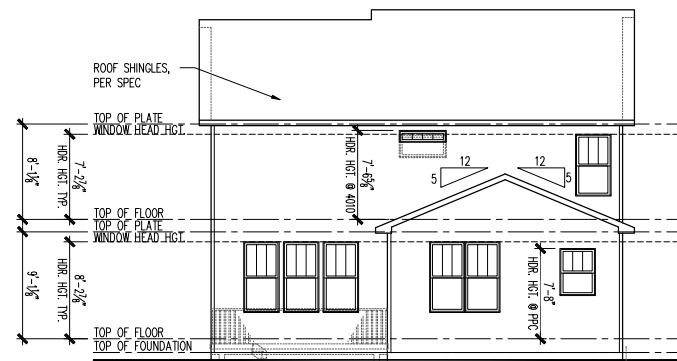

REAR ELEVATION

SCALE: 1/8" = 1'-0"

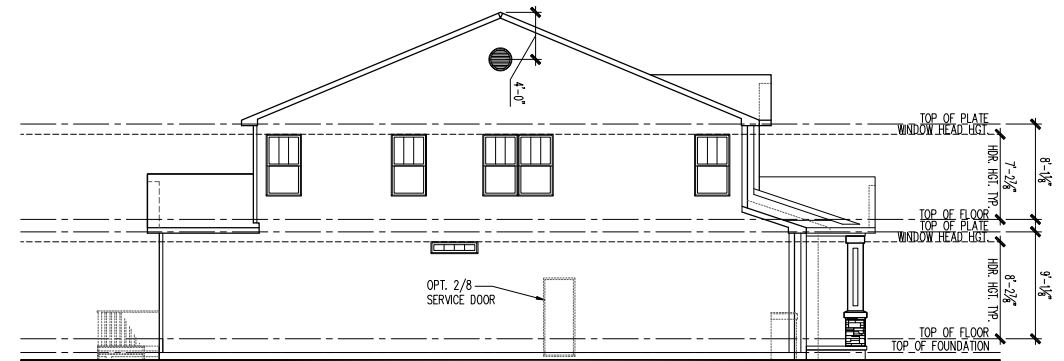

LEFT ELEVATION

SCALE: 1/8" = 1'-0"

NO WINDOW GRIDS OR TRIM ON/AROUND SIDE OR REAR WINDOWS unless noted in community specs.

PLOTTED: September 11, 2019 / Sean Leheney / A3-NC2H 2FL.DWG

(c) Copyright: Pulte Home Corporation - 2019

Midwest Zone Office
1900 E. Golf Road, - Suite 300
Schaumburg, Illinois 60173



Northern Craftsman 2H
2 Car Front Entry
Front, Side and Rear Elevations, Roof Plan and Ventilation Schedule

REV #	DATE	DESCRIPTION
1	12/21/2015	PRODUCTION MANAGER Rick Starkey
2	09/30/2014	INITIAL RELEASE DATE
3	08/19/2016	PLAN REVISIONS
4	08/01/2017	PCR REVISIONS
5	09/14/2018	PCR REVISIONS
6	09/20/2019	PCR REVISIONS

REV #	DATE	DESCRIPTION
7		
8		
9		
10		
11		
12		

GARAGE HANDING
LEFT

PLAN NAME
BOARDWALK
NPS PLAN NUMBER
1956.300
LAWSON PLAN ID

SHEET
A3-NC2H
2FB.1

NOTE: SCALES NOTED ON DRAWINGS RELATE TO FULL SIZE PLOTS ON 22x34 SHEETS - 11x17 SHEETS REPRESENT 1/2 SCALE PLOTS


SCHEDULE of AREAS

BASE HOUSE - HEATED	
FIRST FLOOR	1257
SECOND FLOOR	1405
TOTAL BASE HEATED	2662
BASE HOUSE - UNDER ROOF	
GARAGE - 2 CAR FRONT ENTRY	487
BASEMENT	1207
TOTAL BASE UNDER ROOF	1744
BASE OPTIONS - HEATED	
SUNROOM	120
MODERN FIREPLACE	18
MECHANICAL CLOSET AT SLAB OPTION	12
FINISHED BASEMENT OPTIONS	
FINISHED BASEMENT	801
MECHANICAL / STORAGE	221
STORAGE W/ FINISHED BASEMENT	153
ADDITIONAL AREA W/ SUNROOM	120
BASE OPTIONS	
HOUSE SLAB	1257
BASEMENT / SUNROOM	120
SLAB / SUNROOM	120
COVERED PORCH	120
COVERED PORCH W/ FIREPLACE	120
WOOD DECK	120
WOOD DECK W/ SUNROOM	150
CONCRETE PATIO	120
CONCRETE PATIO W/ SUNROOM	150
3 CAR FRONT GARAGE	200

LIGHT & VENT SCHEDULE


ROOM NAME	AREA	REQUIRED		SUPPLIED	
		LIGHT	VENT	LIGHT	VENT
FLEX	151.62	12.13	6.06	27.40	11.80
BEDROOM 3	125.63	10.05	5.03	14.70	5.00
BEDROOM 4	163.41	13.07	6.54	35.10	15.00

** REFER TO LIGHT & VENT SCHEDULE ON COVER SHIT. FOR INFORMATION NOT SHOWN HERE.

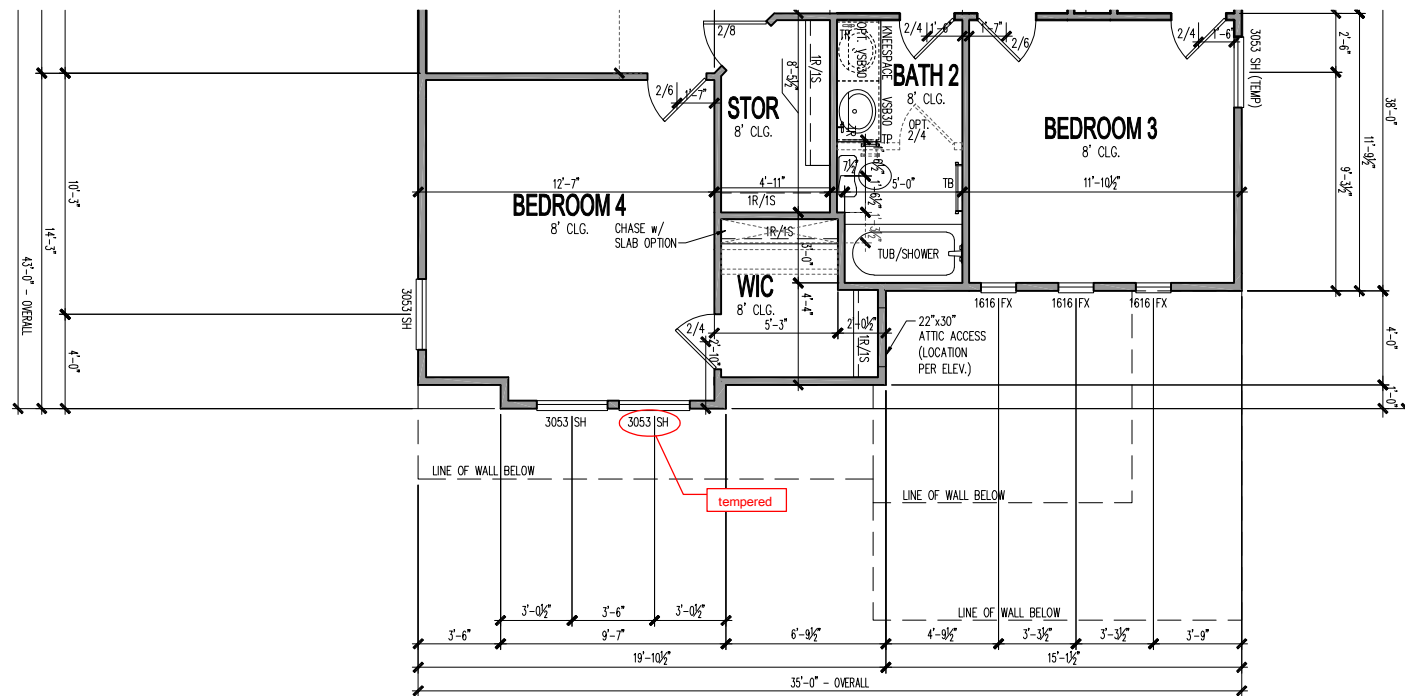

ELEVATION NC2H

ADDITIONAL 1ST FLOOR - HEATED	0
TOTAL 1ST FLOOR	1257
ADDITIONAL 2ND FLOOR - HEATED	5
TOTAL 2ND FLOOR	1410
TOTAL ELEV. HEATED	2667
ADDITIONAL GARAGE - 2 CAR FRONT	0
TOTAL GARAGE	487
ADDITIONAL HOUSE SLAB	0
TOTAL HOUSE SLAB	1257
FRONT PORCH	121
TOTAL ELEV. FOOTPRINT	1865

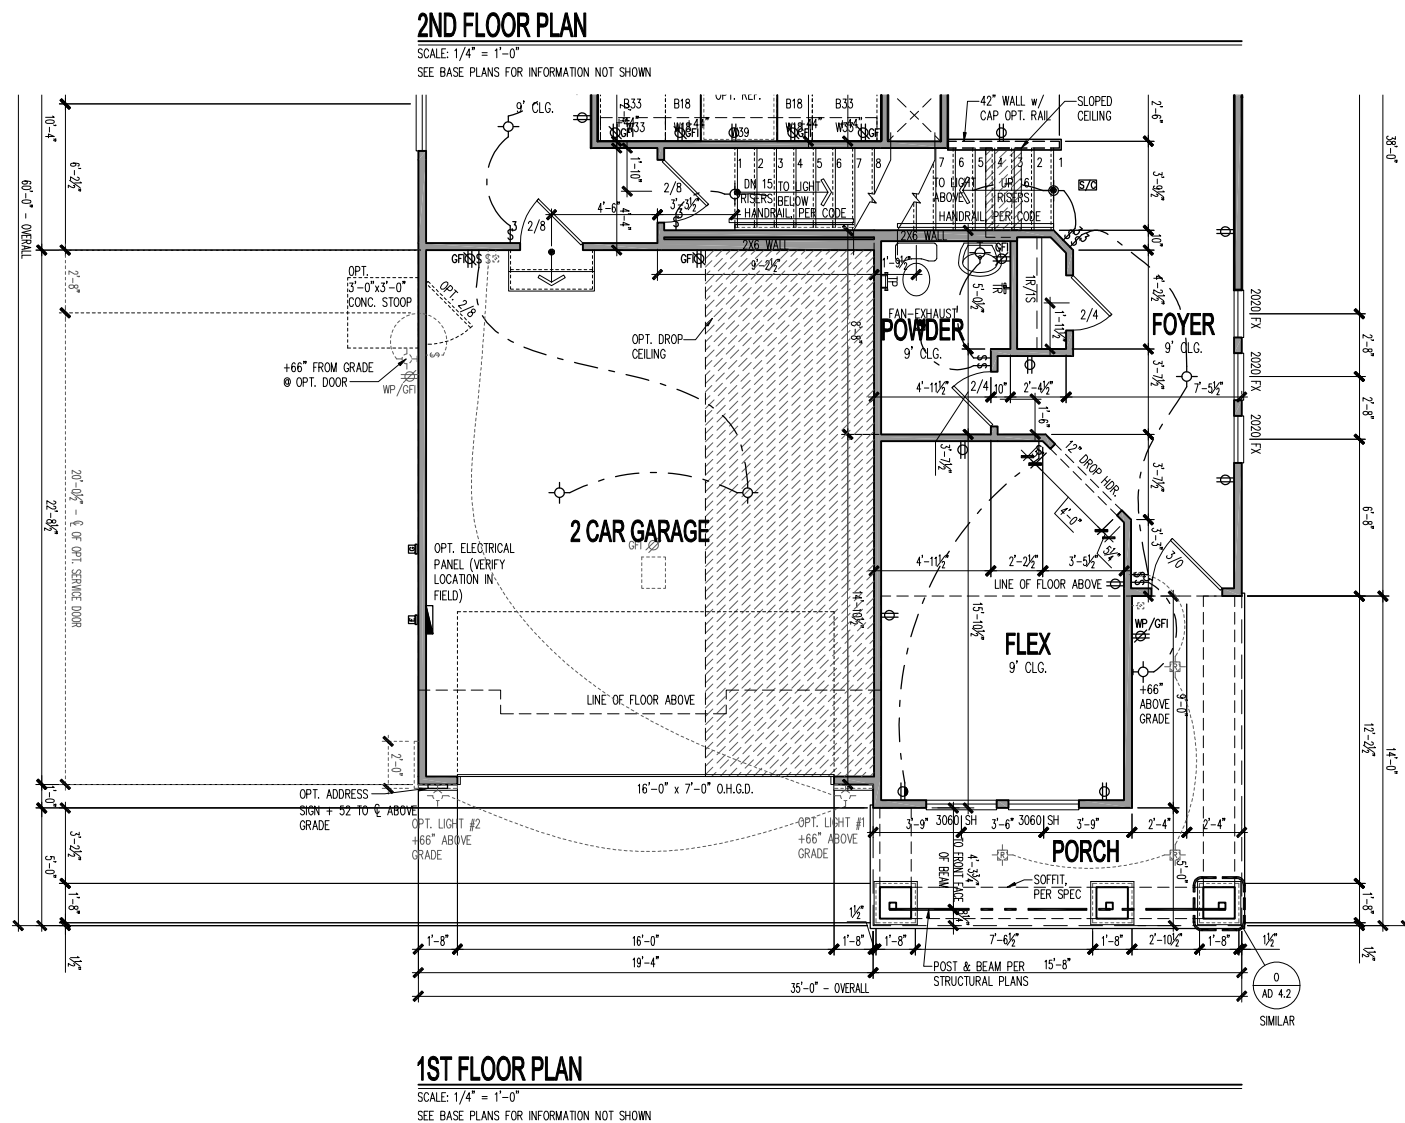

(c) Copyright Pulte Home Corporation - 2019

Midwest Zone Office
1900 E. Golf Road, - Suite 300
Schaumburg, Illinois 60173



Northern Craftsman 2H
2 Car Front Entry
Partial Floor and Utility Plans - 6" Exterior Walls

NOTE: SCALES NOTED ON DRAWINGS RELATE TO FULL SIZE PLOTS ON 22x34 SHEETS - 11x17 SHEETS REPRESENT 1/2 SCALE PLOTS

PRODUCTION MANAGER
Rick Starkey
INITIAL RELEASE DATE:
09/30/2014
CURRENT RELEASE DATE:
08/01/2017

REV #	DATE	DESCRIPTION
1	12/21/2015	PLAN REVISIONS
2	01/11/2016	PLAN REVISIONS
3	08/19/2016	PCR REVISIONS
4	08/01/2017	PLAN REVISIONS
5	09/14/2018	PCR REVISIONS
6	09/20/2019	PCR REVISIONS

GARAGE HANDING
LEFT


PLAN NAME
BOARDWALK
NPS PLAN NUMBER
1956.300
LAWSON PLAN ID

SHEET
A3-NC2H
2FB4.3

ATTIC VENT SCHEDULE										
VENTILATION REQUIRED AND SUPPLIED IS BASED ON POT VENT VALUES AND RIDGE VENT VALUES SHOWN IN TABLE ABOVE ** CONTRACTORS INSTALLING VENTILATION ARE RESPONSIBLE FOR VERIFYING THAT VENTS USED WILL SUPPLY VENTILATION TO MEET CODE REQUIREMENTS SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50% OF TOTAL AND RIDGE AT 40% OF TOTAL REQUIRED VENTILATION										
Prairie 2H										
ROOF AREA "A"		SQ FTG	AT / NEAR RIDGE			AT / NEAR EAVE				
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	POT LARGE (SQ. IN. PER LIN. FT.)	POT SMALL (SQ. IN. PER LIN. FT.)	RIDGE VENT (SQ. IN. PER LIN. FT.)	EAVE VENT (SQ. IN. PER LIN. FT.)	CONTI. VENT (SQ. IN. PER LIN. FT.)			
HIGH - POT VENTS ONLY	1.91 2.36	2.54	45.41	6	0	0.00				
AT EAVE	2.84 2.38	3.06	54.89			0	44.00			
TOTAL (MIN)	4.77 4.77	5.60	100.00							
HIGH - RIDGE VENT	1.91 2.36	2.54	45.41	6	0	0.00				
AT EAVE	2.84 2.38	3.06	54.89			0	44.00			
TOTAL (MIN)	4.77 4.77	5.60	100.00						ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE	


ROOF AREA "B"									
160 SQ. FT.									
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. IN. PER LIN. FT.)	POT SMALL (SQ. IN. PER LIN. FT.)	RIDGE VENT (SQ. IN. PER LIN. FT.)	EAVE VENT (SQ. IN. PER LIN. FT.)	CONTI. VENT (SQ. IN. PER LIN. FT.)	
HIGH - POT VENTS ONLY	0.21 0.27	0.42	46.56	1	0				
AT EAVE	0.32 0.27	0.49	53.44				0	7.00	
TOTAL (MIN)	0.53 0.53	0.91	100.00						
HIGH - RIDGE VENT	0.21 0.27	0.42	46.56	1	0	0.00			
AT EAVE	0.32 0.27	0.49	53.44				0	7.00	
TOTAL (MIN)	0.53 0.53	0.91	100.00						ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE

ROOF AREA "C"									
210 SQ. FT.									
VENT TYPE	SQ. FT. REQUIRED RANGE	SQ. FT. SUPPLIED	PERCENT OF TOTAL SUPPLIED	POT LARGE (SQ. IN. PER LIN. FT.)	POT SMALL (SQ. IN. PER LIN. FT.)	RIDGE VENT (SQ. IN. PER LIN. FT.)	EAVE VENT (SQ. IN. PER LIN. FT.)	CONTI. VENT (SQ. IN. PER LIN. FT.)	
HIGH - POT VENTS ONLY	0.28 0.35	0.42	43.26	1	0				
AT EAVE	0.42 0.35	0.56	56.74				0	8.00	
TOTAL (MIN)	0.70 0.70	0.98	100.00						
HIGH - RIDGE VENT	0.28 0.35	0.42	43.26	1	0	0.00			
AT EAVE	0.42 0.35	0.56	56.74				0	8.00	
TOTAL (MIN)	0.70 0.70	0.98	100.00						ADDITIONAL POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE




SIDE AND REAR WINDOWS PER COMMUNITY SPECS

SCALE: 1/4" = 1'-0"

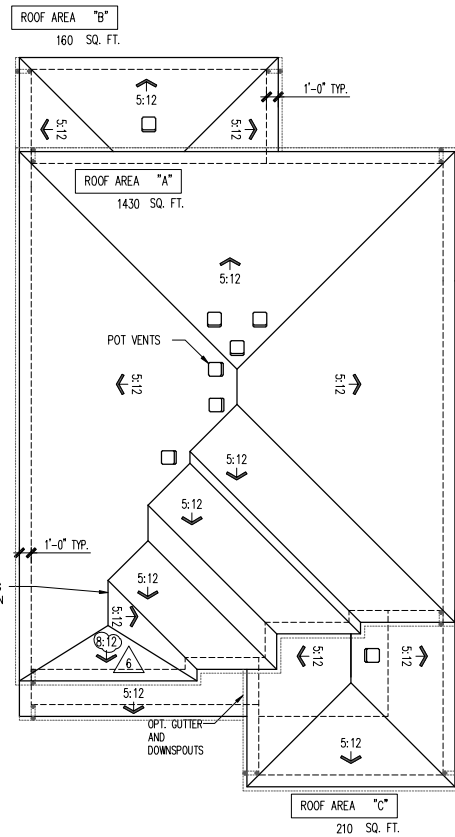


ROOF PLAN

SCALE: 1/8" = 1'-0"

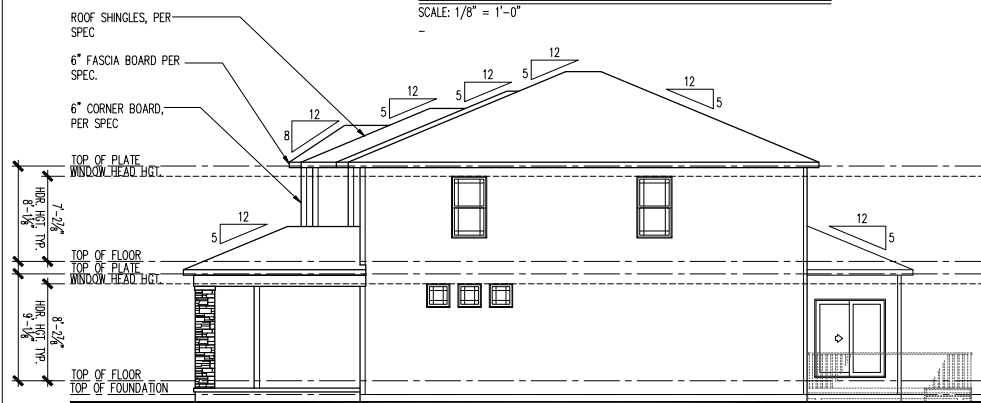


RIGHT ELEVATION

SCALE: 1/8" = 1'-0"

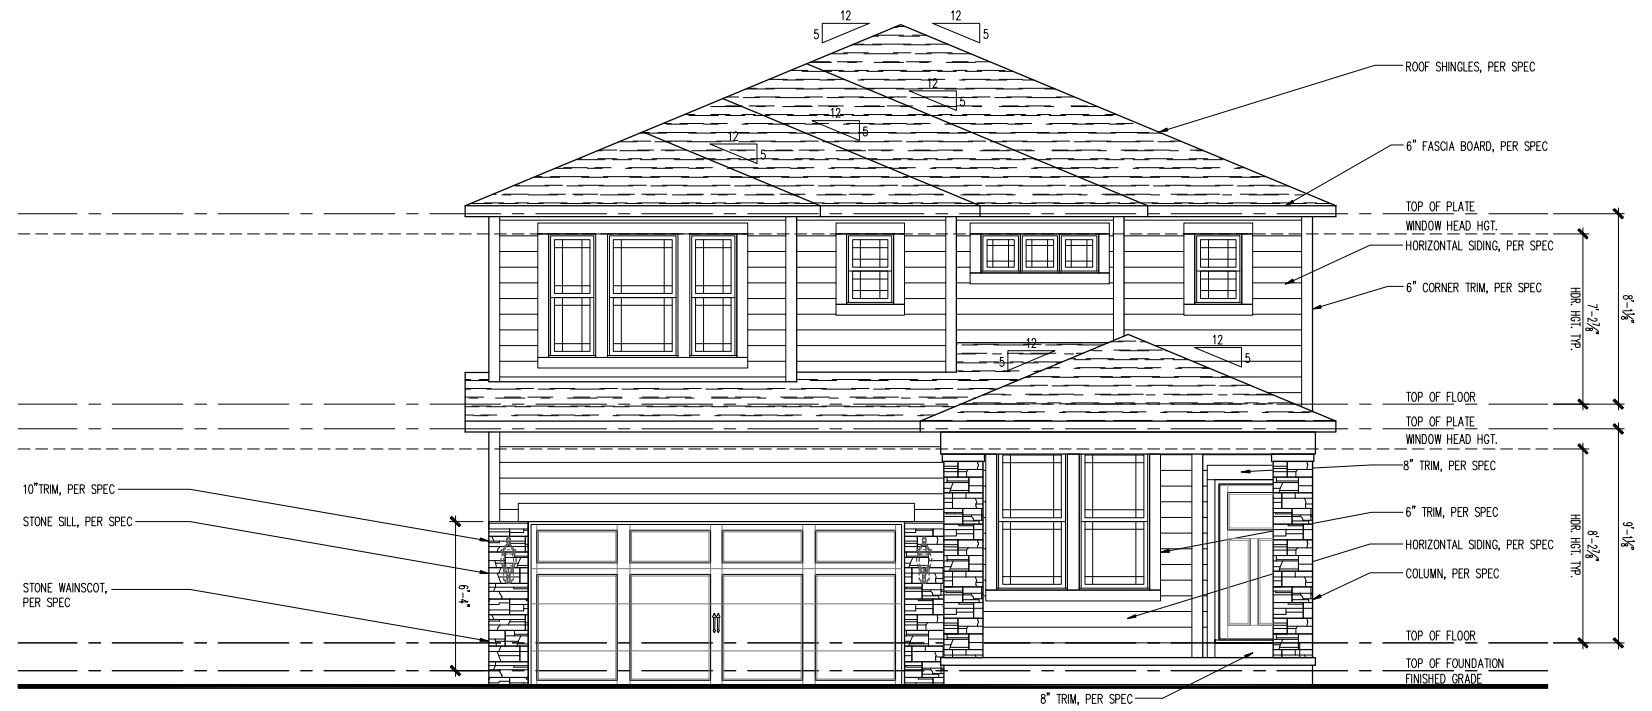


FRONT ELEVATION

SCALE: 1/4" = 1'-0"

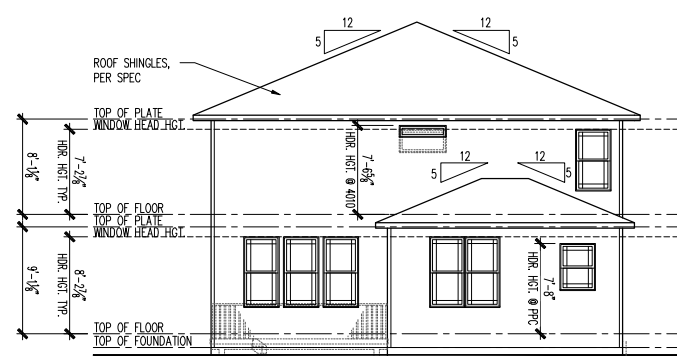

REAR ELEVATION

SCALE: 1/8" = 1'-0"

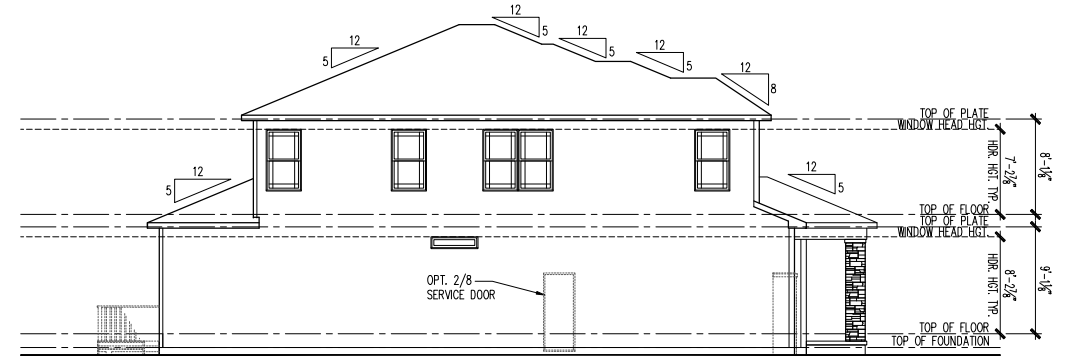

LEFT ELEVATION

SCALE: 1/8" = 1'-0"

NO WINDOW GRIDS OR TRIM ON/AROUND SIDE OR REAR WINDOWS unless noted in community specs.

PLOTTED: September 16, 2019 / Sean Leheney / A3-PR2H.2RB1.DWG

(c) Copyright: Pulte Home Corporation - 2019

Midwest Zone Office
1900 E. Golf Road, - Suite 300
Schaumburg, Illinois 60173



Prairie 2H
2 Car Front Entry
Front, Side and Rear Elevations, Roof Plan and Ventilation Schedule

PRODUCTION MANAGER
Rick Starkey
INITIAL RELEASE DATE:
09/30/2014
CURRENT RELEASE DATE:
08/01/2017

REV #	DATE / DESCRIPTION
1	12/21/2015
2	01/11/2016
3	08/19/2016
4	08/01/2017
5	09/14/2018
6	09/20/2019

GARAGE HANDING
LEFT

PLAN NAME
BOARDWALK
NPS PLAN NUMBER
1956.300
LAWSON PLAN ID

SHEET
A3-PR2H
2FB.1

NOTE: SCALES NOTED ON DRAWINGS RELATE TO FULL SIZE PLOTS ON 22x34 SHEETS - 11x17 SHEETS REPRESENT 1/2 SCALE PLOTS


SCHEDULE of AREAS

BASE HOUSE - HEATED	
FIRST FLOOR	1257
SECOND FLOOR	1405
TOTAL BASE HEATED	2662
BASE HOUSE - UNDER ROOF	
GARAGE - 2 CAR FRONT ENTRY	487
BASEMENT	1207
TOTAL BASE UNDER ROOF	1744
BASE OPTIONS - HEATED	
SUNROOM	120
MODERN FIREPLACE	18
MECHANICAL CLOSET AT SLAB OPTION	12
FINISHED BASEMENT OPTIONS	
FINISHED BASEMENT	801
MECHANICAL / STORAGE	221
STORAGE W/ FINISHED BASEMENT	153
ADDITIONAL AREA W/ SUNROOM	120
BASE OPTIONS	
HOUSE SLAB	1257
BASEMENT / SUNROOM	120
SLAB / SUNROOM	120
COVERED PORCH	120
COVERED PORCH W/ FIREPLACE	120
WOOD DECK	120
WOOD DECK W/ SUNROOM	150
CONCRETE PATIO	120
CONCRETE PATIO W/ SUNROOM	150
3 CAR FRONT GARAGE	200

LIGHT & VENT SCHEDULE


ROOM NAME	AREA	REQUIRED		SUPPLIED	
		LIGHT	VENT	LIGHT	VENT
FLEX	151.62	12.13	6.06	27.40	11.80
BEDROOM 3	125.63	10.05	5.03	15.30	6.30
BEDROOM 4	166.91	13.35	6.68	37.60	16.00

** REFER TO LIGHT & VENT SCHEDULE ON COVER SHIT. FOR INFORMATION NOT SHOWN HERE.

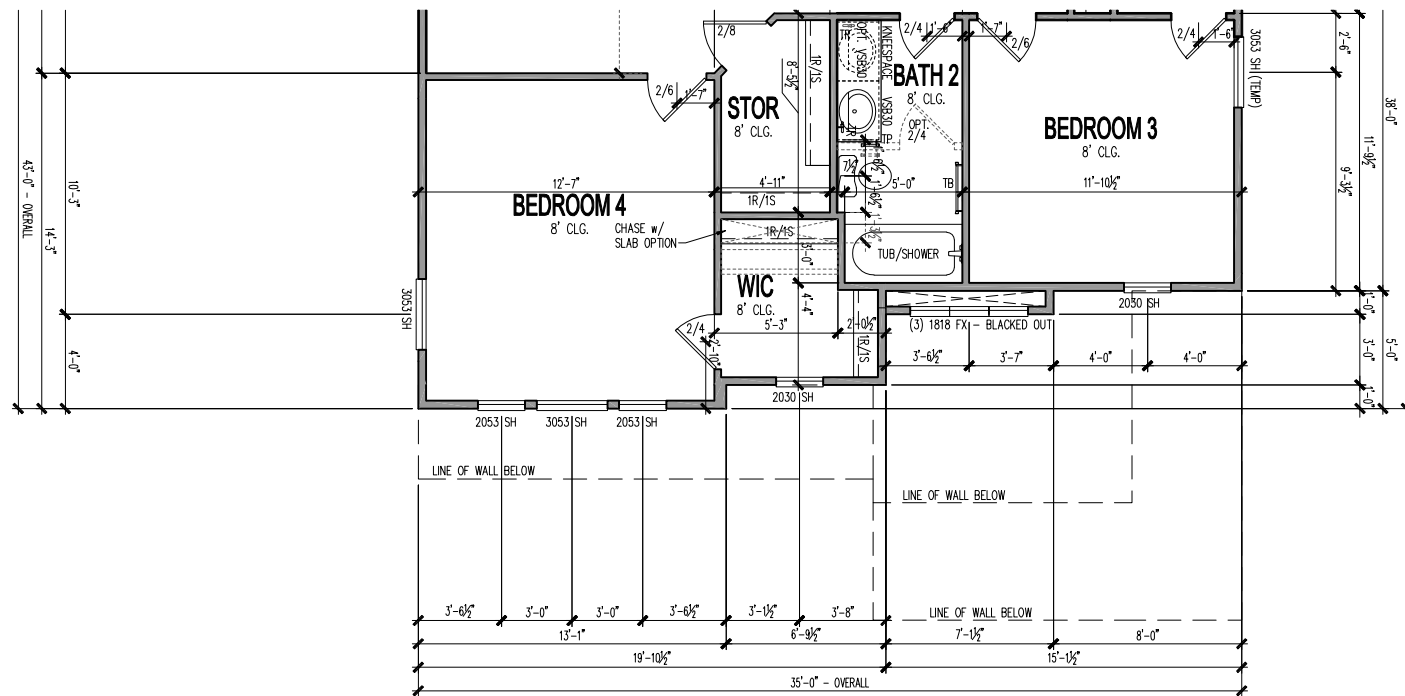

ELEVATION PR2H

ADDITIONAL 1ST FLOOR - HEATED	0
TOTAL 1ST FLOOR	1257
ADDITIONAL 2ND FLOOR - HEATED	5
TOTAL 2ND FLOOR	1410
TOTAL ELEV. HEATED	2667
ADDITIONAL GARAGE - 2 CAR FRONT	0
TOTAL GARAGE	487
ADDITIONAL HOUSE SLAB	0
TOTAL HOUSE SLAB	1257
FRONT PORCH	121
TOTAL ELEV. FOOTPRINT	1865

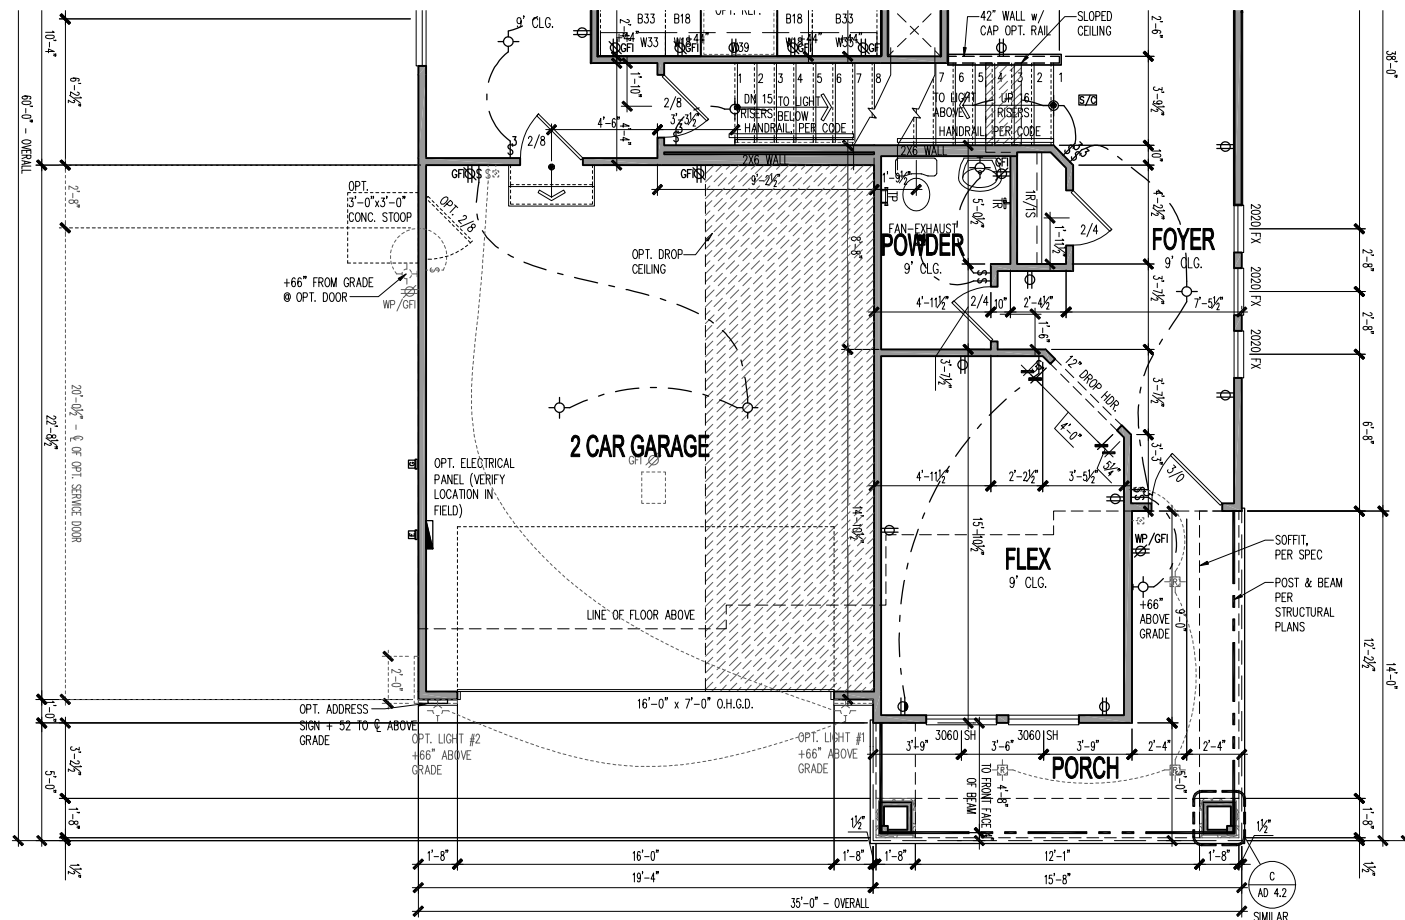

Midwest Zone Office
1900 E. Golf Road, - Suite 300
Schaumburg, Illinois 60173



Prairie 2H
2 Car Front Entry
Partial Floor and Utility Plans - 6" Exterior Walls

PRODUCTION MANAGER
Rick Starkey
INITIAL RELEASE DATE:
09/30/2014
CURRENT RELEASE DATE:
08/01/2017

REV #	DATE / DESCRIPTION
1	12/21/2015
2	01/11/2016
3	08/19/2016
4	08/01/2017
5	09/14/2018
6	09/20/2019

GARAGE HANDING
LEFT

PLAN NAME
BOARDWALK
NPS PLAN NUMBER
1956.300
LAWSON PLAN ID

SHEET
A3-PR2H
2FB4.3