


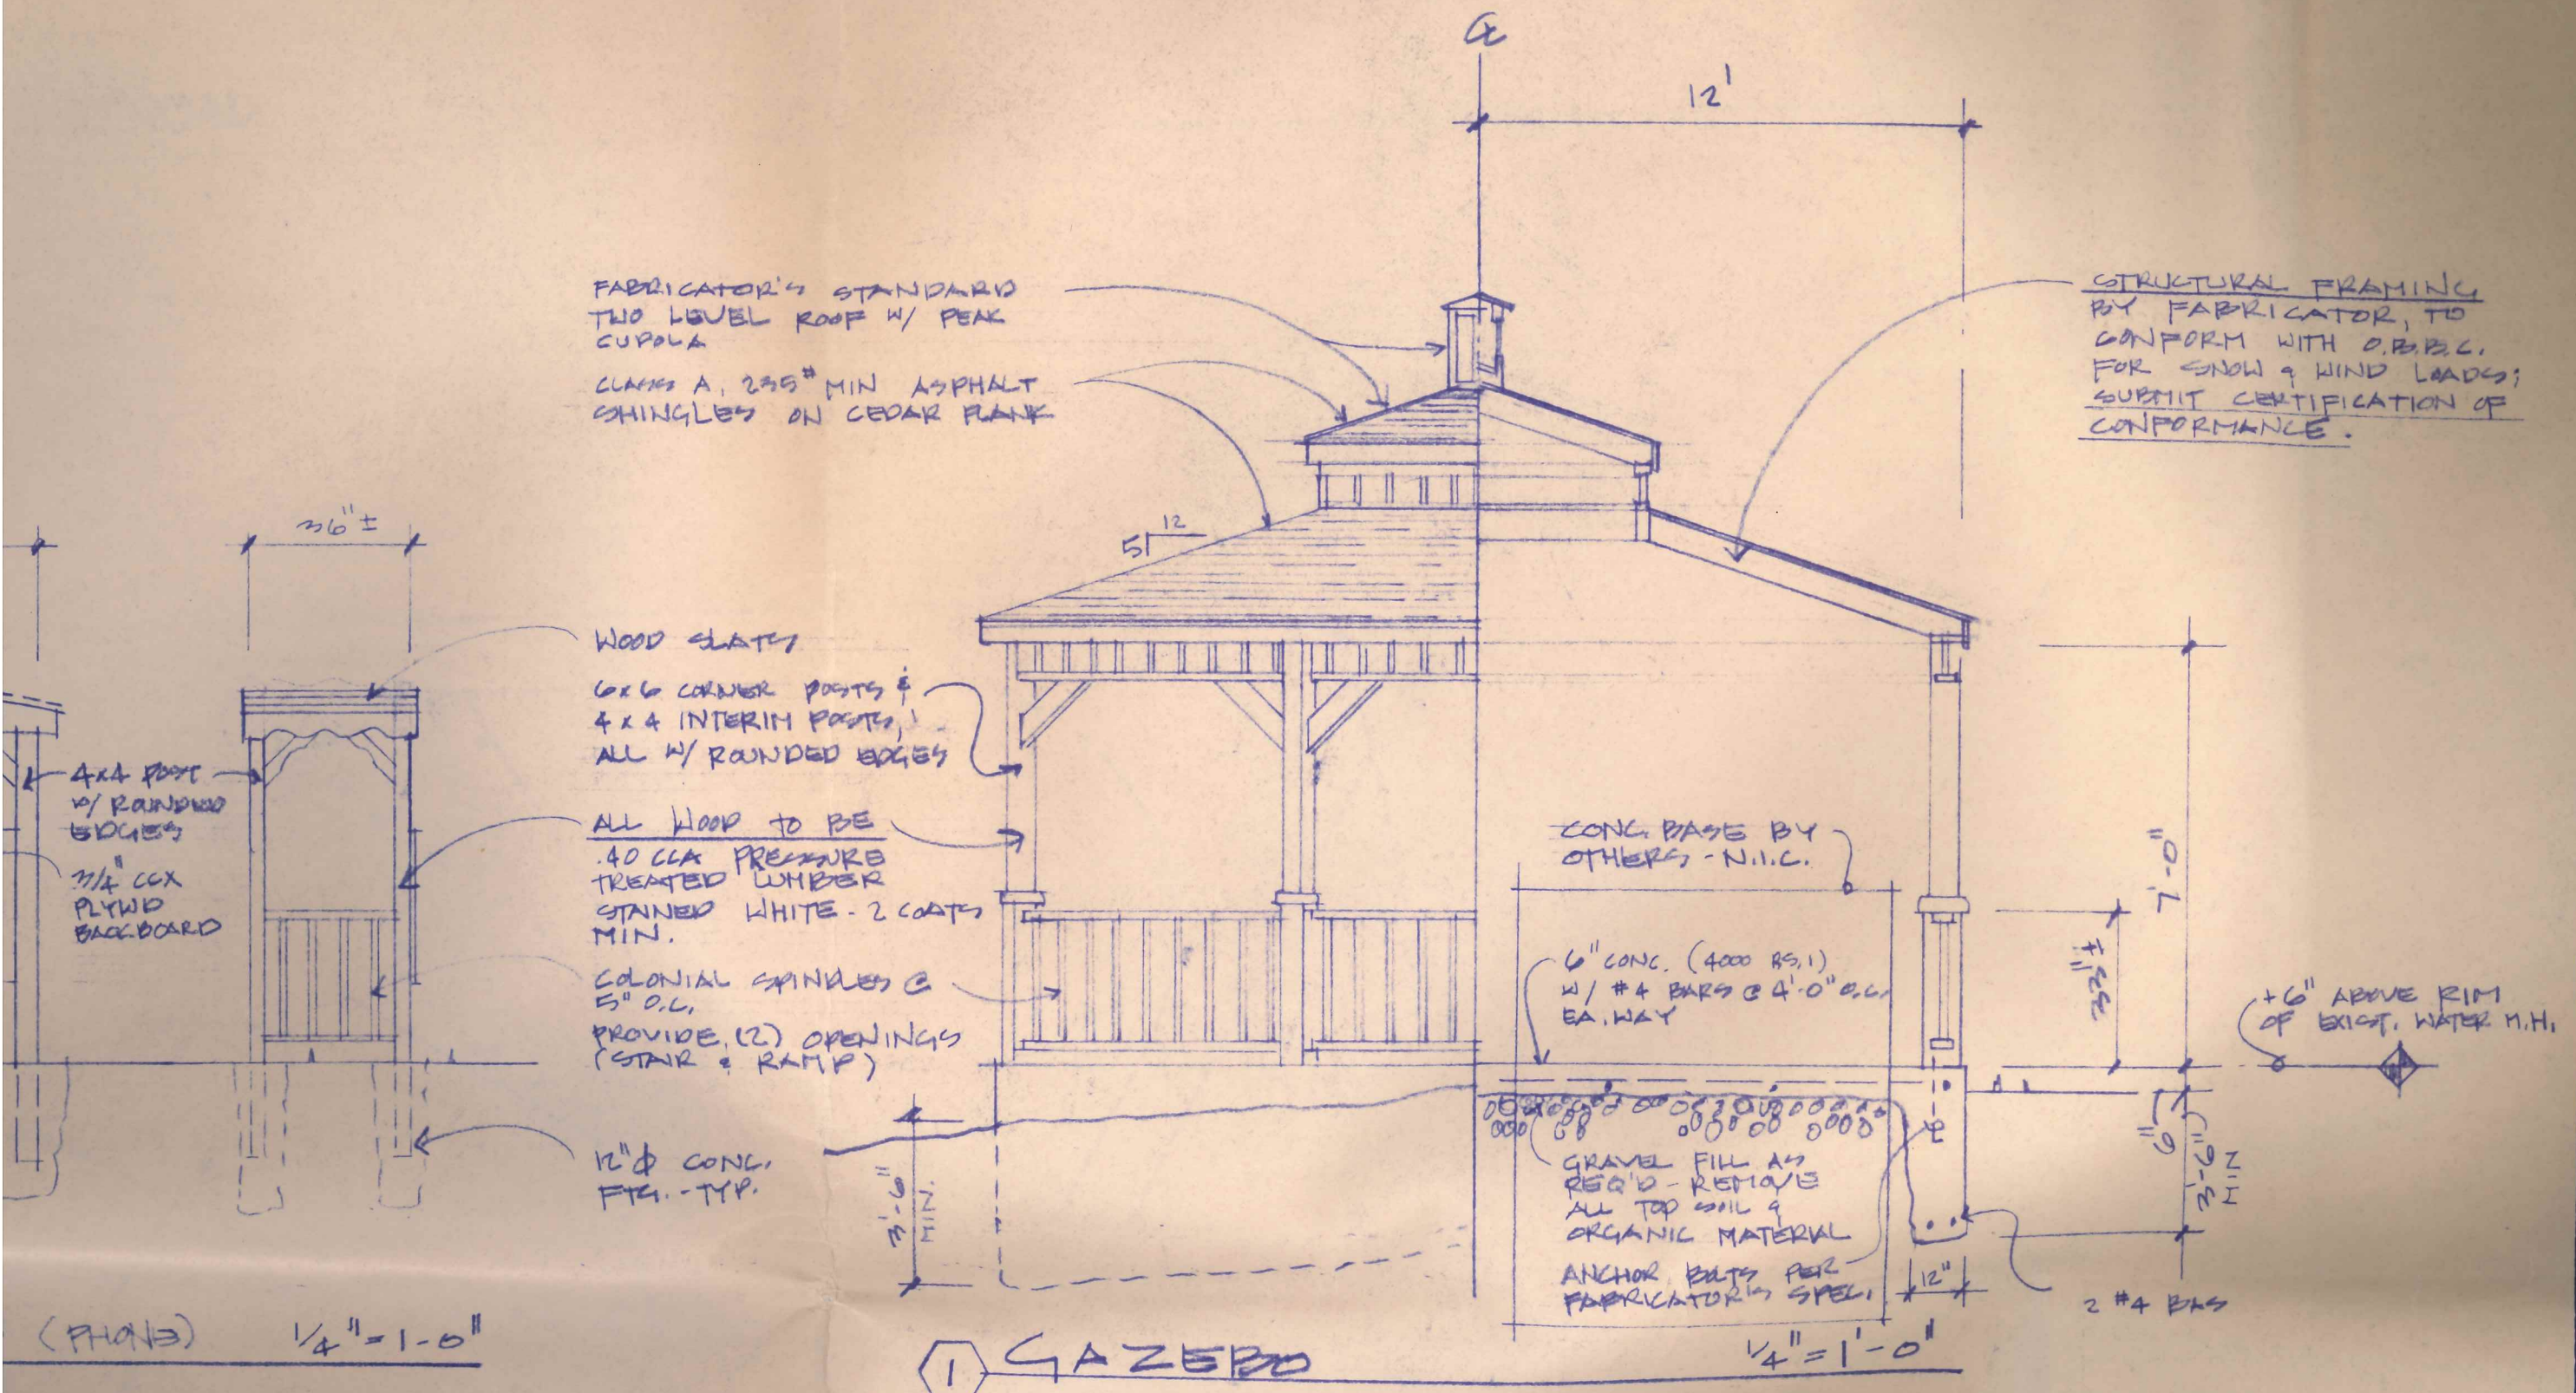

FABRICATOR'S STANDARD
TWO LEVEL ROOF W/ PEAK
CUPOLA
CLASSES A, 235# MIN ASPHALT
SHINGLES ON CEDAR BARK

STRUCTURAL FRAMING
BY FABRICATOR, TO
CONFORM WITH O.B.B.C.
FOR SNOW & WIND LOADS;
SUBMIT CERTIFICATION OF
CONFORMANCE.

WOOD SLATS
6x6 CORNER POSTS &
4x4 INTERIM POSTS,
ALL W/ ROUNDED EDGES

ALL WOOD TO BE
.40 CLA PRESSURE
TREATED LUMBER
STAINED WHITE - 2 COATS
MIN.

COLONIAL SPINDLES @
5" O.C.
PROVIDE (2) OPENINGS
(STAIR & RAMP)

12" ϕ CONC.
FTG. - TYP.

CONC. BASE BY
OTHERS - N.I.C.

6" CONC. (4000 PSI)
W/ #4 BARS @ 4'-0" O.C.
EA. WAY

GRAVEL FILL AS
REQ'D - REMOVE
ALL TOP SOIL &
ORGANIC MATERIAL
ANCHOR BATS PER
FABRICATOR'S SPEC.

+6" ABOVE RIM
OF EXIST. WATER M.H.

1 GAZEBO

(PHONE) 1/4" = 1'-0"

CENTER