

PVRE 70

Energy Recovery Ventilator

Product #: 463444



The PVRE 70 has a profile of only 18.5" x 19.5" and 9.75" high, the PVRE is ideally suited for small condos and apartments that have no mechanical room and where it must be located over a false ceiling. The PVRE 70 brings a continuous supply of fresh air into a home while exhausting an equal amount of contaminated air. The energy recovery core at the center of the unit transfers both heat and moisture from the incoming air to the outgoing air that was cooled and dried by the building's air conditioner.

Features

- Compact design, only 10.4" (264 mm) installed depth
- No drain required
- Easy to install on ceiling or wall with mounting bracket included
- Energy recovery core
- Electrostatic filters (washable)
- Removable screw terminal for easy connection with external access
- Multiple speed operation

Optional Controls

- STS2.0 – Touch screen multi-function control
- DIR-DG – Multi-function Dehumidistat
- EDF1 – Multi-function control
- RTS5 – 20/40/60 minute over-ride
- Dehumidistat 1 – Dehumidistat

Specifications

- Duct size – 4" (100 mm) round
- Voltage/Phase – 120/1
- Rated power – 58 W
- Running amperage – 0.6 A
- CSA rated amperage – 1.1 A
- Average airflow – 70 cfm (50 L/s)@ 0.4" Ps (100Pa)
- Weight – 31.7 lbs (14.4 kg)



Fans

Two (2) factory-balanced fans with backward curved blades. Motors come with permanently lubricated, sealed ball-bearings to guarantee long life and maintenance-free operation.

Energy Recovery Core

AHRI certified core made from water vapor transport durable polymer membrane that is highly permeable to humidity. The ERV core is freeze tolerant and water washable. Core dimensions are 8.5" x 8.5" (216 x 216 mm) with a 8" (205 mm) depth.

Defrost Sequence

A preset frost prevention sequence is activated at an outdoor air temperature of 14°F (-10°C) and lower. During the frost prevention sequence, the supply blower shuts down and the exhaust blower switches into high speed to maximize the effectiveness of the frost prevention strategy. The unit then returns to normal operation, and continues cycle.

Serviceability

Core, filters, fans and electrical panel can be accessed easily from the access panel. Core conveniently slides out with only 8" (205 mm) clearance.

Duct Connections

4" (100mm round metal duct connections with rubberized seal

Case

22 gauge, ASTM A653, G90 galvanized corrosion resistant steel case (pre-painted door).

Insulation

Insulated with 1 in. (25 mm) of high density polystyrene.

Filters

Two (2) washable electrostatic panel type air filters 8.5" (216mm) x 8" (205mm) x 0.125" (3mm).


Installation

Unit is typically hung by using ceiling bracket supplied with unit. Optional chain kit available.

Warranty

5 years on energy recovery core, 7 year on motors, and 5 year on parts.

Dimensions & Airflow

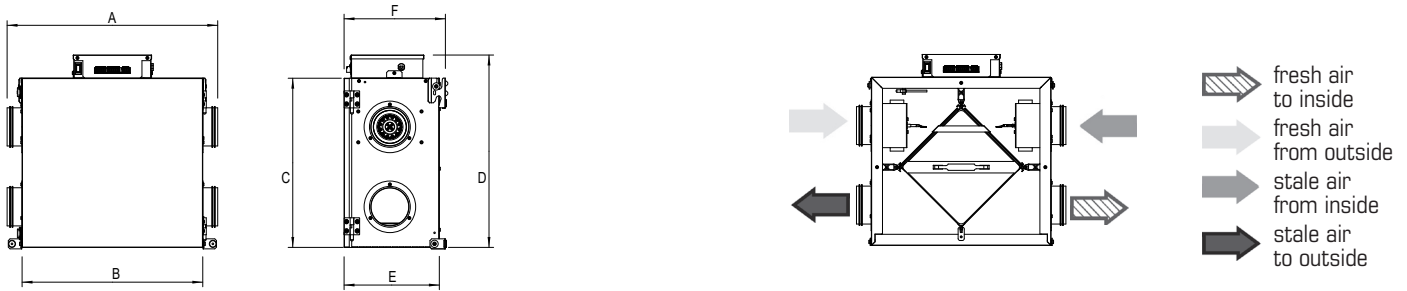


Model	A		B		C		D		E		F	
	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm
PVRE 70	21 1/2	546	18 1/2	470	17 1/4	483	19 5/8	498	9 3/4	248	10 3/8	264

Clearance of 8" (203 mm) in front of the unit is recommended for removal of core.

Ventilation Performance

in.wg. (Pa)	0.1 (25)	0.2 (50)	0.3 (75)	0.4 (100)	0.5 (125)	0.6 (150)
	cfm (L/s)	cfm (L/s)	cfm (L/s)	cfm (L/s)	cfm (L/s)	cfm (L/s)
Net supply airflow	89 (42)	83 (39)	76 (36)	70 (33)	61 (29)	53 (25)
Gross supply airflow	93 (44)	87 (41)	81 (38)	72 (34)	66 (31)	55 (26)
Gross exhaust airflow	93 (44)	87 (41)	81 (38)	72 (34)	66 (31)	55 (26)

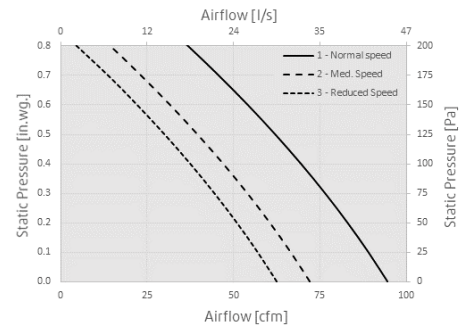

Energy performance

	Supply temperature		Net airflow		Consumed power	Sensible recovery efficiency	Adjusted Sensible recovery efficiency	Apparent sensible effectiveness ¹	Latent recovery/moisture transfer
	°F	°C	cfm	L/s	W	%	%	%	%
Heating	32	0	51	24	40	70	75	78	45
	32	0	59	28	44	67	72	77	42
	32	0	70	33	52	65	69	74	40
	5	-15	55	26	42	55	58	76	35
Cooling	Supply temperature		Net airflow		Consumed power	Total recovery efficiency	Adjusted Total recovery efficiency	Apparent sensible effectiveness ¹	Latent recovery/moisture transfer
	°F	°C	cfm	L/s	W	%	%	%	%
Cooling	95	35	51	24	40	40	43	72	30

¹ ASE is not an HVI certified value

Requirements and standards

- Complies with the UL 1812 requirements regulating the construction and installation of Heat Recovery Ventilators
- Complies with the CSA C22.2 no. 113 Standard applicable to ventilators
- Complies with the CSA F326 requirements regulating the installation of Heat Recovery Ventilators
- Technical data was obtained from published results of test relating to CSA C439 Standards
- ERV Core ISO 846 certified for mold and bacteria resistance
- HVI certified

Our branches

London: 1064 Hargrieve Road, London, ON N6E 1P5
(T) 519.675.1491 (F) 519.675.4725 london@powrmatic.ca
Toronto: 157 Rivermede Rd., Concord, ON L4K 3M4
(T) 905.660.0033 (F) 905.660.8881 toronto@powrmatic.ca
Halifax: 100 Wright Ave, Dartmouth, NS, B3B 1L2
(T) 902.454.8684 (F) 902.453.5875 halifax@powrmatic.ca
Ottawa: 1412 Star Top Rd., Goucester, ON K1B 4V7
(T) 613.230.7160 (F) 613.230.0685 ottawa@powrmatic.ca
Québec: 365 Fortin, Vill-Vanier, QC G1M 1B2
(T) 418.683.2708 (F) 418.683.8860 quebec@powrmatic.ca
Montréal: 9500 BLVD. Ray-Lawson, Anjou, QC H1J 1L1
(T) 514.493.6400 (F) 514.493.8722 montreal@powrmatic.ca

Submitted by:	Date:
Quantity:	Model:
Project #:	
Comments:	
Location:	
Architect:	
Engineer:	Contractor: