

MODEL EXP-1

EXPLOSION-PROOF STATION



SPECIFICATIONS

- HEAVY CAST NEMA TYPE 7 ENCLOSURE
- CONFORMS TO CLASS I, DIVISION I & II GROUP B, C, D, E, F & G
- 2" DIA. PUSHBUTTON SILKSCREENED "*PUSH TO EXIT*" WITH BLACK EPOXY INK
- MOMENTARY CONTACTS
- ONE NORMALLY-OPEN AND ONE NORMALLY-CLOSED CONTACT
- CONTACTS RATED 5 A. @ 35 VDC OR 120 VAC
- SCREW TERMINALS ON CONTACT BLOCKS
- SIZE 4" x 6.5" x 4.5"
- PIPE THREAD 1/2-14 NPT
- U.L. LISTED AND CSA APPROVED



ALARM CONTROLS CORPORATION

19 BRANDYWINE DRIVE P.O. BOX 280


DEER PARK, NY 11729

1 631 586-4220 1 800 645-5538

WWW.ALARMCONTROLS.COM EMAIL INFO@ALARMCONTROLS.COM

INSTRUCTIONS FOR DISASSEMBLY OF MODELS EXP-1, EXP-2 EXPLOSION-PROOF REQUEST TO EXIT STATIONS

SHOWN WITH
SWITCH BLOCK INSTALLED

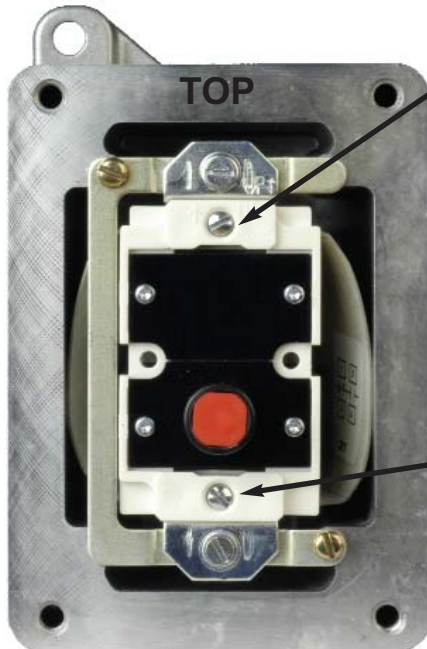


LOOSEN THIS
SCREW TO
REMOVE SWITCH
BLOCK

*PULL SWITCH
BLOCK UP TO
REMOVE AFTER
LOOSENING SCREWS*

LOOSEN THIS
SCREW TO
REMOVE SWITCH
BLOCK

SWITCH BLOCK

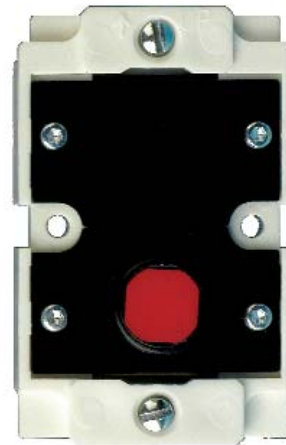

SHOWN WITH
SWITCH BLOCK REMOVED

NORMALLY-CLOSED
CONTACTS



NORMALLY-OPEN
CONTACTS



ALARM CONTROLS CORPORATION

19 BRANDYWINE DRIVE, P.O. BOX 280
DEER PARK, NY 11729

PH: 800 645-5538 FAX: 1 631 586-6500 EMAIL: INFO@ALARMCONTROLS.COM