

COMPANY:
ACCOUNT#
ADDRESS:
ADDRESS:
PHONE:
FAX:
CONTACT:



9500 X 5020 NGP-EDGE  
INTUMESCENT FIRE SEAL  
AND SMOKE SEAL

REVISIONS			
REV.	DESCRIPTION	DATE	APPR'D



SCALE = FULL


TOLERANCE = GASKET MANUFACTURER'S STANDARDS.

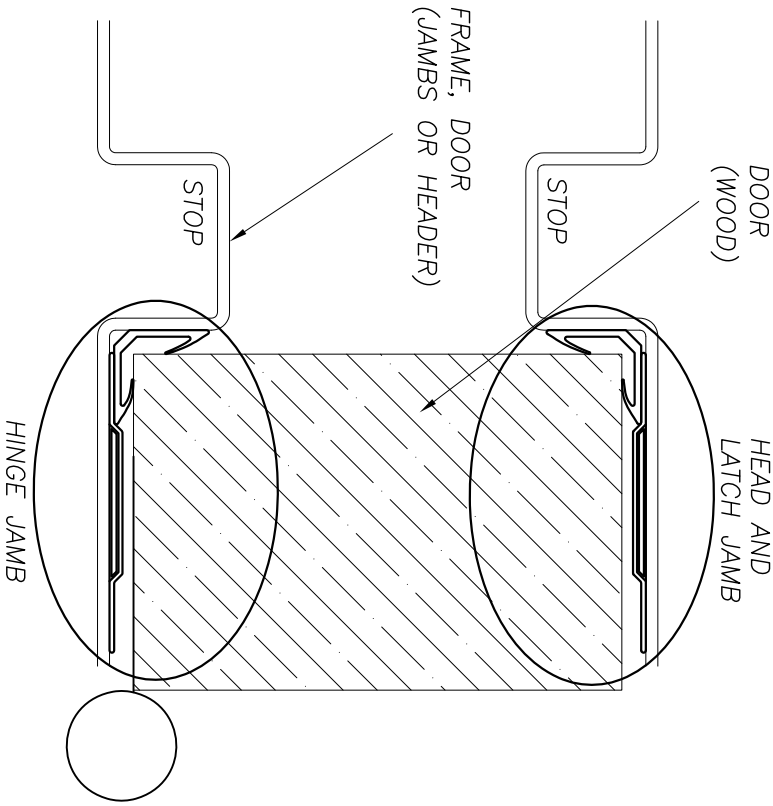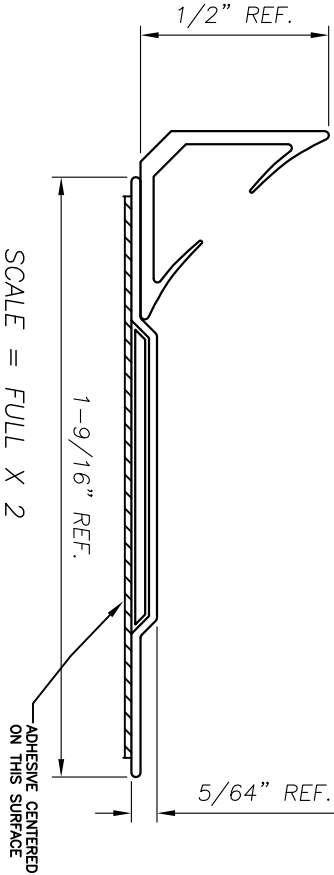

INSTALLED VIEW

GASKET MATERIAL:  
 INTUMESCENT WITH PVC COVER X TPE SMOKE SEAL  
 GASKET COLOR:  
 9500DKB X 5020B = BROWN  
 9500 X 5020B = GRAY X BROWN

AVAILABLE IN 36", 48", 84", 96" AND 108" LENGTHS  
 1/8" CLEARANCE REQUIRED BETWEEN DOOR AND FRAME  
 PLEASE REFER TO NGP CATALOG

		<b>NATIONAL GUARD PRODUCTS, INC.</b> 4985 EAST RAINES ROAD MEMPHIS, TN 38118 PHONE (800) 647-7874 FAX (800) 255-7874	
TITLE <b>9500 X 5020</b>		SIZE A	FSCM NO. 1
DRAWN BY: DANNY TOMPKINS		DWG NO. 1	REV A
SCALE: SEE NOTES		DATE: 03/20/12	SHEET: 1 OF 1