



NOTE: Before installing switch assemblies, position control head in the pinned, cocked position. This will allow additional room for mounting switches.

When switch installation is complete, remove locking pin and make certain the arms of each switch operate properly when contacted by the contact post.

One and Two Micro-Switch Assemblies – CH

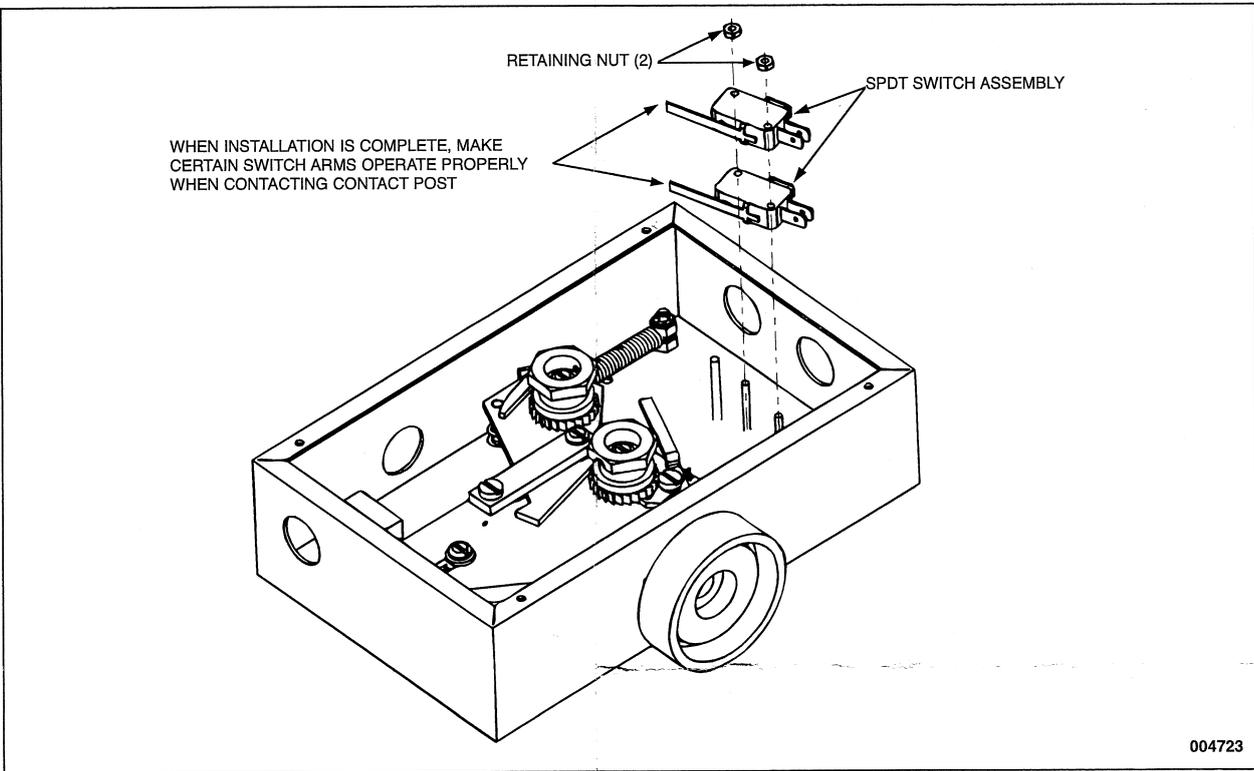

One and Two Micro-Switch Assembly – EN

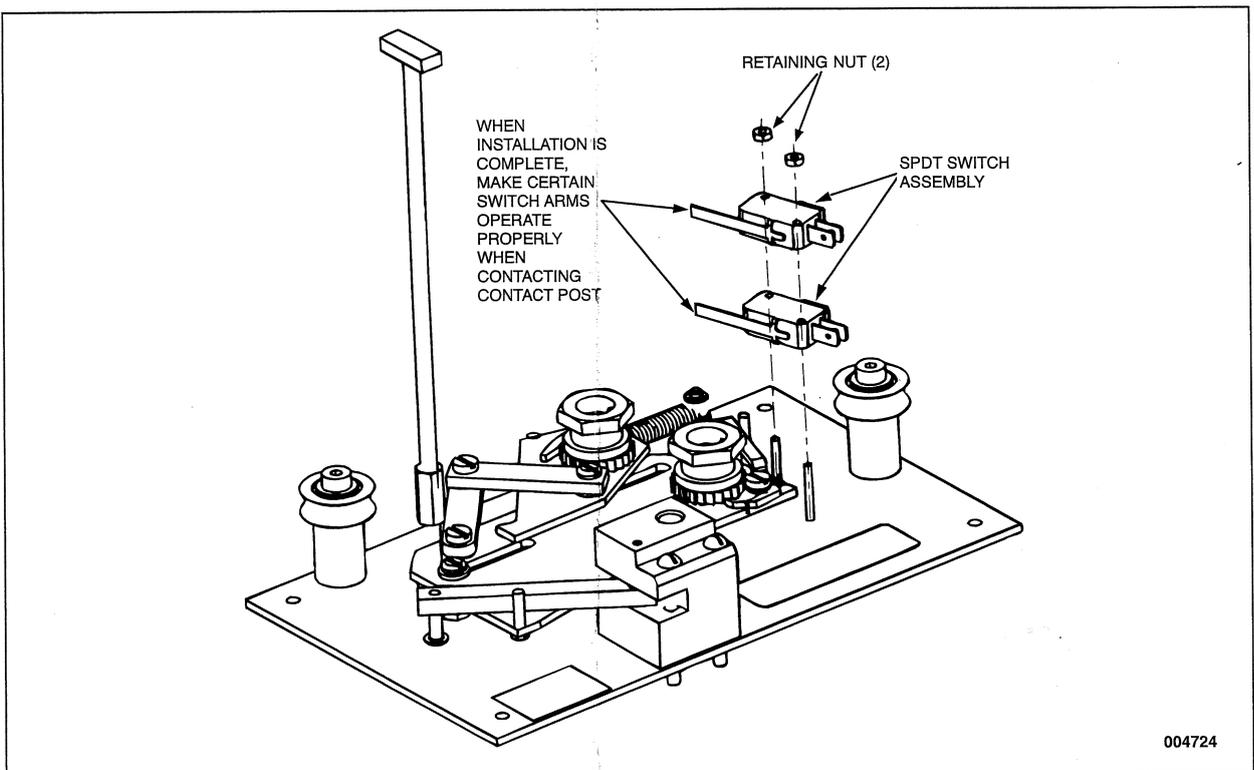


Three and Four Micro-Switch Assembly – CH

NOTE: WHEN INSTALLING 3 AND 4 MICRO-SWITCHES, YOU MUST BEGIN BY PLACING TWO (2) MICRO-SWITCHES ON POSTS, THEN SPACERS AND ADDITIONAL SWITCHES

WHEN INSTALLATION IS COMPLETE, MAKE CERTAIN SWITCH ARMS OPERATE PROPERLY WHEN CONTACTING CONTACT POST

NOTE: WHEN INSTALLING GAS VALVE CABLE, MAKE CERTAIN THAT THE CABLE WILL RUN IN-BETWEEN THE UPPER AND LOWER MICRO-SWITCHES

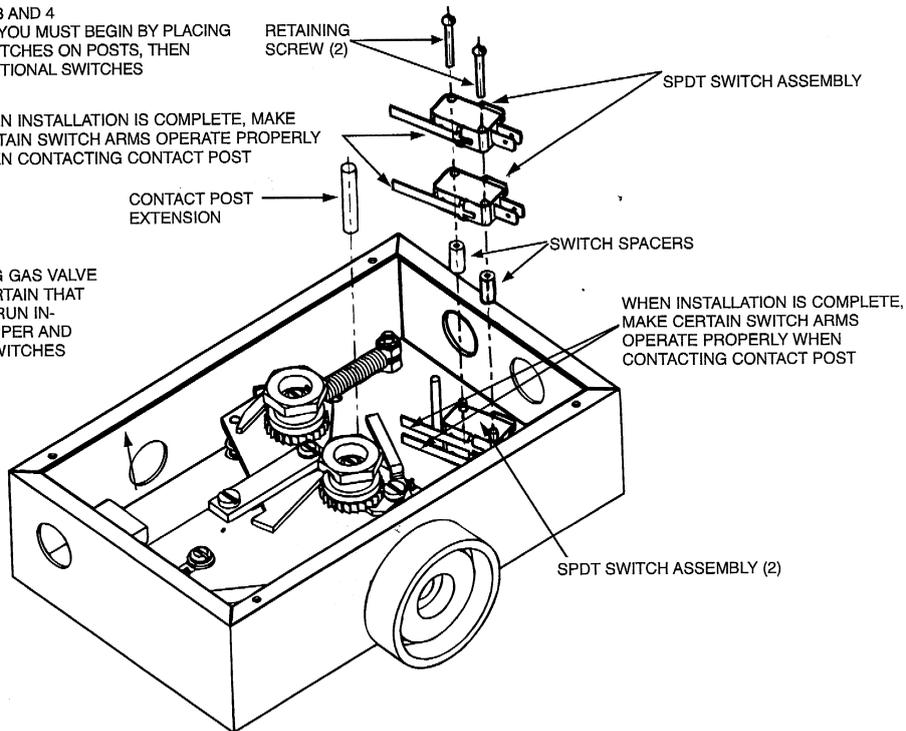


004725

Three and Four Micro-Switch Assembly – EN

NOTE: WHEN INSTALLING 3 AND 4 MICRO-SWITCHES, YOU MUST BEGIN BY PLACING TWO (2) MICRO-SWITCHES ON POSTS, THEN SPACERS AND ADDITIONAL SWITCHES

WHEN INSTALLATION IS COMPLETE, MAKE CERTAIN SWITCH ARMS OPERATE PROPERLY WHEN CONTACTING CONTACT POST

NOTE: WHEN INSTALLING GAS VALVE CABLE, MAKE CERTAIN THAT THE CABLE WILL RUN IN-BETWEEN THE UPPER AND LOWER MICRO-SWITCHES

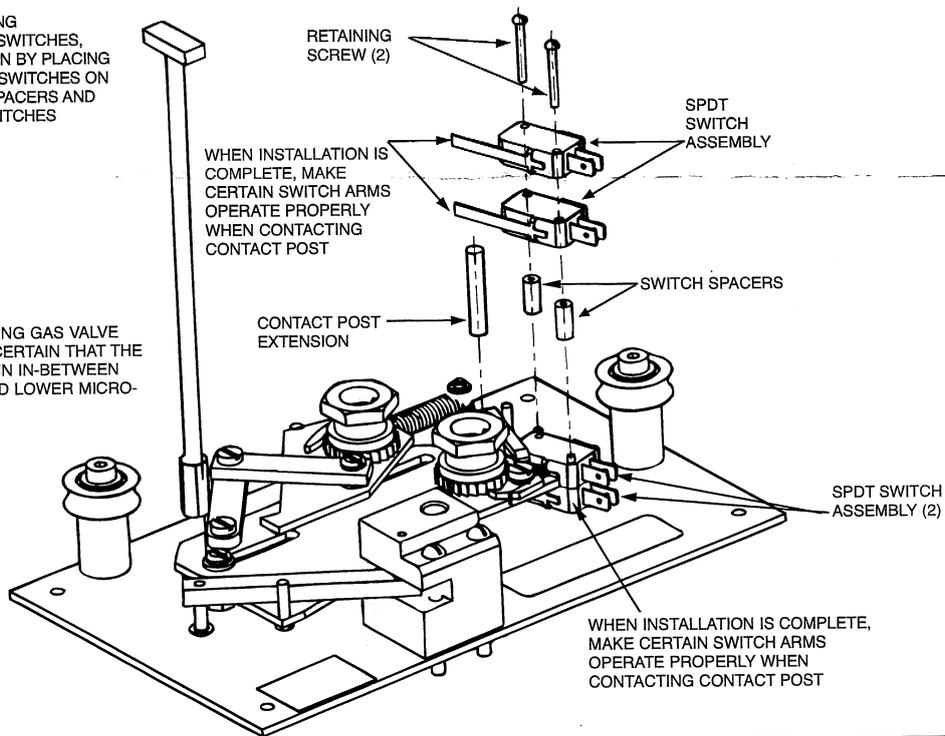

004726

Switch Wiring Diagram

