

IV. INSTALLATION INSTRUCTIONS (continued)

C. Electrical Wiring

The 6-conductor wire harness is to be terminated to the I/O Board as follows:


Wire Connections To I/O Board P/N 313383

COLOR	TB1 ON I/O BOARD	FUNCTION
Brown	4	Automatic
Yellow	5 & 9	Switch I Common
Black	6	Hold Open
Red	7	Enter Switch
Orange	8	Enter Switch Common
Green	10	Reduced Open

NOTE

A wire jumper must be installed on TB1 between terminals 7 and 8 if there is no door position switch or solenoid lock used in the system.

Route the wire harness to the cover or jamb (for flush mount), or externally for surface mount. Plug the wire harness connector to the Rotary/Key Switch prior to mounting the Switch Plate.

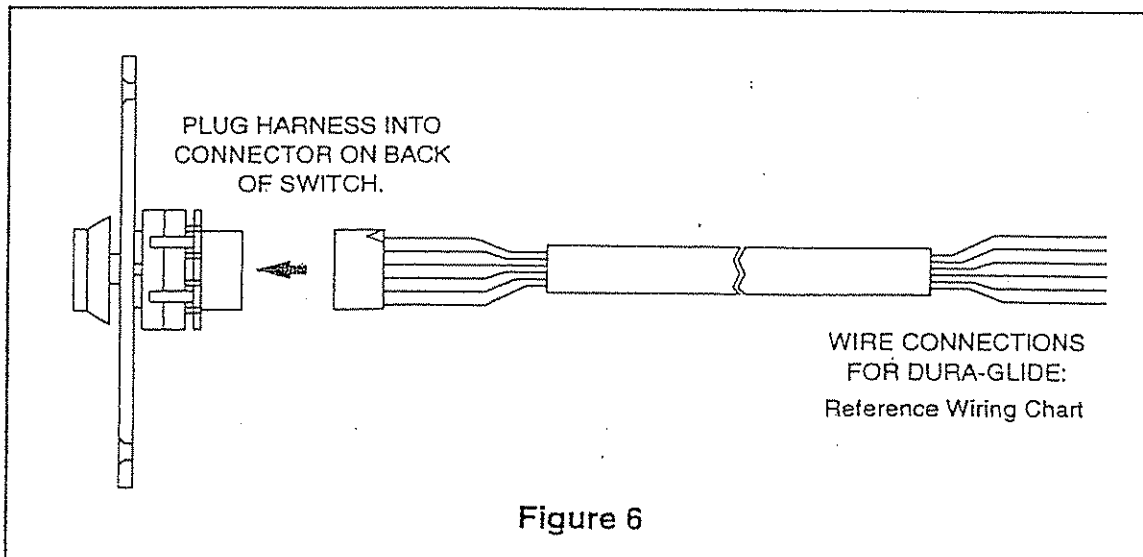

A schematic of the Rotary/Key Switch is shown on the last page of this manual.