

Strike First Corporation of America

BC-BUBBLE Canopy Series Cabinets

Detail & Submittal Sheet

Construction Specifications:

Bubble Canopy (BC) cabinet fronts are 16 gauge cold rolled steel with 22 gauge cold rolled steel tubs. Cabinets offer a sleek design including a convex acrylic bubble door extending out from the trim, permitting 180° of visibility for quick identification of the extinguisher.



To comply with ADA Guidelines, Extinguishers and Cabinets offer handles, brackets and return trims according to instructions provided by installer. For ADA compliance follow the specification ordering process dimensions in our catalog. Proper installation in accordance with the ADA Guidelines is the sole responsibility of the installer. For more information please visit the Accessibility Guidelines for Buildings and Facilities website or call them at 1-800-872-2253.



SPECIFICATION PROCESS: Follow the steps below to specify your cabinet.

STEP 1: EXTINGUISHER SIZE:
1 - 10 lb. 2 - 20 lb.

STEP 2: CABINET STYLE:
0 - Surface Mounted (S)
1 - Semi-Recessed (SR)
2 - Fully-Recessed (FR)

STEP 3: DOOR STYLE:
Bubble Only

STEP 4: SERIES:
BC - Bubble Cabinet

STEP 5: CABINET TYPE:
SG - SAFEGUARD - Fire Rated

STEP 6: FINISH OPTIONS:

- ☐ SSF - Stainless Steel Front
- ☐ FSS - Full Stainless Steel
- ☐ AL - Aluminum Front
- ☐ FAL - Full Aluminum
- ☐ RD - Red Coated

STEP 5: HANDLE OPTIONS:

- ☐ 008 - Safety Break Lock
- ☐ 010 - Alum. Die Cast Red "Fire" Handle
- ☐ 012 - ADA Handle


STEP 7: GLAZING:

Bubble Only


STEP 8: LETTERING:

- ☐ 004 - Decal "Fire Ext." Lrg Vert R/B
- ☐ 006 - Decal "Fire Ext." Lrg Horiz R/B


SAFEGUARD Fire Rating Assembly

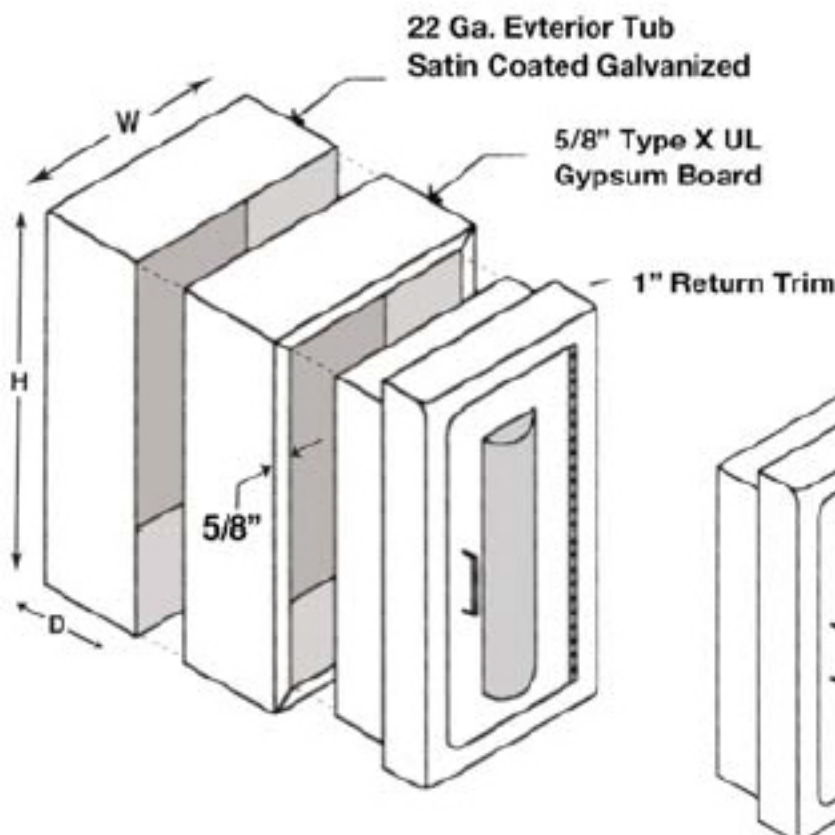


Non-Rated

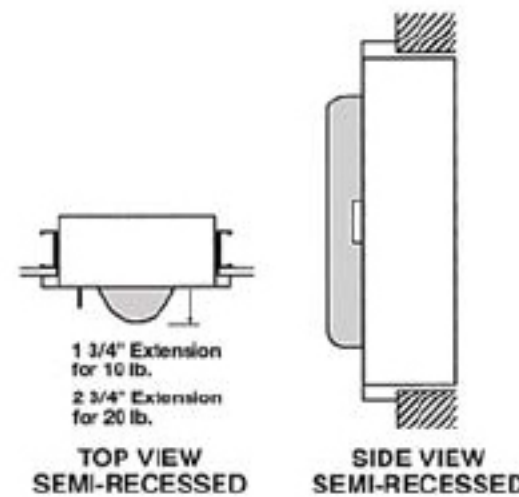

SAFEGUARD Typical Semi-Recessed Fire Rated Installation ONE HOUR FIRE WALL SYSTEM

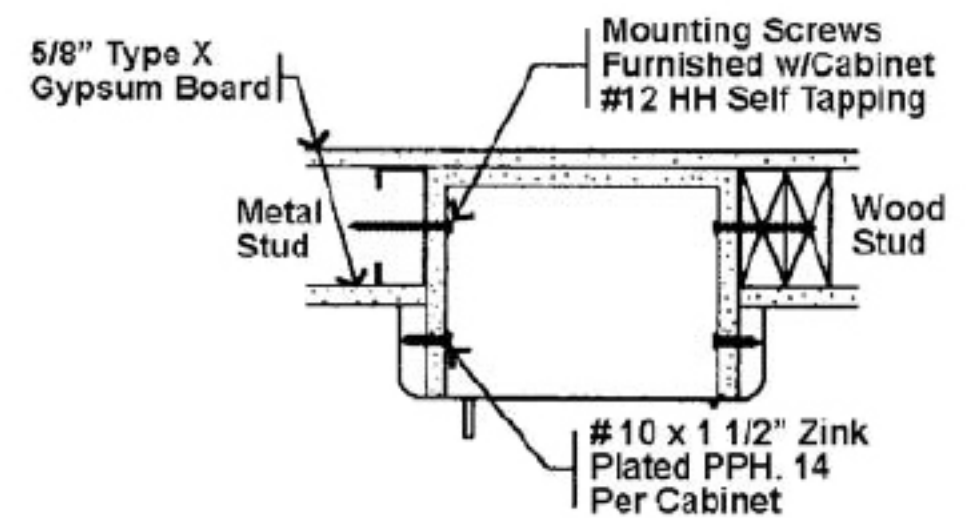

TWO HOUR FIRE WALL SYSTEM

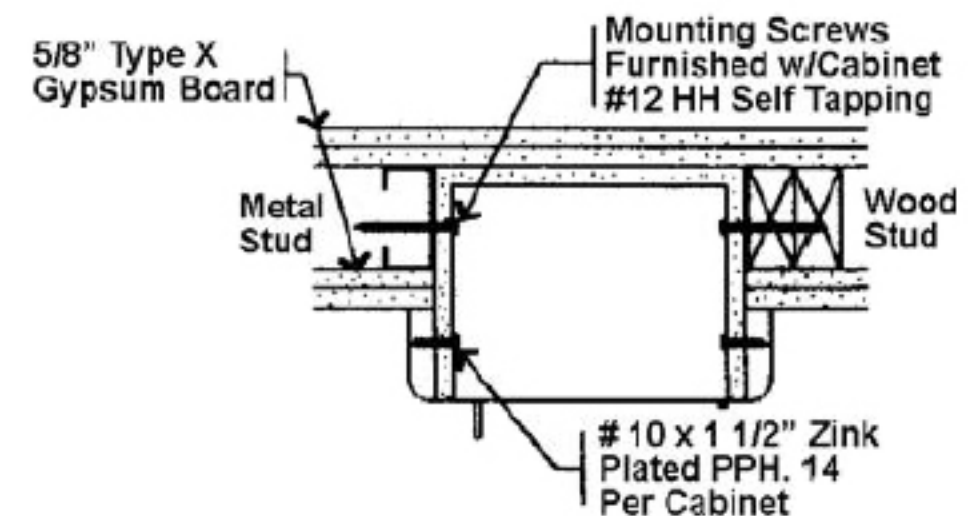

UL Classified 5/8" Type X gypsum board inserted in the cavity between the two layers. Warnock Hersey has approved the Safeguard Cabinets to be mounted in any face of fire rated steel or wood stud for up to 2 hour rated walls without affecting its fire rating. The above meets the requirement test ASTM-E119-98 with test report WHI-495-1534. MOUNTING INSTRUCTIONS are supplied with each safeguard cabinet.

✓	Mod. #	Interior Tub Size			Overall Outside Trim		Rough Opening			Trim Style	SAFEGUARD Rough Opening			SAFEGUARD Trim Style	Accom. Ext Size
		W	H	D	W	H	W	H	D		W	H	D		Lbs.
Surface Mounted															
	10-BC	10 1/2"	24"	4 1/2"	11"	24 1/2"	-	-	-	-	-	-	-	-	10
Semi-Recessed															
	11-BC	10 1/2"	24"	4 1/2"	14 1/2"	28"	10 3/4"	24 1/4"	3"	1 1/2"	12 1/4"	25 3/4"	3 3/4"	1 1/2"	10
	21-BC	14"	30"	4 3/4"	18 1/2"	34"	14 3/4"	30 1/4"	4 1/4"	1	16 1/4"	31 3/4"	5"	1"	20
Fully-Recessed															
	12-BC	10 1/2"	24"	4 1/2"	14 1/2"	28"	10 3/4"	24 1/4"	4 1/2"	1/4"	12 1/4"	25 3/4"	5 1/4"	1/4"	10

SFCA 2010