

FIRE RATING



UL listed




10C Classified

SMOKE PERFORMANCE



The rubber seal in this gasket provides protection from smoke infiltration in accordance with provisions of NFPA 101 Life Safety Code and NFPA 80 Standard for Fire Doors and Other Opening Protectives

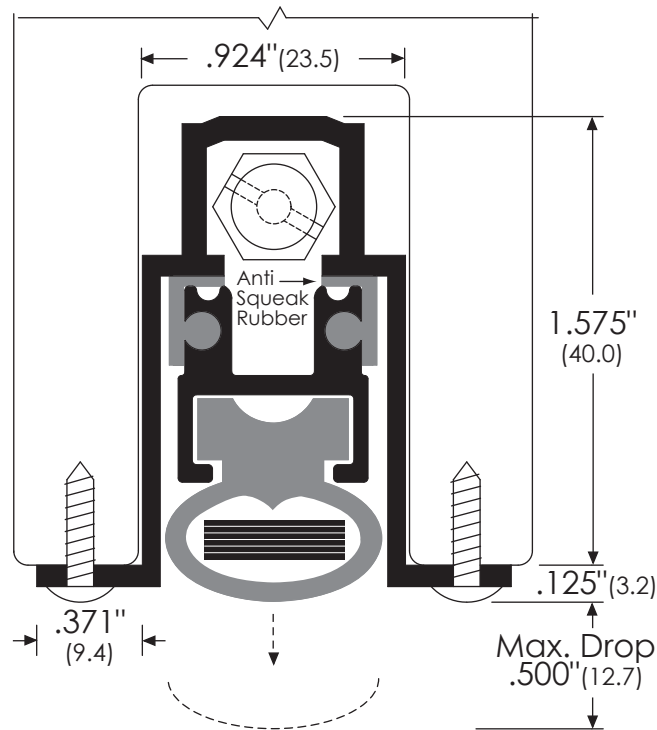

415 Concord Avenue
Bronx, NY 10455

email: zero@zerointernational.com
web site: www.zerointernational.com

tel: 718.585.3230
fax: 718.292.2243

Notes:

Part No:

364FS

Part Description:

Intumescent Automatic
Door Bottom

- Mortised

Provided By:

Customer Name:

Job No:

Date: