ICM CONTROLS™

Compressor Lockout

# ICM207/208/209

## DELAY ON BREAK

APS

- ***3 or 5 minutes fixed, 10 minutes adjustable***
- ***Works with anticipator type thermostats***

## MODE OF OPERATION

Upon initial thermostat closure, the load is energized. When the thermostat opens or there is a loss of power, the load is de-energized and the delay period begins. The compressor will not start again during the delay period.

## SPECIFICATIONS

**Input**

- ***Voltage:*** 18-240 VAC
- ***Frequency:*** 50-60 Hz

**Output**

- ***Output Ratings:***
  - ***Maximum:*** 1 amp
  - ***Minimum:*** 40 mA
  - ***Inrush:*** 10 amps


**Time Delay**

- ***Fixed:*** 3 or 5 minutes
- ***Adjustable:*** 10 minutes


## INSTALLATION

1. Disconnect power.
2. Connect terminals as shown in the wiring diagram below.
3. Select the desired time delay (adjustable models only).
4. Reapply power, check operation.

## TIMING DIAGRAM

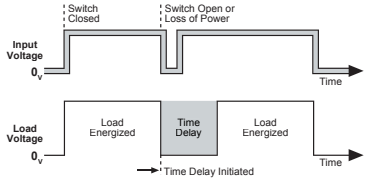


## WIRING DIAGRAM

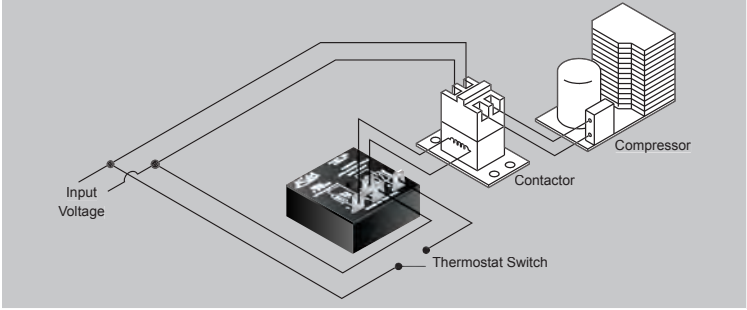


**ICM CONTROLS** 6333 Daedalus Drive, Cicero, N.Y. 13039 **800-365-5525**
visit us on the web at: **www.icmcontrols.com**