



Air Conditioning & Heating

DSXC16

SPLIT SYSTEM AIR CONDITIONER

UP TO 16 SEER

R-410A

COOLING CAPACITY
24,000 - 57,000 BTU/h

Standard Features

- R-410A chlorine-free refrigerant
- Two-Stage Copeland UltraTech scroll compressor
- High-density foam compressor sound blanket
- ComfortNet™ Communications System compatible
- Expanded ComfortAlert diagnostics built in
- Set-up capable with 2 low-voltage wires to outdoor unit
- Diagnostic indicator lights and storage of 6 fault codes
- Color-coded terminal strip for non-communicating set-up
- High- and low-pressure switches
- Fully charged for 15' of tubing length
- Factory-installed filter dryer
- Coil and ambient temperature sensors
- Two-speed, super-quiet condenser fan motor
- Sweat connection service valves with easy access to gauge ports
- AHRI Certified; ETL Listed

Cabinet Features

- Wire fan discharge grille
- Steel louver coil guard
- Baked-on powder paint finish
- Rust-resistant coated screws
- Compact footprint
- Top and side maintenance access
- Single-panel access to controls with space provided for field-installed accessories
- When properly anchored, meets 2001 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



Contents

Nomenclature	2
Product Specifications	3
Expanded Cooling Data	4
AHRI Performance Data	28
Dimensions	38
Wiring Diagram	39
Accessories	40



* Complete warranty details available from your local dealer or at www.goodmanmfg.com. To receive the Lifetime Compressor Limited Warranty (good for as long as you own your home), 10-Year Unit Replacement Limited Warranty and 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Québec.



NOMENCLATURE

	D	S	X	C	16	036	1	A	A	
	1	2	3	4	5,6	7,8,9	10	11	12	
Brand	D Goodman [®] Brand									Engineering * Minor Revision
Product Category	S Split System									Engineering * Major Revision
Unit Type	C Condenser R-22		X Condenser R-410A		H Heat Pump R-22		Z Heat Pump R-410A			Electrical
Communication Feature	C ComfortNet 4-wire communications ready									
Efficiency	13 13 SEER	16 16 SEER								
	14 14 SEER	18 18 SEER								
								1 208/230 V, 1 Phase, 60 Hz		
								2 220/240 V, 1 Phase, 50 Hz		
								3 208/230 V, 3 Phase, 60 Hz		
								4 460 V, 3 Phase, 60 Hz		
								5 380/415 V, 3 Phase, 50 Hz		
										Nominal Capacity
								018 1½ Tons	048 4 Tons	
								024 2 Tons	060 5 Tons	
								030 2½ Tons	090 7½ tons	
								036 3 Tons	120 10 Tons	
								042 3½ Tons		

* Neither used for order entry or inventory management.

Important EnergyStar Notice: EnergyStar ratings are dependent upon conditions beyond equipment installation. Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet EnergyStar criteria. Ask your contractor for details or visit www.energystar.gov.

SPECIFICATIONS

	DSXC16 0241A*	DSXC16 0361A*	DSXC16 0481A*	DSXC16 0481B*	DSXC16 0601A*	DSXC16 0601B*
COOLING CAPACITY						
Nominal Cooling (BTU/h)	24,000	36,000	48,000	48,000	60,000	60,000
Decibels	71	70.4/70.9	74	74	75	75
COMPRESSOR						
RLA	10.3	16.7	21.2	21.2	25.6	25.6
LRA	52.0	82.0	96.0	96.0	118.0	118.0
CONDENSER FAN MOTOR						
Horsepower (RPM)	1/6	1/6	1/6	1/6	1/6	1/6
FLA	1.1	0.9	1.0	1.0	1.0	1.0
REFRIGERATION SYSTEM						
Refrigerant Line Size ¹						
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	7/8"	1 1/8"	1 1/8"	1 1/8"	1 1/8"
Refrigerant Connection Size						
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.)	3/4"	3/4"	7/8"	7/8"	7/8"	7/8"
Valve Connection Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	97	107	199	132	194	197
Electrical Data						
Voltage/Hz-Phase	208/230-60-1		208/230-60-1		208/230-60-1	
Minimum Circuit Ampacity ²	14.0	21.8	27.4	27.5	33.0	33.0
Max. Overcurrent Protection ³	20	35	40	45	50	50
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253
Power Supply	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
SHIP WEIGHT (LBS)	282	282	282	236	296	296

¹ Tested and rated in accordance with ARI Standard 210/240

² Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

³ Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- Always check the S&R plate for electrical data on the unit being installed.
- Installer will need to supply 7/8" to 1 1/8" adapters for suction line connections.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.
- Installation of these units requires the specified TXV Kit to be installed on the indoor coil. THE SPECIFIED TXV IS DETERMINED BY THE OUTDOOR UNIT, NOT THE INDOOR COIL.

EXPANDED COOLING DATA — DSXC160241A* / CA*F3636C6C* +TXV/ MBVC1200** LOW STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	18.0	18.7	20.4	-	17.6	18.2	20.0	-	17.2	17.8	19.5	-	16.7	17.4	19.0	-	15.9	16.5	18.1	-	14.7	15.3	16.7	-
	S/T	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.80	0.66	0.46	-	0.82	0.69	0.48	-	0.85	0.71	0.49	-	0.86	0.72	0.50	-
	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	kW	1.10	1.12	1.16	-	1.19	1.21	1.25	-	1.26	1.29	1.34	-	1.33	1.37	1.41	-	1.39	1.43	1.48	-	1.44	1.48	1.53	-
	Amps	4.5	4.6	4.7	-	4.8	4.9	5.1	-	5.2	5.3	5.5	-	5.6	5.7	5.9	-	5.9	6.1	6.3	-	6.3	6.4	6.6	-
	Hi PR	228	245	248	-	258	277	281	-	293	315	319	-	334	359	364	-	375	404	409	-	420	452	458	-
	Lo PR	122	125	137	-	125	129	141	-	129	133	146	-	133	137	150	-	135	140	153	-	139	143	156	-
	MBh	17.5	18.1	19.8	-	17.1	17.7	19.4	-	16.7	17.3	18.9	-	16.3	16.8	18.5	-	15.4	16.0	17.5	-	14.3	14.8	16.2	-
	S/T	0.71	0.60	0.41	-	0.74	0.62	0.43	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.82	0.68	0.47	-
	ΔT	19	17	13	-	19	17	13	-	19	17	13	-	20	17	13	-	19	17	13	-	18	16	12	-
	kW	1.09	1.11	1.15	-	1.18	1.20	1.24	-	1.25	1.28	1.33	-	1.32	1.35	1.40	-	1.38	1.41	1.46	-	1.43	1.47	1.52	-
	Amps	4.4	4.5	4.7	-	4.8	4.9	5.0	-	5.2	5.3	5.5	-	5.5	5.7	5.8	-	5.9	6.0	6.2	-	6.2	6.4	6.6	-
Hi PR	226	243	246	-	255	274	278	-	290	312	316	-	330	355	360	-	372	400	405	-	416	447	454	-	
Lo PR	120	124	136	-	124	128	140	-	128	132	144	-	132	136	148	-	134	138	151	-	137	142	155	-	
MBh	16.1	16.7	18.3	-	15.8	16.3	17.9	-	15.4	15.9	17.5	-	15.0	15.6	17.0	-	14.3	14.8	16.2	-	13.2	13.7	15.0	-	
S/T	0.69	0.58	0.40	-	0.71	0.60	0.41	-	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.79	0.66	0.46	-	
ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-	
kW	1.08	1.10	1.14	-	1.17	1.19	1.23	-	1.24	1.27	1.31	-	1.31	1.34	1.39	-	1.37	1.40	1.45	-	1.42	1.45	1.50	-	
Amps	4.4	4.5	4.6	-	4.7	4.8	5.0	-	5.1	5.3	5.4	-	5.5	5.6	5.8	-	5.8	6.0	6.2	-	6.2	6.3	6.5	-	
Hi PR	223	240	244	-	252	271	275	-	287	309	313	-	327	352	357	-	368	396	401	-	412	443	449	-	
Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	134	147	-	133	137	150	-	136	140	153	-	

75	MBh	18.3	18.8	20.4	21.9	17.9	18.4	19.9	21.4	17.5	18.0	19.4	20.9	17.0	17.5	19.0	20.4	16.2	16.7	18.0	19.3	15.0	15.4	16.7	17.9
	S/T	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.38	0.90	0.81	0.61	0.39	0.93	0.84	0.63	0.41	0.97	0.87	0.66	0.42	0.98	0.87	0.66	0.43
	ΔT	21	20	16	11	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	18	15	10
	kW	1.10	1.12	1.16	1.20	1.19	1.21	1.25	1.30	1.26	1.29	1.34	1.38	1.33	1.37	1.41	1.46	1.39	1.43	1.48	1.53	1.44	1.48	1.53	1.58
	Amps	4.5	4.6	4.7	4.9	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.1	6.3	6.5	6.3	6.4	6.6	6.9
	Hi PR	228	245	248	254	258	277	281	287	293	315	319	326	334	359	364	372	375	404	409	418	420	452	458	468
	Lo PR	122	125	137	146	125	129	141	150	129	133	146	155	133	137	150	159	135	140	153	162	139	143	156	166
	MBh	17.8	18.3	19.8	21.3	17.4	17.9	19.3	20.8	16.9	17.4	18.9	20.3	16.5	17.0	18.4	19.8	15.7	16.2	17.5	18.8	14.5	15.0	16.2	17.4
	S/T	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.37	0.86	0.77	0.58	0.38	0.89	0.80	0.60	0.39	0.92	0.83	0.63	0.40	0.93	0.83	0.63	0.41
	ΔT	22	20	17	12	22	21	17	12	22	21	17	12	23	21	17	12	23	20	17	12	21	19	16	11
	kW	1.09	1.11	1.15	1.19	1.18	1.20	1.24	1.29	1.25	1.28	1.33	1.37	1.32	1.35	1.40	1.45	1.38	1.41	1.46	1.51	1.43	1.47	1.52	1.57
	Amps	4.4	4.5	4.7	4.8	4.8	4.9	5.0	5.2	5.2	5.3	5.5	5.7	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.4	6.2	6.4	6.6	6.8
Hi PR	226	243	246	251	255	274	278	284	290	312	316	323	330	355	360	368	372	400	405	414	416	447	454	464	
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	137	142	155	165	
MBh	16.4	16.9	18.3	19.6	16.0	16.5	17.9	19.2	15.6	16.1	17.4	18.7	15.3	15.7	17.0	18.2	14.5	14.9	16.2	17.3	13.4	13.8	15.0	16.1	
S/T	0.78	0.70	0.53	0.34	0.81	0.73	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.90	0.80	0.61	0.39	
ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11	
kW	1.08	1.10	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.39	1.44	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.56	
Amps	4.4	4.5	4.6	4.8	4.7	4.8	5.0	5.2	5.1	5.3	5.4	5.6	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4	6.2	6.3	6.5	6.8	
Hi PR	223	240	244	249	252	271	275	281	287	309	313	320	327	352	357	364	368	396	401	410	412	443	449	459	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160241A* / CA*F3636C6C* +TXV/ MBVC1200** LOW STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE														
		65°F				75°F				85°F				95°F				105°F				115°F						
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71			
80	675	MBh	18.6	19.0	20.3	21.7	18.2	18.6	19.9	21.2	17.8	18.1	19.4	20.7	17.3	17.7	18.9	20.2	16.5	16.8	18.0	19.2	15.2	15.6	16.6	17.8		
		S/T	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	1.00	0.93	0.76	0.57	1.00	0.96	0.78	0.58	1.00	1.00	0.81	0.61	1.00	1.00	0.82	0.61		
	600	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	21	21	19	15		
		kW	1.10	1.12	1.16	1.20	1.19	1.21	1.25	1.30	1.26	1.29	1.34	1.38	1.33	1.37	1.41	1.46	1.39	1.43	1.48	1.53	1.44	1.48	1.53	1.58		
	85	675	Amps	4.5	4.6	4.7	4.9	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.1	6.3	6.5	6.3	6.4	6.6	6.9	
			HI PR	228	245	248	254	258	277	281	287	293	315	319	326	334	359	364	372	375	404	409	418	420	452	458	468	
		600	Lo PR	122	125	137	146	125	129	141	150	129	133	146	155	133	137	150	159	135	140	153	162	139	143	156	166	
			MBh	18.1	18.5	19.7	21.1	17.7	18.1	19.3	20.6	17.2	17.6	18.8	20.1	16.8	17.2	18.4	19.6	16.0	16.3	17.4	18.7	14.8	15.1	16.2	17.3	
		525	675	S/T	0.89	0.84	0.68	0.51	0.92	0.87	0.70	0.53	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	1.00	0.95	0.77	0.58	1.00	0.96	0.78	0.58
				ΔT	25	24	21	16	25	24	21	17	25	24	21	17	25	24	21	17	24	24	21	17	23	22	19	15
			600	kW	1.09	1.11	1.15	1.19	1.18	1.20	1.24	1.29	1.25	1.28	1.33	1.37	1.32	1.35	1.40	1.45	1.38	1.41	1.46	1.51	1.43	1.47	1.52	1.57
				Amps	4.4	4.5	4.7	4.8	4.8	4.9	5.0	5.2	5.2	5.3	5.5	5.7	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.4	6.2	6.4	6.6	6.8
525			675	HI PR	226	243	246	251	255	274	278	284	290	312	316	323	330	355	360	368	372	400	405	414	416	447	454	464
				Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	137	142	155	165
			600	MBh	16.7	17.1	18.2	19.5	16.3	16.7	17.8	19.0	15.9	16.3	17.4	18.6	15.5	15.9	17.0	18.1	14.8	15.1	16.1	17.2	13.7	14.0	14.9	15.9
				S/T	0.86	0.81	0.66	0.49	0.89	0.83	0.68	0.51	0.91	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.92	0.75	0.56
	525		675	ΔT	25	24	21	17	25	24	21	17	25	24	21	17	26	25	21	17	25	24	21	17	24	23	20	16
				kW	1.08	1.10	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.39	1.44	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.56
			600	Amps	4.4	4.5	4.6	4.8	4.7	4.8	5.0	5.2	5.1	5.3	5.4	5.6	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4	6.2	6.3	6.5	6.8
				HI PR	223	240	244	249	252	271	275	281	287	309	313	320	327	352	357	364	368	396	401	410	412	443	449	459
		525	675	Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163
				MBh	19.0	19.3	20.2	21.6	18.5	18.9	19.8	21.1	18.1	18.4	19.3	20.6	17.6	18.0	18.8	20.1	16.8	17.1	17.9	19.1	15.5	15.8	16.6	17.7
			600	S/T	0.98	0.94	0.85	0.69	1.00	0.98	0.88	0.72	1.00	1.00	0.91	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.97	0.79	1.00	1.00	0.98	0.79
				ΔT	25	25	23	20	25	25	24	21	25	25	24	21	24	24	24	21	23	23	24	20	21	22	22	19
85			675	kW	1.10	1.12	1.16	1.20	1.19	1.21	1.25	1.30	1.26	1.29	1.34	1.38	1.33	1.37	1.41	1.46	1.39	1.43	1.48	1.53	1.44	1.48	1.53	1.58
				Amps	4.5	4.6	4.7	4.9	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.7	5.9	6.1	5.9	6.1	6.3	6.5	6.3	6.4	6.6	6.9
			600	HI PR	228	245	248	254	258	277	281	287	293	315	319	326	334	359	364	372	375	404	409	418	420	452	458	468
				Lo PR	122	125	137	146	125	129	141	150	129	133	146	155	133	137	150	159	135	140	153	162	139	143	156	166
	85		675	MBh	18.4	18.8	19.6	21.0	18.0	18.3	19.2	20.5	17.5	17.9	18.7	20.0	17.1	17.4	18.3	19.5	16.3	16.6	17.4	18.5	15.1	15.4	16.1	17.2
				S/T	0.93	0.90	0.81	0.66	0.97	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.93	0.75	1.00	1.00	0.93	0.76
			600	ΔT	26	26	24	21	27	26	25	21	27	26	25	21	26	26	25	22	25	25	25	21	23	24	23	20
				kW	1.09	1.11	1.15	1.19	1.18	1.20	1.24	1.29	1.25	1.28	1.33	1.37	1.32	1.35	1.40	1.45	1.38	1.41	1.46	1.51	1.43	1.47	1.52	1.57
		85	675	Amps	4.4	4.5	4.7	4.8	4.8	4.9	5.0	5.2	5.2	5.3	5.5	5.7	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.4	6.2	6.4	6.6	6.8
				HI PR	226	243	246	251	255	274	278	284	290	312	316	323	330	355	360	368	372	400	405	414	416	447	454	464
			600	Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	137	142	155	165
				MBh	17.0	17.3	18.1	19.3	16.6	16.9	17.7	18.9	16.2	16.5	17.3	18.4	15.8	16.1	16.9	18.0	15.0	15.3	16.0	17.1	13.9	14.2	14.8	15.8
85			675	S/T	0.90	0.87	0.78	0.64	0.93	0.90	0.81	0.66	0.96	0.92	0.83	0.68	0.99	0.95	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.90	0.73
				ΔT	26.8	26	25	22	27	27	25	22	27	27	25	22	27	27	25	22	26	26	25	22	24	25	23	20
			600	kW	1.08	1.10	1.14	1.18	1.17	1.19	1.23	1.27	1.24	1.27	1.31	1.36	1.31	1.34	1.39	1.44	1.37	1.40	1.45	1.50	1.42	1.45	1.50	1.56
				Amps	4.4	4.5	4.6	4.8	4.7	4.8	5.0	5.2	5.1	5.3	5.4	5.6	5.5	5.6	5.8	6.0	5.8	6.0	6.2	6.4	6.2	6.3	6.5	6.8
	85		675	HI PR	223	240	244	249	252	271	275	281	287	309	313	320	327	352	357	364	368	396	401	410	412	443	449	459
				Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp. + fan)

EXPANDED COOLING DATA — DSXC160241A* / CA*F3636C6C* + TXV / MBVC1200** HIGH STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	23.5	24.4	26.7	-	23.0	23.8	26.1	-	22.4	23.2	25.5	-	21.9	22.7	24.8	-	20.8	21.5	23.6	-	19.3	20.0	21.9	-
	S/T	0.76	0.63	0.44	-	0.78	0.66	0.45	-	0.80	0.67	0.47	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.87	0.73	0.50	-
	ΔT	18	16	12	-	18	16	12	-	19	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	kW	1.50	1.53	1.58	-	1.62	1.65	1.71	-	1.72	1.76	1.82	-	1.81	1.86	1.92	-	1.89	1.94	2.00	-	1.96	2.01	2.07	-
	Amps	5.9	6.0	6.2	-	6.4	6.5	6.7	-	6.9	7.1	7.3	-	7.4	7.5	7.8	-	7.8	8.0	8.3	-	8.3	8.5	8.7	-
	HI PR	237	255	258	-	268	288	292	-	304	327	332	-	347	373	378	-	390	419	425	-	437	470	476	-
	Lo PR	122	125	137	-	125	129	141	-	129	134	146	-	133	137	150	-	136	140	153	-	139	143	156	-
	MBh	22.8	23.7	25.9	-	22.3	23.1	25.3	-	21.8	22.6	24.7	-	21.2	22.0	24.1	-	20.2	20.9	22.9	-	18.7	19.4	21.2	-
	S/T	0.72	0.60	0.42	-	0.75	0.63	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.69	0.48	-	0.83	0.69	0.48	-
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-
kW	1.49	1.52	1.57	-	1.61	1.64	1.69	-	1.71	1.75	1.80	-	1.80	1.84	1.90	-	1.88	1.92	1.98	-	1.94	1.99	2.06	-	
Amps	5.9	6.0	6.2	-	6.3	6.5	6.7	-	6.8	7.0	7.2	-	7.3	7.5	7.7	-	7.8	7.9	8.2	-	8.2	8.4	8.7	-	
HI PR	234	252	256	-	265	285	289	-	301	324	329	-	343	369	374	-	386	415	421	-	432	465	471	-	
Lo PR	120	124	136	-	124	128	140	-	128	132	144	-	132	136	148	-	134	138	151	-	138	142	155	-	
MBh	21.1	21.8	23.9	-	20.6	21.3	23.4	-	20.1	20.8	22.8	-	19.6	20.3	22.3	-	18.6	19.3	21.1	-	17.3	17.9	19.6	-	
S/T	0.70	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.80	0.67	0.46	-	
ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	19	17	13	-	18	16	12	-	
kW	1.48	1.51	1.56	-	1.59	1.63	1.68	-	1.69	1.73	1.79	-	1.78	1.82	1.89	-	1.86	1.90	1.97	-	1.93	1.97	2.04	-	
Amps	5.8	5.9	6.1	-	6.3	6.4	6.6	-	6.8	6.9	7.2	-	7.2	7.4	7.6	-	7.7	7.9	8.1	-	8.1	8.3	8.6	-	
HI PR	232	249	253	-	262	282	286	-	298	321	325	-	340	365	370	-	382	411	417	-	428	460	467	-	
Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	134	147	-	133	137	150	-	136	140	153	-	

900	MBh	23.9	24.6	26.7	28.6	23.4	24.1	26.0	27.9	22.8	23.5	25.4	27.3	22.2	22.9	24.8	26.6	21.1	21.8	23.6	25.3	19.6	20.2	21.8	23.4
	S/T	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.91	0.82	0.62	0.40	0.94	0.84	0.64	0.41	0.98	0.88	0.66	0.43	0.99	0.88	0.67	0.43
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	19	16	11	20	18	15	10
	kW	1.50	1.53	1.58	1.63	1.62	1.65	1.71	1.77	1.72	1.76	1.82	1.88	1.81	1.86	1.92	1.98	1.89	1.94	2.00	2.07	1.96	2.01	2.07	2.15
	Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.5	7.8	8.1	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1
	HI PR	237	255	258	264	268	288	292	298	304	327	332	339	347	373	378	386	390	419	425	435	437	470	476	487
	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	153	163	139	143	156	167
	MBh	23.2	23.9	25.9	27.8	22.7	23.4	25.3	27.1	22.1	22.8	24.7	26.5	21.6	22.2	24.1	25.8	20.5	21.1	22.9	24.5	19.0	19.6	21.2	22.7
	S/T	0.82	0.73	0.56	0.36	0.85	0.76	0.58	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.93	0.84	0.63	0.41	0.94	0.84	0.64	0.41
	ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	11	21	19	16	11
kW	1.49	1.52	1.57	1.62	1.61	1.64	1.69	1.75	1.71	1.75	1.80	1.87	1.80	1.84	1.90	1.97	1.88	1.92	1.98	2.05	1.94	1.99	2.06	2.13	
Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	7.9	8.2	8.5	8.2	8.4	8.7	9.0	
HI PR	234	252	256	261	265	285	289	295	301	324	329	336	343	369	374	382	386	415	421	430	432	465	471	482	
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	138	142	155	165	
MBh	21.4	22.1	23.9	25.6	20.9	21.6	23.3	25.0	20.4	21.0	22.8	24.4	19.9	20.5	22.2	23.8	18.9	19.5	21.1	22.7	17.5	18.1	19.6	21.0	
S/T	0.79	0.71	0.54	0.34	0.82	0.73	0.56	0.36	0.84	0.75	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.91	0.81	0.62	0.40	
ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11	
kW	1.48	1.51	1.56	1.61	1.59	1.63	1.68	1.74	1.69	1.73	1.79	1.85	1.78	1.82	1.89	1.95	1.86	1.90	1.97	2.04	1.93	1.97	2.04	2.11	
Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.9	8.1	8.4	8.1	8.3	8.6	8.9	
HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	382	411	417	426	428	460	467	477	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160241A* / CA*F3636C6C* +TXV/ MBVC1200** HIGH STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	900	MBh	24.3	24.9	26.6	28.4	23.8	24.3	26.0	27.7	23.2	23.7	25.3	27.1	22.6	23.1	24.7	26.4	21.5	22.0	23.5	25.1	19.9	20.4	21.8	23.3
		S/T	0.94	0.89	0.72	0.54	1.00	0.92	0.75	0.56	1.00	0.94	0.77	0.57	1.00	1.00	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.83	0.62
	ΔT	23	22	20	16	24	23	20	16	23	24	20	16	23	24	20	16	22	22	20	16	20	21	18	15	
	kW	1.50	1.53	1.58	1.63	1.62	1.65	1.71	1.77	1.72	1.76	1.82	1.88	1.81	1.86	1.92	1.98	1.89	1.94	2.00	2.07	1.96	2.01	2.07	2.15	
	Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.5	7.8	8.1	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1	
	HI PR	237	255	258	264	268	288	292	298	304	327	332	339	347	373	378	386	390	419	425	435	437	470	476	487	
	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	153	163	139	143	156	167	
	MBh	23.6	24.1	25.8	27.6	23.1	23.6	25.2	26.9	22.5	23.0	24.6	26.3	22.0	22.5	24.0	25.7	20.9	21.3	22.8	24.4	19.3	19.8	21.1	22.6	
	S/T	0.90	0.84	0.69	0.51	0.93	0.88	0.71	0.53	0.96	0.90	0.73	0.55	0.99	0.93	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.97	0.79	0.59	
	ΔT	24	23	20	16	25	24	21	16	25	24	21	16	25	24	21	17	24	24	21	16	22	22	19	15	
kW	1.49	1.52	1.57	1.62	1.61	1.64	1.69	1.75	1.71	1.75	1.80	1.87	1.80	1.84	1.90	1.97	1.88	1.92	1.98	2.05	1.94	1.99	2.06	2.13		
Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	7.9	8.2	8.5	8.2	8.4	8.7	9.0		
HI PR	234	252	256	261	265	285	289	295	301	324	329	336	343	369	374	382	386	415	421	430	432	465	471	482		
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	138	142	155	165		
MBh	21.8	22.3	23.8	25.5	21.3	21.8	23.3	24.9	20.8	21.3	22.7	24.3	20.3	20.7	22.2	23.7	19.3	19.7	21.0	22.5	17.9	18.2	19.5	20.8		
S/T	0.87	0.81	0.66	0.50	0.90	0.84	0.69	0.51	0.92	0.87	0.70	0.53	0.95	0.89	0.73	0.54	0.99	0.93	0.75	0.56	1.00	0.93	0.76	0.57		
ΔT	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	23	22	19	16		
kW	1.48	1.51	1.56	1.61	1.59	1.63	1.68	1.74	1.69	1.73	1.79	1.85	1.78	1.82	1.89	1.95	1.86	1.90	1.97	2.04	1.93	1.97	2.04	2.11		
Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.9	8.1	8.4	8.1	8.3	8.6	8.9		
HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	382	411	417	426	428	460	467	477		
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163		

85	900	MBh	24.8	25.2	26.4	28.2	24.2	24.7	25.8	27.6	23.6	24.1	25.2	26.9	23.0	23.5	24.6	26.2	21.9	22.3	23.4	24.9	20.3	20.7	21.6	23.1
		S/T	0.99	0.96	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.98	0.80	1.00	1.00	0.99	0.80
	ΔT	25	25	23	20	25	25	24	20	24	25	24	20	24	24	24	21	22	23	23	20	21	21	22	19	
	kW	1.50	1.53	1.58	1.63	1.62	1.65	1.71	1.77	1.72	1.76	1.82	1.88	1.81	1.86	1.92	1.98	1.89	1.94	2.00	2.07	1.96	2.01	2.07	2.15	
	Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.5	7.8	8.1	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1	
	HI PR	237	255	258	264	268	288	292	298	304	327	332	339	347	373	378	386	390	419	425	435	437	470	476	487	
	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	153	163	139	143	156	167	
	MBh	24.0	24.5	25.7	27.4	23.5	23.9	25.1	26.8	22.9	23.4	24.5	26.1	22.4	22.8	23.9	25.5	21.2	21.7	22.7	24.2	19.7	20.1	21.0	22.4	
	S/T	0.94	0.91	0.82	0.67	0.98	0.94	0.85	0.69	1.00	0.97	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.94	0.76	1.00	1.00	0.94	0.77	
	ΔT	26	26	24	21	26	26	25	21	26	26	25	21	26	26	25	21	24	25	24	21	23	23	23	20	
kW	1.49	1.52	1.57	1.62	1.61	1.64	1.69	1.75	1.71	1.75	1.80	1.87	1.80	1.84	1.90	1.97	1.88	1.92	1.98	2.05	1.94	1.99	2.06	2.13		
Amps	5.9	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.8	7.0	7.2	7.5	7.3	7.5	7.7	8.0	7.8	7.9	8.2	8.5	8.2	8.4	8.7	9.0		
HI PR	234	252	256	261	265	285	289	295	301	324	329	336	343	369	374	382	386	415	421	430	432	465	471	482		
Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	138	142	155	165		
MBh	22.2	22.6	23.7	25.3	21.7	22.1	23.1	24.7	21.2	21.6	22.6	24.1	20.6	21.0	22.0	23.5	19.6	20.0	20.9	22.3	18.2	18.5	19.4	20.7		
S/T	0.91	0.88	0.79	0.64	0.94	0.91	0.82	0.67	0.97	0.93	0.84	0.68	1.00	0.96	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.91	0.74		
ΔT	26.5	26	25	21	27	26	25	22	27	26	25	22	27	27	25	22	26	26	25	21	24	24	23	20		
kW	1.48	1.51	1.56	1.61	1.59	1.63	1.68	1.74	1.69	1.73	1.79	1.85	1.78	1.82	1.89	1.95	1.86	1.90	1.97	2.04	1.93	1.97	2.04	2.11		
Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.8	6.8	6.9	7.2	7.4	7.2	7.4	7.6	7.9	7.7	7.9	8.1	8.4	8.1	8.3	8.6	8.9		
HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	382	411	417	426	428	460	467	477		
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163		

kW = Total system power
Amps = outdoor unit amps (comp. + fan)

Shaded area reflects AHRI (TVA) conditions

IDB = Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — DSXC160361A* / CA*F3743*6A* +TXV / MBVC1600** LOW STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE													
		65°F				75°F				85°F				95°F				105°F				115°F					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	904	MBh	24.9	25.8	28.3	-	24.3	25.2	27.6	-	23.8	24.6	27.0	-	23.2	24.0	26.3	-	22.0	22.8	25.0	-	20.4	21.1	23.2	-	
		S/T	0.72	0.60	0.41	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.45	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-	
		ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-	
	800	kW	1.50	1.53	1.58	-	1.61	1.65	1.70	-	1.72	1.75	1.81	-	1.81	1.85	1.91	-	1.88	1.93	1.99	-	1.95	2.00	2.06	-	
		Amps	5.8	6.0	6.2	-	6.3	6.4	6.6	-	6.8	7.0	7.2	-	7.3	7.4	7.7	-	7.7	7.9	8.1	-	8.2	8.3	8.6	-	
		Hi PR	220	237	240	-	249	268	271	-	283	304	309	-	322	347	352	-	348	374	380	-	413	444	450	-	
	696	Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	135	147	-	133	137	150	-	136	141	153	-	
		MBh	24.2	25.1	27.5	-	23.6	24.5	26.8	-	23.1	23.9	26.2	-	22.5	23.3	25.5	-	21.4	22.2	24.3	-	19.8	20.5	22.5	-	
		S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.78	0.65	0.45	-	
	75	904	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-
			kW	1.49	1.52	1.57	-	1.60	1.64	1.69	-	1.70	1.74	1.80	-	1.79	1.83	1.89	-	1.87	1.91	1.97	-	1.93	1.98	2.04	-
			Amps	5.8	5.9	6.1	-	6.2	6.4	6.6	-	6.7	6.9	7.1	-	7.2	7.4	7.6	-	7.6	7.8	8.1	-	8.1	8.3	8.5	-
800		Hi PR	218	234	238	-	246	265	269	-	280	301	306	-	319	343	348	-	345	371	376	-	409	439	446	-	
		Lo PR	118	122	133	-	122	125	137	-	126	130	142	-	129	133	145	-	132	136	148	-	135	139	152	-	
		MBh	22.3	23.1	25.3	-	21.8	22.6	24.8	-	21.3	22.1	24.2	-	20.8	21.5	23.6	-	19.7	20.4	22.4	-	18.3	18.9	20.8	-	
696		S/T	0.66	0.55	0.38	-	0.68	0.57	0.39	-	0.70	0.58	0.40	-	0.72	0.60	0.42	-	0.75	0.63	0.43	-	0.76	0.63	0.44	-	
		ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-	
		kW	1.47	1.51	1.55	-	1.59	1.62	1.67	-	1.69	1.73	1.78	-	1.78	1.82	1.88	-	1.85	1.89	1.96	-	1.92	1.96	2.03	-	
75		904	Amps	5.7	5.9	6.0	-	6.2	6.3	6.5	-	6.7	6.8	7.1	-	7.1	7.3	7.5	-	7.6	7.8	8.0	-	8.0	8.2	8.5	-
			Hi PR	216	232	235	-	244	262	266	-	277	298	303	-	316	340	345	-	341	367	372	-	404	435	441	-
			Lo PR	117	121	132	-	120	124	136	-	125	128	140	-	128	132	144	-	130	134	147	-	134	138	150	-
	800	MBh	25.3	26.1	28.2	30.3	24.7	25.5	27.6	29.6	24.2	24.9	26.9	28.9	23.6	24.3	26.3	28.2	22.4	23.0	24.9	26.8	20.7	21.4	23.1	24.8	
		S/T	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.37	0.87	0.77	0.59	0.38	0.89	0.80	0.60	0.39	0.93	0.83	0.63	0.40	0.93	0.84	0.63	0.41	
		ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	20	16	11	20	18	15	10	
	696	kW	1.50	1.53	1.58	1.63	1.61	1.65	1.70	1.76	1.72	1.75	1.81	1.87	1.81	1.85	1.91	1.97	1.88	1.93	1.99	2.06	1.95	2.00	2.06	2.13	
		Amps	5.8	6.0	6.2	6.4	6.3	6.4	6.6	6.9	6.8	7.0	7.2	7.4	7.3	7.4	7.7	7.9	7.7	7.9	8.1	8.4	8.2	8.3	8.6	8.9	
		Hi PR	220	237	240	245	249	268	271	277	283	304	309	315	322	347	352	359	348	374	380	388	413	444	450	460	
	75	904	Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	135	147	156	133	137	150	160	136	141	153	163
			MBh	24.6	25.3	27.4	29.4	24.0	24.7	26.8	28.7	23.5	24.1	26.1	28.0	22.9	23.6	25.5	27.4	21.7	22.4	24.2	26.0	20.1	20.7	22.4	24.1
			S/T	0.78	0.69	0.53	0.34	0.80	0.72	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.38	0.89	0.80	0.60	0.39
800		ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	12	21	19	16	11	
		kW	1.49	1.52	1.57	1.62	1.60	1.64	1.69	1.74	1.70	1.74	1.80	1.86	1.79	1.83	1.89	1.96	1.87	1.91	1.97	2.04	1.93	1.98	2.04	2.11	
		Amps	5.8	5.9	6.1	6.3	6.2	6.4	6.6	6.8	6.7	6.9	7.1	7.4	7.2	7.4	7.6	7.9	7.6	7.8	8.1	8.4	8.1	8.3	8.5	8.9	
696		Hi PR	218	234	238	243	246	265	269	275	280	301	306	312	319	343	348	356	345	371	376	384	409	439	446	455	
		Lo PR	118	122	133	142	122	125	137	146	126	130	142	151	129	133	145	155	132	136	148	158	135	139	152	162	
		MBh	22.7	23.4	25.3	27.2	22.2	22.8	24.7	26.5	21.6	22.3	24.1	25.9	21.1	21.7	23.5	25.3	20.1	20.7	22.4	24.0	18.6	19.1	20.7	22.2	
75		904	S/T	0.75	0.67	0.51	0.33	0.78	0.69	0.53	0.34	0.80	0.71	0.54	0.35	0.82	0.73	0.56	0.36	0.85	0.76	0.58	0.37	0.86	0.77	0.58	0.37
			ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11
			kW	1.47	1.51	1.55	1.60	1.59	1.62	1.67	1.73	1.69	1.73	1.78	1.84	1.78	1.82	1.88	1.94	1.85	1.89	1.96	2.02	1.92	1.96	2.03	2.10
	800	Amps	5.7	5.9	6.0	6.3	6.2	6.3	6.5	6.8	6.7	6.8	7.1	7.3	7.1	7.3	7.5	7.8	7.6	7.8	8.0	8.3	8.0	8.2	8.5	8.8	
		Hi PR	216	232	235	241	244	262	266	272	277	298	303	309	316	340	345	352	341	367	372	380	404	435	441	451	
		Lo PR	117	121	132	140	120	124	136	144	125	128	140	149	128	132	144	153	130	134	147	156	134	138	150	160	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160361A* / CA*F3743*6A* +TXV / MBVC1600** LOW STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	904	MBh	25.8	26.3	28.1	30.1	25.2	25.7	27.5	29.4	24.6	25.1	26.8	28.7	24.0	24.5	26.2	28.0	22.8	23.3	24.9	26.6	21.1	21.6	23.0	24.6
		S/T	0.89	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.72	0.54	1.00	0.92	0.75	0.56	1.00	0.95	0.78	0.58	1.00	0.96	0.78	0.58
	ΔT	23	22	20	16	24	23	20	16	24	23	20	16	24	23	20	16	23	23	20	16	21	21	18	15	
	kW	1.50	1.53	1.58	1.63	1.61	1.65	1.70	1.76	1.72	1.75	1.81	1.87	1.81	1.85	1.91	1.97	1.88	1.93	1.99	2.06	1.95	2.00	2.06	2.13	
	Amps	5.8	6.0	6.2	6.4	6.3	6.4	6.6	6.9	6.8	7.0	7.2	7.4	7.3	7.4	7.7	7.9	7.7	7.9	8.1	8.4	8.2	8.3	8.6	8.9	
	Hi PR	220	237	240	245	249	268	271	277	283	304	309	315	322	347	352	359	348	374	380	388	413	444	450	460	
	Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	135	147	156	133	137	150	160	136	141	153	163	
	MBh	25.0	25.6	27.3	29.2	24.4	25.0	26.7	28.5	23.9	24.4	26.1	27.9	23.3	23.8	25.4	27.2	22.1	22.6	24.1	25.8	20.5	20.9	22.4	23.9	
	S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.67	0.50	0.90	0.85	0.69	0.52	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56	
	ΔT	24	23	20	16	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	16	23	22	19	15	
kW	1.49	1.52	1.57	1.62	1.60	1.64	1.69	1.74	1.70	1.74	1.80	1.86	1.79	1.83	1.89	1.96	1.87	1.91	1.97	2.04	1.93	1.98	2.04	2.11		
Amps	5.8	5.9	6.1	6.3	6.2	6.4	6.6	6.8	6.7	6.9	7.1	7.4	7.2	7.4	7.6	7.9	7.6	7.8	8.1	8.4	8.1	8.3	8.5	8.9		
Hi PR	218	234	238	243	246	265	269	275	280	301	306	312	319	343	348	356	345	371	376	384	409	439	446	455		
Lo PR	118	122	133	142	122	125	137	146	126	130	142	151	129	133	145	155	132	136	148	158	135	139	152	162		
MBh	23.1	23.6	25.2	27.0	22.6	23.1	24.6	26.3	22.0	22.5	24.1	25.7	21.5	22.0	23.5	25.1	20.4	20.9	22.3	23.8	18.9	19.3	20.6	22.1		
S/T	0.82	0.77	0.63	0.47	0.85	0.80	0.65	0.49	0.87	0.82	0.67	0.50	0.90	0.84	0.69	0.51	0.93	0.88	0.71	0.53	0.94	0.88	0.72	0.54		
ΔT	25	24	21	17	25	24	21	17	25	24	21	17	26	25	21	17	25	24	21	17	24	23	20	16		
kW	1.47	1.51	1.55	1.60	1.59	1.62	1.67	1.73	1.69	1.73	1.78	1.84	1.78	1.82	1.88	1.94	1.85	1.89	1.96	2.02	1.92	1.96	2.03	2.10		
Amps	5.7	5.9	6.0	6.3	6.2	6.3	6.5	6.8	6.7	6.8	7.1	7.3	7.1	7.3	7.5	7.8	7.6	7.8	8.0	8.3	8.0	8.2	8.5	8.8		
Hi PR	216	232	235	241	244	262	266	272	277	298	303	309	316	340	345	352	341	367	372	380	404	435	441	451		
Lo PR	117	121	132	140	120	124	136	144	125	128	140	149	128	132	144	153	130	134	147	156	134	138	150	160		

85	904	MBh	26.2	26.7	28.0	29.9	25.6	26.1	27.4	29.2	25.0	25.5	26.7	28.5	24.4	24.9	26.1	27.8	23.2	23.6	24.8	26.4	21.5	21.9	22.9	24.5
		S/T	0.94	0.90	0.82	0.66	0.97	0.94	0.84	0.69	0.99	0.96	0.87	0.70	1.00	0.99	0.89	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.94	0.76
	ΔT	25	25	23	20	25	25	24	20	25	25	24	20	25	25	24	21	24	24	23	20	22	22	22	19	
	kW	1.50	1.53	1.58	1.63	1.61	1.65	1.70	1.76	1.72	1.75	1.81	1.87	1.81	1.85	1.91	1.97	1.88	1.93	1.99	2.06	1.95	2.00	2.06	2.13	
	Amps	5.8	6.0	6.2	6.4	6.3	6.4	6.6	6.9	6.8	7.0	7.2	7.4	7.3	7.4	7.7	7.9	7.7	7.9	8.1	8.4	8.2	8.3	8.6	8.9	
	Hi PR	220	237	240	245	249	268	271	277	283	304	309	315	322	347	352	359	348	374	380	388	413	444	450	460	
	Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	135	147	156	133	137	150	160	136	141	153	163	
	MBh	25.5	26.0	27.2	29.0	24.9	25.4	26.6	28.3	24.3	24.8	25.9	27.7	23.7	24.2	25.3	27.0	22.5	22.9	24.0	25.6	20.8	21.3	22.3	23.7	
	S/T	0.89	0.86	0.78	0.63	0.93	0.89	0.81	0.65	0.95	0.92	0.83	0.67	0.98	0.94	0.85	0.69	1.00	0.98	0.89	0.72	1.00	0.99	0.89	0.72	
	ΔT	26	26	24	21	26	26	25	21	26	26	25	21	27	26	25	21	26	26	24	21	24	24	23	20	
kW	1.49	1.52	1.57	1.62	1.60	1.64	1.69	1.74	1.70	1.74	1.80	1.86	1.79	1.83	1.89	1.96	1.87	1.91	1.97	2.04	1.93	1.98	2.04	2.11		
Amps	5.8	5.9	6.1	6.3	6.2	6.4	6.6	6.8	6.7	6.9	7.1	7.4	7.2	7.4	7.6	7.9	7.6	7.8	8.1	8.4	8.1	8.3	8.5	8.9		
Hi PR	218	234	238	243	246	265	269	275	280	301	306	312	319	343	348	356	345	371	376	384	409	439	446	455		
Lo PR	118	122	133	142	122	125	137	146	126	130	142	151	129	133	145	155	132	136	148	158	135	139	152	162		
MBh	23.5	24.0	25.1	26.8	23.0	23.4	24.5	26.2	22.4	22.8	23.9	25.5	21.9	22.3	23.3	24.9	20.8	21.2	22.2	23.7	19.2	19.6	20.5	21.9		
S/T	0.86	0.83	0.75	0.61	0.89	0.86	0.78	0.63	0.91	0.88	0.80	0.65	0.94	0.91	0.82	0.67	0.98	0.95	0.85	0.69	0.99	0.95	0.86	0.70		
ΔT	26.7	26	25	22	27	27	25	22	27	27	25	22	27	27	25	22	27	26	25	22	25	25	23	20		
kW	1.47	1.51	1.55	1.60	1.59	1.62	1.67	1.73	1.69	1.73	1.78	1.84	1.78	1.82	1.88	1.94	1.85	1.89	1.96	2.02	1.92	1.96	2.03	2.10		
Amps	5.7	5.9	6.0	6.3	6.2	6.3	6.5	6.8	6.7	6.8	7.1	7.3	7.1	7.3	7.5	7.8	7.6	7.8	8.0	8.3	8.0	8.2	8.5	8.8		
Hi PR	216	232	235	241	244	262	266	272	277	298	303	309	316	340	345	352	341	367	372	380	404	435	441	451		
Lo PR	117	121	132	140	120	124	136	144	125	128	140	149	128	132	144	153	130	134	147	156	134	138	150	160		

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160361A* / CA*F3743*6A* +TXV / MBVC1600** HIGH STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	1356	MBh	33.9	35.1	38.5	-	33.1	34.3	37.6	-	32.3	33.5	36.7	-	31.5	32.7	35.8	-	30.0	31.1	34.0	-	27.8	28.8	31.5	-
		S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-
	ΔT	17	14	11	-	17	14	11	-	17	14	11	-	17	15	11	-	17	14	11	-	16	13	10	-	
	kW	2.14	2.18	2.25	-	2.31	2.36	2.43	-	2.45	2.51	2.59	-	2.58	2.64	2.73	-	2.69	2.76	2.85	-	2.79	2.85	2.95	-	
	Amps	8.1	8.3	8.6	-	8.8	9.0	9.3	-	9.5	9.7	10.0	-	10.1	10.4	10.7	-	10.8	11.1	11.4	-	11.4	11.7	12.1	-	
	Hi PR	232	249	253	-	262	282	286	-	298	321	325	-	340	365	370	-	367	394	400	-	435	467	474	-	
	Lo PR	116	120	131	-	119	123	135	-	124	127	139	-	127	131	143	-	129	133	146	-	133	137	149	-	
	MBh	32.9	34.1	37.4	-	32.2	33.3	36.5	-	31.4	32.5	35.6	-	30.6	31.7	34.8	-	29.1	30.2	33.0	-	26.9	27.9	30.6	-	
	S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.79	0.66	0.45	-	
	ΔT	17	15	11	-	17	15	11	-	18	15	11	-	18	15	12	-	17	15	11	-	16	14	11	-	
kW	2.12	2.17	2.24	-	2.29	2.34	2.41	-	2.43	2.49	2.57	-	2.56	2.62	2.71	-	2.67	2.73	2.82	-	2.77	2.83	2.93	-		
Amps	8.0	8.2	8.5	-	8.7	8.9	9.2	-	9.4	9.6	10.0	-	10.1	10.3	10.6	-	10.7	11.0	11.3	-	11.3	11.6	12.0	-		
Hi PR	230	247	250	-	260	279	283	-	295	317	322	-	336	362	367	-	363	390	396	-	430	463	469	-		
Lo PR	115	119	129	-	118	122	133	-	122	126	138	-	126	130	141	-	128	132	144	-	131	135	148	-		
MBh	30.4	31.5	34.5	-	29.7	30.8	33.7	-	29.0	30.0	32.9	-	28.3	29.3	32.1	-	26.9	27.8	30.5	-	24.9	25.8	28.2	-		
S/T	0.66	0.55	0.38	-	0.68	0.57	0.40	-	0.70	0.59	0.41	-	0.72	0.61	0.42	-	0.75	0.63	0.44	-	0.76	0.63	0.44	-		
ΔT	18	15	12	-	18	15	12	-	18	16	12	-	18	16	12	-	18	15	12	-	17	14	11	-		
kW	2.10	2.15	2.22	-	2.27	2.32	2.39	-	2.41	2.47	2.55	-	2.54	2.60	2.68	-	2.65	2.71	2.80	-	2.74	2.81	2.90	-		
Amps	8.0	8.2	8.4	-	8.6	8.8	9.1	-	9.3	9.6	9.9	-	10.0	10.2	10.5	-	10.6	10.9	11.2	-	11.2	11.5	11.9	-		
Hi PR	227	244	248	-	257	276	280	-	292	314	319	-	333	358	363	-	360	387	392	-	426	458	465	-		
Lo PR	114	117	128	-	117	121	132	-	121	125	136	-	124	128	140	-	127	131	143	-	130	134	146	-		

75	1356	MBh	34.5	35.5	38.4	41.2	33.7	34.7	37.5	40.3	32.9	33.8	36.6	39.3	32.1	33.0	35.7	38.4	30.5	31.4	34.0	36.4	28.2	29.1	31.5	33.8
		S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41
	ΔT	19	18	14	10	19	18	15	10	19	18	15	10	19	18	15	10	19	18	14	10	18	17	14	9	
	kW	2.14	2.18	2.25	2.33	2.31	2.36	2.43	2.51	2.45	2.51	2.59	2.68	2.58	2.64	2.73	2.82	2.69	2.76	2.85	2.95	2.79	2.85	2.95	3.05	
	Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.1	11.4	11.9	11.4	11.7	12.1	12.6	
	Hi PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	367	394	400	409	435	467	474	484	
	Lo PR	116	120	131	139	119	123	135	143	124	127	139	148	127	131	143	152	129	133	146	155	133	137	149	159	
	MBh	33.5	34.5	37.3	40.0	32.7	33.7	36.4	39.1	31.9	32.9	35.6	38.2	31.1	32.1	34.7	37.2	29.6	30.5	33.0	35.4	27.4	28.2	30.5	32.8	
	S/T	0.78	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.89	0.79	0.60	0.39	0.89	0.80	0.61	0.39	
	ΔT	20	18	15	10	20	19	15	11	20	19	15	11	20	19	15	11	20	19	15	10	19	17	14	10	
kW	2.12	2.17	2.24	2.31	2.29	2.34	2.41	2.49	2.43	2.49	2.57	2.66	2.56	2.62	2.71	2.80	2.67	2.73	2.82	2.92	2.77	2.83	2.93	3.03		
Amps	8.0	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	10.0	10.3	10.1	10.3	10.6	11.0	10.7	11.0	11.3	11.7	11.3	11.6	12.0	12.4		
Hi PR	230	247	250	256	260	279	283	289	295	317	322	329	336	362	367	375	363	390	396	405	430	463	469	480		
Lo PR	115	119	129	138	118	122	133	142	122	126	138	147	126	130	141	151	128	132	144	154	131	135	148	157		
MBh	30.9	31.8	34.4	37.0	30.2	31.1	33.6	36.1	29.5	30.3	32.8	35.2	28.7	29.6	32.0	34.4	27.3	28.1	30.4	32.7	25.3	26.0	28.2	30.3		
S/T	0.75	0.67	0.51	0.33	0.78	0.70	0.53	0.34	0.80	0.71	0.54	0.35	0.82	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.86	0.77	0.58	0.38		
ΔT	20	19	15	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	14	10		
kW	2.10	2.15	2.22	2.29	2.27	2.32	2.39	2.47	2.41	2.47	2.55	2.63	2.54	2.60	2.68	2.78	2.65	2.71	2.80	2.90	2.74	2.81	2.90	3.00		
Amps	8.0	8.2	8.4	8.7	8.6	8.8	9.1	9.4	9.3	9.6	9.9	10.2	10.0	10.2	10.5	10.9	10.6	10.9	11.2	11.6	11.2	11.5	11.9	12.3		
Hi PR	227	244	248	253	257	276	280	286	292	314	319	326	333	358	363	371	360	387	392	401	426	458	465	475		
Lo PR	114	117	128	136	117	121	132	140	121	125	136	145	124	128	140	149	127	131	143	152	130	134	146	156		

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160361A* / CA*F3743*6A* +TXV / MBVC1600** HIGH STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	35.1	35.9	38.3	41.0	34.3	35.0	37.4	40.0	33.5	34.2	36.5	39.0	32.6	33.4	35.6	38.1	31.0	31.7	33.9	36.2	28.7	29.4	31.4	33.5
	S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	1.00	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.59
	ΔT	21	20	18	14	22	21	18	14	22	21	18	14	22	21	18	14	21	21	19	14	19	19	17	13
	kW	2.14	2.18	2.25	2.33	2.31	2.36	2.43	2.51	2.45	2.51	2.59	2.68	2.58	2.64	2.73	2.82	2.69	2.76	2.85	2.95	2.79	2.85	2.95	3.05
	Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.1	11.4	11.9	11.4	11.7	12.1	12.6
	HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	367	394	400	409	435	467	474	484
	Lo PR	116	120	131	139	119	123	135	143	124	127	139	148	127	131	143	152	129	133	146	155	133	137	149	159
	MBh	34.1	34.8	37.2	39.8	33.3	34.0	36.3	38.8	32.5	33.2	35.5	37.9	31.7	32.4	34.6	37.0	30.1	30.8	32.9	35.1	27.9	28.5	30.4	32.5
	S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.68	0.50	0.91	0.85	0.69	0.52	0.94	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56
	ΔT	22	21	19	15	23	22	19	15	23	22	19	15	23	22	19	15	22	21	19	15	21	20	17	14
kW	2.12	2.17	2.24	2.31	2.29	2.34	2.41	2.49	2.43	2.49	2.57	2.66	2.56	2.62	2.71	2.80	2.67	2.73	2.82	2.92	2.77	2.83	2.93	3.03	
Amps	8.0	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	10.0	10.3	10.1	10.3	10.6	11.0	10.7	11.0	11.3	11.7	11.3	11.6	12.0	12.4	
HI PR	230	247	250	256	260	279	283	289	295	317	322	329	336	362	367	375	363	390	396	405	430	463	469	480	
Lo PR	115	119	129	138	118	122	133	142	122	126	138	147	126	130	141	151	128	132	144	154	131	135	148	157	
MBh	31.4	32.1	34.3	36.7	30.7	31.4	33.5	35.8	30.0	30.6	32.7	35.0	29.3	29.9	31.9	34.1	27.8	28.4	30.3	32.4	25.7	26.3	28.1	30.0	
S/T	0.82	0.77	0.63	0.47	0.85	0.80	0.65	0.49	0.87	0.82	0.67	0.50	0.90	0.85	0.69	0.52	0.94	0.88	0.72	0.53	0.95	0.89	0.72	0.54	
ΔT	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	21	21	18	14	
kW	2.10	2.15	2.22	2.29	2.27	2.32	2.39	2.47	2.41	2.47	2.55	2.63	2.54	2.60	2.68	2.78	2.65	2.71	2.80	2.90	2.74	2.81	2.90	3.00	
Amps	8.0	8.2	8.4	8.7	8.6	8.8	9.1	9.4	9.3	9.6	9.9	10.2	10.0	10.2	10.5	10.9	10.6	10.9	11.2	11.6	11.2	11.5	11.9	12.3	
HI PR	227	244	248	253	257	276	280	286	292	314	319	326	333	358	363	371	360	387	392	401	426	458	465	475	
Lo PR	114	117	128	136	117	121	132	140	121	125	136	145	124	128	140	149	127	131	143	152	130	134	146	156	

85	MBh	35.7	36.4	38.1	40.7	34.9	35.6	37.2	39.7	34.0	34.7	36.3	38.8	33.2	33.9	35.5	37.8	31.6	32.2	33.7	35.9	29.2	29.8	31.2	33.3
	S/T	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.96	0.87	0.70	1.00	0.99	0.90	0.73	1.00	0.93	0.93	0.75	1.00	1.00	0.94	0.76
	ΔT	23	22	21	18	23	23	21	19	23	23	21	19	23	23	22	19	21	22	21	18	20	20	20	17
	kW	2.14	2.18	2.25	2.33	2.31	2.36	2.43	2.51	2.45	2.51	2.59	2.68	2.58	2.64	2.73	2.82	2.69	2.76	2.85	2.95	2.79	2.85	2.95	3.05
	Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.1	11.4	11.9	11.4	11.7	12.1	12.6
	HI PR	232	249	253	259	262	282	286	292	298	321	325	332	340	365	370	379	367	394	400	409	435	467	474	484
	Lo PR	116	120	131	139	119	123	135	143	124	127	139	148	127	131	143	152	129	133	146	155	133	137	149	159
	MBh	34.7	35.3	37.0	39.5	33.9	34.5	36.1	38.6	33.1	33.7	35.3	37.6	32.2	32.9	34.4	36.7	30.6	31.2	32.7	34.9	28.4	28.9	30.3	32.3
	S/T	0.90	0.86	0.78	0.63	0.93	0.90	0.81	0.66	0.95	0.92	0.83	0.67	0.98	0.95	0.86	0.69	1.00	0.98	0.89	0.72	1.00	0.99	0.89	0.73
	ΔT	24	23	22	19	24	24	22	19	24	24	22	19	24	24	23	20	23	24	22	19	22	22	21	18
kW	2.12	2.17	2.24	2.31	2.29	2.34	2.41	2.49	2.43	2.49	2.57	2.66	2.56	2.62	2.71	2.80	2.67	2.73	2.82	2.92	2.77	2.83	2.93	3.03	
Amps	8.0	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	10.0	10.3	10.1	10.3	10.6	11.0	10.7	11.0	11.3	11.7	11.3	11.6	12.0	12.4	
HI PR	230	247	250	256	260	279	283	289	295	317	322	329	336	362	367	375	363	390	396	405	430	463	469	480	
Lo PR	115	119	129	138	118	122	133	142	122	126	138	147	126	130	141	151	128	132	144	154	131	135	148	157	
MBh	32.0	32.6	34.2	36.4	31.3	31.9	33.4	35.6	30.5	31.1	32.6	34.7	29.8	30.3	31.8	33.9	28.3	28.8	30.2	32.2	26.2	26.7	28.0	29.8	
S/T	0.86	0.83	0.75	0.61	0.89	0.86	0.78	0.63	0.92	0.89	0.80	0.65	0.95	0.91	0.82	0.67	0.98	0.95	0.86	0.69	0.99	0.96	0.86	0.70	
ΔT	24	24	23	20	25	24	23	20	25	24	23	20	25	24	23	20	24	24	23	20	23	22	21	18	
kW	2.10	2.15	2.22	2.29	2.27	2.32	2.39	2.47	2.41	2.47	2.55	2.63	2.54	2.60	2.68	2.78	2.65	2.71	2.80	2.90	2.74	2.81	2.90	3.00	
Amps	8.0	8.2	8.4	8.7	8.6	8.8	9.1	9.4	9.3	9.6	9.9	10.2	10.0	10.2	10.5	10.9	10.6	10.9	11.2	11.6	11.2	11.5	11.9	12.3	
HI PR	227	244	248	253	257	276	280	286	292	314	319	326	333	358	363	371	360	387	392	401	426	458	465	475	
Lo PR	114	117	128	136	117	121	132	140	121	125	136	145	124	128	140	149	127	131	143	152	130	134	146	156	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRl (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160481A* / CA*F4961*6A* +TXV / MBVC2000** Low Stage

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	1238	MBh	33.9	35.2	38.5	-	33.1	34.3	37.6	-	32.3	33.5	36.7	-	31.5	32.7	35.8	-	30.0	31.1	34.0	-	27.8	28.8	31.5	-
		S/T	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.47	-	0.83	0.70	0.48	-	0.84	0.70	0.49	-
		ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-
	1100	kW	2.04	2.09	2.16	-	2.21	2.26	2.33	-	2.35	2.41	2.49	-	2.48	2.54	2.62	-	2.59	2.65	2.74	-	2.68	2.74	2.84	-
		Amps	8.1	8.3	8.6	-	8.8	9.0	9.3	-	9.5	9.7	10.0	-	10.1	10.4	10.7	-	10.8	11.0	11.4	-	11.4	11.7	12.1	-
		Hi PR	227	244	248	-	257	276	280	-	292	314	318	-	332	357	362	-	374	402	408	-	419	450	457	-
	963	Lo PR	122	125	137	-	125	129	141	-	129	134	146	-	133	137	150	-	136	140	153	-	139	143	156	-
		MBh	32.9	34.1	37.4	-	32.2	33.3	36.5	-	31.4	32.5	35.7	-	30.6	31.7	34.8	-	29.1	30.2	33.0	-	27.0	27.9	30.6	-
		S/T	0.70	0.58	0.40	-	0.72	0.61	0.42	-	0.74	0.62	0.43	-	0.77	0.64	0.44	-	0.80	0.66	0.46	-	0.80	0.67	0.46	-
	963	ΔT	19	17	13	-	19	17	13	-	19	17	13	-	20	17	13	-	19	17	13	-	18	16	12	-
		kW	2.03	2.07	2.14	-	2.19	2.24	2.31	-	2.33	2.38	2.47	-	2.46	2.51	2.60	-	2.57	2.62	2.71	-	2.66	2.72	2.81	-
		Amps	8.1	8.2	8.5	-	8.7	8.9	9.2	-	9.4	9.6	10.0	-	10.1	10.3	10.6	-	10.7	10.9	11.3	-	11.3	11.6	12.0	-
963	Hi PR	225	242	245	-	254	273	277	-	289	311	315	-	329	354	359	-	370	398	404	-	415	446	452	-	
	Lo PR	120	124	136	-	124	128	140	-	128	132	144	-	132	136	148	-	134	138	151	-	138	142	155	-	
	MBh	30.4	31.5	34.5	-	29.7	30.8	33.7	-	29.0	30.0	32.9	-	28.3	29.3	32.1	-	26.9	27.8	30.5	-	24.9	25.8	28.3	-	
963	S/T	0.67	0.56	0.39	-	0.70	0.58	0.40	-	0.72	0.60	0.41	-	0.74	0.62	0.43	-	0.77	0.64	0.44	-	0.77	0.65	0.45	-	
	ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-	
	kW	2.01	2.05	2.12	-	2.17	2.22	2.29	-	2.31	2.36	2.44	-	2.44	2.49	2.58	-	2.54	2.60	2.69	-	2.64	2.70	2.79	-	
963	Amps	8.0	8.2	8.4	-	8.6	8.8	9.1	-	9.3	9.6	9.9	-	10.0	10.2	10.5	-	10.6	10.8	11.2	-	11.2	11.5	11.9	-	
	Hi PR	223	239	243	-	252	270	274	-	286	308	312	-	326	350	355	-	367	394	400	-	411	441	448	-	
	Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	134	147	-	133	137	150	-	136	140	153	-	

75	1238	MBh	34.5	35.5	38.4	41.3	33.7	34.7	37.5	40.3	32.9	33.9	36.6	39.3	32.1	33.0	35.8	38.4	30.5	31.4	34.0	36.5	28.2	29.1	31.5	33.8
		S/T	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.38	0.89	0.79	0.60	0.39	0.91	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42
		ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	18	15	10
	1100	kW	2.04	2.09	2.16	2.23	2.21	2.26	2.33	2.41	2.35	2.41	2.49	2.57	2.48	2.54	2.62	2.71	2.59	2.65	2.74	2.83	2.68	2.74	2.84	2.94
		Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.0	11.4	11.8	11.4	11.7	12.1	12.5
		Hi PR	227	244	248	253	257	276	280	286	292	314	318	325	332	357	362	370	374	402	408	417	419	450	457	467
	1100	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	153	163	139	143	156	167
		MBh	33.5	34.5	37.3	40.1	32.7	33.7	36.4	39.1	31.9	32.9	35.6	38.2	31.1	32.1	34.7	37.3	29.6	30.5	33.0	35.4	27.4	28.2	30.5	32.8
		S/T	0.79	0.71	0.54	0.35	0.82	0.74	0.56	0.36	0.84	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.91	0.82	0.62	0.40
	963	ΔT	22	20	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11
		kW	2.03	2.07	2.14	2.21	2.19	2.24	2.31	2.39	2.33	2.38	2.47	2.55	2.46	2.51	2.60	2.69	2.57	2.62	2.71	2.81	2.66	2.72	2.81	2.91
		Amps	8.1	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	10.0	10.3	10.1	10.3	10.6	11.0	10.7	10.9	11.3	11.7	11.3	11.6	12.0	12.4
963	Hi PR	225	242	245	251	254	273	277	283	289	311	315	322	329	354	359	367	370	398	404	413	415	446	452	462	
	Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	138	142	155	165	
	MBh	30.9	31.8	34.4	37.0	30.2	31.1	33.6	36.1	29.5	30.3	32.8	35.2	28.8	29.6	32.0	34.4	27.3	28.1	30.4	32.7	25.3	26.0	28.2	30.3	
963	S/T	0.77	0.69	0.52	0.33	0.79	0.71	0.54	0.35	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.37	0.87	0.78	0.59	0.38	0.88	0.79	0.60	0.38	
	ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	20	16	11	
	kW	2.01	2.05	2.12	2.19	2.17	2.22	2.29	2.37	2.31	2.36	2.44	2.53	2.44	2.49	2.58	2.67	2.54	2.60	2.69	2.78	2.64	2.70	2.79	2.89	
963	Amps	8.0	8.2	8.4	8.7	8.6	8.8	9.1	9.4	9.3	9.6	9.9	10.2	10.0	10.2	10.5	10.9	10.6	10.8	11.2	11.6	11.2	11.5	11.9	12.3	
	Hi PR	223	239	243	248	252	270	274	280	286	308	312	319	326	350	355	363	367	394	400	409	411	441	448	458	
	Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160481A* / CA*F4961*6A* +TXV / MBVC2000** Low Stage (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE													
		65°F				75°F				85°F				95°F				105°F				115°F					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
80	1238	MBh	35.1	35.9	38.3	41.0	34.3	35.0	37.4	40.0	33.5	34.2	36.5	39.1	32.7	33.4	35.6	38.1	31.0	31.7	33.9	36.2	28.7	29.4	31.4	33.5	
		S/T	0.91	0.86	0.70	0.52	0.95	0.89	0.72	0.54	1.00	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	1.00	0.79	0.59	1.00	1.00	0.80	0.60	
	1100	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	21	22	19	15	
		kW	2.04	2.09	2.16	2.23	2.21	2.26	2.33	2.41	2.35	2.41	2.49	2.57	2.48	2.54	2.62	2.71	2.59	2.65	2.74	2.83	2.68	2.74	2.84	2.94	
	963	Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.0	11.4	11.8	11.4	11.7	12.1	12.5	
		Hi PR	227	244	248	253	257	276	280	286	292	314	318	325	332	357	362	370	374	402	408	417	419	450	457	467	
	80	1100	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	153	163	139	143	156	167
			MBh	34.1	34.8	37.2	39.8	33.3	34.0	36.3	38.8	32.5	33.2	35.5	37.9	31.7	32.4	34.6	37.0	30.1	30.8	32.9	35.1	27.9	28.5	30.5	32.6
	80	1100	S/T	0.87	0.82	0.67	0.50	0.90	0.85	0.69	0.52	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	0.99	0.93	0.76	0.57	1.00	0.94	0.76	0.57
			ΔT	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	23	22	19	16
	80	1100	kW	2.03	2.07	2.14	2.21	2.19	2.24	2.31	2.39	2.33	2.38	2.47	2.55	2.46	2.51	2.60	2.69	2.57	2.62	2.71	2.81	2.66	2.72	2.81	2.91
			Amps	8.1	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	10.0	10.3	10.1	10.3	10.6	11.0	10.7	10.9	11.3	11.7	11.3	11.6	12.0	12.4
80	963	Hi PR	225	242	245	251	254	273	277	283	289	311	315	322	329	354	359	367	370	398	404	413	415	446	452	462	
		Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	138	142	155	165	
80	963	MBh	31.5	32.1	34.3	36.7	30.7	31.4	33.5	35.9	30.0	30.6	32.7	35.0	29.3	29.9	31.9	34.1	27.8	28.4	30.3	32.4	25.8	26.3	28.1	30.1	
		S/T	0.84	0.79	0.64	0.48	0.87	0.82	0.66	0.50	0.89	0.84	0.68	0.51	0.92	0.86	0.70	0.53	0.96	0.90	0.73	0.55	0.96	0.90	0.74	0.55	
80	963	ΔT	25	24	21	17	26	24	21	17	26	25	21	17	26	25	21	17	26	25	21	17	24	23	20	16	
		kW	2.01	2.05	2.12	2.19	2.17	2.22	2.29	2.37	2.31	2.36	2.44	2.53	2.44	2.49	2.58	2.67	2.54	2.60	2.69	2.78	2.64	2.70	2.79	2.89	
80	963	Amps	8.0	8.2	8.4	8.7	8.6	8.8	9.1	9.4	9.3	9.6	9.9	10.2	10.0	10.2	10.5	10.9	10.6	10.8	11.2	11.6	11.2	11.5	11.9	12.3	
		Hi PR	223	239	243	248	252	270	274	280	286	308	312	319	326	350	355	363	367	394	400	409	411	441	448	458	
80	963	Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

85	1238	MBh	35.7	36.4	38.1	40.7	34.9	35.6	37.2	39.7	34.1	34.7	36.4	38.8	33.2	33.9	35.5	37.8	31.6	32.2	33.7	35.9	29.2	29.8	31.2	33.3	
		S/T	0.96	0.92	0.83	0.68	0.99	0.96	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78	
	1100	ΔT	25	25	24	20	26	25	24	21	25	25	24	21	25	25	24	21	23	24	24	21	22	22	22	19	
		kW	2.04	2.09	2.16	2.23	2.21	2.26	2.33	2.41	2.35	2.41	2.49	2.57	2.48	2.54	2.62	2.71	2.59	2.65	2.74	2.83	2.68	2.74	2.84	2.94	
	85	1100	Amps	8.1	8.3	8.6	8.9	8.8	9.0	9.3	9.6	9.5	9.7	10.0	10.4	10.1	10.4	10.7	11.1	10.8	11.0	11.4	11.8	11.4	11.7	12.1	12.5
			Hi PR	227	244	248	253	257	276	280	286	292	314	318	325	332	357	362	370	374	402	408	417	419	450	457	467
	85	1100	Lo PR	122	125	137	146	125	129	141	150	129	134	146	155	133	137	150	159	136	140	153	163	139	143	156	167
			MBh	34.7	35.3	37.0	39.5	33.9	34.5	36.2	38.6	33.1	33.7	35.3	37.7	32.3	32.9	34.4	36.7	30.6	31.2	32.7	34.9	28.4	28.9	30.3	32.3
	85	1100	S/T	0.91	0.88	0.80	0.65	0.95	0.91	0.82	0.67	0.97	0.94	0.85	0.69	1.00	0.97	0.87	0.71	1.00	1.00	0.91	0.73	1.00	1.00	0.91	0.74
			ΔT	26	26	25	21	27	26	25	22	27	26	25	22	27	27	25	22	26	26	25	21	24	24	23	20
	85	1100	kW	2.03	2.07	2.14	2.21	2.19	2.24	2.31	2.39	2.33	2.38	2.47	2.55	2.46	2.51	2.60	2.69	2.57	2.62	2.71	2.81	2.66	2.72	2.81	2.91
			Amps	8.1	8.2	8.5	8.8	8.7	8.9	9.2	9.5	9.4	9.6	10.0	10.3	10.1	10.3	10.6	11.0	10.7	10.9	11.3	11.7	11.3	11.6	12.0	12.4
85	1100	Hi PR	225	242	245	251	254	273	277	283	289	311	315	322	329	354	359	367	370	398	404	413	415	446	452	462	
		Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	138	151	161	138	142	155	165	
85	1100	MBh	32.0	32.6	34.2	36.5	31.3	31.9	33.4	35.6	30.5	31.1	32.6	34.8	29.8	30.3	31.8	33.9	28.3	28.8	30.2	32.2	26.2	26.7	28.0	29.8	
		S/T	0.88	0.85	0.77	0.62	0.91	0.88	0.80	0.65	0.94	0.90	0.82	0.66	0.97	0.93	0.84	0.68	1.00	0.97	0.87	0.71	1.00	0.98	0.88	0.71	
85	1100	ΔT	26.9	26	25	22	27	27	25	22	27	27	25	22	27	27	26	22	27	27	25	22	25	25	24	20	
		kW	2.01	2.05	2.12	2.19	2.17	2.22	2.29	2.37	2.31	2.36	2.44	2.53	2.44	2.49	2.58	2.67	2.54	2.60	2.69	2.78	2.64	2.70	2.79	2.89	
85	1100	Amps	8.0	8.2	8.4	8.7	8.6	8.8	9.1	9.4	9.3	9.6	9.9	10.2	10.0	10.2	10.5	10.9	10.6	10.8	11.2	11.6	11.2	11.5	11.9	12.3	
		Hi PR	223	239	243	248	252	270	274	280	286	308	312	319	326	350	355	363	367	394	400	409	411	441	448	458	
85	1100	Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160481A* / CA*F4961*6A* +TXV / MBVC2000** HIGH STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	46.1	47.7	52.3	-	45.0	46.6	51.1	-	43.9	45.5	49.9	-	42.8	44.4	48.7	-	40.7	42.2	46.2	-	37.7	39.1	42.8	-
	S/T	0.77	0.64	0.44	-	0.80	0.66	0.46	-	0.82	0.68	0.47	-	0.84	0.70	0.49	-	0.87	0.73	0.51	-	0.88	0.74	0.51	-
	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	15	12	-
	kW	2.94	3.01	3.10	-	3.18	3.25	3.36	-	3.38	3.46	3.58	-	3.57	3.65	3.77	-	3.72	3.81	3.94	-	3.86	3.95	4.08	-
	Amps	11.4	11.7	12.1	-	12.3	12.6	13.0	-	13.4	13.7	14.2	-	14.3	14.7	15.2	-	15.2	15.6	16.1	-	16.1	16.5	17.1	-
	HI PR	241	259	262	-	272	292	297	-	309	333	337	-	352	379	384	-	396	426	432	-	444	477	484	-
	Lo PR	120	124	135	-	123	127	139	-	127	131	144	-	131	135	147	-	133	138	150	-	137	141	154	-
	MBh	44.7	46.3	50.8	-	43.7	45.3	49.6	-	42.6	44.2	48.4	-	41.6	43.1	47.2	-	39.5	41.0	44.9	-	36.6	37.9	41.6	-
	S/T	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.70	0.48	-	0.84	0.70	0.49	-
	ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-
kW	2.92	2.98	3.08	-	3.15	3.22	3.33	-	3.36	3.43	3.55	-	3.54	3.62	3.74	-	3.69	3.78	3.91	-	3.83	3.91	4.05	-	
Amps	11.3	11.6	12.0	-	12.2	12.5	12.9	-	13.3	13.6	14.0	-	14.2	14.5	15.0	-	15.1	15.5	16.0	-	16.0	16.4	16.9	-	
HI PR	238	256	260	-	269	289	294	-	306	329	334	-	349	375	380	-	392	422	428	-	439	472	479	-	
Lo PR	119	122	133	-	122	126	137	-	126	130	142	-	130	134	146	-	132	136	149	-	135	140	152	-	
MBh	41.3	42.8	46.9	-	40.3	41.8	45.8	-	39.4	40.8	44.7	-	38.4	39.8	43.6	-	36.5	37.8	41.4	-	33.8	35.0	38.4	-	
S/T	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.81	0.68	0.47	-	
ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	17	16	12	-	
kW	2.89	2.96	3.05	-	3.12	3.19	3.30	-	3.33	3.40	3.52	-	3.51	3.59	3.71	-	3.66	3.74	3.87	-	3.79	3.88	4.01	-	
Amps	11.2	11.5	11.8	-	12.1	12.4	12.8	-	13.2	13.5	13.9	-	14.1	14.4	14.9	-	15.0	15.3	15.8	-	15.9	16.2	16.8	-	
HI PR	236	254	257	-	267	287	291	-	303	326	331	-	345	371	376	-	388	418	424	-	435	468	474	-	
Lo PR	117	121	132	-	121	125	136	-	125	129	141	-	128	132	144	-	131	135	147	-	134	138	151	-	

75	MBh	46.8	48.2	52.2	56.0	45.7	47.1	51.0	54.7	44.7	46.0	49.8	53.4	43.6	44.9	48.6	52.1	41.4	42.6	46.1	49.5	38.3	39.5	42.7	45.9
	S/T	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.93	0.83	0.63	0.40	0.96	0.86	0.65	0.42	0.99	0.89	0.67	0.43	1.00	0.90	0.68	0.44
	ΔT	22	20	16	11	22	20	16	11	22	20	16	11	22	20	17	11	22	20	16	11	20	19	15	11
	kW	2.94	3.01	3.10	3.21	3.18	3.25	3.36	3.47	3.38	3.46	3.58	3.70	3.57	3.65	3.77	3.90	3.72	3.81	3.94	4.08	3.86	3.95	4.08	4.23
	Amps	11.4	11.7	12.1	12.5	12.3	12.6	13.0	13.5	13.4	13.7	14.2	14.7	14.3	14.7	15.2	15.7	15.2	15.6	16.1	16.8	16.1	16.5	17.1	17.8
	HI PR	241	259	262	268	272	292	297	303	309	333	337	345	352	379	384	393	396	426	432	442	444	477	484	495
	Lo PR	120	124	135	144	123	127	139	148	127	131	144	153	131	135	147	157	133	138	150	160	137	141	154	164
	MBh	45.5	46.8	50.7	54.4	44.4	45.7	49.5	53.1	43.4	44.6	48.3	51.9	42.3	43.6	47.1	50.6	40.2	41.4	44.8	48.1	37.2	38.3	41.5	44.5
	S/T	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.38	0.88	0.79	0.60	0.39	0.91	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.85	0.65	0.42
	ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11
kW	2.92	2.98	3.08	3.18	3.15	3.22	3.33	3.44	3.36	3.43	3.55	3.67	3.54	3.62	3.74	3.87	3.69	3.78	3.91	4.04	3.83	3.91	4.05	4.19	
Amps	11.3	11.6	12.0	12.4	12.2	12.5	12.9	13.4	13.3	13.6	14.0	14.6	14.2	14.5	15.0	15.6	15.1	15.5	16.0	16.6	16.0	16.4	16.9	17.6	
HI PR	238	256	260	265	269	289	294	300	306	329	334	341	349	375	380	389	392	422	428	437	439	472	479	490	
Lo PR	119	122	133	142	122	126	137	146	126	130	142	151	130	134	146	155	132	136	149	158	135	140	152	162	
MBh	42.0	43.2	46.8	50.2	41.0	42.2	45.7	49.0	40.0	41.2	44.6	47.9	39.0	40.2	43.5	46.7	37.1	38.2	41.3	44.4	34.4	35.4	38.3	41.1	
S/T	0.80	0.72	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.38	0.91	0.82	0.62	0.40	0.92	0.82	0.62	0.40	
ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	18	12	23	21	17	12	21	20	16	11	
kW	2.89	2.96	3.05	3.16	3.12	3.19	3.30	3.41	3.33	3.40	3.52	3.64	3.51	3.59	3.71	3.84	3.66	3.74	3.87	4.01	3.79	3.88	4.01	4.15	
Amps	11.2	11.5	11.8	12.3	12.1	12.4	12.8	13.3	13.2	13.5	13.9	14.4	14.1	14.4	14.9	15.4	15.0	15.3	15.8	16.4	15.9	16.2	16.8	17.4	
HI PR	236	254	257	263	267	287	291	297	303	326	331	338	345	371	376	385	388	418	424	433	435	468	474	485	
Lo PR	117	121	132	141	121	125	136	145	125	129	141	150	128	132	144	154	131	135	147	157	134	138	151	161	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160481A* / CA*F4961*6A* +TXV / MBVC2000** HIGH STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	47.7	48.7	52.0	55.6	46.6	47.6	50.8	54.3	45.5	46.4	49.6	53.0	44.3	45.3	48.4	51.8	42.1	43.0	46.0	49.2	39.0	39.9	42.6	45.5
	S/T	0.96	0.90	0.73	0.55	1.00	0.93	0.76	0.57	1.00	0.95	0.78	0.58	1.00	1.00	0.80	0.60	1.00	1.00	0.83	0.62	1.00	1.00	0.84	0.63
	ΔT	24	23	20	16	25	23	20	16	24	23	20	16	23	24	20	16	22	24	21	17	21	21	19	15
	kW	2.94	3.01	3.10	3.21	3.18	3.25	3.36	3.47	3.38	3.46	3.58	3.70	3.57	3.65	3.77	3.90	3.72	3.81	3.94	4.08	3.86	3.95	4.08	4.23
	Amps	11.4	11.7	12.1	12.5	12.3	12.6	13.0	13.5	13.4	13.7	14.2	14.7	14.3	14.7	15.2	15.7	15.2	15.6	16.1	16.8	16.1	16.5	17.1	17.8
	Hi PR	241	259	262	268	272	292	297	303	309	333	337	345	352	379	384	393	396	426	432	442	444	477	484	495
	Lo PR	120	124	135	144	123	127	139	148	127	131	144	153	131	135	147	157	133	138	150	160	137	141	154	164
	MBh	46.3	47.3	50.5	54.0	45.2	46.2	49.4	52.8	44.1	45.1	48.2	51.5	43.1	44.0	47.0	50.2	40.9	41.8	44.7	47.7	37.9	38.7	41.4	44.2
	S/T	0.91	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	0.98	0.80	0.60
	ΔT	25	24	21	17	25	24	21	17	25	24	21	17	26	24	21	17	24	24	21	17	22	23	20	16
kW	2.92	2.98	3.08	3.18	3.15	3.22	3.33	3.44	3.36	3.43	3.55	3.67	3.54	3.62	3.74	3.87	3.69	3.78	3.91	4.04	3.83	3.91	4.05	4.19	
Amps	11.3	11.6	12.0	12.4	12.2	12.5	12.9	13.4	13.3	13.6	14.0	14.6	14.2	14.5	15.0	15.6	15.1	15.5	16.0	16.6	16.0	16.4	16.9	17.6	
Hi PR	238	256	260	265	269	289	294	300	306	329	334	341	349	375	380	389	392	422	428	437	439	472	479	490	
Lo PR	119	122	133	142	122	126	137	146	126	130	142	151	130	134	146	155	132	136	149	158	135	140	152	162	
MBh	42.7	43.6	46.6	49.9	41.7	42.6	45.6	48.7	40.7	41.6	44.5	47.5	39.7	40.6	43.4	46.4	37.8	38.6	41.2	44.1	35.0	35.7	38.2	40.8	
S/T	0.88	0.83	0.67	0.50	0.91	0.86	0.70	0.52	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	1.00	0.94	0.76	0.57	1.01	0.95	0.77	0.58	
ΔT	25	24	21	17	26	25	21	17	26	25	22	17	26	25	22	17	26	25	21	17	24	23	20	16	
kW	2.89	2.96	3.05	3.16	3.12	3.19	3.30	3.41	3.33	3.40	3.52	3.64	3.51	3.59	3.71	3.84	3.66	3.74	3.87	4.01	3.79	3.88	4.01	4.15	
Amps	11.2	11.5	11.8	12.3	12.1	12.4	12.8	13.3	13.2	13.5	13.9	14.4	14.1	14.4	14.9	15.4	15.0	15.3	15.8	16.4	15.9	16.2	16.8	17.4	
Hi PR	236	254	257	263	267	287	291	297	303	326	331	338	345	371	376	385	388	418	424	433	435	468	474	485	
Lo PR	117	121	132	141	121	125	136	145	125	129	141	150	128	132	144	154	131	135	147	157	134	138	151	161	

85	MBh	48.5	49.4	51.8	55.2	47.4	48.3	50.6	54.0	46.2	47.1	49.4	52.7	45.1	46.0	48.2	51.4	42.9	43.7	45.8	48.8	39.7	40.5	42.4	45.2
	S/T	1.00	0.97	0.87	0.71	1.00	1.00	0.91	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.96	0.78	1.00	1.00	0.99	0.81	1.00	1.00	1.00	0.81
	ΔT	26	25	24	21	25	25	24	21	24	25	24	21	24	24	24	21	23	23	23	24	21	21	21	19
	kW	2.94	3.01	3.10	3.21	3.18	3.25	3.36	3.47	3.38	3.46	3.58	3.70	3.57	3.65	3.77	3.90	3.72	3.81	3.94	4.08	3.86	3.95	4.08	4.23
	Amps	11.4	11.7	12.1	12.5	12.3	12.6	13.0	13.5	13.4	13.7	14.2	14.7	14.3	14.7	15.2	15.7	15.2	15.6	16.1	16.8	16.1	16.5	17.1	17.8
	Hi PR	241	259	262	268	272	292	297	303	309	333	337	345	352	379	384	393	396	426	432	442	444	477	484	495
	Lo PR	120	124	135	144	123	127	139	148	127	131	144	153	131	135	147	157	133	138	150	160	137	141	154	164
	MBh	47.1	48.0	50.3	53.6	46.0	46.9	49.1	52.4	44.9	45.8	47.9	51.1	43.8	44.7	46.8	49.9	41.6	42.4	44.4	47.4	38.5	39.3	41.2	43.9
	S/T	0.96	0.92	0.83	0.68	0.99	0.96	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78
	ΔT	27	26	25	21	27	27	25	22	27	27	25	22	26	26	25	22	25	25	25	22	23	23	23	20
kW	2.92	2.98	3.08	3.18	3.15	3.22	3.33	3.44	3.36	3.43	3.55	3.67	3.54	3.62	3.74	3.87	3.69	3.78	3.91	4.04	3.83	3.91	4.05	4.19	
Amps	11.3	11.6	12.0	12.4	12.2	12.5	12.9	13.4	13.3	13.6	14.0	14.6	14.2	14.5	15.0	15.6	15.1	15.5	16.0	16.6	16.0	16.4	16.9	17.6	
Hi PR	238	256	260	265	269	289	294	300	306	329	334	341	349	375	380	389	392	422	428	437	439	472	479	490	
Lo PR	119	122	133	142	122	126	137	146	126	130	142	151	130	134	146	155	132	136	149	158	135	140	152	162	
MBh	43.5	44.3	46.4	49.5	42.5	43.3	45.3	48.4	41.4	42.2	44.2	47.2	40.4	41.2	43.2	46.0	38.4	39.2	41.0	43.7	35.6	36.3	38.0	40.5	
S/T	0.92	0.89	0.80	0.65	0.96	0.92	0.83	0.68	0.98	0.95	0.85	0.69	1.00	0.98	0.88	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.92	0.75	
ΔT	27	27	25	22	28	27	26	22	28	27	26	22	27	27	26	22	26	27	25	22	24	25	24	21	
kW	2.89	2.96	3.05	3.16	3.12	3.19	3.30	3.41	3.33	3.40	3.52	3.64	3.51	3.59	3.71	3.84	3.66	3.74	3.87	4.01	3.79	3.88	4.01	4.15	
Amps	11.2	11.5	11.8	12.3	12.1	12.4	12.8	13.3	13.2	13.5	13.9	14.4	14.1	14.4	14.9	15.4	15.0	15.3	15.8	16.4	15.9	16.2	16.8	17.4	
Hi PR	236	254	257	263	267	287	291	297	303	326	331	338	345	371	376	385	388	418	424	433	435	468	474	485	
Lo PR	117	121	132	141	121	125	136	145	125	129	141	150	128	132	144	154	131	135	147	157	134	138	151	161	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160481B* / CA*F4860*6** +TXV/MBVC2000** LOW STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE													
		65°F				75°F				85°F				95°F				105°F				115°F					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	1238	MBh	34.3	35.5	38.9	-	33.5	34.7	38.0	-	32.7	33.9	37.1	-	31.9	33.1	36.2	-	30.3	31.4	34.4	-	28.1	29.1	31.9	-	
		S/T	0.74	0.62	0.43	-	0.77	0.64	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.85	0.71	0.49	-	
	1100	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	16	13	-	18	15	12	-	
		kW	2.04	2.08	2.15	-	2.20	2.25	2.32	-	2.34	2.39	2.47	-	2.46	2.52	2.60	-	2.57	2.63	2.71	-	2.66	2.72	2.81	-	
	963	Amps	9.8	10.0	10.2	-	10.4	10.6	10.9	-	11.2	11.4	11.8	-	11.9	12.1	12.5	-	12.5	12.8	13.2	-	13.2	13.4	13.8	-	
		HI PR	216	232	245	-	242	261	275	-	275	296	313	-	314	337	356	-	353	380	401	-	390	419	443	-	
	75	1238	LO PR	107	114	124	-	113	120	131	-	117	125	136	-	123	131	143	-	129	137	150	-	133	142	155	-
			MBh	33.3	34.5	37.8	-	32.5	33.7	36.9	-	31.7	32.9	36.1	-	31.0	32.1	35.2	-	29.4	30.5	33.4	-	27.3	28.3	31.0	-
		1100	S/T	0.71	0.59	0.41	-	0.73	0.61	0.43	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.81	0.68	0.47	-
			ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	19	16	12	-
963		kW	2.02	2.07	2.13	-	2.18	2.23	2.30	-	2.32	2.37	2.45	-	2.44	2.50	2.58	-	2.55	2.60	2.69	-	2.64	2.70	2.79	-	
		Amps	9.7	9.9	10.2	-	10.4	10.6	10.9	-	11.1	11.3	11.7	-	11.8	12.0	12.4	-	12.4	12.7	13.0	-	13.1	13.3	13.7	-	
75		1238	HI PR	214	230	243	-	240	258	272	-	273	293	310	-	310	334	353	-	349	376	397	-	386	415	439	-
			LO PR	106	112	123	-	112	119	130	-	116	123	135	-	122	130	142	-	128	136	148	-	132	141	153	-
		1100	MBh	30.7	31.9	34.9	-	30.0	31.1	34.1	-	29.3	30.4	33.3	-	28.6	29.6	32.5	-	27.2	28.2	30.8	-	25.2	26.1	28.6	-
			S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.78	0.66	0.45	-
	963	ΔT	20	17	13	-	20	18	13	-	20	18	13	-	20	18	13	-	20	17	13	-	19	16	12	-	
		kW	1.97	2.02	2.08	-	2.13	2.17	2.24	-	2.26	2.31	2.39	-	2.38	2.43	2.51	-	2.48	2.54	2.62	-	2.57	2.63	2.71	-	
	75	1238	Amps	9.5	9.7	9.9	-	10.1	10.3	10.6	-	10.8	11.1	11.4	-	11.5	11.7	12.1	-	12.1	12.4	12.7	-	12.7	13.0	13.4	-
			HI PR	207	223	235	-	232	250	264	-	264	285	300	-	301	324	342	-	339	365	385	-	374	403	425	-
		1100	LO PR	102	109	119	-	108	115	126	-	113	120	131	-	118	126	137	-	124	132	144	-	128	136	149	-
			MBh	34.9	35.9	38.9	41.7	34.1	35.1	38.0	40.7	33.3	34.2	37.1	39.8	32.4	33.4	36.2	38.8	30.8	31.7	34.4	36.9	28.6	29.4	31.8	34.2
963		S/T	0.84	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.96	0.86	0.65	0.42	0.97	0.87	0.66	0.42	
		ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	11	21	19	16	11	
75		1238	kW	2.06	2.10	2.17	2.24	2.22	2.27	2.34	2.42	2.36	2.41	2.49	2.57	2.48	2.54	2.62	2.71	2.59	2.65	2.74	2.83	2.68	2.74	2.83	2.93
			Amps	9.9	10.0	10.3	10.6	10.5	10.7	11.0	11.4	11.3	11.5	11.8	12.2	11.9	12.2	12.6	13.0	12.6	12.9	13.3	13.7	13.3	13.6	14.0	14.4
		1100	HI PR	218	235	248	258	245	263	278	290	278	299	316	330	317	341	360	375	356	383	405	422	394	424	447	467
			LO PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	157	167
	963	MBh	33.9	34.9	37.7	40.5	33.1	34.1	36.9	39.6	32.3	33.2	36.0	38.6	31.5	32.4	35.1	37.7	29.9	30.8	33.3	35.8	27.7	28.5	30.9	33.2	
		S/T	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40	
	75	1238	ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	18	12	23	21	17	12	21	20	16	11
			kW	2.04	2.08	2.15	2.22	2.20	2.25	2.32	2.40	2.34	2.39	2.47	2.55	2.46	2.52	2.60	2.69	2.57	2.63	2.71	2.81	2.66	2.72	2.81	2.91
		1100	Amps	9.8	10.0	10.2	10.6	10.4	10.6	10.9	11.3	11.2	11.4	11.8	12.1	11.9	12.1	12.5	12.9	12.5	12.8	13.2	13.6	13.2	13.4	13.8	14.3
			HI PR	216	232	245	256	242	261	275	287	275	296	313	326	314	338	356	372	353	380	401	418	390	420	443	462
963		LO PR	107	114	124	132	113	120	131	139	117	125	136	145	123	131	143	152	129	137	150	160	133	142	155	165	
		MBh	31.3	32.2	34.8	37.4	30.5	31.4	34.0	36.5	29.8	30.7	33.2	35.6	29.1	29.9	32.4	34.8	27.6	28.4	30.8	33.0	25.6	26.3	28.5	30.6	
75		1238	S/T	0.78	0.69	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.39	0.89	0.80	0.60	0.39
			ΔT	23	21	17	12	23	22	18	12	24	22	18	12	24	22	18	12	24	22	18	12	22	20	16	11
		1100	kW	1.99	2.03	2.10	2.17	2.14	2.19	2.26	2.34	2.28	2.33	2.41	2.49	2.40	2.45	2.54	2.62	2.50	2.56	2.64	2.73	2.59	2.65	2.74	2.83
			Amps	9.6	9.7	10.0	10.3	10.2	10.4	10.7	11.0	10.9	11.2	11.5	11.8	11.6	11.8	12.2	12.6	12.2	12.5	12.8	13.3	12.8	13.1	13.5	14.0
	963	HI PR	209	225	238	248	235	253	267	278	267	287	304	317	304	327	346	361	342	368	389	406	378	407	430	448	
		LO PR	104	110	120	128	109	116	127	135	114	121	132	141	119	127	139	148	125	133	145	155	129	138	150	160	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp. +fan)

EXPANDED COOLING DATA — DSXC160481B* / CA*F4860*6** +TXV/MBVC2000** LOW STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	35.5	36.3	38.8	41.4	34.7	35.4	37.9	40.5	33.8	34.6	37.0	39.5	33.0	33.7	36.1	38.5	31.4	32.1	34.2	36.6	29.1	29.7	31.7	33.9
	S/T	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.92	0.75	0.56	1.00	0.95	0.78	0.58	1.00	1.00	0.81	0.60	1.00	1.00	0.81	0.61
	ΔT	24	23	20	16	25	24	21	16	25	24	21	16	25	24	21	17	23	24	20	16	22	22	19	15
	kW	2.07	2.12	2.19	2.26	2.24	2.28	2.36	2.42	2.38	2.43	2.51	2.60	2.50	2.56	2.65	2.74	2.61	2.67	2.76	2.85	2.70	2.77	2.86	2.96
	Amps	9.9	10.1	10.4	10.7	10.6	10.8	11.1	11.5	11.4	11.6	11.9	12.3	12.0	12.3	12.7	13.1	12.7	13.0	13.4	13.8	13.4	13.7	14.1	14.6
	HI PR	220	237	250	261	247	266	281	293	281	302	319	333	320	344	364	379	360	387	409	427	398	428	452	471
	LO PR	109	116	126	135	115	122	134	142	120	127	139	148	126	134	146	155	132	140	153	163	136	145	158	168
	MBh	34.5	35.2	37.6	40.2	33.7	34.4	36.8	39.3	32.9	33.6	35.9	38.4	32.1	32.8	35.0	37.4	30.5	31.1	33.3	35.5	28.2	28.8	30.8	32.9
	S/T	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	0.95	0.77	0.58
	ΔT	25	24	21	17	26	25	21	17	26	25	21	17	26	25	22	17	25	25	21	17	24	23	20	16
kW	2.06	2.10	2.17	2.24	2.22	2.27	2.34	2.42	2.36	2.41	2.49	2.57	2.48	2.54	2.62	2.71	2.59	2.65	2.74	2.83	2.68	2.74	2.83	2.93	
Amps	9.9	10.0	10.3	10.6	10.5	10.7	11.0	11.4	11.3	11.5	11.8	12.2	12.0	12.2	12.6	13.0	12.6	12.9	13.3	13.7	13.3	13.6	14.0	14.4	
HI PR	218	235	248	258	245	263	278	290	278	299	316	330	317	341	360	375	356	384	405	422	394	424	447	467	
LO PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	157	167	
MBh	31.8	32.5	34.7	37.1	31.1	31.7	33.9	36.3	30.3	31.0	33.1	35.4	29.6	30.2	32.3	34.5	28.1	28.7	30.7	32.8	26.0	26.6	28.4	30.4	
S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56	
ΔT	26	25	22	17	26	25	22	17	26	25	22	17	26	25	22	18	26	25	21	17	24	23	20	16	
kW	2.01	2.05	2.11	2.18	2.16	2.21	2.28	2.36	2.30	2.35	2.43	2.51	2.42	2.48	2.56	2.64	2.52	2.58	2.67	2.76	2.61	2.67	2.76	2.86	
Amps	9.6	9.8	10.1	10.4	10.3	10.5	10.8	11.1	11.0	11.2	11.6	11.9	11.7	11.9	12.3	12.7	12.3	12.6	12.9	13.4	12.9	13.2	13.6	14.1	
HI PR	211	228	240	251	237	255	270	281	270	290	307	320	307	331	349	364	346	372	393	410	382	411	434	453	
LO PR	105	111	121	129	110	118	128	137	115	122	133	142	121	128	140	149	126	134	147	156	131	139	152	162	

85	MBh	36.1	36.8	38.6	41.1	35.3	36.0	37.7	40.2	34.4	35.1	36.8	39.2	33.6	34.2	35.9	38.3	31.9	32.5	34.1	36.4	29.6	30.1	31.6	33.7
	S/T	0.97	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.96	0.78	1.00	1.00	0.97	0.79
	ΔT	26	26	24	21	26	26	25	21	26	26	25	21	25	25	25	21	24	24	24	21	22	22	23	20
	kW	2.09	2.13	2.20	2.28	2.25	2.30	2.38	2.46	2.40	2.45	2.53	2.62	2.53	2.58	2.67	2.76	2.63	2.69	2.78	2.88	2.73	2.79	2.88	2.98
	Amps	10.0	10.2	10.5	10.8	10.7	10.9	11.2	11.6	11.5	11.7	12.0	12.4	12.1	12.4	12.8	13.2	12.8	13.1	13.5	13.9	13.5	13.8	14.2	14.7
	HI PR	222	239	253	264	249	268	284	296	284	305	322	336	323	348	367	383	364	391	413	431	402	432	456	476
	LO PR	110	117	128	136	116	124	135	144	121	128	140	149	127	135	147	157	133	141	154	164	137	146	160	170
	MBh	35.1	35.7	37.4	39.9	34.3	34.9	36.6	39.0	33.4	34.1	35.7	38.1	32.6	33.3	34.8	37.2	31.0	31.6	33.1	35.3	28.7	29.3	30.6	32.7
	S/T	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.75
	ΔT	27	27	25	22	27	27	26	22	28	27	26	22	27	27	26	22	26	26	25	22	24	24	24	21
kW	2.07	2.12	2.19	2.26	2.24	2.28	2.36	2.44	2.38	2.43	2.51	2.60	2.50	2.56	2.65	2.74	2.61	2.67	2.76	2.85	2.70	2.77	2.86	2.96	
Amps	9.9	10.1	10.4	10.7	10.6	10.8	11.1	11.5	11.4	11.6	11.9	12.3	12.0	12.3	12.7	13.1	12.7	13.0	13.4	13.8	13.4	13.7	14.1	14.6	
HI PR	220	237	250	261	247	266	281	293	281	302	319	333	320	344	364	379	360	387	409	427	398	428	452	471	
LO PR	109	116	126	135	115	122	134	142	120	127	139	148	126	134	146	155	132	140	153	163	136	145	158	168	
MBh	32.4	33.0	34.6	36.9	31.6	32.2	33.8	36.0	30.9	31.5	32.9	35.1	30.1	30.7	32.1	34.3	28.6	29.2	30.5	32.6	26.5	27.0	28.3	30.2	
S/T	0.89	0.86	0.78	0.63	0.93	0.89	0.81	0.65	0.95	0.92	0.83	0.67	0.98	0.95	0.85	0.69	1.00	0.98	0.89	0.72	1.00	0.99	0.89	0.72	
ΔT	28	27	26	22	28	27	26	22	28	28	26	23	28	28	26	23	27	27	26	22	25	26	24	21	
kW	2.02	2.07	2.13	2.20	2.18	2.23	2.30	2.38	2.32	2.37	2.45	2.53	2.44	2.50	2.58	2.67	2.55	2.60	2.69	2.78	2.64	2.69	2.79	2.88	
Amps	9.7	9.9	10.2	10.5	10.4	10.6	10.9	11.2	11.1	11.3	11.7	12.0	11.8	12.0	12.4	12.8	12.4	12.7	13.0	13.5	13.1	13.3	13.7	14.2	
HI PR	214	230	243	253	240	258	272	284	273	293	310	323	310	334	353	368	349	376	397	414	386	415	438	457	
LO PR	106	112	123	131	112	119	130	138	116	123	135	143	122	130	141	151	128	136	148	158	132	140	153	163	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp. + fan)

EXPANDED COOLING DATA — DSXC160481B* / CA*F4860*6** +TXV/MBVC2000** HIGH STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
	MBh	46.1	47.7	52.3	-	45.0	46.6	51.1	-	43.9	45.5	49.9	-	42.8	44.4	48.7	-	40.7	42.2	46.2	-	37.7	39.1	42.8	-
	S/T	0.74	0.62	0.43	-	0.77	0.64	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.85	0.71	0.49	-
	ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-
1800	kW	3.03	3.10	3.19	-	3.27	3.34	3.45	-	3.48	3.55	3.67	-	3.66	3.74	3.87	-	3.82	3.90	4.03	-	3.95	4.04	4.18	-
	Amps	14.6	14.9	15.3	-	15.5	15.9	16.3	-	16.7	17.0	17.5	-	17.6	18.0	18.5	-	18.6	19.0	19.5	-	19.5	20.0	20.5	-
	HI PR	235	253	267	-	264	284	300	-	300	323	341	-	341	367	388	-	384	413	437	-	424	457	482	-
	LO PR	104	111	121	-	110	117	128	-	114	122	133	-	120	128	140	-	126	134	146	-	130	139	151	-
	MBh	44.7	46.3	50.8	-	43.7	45.3	49.6	-	42.6	44.2	48.4	-	41.6	43.1	47.2	-	39.5	41.0	44.9	-	36.6	37.9	41.6	-
	S/T	0.71	0.59	0.41	-	0.73	0.61	0.43	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.81	0.68	0.47	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
1600	kW	3.01	3.07	3.17	-	3.24	3.31	3.42	-	3.45	3.52	3.64	-	3.63	3.71	3.83	-	3.78	3.87	4.00	-	3.92	4.01	4.14	-
	Amps	14.5	14.8	15.1	-	15.4	15.7	16.2	-	16.5	16.9	17.3	-	17.5	17.8	18.4	-	18.4	18.8	19.4	-	19.4	19.8	20.4	-
	HI PR	233	250	264	-	261	281	297	-	297	319	337	-	338	364	384	-	380	409	432	-	420	452	478	-
	LO PR	103	110	120	-	109	116	127	-	113	120	132	-	119	127	138	-	125	133	145	-	129	137	150	-
	MBh	41.3	42.8	46.9	-	40.3	41.8	45.8	-	39.4	40.8	44.7	-	38.4	39.8	43.6	-	36.5	37.8	41.4	-	33.8	35.0	38.4	-
	S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.78	0.66	0.45	-
	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-
1400	kW	2.93	3.00	3.09	-	3.16	3.23	3.33	-	3.36	3.44	3.55	-	3.54	3.62	3.74	-	3.69	3.77	3.90	-	3.82	3.90	4.04	-
	Amps	14.2	14.4	14.8	-	15.1	15.4	15.8	-	16.1	16.5	16.9	-	17.1	17.4	17.9	-	18.0	18.4	18.9	-	18.9	19.3	19.9	-
	HI PR	226	243	256	-	253	272	288	-	288	310	327	-	328	353	373	-	369	397	419	-	408	439	463	-
	LO PR	100	106	116	-	106	112	123	-	110	117	128	-	115	123	134	-	121	129	140	-	125	133	145	-

	MBh	46.8	48.2	52.2	56.0	45.7	47.1	51.0	54.7	44.7	46.0	49.8	53.4	43.6	44.9	48.6	52.1	41.4	42.6	46.1	49.5	38.3	39.5	42.7	45.9
	S/T	0.84	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.96	0.86	0.65	0.42	0.97	0.87	0.66	0.42
	ΔT	20	19	15	11	20	19	15	11	20	19	15	11	21	19	16	11	20	19	15	11	19	17	14	10
1800	kW	3.06	3.12	3.22	3.33	3.29	3.37	3.48	3.59	3.51	3.58	3.70	3.83	3.69	3.77	3.90	4.03	3.85	3.94	4.07	4.21	3.99	4.08	4.21	4.36
	Amps	14.7	15.0	15.4	15.9	15.7	16.0	16.4	16.9	16.8	17.1	17.6	18.2	17.8	18.1	18.6	19.3	18.7	19.1	19.7	20.3	19.7	20.1	20.7	21.4
	HI PR	237	255	270	281	266	287	303	316	303	326	344	359	345	371	392	409	388	418	441	460	429	461	487	508
	LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163
	MBh	45.5	46.8	50.7	54.4	44.4	45.7	49.5	53.1	43.4	44.6	48.3	51.9	42.3	43.6	47.1	50.6	40.2	41.4	44.8	48.1	37.2	38.3	41.5	44.5
	S/T	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	20	16	11	20	18	15	10
1600	kW	3.03	3.10	3.20	3.30	3.27	3.34	3.45	3.56	3.48	3.55	3.67	3.79	3.66	3.74	3.87	4.00	3.82	3.90	4.03	4.17	3.95	4.04	4.18	4.32
	Amps	14.6	14.9	15.3	15.7	15.5	15.9	16.3	16.8	16.7	17.0	17.5	18.0	17.6	18.0	18.5	19.1	18.6	19.0	19.5	20.2	19.5	20.0	20.5	21.2
	HI PR	235	253	267	278	264	284	300	312	300	323	341	355	342	368	388	405	384	413	437	455	424	457	482	503
	LO PR	104	111	121	129	110	117	128	136	114	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161
	MBh	42.0	43.2	46.8	50.2	41.0	42.2	45.7	49.0	40.0	41.2	44.6	47.9	39.0	40.2	43.5	46.7	37.1	38.2	41.3	44.4	34.4	35.4	38.3	41.1
	S/T	0.78	0.69	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.39	0.89	0.80	0.60	0.39
	ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	19	15	10
1400	kW	2.96	3.02	3.12	3.22	3.19	3.26	3.36	3.47	3.39	3.46	3.58	3.70	3.57	3.65	3.77	3.90	3.72	3.80	3.93	4.06	3.85	3.94	4.07	4.21
	Amps	14.3	14.5	14.9	15.4	15.2	15.5	15.9	16.4	16.3	16.6	17.1	17.6	17.2	17.6	18.1	18.6	18.1	18.5	19.1	19.7	19.1	19.5	20.0	20.7
	HI PR	228	245	259	270	256	275	291	303	291	313	331	345	331	356	376	393	373	401	423	442	412	443	468	488
	LO PR	101	108	117	125	107	114	124	132	111	118	129	137	117	124	135	144	122	130	142	151	126	134	147	156

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160481B* / CA*F4860*6** +TXV/MBVC2000** HIGH STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	47.7	48.7	52.0	55.6	46.6	47.6	50.8	54.3	45.5	46.4	49.6	53.0	44.3	45.3	48.4	51.8	42.1	43.0	46.0	49.2	39.0	39.9	42.6	45.5
	S/T	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.92	0.75	0.56	1.00	0.95	0.78	0.58	1.00	1.00	0.81	0.60	1.00	1.00	0.81	0.61
	ΔT	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	22	22	19	15	20	20	18	14
	kW	3.08	3.15	3.25	3.35	3.32	3.39	3.51	3.62	3.53	3.61	3.73	3.86	3.72	3.81	3.93	4.07	3.88	3.97	4.10	4.24	4.02	4.11	4.25	4.40
	Amps	14.8	15.1	15.5	16.0	15.8	16.1	16.5	17.1	16.9	17.3	17.8	18.3	17.9	18.3	18.8	19.4	18.9	19.3	19.8	20.5	19.9	20.3	20.9	21.6
	HI PR	240	258	272	284	269	289	306	319	306	329	348	363	348	375	396	413	392	422	445	465	433	466	492	513
	LO PR	106	113	123	131	112	119	130	139	117	124	136	144	123	130	142	152	129	137	149	159	133	141	154	164
	MBh	46.3	47.3	50.5	54.0	45.2	46.2	49.4	52.8	44.1	45.1	48.2	51.5	43.1	44.0	47.0	50.2	40.9	41.8	44.7	47.7	37.9	38.7	41.4	44.2
	S/T	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	0.95	0.77	0.58
	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	18	15
	kW	3.06	3.12	3.22	3.33	3.29	3.37	3.48	3.59	3.51	3.58	3.70	3.83	3.69	3.77	3.90	4.03	3.85	3.94	4.07	4.21	3.99	4.08	4.21	4.36
	Amps	14.7	15.0	15.4	15.9	15.7	16.0	16.4	16.9	16.8	17.1	17.6	18.2	17.8	18.1	18.7	19.3	18.7	19.1	19.7	20.3	19.7	20.1	20.7	21.4
HI PR	237	255	270	281	266	287	303	316	303	326	344	359	345	371	392	409	388	418	441	460	429	461	487	508	
LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163	
MBh	42.7	43.6	46.6	49.9	41.7	42.6	45.6	48.7	40.7	41.6	44.5	47.5	39.7	40.6	43.4	46.4	37.8	38.6	41.2	44.1	35.0	35.7	38.2	40.8	
S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56	
ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	22	19	15	
kW	2.98	3.05	3.14	3.24	3.21	3.28	3.39	3.50	3.42	3.49	3.61	3.73	3.60	3.68	3.80	3.93	3.75	3.84	3.96	4.10	3.88	3.97	4.11	4.25	
Amps	14.4	14.6	15.0	15.5	15.3	15.6	16.0	16.5	16.4	16.7	17.2	17.7	17.3	17.7	18.2	18.8	18.3	18.7	19.2	19.8	19.2	19.6	20.2	20.9	
HI PR	230	248	262	273	258	278	294	306	294	316	334	348	335	360	380	397	376	405	428	446	416	448	473	493	
LO PR	102	109	119	126	108	115	125	133	112	119	130	139	118	125	137	146	123	131	143	153	128	136	148	158	
85	MBh	48.5	49.4	51.8	55.2	47.4	48.3	50.6	54.0	46.2	47.1	49.4	52.7	45.1	46.0	48.2	51.4	42.9	43.7	45.8	48.8	39.7	40.5	42.4	45.2
	S/T	0.97	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.96	0.78	1.00	1.00	0.97	0.79
	ΔT	24	24	22	19	24	23	20	16	24	24	23	20	23	23	23	20	22	22	20	18	20	21	21	18
	kW	3.11	3.17	3.27	3.38	3.35	3.42	3.53	3.65	3.56	3.64	3.76	3.89	3.75	3.84	3.97	4.10	3.92	4.00	4.14	4.28	4.05	4.15	4.29	4.44
	Amps	14.9	15.2	15.6	16.1	15.9	16.2	16.7	17.2	17.0	17.4	17.9	18.5	18.0	18.4	18.9	19.6	19.0	19.4	20.0	20.7	20.0	20.4	21.0	21.8
	HI PR	242	261	275	287	272	292	309	322	309	332	351	366	352	379	400	417	396	426	450	469	437	471	497	518
	LO PR	107	114	125	133	113	121	132	140	118	125	137	146	124	132	144	153	130	138	151	161	134	143	156	166
	MBh	47.1	48.0	50.3	53.6	46.0	46.9	49.1	52.4	44.9	45.8	47.9	51.1	43.8	44.7	46.8	49.9	41.6	42.4	44.4	47.4	38.5	39.3	41.2	43.9
	S/T	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.75
	ΔT	25	25	23	20	25	25	24	20	25	25	24	20	25	25	24	21	24	24	23	20	22	23	22	19
	kW	3.08	3.15	3.25	3.35	3.32	3.39	3.51	3.62	3.53	3.61	3.73	3.86	3.72	3.81	3.93	4.07	3.88	3.97	4.10	4.24	4.02	4.11	4.25	4.40
	Amps	14.8	15.1	15.5	16.0	15.8	16.1	16.5	17.1	16.9	17.3	17.8	18.3	17.9	18.3	18.8	19.4	18.9	19.3	19.8	20.5	19.9	20.3	20.9	21.6
HI PR	240	258	272	284	269	289	306	319	306	329	348	363	348	375	396	413	392	422	445	465	433	466	492	513	
LO PR	106	113	123	131	112	119	130	139	117	124	136	144	123	130	142	152	129	137	149	159	133	141	154	164	
MBh	43.5	44.3	46.4	49.5	42.5	43.3	45.3	48.4	41.4	42.2	44.2	47.2	40.4	41.2	43.2	46.0	38.4	39.2	41.0	43.7	35.6	36.3	38.0	40.5	
S/T	0.89	0.86	0.78	0.63	0.93	0.89	0.81	0.65	0.95	0.92	0.83	0.67	0.98	0.95	0.85	0.69	1.00	0.98	0.89	0.72	1.00	0.99	0.89	0.72	
ΔT	25	25	24	21	26	25	24	21	26	25	24	21	26	26	24	21	25	25	24	21	23	24	22	19	
kW	3.01	3.07	3.17	3.27	3.24	3.31	3.42	3.53	3.45	3.52	3.64	3.76	3.63	3.71	3.83	3.96	3.78	3.87	4.00	4.13	3.92	4.01	4.14	4.28	
Amps	14.5	14.7	15.1	15.6	15.4	15.7	16.2	16.7	16.5	16.9	17.3	17.9	17.5	17.8	18.3	18.9	18.4	18.8	19.4	20.0	19.4	19.8	20.4	21.0	
HI PR	233	250	264	276	261	281	296	309	297	319	337	352	338	364	384	401	380	409	432	451	420	452	477	498	
LO PR	103	110	120	128	109	116	127	135	113	120	132	140	119	127	138	147	125	133	145	154	129	137	150	159	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp. +fan)

EXPANDED COOLING DATA — DSXC160601A* / CA*F4961*6A* + TXV / MBVC2000** LOW STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	41.8	43.3	47.5	-	40.8	42.3	46.3	-	39.8	41.3	45.2	-	38.9	40.3	44.1	-	36.9	38.3	41.9	-	34.2	35.5	38.8	-
	S/T	0.75	0.62	0.43	-	0.78	0.65	0.45	-	0.80	0.66	0.46	-	0.82	0.69	0.47	-	0.85	0.71	0.49	-	0.86	0.72	0.50	-
	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
	kW	2.61	2.67	2.76	-	2.83	2.89	2.99	-	3.02	3.09	3.19	-	3.19	3.26	3.37	-	3.33	3.41	3.52	-	3.45	3.53	3.66	-
	Amps	10.1	10.3	10.7	-	10.9	11.2	11.6	-	11.9	12.2	12.6	-	12.7	13.0	13.5	-	14.9	15.2	15.8	-	15.7	16.1	16.7	-
	HI PR	231	248	252	-	253	272	276	-	297	319	323	-	338	363	368	-	380	409	415	-	439	472	479	-
	Lo PR	120	124	136	-	124	128	140	-	128	132	144	-	132	136	148	-	134	139	151	-	138	142	155	-
	MBh	40.6	42.0	46.1	-	39.6	41.1	45.0	-	38.7	40.1	43.9	-	37.7	39.1	42.9	-	35.9	37.2	40.7	-	33.2	34.4	37.7	-
	S/T	0.71	0.60	0.41	-	0.74	0.62	0.43	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.82	0.68	0.47	-
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	18	15	12	-
kW	2.59	2.65	2.74	-	2.80	2.87	2.97	-	2.99	3.06	3.17	-	3.16	3.23	3.34	-	3.30	3.38	3.49	-	3.42	3.50	3.62	-	
Amps	10.0	10.2	10.6	-	10.8	11.1	11.5	-	11.8	12.1	12.5	-	12.6	12.9	13.4	-	14.7	15.1	15.6	-	15.6	15.9	16.5	-	
HI PR	228	246	249	-	251	270	274	-	294	316	320	-	335	360	365	-	376	405	410	-	435	468	474	-	
Lo PR	119	123	134	-	123	127	138	-	127	131	143	-	130	134	147	-	133	137	150	-	136	141	153	-	
MBh	37.4	38.8	42.5	-	36.6	37.9	41.5	-	35.7	37.0	40.5	-	34.8	36.1	39.6	-	33.1	34.3	37.6	-	30.7	31.8	34.8	-	
S/T	0.69	0.57	0.40	-	0.71	0.60	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.79	0.66	0.46	-	
ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	19	17	13	-	18	16	12	-	
kW	2.57	2.63	2.72	-	2.78	2.84	2.94	-	2.97	3.03	3.14	-	3.13	3.20	3.31	-	3.27	3.35	3.46	-	3.39	3.47	3.59	-	
Amps	9.9	10.1	10.5	-	10.7	11.0	11.4	-	11.7	12.0	12.4	-	12.5	12.8	13.2	-	14.6	15.0	15.5	-	15.4	15.8	16.3	-	
HI PR	226	243	247	-	248	267	271	-	291	313	317	-	331	356	361	-	373	401	406	-	431	463	469	-	
Lo PR	118	122	133	-	122	125	137	-	126	130	142	-	129	133	145	-	132	136	148	-	135	139	152	-	

75	MBh	42.5	43.8	47.4	50.8	41.5	42.7	46.3	49.6	40.5	41.7	45.2	48.5	39.5	40.7	44.1	47.3	37.6	38.7	41.9	44.9	34.8	35.8	38.8	41.6
	S/T	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.38	0.90	0.81	0.61	0.39	0.93	0.83	0.63	0.41	0.97	0.87	0.66	0.42	0.98	0.87	0.66	0.43
	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	22	20	16	11	22	20	16	11	20	18	15	10
	kW	2.61	2.67	2.76	2.86	2.83	2.89	2.99	3.10	3.02	3.09	3.19	3.31	3.19	3.26	3.37	3.49	3.33	3.41	3.52	3.65	3.45	3.53	3.66	3.79
	Amps	10.1	10.3	10.7	11.1	10.9	11.2	11.6	12.0	11.9	12.2	12.6	13.1	12.7	13.0	13.5	14.0	14.9	15.2	15.8	16.4	15.7	16.1	16.7	17.3
	HI PR	231	248	252	257	253	272	276	282	297	319	323	331	338	363	368	377	380	409	415	424	439	472	479	490
	Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	139	151	161	138	142	155	165
	MBh	41.3	42.5	46.0	49.3	40.3	41.5	44.9	48.2	39.3	40.5	43.8	47.1	38.4	39.5	42.8	45.9	36.5	37.5	40.6	43.6	33.8	34.8	37.6	40.4
	S/T	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.37	0.86	0.77	0.58	0.38	0.89	0.80	0.60	0.39	0.92	0.83	0.63	0.40	0.93	0.83	0.63	0.41
	ΔT	22	20	17	11	22	20	17	12	22	21	17	12	22	21	17	12	22	20	17	12	21	19	16	11
kW	2.59	2.65	2.74	2.83	2.80	2.87	2.97	3.07	2.99	3.06	3.17	3.28	3.16	3.23	3.34	3.46	3.30	3.38	3.49	3.62	3.42	3.50	3.62	3.75	
Amps	10.0	10.2	10.6	11.0	10.8	11.1	11.5	11.9	11.8	12.1	12.5	13.0	12.6	12.9	13.4	13.9	14.7	15.1	15.6	16.2	15.6	15.9	16.5	17.1	
HI PR	228	246	249	255	251	270	274	280	294	316	320	327	335	360	365	373	376	405	410	419	435	468	474	485	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	141	153	163	
MBh	38.1	39.2	42.4	45.5	37.2	38.3	41.5	44.5	36.3	37.4	40.5	43.4	35.4	36.5	39.5	42.4	33.7	34.6	37.5	40.3	31.2	32.1	34.7	37.3	
S/T	0.78	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.90	0.80	0.61	0.39	
ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11	
kW	2.57	2.63	2.72	2.81	2.78	2.84	2.94	3.04	2.97	3.03	3.14	3.25	3.13	3.20	3.31	3.43	3.27	3.35	3.46	3.58	3.39	3.47	3.59	3.72	
Amps	9.9	10.1	10.5	10.9	10.7	11.0	11.4	11.8	11.7	12.0	12.4	12.8	12.5	12.8	13.2	13.7	14.6	15.0	15.5	16.1	15.4	15.8	16.3	17.0	
HI PR	226	243	247	252	248	267	271	277	291	313	317	324	331	356	361	369	373	401	406	415	431	463	469	480	
Lo PR	118	122	133	142	122	125	137	146	126	130	142	151	129	133	145	155	132	136	148	158	135	139	152	162	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160601A* / CA*F4961*6A* + TXV / MBVC2000** LOW STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	43.3	44.2	47.2	50.5	42.2	43.2	46.1	49.3	41.2	42.1	45.0	48.1	40.2	41.1	43.9	47.0	38.2	39.1	41.7	44.6	35.4	36.2	38.7	41.3
	S/T	0.93	0.87	0.71	0.53	0.97	0.91	0.74	0.55	1.00	0.93	0.76	0.57	1.00	0.96	0.78	0.58	1.00	1.00	0.81	0.61	1.00	1.00	0.82	0.61
	ΔT	24	23	20	16	24	23	20	16	23	23	20	16	23	23	20	16	22	23	21	16	21	21	18	15
	kW	2.61	2.67	2.76	2.86	2.83	2.89	2.99	3.10	3.02	3.09	3.19	3.31	3.19	3.26	3.37	3.49	3.33	3.41	3.52	3.65	3.45	3.53	3.66	3.79
	Amps	10.1	10.3	10.7	11.1	10.9	11.2	11.6	12.0	12.7	13.0	13.5	14.0	14.9	15.2	15.8	16.4	15.7	16.1	16.7	17.3	15.7	16.1	16.7	17.3
	Hi PR	231	248	252	257	253	272	276	282	297	319	323	331	338	363	368	377	380	409	415	424	439	472	479	490
	Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	139	151	161	138	142	155	165
	MBh	42.0	42.9	45.8	49.0	41.0	41.9	44.8	47.9	40.0	40.9	43.7	46.7	39.1	39.9	42.6	45.6	37.1	37.9	40.5	43.3	34.4	35.1	37.5	40.1
	S/T	0.89	0.83	0.68	0.51	0.92	0.86	0.70	0.53	0.95	0.89	0.72	0.54	0.98	0.92	0.74	0.56	1.00	0.95	0.77	0.58	1.00	0.96	0.78	0.58
	ΔT	25	24	20	16	25	24	21	17	25	24	21	17	25	24	21	17	24	24	21	16	23	22	19	15
kW	2.59	2.65	2.74	2.83	2.80	2.87	2.97	3.07	2.99	3.06	3.17	3.28	3.16	3.23	3.34	3.46	3.30	3.38	3.49	3.62	3.42	3.50	3.62	3.75	
Amps	10.0	10.2	10.6	11.0	10.8	11.1	11.5	11.9	11.8	12.1	12.5	13.0	12.6	12.9	13.4	13.9	14.7	15.1	15.6	16.2	15.6	15.9	16.5	17.1	
Hi PR	228	246	249	255	251	270	274	280	294	316	320	327	335	360	365	373	376	405	410	419	435	468	474	485	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	141	153	163	
MBh	38.8	39.6	42.3	45.2	37.9	38.7	41.3	44.2	37.0	37.8	40.3	43.1	36.1	36.8	39.4	42.1	34.3	35.0	37.4	40.0	31.7	32.4	34.6	37.0	
S/T	0.86	0.80	0.65	0.49	0.89	0.83	0.68	0.51	0.91	0.85	0.70	0.52	0.94	0.88	0.72	0.54	0.98	0.92	0.75	0.56	0.98	0.92	0.75	0.56	
ΔT	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	25	24	21	17	23	22	20	16	
kW	2.57	2.63	2.72	2.81	2.78	2.84	2.94	3.04	2.97	3.03	3.14	3.25	3.13	3.20	3.31	3.43	3.27	3.35	3.46	3.58	3.39	3.47	3.59	3.72	
Amps	9.9	10.1	10.5	10.9	10.7	11.0	11.4	11.8	11.7	12.0	12.4	12.8	12.5	12.8	13.2	13.7	14.6	15.0	15.5	16.1	15.4	15.8	16.3	17.0	
Hi PR	226	243	247	252	248	267	271	277	291	313	317	324	331	356	361	369	373	401	406	415	431	463	469	480	
Lo PR	118	122	133	142	122	125	137	146	126	130	142	151	129	133	145	155	132	136	148	158	135	139	152	162	

85	MBh	44.0	44.9	47.0	50.1	43.0	43.8	45.9	49.0	42.0	42.8	44.8	47.8	40.9	41.7	43.7	46.6	38.9	39.6	41.5	44.3	36.0	36.7	38.5	41.0
	S/T	0.98	0.94	0.85	0.69	1.00	0.98	0.88	0.72	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.97	0.79	1.00	1.00	0.98	0.79
	ΔT	25	25	23	20	25	25	24	20	24	25	24	20	24	24	24	21	23	23	23	20	21	21	22	19
	kW	2.61	2.67	2.76	2.86	2.83	2.89	2.99	3.10	3.02	3.09	3.19	3.31	3.19	3.26	3.37	3.49	3.33	3.41	3.52	3.65	3.45	3.53	3.66	3.79
	Amps	10.1	10.3	10.7	11.1	10.9	11.2	11.6	12.0	11.9	12.2	12.6	13.1	12.7	13.0	13.5	14.0	14.9	15.2	15.8	16.4	15.7	16.1	16.7	17.3
	Hi PR	231	248	252	257	253	272	276	282	297	319	323	331	338	363	368	377	380	409	415	424	439	472	479	490
	Lo PR	120	124	136	144	124	128	140	149	128	132	144	154	132	136	148	158	134	139	151	161	138	142	155	165
	MBh	42.7	43.6	45.6	48.7	41.7	42.5	44.6	47.5	40.7	41.5	43.5	46.4	39.7	40.5	42.4	45.3	37.8	38.5	40.3	43.0	35.0	35.7	37.3	39.8
	S/T	0.93	0.90	0.81	0.66	0.97	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.76
	ΔT	26	26	24	21	26	26	25	21	27	26	25	21	26	26	25	21	26	26	25	21	25	25	23	20
kW	2.59	2.65	2.74	2.83	2.80	2.87	2.97	3.07	2.99	3.06	3.17	3.28	3.16	3.23	3.34	3.46	3.30	3.38	3.49	3.62	3.42	3.50	3.62	3.75	
Amps	10.0	10.2	10.6	11.0	10.8	11.1	11.5	11.9	11.8	12.1	12.5	13.0	12.6	12.9	13.4	13.9	14.7	15.1	15.6	16.2	15.6	15.9	16.5	17.1	
Hi PR	228	246	249	255	251	270	274	280	294	316	320	327	335	360	365	373	376	405	410	419	435	468	474	485	
Lo PR	119	123	134	143	123	127	138	147	127	131	143	152	130	134	147	156	133	137	150	159	136	141	153	163	
MBh	39.4	40.2	42.1	44.9	38.5	39.3	41.1	43.9	37.6	38.3	40.1	42.8	36.7	37.4	39.2	41.8	34.8	35.5	37.2	39.7	32.3	32.9	34.5	36.8	
S/T	0.90	0.87	0.78	0.64	0.93	0.90	0.81	0.66	0.96	0.92	0.83	0.68	0.99	0.95	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.90	0.73	
ΔT	26.6	26	25	21	27	26	25	22	27	27	25	22	27	27	25	22	26	26	25	22	24	25	23	20	
kW	2.57	2.63	2.72	2.81	2.78	2.84	2.94	3.04	2.97	3.03	3.14	3.25	3.13	3.20	3.31	3.43	3.27	3.35	3.46	3.58	3.39	3.47	3.59	3.72	
Amps	9.9	10.1	10.5	10.9	10.7	11.0	11.4	11.8	11.7	12.0	12.4	12.8	12.5	12.8	13.2	13.7	14.6	15.0	15.5	16.1	15.4	15.8	16.3	17.0	
Hi PR	226	243	247	252	248	267	271	277	291	313	317	324	331	356	361	369	373	401	406	415	431	463	469	480	
Lo PR	118	122	133	142	122	125	137	146	126	130	142	151	129	133	145	155	132	136	148	158	135	139	152	162	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160601A*/ CA*F4961*6A* + TXV/ MBVC2000** HIGH STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65°F				75°F				85°F				95°F				105°F				115°F				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	2025	MBh	55.9	57.9	63.4	-	54.6	56.5	62.0	-	53.3	55.2	60.5	-	52.0	53.9	59.0	-	49.4	51.2	56.1	-	45.7	47.4	51.9	-
		S/T	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.81	0.68	0.47	-	0.84	0.70	0.49	-	0.87	0.73	0.50	-	0.88	0.73	0.51	-
	ΔT	19	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-	
	kW	3.94	4.02	4.15	-	4.25	4.34	4.48	-	4.52	4.62	4.77	-	4.76	4.86	5.03	-	4.96	5.07	5.24	-	5.14	5.25	5.43	-	
	Amps	14.2	14.5	15.0	-	15.4	15.8	16.3	-	16.8	17.2	17.8	-	18.0	18.4	19.0	-	21.0	21.6	22.3	-	22.2	22.8	23.6	-	
	Hi PR	247	266	269	-	271	292	296	-	318	342	346	-	362	389	395	-	407	438	444	-	470	506	513	-	
	Lo PR	118	121	132	-	121	125	136	-	125	129	141	-	128	132	145	-	131	135	148	-	134	138	151	-	
	MBh	54.2	56.2	61.6	-	53.0	54.9	60.1	-	51.7	53.6	58.7	-	50.4	52.3	57.3	-	47.9	49.7	54.4	-	44.4	46.0	50.4	-	
	S/T	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.84	0.70	0.49	-	
	ΔT	20	18	13	-	20	18	13	-	20	18	13	-	21	18	14	-	20	18	13	-	19	16	12	-	
1800	2025	MBh	3.91	3.99	4.12	-	4.21	4.30	4.44	-	4.48	4.58	4.73	-	4.72	4.82	4.98	-	4.92	5.03	5.20	-	5.09	5.21	5.39	-
		Amps	14.0	14.4	14.9	-	15.2	15.6	16.1	-	16.6	17.0	17.6	-	17.8	18.2	18.9	-	20.8	21.4	22.1	-	22.0	22.6	23.4	-
	Hi PR	245	263	267	-	269	289	293	-	314	338	343	-	358	385	391	-	403	433	439	-	466	501	508	-	
	Lo PR	116	120	131	-	120	124	135	-	124	128	139	-	127	131	143	-	130	134	146	-	133	137	150	-	
	MBh	50.1	51.9	56.8	-	48.9	50.7	55.5	-	47.7	49.5	54.2	-	46.6	48.3	52.9	-	44.2	45.8	50.2	-	41.0	42.5	46.5	-	
	S/T	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.81	0.68	0.47	-	
	ΔT	21	18	14	-	21	18	14	-	21	18	14	-	21	18	14	-	21	18	14	-	19	17	13	-	
	kW	3.87	3.96	4.08	-	4.18	4.27	4.41	-	4.44	4.54	4.69	-	4.68	4.78	4.94	-	4.88	4.99	5.16	-	5.05	5.17	5.34	-	
	Amps	13.9	14.3	14.7	-	15.1	15.5	16.0	-	16.4	16.9	17.4	-	17.6	18.1	18.7	-	20.6	21.1	21.9	-	21.8	22.3	23.1	-	
	Hi PR	242	260	264	-	266	286	290	-	311	335	340	-	355	381	387	-	399	429	435	-	461	496	503	-	
Lo PR	115	119	130	-	119	122	134	-	123	126	138	-	126	130	142	-	128	132	145	-	132	136	148	-		

75	2025	MBh	56.8	58.5	63.3	67.9	55.5	57.1	61.8	66.4	54.2	55.8	60.4	64.8	52.8	54.4	58.9	63.2	50.2	51.7	55.9	60.0	46.5	47.9	51.8	55.6
		S/T	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.93	0.83	0.63	0.40	0.95	0.85	0.65	0.42	0.99	0.89	0.67	0.43	1.00	0.89	0.68	0.44
	ΔT	22	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	19	16	11	
	kW	3.94	4.02	4.15	4.29	4.25	4.34	4.48	4.63	4.52	4.62	4.77	4.93	4.76	4.86	5.03	5.20	4.96	5.07	5.24	5.42	5.14	5.25	5.43	5.62	
	Amps	14.2	14.5	15.0	15.6	15.4	15.8	16.3	16.9	16.8	17.2	17.8	18.5	18.0	18.4	19.0	19.8	21.0	21.6	22.3	23.2	22.2	22.8	23.6	24.5	
	Hi PR	247	266	269	275	271	292	296	302	318	342	346	354	362	389	395	403	407	438	444	454	470	506	513	524	
	Lo PR	118	121	132	141	121	125	136	145	125	129	141	150	128	132	145	154	131	135	148	157	134	138	151	161	
	MBh	55.1	56.8	61.5	66.0	53.9	55.5	60.0	64.4	52.6	54.1	58.6	62.9	51.3	52.8	57.2	61.4	48.7	50.2	54.3	58.3	45.1	46.5	50.3	54.0	
	S/T	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.91	0.81	0.62	0.40	0.95	0.85	0.64	0.41	0.95	0.85	0.65	0.42	
	ΔT	23	22	18	12	24	22	18	12	24	22	18	12	24	22	18	12	24	22	18	12	22	20	17	11	
1800	2025	kW	3.91	3.99	4.12	4.25	4.21	4.30	4.44	4.59	4.48	4.58	4.73	4.89	4.72	4.82	4.98	5.15	4.92	5.03	5.20	5.38	5.09	5.21	5.39	5.57
		Amps	14.0	14.4	14.9	15.5	15.2	15.6	16.1	16.8	16.6	17.0	17.6	18.3	17.8	18.2	18.9	19.6	20.8	21.4	22.1	23.0	22.0	22.6	23.4	24.3
	Hi PR	245	263	267	273	269	289	293	299	314	338	343	350	358	385	391	399	403	433	439	449	466	501	508	519	
	Lo PR	116	120	131	140	120	124	135	144	124	128	139	149	127	131	143	153	130	134	146	156	133	137	150	159	
	MBh	50.9	52.4	56.7	60.9	49.7	51.2	55.4	59.5	48.5	50.0	54.1	58.1	47.3	48.8	52.8	56.6	45.0	46.3	50.1	53.8	41.7	42.9	46.4	49.8	
	S/T	0.80	0.72	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.59	0.38	0.91	0.82	0.62	0.40	0.92	0.82	0.62	0.40	
	ΔT	24	22	18	12	24	22	18	13	24	22	18	13	24	22	18	13	24	22	18	12	22	21	17	12	
	kW	3.87	3.96	4.08	4.22	4.18	4.27	4.41	4.55	4.44	4.54	4.69	4.85	4.68	4.78	4.94	5.11	4.88	4.99	5.16	5.33	5.05	5.17	5.34	5.52	
	Amps	13.9	14.3	14.7	15.3	15.1	15.5	16.0	16.6	16.4	16.9	17.4	18.1	17.6	18.1	18.7	19.4	20.6	21.1	21.9	22.7	21.8	22.3	23.1	24.0	
	Hi PR	242	260	264	270	266	286	290	296	311	335	340	347	355	381	387	395	399	429	435	445	461	496	503	514	
Lo PR	115	119	130	138	119	122	134	142	123	126	138	147	126	130	142	151	128	132	145	154	132	136	148	158		

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160601A*/CA*F4961*6A* + TXV/MBVC2000** HIGH STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
2025	MBh	57.8	59.1	63.1	67.5	56.5	57.7	61.6	65.9	55.1	56.3	60.2	64.3	53.8	55.0	58.7	62.8	51.1	52.2	55.8	59.6	47.3	48.4	51.7	55.2
	S/T	0.95	0.90	0.73	0.54	1.00	0.93	0.76	0.56	1.00	0.95	0.77	0.58	1.00	1.00	0.80	0.60	1.00	1.00	0.83	0.62	1.00	1.00	0.84	0.63
	ΔT	25	24	21	17	26	24	21	17	25	24	21	17	24	25	21	17	23	24	21	17	21	22	20	16
	kW	3.94	4.02	4.15	4.29	4.25	4.34	4.48	4.63	4.52	4.62	4.77	4.93	4.76	4.86	5.03	5.20	4.96	5.07	5.24	5.42	5.14	5.25	5.43	5.62
	Amps	14.2	14.5	15.0	15.6	15.4	15.8	16.3	16.9	16.8	17.2	17.8	18.5	18.0	18.4	19.0	19.8	21.0	21.6	22.3	23.2	22.2	22.8	23.6	24.5
	Hi PR	247	266	269	275	271	292	296	302	318	342	346	354	362	389	395	403	407	438	444	454	470	506	513	524
	Lo PR	118	121	132	141	121	125	136	145	125	129	141	150	128	132	145	154	131	135	148	157	134	138	151	161
	MBh	56.1	57.4	61.3	65.5	54.8	56.0	59.9	64.0	53.5	54.7	58.4	62.5	52.2	53.4	57.0	60.9	49.6	50.7	54.2	57.9	45.9	46.9	50.2	53.6
	S/T	0.91	0.85	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	0.98	0.80	0.60
	ΔT	26	25	22	17	26	25	22	18	26	25	22	18	27	26	22	18	25	25	22	17	23	24	20	16
1800	kW	3.91	3.99	4.12	4.25	4.21	4.30	4.44	4.59	4.48	4.58	4.73	4.89	4.72	4.82	4.98	5.15	4.92	5.03	5.20	5.38	5.09	5.21	5.39	5.57
	Amps	14.0	14.4	14.9	15.5	15.2	15.6	16.1	16.8	16.6	17.0	17.6	18.3	17.8	18.2	18.9	19.6	20.8	21.4	22.1	23.0	22.0	22.6	23.4	24.3
	Hi PR	245	263	267	273	269	289	293	299	314	338	343	350	358	385	391	399	403	433	439	449	466	501	508	519
	Lo PR	116	120	131	140	120	124	135	144	124	128	139	149	127	131	143	153	130	134	146	156	133	137	150	159
	MBh	51.8	52.9	56.6	60.5	50.6	51.7	55.2	59.1	49.4	50.5	53.9	57.6	48.2	49.2	52.6	56.2	45.8	46.8	50.0	53.4	42.4	43.3	46.3	49.5
	S/T	0.88	0.82	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.88	0.71	0.53	0.96	0.90	0.74	0.55	1.00	0.94	0.76	0.57	1.01	0.95	0.77	0.58
	ΔT	27	25	22	18	27	26	22	18	27	26	22	18	27	26	23	18	27	26	22	18	25	24	21	17
	kW	3.87	3.96	4.08	4.22	4.18	4.27	4.41	4.55	4.44	4.54	4.69	4.85	4.68	4.78	4.94	5.11	4.88	4.99	5.16	5.33	5.05	5.17	5.34	5.52
	Amps	13.9	14.3	14.7	15.3	15.1	15.5	16.0	16.6	16.4	16.9	17.4	18.1	17.6	18.1	18.7	19.4	20.6	21.1	21.9	22.7	21.8	22.3	23.1	24.0
	Hi PR	242	260	264	270	266	286	290	296	311	335	340	347	355	381	387	395	399	429	435	445	461	496	503	514
Lo PR	115	119	130	138	119	122	134	142	123	126	138	147	126	130	142	151	128	132	145	154	132	136	148	158	

2025	MBh	58.8	60.0	62.8	67.0	57.5	58.6	61.3	65.4	56.1	57.2	59.9	63.9	54.7	55.8	58.4	62.3	52.0	53.0	55.5	59.2	48.2	49.1	51.4	54.8
	S/T	1.00	0.97	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.96	0.78	1.00	1.00	0.99	0.81	1.00	1.00	1.00	0.81
	ΔT	27	26	25	22	26	27	25	22	25	26	25	22	25	25	25	22	24	24	25	22	22	22	23	20
	kW	3.94	4.02	4.15	4.29	4.25	4.34	4.48	4.63	4.52	4.62	4.77	4.93	4.76	4.86	5.03	5.20	4.96	5.07	5.24	5.42	5.14	5.25	5.43	5.62
	Amps	14.2	14.5	15.0	15.6	15.4	15.8	16.3	16.9	16.8	17.2	17.8	18.5	18.0	18.4	19.0	19.8	21.0	21.6	22.3	23.2	22.2	22.8	23.6	24.5
	Hi PR	247	266	269	275	271	292	296	302	318	342	346	354	362	389	395	403	407	438	444	454	470	506	513	524
	Lo PR	118	121	132	141	121	125	136	145	125	129	141	150	128	132	145	154	131	135	148	157	134	138	151	161
	MBh	57.1	58.2	61.0	65.0	55.8	56.9	59.6	63.5	54.5	55.5	58.1	62.0	53.1	54.2	56.7	60.5	50.5	51.4	53.9	57.5	46.7	47.7	49.9	53.2
	S/T	0.95	0.92	0.83	0.67	0.99	0.95	0.86	0.70	1.00	0.98	0.88	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.95	0.77
	ΔT	28	27	26	22	28	28	26	23	28	28	26	23	27	28	26	23	26	26	26	23	24	24	24	21
1800	kW	3.91	3.99	4.12	4.25	4.21	4.30	4.44	4.59	4.48	4.58	4.73	4.89	4.72	4.82	4.98	5.15	4.92	5.03	5.20	5.38	5.09	5.21	5.39	5.57
	Amps	14.0	14.4	14.9	15.5	15.2	15.6	16.1	16.8	16.6	17.0	17.6	18.3	17.8	18.2	18.9	19.6	20.8	21.4	22.1	23.0	22.0	22.6	23.4	24.3
	Hi PR	245	263	267	273	269	289	293	299	314	338	343	350	358	385	391	399	403	433	439	449	466	501	508	519
	Lo PR	116	120	131	140	120	124	135	144	124	128	139	149	127	131	143	153	130	134	146	156	133	137	150	159
	MBh	52.7	53.7	56.3	60.0	51.5	52.5	55.0	58.6	50.3	51.2	53.7	57.2	49.0	50.0	52.3	55.8	46.6	47.5	49.7	53.1	43.1	44.0	46.1	49.1
	S/T	0.92	0.89	0.80	0.65	0.95	0.92	0.83	0.67	0.98	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.92	0.75
	ΔT	28	28	26	23	29	28	27	23	29	28	27	23	29	28	27	23	27	28	26	23	25	26	25	21
	kW	3.87	3.96	4.08	4.22	4.18	4.27	4.41	4.55	4.44	4.54	4.69	4.85	4.68	4.78	4.94	5.11	4.88	4.99	5.16	5.33	5.05	5.17	5.34	5.52
	Amps	13.9	14.3	14.7	15.3	15.1	15.5	16.0	16.6	16.4	16.9	17.4	18.1	17.6	18.1	18.7	19.4	20.6	21.1	21.9	22.7	21.8	22.3	23.1	24.0
	Hi PR	242	260	264	270	266	286	290	296	311	335	340	347	355	381	387	395	399	429	435	445	461	496	503	514
Lo PR	115	119	130	138	119	122	134	142	123	126	138	147	126	130	142	151	128	132	145	154	132	136	148	158	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — DSXC160601B* / CA*F4961*6A* +TXV / MBVC2000** -1** LOW STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																									
		65°F				75°F				85°F				95°F				105°F				115°F					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	1350	MBh	39.3	40.7	44.6	-	38.3	39.7	43.5	-	37.4	38.8	42.5	-	36.5	37.8	41.5	-	34.7	36.0	39.4	-	32.1	33.3	36.5	-	
		S/T	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.47	-	0.83	0.70	0.48	-	0.84	0.70	0.49	-	
		ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-	
	1217	kW	2.43	2.49	2.57	-	2.63	2.69	2.78	-	2.81	2.87	2.97	-	2.96	3.03	3.14	-	3.09	3.17	3.28	-	3.21	3.28	3.40	-	
		Amps	9.9	10.1	10.4	-	10.7	10.9	11.3	-	11.6	11.9	12.3	-	12.4	12.7	13.1	-	13.2	13.5	14.0	-	14.0	14.3	14.8	-	
		HI PR	214	231	244	-	241	259	273	-	274	294	311	-	312	335	354	-	351	377	398	-	387	417	440	-	
	1050	LO PR	107	114	124	-	113	120	132	-	118	125	137	-	124	132	144	-	130	138	150	-	134	143	156	-	
		MBh	38.7	40.1	43.9	-	37.8	39.2	42.9	-	36.9	38.2	41.9	-	36.0	37.3	40.9	-	34.2	35.4	38.8	-	31.7	32.8	35.9	-	
		S/T	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.81	0.67	0.47	-	
	75	1350	ΔT	21	18	13	-	21	18	14	-	21	18	14	-	21	18	14	-	21	18	14	-	19	17	13	-
			kW	2.42	2.47	2.56	-	2.62	2.68	2.77	-	2.79	2.85	2.95	-	2.94	3.01	3.12	-	3.07	3.15	3.26	-	3.19	3.26	3.38	-
			Amps	9.8	10.0	10.4	-	10.6	10.9	11.2	-	11.5	11.8	12.2	-	12.3	12.6	13.0	-	13.1	13.4	13.9	-	13.9	14.2	14.7	-
1217		HI PR	213	229	242	-	239	257	271	-	272	292	309	-	309	333	352	-	348	375	396	-	385	414	437	-	
		LO PR	106	113	124	-	112	120	131	-	117	124	136	-	123	131	143	-	129	137	149	-	133	142	155	-	
		MBh	35.7	37.0	40.5	-	34.9	36.1	39.6	-	34.0	35.3	38.6	-	33.2	34.4	37.7	-	31.5	32.7	35.8	-	29.2	30.3	33.2	-	
1050		S/T	0.68	0.57	0.39	-	0.70	0.59	0.41	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.77	0.64	0.45	-	0.78	0.65	0.45	-	
		ΔT	21	18	14	-	21	19	14	-	21	19	14	-	22	19	14	-	21	18	14	-	20	17	13	-	
		kW	2.36	2.41	2.49	-	2.55	2.61	2.69	-	2.72	2.78	2.88	-	2.87	2.93	3.03	-	2.99	3.06	3.17	-	3.10	3.18	3.29	-	
75		1350	Amps	9.5	9.8	10.1	-	10.3	10.6	10.9	-	11.2	11.5	11.8	-	12.0	12.3	12.7	-	12.7	13.0	13.5	-	13.5	13.8	14.3	-
			HI PR	207	222	235	-	232	249	263	-	264	284	299	-	300	323	341	-	338	363	384	-	373	401	424	-
			LO PR	103	110	120	-	109	116	127	-	113	121	132	-	119	127	138	-	125	133	145	-	129	137	150	-
	1217	MBh	39.92	41.10	44.49	47.75	38.99	40.14	43.45	46.64	38.06	39.19	42.42	45.52	37.13	38.23	41.38	44.41	35.28	36.32	39.31	42.19	32.68	33.64	36.42	39.08	
		S/T	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.38	0.89	0.79	0.60	0.39	0.91	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42	
		ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	20	16	11	
	1050	kW	2.45	2.51	2.59	2.68	2.65	2.72	2.81	2.90	2.83	2.90	3.00	3.10	2.99	3.06	3.16	3.27	3.12	3.19	3.31	3.42	3.24	3.31	3.43	3.55	
		Amps	10.0	10.2	10.5	10.9	10.8	11.0	11.4	11.8	11.7	12.0	12.4	12.8	12.5	12.8	13.2	13.7	13.3	13.6	14.1	14.6	14.1	14.4	14.9	15.5	
		HI PR	217	233	246	257	243	262	276	288	276	297	314	328	315	339	358	373	354	381	402	420	391	421	445	464	
	75	1350	LO PR	108	115	126	134	114	122	133	142	119	126	138	147	125	133	145	154	131	139	152	162	135	144	157	167
			MBh	39.3	40.5	43.8	47.0	38.4	39.6	42.8	45.9	37.5	38.6	41.8	44.9	36.6	37.7	40.8	43.8	34.8	35.8	38.7	41.6	32.2	33.1	35.9	38.5
			S/T	0.80	0.71	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.91	0.81	0.62	0.40	0.92	0.82	0.62	0.40
1217		ΔT	24	22	18	12	24	22	18	13	24	22	18	13	24	22	18	13	24	22	18	12	22	21	17	12	
		kW	2.44	2.49	2.58	2.67	2.64	2.70	2.79	2.89	2.81	2.88	2.98	3.08	2.97	3.04	3.14	3.25	3.10	3.17	3.28	3.40	3.22	3.29	3.41	3.53	
		Amps	9.9	10.1	10.5	10.9	10.7	11.0	11.3	11.7	11.6	11.9	12.3	12.8	12.4	12.7	13.1	13.6	13.2	13.5	14.0	14.5	14.0	14.4	14.8	15.4	
1050		HI PR	215	231	244	255	241	260	274	286	274	295	312	325	313	336	355	370	352	378	400	417	389	418	442	461	
		LO PR	108	114	125	133	114	121	132	141	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166	
		MBh	36.3	37.4	40.5	43.4	35.5	36.5	39.5	42.4	34.6	35.6	38.6	41.4	33.8	34.8	37.6	40.4	32.1	33.0	35.8	38.4	29.7	30.6	33.1	35.5	
75		1350	S/T	0.77	0.69	0.52	0.34	0.80	0.71	0.54	0.35	0.82	0.73	0.55	0.36	0.84	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.88	0.79	0.60	0.38
			ΔT	24	23	18	13	25	23	19	13	25	23	19	13	25	23	19	13	25	23	19	13	23	21	17	12
			kW	2.38	2.43	2.51	2.60	2.57	2.63	2.72	2.81	2.74	2.80	2.90	3.00	2.89	2.96	3.06	3.17	3.02	3.09	3.20	3.31	3.13	3.20	3.32	3.43
	1050	Amps	9.6	9.9	10.2	10.6	10.4	10.7	11.0	11.4	11.3	11.6	12.0	12.4	12.1	12.4	12.8	13.3	12.9	13.2	13.6	14.1	13.6	14.0	14.4	15.0	
		HI PR	209	224	237	247	234	252	266	277	266	286	303	316	303	326	345	359	341	367	388	404	377	406	428	447	
		LO PR	104	111	121	129	110	117	128	136	115	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161	

kW = Total system power
Amps = outdoor unit amps (comp. +fan)

Shaded area reflects ACCA (TVA) conditions

IDB = Entering Indoor Dry Bulb Temperature
High and low pressures are measured at the liquid and suction service valves.

EXPANDED COOLING DATA — DSXC160601B*/CA*F4961*6A*+TXV / MBVC2000** -1** LOW STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	40.63	41.51	44.35	47.41	39.68	40.55	43.32	46.31	38.74	39.58	42.29	45.21	37.79	38.62	41.26	44.11	35.90	36.69	39.20	41.90	33.26	33.98	36.31	38.81
	S/T	0.91	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	0.98	0.79	0.59	1.00	0.98	0.80	0.60
	ΔT	25	24	21	17	26	25	21	17	26	25	21	17	26	25	22	17	24	24	22	17	23	23	20	16
	kW	2.47	2.53	2.62	2.70	2.68	2.74	2.83	2.93	2.86	2.92	3.02	3.13	3.01	3.08	3.19	3.30	3.15	3.22	3.33	3.45	3.26	3.34	3.46	3.58
	Amps	10.1	10.3	10.6	11.0	10.9	11.1	11.5	11.9	11.8	12.1	12.5	13.0	12.6	12.9	13.4	13.9	13.4	13.8	14.2	14.8	14.2	14.6	15.1	15.6
	HI PR	219	235	249	259	245	264	279	291	279	300	317	331	318	342	361	377	358	385	406	424	395	425	449	468
	LO PR	109	116	127	135	116	123	134	143	120	128	139	149	126	134	147	156	132	141	154	164	137	145	159	169
	MBh	40.0	40.9	43.7	46.7	39.1	39.9	42.7	45.6	38.2	39.0	41.7	44.5	37.2	38.0	40.6	43.5	35.4	36.1	38.6	41.3	32.8	33.5	35.8	38.2
	S/T	0.88	0.82	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.93	0.76	0.57	1.00	0.94	0.77	0.57
	ΔT	26	25	22	18	27	26	22	18	27	26	22	18	27	26	23	18	27	26	22	18	25	24	21	17
kW	2.46	2.52	2.60	2.69	2.66	2.72	2.81	2.91	2.84	2.90	3.00	3.11	3.00	3.07	3.17	3.28	3.13	3.20	3.31	3.43	3.24	3.32	3.44	3.56	
Amps	10.0	10.2	10.6	11.0	10.8	11.1	11.4	11.8	11.7	12.0	12.4	12.9	12.5	12.8	13.3	13.8	13.3	13.7	14.1	14.7	14.1	14.5	15.0	15.5	
HI PR	217	234	247	257	244	262	277	289	277	298	315	329	316	340	359	374	355	382	404	421	392	422	446	465	
LO PR	109	116	126	134	115	122	133	142	119	127	139	148	125	133	146	155	131	140	152	162	136	144	158	168	
MBh	36.9	37.8	40.3	43.1	36.1	36.9	39.4	42.1	35.2	36.0	38.5	41.1	34.4	35.1	37.5	40.1	32.6	33.4	35.6	38.1	30.2	30.9	33.0	35.3	
S/T	0.84	0.79	0.64	0.48	0.87	0.82	0.67	0.50	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	0.97	0.91	0.74	0.55	
ΔT	27	26	23	18	28	26	23	18	28	27	23	18	28	27	23	19	27	26	23	18	26	25	21	17	
kW	2.40	2.45	2.53	2.62	2.59	2.65	2.74	2.84	2.77	2.83	2.93	3.03	2.92	2.99	3.09	3.20	3.05	3.12	3.23	3.34	3.16	3.23	3.35	3.46	
Amps	9.7	10.0	10.3	10.7	10.5	10.8	11.1	11.5	11.4	11.7	12.1	12.5	12.2	12.5	12.9	13.4	13.0	13.3	13.7	14.3	13.7	14.1	14.6	15.1	
HI PR	211	227	239	250	236	254	269	280	269	289	306	319	306	330	348	363	345	371	392	408	381	410	433	451	
LO PR	105	112	122	130	111	118	129	138	116	123	134	143	122	129	141	150	127	135	148	158	132	140	153	163	

85	MBh	41.34	42.14	44.13	47.08	40.38	41.16	43.11	45.99	39.41	40.18	42.08	44.89	38.45	39.20	41.05	43.80	36.53	37.24	39.00	41.61	33.84	34.49	36.13	38.54
	S/T	0.96	0.92	0.83	0.68	0.99	0.96	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78
	ΔT	27	27	25	22	27	27	25	22	26	27	25	22	26	27	26	22	25	25	25	22	23	23	24	20
	kW	2.50	2.55	2.64	2.73	2.70	2.76	2.86	2.96	2.88	2.95	3.05	3.16	3.04	3.11	3.22	3.33	3.18	3.25	3.36	3.48	3.29	3.37	3.49	3.61
	Amps	10.1	10.4	10.7	11.1	11.0	11.2	11.6	12.0	11.9	12.2	12.6	13.1	12.7	13.0	13.5	14.0	13.6	13.9	14.4	14.9	14.4	14.7	15.2	15.8
	HI PR	221	238	251	262	248	267	282	294	282	303	320	334	321	346	365	381	361	389	411	428	399	430	454	473
	LO PR	110	118	128	137	117	124	136	144	121	129	141	150	127	136	148	158	134	142	155	165	138	147	160	171
	MBh	40.7	41.5	43.5	46.4	39.8	40.5	42.5	45.3	38.8	39.6	41.5	44.2	37.9	38.6	40.4	43.1	36.0	36.7	38.4	41.0	33.3	34.0	35.6	38.0
	S/T	0.92	0.89	0.80	0.65	0.95	0.92	0.83	0.67	0.98	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.92	0.74
	ΔT	28	28	26	23	29	28	27	23	29	28	27	23	29	28	27	23	27	28	26	23	25	26	25	21
kW	2.48	2.54	2.62	2.71	2.68	2.75	2.84	2.94	2.86	2.93	3.03	3.14	3.02	3.09	3.20	3.31	3.16	3.23	3.34	3.46	3.27	3.35	3.47	3.59	
Amps	10.1	10.3	10.7	11.1	10.9	11.2	11.5	12.0	11.8	12.1	12.5	13.0	12.7	13.0	13.4	13.9	13.5	13.8	14.3	14.8	14.3	14.6	15.1	15.7	
HI PR	219	236	249	260	246	265	280	292	280	301	318	332	319	343	362	378	359	386	408	425	396	427	450	470	
LO PR	110	117	127	136	116	123	135	143	120	128	140	149	127	135	147	157	133	141	154	164	137	146	159	170	
MBh	37.6	38.3	40.1	42.8	36.7	37.4	39.2	41.8	35.8	36.5	38.3	40.8	35.0	35.6	37.3	39.8	33.2	33.9	35.5	37.8	30.8	31.4	32.9	35.0	
S/T	0.88	0.85	0.77	0.63	0.92	0.88	0.80	0.65	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	0.98	0.88	0.72	
ΔT	29	29	27	23	29	29	27	24	30	29	27	24	30	29	28	24	29	29	27	24	27	27	25	22	
kW	2.42	2.47	2.56	2.64	2.62	2.67	2.77	2.86	2.79	2.85	2.95	3.05	2.94	3.01	3.12	3.22	3.07	3.15	3.25	3.37	3.19	3.26	3.38	3.49	
Amps	9.8	10.0	10.4	10.8	10.6	10.9	11.2	11.6	11.5	11.8	12.2	12.6	12.3	12.6	13.0	13.5	13.1	13.4	13.9	14.4	13.9	14.2	14.7	15.3	
HI PR	213	229	242	252	239	257	271	283	272	292	309	322	309	333	352	367	348	374	395	412	385	414	437	456	
LO PR	106	113	124	132	112	120	131	139	117	124	136	145	123	131	143	152	129	137	149	159	133	142	155	165	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp. +fan)

EXPANDED COOLING DATA — DSXC160601B* / CA*F4961*6A* +TXV / MBVC2000** -1** HIGH STAGE

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	55.9	57.9	63.4	-	54.6	56.5	62.0	-	53.3	55.2	60.5	-	52.0	53.9	59.0	-	49.4	51.2	56.1	-	45.7	47.4	51.9	-
	S/T	0.74	0.62	0.43	-	0.77	0.64	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.85	0.71	0.49	-
	ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	16	12	-	18	15	12	-
	kW	3.57	3.65	3.77	-	3.86	3.95	4.09	-	4.12	4.22	4.36	-	4.35	4.45	4.61	-	4.55	4.65	4.82	-	4.71	4.83	4.99	-
	Amps	14.1	14.4	14.9	-	15.2	15.6	16.2	-	16.6	17.0	17.6	-	17.8	18.2	18.9	-	19.0	19.4	20.1	-	20.1	20.6	21.3	-
	HI PR	231	248	262	-	259	279	294	-	295	317	335	-	336	361	381	-	377	406	429	-	417	449	474	-
	LO PR	104	111	121	-	110	117	128	-	114	122	133	-	120	128	140	-	126	134	146	-	130	139	151	-
	MBh	54.2	56.2	61.6	-	53.0	54.9	60.1	-	51.7	53.6	58.7	-	50.4	52.3	57.3	-	47.9	49.7	54.4	-	44.4	46.0	50.4	-
	S/T	0.71	0.59	0.41	-	0.73	0.61	0.43	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.81	0.68	0.47	-
	ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	18	16	12	-
	kW	3.54	3.62	3.74	-	3.83	3.92	4.05	-	4.09	4.18	4.33	-	4.31	4.41	4.57	-	4.51	4.61	4.77	-	4.67	4.78	4.95	-
	Amps	13.9	14.3	14.8	-	15.1	15.5	16.0	-	16.5	16.9	17.4	-	17.6	18.1	18.7	-	18.8	19.2	19.9	-	19.9	20.4	21.1	-
HI PR	229	246	260	-	256	276	291	-	292	314	331	-	332	357	377	-	374	402	425	-	413	444	469	-	
LO PR	103	110	120	-	109	116	127	-	113	120	132	-	119	127	138	-	125	133	145	-	129	137	150	-	
MBh	50.1	51.9	56.8	-	48.9	50.7	55.5	-	47.7	49.5	54.2	-	46.6	48.3	52.9	-	44.2	45.8	50.2	-	41.0	42.5	46.5	-	
S/T	0.68	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.78	0.65	0.45	-	0.78	0.66	0.45	-	
ΔT	20	17	13	-	20	18	13	-	20	18	13	-	20	18	13	-	20	17	13	-	19	16	12	-	
kW	3.45	3.53	3.65	-	3.73	3.82	3.95	-	3.98	4.07	4.21	-	4.20	4.30	4.45	-	4.39	4.49	4.65	-	4.55	4.66	4.82	-	
Amps	13.6	13.9	14.4	-	14.7	15.0	15.6	-	16.0	16.4	16.9	-	17.1	17.5	18.1	-	18.2	18.7	19.3	-	19.4	19.8	20.5	-	
HI PR	222	239	252	-	249	268	283	-	283	304	321	-	322	347	366	-	363	390	412	-	401	431	455	-	
LO PR	100	106	116	-	106	112	123	-	110	117	128	-	115	123	134	-	121	129	140	-	125	133	145	-	

75	MBh	56.80	58.48	63.30	67.94	55.48	57.12	61.83	66.36	54.16	55.76	60.36	64.78	52.84	54.40	58.89	63.20	50.20	51.68	55.94	60.04	46.50	47.87	51.82	55.62
	S/T	0.84	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.96	0.86	0.65	0.42	0.97	0.87	0.66	0.42
	ΔT	22	20	16	11	22	20	17	12	22	20	17	12	22	20	17	12	22	20	17	11	20	19	15	11
	kW	3.60	3.68	3.81	3.94	3.90	3.99	4.12	4.27	4.16	4.26	4.40	4.56	4.39	4.49	4.65	4.81	4.59	4.70	4.86	5.03	4.76	4.87	5.04	5.22
	Amps	14.2	14.6	15.0	15.6	15.4	15.8	16.3	16.9	16.8	17.2	17.8	18.5	18.0	18.4	19.0	19.8	19.1	19.6	20.3	21.1	20.3	20.8	21.5	22.4
	HI PR	233	251	265	276	262	282	297	310	298	320	338	353	339	365	385	402	381	410	433	452	421	453	479	499
	LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163
	MBh	55.1	56.8	61.5	66.0	53.9	55.5	60.0	64.4	52.6	54.1	58.6	62.9	51.3	52.8	57.2	61.4	48.7	50.2	54.3	58.3	45.1	46.5	50.3	54.0
	S/T	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40
	ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	23	21	17	12	21	20	16	11
	kW	3.57	3.65	3.78	3.90	3.87	3.95	4.09	4.23	4.12	4.22	4.36	4.52	4.35	4.45	4.61	4.77	4.55	4.65	4.82	4.99	4.71	4.83	5.00	5.17
	Amps	14.1	14.4	14.9	15.5	15.3	15.6	16.2	16.8	16.6	17.0	17.6	18.3	17.8	18.2	18.9	19.6	19.0	19.4	20.1	20.9	20.1	20.6	21.3	22.2
HI PR	231	248	262	274	259	279	294	307	295	317	335	349	336	361	381	398	378	406	429	447	417	449	474	494	
LO PR	104	111	121	129	110	117	128	136	114	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161	
MBh	50.9	52.4	56.7	60.9	49.7	51.2	55.4	59.5	48.5	50.0	54.1	58.1	47.3	48.8	52.8	56.6	45.0	46.3	50.1	53.8	41.7	42.9	46.4	49.8	
S/T	0.78	0.69	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.79	0.60	0.39	0.89	0.80	0.60	0.39	
ΔT	23	21	17	12	23	22	18	12	23	22	18	12	24	22	18	12	24	22	18	12	22	20	16	11	
kW	3.48	3.56	3.68	3.80	3.77	3.85	3.98	4.12	4.02	4.11	4.25	4.40	4.24	4.34	4.49	4.64	4.43	4.53	4.69	4.85	4.59	4.70	4.86	5.03	
Amps	13.7	14.0	14.5	15.0	14.8	15.2	15.7	16.3	16.1	16.5	17.1	17.8	17.3	17.7	18.3	19.0	18.4	18.9	19.5	20.3	19.5	20.0	20.7	21.5	
HI PR	224	241	254	265	251	270	286	298	286	308	325	339	326	350	370	386	366	394	416	434	405	435	460	480	
LO PR	101	108	117	125	107	114	124	132	111	118	129	137	117	124	135	144	122	130	142	151	126	134	147	156	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects ACCA (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp. +fan)

EXPANDED COOLING DATA — DSXC160601B*/CA*F4961*6A*+TXV / MBVC2000** -1** HIGH STAGE (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65°F				75°F				85°F				95°F				105°F				115°F			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
80	MBh	57.81	59.07	63.11	67.47	56.47	57.70	61.65	65.90	55.12	56.33	60.18	64.33	53.78	54.95	58.71	62.76	51.09	52.20	55.77	59.62	47.32	48.36	51.66	55.23
	S/T	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.92	0.75	0.56	1.00	0.95	0.78	0.58	1.00	1.00	0.81	0.60	1.00	1.00	0.81	0.61
	ΔT	24	23	20	16	25	24	21	16	25	24	21	16	24	24	21	17	23	24	20	16	21	22	19	15
	kW	3.63	3.72	3.84	3.97	3.93	4.02	4.16	4.30	4.20	4.29	4.44	4.60	4.43	4.53	4.69	4.86	4.63	4.74	4.90	5.08	4.80	4.91	5.09	5.27
	Amps	14.3	14.7	15.2	15.8	15.5	15.9	16.5	17.1	16.9	17.3	17.9	18.6	18.1	18.6	19.2	20.0	19.3	19.8	20.5	21.3	20.5	21.0	21.7	22.6
	HI PR	236	253	268	279	264	284	300	313	301	323	342	356	342	368	389	406	385	414	438	457	426	458	484	504
	LO PR	106	113	123	131	112	119	130	139	117	124	136	144	123	130	142	152	129	137	149	159	133	141	154	164
	MBh	56.1	57.4	61.3	65.5	54.8	56.0	59.9	64.0	53.5	54.7	58.4	62.5	52.2	53.4	57.0	60.9	49.6	50.7	54.2	57.9	45.9	46.9	50.2	53.6
	S/T	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	0.95	0.77	0.58
	ΔT	25	24	21	17	26	25	21	17	26	25	21	17	26	25	22	17	25	24	21	17	23	23	20	16
	kW	3.60	3.68	3.81	3.94	3.90	3.99	4.12	4.27	4.16	4.26	4.40	4.56	4.39	4.49	4.65	4.81	4.59	4.70	4.86	5.03	4.76	4.87	5.04	5.22
	Amps	14.2	14.6	15.1	15.6	15.4	15.8	16.3	16.9	16.8	17.2	17.8	18.5	18.0	18.4	19.0	19.8	19.1	19.6	20.3	21.1	20.3	20.8	21.5	22.4
HI PR	233	251	265	276	262	282	297	310	298	320	338	353	339	365	385	402	381	410	433	452	421	453	479	499	
LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163	
MBh	51.8	52.9	56.6	60.5	50.6	51.7	55.2	59.1	49.4	50.5	53.9	57.6	48.2	49.2	52.6	56.2	45.8	46.8	50.0	53.4	42.4	43.3	46.3	49.5	
S/T	0.85	0.80	0.65	0.49	0.88	0.83	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.88	0.71	0.53	0.97	0.91	0.74	0.55	0.98	0.92	0.75	0.56	
ΔT	26	25	21	17	26	25	22	17	26	25	22	17	26	25	22	18	26	25	22	17	24	23	20	16	
kW	3.51	3.59	3.71	3.84	3.80	3.88	4.02	4.16	4.05	4.15	4.29	4.44	4.28	4.38	4.53	4.69	4.47	4.57	4.73	4.90	4.63	4.74	4.91	5.08	
Amps	13.8	14.2	14.6	15.2	15.0	15.3	15.9	16.5	16.3	16.7	17.3	17.9	17.4	17.9	18.5	19.2	18.6	19.1	19.7	20.5	19.7	20.2	20.9	21.7	
HI PR	226	243	257	268	254	273	288	301	289	311	328	342	329	354	374	390	370	398	420	438	409	440	464	484	
LO PR	102	109	119	126	108	115	125	133	112	119	130	139	118	125	137	146	123	131	143	153	128	136	148	158	
85	MBh	58.82	59.96	62.80	67.00	57.45	58.57	61.34	65.44	56.09	57.17	59.88	63.88	54.72	55.78	58.42	62.32	51.98	52.99	55.50	59.21	48.15	49.08	51.41	54.84
	S/T	0.97	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.75	1.00	1.00	0.96	0.78	1.00	1.00	0.97	0.79
	ΔT	26	26	24	21	26	26	24	21	25	26	24	21	25	25	25	21	24	24	24	21	22	22	23	20
	kW	3.66	3.75	3.87	4.01	3.97	4.06	4.20	4.34	4.23	4.33	4.48	4.64	4.47	4.57	4.73	4.90	4.67	4.78	4.95	5.12	4.84	4.96	5.13	5.31
	Amps	14.5	14.8	15.3	15.9	15.7	16.1	16.6	17.3	17.1	17.5	18.1	18.8	18.3	18.8	19.4	20.2	19.5	20.0	20.7	21.5	20.7	21.2	22.0	22.8
	HI PR	238	256	270	282	267	287	303	316	304	327	345	360	346	372	393	410	389	419	442	461	430	463	488	509
	LO PR	107	114	125	133	113	121	132	140	118	125	137	146	124	132	144	153	130	138	151	161	134	143	156	166
	MBh	57.1	58.2	61.0	65.0	55.8	56.9	59.6	63.5	54.5	55.5	58.1	62.0	53.1	54.2	56.7	60.5	50.5	51.4	53.9	57.5	46.7	47.7	49.9	53.2
	S/T	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.75
	ΔT	27	27	25	22	27	27	25	22	27	27	25	22	27	27	26	22	26	26	25	22	24	24	24	20
	kW	3.63	3.72	3.84	3.97	3.93	4.02	4.16	4.30	4.20	4.29	4.44	4.60	4.43	4.53	4.69	4.86	4.63	4.74	4.90	5.08	4.80	4.91	5.09	5.27
	Amps	14.3	14.7	15.2	15.8	15.5	15.9	16.5	17.1	16.9	17.3	17.9	18.6	18.1	18.6	19.2	20.0	19.3	19.8	20.5	21.3	20.5	21.0	21.7	22.6
HI PR	236	253	268	279	264	284	300	313	301	323	342	356	342	368	389	406	385	414	438	457	426	458	484	504	
LO PR	106	113	123	131	112	119	130	139	117	124	136	144	123	130	142	152	129	137	149	159	133	141	154	164	
MBh	52.7	53.7	56.3	60.0	51.5	52.5	55.0	58.6	50.3	51.2	53.7	57.2	49.0	50.0	52.3	55.8	46.6	47.5	49.7	53.1	43.1	44.0	46.1	49.1	
S/T	0.89	0.86	0.78	0.63	0.93	0.89	0.81	0.65	0.95	0.92	0.83	0.67	0.98	0.95	0.85	0.69	1.00	0.98	0.89	0.72	1.00	0.99	0.89	0.72	
ΔT	27	27	26	22	28	27	26	22	28	27	26	22	28	28	26	23	27	27	26	22	25	25	24	21	
kW	3.54	3.62	3.74	3.87	3.83	3.92	4.05	4.19	4.09	4.18	4.33	4.48	4.31	4.41	4.57	4.73	4.51	4.61	4.77	4.94	4.67	4.78	4.95	5.13	
Amps	13.9	14.3	14.8	15.3	15.1	15.5	16.0	16.6	16.4	16.9	17.4	18.1	17.6	18.1	18.7	19.4	18.8	19.2	19.9	20.7	19.9	20.4	21.1	21.9	
HI PR	228	246	260	271	256	276	291	304	292	314	331	346	332	357	377	394	374	402	425	443	413	444	469	489	
LO PR	103	110	120	128	109	116	127	135	113	120	132	140	119	127	138	147	125	133	145	154	129	137	150	159	

IDB = Entering Indoor Dry Bulb Temperature
 High and low pressures are measured at the liquid and suction service valves.
 Shaded area reflects AHRI (TVA) conditions
 kW = Total system power
 Amps = outdoor unit amps (comp. +fan)

AHRI PERFORMANCE DATA

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				ARI #
	COILS / AIR HANDLERS	FURNACES / BLOWERS	TOTAL	SENSIBLE	SEER ¹	EER ²	
DSXC16 0241A*	AEPF183016C*+TXV		23,000	17,300	16.0	12.5	3653913
	CA*F3636*6C*+TXV	MBE1200** -1B*	24,000	18,000	16.0	13.0	3653914
	CA*F3636*6C*+TXV	MBVC1200** -1A*	24,000	18,000	16.0	13.0	3653915
	CA*F3636*6C*+TXV	A*V80704B**	24,000	18,000	16.0	13.0	3653916
	CA*F3636*6C*+TXV	A*VC80704BXA*	24,000	18,000	16.0	13.0	3653917
	CA*F3636*6C*+TXV	G*VC90704CXA*	24,000	18,000	16.0	13.0	3653922
	CA*F3636*6C*+TXV	G*V90704C**	24,000	18,000	16.0	13.0	3653918
	CA*F3636*6C*+TXV	G*V90905D**	24,000	18,000	16.0	13.0	3653919
	CA*F3636*6C*+TXV	G*V950453B**	24,000	18,000	16.0	13.0	3653920
	CA*F3636*6C*+TXV	G*V950704C**	24,000	18,000	16.0	13.0	3653921
	CA*F3636*6C*+TXV	G*VC950704CXA*	24,000	18,000	16.0	13.0	3653925
	CA*F3636*6C*+TXV	G*VC90905DXA*	24,000	18,000	16.0	13.0	3653923
	CA*F3636*6C*+TXV	G*VC950453BXA*	24,000	18,000	16.0	13.0	3653924
	CA*F3642*6C*+TXV	A*VC80704BXA*	24,000	18,000	16.0	13.0	3653927
	CA*F3642*6C*+TXV	G*V90704C**	24,000	18,000	16.0	13.0	3653928
	CA*F3642*6C*+TXV	G*V90905D**	24,000	18,000	16.0	13.0	3653929
	CA*F3642*6C*+TXV	G*V950453B**	24,000	18,000	16.0	13.0	3653930
	CA*F3642*6C*+TXV	A*V80704B**	24,000	18,000	16.0	13.0	3653926
	CA*F3642*6C*+TXV	G*V950704C**	24,000	18,000	16.0	13.0	3653931
	CA*F3642*6C*+TXV	G*VC90704CXA*	24,000	18,000	16.0	13.0	3653932
	CA*F3642*6C*+TXV	G*VC90905DXA*	24,000	18,000	16.0	13.0	3653933
	CA*F3642*6C*+TXV	G*VC950453BXA*	24,000	18,000	16.0	13.0	3653934
	CA*F3642*6C*+TXV	G*VC950704CXA*	24,000	18,000	16.0	13.0	3653935
	CHPF3636B6C*+TXV	MBE1200** -1B*	24,000	18,000	16.0	13.0	3653936
	CHPF3636B6C*+TXV	MBVC1200** -1A*	24,000	18,000	16.0	13.0	3653937
	CHPF3636B6C*+TXV	A*V80704B**	24,000	18,000	16.0	13.0	3653938
	CHPF3636B6C*+TXV	A*VC80704BXA*	24,000	18,000	16.0	13.0	3653939
	CHPF3636B6C*+TXV	G*V950453B**	24,000	18,000	16.0	13.0	3653940
	CHPF3636B6C*+TXV	G*V950704C**	24,000	18,000	16.0	12.5	3653941
	CHPF3636B6C*+TXV	G*VC950453BXA*	24,000	18,000	16.0	13.0	3653942
	CHPF3636B6C*+TXV	G*VC950704CXA*	24,000	18,000	16.0	12.5	3653943
	CHPF3642C6C*+TXV	G*V950453B**	24,000	18,000	16.0	13.0	3653944
	CHPF3642C6C*+TXV	G*V950704C**	24,000	18,000	16.0	13.0	3653945
	CHPF3642C6C*+TXV	G*VC950453BXA*	24,000	18,000	16.0	13.0	3653946
	CHPF3642C6C*+TXV	G*VC950704CXA*	24,000	18,000	16.0	13.0	3653947
	CHPF3743C6B*+TXV	G*V950453B**	24,000	18,000	16.0	12.5	3653948
	CHPF3743C6B*+TXV	G*V950704C**	24,000	18,000	16.0	12.5	3653950
	CHPF3743C6B*+TXV	G*VC950453BXA*	24,000	18,000	16.0	12.5	3653951
	CHPF3743C6B*+TXV	G*VC950704CXA*	24,000	18,000	16.0	12.5	3653952
	CHTF3636B6A*+TXV	MBE1200** -1B*	24,000	18,000	15.5	12.5	3653953
	CHTF3636B6A*+TXV	MBVC1200** -1A*	24,000	18,000	15.5	12.5	3653954
	CSCF3036N6B*+TXV	G*V90905D**	24,000	18,000	16.0	13.0	3653958
CSCF3036N6B*+TXV	G*V950453B**	24,000	18,000	15.5	12.5	3653959	
CSCF3036N6B*+TXV	G*V950704C**	24,000	18,000	16.0	13.0	3653960	
CSCF3036N6B*+TXV	A*V80704B**	24,000	18,000	15.5	12.5	3653955	

See Notes on Page 37.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				ARI #
	COILS / AIR HANDLERS	FURNACES / BLOWERS	TOTAL	SENSIBLE	SEER ¹	EER ²	
DSXC16 0241A* (cont.)	CSCF3036N6B*+TXV	G*VC90704CXA*	24,000	18,000	16.0	13.0	3653961
	CSCF3036N6B*+TXV	G*VC90905DXA*	24,000	18,000	16.0	13.0	3653962
	CSCF3036N6B*+TXV	G*VC950453BXA*	24,000	18,000	15.5	12.5	3653963
	CSCF3036N6B*+TXV	G*VC950704CXA*	24,000	18,000	16.0	13.0	3653964
	CSCF3036N6B*+TXV	A*VC80704BXA*	24,000	18,000	15.5	12.5	3653956
	CSCF3036N6B*+TXV	G*V90704C**	24,000	18,000	16.0	13.0	3653957
	CSCF3642N6C*+TXV	G*VC90905DXA*	24,000	18,000	16.0	13.0	3653972
	CSCF3642N6C*+TXV	G*VC950453BXA*	24,000	18,000	16.0	13.0	3653973
	CSCF3642N6C*+TXV	G*VC950704CXA*	24,000	18,000	16.0	13.0	3653974
	CSCF3642N6C*+TXV	G*V950453B**	24,000	18,000	16.0	13.0	3653969
	CSCF3642N6C*+TXV	G*V950704C**	24,000	18,000	16.0	13.0	3653970
	CSCF3642N6C*+TXV	G*VC90704CXA*	24,000	18,000	16.0	13.0	3653971
	CSCF3642N6C*+TXV	G*V90905D**	24,000	18,000	16.0	13.0	3653968
	CSCF3642N6C*+TXV	A*V80704B**	24,000	18,000	16.0	13.0	3653965
	CSCF3642N6C*+TXV	A*VC80704BXA*	24,000	18,000	16.0	13.0	3653966
	CSCF3642N6C*+TXV	G*V90704C**	24,000	18,000	16.0	13.0	3653967
DSXC16 0361A*	AEPF313716A*+TXV		35,000	24,900	16.0	12.8	3653975
	AEPF426016C*+TXV		36,000	25,600	16.0	12.8	3653976
	CA*F3642*6C*+TXV	MBE1600**-1B*	34,000	24,100	15.5	12.0	3653977
	CA*F3642*6C*+TXV	MBVC1600**-1A*	34,000	24,100	15.5	12.0	3653978
	CA*F3642*6C*+TXV	A*V80704B**	34,000	24,100	15.5	12.0	3653979
	CA*F3642*6C*+TXV	G*VC90905DXA*	34,600	24,600	15.5	12.0	3653986
	CA*F3642*6C*+TXV	G*VC950704CXA*	34,600	24,600	16.0	12.3	3653987
	CA*F3642*6C*+TXV	G*V90704C**	34,600	24,600	15.5	12.0	3653981
	CA*F3642*6C*+TXV	G*V90905D**	34,600	24,600	15.5	12.0	3653982
	CA*F3642*6C*+TXV	G*VC951155DXA*	34,600	24,600	16.0	12.3	3653988
	CA*F3642*6C*+TXV	A*VC80704BXA*	34,000	24,100	15.5	12.0	3653980
	CA*F3642*6C*+TXV	G*V950704C**	34,600	24,600	16.0	12.3	3653983
	CA*F3642*6C*+TXV	G*V951155D**	34,600	24,600	16.0	12.3	3653984
	CA*F3642*6C*+TXV	G*VC90704CXA*	34,600	24,600	15.5	12.0	3653985
	CA*F3743*6A*+TXV	MBE1600**-1B*	35,000	24,900	16.0	12.5	3653989
	CA*F3743*6A*+TXV	MBVC1600**-1A*	35,000	24,900	16.0	12.5	3653990
	CA*F3743*6A*+TXV	A*V80704B**	34,000	24,100	16.0	12.5	3653991
	CA*F3743*6A*+TXV	A*VC80704BXA*	34,000	24,100	16.0	12.5	3653992
	CA*F3743*6A*+TXV	G*V90704C**	34,600	24,600	15.5	12.2	3653993
	CA*F3743*6A*+TXV	G*V90905D**	34,600	24,600	15.5	12.2	3653994
	CA*F3743*6A*+TXV	G*V91155D**	34,600	24,600	15.5	12.2	3653995
	CA*F3743*6A*+TXV	G*V950453B**	34,000	24,100	16.0	12.5	3653996
	CA*F3743*6A*+TXV	G*VC950704CXA*	34,600	24,600	16.0	12.5	3654004
	CA*F3743*6A*+TXV	G*VC950905DXA*	34,600	24,600	16.0	12.5	3654005
	CA*F3743*6A*+TXV	G*VC951155DXA*	34,600	24,600	16.0	12.5	3654006
	CA*F3743*6A*+TXV	G*V951155D**	34,600	24,600	16.0	12.5	3653999
CA*F3743*6A*+TXV	G*VC90704CXA*	34,600	24,600	15.5	12.2	3654000	
CA*F3743*6A*+TXV	G*VC950453BXA*	34,000	24,100	16.0	12.5	3654003	
CA*F3743*6A*+TXV	G*VC90905DXA*	34,600	24,600	15.5	12.2	3654001	

See Notes on Page 37.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				ARI #
	COILS / AIR HANDLERS	FURNACES / BLOWERS	TOTAL	SENSIBLE	SEER ¹	EER ²	
DSXC16 0361A* (cont.)	CA*F3743*6A*+TXV	G*VC91155DXA*	34,600	24,600	15.5	12.2	3654002
	CA*F3743*6A*+TXV	G*V950704C**	34,600	24,600	16.0	12.5	3653997
	CA*F3743*6A*+TXV	G*V950905D**	34,600	24,600	16.0	12.5	3653998
	CA*F4860*6B*+TXV	G*VC951155DXA*	34,600	24,600	16.0	12.5	3654022
	CA*F4860*6B*+TXV	G*V90704C**	35,000	24,900	16.0	12.5	3654009
	CA*F4860*6B*+TXV	G*V90905D**	35,000	24,900	16.0	12.5	3654010
	CA*F4860*6B*+TXV	A*V80704B**	34,600	24,600	16.0	12.5	3654007
	CA*F4860*6B*+TXV	A*VC80704BXA*	34,600	24,600	16.0	12.5	3654008
	CA*F4860*6B*+TXV	G*VC950905DXA*	35,000	24,900	16.0	12.5	3654021
	CA*F4860*6B*+TXV	G*V951155D**	34,600	24,600	16.0	12.5	3654015
	CA*F4860*6B*+TXV	G*VC90704CXA*	35,000	24,900	16.0	12.5	3654016
	CA*F4860*6B*+TXV	G*VC90905DXA*	35,000	24,900	16.0	12.5	3654017
	CA*F4860*6B*+TXV	G*VC91155DXA*	35,000	24,900	15.5	12.2	3654018
	CA*F4860*6B*+TXV	G*V91155D**	35,000	24,900	15.5	12.2	3654011
	CA*F4860*6B*+TXV	G*V950453B**	34,600	24,600	16.0	12.5	3654012
	CA*F4860*6B*+TXV	G*V950704C**	35,000	24,900	16.0	12.5	3654013
	CA*F4860*6B*+TXV	G*V950905D**	35,000	24,900	16.0	12.5	3654014
	CA*F4860*6B*+TXV	G*VC950453BXA*	34,600	24,600	16.0	12.5	3654019
	CA*F4860*6B*+TXV	G*VC950704CXA*	35,000	24,900	16.0	12.5	3654020
	CHPF3642C6C*+TXV	MBE1600**-1B*	34,600	24,600	16.0	12.5	3654023
	CHPF3642C6C*+TXV	MBVC1600**-1A*	34,600	24,600	16.0	12.5	3654024
	CHPF3642C6C*+TXV	G*VC951155DXA*	34,600	24,600	16.0	12.5	3654034
	CHPF3642C6C*+TXV	A*V80704B**	34,000	24,100	15.5	12.0	3654025
	CHPF3642C6C*+TXV	A*VC80704BXA*	34,000	24,100	15.5	12.0	3654026
	CHPF3642C6C*+TXV	G*V950453B**	34,000	24,100	15.5	12.0	3654027
	CHPF3642C6C*+TXV	G*V950704C**	34,600	24,600	16.0	12.0	3654028
	CHPF3642C6C*+TXV	G*V950905D**	34,600	24,600	16.0	12.5	3654029
	CHPF3642C6C*+TXV	G*V951155D**	34,600	24,600	16.0	12.5	3654030
	CHPF3642C6C*+TXV	G*VC950453BXA*	34,000	24,100	15.5	12.0	3654031
	CHPF3642C6C*+TXV	G*VC950704CXA*	34,600	24,600	16.0	12.0	3654032
	CHPF3642C6C*+TXV	G*VC950905DXA*	34,600	24,600	16.0	12.5	3654033
	CHPF3642D6C*+TXV	MBE2000**-1B*	35,000	24,900	16.0	12.8	3654035
	CHPF3642D6C*+TXV	MBVC2000**-1A*	35,000	24,900	16.0	12.8	3654036
	CHPF3642D6C*+TXV	G*V950905D**	34,600	24,600	16.0	12.5	3654037
	CHPF3642D6C*+TXV	G*V951155D**	34,600	24,600	16.0	12.5	3654038
	CHPF3642D6C*+TXV	G*VC950905DXA*	34,600	24,600	16.0	12.5	3654039
	CHPF3642D6C*+TXV	G*VC951155DXA*	34,600	24,600	16.0	12.5	3654040
	CHPF3743C6B*+TXV	MBE1600**-1B*	34,600	24,600	16.0	12.5	3654041
	CHPF3743C6B*+TXV	MBVC1600**-1A*	34,600	24,600	16.0	12.5	3654042
	CHPF3743C6B*+TXV	A*V80704B**	34,000	24,100	15.5	12.0	3654043
CHPF3743C6B*+TXV	A*VC80704BXA*	34,000	24,100	15.5	12.0	3654044	
CHPF3743C6B*+TXV	G*V90905D**	34,600	24,600	16.0	12.5	3654045	
CHPF3743C6B*+TXV	G*V950453B**	34,000	24,100	16.0	12.5	3654046	
CHPF3743C6B*+TXV	G*V950704C**	34,600	24,600	16.0	12.0	3654047	
CHPF3743C6B*+TXV	G*V950905D**	34,600	24,600	16.0	12.5	3654048	
CHPF3743C6B*+TXV	G*V951155D**	34,600	24,600	16.0	12.5	3654049	
CHPF3743C6B*+TXV	G*VC90905DXA*	34,600	24,600	16.0	12.5	3654050	
CHPF3743C6B*+TXV	G*VC950905DXA*	34,600	24,600	16.0	12.5	3654053	

See Notes on Page 37.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				ARI #
	COILS / AIR HANDLERS	FURNACES / BLOWERS	TOTAL	SENSIBLE	SEER ¹	EER ²	
DSXC16 0361A* (cont.)	CHPF3743C6B*+TXV	G*VC951155DXA*	34,600	24,600	16.0	12.5	3654054
	CHPF3743C6B*+TXV	G*VC950453BXA*	34,000	24,100	16.0	12.5	3654051
	CHPF3743C6B*+TXV	G*VC950704CXA*	34,600	24,600	16.0	12.0	3654052
	CHPF3743D6B*+TXV	MBE2000** -1B*	35,000	24,900	16.0	12.8	3654055
	CHPF3743D6B*+TXV	MBVC2000** -1A*	35,000	24,900	16.0	12.8	3654056
	CHPF3743D6B*+TXV	A*V80704B**	34,000	24,100	16.0	12.5	3654057
	CHPF3743D6B*+TXV	G*V951155D**	34,600	24,600	16.0	12.5	3654062
	CHPF3743D6B*+TXV	G*VC950453BXA*	34,000	24,100	16.0	12.5	3654063
	CHPF3743D6B*+TXV	G*VC950704CXA*	34,000	24,100	16.0	12.5	3654064
	CHPF3743D6B*+TXV	A*VC80704BXA*	34,000	24,100	16.0	12.5	3654058
	CHPF3743D6B*+TXV	G*V950453B**	34,000	24,100	16.0	12.5	3654059
	CHPF3743D6B*+TXV	G*V950704C**	34,000	24,100	16.0	12.5	3654060
	CHPF3743D6B*+TXV	G*V950905D**	34,600	24,600	16.0	12.5	3654061
	CHPF3743D6B*+TXV	G*VC950905DXA*	34,600	24,600	16.0	12.5	3654065
	CHPF3743D6B*+TXV	G*VC951155DXA*	34,600	24,600	16.0	12.5	3654066
	CHPF4860D6D*+TXV	G*VC950453BXA*	34,600	24,600	16.0	12.5	3654073
	CHPF4860D6D*+TXV	G*VC950704CXA*	35,000	24,900	16.0	12.5	3654074
	CHPF4860D6D*+TXV	A*V80704B**	34,600	24,600	16.0	12.5	3654067
	CHPF4860D6D*+TXV	G*V951155D**	35,000	24,900	16.0	12.5	3654072
	CHPF4860D6D*+TXV	G*VC951155DXA*	35,000	24,900	16.0	12.5	3654076
	CHPF4860D6D*+TXV	G*VC950905DXA*	35,000	24,900	16.0	12.5	3654075
	CHPF4860D6D*+TXV	G*V950905D**	35,000	24,900	16.0	12.5	3654071
	CHPF4860D6D*+TXV	A*VC80704BXA*	34,600	24,600	16.0	12.5	3654068
	CHPF4860D6D*+TXV	G*V950453B**	34,600	24,600	16.0	12.5	3654069
	CHPF4860D6D*+TXV	G*V950704C**	35,000	24,900	16.0	12.5	3654070
	CHTF3743C6A*+TXV	MBE1600** -1B*	34,600	24,600	16.0	12.5	3654077
	CHTF3743C6A*+TXV	MBVC1600** -1A*	34,600	24,600	16.0	12.5	3654078
	CSCF3642N6C*+TXV	A*V80704B**	34,000	24,100	16.0	12.5	3654079
	CSCF3642N6C*+TXV	A*V80905C**	34,000	24,100	16.0	12.3	3654080
	CSCF3642N6C*+TXV	A*VC80704BXA*	34,000	24,100	16.0	12.5	3654081
	CSCF3642N6C*+TXV	A*VC80905CXA*	34,000	24,100	16.0	12.3	3654082
	CSCF3642N6C*+TXV	G*V950453B**	34,000	24,100	16.0	12.5	3654083
	CSCF3642N6C*+TXV	G*VC950453BXA*	34,000	24,100	16.0	12.5	3654084
	CSCF4860N6C*+TXV	A*V80704B**	35,000	24,900	16.0	12.5	3654085
	CSCF4860N6C*+TXV	G*V951155D**	35,000	24,900	16.0	12.5	3654090
	CSCF4860N6C*+TXV	A*VC80704BXA*	35,000	24,900	16.0	12.5	3654086
	CSCF4860N6C*+TXV	G*V950453B**	35,000	24,900	16.0	12.5	3654087
	CSCF4860N6C*+TXV	G*V950704C**	35,000	24,900	16.0	12.5	3654088
	CSCF4860N6C*+TXV	G*V950905D**	35,000	24,900	16.0	12.5	3654089
	CSCF4860N6C*+TXV	G*VC950704CXA*	35,000	24,900	16.0	12.5	3654092
CSCF4860N6C*+TXV	G*VC950905DXA*	35,000	24,900	16.0	12.5	3654093	
CSCF4860N6C*+TXV	G*VC950453BXA*	35,000	24,900	16.0	12.5	3654091	
CSCF4860N6C*+TXV	G*VC951155DXA*	35,000	24,900	16.0	12.5	3654094	
CT*F3636*6A*+TXV	MBE1600** -1B*	34,600	24,600	16.0	12.5	3654095	
CT*F3636*6A*+TXV	MBVC1600** -1A*	34,600	24,600	16.0	12.5	3654096	
CT*F3642*6A*+TXV	MBE1600** -1B*	34,600	24,600	16.0	12.5	3654097	
CT*F3642*6A*+TXV	MBVC1600** -1A*	34,600	24,600	16.0	12.5	3654098	

See Notes on Page 37.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				ARI #
	COILS / AIR HANDLERS	FURNACES / BLOWERS	TOTAL	SENSIBLE	SEER ¹	EER ²	
DSXC16 0481A*	AEPF426016C*+TXV		46,000	35,000	15.5	12.0	3654099
	CA*F4860*6B*+TXV	MBE1600** -1B*	46,000	35,000	15.0	12.0	3654100
	CA*F4860*6B*+TXV	MBE2000** -1B*	47,000	35,700	16.0	12.5	3654101
	CA*F4860*6B*+TXV	MBVC1600** -1A*	46,000	35,000	15.0	12.0	3654102
	CA*F4860*6B*+TXV	MBVC2000** -1A*	47,000	35,700	16.0	12.5	3654103
	CA*F4860*6B*+TXV	A*V80704B**	45,500	34,600	15.0	12.0	3654104
	CA*F4860*6B*+TXV	G*VC950905DXA*	47,000	35,700	16.0	12.3	3654113
	CA*F4860*6B*+TXV	G*VC951155DXA*	47,000	35,700	16.0	12.3	3654114
	CA*F4860*6B*+TXV	G*V90905D**	45,500	34,600	15.0	11.5	3654107
	CA*F4860*6B*+TXV	G*V91155D**	45,500	34,600	15.5	11.5	3654108
	CA*F4860*6B*+TXV	G*V950905D**	47,000	35,700	16.0	12.3	3654109
	CA*F4860*6B*+TXV	A*V80905C**	47,000	35,700	16.0	12.3	3654105
	CA*F4860*6B*+TXV	A*VC80905CXA*	47,000	35,700	16.0	12.3	3654106
	CA*F4860*6B*+TXV	G*VC90905DXA*	45,500	34,600	15.0	11.5	3654111
	CA*F4860*6B*+TXV	G*VC91155DXA*	45,500	34,600	15.5	11.5	3654112
	CA*F4860*6B*+TXV	G*V951155D**	47,000	35,700	16.0	12.3	3654110
	CA*F4961*6A*+TXV	MBE1600** -1B*	46,000	35,000	15.0	12.0	3654115
	CA*F4961*6A*+TXV	MBE2000** -1B*	47,000	35,700	16.0	12.5	3654116
	CA*F4961*6A*+TXV	MBVC1600** -1A*	46,000	35,000	15.0	12.0	3654117
	CA*F4961*6A*+TXV	MBVC2000** -1A*	47,000	35,700	16.0	12.5	3654118
	CA*F4961*6A*+TXV	G*VC91155DXA*	45,500	34,600	15.5	12.0	3654127
	CA*F4961*6A*+TXV	G*VC950704CXA*	46,500	35,300	15.0	12.0	3654128
	CA*F4961*6A*+TXV	A*V80704B**	46,000	35,000	15.5	12.2	3654119
	CA*F4961*6A*+TXV	G*V90704C**	45,500	34,600	15.0	11.5	3654120
	CA*F4961*6A*+TXV	G*V90905D**	45,500	34,600	15.5	12.0	3654121
	CA*F4961*6A*+TXV	G*V91155D**	45,500	34,600	15.5	12.0	3654122
	CA*F4961*6A*+TXV	G*VC90905DXA*	45,500	34,600	15.5	12.0	3654126
	CA*F4961*6A*+TXV	G*VC950905DXA*	47,000	35,700	16.0	12.5	3654129
	CA*F4961*6A*+TXV	G*VC951155DXA*	47,000	35,700	16.0	12.5	3654130
	CA*F4961*6A*+TXV	G*V950704C**	46,500	35,300	15.0	12.0	3654123
	CA*F4961*6A*+TXV	G*V950905D**	47,000	35,700	16.0	12.5	3654124
	CA*F4961*6A*+TXV	G*V951155D**	47,000	35,700	16.0	12.5	3654125
	CHPF4860D6D*+TXV	MBE1600** -1B*	46,000	35,000	15.0	12.0	3654131
	CHPF4860D6D*+TXV	MBE2000** -1B*	47,000	35,700	16.0	12.5	3654132
	CHPF4860D6D*+TXV	MBVC1600** -1A*	46,000	35,000	15.0	12.0	3654133
	CHPF4860D6D*+TXV	MBVC2000** -1A*	47,000	35,700	16.0	12.5	3654134
	CHPF4860D6D*+TXV	A*V80704B**	45,500	34,600	15.5	12.0	3654135
	CHPF4860D6D*+TXV	A*V80905C**	45,500	34,600	15.5	12.0	3654136
	CHPF4860D6D*+TXV	A*VC80905CXA*	45,500	34,600	15.5	12.0	3654137
	CHPF4860D6D*+TXV	G*V950704C**	46,000	35,000	15.5	12.0	3654138
	CHPF4860D6D*+TXV	G*V950905D**	47,000	35,700	16.0	12.3	3654139
	CHPF4860D6D*+TXV	G*V951155D**	47,000	35,700	16.0	12.3	3654140
	CHPF4860D6D*+TXV	G*VC950704CXA*	46,000	35,000	15.5	12.0	3654141
	CHPF4860D6D*+TXV	G*VC950905DXA*	47,000	35,700	16.0	12.3	3654142
	CHPF4860D6D*+TXV	G*VC951155DXA*	47,000	35,700	16.0	12.3	3654143

See Notes on Page 37.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				ARI #
	COILS / AIR HANDLERS	FURNACES / BLOWERS	TOTAL	SENSIBLE	SEER ¹	EER ²	
DSXC16 0481A* (cont.)	CHTF4860D6A*+TXV	MBE2000**-1B*	47,000	35,700	16.0	12.5	3654144
	CHTF4860D6A*+TXV	MBVC2000**-1A*	47,000	35,700	16.0	12.5	3654145
	CSCF4860N6C*+TXV	A*V80704B**	45,500	34,600	15.5	12.0	3654146
	CSCF4860N6C*+TXV	G*VC950704CXA*	45,500	34,600	15.0	12.0	3654150
	CSCF4860N6C*+TXV	G*VC950905DXA*	46,000	35,000	16.0	12.5	3654151
	CSCF4860N6C*+TXV	G*VC951155DXA*	46,000	35,000	16.0	12.5	3654152
	CSCF4860N6C*+TXV	G*V950704C**	45,500	34,600	15.0	12.0	3654147
	CSCF4860N6C*+TXV	G*V950905D**	46,000	35,000	16.0	12.5	3654148
	CSCF4860N6C*+TXV	G*V951155D**	46,000	35,000	16.0	12.5	3654149
	CT*F4860*6A*+TXV	MBE2000**-1B*	47,000	35,700	16.0	12.5	3654153
	CT*F4860*6A*+TXV	MBVC2000**-1A*	47,000	35,700	16.0	12.5	3654154
	DSXC16 0481B*	AEPF426016C*+TXV		46,000	34,000	15.5	12.0
CA*F4860*6B*+TXV		MBVC1600**-1A*	46,000	34,000	15.0	12.0	4172453
CA*F4860*6B*+TXV		MBVC2000**-1A*	47,000	34,800	16.0	12.5	4172454
CA*F4860*6B*+TXV		A*VC950905DXA*	46,000	34,000	16.0	12.3	4172460
CA*F4860*6B*+TXV		A*VC80905CXA*	46,000	34,000	16.0	12.3	4172455
CA*F4860*6B*+TXV		A*VC90905DXA*	46,000	34,000	16.0	12.3	4172458
CA*F4860*6B*+TXV		G*VC80905CXA*	46,000	34,000	16.0	12.3	4172463
CA*F4860*6B*+TXV		G*VC90704CXA*	45,500	33,700	15.0	12.0	4172465
CA*F4860*6B*+TXV		A*VC90704CXA*	45,500	33,700	15.0	12.0	4172457
CA*F4860*6B*+TXV		G*VC91155DXA*	45,500	33,700	15.5	11.5	4172467
CA*F4860*6B*+TXV		A*VC81155CXA*	46,000	34,000	16.0	12.0	4172456
CA*F4860*6B*+TXV		A*VC951155DXA*	46,000	34,000	16.0	12.5	4172461
CA*F4860*6B*+TXV		G*VC80704BXA*	45,500	33,700	15.0	12.0	4172462
CA*F4860*6B*+TXV		G*VC950905DXA*	46,000	34,000	16.0	12.3	4172469
CA*F4860*6B*+TXV		A*VC950704CXA*	45,500	33,700	15.0	12.0	4172459
CA*F4860*6B*+TXV		G*VC90905DXA*	45,500	33,700	15.0	11.5	4172466
CA*F4860*6B*+TXV		G*VC951155DXA*	46,000	34,000	16.0	12.3	4172470
CA*F4860*6B*+TXV		G*VC81155CXA*	46,000	34,000	16.0	12.0	4172464
CA*F4860*6B*+TXV		G*VC950704CXA*	45,500	33,700	15.0	12.0	4172468
CA*F4860*6D*+TXV		A*VC90704CXA*	45,500	33,700	15.0	12.0	4172474
CA*F4860*6D*+TXV		G*VC81155CXA*	46,000	34,000	16.0	12.0	4172481
CA*F4860*6D*+TXV		G*VC80905CXA*	46,000	34,000	16.0	12.3	4172480
CA*F4860*6D*+TXV		G*VC90704CXA*	45,500	33,700	15.0	12.0	4172482
CA*F4860*6D*+TXV		A*VC81155CXA*	46,000	34,000	16.0	12.0	4172473
CA*F4860*6D*+TXV		G*VC80704BXA*	45,500	33,700	15.0	12.0	4172479
CA*F4860*6D*+TXV		A*VC80905CXA*	46,000	34,000	16.0	12.3	4172472
CA*F4860*6D*+TXV		A*VC950905DXA*	46,000	34,000	16.0	12.3	4172477
CA*F4860*6D*+TXV		A*VC951155DXA*	46,000	34,000	16.0	12.5	4172478
CA*F4860*6D*+TXV		G*VC90905DXA*	45,500	33,700	15.0	11.5	4172483
CA*F4860*6D*+TXV		A*VC90905DXA*	46,000	34,000	16.0	12.3	4172475
CA*F4860*6D*+TXV		A*VC950704CXA*	45,500	33,700	15.0	12.0	4172476
CA*F4860*6D*+TXV		G*VC91155DXA*	45,500	33,700	15.5	11.5	4172484
CA*F4860*6D*+TXV	G*VC950704CXA*	45,500	33,700	15.0	12.0	4172485	
CA*F4860*6D*+TXV	A*VC80704BXA*	45,500	33,700	15.0	12.0	4172471	

See Notes on Page 37.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				ARI #
	COILS / AIR HANDLERS	FURNACES / BLOWERS	TOTAL	SENSIBLE	SEER ¹	EER ²	
DSXC16 0481B* (cont.)	CA*F4860*6D*+TXV	G*VC950905DXA*	46,000	34,000	16.0	12.3	4172486
	CA*F4860*6D*+TXV	G*VC951155DXA*	46,000	34,000	16.0	12.3	4172487
	CA*F4961*6A*+TXV	MBVC1600** -1A*	46,000	34,000	15.0	12.0	4172488
	CA*F4961*6A*+TXV	MBVC2000** -1A*	47,000	34,800	16.0	12.5	4172489
	CA*F4961*6A*+TXV	A*VC81155CXA*	46,500	34,400	16.0	12.0	4172492
	CA*F4961*6A*+TXV	G*VC80704BXA*	46,000	34,000	15.5	12.3	4172498
	CA*F4961*6A*+TXV	G*VC90704CXA*	46,500	34,400	15.0	12.0	4172501
	CA*F4961*6A*+TXV	G*VC90905DXA*	45,500	33,700	15.5	12.0	4172502
	CA*F4961*6A*+TXV	A*VC90704CXA*	46,500	34,400	15.0	12.0	4172493
	CA*F4961*6A*+TXV	G*VC80905CXA*	47,000	34,800	16.0	12.5	4172499
	CA*F4961*6A*+TXV	G*VC91155DXA*	45,500	33,700	15.5	12.0	4172503
	CA*F4961*6A*+TXV	G*VC950704CXA*	46,500	34,400	15.0	12.0	4172504
	CA*F4961*6A*+TXV	G*VC81155CXA*	46,500	34,400	16.0	12.0	4172500
	CA*F4961*6A*+TXV	A*VC80905CXA*	47,000	34,800	16.0	12.5	4172491
	CA*F4961*6A*+TXV	A*VC90905DXA*	47,000	34,800	16.0	12.5	4172494
	CA*F4961*6A*+TXV	A*VC951155DXA*	47,000	34,800	16.0	12.5	4172497
	CA*F4961*6A*+TXV	G*VC950905DXA*	47,000	34,800	16.0	12.5	4172505
	CA*F4961*6A*+TXV	G*VC951155DXA*	47,000	34,800	16.0	12.5	4172506
	CA*F4961*6A*+TXV	A*VC950704CXA*	46,500	34,400	15.0	12.0	4172495
	CA*F4961*6A*+TXV	A*VC80704BXA*	46,000	34,000	15.5	12.3	4172490
	CA*F4961*6A*+TXV	A*VC950905DXA*	47,000	34,800	16.0	12.5	4172496
	CHPF4860D6D*+TXV	MBVC1600** -1A*	46,000	34,000	15.0	12.0	4172507
	CHPF4860D6D*+TXV	MBVC2000** -1A*	47,000	34,800	16.0	12.5	4172508
	CHPF4860D6D*+TXV	G*VC950905DXA*	47,000	34,800	16.0	12.3	4172519
	CHPF4860D6D*+TXV	A*VC951155DXA*	47,000	34,800	16.0	12.3	4172516
	CHPF4860D6D*+TXV	G*VC80905CXA*	45,500	33,700	15.5	12.0	4172517
	CHPF4860D6D*+TXV	G*VC950704CXA*	46,000	34,000	15.5	12.0	4172518
	CHPF4860D6D*+TXV	A*VC80704BXA*	45,500	33,700	15.5	12.0	4172509
	CHPF4860D6D*+TXV	A*VC90704CXA*	46,000	34,000	15.5	12.0	4172512
	CHPF4860D6D*+TXV	A*VC80905CXA*	45,500	33,700	15.5	12.0	4172510
	CHPF4860D6D*+TXV	G*VC951155DXA*	47,000	34,800	16.0	12.3	4172520
	CHPF4860D6D*+TXV	A*VC950704CXA*	46,000	34,000	15.5	12.0	4172514
CHPF4860D6D*+TXV	A*VC81155CXA*	45,500	33,700	15.5	12.0	4172511	
CHPF4860D6D*+TXV	A*VC950905DXA*	47,000	34,800	16.0	12.3	4172515	
CHPF4860D6D*+TXV	A*VC90905DXA*	47,000	34,800	16.0	12.3	4172513	
CSCF4860N6C*+TXV	G*VC950704CXA*	45,500	33,700	15.0	12.0	4172521	
CSCF4860N6C*+TXV	G*VC951155DXA*	46,000	34,000	16.0	12.5	4172523	
CSCF4860N6C*+TXV	G*VC950905DXA*	46,000	34,000	16.0	12.5	4172522	
DSXC16 0601A*	AEPF426016C*+TXV		57,000	43,300	15.5	11.5	3654155
	CA*F4860*6B*+TXV	MBE2000** -1B*	57,000	43,300	16.0	12.0	3654156
	CA*F4860*6B*+TXV	MBVC2000** -1A*	57,000	43,300	16.0	12.0	3654157
	CA*F4860*6B*+TXV	G*V90905D**	56,500	42,900	15.0	11.5	3654158
	CA*F4860*6B*+TXV	G*V91155D**	57,000	43,300	15.0	11.5	3654159
	CA*F4860*6B*+TXV	G*V950905D**	57,500	43,700	15.5	11.5	3654160
	CA*F4860*6B*+TXV	G*V951155D**	57,500	43,700	15.5	11.5	3654161

See Notes on Page 37.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				ARI #
	COILS / AIR HANDLERS	FURNACES / BLOWERS	TOTAL	SENSIBLE	SEER ¹	EER ²	
DSXC16 0601A* (cont.)	CA*F4860*6B*+TXV	G*VC90905DXA*	56,500	42,900	15.0	11.5	3654162
	CA*F4860*6B*+TXV	G*VC91155DXA*	57,000	43,300	15.0	11.5	3654163
	CA*F4860*6B*+TXV	G*VC950905DXA*	57,500	43,700	15.5	11.5	3654164
	CA*F4860*6B*+TXV	G*VC951155DXA*	57,500	43,700	15.5	11.5	3654165
	CA*F4961*6A*+TXV	MBE2000** -1B*	57,000	43,300	16.0	12.0	3654166
	CA*F4961*6A*+TXV	MBVC2000** -1A*	57,000	43,300	16.0	12.0	3654167
	CA*F4961*6A*+TXV	G*V951155D**	57,500	43,700	15.5	11.5	3654171
	CA*F4961*6A*+TXV	G*VC90905DXA*	56,500	42,900	15.5	11.5	3654172
	CA*F4961*6A*+TXV	G*VC951155DXA*	57,500	43,700	15.5	11.5	3654175
	CA*F4961*6A*+TXV	G*VC91155DXA*	57,000	43,300	15.0	11.5	3654173
	CA*F4961*6A*+TXV	G*VC950905DXA*	57,500	43,700	15.5	11.5	3654174
	CA*F4961*6A*+TXV	G*V90905D**	56,500	42,900	15.5	11.5	3654168
	CA*F4961*6A*+TXV	G*V91155D**	57,000	43,300	15.0	11.5	3654169
	CA*F4961*6A*+TXV	G*V950905D**	57,500	43,700	15.5	11.5	3654170
	CHPF4860D6D*+TXV	MBE2000** -1B*	57,000	43,300	16.0	12.0	3654176
	CHPF4860D6D*+TXV	MBVC2000** -1A*	57,000	43,300	16.0	12.0	3654177
	CHPF4860D6D*+TXV	G*V950905D**	57,000	43,300	15.5	12.5	3654178
	CHPF4860D6D*+TXV	G*V951155D**	57,000	43,300	15.5	11.5	3654179
	CHPF4860D6D*+TXV	G*VC950905DXA*	57,000	43,300	15.5	12.5	3654180
	CHPF4860D6D*+TXV	G*VC951155DXA*	57,000	43,300	15.5	11.5	3654181
	CHTF4860D6A*+TXV	MBE2000** -1B*	57,000	43,300	16.0	12.0	3654182
	CHTF4860D6A*+TXV	MBVC2000** -1A*	57,000	43,300	16.0	12.0	3654183
	CSCF4860N6C*+TXV	G*V950905D**	57,000	43,300	15.5	11.5	3654184
	CSCF4860N6C*+TXV	G*V951155D**	57,000	43,300	15.5	11.5	3654185
	CSCF4860N6C*+TXV	G*VC950905DXA*	57,000	43,300	15.5	11.5	3654186
	CSCF4860N6C*+TXV	G*VC951155DXA*	57,000	43,300	15.5	11.5	3654187
	CT*F4860*6A*+TXV	MBE2000** -1B*	57,000	43,300	16.0	12.0	3654188
	CT*F4860*6A*+TXV	MBVC2000** -1A*	57,000	43,300	16.0	12.0	3654189
DSXC16 0601B*	AEPF426016C*+TXV		57,000	42,180	15.5	12.3	3798897
	CA*F4860*6B*+TXV	MBE2000** -1B*	56,000	41,440	15.5	12.3	3798898
	CA*F4860*6B*+TXV	MBVC2000** -1A*	55,500	41,070	15.5	12	3798899
	CA*F4860*6B*+TXV	A*VC90905DXA*	55,500	41,070	15.5	12	3798851
	CA*F4860*6B*+TXV	G*V91155D**	55,500	41,070	15	12	3798872
	CA*F4860*6B*+TXV	G*V951155D**	55,500	41,070	15.5	12	3798878
	CA*F4860*6B*+TXV	G*VC950905DXA*	55,500	41,070	15.5	12	3798889
	CA*F4860*6B*+TXV	G*VC90905DXA*	55,500	41,070	15.5	12	3798884
	CA*F4860*6B*+TXV	A*VC80905CXA*	55,500	41,070	15.5	12	3798843
	CA*F4860*6B*+TXV	A*VC951155DXA*	55,500	41,070	15.5	12	3798859
	CA*F4860*6B*+TXV	A*V90905D**	55,500	41,070	15.5	12	3798835
	CA*F4860*6B*+TXV	A*V91155D**	55,500	41,070	15	12	3798839
	CA*F4860*6B*+TXV	G*V90905D**	55,500	41,070	15.5	12	3798869
	CA*F4860*6B*+TXV	A*VC950905DXA*	55,500	41,070	15.5	12	3798855
	CA*F4860*6B*+TXV	G*VC91155DXA*	55,500	41,070	15.5	12	3798887
	CA*F4860*6B*+TXV	G*VC951155DXA*	55,500	41,070	15.5	12	3798893
	CA*F4860*6B*+TXV	G*V950905D**	55,500	41,070	15.5	12	3798874

See Notes on Page 37.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				ARI #
	COILS / AIR HANDLERS	FURNACES / BLOWERS	TOTAL	SENSIBLE	SEER ¹	EER ²	
DSXC16 0601B* (cont.)	CA*F4860*6B*+TXV	A*V80905C**	55,500	41,070	15.5	12	3798827
	CA*F4860*6B*+TXV	A*V81155C**	55,500	41,070	15.5	12	3798831
	CA*F4860*6B*+TXV	A*VC81155CXA*	55,500	41,070	15.5	12	3798847
	CA*F4961*6A*+TXV	MBE2000**-1B*	57,000	42,180	16	12.3	3798900
	CA*F4961*6A*+TXV	MBVC2000**-1A*	57,000	42,180	16	12.3	3798901
	CA*F4961*6A*+TXV	A*V81155C**	56,000	41,440	15.5	12	3798832
	CA*F4961*6A*+TXV	G*E81155C**	56,000	41,440	15	11.5	3798865
	CA*F4961*6A*+TXV	G*V91155D**	56,000	41,440	15	12	3798873
	CA*F4961*6A*+TXV	G*V950905D**	56,000	41,440	15.5	12.3	3798875
	CA*F4961*6A*+TXV	A*VC951155DXA*	56,000	41,440	15.5	12	3798860
	CA*F4961*6A*+TXV	G*E80905C**	56,000	41,440	15	11.5	3798863
	CA*F4961*6A*+TXV	G*VC950905DXA*	56,000	41,440	15.5	12.3	3798890
	CA*F4961*6A*+TXV	G*VC951155DXA*	56,000	41,440	15.5	12	3798894
	CA*F4961*6A*+TXV	A*VC80905CXA*	56,000	41,440	15.5	12.3	3798844
	CA*F4961*6A*+TXV	A*VC90905DXA*	56,000	41,440	15.5	12.3	3798852
	CA*F4961*6A*+TXV	G*VC90905DXA*	56,000	41,440	15.5	12.3	3798885
	CA*F4961*6A*+TXV	G*VC91155DXA*	56,000	41,440	15.5	12	3798888
	CA*F4961*6A*+TXV	A*V80905C**	56,000	41,440	15.5	12.3	3798828
	CA*F4961*6A*+TXV	A*V91155D**	56,000	41,440	15.5	12	3798840
	CA*F4961*6A*+TXV	G*V90905D**	56,000	41,440	15.5	12.3	3798870
	CA*F4961*6A*+TXV	G*V951155D**	56,000	41,440	15.5	12	3798879
	CA*F4961*6A*+TXV	A*VC81155CXA*	56,000	41,440	15.5	12	3798848
	CA*F4961*6A*+TXV	A*VC950905DXA*	56,000	41,440	15.5	12.3	3798856
	CA*F4961*6A*+TXV	A*V90905D**	56,000	41,440	15.5	12.3	3798836
	CHPF4860D6D*+TXV	MBE2000**-1B*	57,000	42,180	15.5	12.3	3798902
	CHPF4860D6D*+TXV	MBVC2000**-1A*	57,000	42,180	15.5	12.3	3798903
	CHPF4860D6D*+TXV	A*V80905C**	56,000	41,440	15.5	12.3	3798829
	CHPF4860D6D*+TXV	A*V81155C**	56,000	41,440	15.5	12	3798833
	CHPF4860D6D*+TXV	A*VC80905CXA*	56,000	41,440	15.5	12.3	3798845
	CHPF4860D6D*+TXV	G*V90905D**	56,000	41,440	16	12.3	3798871
	CHPF4860D6D*+TXV	G*VC81155CXA*	56,000	41,440	15.5	12	3798883
	CHPF4860D6D*+TXV	G*V951155D**	56,000	41,440	15.5	12	3798880
	CHPF4860D6D*+TXV	A*V91155D**	56,000	41,440	15.5	12	3798841
	CHPF4860D6D*+TXV	G*V81155C**	56,000	41,440	15.5	12	3798868
	CHPF4860D6D*+TXV	G*V950905D**	56,000	41,440	15.5	12.3	3798876
	CHPF4860D6D*+TXV	A*VC81155CXA*	56,000	41,440	15.5	12	3798849
	CHPF4860D6D*+TXV	G*E80905C**	56,000	41,440	15	11.5	3798864
	CHPF4860D6D*+TXV	A*V90905D**	56,000	41,440	15.5	12.3	3798837
	CHPF4860D6D*+TXV	A*VC950905DXA*	56,000	41,440	15.5	12.3	3798857
	CHPF4860D6D*+TXV	A*VC951155DXA*	56,000	41,440	15.5	12	3798861
CHPF4860D6D*+TXV	A*VC90905DXA*	56,000	41,440	15.5	12.3	3798853	
CHPF4860D6D*+TXV	G*E81155C**	56,000	41,440	15	11.5	3798866	
CHPF4860D6D*+TXV	G*V80905C**	56,000	41,440	15.5	12.3	3798867	
CHPF4860D6D*+TXV	G*VC950905DXA*	56,000	41,440	15.5	12.3	3798891	
CHPF4860D6D*+TXV	G*VC90905DXA*	56,000	41,440	15.5	12.3	3798886	

See Notes on Page 37.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				ARI #
	COILS / AIR HANDLERS	FURNACES / BLOWERS	TOTAL	SENSIBLE	SEER ¹	EER ²	
DSXC16 0601B* (cont.)	CHPF4860D6D*+TXV	G*VC80905CXA*	56,000	41,440	15.5	12.3	3798882
	CHPF4860D6D*+TXV	G*VC951155DXA*	56,000	41,440	15.5	12	3798895
	CHTF4860D6A*+TXV	MBE2000** -1B*	57,000	42,180	16	12.3	3798904
	CHTF4860D6A*+TXV	MBVC2000** -1A*	57,000	42,180	16	12.3	3798905
	CSCF4860N6C*+TXV	G*VC951155DXA*	56,000	41,440	15.5	12	3798896
	CSCF4860N6C*+TXV	A*V80905C**	56,000	41,440	15.5	12.3	3798830
	CSCF4860N6C*+TXV	A*VC90905DXA*	56,000	41,440	15.5	12.3	3798854
	CSCF4860N6C*+TXV	A*VC950905DXA*	56,000	41,440	15.5	12.3	3798858
	CSCF4860N6C*+TXV	A*VC80905CXA*	56,000	41,440	15.5	12.3	3798846
	CSCF4860N6C*+TXV	G*V951155D**	56,000	41,440	15.5	12	3798881
	CSCF4860N6C*+TXV	A*V90905D**	56,000	41,440	15.5	12.3	3798838
	CSCF4860N6C*+TXV	A*VC951155DXA*	56,000	41,440	15.5	12	3798862
	CSCF4860N6C*+TXV	A*VC81155CXA*	56,000	41,440	15.5	12	3798850
	CSCF4860N6C*+TXV	A*V81155C**	56,000	41,440	15.5	12	3798834
	CSCF4860N6C*+TXV	A*V91155D**	56,000	41,440	15.5	12	3798842
	CSCF4860N6C*+TXV	G*VC950905DXA*	56,000	41,440	15.5	12.3	3798892
	CSCF4860N6C*+TXV	G*V950905D**	56,000	41,440	15.5	12.3	3798877
	CT*F4860*6A*+TXV	MBE2000** -1B*	57,000	42,180	16	12.3	3798906
	CT*F4860*6A*+TXV	MBVC2000** -1A*	57,000	42,180	16	12.3	3798907


¹ Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

² Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

NOTES:


- Always check the S&R plate for electrical data on the UNIT being installed.
- When matching the outdoor unit to the indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Goodman Gas Furnace contains the EEP cooling time delay

DIMENSIONS

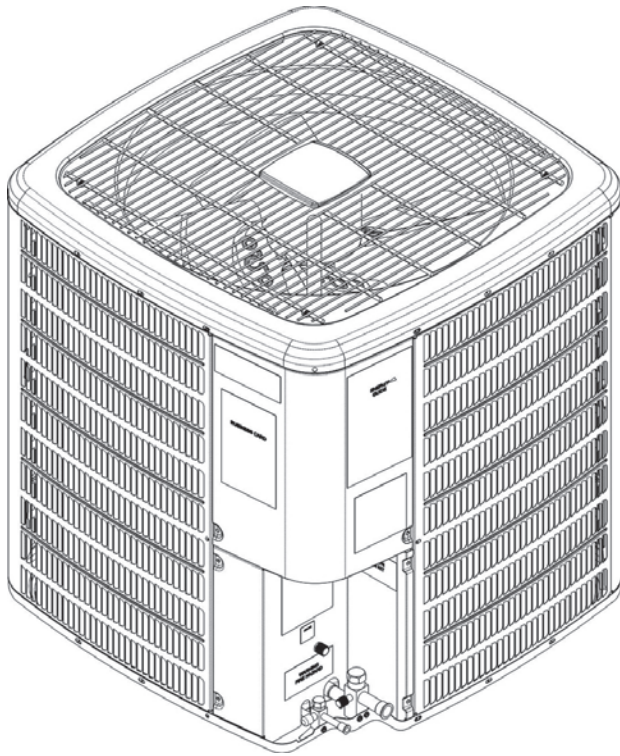

MODEL	DIMENSIONS		
	W"	D"	H"
DSXC160241A	26	26	32¼
DSXC160361A	29	29	38¼
DSXC160481A	35½	35½	38¼
DSXC160481B	35½	35½	36¼
DSXC160601A	35½	35½	38¼
DSXC160601B	35½	35½	38¼

WIRING DIAGRAM

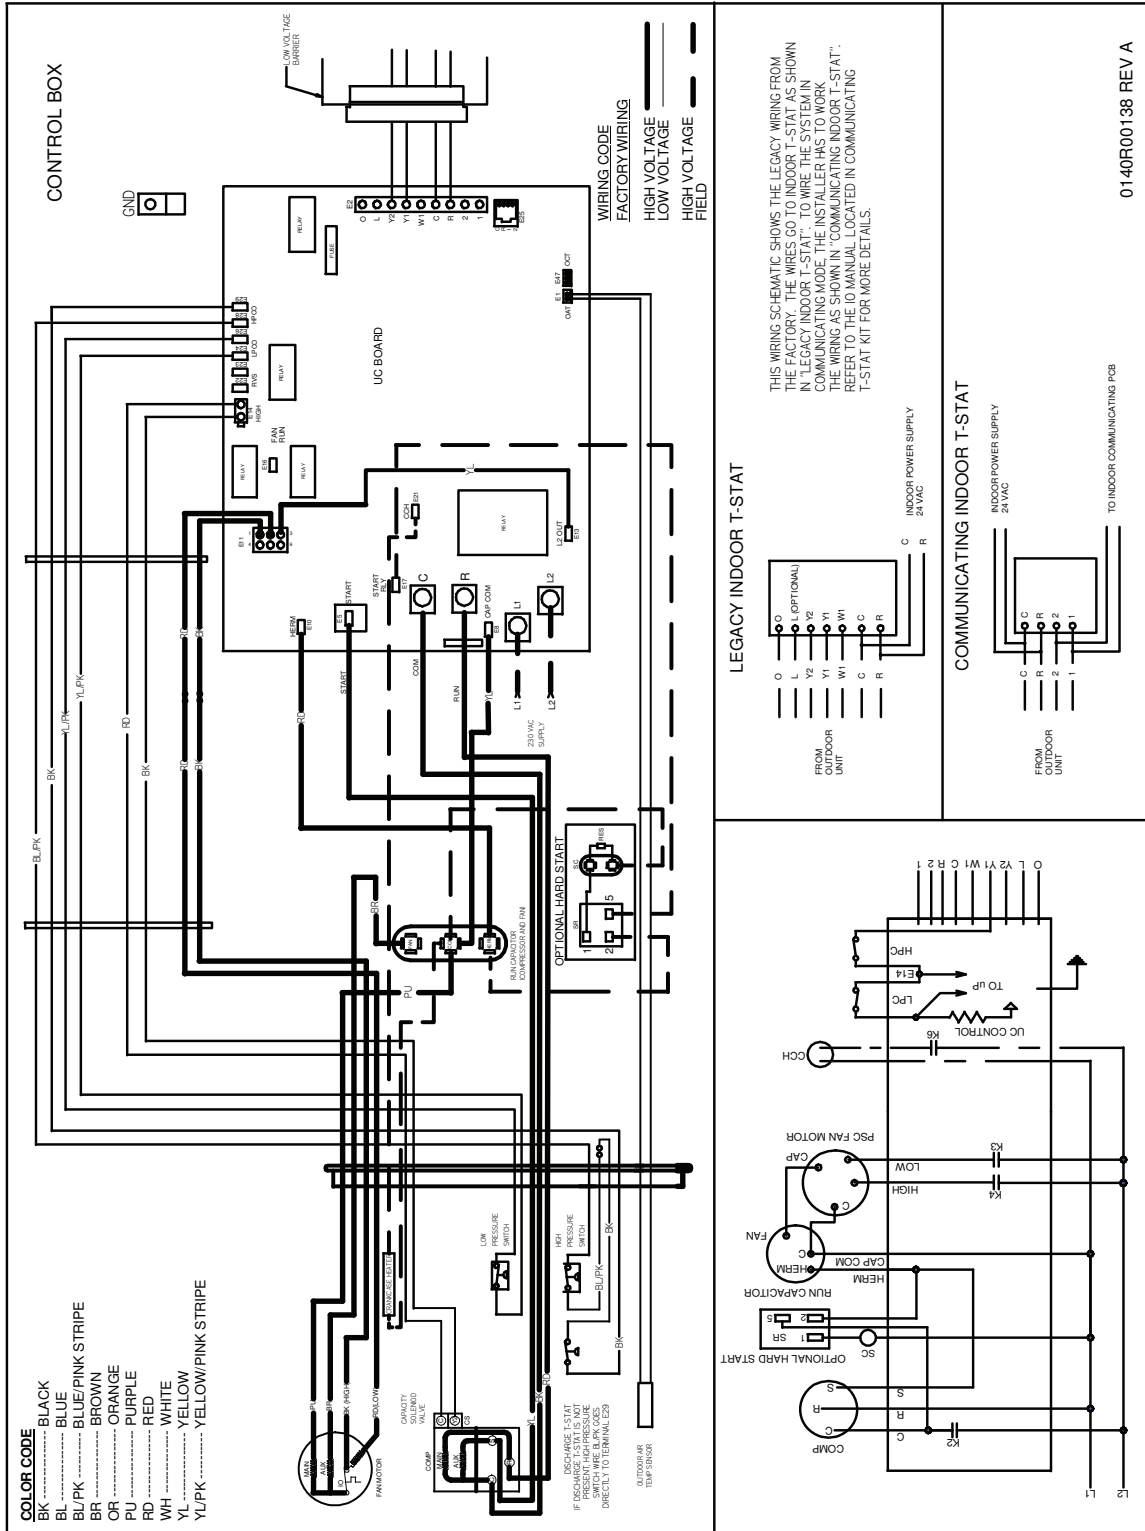

0140R00138 REV A

WARNING
 High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

ACCESSORIES

MODEL	DESCRIPTION	DSXC16 024	DSXC16 036	DSXC16 048	DSXC16 060
ABK-20	Anchor Bracket Kit [^]	X	X	X	X
ASC-01	Anti-Short Cycle Kit	X	X	X	X
B1141643 ¹	24V Transformer	Maximum number installed at the same time is limited. See table below.	Maximum number installed at the same time is limited. See separate table.	X	X
CSR-U-1	Hard-start Kit				
CSR-U-2	Hard-start Kit			X	X
CSR-U-3	Hard-start Kit			X	X
FSK01A ²	Freeze Protection Kit			X	X
LSK02A	Liquid Line Solenoid Valve			X	X
OT18-60A ³	Outdoor Thermostat/Lockout Thermostat			X	X
TX2N4 ⁴	TXV Kit			X	
TX2N4A ⁴	TXV Kit	X			
TX3N4 ⁴	TXV Kit		X		
TX5N4	TXV Kit			X	X

[^] Contains 20 brackets; four brackets needed to anchor unit to pad

¹ This component is included in the CTK01AA communicating thermostat kit.

² Installed on indoor coil

³ Available in 24V legacy mode only. This feature is integrated in the communicating mode.

⁴ Condensing units and heat pumps with reciprocating compressors require the use of startassist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device or liquid line solenoid kit.

MODEL	DESCRIPTION	DSXC16 024	DSXC16 024	DSXC16 024	DSXC16 024	DSXC16 024
B1141643 ¹	24V Transformer			X		X
CSR-U-1	Hard-start Kit	X	X	X		
FSK01A ²	Freeze Protection Kit	X	X	X	X	X
LSK02A	Liquid Line Solenoid Valve	X			X	X
OT18-60A ³	Outdoor Thermostat/Lockout Thermostat		X		X	

MODEL	DESCRIPTION	DSXC16 036	DSXC16 036	DSXC16 036	DSXC16 036	DSXC16 036
B1141643 ¹	24V Transformer					X
CSR-U-1	Hard-start Kit	X	X			
CSR-U-2	Hard-start Kit			X		
FSK01A ²	Freeze Protection Kit	X	X		X	X
LSK02A	Liquid Line Solenoid Valve	X			X	X
OT18-60A ³	Outdoor Thermostat/Lockout Thermostat		X		X	

¹ This component is included in the CTK01AA communicating thermostat kit.

² Installed on indoor coil

³ Available in 24V legacy mode only. This feature is integrated in the communicating mode.

