



INSTRUCTIONS

TWA NO






TWA-A

For Danfoss RA valves





TWA-V

For Danfoss RAV/VMT valves






TWA-L

For Danfoss RAVL valves






TWA-K

For Heimeier/MNG/Oventrop valves with M30 × 1.5 connection, generally as per attached drawing. Other valves must be verified individually to ensure correct valve closing measurement and valve top geometry.




TWA-D

For Danfoss RTD valves

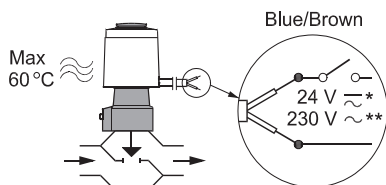

*) 24 V Class II transformer (SELV)

**) 230 V max. 3 A pre-fuse




INSTRUCTIONS

TWA NC




TWA-A

For Danfoss RA valves

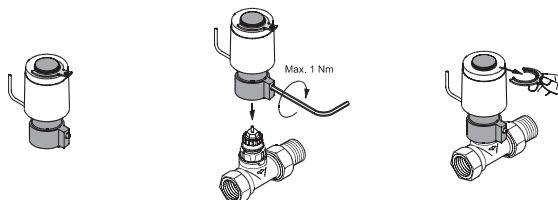


TWA-V

For Danfoss RAV/VMT valves

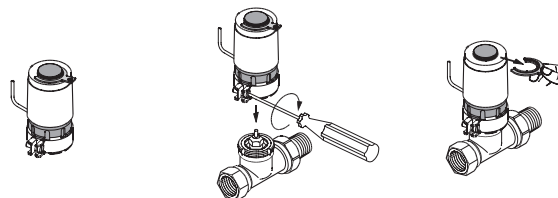


TWA-L

For Danfoss RAVL valves

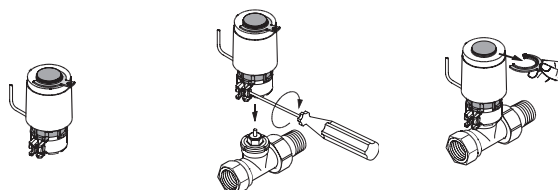



TWA-K

For Heimeier/MNG/Oventrop valves with M30 × 1.5 connection, generally as per attached drawing. Other valves must be verified individually to ensure correct valve closing measurement and valve top geometry.

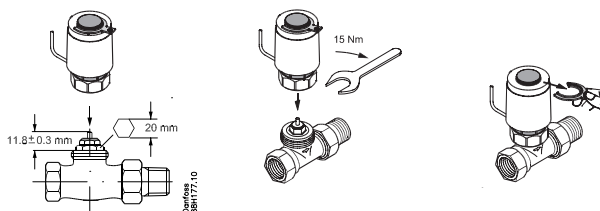

TWA-D

For Danfoss RTD valves

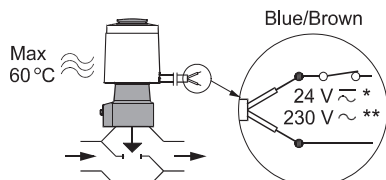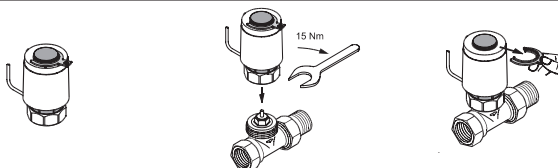

*) 24 V Class II transformer (SELV)

**) 230 V max. 3 A pre-fuse

