



SPECIFICATION SHEET

MODEL 8191 & 8192 VENTILATOR WITH DEHUMIDIFICATION


PRODUCT SPECIFICATIONS AND SIZING SUMMARY		
Model	8191	8192
Nominal Ventilation Airflow (CFM)	100 CFM	200 CFM
Capacity ⁽¹⁾ pints/day	70 ppd	95 ppd
Energy Factor ⁽¹⁾	1.91 L/kW-h	2.2 L/kW-h
Energy Star Qualified	Yes	No
Air flow @ various external static pressure - dry coil		
0.0" w.c.	160 CFM	265 CFM
0.2" w.c.	120 CFM	230 CFM
0.4" w.c.	70 CFM	200 CFM
Voltage, Phase, Frequency	120VAC, 1, 60 Hz	
Current Draw ⁽¹⁾	6.3 Amps	8.0 Amps
Sound Level	47 dBA ducted	54 dBA ducted
	51 dBA unducted	
Dimensions - cabinet only		
Width	12.5"	12.5"
Height ⁽²⁾	14.5"	14.5"
Length	25"	27.5"
Weight	70 lbs	75 lbs
Operating Condition		
Inlet Air Operating Conditions	50°F - 104°F, 40°F dew point min.	
Ambient/Ventilation	40°F - 140°F, 0% - 99% RH	

⁽¹⁾ Rated capacity and Energy Factor test done and current draw measure in accordance with AHAM DH-1 2008 at 80°F/60%RH inlet air at 0.0 ESP.

⁽²⁾ Height does not include adjustable feet or casters. The width excludes the filter doors, and length excludes the duct collars.

PRODUCT SPECIFICATIONS	
Control	Built-in digital control with display
Control Mounting Option	Field interchangeable from top to front
Cabinet Insulation	1/2" EPS
Air Discharge Orientation	Top or end air discharge
Inlet/Outlet Duct Collars	10" round
Back Damper at Outlet	Included
Air Filter	Washable MERV 8
Refridgeration	R-410A
Coil Corrosion Resistance	E-coated coil
8' Power Cord Type	Plug type
Drain Connection	3/4" PVC adapters ⁽¹⁾
Warranty	5 years

⁽¹⁾ Thread adapter and barbed fitting for clear drain tubing included.

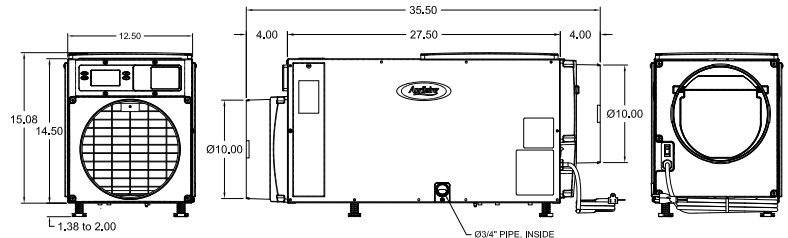

FEATURES

- Removes moisture from outdoor air before it enters the live space
- Unit is designed, when properly installed, to achieve ASHRAE Standard 62.2 2010
- Control is integrated into the unit
- High and Low Temperature Limit Lock-outs
- Simple plug-in installation
- Installation temperature range up to 140°


BENEFITS

- Helps control RH in the home during periods when the air conditioning system does not run long enough to remove sufficient moisture. If air conditioner can satisfy RH requirements the Aprilaire unit's compressor shuts off
- Optimize energy savings by locking out ventilation during hottest/coldest times of the day
- Improves indoor air quality
- Installation labor reduced, requires only a power outlet and 24 volt wiring to HVAC system


When properly installed and set, the Aprilaire Model 8191 and Model 8192 Ventilators with Dehumidification will meet the mechanical ventilation requirements of:

- Energy Star Certified Homes, Version 3
- EPA Indoor airPLUS, Version 1
- 2012 International Residential Code (IRC)
- 2012 International Energy Conservation Code (IECC) – **8191 Only**

Ducting the Ventilator

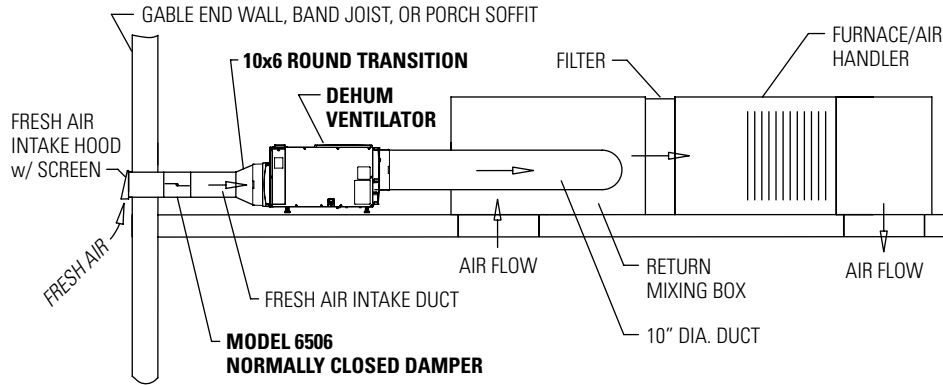


Ducting the Ventilator for Air Mixing

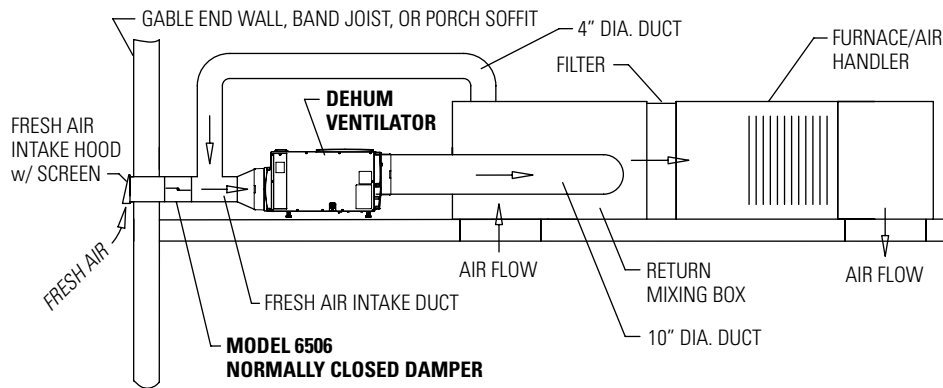

ON/OFF button used to turn the ventilator on and off

UP/DOWN buttons used to change humidity or vent time setting

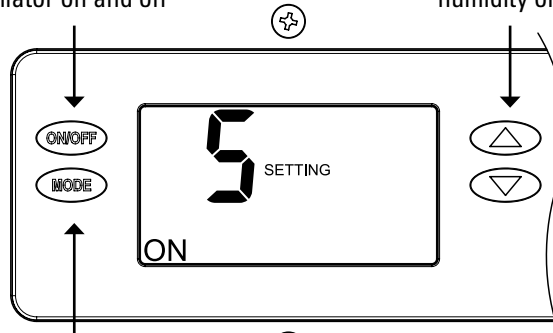

MODE button used to access ventilation time setting



APRILAIRE RESERVES THE RIGHT TO CHANGE SPECIFICATIONS WITHOUT NOTICE.

PO Box 1467 • Madison, WI 53701-1467 • Phone 800/334-6011 • Fax 608/257-4357 • www.aprilairepartners.com