


Product Transition

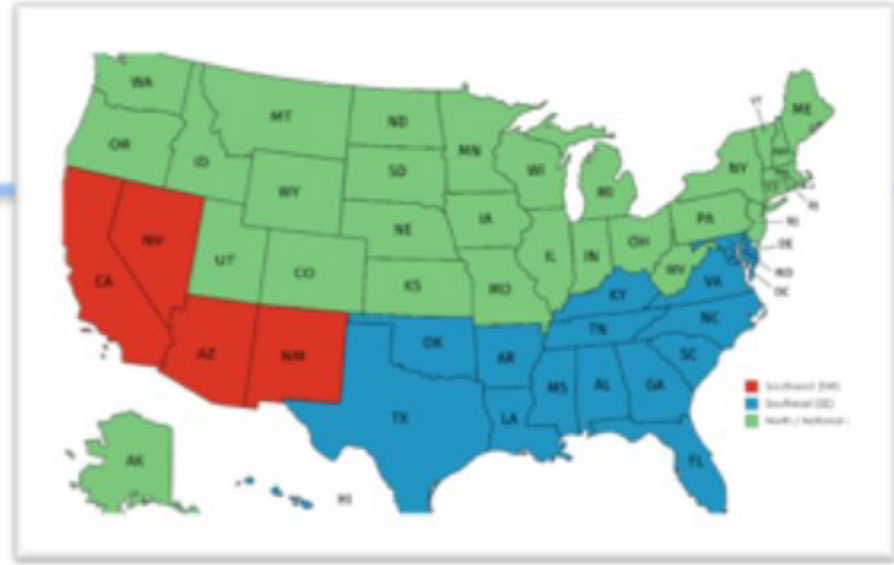

Split System AC - 5 ton and less single phase

Split System AC		Built Before 2023						Built 2023+			
		Install b4 2023			Install 2023+			Install 2023+			
		N	SE	SW	N	SE	SW	N	SE	SW	
SEER	13	Y	N	N	Y	N	N	Illegal to sell in the U.S.			
	14	Y	Y	N	Y	N	N				
	14 SW EER**	Y	Y	Y	Y	N	N				
	15	Y	Y	Y	Y	N	N				
	15 SW EER**	Y	Y	Y	Y	N	N				
	16	Y	Y	Y	Y	N	N				
	16 SW EER**	Y	Y	Y	Y	N	N				
	18+	Y	Y	Y	Y	Y	N				
18+ SW EER**	Y	Y	Y	Y	Y	Y					
SEER2	13.4	Okay to rate to SEER2 prior to 2023 as long as meet the new minimum efficiencies.						Y	N	N	
	14.3	Okay to rate to SEER2 prior to 2023 as long as meet the new minimum efficiencies.						Y	Y	N	
	14.3 SW EER2**	Okay to rate to SEER2 prior to 2023 as long as meet the new minimum efficiencies.						Y	Y	Y	
	15+	Okay to rate to SEER2 prior to 2023 as long as meet the new minimum efficiencies.						Y	Y	Y	
	15+ SW EER2**	Okay to rate to SEER2 prior to 2023 as long as meet the new minimum efficiencies.						Y	Y	Y	

*See Phase In Phase Out Plan.
 ** See Standards Table for Requirements

All combinations of the split system AC have to make ratings for a given region in order to be installed in that region.

Single Package AC (Gas or Elec Heat) 5 ton and less single phase

Single Package AC and G/E		Built Before 2023						Built 2023+			
		Install b4 2023			Install 2023+			Install 2023+			
		N	SE	SW	N	SE	SW	N	SE	SW	
SEER	14 SW EER*	Y	Y	Y	Y	Y	Y	Illegal to sell in the U.S.			
	15+	Y	Y	N	Y	Y	N				
	15 SW EER*+	Y	Y	Y	Y	Y	Y				
SEER2	13.4	Okay to rate to SEER2 prior to 2023 as long as meet the new minimum efficiencies.						Y	Y	N	
	13.4 SW EER2*	Okay to rate to SEER2 prior to 2023 as long as meet the new minimum efficiencies.						Y	Y	Y	
	14+	Okay to rate to SEER2 prior to 2023 as long as meet the new minimum efficiencies.						Y	Y	N	
	14+ SW EER2*	Okay to rate to SEER2 prior to 2023 as long as meet the new minimum efficiencies.						Y	Y	Y	

* See Standards Table for Requirements