


FTXM09/12WVJU9



REQUIRED SPACE FOR SERVICE AND VENTILATION

→ INDOOR AIRFLOW

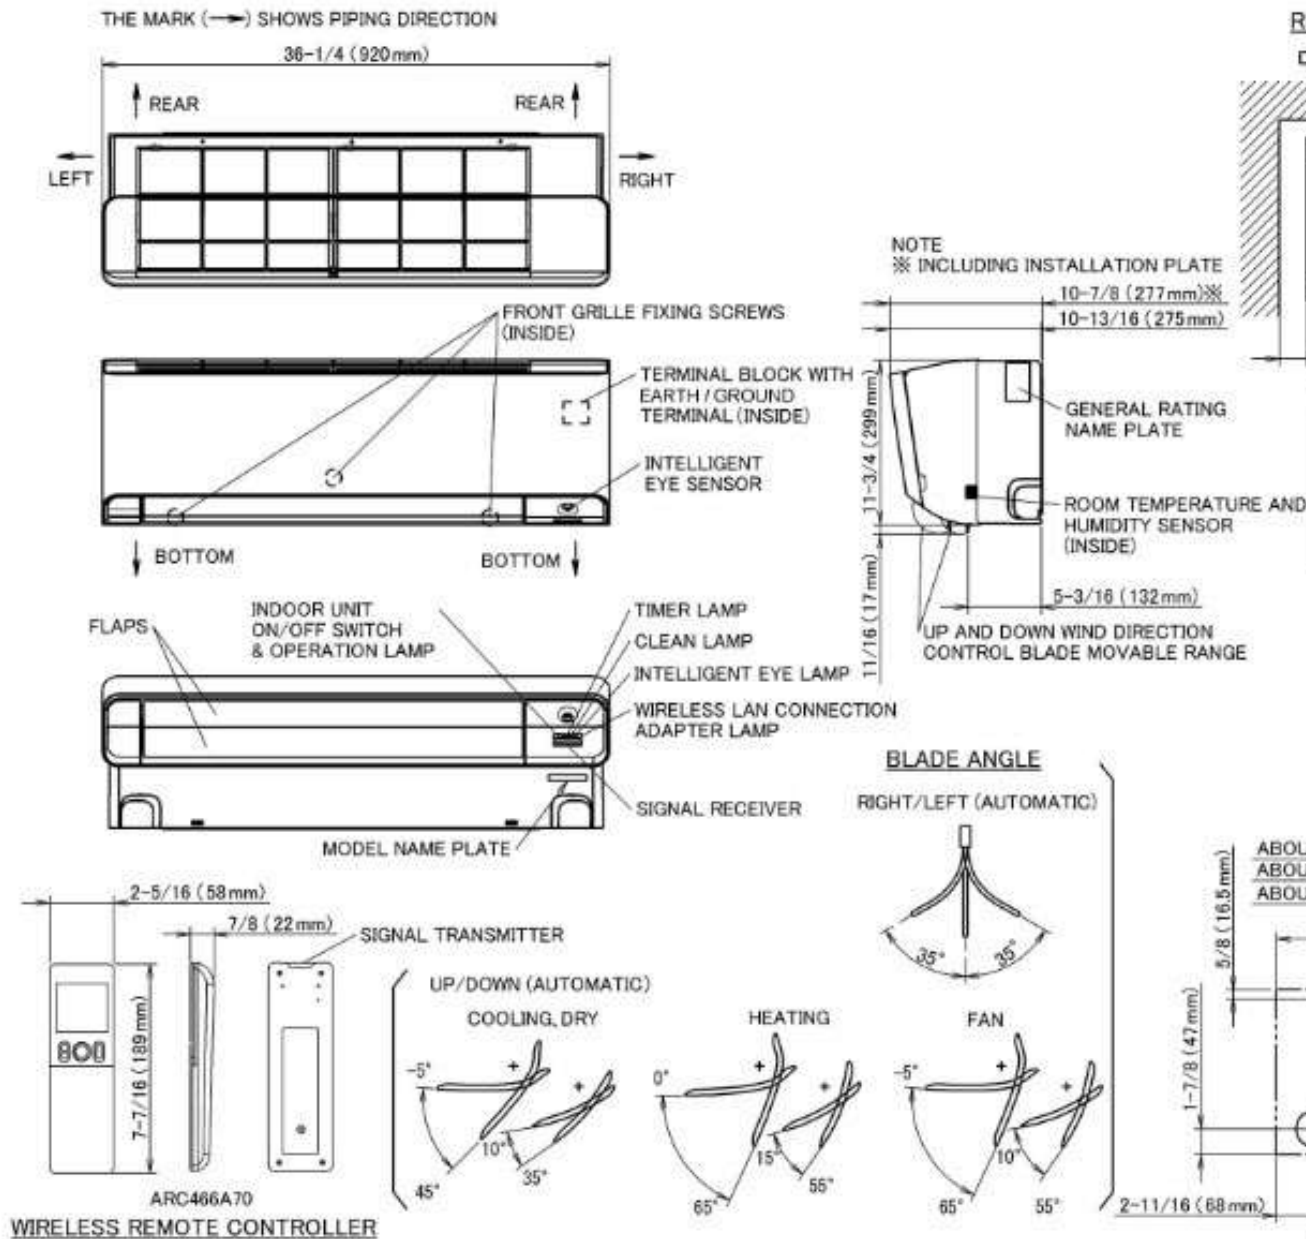