

Features

- 1.28 gpf (4.8 lpf)
- Activation distance is factory-set
- Chloramine and chlorine resistance on all rubber components exposed to waterway
- Engineered for optimal performance with KOHLER® commercial fixtures
- 125-micron filter protects internal components
- High back pressure vacuum breaker
- Locking stop cap provides protection against vandalism
- No external flush volume adjustment ensures water conservation
- 24-hour automatic sentinel flush keeps trapway fresh
- Mechanical override enables flushometer to be used manually even during a power outage
- Includes 1.5V AA alkaline batteries
- Patented piston technology for superior flush volume accuracy

Material

- Brass construction with durable Polished Chrome finish

Technology

- Flushometer activates when hand is waved over electronic infrared WAVE sensor

Installation

- Intended for toilet installations with 1-1/2" (38 mm) top spud coupling connection

Recommended Products/Accessories

1421939 Flushometer Arm Extension Kit
1509698 Pressure Gauge Kit, 1/8"

Optional Products/Accessories

GP1118986 Flushometer Extension Kit
K-10313 Flushometer 12" rough-in kit



ADA

CSA B651

OBC

Codes/Standards

ASME A112.18.1/CSA B125.1
ASSE 1037/ASME A112.1037/CSA B125.37
EPA WaterSense®
ADA
ICC/ANSI A117.1
CSA B651
OBC
NOM Standards
NOM 002-CONAGUA

KOHLER® One-Year Limited Warranty

See website for detailed warranty information.

Available Colors/Finishes


Color tiles intended for reference only.

Color Code Description



CP Polished Chrome

*10-3/4" (273 mm) minimum with a
6" (152 mm) critical level above the fixture

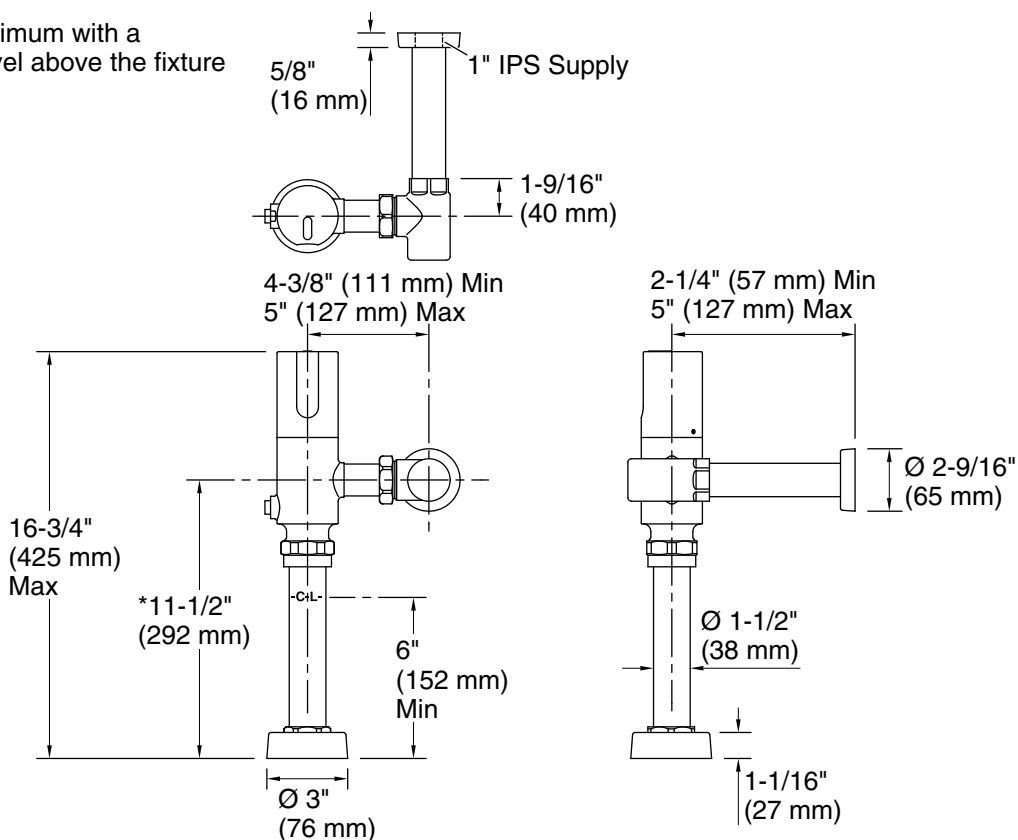

Technical Information

All product dimensions are nominal.

Spout:

Pressure/fixture Supply Requirements

Fixture pressure	80 psi (551.6 kPa)
max (static):	
Fixture pressure min	35 psi (241.3 kPa)
(static):	
Min flowing	25 psi (172.4 kPa)
pressure:	
Min flow rate:	25 gpm (94.6 lpm)

Notes

Install this product according to the installation instructions.

ADA, OBC, CSA B651 compliant when installed to the specific requirements of these regulations.