

Vacancy Sensors

That Can Be Used to Comply with 2019 California Title 24, Part 6, Indoor Device Requirements and 2017 NEC®



Leviton offers many products that help lower electrical costs and add convenience to everyday living. Replacing standard switches with sensors helps to reduce energy consumption by ensuring that lights are never left on for an extended period of time. Residential indoor lighting requirements in the State of California have changed and finding a sensor that meets these new specifications can be challenging. Fortunately, Leviton offers compliant solutions for new construction and retrofit applications.

NEW CONSTRUCTION/ADDITIONS (For permits filed after 1/1/2020)

CHALLENGE

Residential new construction in the State of CA must meet 2019 Title 24 energy code requirements for Indoor Lighting as well as the NEC 2017.

- 2019 California Title 24 now allows an occupancy sensor to meet the vacancy requirements
 - If occupant sensor is installed, it must be configured to manual-ON operation
 - If occupant sensor is installed, it shall not be capable of conversion by occupants from manual-ON to automatic-ON functionality
- NEC 2017 prohibits current on the equipment grounding conductor during normal operation

SOLUTION

All Leviton Occupancy and Vacancy Sensors comply with 2019 California Title 24 can be used to also meet the requirements of NEC 2017 for new construction.

- Neutral required for installations in new construction
- 180° field of view, 900 sq. ft. coverage
- Suitable for bathrooms, garages, laundry rooms and utility rooms
- DOS02, DVS02 are single pole only. DOS05/DVS05 are single/pole or 3 way and IPV15 is single pole or 3-way when used with IPV0R sensor remote or VP0SR switch remote
- For use with LED, CFL, Incandescent, Fluorescent Ballast or Motor loads

RETROFIT/REPLACEMENT CONSTRUCTION

CHALLENGE


Residential retrofit construction may not have a neutral in the wallbox.

- NEC 2017 exceptions:
- For replacement in already installed places (allowable to sell and replace)
 - Retrofit: allowed, but will be limited to 5 devices per branch circuit conductor and 25 per feeder conductors

SOLUTION

All Leviton Occupancy and Vacancy Sensors can be used to replace an existing wall switch.

- 180° field of view, 900 sq. ft. coverage
- Suitable for bathrooms, garages, laundry rooms and utility rooms
- Single pole or 3-way
- For use with LED, CFL, Incandescent, Fluorescent Ballast or Motor loads

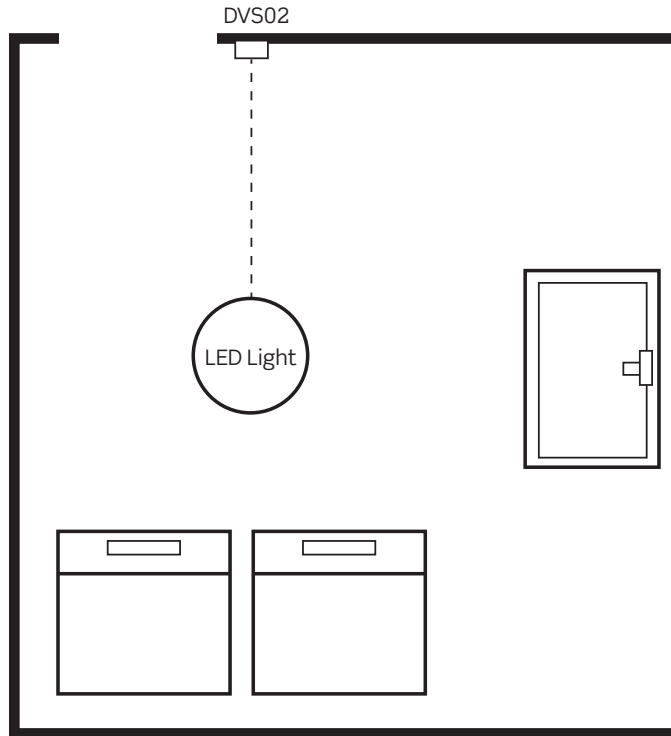

WHAT YOU WILL NEED TO ORDER

New Construction/Additions or Retrofit with Neutral in the wallbox



DVS02 or DVS05 Vacancy Sensors
 DOS02 or DOS05 Occupancy Sensors

IPV15 Vacancy Sensors
 VP0SR Matching Switch Remote to be used in 3-way applications
 IPV0R Sensor Remote to be used in 3-way applications

Retrofit/Replacement Construction with no Neutral in the wallbox



DVS02 or DVS05 Vacancy Sensors
 DOS02 or DOS05 Occupancy Sensors



Leviton Manufacturing Co., Inc.
 201 North Service Road, Melville, NY 11747-3138
 Telephone: 1-800-323-8920 • FAX: 1-800-832-9538
 Tech Line: 1-800-824-3005
 Mon-Fri 8am-10pm EST, Saturday 9am-7pm EST

Visit our Website at: www.leviton.com

© 2021 Leviton Manufacturing Co., Inc. All rights reserved. Subject to change without notice.

