


SUBMITTAL DATA horizontal steam/hot water unit heaters model HC, side connections

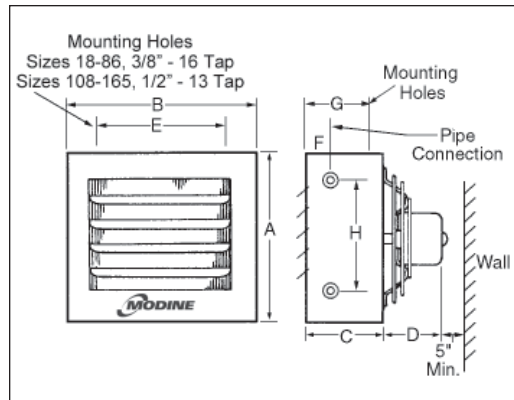


**Canadian
Registered
heat exchangers
CRN
OH 9234.5**

**Figure 1.1
Model Dimensions HC18-165**



**Figure 1.2
Model Dimensions HC193-340 ①**

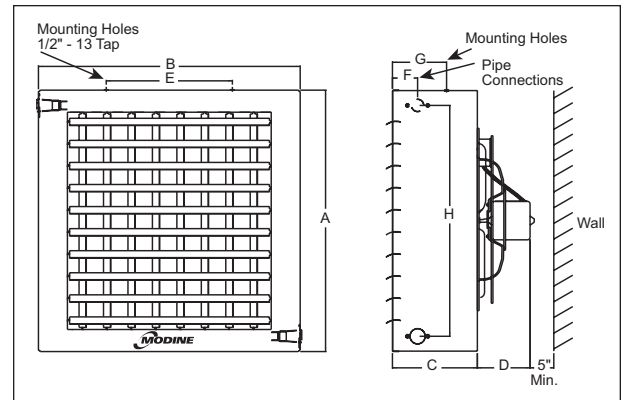

① Vertical deflector blades shown are standard on models HC 258-340 and optional on model HC 193.

Table 1.1 - Dimensions ①②

Model No.	A	B	C	D		E	F	G	H	Connections NPT	Shipping Fan Dia.	Approx. Weight (Lb.)
				115V Std. Motor	115V Exp. Motor							
HC-18	11-1/2	12-3/4	6	5	12-1/4	5-5/8	2-1/4	4-1/8	7 1/2	1/2	9	16
HC-24	11-1/2	12-3/4	6	5	12-1/4	5-5/8	2-1/4	4-1/8	7 1/2	1/2	9	20
HC-33	15	17-1/2	8-3/4	6	11-3/4	11	3-5/8	6	10	3/4	12	34
HC-47	15	17-1/2	8-3/4	6	11-3/4	11	3-5/8	6	10	3/4	12	6
HC-63	18-1/2	21-1/2	8-3/4	7 3/4	12	15	3-5/8	6	14	3/4	12	48
HC-86	18-1/2	21-1/2	8-3/4	7 3/4	12	15	3-5/8	6	14	3/4	14	52
HC-108	22-1/2	25-1/2	9-1/2	6 3/4	13-1/4	18	3-5/8	6-3/8	18	3/4	18	74
HC-121	22-1/2	25-1/2	9-1/2	6 3/4	11	18	3-5/8	6-3/8	18	3/4	18	76
HC-165	26-1/2	29-1/2	9-1/4	8	14	21-1/4	3-5/8	6-3/8	22	3/4	22	92
HC-193	30-1/2	32-1/2	9-1/4	8	14	21-1/4	3-5/8	4-3/4	26	1-1/4	22	98
HC-258	38-1/2	38-1/2	12-1/2	10	15	18-5/8	3-5/8	8	34	1-1/4	22	163
HC-290	38-1/2	38-1/2	12-1/2	10	15	18-5/8	3-5/8	8	34	1-1/4	24	168
HC-340	38-1/2	44-1/2	12-1/2	10	15	18-5/8	3-5/8	8	34	1-1/4	24	176

① All dimensions in inches.

② Dimensions shown are for Standard and Low Outlet Temperature models.

Table 1.2 - Specifications

Model No.	Core Type		Copper Tube Size (Inches)	Copper Tube Wall Thickness (Inches)
	Single Serpentine	Double Serpentine		
HC-18	X	—	5/8 OD	0.028
HC-24	X	—	5/8 OD	0.028
HC-33	X	—	1 OD	0.030
HC-47	X	—	1 OD	0.030
HC-63	X	—	1 OD	0.030
HC-86	X	—	1 OD	0.030
HC-108	X	—	1 OD	0.030
HC-121	X	—	1 OD	0.030
HC-165	X	—	1 OD	0.030
HC-193	—	X	1 OD	0.030
HC-258	—	X	1 OD	0.030
HC-290	—	X	1 OD	0.030
HC-340	—	X	1 OD	0.030

Junction Box

All units include an electrical junction box either integral to the motor or attached to the unit casing. Explosion proof units include an explosion proof junction box attached to the motor.

1-456.3 SUBMITTAL DATA

Table 2.1 - Motor Data ①

Model Number	Motor HP	Voltage, Motor Type and Power Code							
		115/60/1	230/60/1	200-208/60/3	230/460/60/3	115/60/1	230/460/60/3	575/60/3	575/60/3
		Totally Enclosed w/Thermal Overload	Totally Enclosed w/Thermal Overload	Totally Enclosed	Totally Enclosed	Explosion Proof w/Thermal Overload	Explosion Proof w/Thermal Overload	Totally Enclosed	Explosion Proof w/Thermal Overload
		01	02	04	05	06	09	10	11
		Amps	Amps	Amps	Amps	Amps	Amps	Amps	Amps
HC-18	1/60	0.8	0.44	-	-	3.1	-	-	-
HC-24	1/25	1.6	0.44	-	-	3.1	-	-	-
HC-33	1/25	1.6	1	-	-	3.1	-	-	-
HC-47	1/12	2.2	1	1.2	1.4/0.7	3.1	-	-	-
HC-63	1/12	2.2	1	1.2	1.4/0.7	3.1	-	-	-
HC-86	1/8	2.3	1	1.2	1.4/0.7	3.1	-	-	-
HC-108	1/8	2.3	1	1.2	1.4/0.7	3.1	-	-	-
HC-121	1/6	2.8	1.5	1.9	2.1/1.05	4.1	1.5/0.75	0.84	-
HC-165	1/3	5.4	2.23	1.9	2.1/1.05	6.1	1.5/0.75	0.84	-
HC-193	1/3	5.4	2.23	1.9	2.1/1.05	6.1	1.5/0.75	0.84	-
HC-258	1/2	7.5	3.5	2.6	3.0/1.5	5.8	2.0/1.0	0.92	0.76
HC-290	1/2	7.5	3.5	2.6	3.0/1.5	5.8	2.0/1.0	0.92	0.76
HC-340	1/2	7.5	3.5	2.6	3.0/1.5	5.8	2.0/1.0	0.92	0.76

① Ratings shown are for Standard and Low Outlet Temperature models.





Modine Breeze™ AccuSpec Sizing and Selection Program

The Modine Breeze AccuSpec is the fastest way to generate performance data based on actual job conditions. The Breeze AccuSpec program is a Windows based sizing and selection program. The program provides a series on step-by-step questions that allow for the easy configuration of Modine products. After a model has been configured, the program can generate Submittal Schedules, Submittal Data including performance and dimensional drawings, and Specifications.

Capacities at Job Conditions

Pictures for Visual Selection

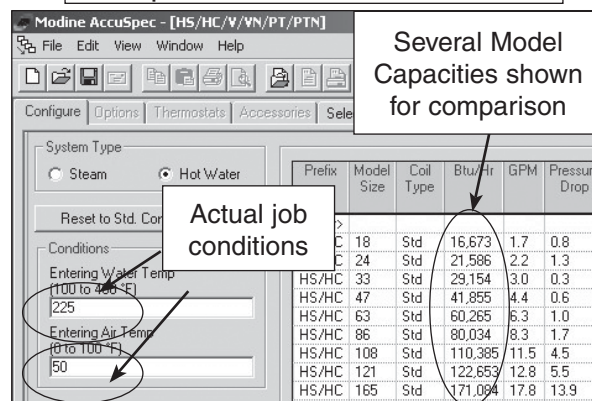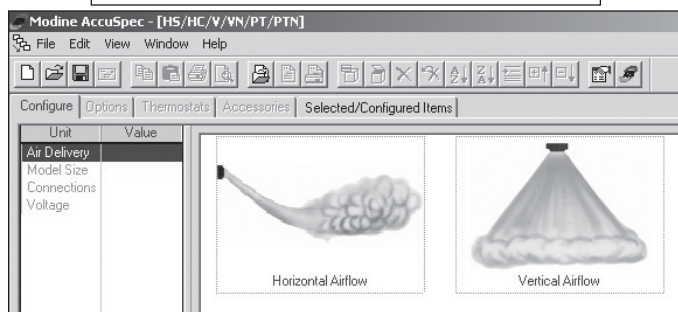

Submittal Schedules

MODINE AccuSpec V6.20


SUBMITTAL SCHEDULE & DATA

Steam/Hot Water Unit Heaters

Job Name: _____ Date: _____
 Location: _____ Engineer: _____
 Submitted by: _____ Architect/Contractor: _____

Unit Tag	Model Number	Quantity of Units	Supply Output	CFM	Outlet Velocity	Entering Air Temp. (°F)	Final Air Temp. (°F)	Fluid Type (Steam or Hot Water)	Steam Pressure (PSI)	Condensate (Btu/h)	Entering Water Temp. (°F)	Water Flow Rate (GPM)	Water Pressure Drop (ft of Water)	Water Temp. Drop (°F)	Supply Voltage	Motor Type	Motor HP
	HS 108S 01	1	166,000	2010	760	60	109	Steam	2	112	N/A	N/A	N/A	N/A	115/60/1	Totally Enclosed with Thermal Overload	1/8

Unit Specific Dimensional Drawings

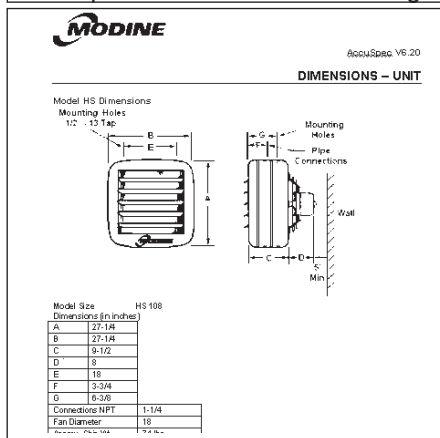

Job Specific Specifications

Specifications

General
 Contractor shall furnish and install Modine steam/hot water unit heaters(s). Performance shall be as indicated on the equipment schedule in the plans. Unit heater(s) shall listed by CSA as certified.

Units
 Self-contained, factory assembled, pre-wired unit consisting of cabinet with air deflection louvers, supply fan, motor, and condenser.

Coating
 Electrocoat applied on grey-green corrosion resistant, high solids coating that meets the following:
 1. 500 hours of salt spray as defined in ASTM B117.
 2. Adhesion/crosshatch tests as defined in ASTM D3359, Method B, Rating 5B.
 3. Will not crack or peel when test panel is bent around a 1/8 inch radius.

Condenser
 Condenser coils are of the extended surface type of serpentine design, utilizing aluminum fins and D.I.P. type copper tubes with malleable iron supply and return connections. Tubes are mechanically bonded to the rollers of the fins. The condensers are warranted for operation at steam or hot water pressures up to 160 pounds per square inch gauge and/or temperatures up to 375°F. All coils are leak tested at 160 to 200 psig, air under water. Fins are continuous across the width and depth of the condenser and are vertically oriented to minimize the collection of dirt and dust.

Coils
 Coils are of serpentine design with horizontal tubes, vertical fins and center supply and return connections at top and bottom of unit. All tube bends are beveled. All tubes have individual expansion bends. Copper tubes are 1" O.D. with 0.03" wall thickness.

Motor
 Single motor with a supply voltage of _____ and horsepower of 1/8 as indicated on the equipment schedule and manufactured in accordance with NEMA standards for continuous fan duty type applications. Must be totally enclosed and single phase motors will have built in thermal overload protection. _____ to the unit with rubber gasketing (gasketing material). The entire length of the line voltage motor leads will be shielded and terminate in a factory supplied junction box mounted on the unit or integrate to the motor.

For a copy of the Breeze AccuSpec program, contact your local Modine sales representative.

Commercial HVAC&R Division • Modine Manufacturing Company • 1500 DeKoven Avenue • Racine, Wisconsin 53403-2552
 Phone: 1.800.828.4328 (HEAT) • Fax: 262.636.1665 • www.modine.com