

RECTORSEAL

A CSW Industrials Company

INSTALLATION INSTRUCTIONS


RSHTM50^{DB}

**RSH-50 Surge Protection Device with
Non-Fused Disconnect Box 120/240 VAC, 60A**


PRODUCT CODE **96419**




Front View (Cover)

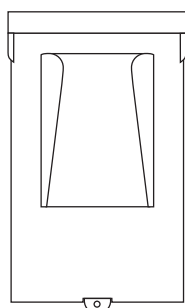

Back View

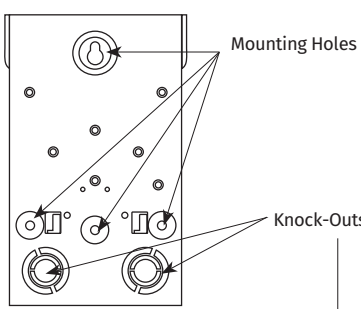

Side View

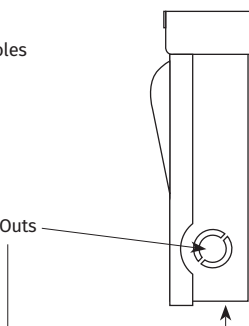

1. OPEN LID

Lift lid and slide back into slot to keep open.


2. PULL-OUT MECHANISM

Pull up on the handle to remove pull-out mechanism and then remove the plastic shielding cover.

3. WIRING THE DISCONNECT

1/2", 3/4" and 1" knock-outs are provided on back, side and bottom of can to attach the proper size wiring connectors. Use a screwdriver and hammer to remove the exact number of knockouts needed for the installation. Secure the wiring to the box and protect it from sharp edges. If you are using a pre-made whip attached to the bottom of the can, use the knock-out to the left of the surge protector. This knock-out has a larger spacing to allow for the connector.

Inside View

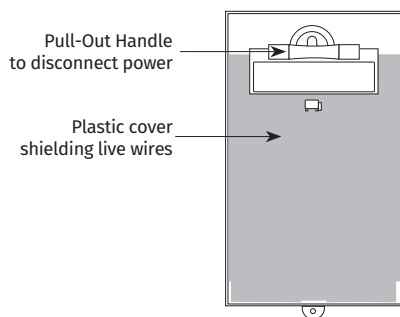

4. INSTALLING THE DISCONNECT

Pre-drilled holes on the back of the box allows mounting the unit to the wall. Provide proper size fasteners to ensure secure mounting to the wall.

5. INSTALLING WIRES INTO LUGS


The pre-installed surge protector wires are attached to flat tabs below the LOAD lugs. Wire from the circuit breaker panel attaches to the LINE lugs. Wiring to the equipment attaches to the LOAD lugs above the surge protector tab. Ground bar supplied for attaching the GROUND wires. Make sure the wire gauge meets any NEC-Code standard for the amperage of the equipment.

6. FINISH INSTALLATION

Check all connections to make sure they are torqued properly before replacing front plastic shielding cover and then install the pull-out handle in the ON position. This handle **MUST** be pushed in as far as possible for proper installation.

NOTICE: Failure to properly secure the cables may cause equipment damage due to overheating.

Inside View

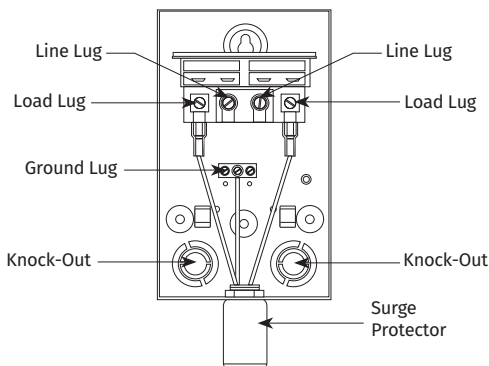

This table provides required torque values for ALL wiring inside the disconnect box

LUG SPECIFICATIONS (60/75°C AL-CU WIRE)					
WIRE SIZE (AWG)				CONNECTOR TORQUE (LB-IN)	
Line/Load		Equipment Ground		Line/Load	Equipment Ground
CU	AL	CU	AL		
14-10	-	14	-	35	25
8-6	8-6	8	8	45	40
4-2	4-2	8	8	50	40

Para instrucciones en español visite www.rectorseal.com

Technical Support Call 1-800-648-6802

All surge protection devices require a good ground connection for effective operation



RSH-50 Surge Protection Device with
Non-Fused Disconnect Box 120/240 VAC, 60A

WARRANTY INFORMATION & SAFETY NOTICE

Coverage for the RSH-50 Surge Protective Device (SPD) for Single-Phase System

Lifetime Product Warranty

PSP Products, Inc. ("Manufacturer") will, at its sole discretion, repair or replace any RSH-50 Surge Protection Device (SPD) that is defective or is damaged by an electrical surge (including those caused by lightning) for the lifetime of the product from the date of installation by the original owner or owner of record of the premises (User) at no cost to the User.

Connected Equipment Warranty

Manufacturer will, at its sole discretion, for a period of 5 years from the date of installation, repair or replace heating, ventilation and air conditioning equipment that is damaged as a result of SPD failure during a surge event. Coverage is applicable only if the SPD (1) was fully functional immediately prior to the claim event; (2) was properly installed per the installation instructions; and (3) sustained surge damage as a result of the claim event.

Damage claims must be made within 14 days of the occurrence and the SPD returned to Manufacturer within 30 days of the occurrence with the original purchase receipts of the SPD. Returned SPDs require an RMA number and a completed Warranty Claim Form (contact Warranty Assistance for details), and the SPD must be determined to have failed based on Manufacturer's test procedures.

This coverage is secondary to any applicable warranties, service contracts and all other insurance. If the claim is found to be valid, Manufacturer will pay up to the deductible amount of the home owners insurance or the cost of the damage, whichever is less, subject to a \$5000.00 limit per occurrence. All of the above items must be met in order to have a valid claim.

The above coverage applies to the User only and is the exclusive remedy under this warranty, whether based on contract, tort, including negligence, or otherwise. Manufacturer reserves the right to audit the damages, site and/or cost of repairs and may require a notarized proof of loss. This warranty does not cover damage associated with sustained over voltages, vandalism, theft, normal wear and tear, obsolescence, abuse, unauthorized modification or alteration, misuse, improper installation or catastrophic events including direct lightning hit.

Except as expressly provided by this warranty, Manufacturer disclaims liability for any incidental, indirect, special or consequential damages arising out of the sale or use of SPDs (including without limitation: lost business profits, loss of data and all freight, mileage, travel time and insurance charges associated with warranty coverage claims). Some states do not allow the exclusion or limitation of incidental or consequential damages, so the above limitation or exclusion may not apply to you. This warranty gives you specific legal rights and you may have other rights which vary from state to state. *This warranty is valid in the United States and Canada only.*

Caution: Effective surge suppression requires correct wiring and all SPDs must be properly grounded for this warranty to be honored.

For Warranty Assistance call 800-648-6802 or (703) 368-8376 • PO Box 4108, Manassas, VA 20110

WARNING

Voltage or current hazard, follow these instructions or it could result in serious bodily injury or death.

Most electric product-related incidents are caused by failure to observe basic safety rules or precautions. RectorSeal cannot anticipate every possible circumstance that might involve a potential hazard.


Requirement

Installation **MUST** be completed by a qualified licensed tradesman in the field of electrical installation. This would include a thorough understanding of the requirements of NFPA 70: National Electrical Code® and all local codes.

Installation Process

The Installation must conform to these instructions and the local code authority having jurisdiction and the requirements of the power company. In the absence of code requirements follow NFPA 70 (latest edition) National Electric Code.

The Code which may be ordered from: National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02269.

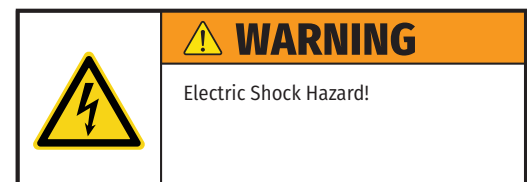

RectorSeal, LLC • 2601 Spenwick Drive, Houston, TX 77055, USA • 800-231-3345 • Fax 800-441-0051 • rectorseal.com

A CSW Industries Company. RectorSeal, the logos and other trademarks are property of RectorSeal, LLC, its affiliates or its licensors and are protected by copyright, trademark and other intellectual property laws, and may not be used without permission. RectorSeal reserves the right to change specifications without prior notice. ©2022 RectorSeal. All rights reserved. R50366-0922