
General Assembly

75009417

REV A

Typical illustration. Unit may not appear exactly as shown.

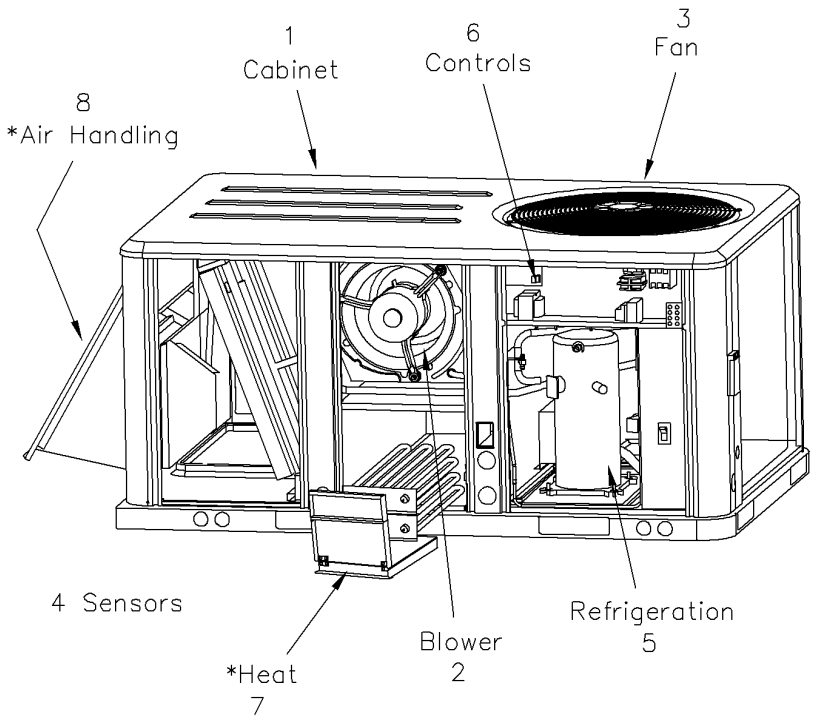


* The Heat and Air Handling sections will appear in the Parts List if ordered with the unit.

View is determined by facing Appearance Nameplate

Part No.	Reference No.	Quantity	Description
75007492	2		BLOWER
75006103	3		FAN
75008463	5		REFRIGERATION
75009416	9		MODEL NUMBER DESCRIPTION, DIGITS 1-16
75009422	9		MODEL NUMBER DESCRIPTION, DIGITS 17-31
75009423	9		MODEL NUMBER NOTES
NGRAPHIC	10		OPTIONAL FIELD INSTALLED ACCESSORIES

Blower 75007492 REV A

Typical illustration. Unit may not appear exactly as shown.

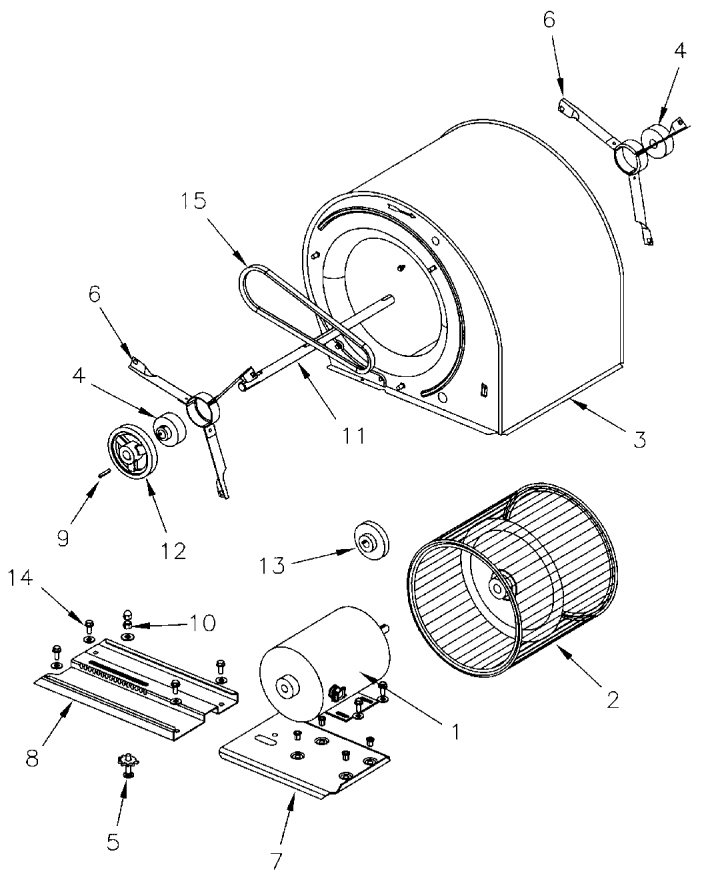


Part No.	Reference No.	Quantity	Description
BLT00845	*	1	BOLT; CARRIAGE BD, .38-16 X 1.75 CRG, W/O NUT, STEEL-ZINC PLT, THREADED FULL LENGTH, GR5
BRK02975	*	1	BRACKET; ADJUSTMENT, MOTOR (IDLER GEAR)
BUS00363	*	1	BUSHING; STRAIN RELIEF
BUS00485	*	1	BUSHING; .62 MTG W/MAX .44 ID
KEY00300	*	1	KEY; 1/4 IN X 1/4 IN X 1-1/2 IN
NUT00355	*	8	NUT; HEX, LOCK, 5/16IN.-18
SCR01634	*	8	SCREW; .31-18 X .75, HEX MACH
WAS00283	*	1	WASHER; PLAIN, .43 ID X 1.00 OD, .083 THK, CARBON-STL PLD
WIR03418	*	1	WIRE; HARNESS, INDOOR MOTOR, BELT DRIVE, 74.5 L, 16A RED, 17A BLU, 3A BLK
MOT13023	1	1	MOTOR; 1 HP, 208-230/460/60/3, 380-415/50/3, 1725-1425 RPM, 56 FRAME, BALL BEARINGS
WHL00625	2	1	WHEEL; FAN, STEEL, 15 DIA X 15 LG, 1.0 BORE, BELT
HUS03661	3	1	HOUSING; BLOWER, 15 X 15. BRACKETS NOT INCLUDED.
BRG01579	4	2	BEARING; BALL; 1.0 BORE, BB CRTG, RUBBER MOUNT
KIT09200	5	1	KIT; BELT DRIVE TENSIONING GEAR HARDWARE
BRK03736	6	2	BRACKET; BEARING, 4 ARM MECHANICALLY CLINCHED ASSEMBLY
BRK02978	7	1	BRACKET; MOTOR MOUNTING PLATE, TOP, 11.7 X 7.8. INCLUDES (4) .31-18 HEX RIVNUTS.
BRK02977	8	1	BRACKET; MOTOR MOUNTING PLATE, BOTTOM, 14.5 X 8.0. INCLUDES (4) 0.31-18 X 0.75 HEX MACH SCREWS.
KEY00299	9	2	KEY; 1/4 IN X 1/4 IN X 1 IN
WAS00283	10	1	WASHER; PLAIN, .43 ID X 1.00 OD, .083 THK, CARBON-STL PLD
SHF03136	11	1	SHAFT; INDOOR FAN, 21.90 LENGTH X 1 IN DIA
SHE01114	12	1	SHEAVE; AK64 X 1, 6.25 OD
SHE00866	13	1	SHEAVE; 5/8IN. BORE, 1VL40
NUT00588	14	4	NUT; HEX RIVET, .31-18
BLL00080	15	1	BELT; AX35,37.2IN.OUTSIDE LENGTH

Fan

75006103

REV A


Typical illustration. Unit may not appear exactly as shown.

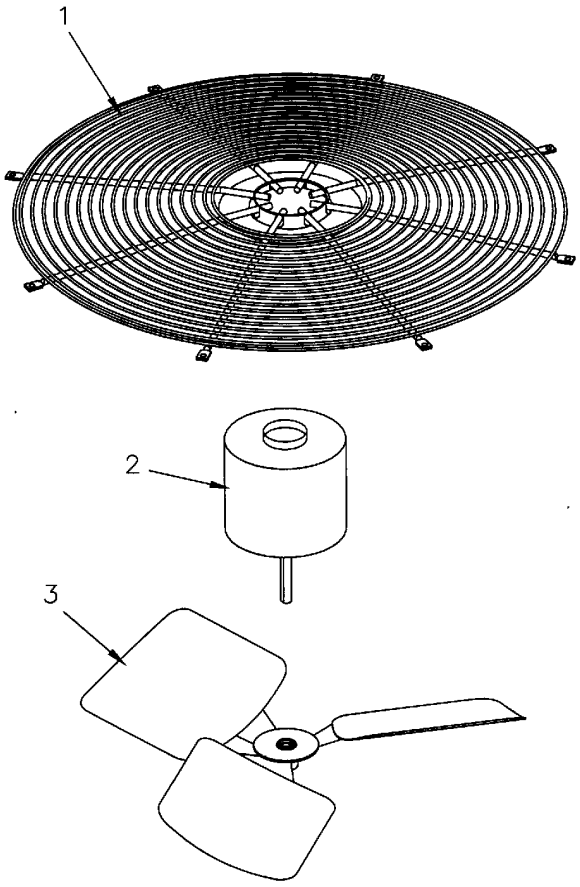

Part No.	Reference No.	Quantity	Description
BRK00688	*	2	BRACKET; CONNECTING, HEAT SINK
NUT00009	*	1	NUT; .25-20, HEX LOCK
RNG01005	*	2	RING; EXTRUDED FIN, HEAT SINK, 3.00 WIDE, UNRESTRAINED DIM IS 7.20/6.61
SCR01996	*	4	SCREW; #10-32 THREAD FORMING, IND 5/16 HEX FLG WASHER HEAD, .438/.408 LENGTH, W/GERNIBS TAPTITE II (4 PER BAG)
WAS00041	*	1	WASHER; FLAT, PLAIN, #12 .25 ID X .56 OD, .065 THK, CARBON STL-PLD
WAS00670	*	1	WASHER; .26 ID X .49 OD
GRL01353	1	1	GRILLE; OUTDOOR FAN, 30.33 MTG DIA
MOT10508	2	1	MOTOR; .70 HP, 208-230/60/1, 1100 RPM, CCW LEAD END, TYPE PSC, 48 FRAME, BALL BEARING, 20 MFD CPT AT 370V
FAN03159	3	1	FAN; 4 BLADE, 26 IN DIA, 26 DEG PITCH, CCW, 1/2 BORE

Refrigeration 75008463 REV A

Typical illustration. Unit may not appear exactly as shown.

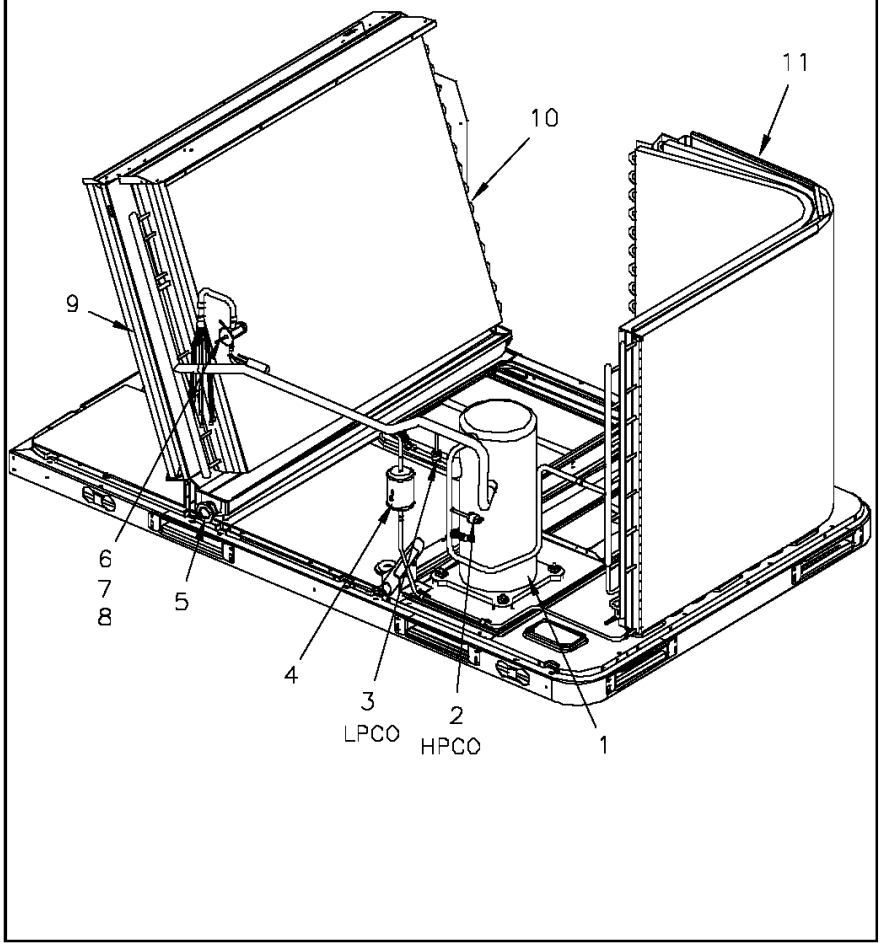

Part No.	Reference No.	Quantity	Description
BOF01686	*	1	BLOCKOFF, INDOOR COIL, BOTTOM, 51.5 LENGTH
BRK03095	*	2	BRACKET; FILTER RETAINER, 47.70 IN LENGTH
BRK03234	*	1	BRACKET; INDOOR COIL, BOTTOM, 0.65 X 4.39 X 1.50
BRK03274	*	2	BRACKET; BASE SUPPORT MOUNT, 10.3 LENGTH (FORKLIFT BRACKET)
BRK03275	*	1	BRACKET; COMPRESSOR SUPPORT (3 SIDES)
CAP00072	*	2	CAP; VALVE, SEAL, .25 FFL
CNL01124	*	2	CHANNEL; FILTER SEPARATOR, 50.50 IN LENGTH. THESE ARE LOCATED BETWEEN THE UPPER AND LOWER FILTERS
COR00006	*	1	CORE; VALVE PORT, .79 LENGTH, .206-36 UNS 2A THD
HTR06511	*	1	HEATER; CRANKCASE, 70W, 230V, 6.5 DIA, 65/46 IN LEAD LENGTHS
KIT08039	*	1	KIT; GROMMETS. COMPRESSOR MOUNTING. (CONSISTS OF 4), 0.44 ID X 1.63 OD NEOPRENE RUBBER-BLACK 45-55 DUROMETER
NUT00355	*	4	NUT; HEX, LOCK, 5/16IN.-18
NUT00890	*	4	NUT; PALLET, 5/16-18 UNC 2B THD.
PLT03619	*	1	PLATE; MOUNTING, COMPRESSOR, 34.56 X 14.30
STM00803	*	2	STEM; SADDLE MOUNT, VALVE CORE, BRASS, .344 DIA X 1.29 SCHRAEDER TYPE FITTING (TO INCLUDE 5 PIECES)
SUP04486	*	1	SUPPORT; INDOOR COIL, 51.6 INCH LENGTH
THT02760	*	1	THERMOSTAT; WITH CLIP, .5/.625 TUBE, 72" BLACK WIRES, SPST, 230F OPEN, 180F CLOSE
VAL01483	*	1	VALVE; BODY, .44-20 THD X .25 ODS, STRAIGHT, BRASS, LESS CORE
WIR03438	*	1	WIRE; HARNESS, COMPRESSOR, 12 AWG, CC1, 46 IN LENGTH (3 WIRE-RD,BL,BK)
WIR04406	*	1	WIRE; HARNESS, LOW PRESSURE SWITCH, 42 IN LENGTH, BLUE WIRES, CIR 1
COM08834	1	1	COMPRESSOR; SCROLL, SPA057A3BPZ, 4.75 TON, 200/230/60/3, 200/220/50/3, R410A, .50 ID DISCHARGE, .875 ID SUCTION
SWT03398	2	1	SWITCH; HIGH PRESSURE, BRAZED, OPENS AT 650 PSIG, CLOSES AT 550 PSIG, 36 INCH WHITE LEADS
SWT03173	3	1	SWITCH; LOW PRESSURE CUTOUT, 250 OPEN, ACTUATION PRESSURE 41 +/- 4, RESET PRESSURE 25 +/- 4
DHY01287	4	1	FILTER DRIER; LIQUID LINE, 5/16 ODM INLET X 5/16 ODF OUTLET
PAN02916	5	1	PAN; DRAIN, 52 INCH LENGTH, BLACK POLYCARBONATE, GASKETS INCLUDED
VAL09598	6	1	VALVE; EXPANSION; 6 TON, 3/8 ODF IN X 1/2 ODF OUT, NON-ADJUSTABLE, R410A, 131.5 PSIG
DST00947	7	1	DISTRIBUTOR; ASSEMBLY, INDOOR, 20 OUTLETS, #4 NOZZLE
COL16356	10	1	COIL; INDOOR. INCLUDES THE DISTRIBUTOR, NOT THE TXV

Model Nomenclature

75009422 REV D

Packaged Cooling
Digits 18 through 31

DIGIT 18 – Through the Base Provisions
- 0 = No Through the Base Provisions
- A = Through the Base Electric (11)

DIGIT 19 – Disconnect/Circuit Breaker
- 0 = No Disconnect/No Circuit Breaker
- 1 = Unit Mounted Non–Fused Disconnect (11)
- 2 = Unit Mounted Circuit Breaker (11)

DIGIT 20 = Convenience Outlet
- 0 = No Convenience Outlet
- A = Unpowered Convenience Outlet
- B = Powered Convenience Outlet (12)

DIGIT 21 – Communications Options (4)
- 0 = No Communications Interface
- 1 = Trane Communications Interface
- 2 = LonTalk® Communications Interface
- 3 = Novar 2024 Controls (13)
- 4 = Novar 3051 Controls without Zone Sensor (13)
- 5 = Novar 3051 Controls Interface with DCV (13)
- 6 = BACnet™ Communications Interface
- 7 = Wireless Building Automation Control Network Communications Interface

DIGIT 22 – Refrigeration System Option
- 0 = Standard Refrigeration System (14)
- 1 = Dehumidification Option (15)

DIGIT 23 – Refrigeration Controls
- 0 = No Refrigeration Control (16)
- 1 = Frostat (17) (18)
- 2 = Crankcase Heater (19)
- 3 = Frostat (17) (18) and Crankcase Heater (19)

DIGIT 24 – Smoke Detector (21)
- 0 = No Smoke Detector
- A = Return Air Smoke Detector (21) (22)
- B = Supply Air Smoke Detector
- C = Supply and Return Air Smoke Detectors (21) (22)
- D = Plenum Smoke Detector

DIGIT 25 – Monitoring Controls
- 0 = No Monitoring Controls (23)
- 1 = Clogged Filter Switch (23)
- 2 = Fan Failure Switch (23)
- 3 = Discharge Air Sensing Tube (23)
- 4 = Clogged Filter Switch and Fan Failure Switch (23)
- 5 = Clogged Filter Switch and Discharge Air Sensing Tube (23)
- 6 = Fan Failure Switch and Discharge Air Sensing Tube (23)
- 7 = Clogged Filter, Fan Fail Switch and Discharge Air Sensing Tube (23)
- 8 = Novar 2024 Return Air Sensor (14) (24)
- 9 = Novar 3051 Zone Sensor (14) (25)
- A = Condensate Drain Pan Overflow Switch
- B = Clogged Filter Switch (23) and Condensate Drain Pan Overflow Switch
- C = Fan Failure Switch (23) and Condensate Drain Pan Overflow Switch
- D = Discharge Air Sensing (23) and Condensate Drain Pan Overflow Switch
- E = Clogged Filter Switch (23), Fan Failure Switch (23) and Condensate Drain Pan Overflow Switch
- F = Clogged Filter Switch (23), Discharge Air Sensing Tube (23), and Condensate Drain Pan Overflow Switch
- G = Fan Failure Switch (23), Discharge Air Sensing Tube (23), and Condensate Drain Pan Overflow Switch
- H = Clogged Filter Switch (23), Fan Failure Switch (23), Discharge Air Sensing Tube (23), and Condensate Drain Pan Overflow Switch

DIGIT 26 – System Monitoring Controls
- 0 = No Monitoring Controls
- 1 = Demand Control Ventilation (CO_2) (26) (27)

DIGIT 27 – Unit Hardware Enhancements
- 0 = No Enhancements
- 1 = Stainless Steel Drain Pan

DIGIT 31 – Advanced Unit Controls
- 0 = Standard Unit Controls
- 1 = Human Interface

See Model Number Notes graphic for explanation of Notes (1) to (27)

Model Number Description

75009416 REV C

Packaged Cooling
Digits 1 through 17

DIGIT 1 – Unit Function
T = DX Cooling

DIGIT 2 – Efficiency
H = High Efficiency

DIGIT 3 – Airflow
C = Convertible

DIGIT 4,5,6 – Nominal Gross Cooling Capacity (MBh)
072 = 6 Ton
074 = 6 Ton (Title 24 compliant)
092 = 7.5 Ton
102 = 8.5 Ton
120 = 10 Ton

DIGIT 7 – Major Design Sequence
E = R–410A Refrigerant
F = Microchannel Type Condenser Coils Coils (1)

DIGIT 8 –Unit Voltage
3 = 208–230/60/3
4 = 460/60/3

DIGIT 9 – Unit Controls
E = Electromechanical
R = ReliaTel™ Microprocessor

DIGITS 10 – Heating Capacity
0 = No Electric Heater
C = 9 kW
G = 18 kW
K = 27 kW
N = 36 kW
P = 54 kW

DIGIT 11 – Minor Design Sequence
A = First Sequence

DIGITS 12,13 – Service Sequence
** = First Sequence

DIGITS 14 – Fresh Air Selection
0 = No Fresh Air
A = Manual Outside Air Damper 0–50% (2)
B = Motorized Outside Air Damper 0–50% (3)
C = Economizer, Dry Bulb 0–100% without Barometric Relief (5)
D = Economizer, Dry Bulb 0–100% with Barometric Relief (5)
E = Economizer, Reference Enthalpy 0–100% without Barometric Relief (4) (5)
F = Economizer, Reference Enthalpy 0–100% with Barometric Relief (4) (5)
G = Economizer, Comparitive Enthalpy 0–100% without Barometric Relief (4) (5)
H = Economizer, Comparative Enthalpy 0–100% with Barometric Relief (4) (5)
K = Low Leak Economizer with Barometric Relief
M = Low Leak Economizer with Reference Enthalpy with Barometric Relief
P = Low Leak Economizer with Comparative Enthalpy with Barometric Relief

DIGIT 15 – Supply Fan/Drive Type/Motor
0 = Standard Drive (6)
1 = Oversize Motor
6 = Single Zone VAV (7) (8)
7 = Multi–Speed Indoor Fan (9)
E = VAV Supply Air Temperature Control Standard Motor (8)

DIGIT 16 – Hinged Service Access
0 = Standard Panels/Standard Filters
A = Hinged Access Panels/Standard Filters
B = Standard Panels/2" MERV Filters
C = Hinged Access Panels/2" MERV Filters
D = Standard Panels/2" MERV 13 Filters
E = Hinged Access Panels/2" MERV 13 Filters

DIGIT 17 – Condenser Coil Protection
0 = Standard Coil
1 = Standard Coil with Hail Guard
2 = Black Epoxy Pre–Coated Condenser Coil (10)
3 = Black Epoxy Pre–Coated Condenser Coil with Hail Guard (10)
4 = CompleteCoat™ Condenser Coil
5 = CompleteCoat™ Condenser Coil with Hail Guard

See Model Number Notes graphic for explanation of Notes (1) to (27)

Model Number Notes

75009423 REV C

THC Packaged Cooling

1. Optional on THC072, Standard on THC074F to THC120F.
2. Manual outside air damper will ship factory supplied within the unit, but must be field installed.
3. Motorized Outside Air Damper is not available on Multi–Speed or SZVAV (Single Zone Variable Air Volume) products.
4. Not available with electromechanical controls
5. Economizer with Barometric Relief is for downflow configured units only. Order Economizer without Barometric Relief for horizontal configuration. Barometric Relief for horizontal configured units must be ordered as field installed accessory.
6. THC072E,072F – Belt Drive Standard, 15=1 Optional.
   THC074F,092E,092F,102E,102F,120E,120F – Ultra High Efficiency Direct Drive Plenum Fan is standard.
7. Single Zone VAV is only available on THC074–THC120 units with ReliaTel Controls.
8. Discharge Air Sensing is also standard equipment on units with Single Zone and Supply Air Temperature Control VAV.
9. Multi–speed indoor fan available only on THC074–THC120 units with ReliaTel Controls.
10. Epoxy coil and epoxy with hailguard options are not available for units with microchannel condenser coil.
11. Through the base electric required when ordering disconnect/circuit breaker options.
12. Requires use of Disconnect or Circuit Breaker.
13. Novar is not available with SZVAV products.
14. Standard metering devices are TXVs.
15. Requires selection of 2" Pleated Filters (16=B or C)
16. Frostat cannot be field installed in electromechanical units.
17. High Pressure Control is standard on all units.
18. Frostat standard on Multi–Speed and SZVAV (Single Zone Variable Air Volume).
19. Crankcase heaters are standard.
20. Not available with high temperature duct sensor accessory.
21. Return Air Smoke Detector cannot be ordered with Novar Controls.
22. The return air smoke detector may not fit up or work properly on the Precedent units when used in conjunction with 3rd party accessories such as bolt on heat wheels, economizers and power exhaust. Do not order the return air smoke detectors when using this type of accessory.
23. These options are standard when ordering Novar Controls.
24. This option is used when ordering Novar Controls.
25. Novar Sensor untilized with Digit 21=(4) Novar 3051 Controls without Zone Sensor.
26. Demand Control Ventilation Option includes wiring only. The CO_2 sensor is a field–installed only option.
27. Demand Control Ventilation Option not available with electromechanical controls.

Part No.	Reference No.	Quantity	Description
BAYHSMT402A	*	1	OVERSIZED MOTOR KIT; 2 HP OS MOTOR, 208-230/460/60/3
BAYHTRU309A	*	1	ELECTRIC HEATER; 208/230-240/60/3, 9KW
BAYHTRU317A	*	1	NO DESCRIPTION AVAILABLE
BAYHTRU318A	*	1	ELECTRIC HEATER; 208/230-240/60/3, 18KW
BAYHTRU336A	*	1	ELECTRIC HEATER; 208/230-240/60/3, 18/18KW
BAYLMSW001A	*	1	POWER EXHAUST LIMIT SWITCH
BAYRTEM001A	*	1	RELIATEL ECONOMIZER LOGIC MODULE
BRD03177	*	1	RELIATEL COMMUNICATION INTERFACE; COMM3 & 4 PACKAGE UNITS (BAYICSI003AD) RTCI - FIELD KIT
CNT04875	*	1	CONTROL; EVAPORATOR DEFROST KIT (FROSTAT) (BAYLOAM020BB). (OPTIONS BOARD KIT09433-BAYABRD001CA MUST BE INSTALLED IN THE UNIT FOR THIS ACCESSORY TO OPERATE).
CRB00172	*	1	CURB; ADAPTA CURB (BAYQACB011AA), TRANSITIONS BAYCURB022B, 83.50 X 49.375
CRB00173	*	1	CURB; ADAPTA CURB (BAYQACB012AA), TRANSITIONS BAYCURB025B, 90.50 X 60.625
CRB00174	*	1	CURB; ADAPTA CURB (BAYQACB013AA), TRANSITIONS BAYCURB026B, 103.375 X 68.125
CRB00176	*	1	CURB; ROOFCURB (BAYCURB043AB)
DMP02176	*	1	DAMPER; 0-50% MANUAL OUTSIDE AIR DAMPER (BAYDMPR056BA)
DMP02840	*	1	DAMPER; BAROMETRIC RELIEF (BAYBARM011AB)
DMP02957	*	1	DAMPER; RELIATEL, 0-50 PERCENT MOTORIZED OUTSIDE AIR DAMPER (BAYDMPR054A)
ECN00123	*	1	ECONOMIZER; RELIATEL, 0-100% DRY BULB (BAYECON087A)
GRD01612	*	1	GUARD; HAIL GUARD ACCESSORY (BAYGARD041BB)
KIT09221	*	1	KIT; RETURN AIR SMOKE DETECTOR (AN OPTIONS BOARD KIT09099 BAYABRD001BA MUST BE INSTALLED IN THE UNIT FOR THIS ACCESSORY KIT TO OPERATE)
KIT09222	*	1	KIT; SUPPLY AIR SMOKE DETECTOR (AN OPTIONS BOARD KIT09099 BAYABRD001BA MUST BE INSTALLED IN THE UNIT FOR THIS ACCESSORY KIT TO OPERATE)
KIT09433	*	1	KIT; ACCESSORY, OPTIONS BOARD (BAYABRD001CA)
KIT09457	*	1	KIT; 7.5, 8.5 TON LOW STATIC DRIVE (BAYLSDR009AA)
KIT09500	*	1	LCIR W/ SHORT HARNESS 3-10 TON PACKAGE UNITS (HARNESS = WIR03458) LCI-R SHORT KIT
KIT13704	*	1	KIT; FAN FAILURE SWITCH (BAYDFPS004AB). (OPTIONS BOARD KIT09433-BAYABRD001CA MUST BE INSTALLED IN THE UNIT FOR THIS ACCESSORY TO OPERATE).
KIT13710	*	1	KIT; DISCHARGE AIR SENSING (BAYTUBE007A). (OPTIONS BOARD KIT09433-BAYABRD001CA MUST BE INSTALLED IN THE UNIT FOR THIS ACCESSORY TO OPERATE).
KIT13711	*	1	KIT; VENTILATION OVERIDE (BAYVNOR001BB) (OPTIONS BOARD KIT09433-BAYABRD001CA MUST BE INSTALLED IN THE UNIT FOR THIS ACCESSORY TO OPERATE).
KIT15159	*	1	KIT; CO2 SENSING (BAYCO2K001B)
KIT15160	*	1	KIT; CO2 DEMAND-CONTROLLED VENTILATION DUCT SENSOR (BAYCO2K003B)
KIT15161	*	1	KIT; REFERENCE ENTHALPY (BAYENTH005A)
KIT15162	*	1	KIT; COMPARATIVE ENTHALPY (BAYENTH006B)
KIT15163	*	1	KIT; POWER EXHAUST, 208/230V (BAYPWRX026A)
KIT16226	*	1	KIT; AUTOMATIC BELT TENSIONER FOR PRECEDENT UNITS. INCLUDES INSTALLATION INSTRUCTIONS (PART-SVN134A-EN) AND ALIGNMENT TOOL.
PLT02562	*	1	PLATE, SENSOR MOUNTING (BAYMTPL004AA)
PLT03127	*	1	PLATE; COMBINED MOUNTING PLATE AND ADAPTER PLATE (BAYMTPL003BA)
SEN00278	*	1	SENSOR; THERMISTOR PROBE, -40 DEG C TO 65 DEG, STRIPPED LEADS (BAYSENS016AA)
SEN00408	*	1	SENSOR; ZONE STAT, LEVEL 2, NON-HEAT PUMP (BAYSENS008BB), DUAL SETPOINT MANUAL OR AUTO CHANGEOVER
SEN00410	*	1	SENSOR; ZONE STAT ASSEMBLY (BAYSENS006BA), SINGLE SETPOINT MANUAL CHANGEOVER

Part No.	Reference No.	Quantity	Description
SEN00413	*	1	SENSOR; ZONE STAT ASSEMBLY (BAYSENS010BB), DUAL SETPOINT MANUAL OR AUTO CHANGEOVER WITH SYSTEM FUNCTION LIGHTS
SEN00435	*	1	SENSOR; ZONE LEVEL 4 (BAYSENS017BB) REMOTE ROOM SENSOR
SEN00495	*	1	SENSOR; ZONE LEVEL 4 (BAYSENS013CA) ROOM SENSOR W/ OVERRIDE AND CANCEL BUTTONS
SEN00496	*	1	SENSOR; ZONE LEVEL 4 (TRANE). (BAYSENS014CA) ROOM SENSOR W/ TEMP. ADJUSTMENT WITH OVERRIDE AND CANCEL BUTTONS
SEN01120	*	1	SENSOR; REMOTE ZONE, DUAL THERMISTOR (BAYSENS032AA)
SEN01127	*	1	SENSOR; REMOTE WALL (BAYSENS033AA)
SEN01128	*	1	SENSOR; TEMPERATURE (BAYSENS034AA), RETURN AIR REMOTE TEMPERATURE SENSOR
SEN01130	*	1	SENSOR; DIGITAL ZONE (BAYSENS035AB), DIGITAL DISPLAY ZONE SENSOR
SEN01195	*	1	SENSOR; HUMIDITY ZONE, WALL MOUNTED, TRANE (BAYSENS036A)
SEN01196	*	1	SENSOR; HUMIDITY ZONE, DUCT MOUNTED, TRANE (BAYSENS037A)
SEN01289	*	1	SENSOR; PROGRAMMABLE ZONE, CONSTANT VOLUME/HEAT PUMP (BAYSENS019CA)
SEN01447	*	1	SENSOR; ZONE, ROOM SENSOR W/TEMP. ADJUSTMENT WITH OVERRIDE AND CANCEL BUTTONS, 10K, DIAL, OCCUPIED (BAYSENS074AA)
SEN01448	*	1	SENSOR; ZONE, REMOTE ROOM SENSOR, 10K (BAYSENS077AA)
SEN01450	*	1	SENSOR; ZONE, ROOM SENSOR W/ OVERRIDE AND CANCEL BUTTONS, 10K, OCCUPIED (BAYSENS073AA)
SEN01513	*	1	SENSOR; ZONE; DUAL SETPOINT MANUAL OR AUTO CHANGOVER, TWO SET FAN SYSTEM (BAYSENS108AA)
SEN01515	*	1	SENSOR;ZONE SINGLE SETPOINT MANUAL CHANGEOVER, SET FAN SYSTEM, COOL/OFF/HEAT (BAYSENS106A)
SEN01522	*	1	SENSOR; ZONE, DUAL SETPOINT MANUAL OR AUTO CHANGEOVER W/SYSTEM FUNCTION LIGHTS TWO SET FAN SYSTEM, LED (BAYSENS110A)
SEN01577	*	1	SENSOR; PROGRAMMABLE ZONE, AUTOMATIC OR MANUAL CHANGEOVER W/ SYSTEM LIGHTS TRANE (BAYSENS119AA)
THT00839	*	1	THERMOSTAT; REMOTE POTENTIOMETER, 60-90 DEG F (BAYSTAT023AA)
THT02239	*	1	THERMOSTAT; HIGH TEMPERATURE (BAYFRST001AA)
TOL00099	*	1	TOOL; RESISTANCE DECADE BOX