

# Modular timers 16 A

AUTOMATION

APEX



Control panels



Milk processing plant



Punches, cleaners, planers and sanders



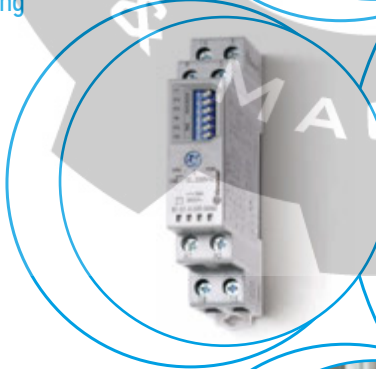
Hoists and cranes



Shipyards



Door and gate openers



**81**  
SERIES



**Multi-function and multi-voltage timer**



- One module 17.5 mm wide housing
- Seven functions (4 with supply start and 3 with control signal)
- Additional Reset function
- Six time ranges from 0.1 s to 10 h
- 35 mm rail (EN 60715) mounting

81.01

Screw terminal


**81.01**


- Multi-voltage (DC non polarized)
- Multi-function
- 35 mm rail (EN 60715) mounting

**AI:** On-delay**DI:** Interval**SW:** Symmetrical flasher (starting pulse on)**SP:** Symmetrical flasher (starting pulse off)**BE:** Off-delay with control signal**DE:** Interval with control signal on**EEb:** Interval with control signal off
 Wiring diagram  
 (supply START)

 Wiring diagram  
 (control signal)

For outline drawing see page 4

**Contact specification**

Contact configuration

1 CO (SPDT)

Rated current/Maximum peak current

A

16/30

Rated voltage/

Maximum switching voltage

V AC

250/400

Rated load AC1

VA

4000

Rated load AC15 (230 V AC)

VA

750

Single phase motor rating (230 V AC)

kW

0.55

Breaking capacity DC1: 30/110/220 V

A

16/0.3/0.12

Minimum switching load

mW (V/mA)

500 (10/5)

Standard contact material

AgCdO

**Supply specification**
Nominal voltage ( $U_N$ )

V AC (50/60 Hz)

12...230

V DC

12...230 (non polarized)

Rated power AC/DC

VA (50 Hz)/W

&lt; 2/&lt; 2

Operating range

V AC

10.8...250

V DC

10.8...250

**Technical data**

Specified time range

(0.1...1)s, (1...10)s, (10...60)s, (1...10)min, (10...60)min, (1...10)h

Repeatability

%

± 1

Recovery time

ms

≤ 50

Minimum control impulse

ms

50

Setting accuracy-full range

%

± 5

Electrical life at rated load in AC1

cycles

100 · 10<sup>3</sup>

Ambient temperature range

°C

-10...+50

Protection category

IP 20

Approvals (according to type)

## Ordering information

Example: 81 series, modular timer multi-voltage, 1 CO (SPDT) - 16 A, supply rated at (12...230)V AC/DC.

**8 1 . 0 . 1 . 0 . 2 3 0 . 0 0 0 0**

**Series**

**Type**  
0 = Multi-function  
(AI, DI, SW, SP, BE, DE, EEb)

**No. of poles**  
1 = 1 CO (SPDT)

**Supply voltage**  
230 = (12...230)V AC/DC


**Supply version**  
0 = AC (50/60 Hz)/DC

## Technical data

### EMC specifications

Type of test	Reference standard		
Electrostatic discharge	contact discharge	EN 61000-4-2	4 kV
	air discharge	EN 61000-4-2	8 kV
Radio-frequency electromagnetic field (80 ÷ 1000 MHz)		EN 61000-4-3	10 V/m
Fast transients (burst) (5-50 ns, 5 kHz) on Supply terminals		EN 61000-4-4	4 kV
Surges (1.2/50 µs) on Supply terminals	common mode	EN 61000-4-5	4 kV
	differential mode	EN 61000-4-5	4 kV
Radio-frequency common mode (0.15 ÷ 80 MHz) on Supply terminals		EN 61000-4-6	10 V
Radiated and conducted emission		EN 55022	class A

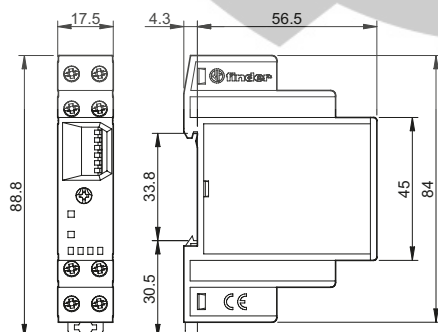
### Other data

Current absorption on signal control (B1)	< 1 mA (S-X)		< 1 mA (R-X)
Voltage potential on the input terminal R - X and S - X	Not galvanic separation from the supply voltage on A1 - A2		
Power lost to the environment	without contact current W	1.3	
	with rated current W	3.2	
 Screw torque	Nm	0.8	
Max. wire size		solid cable	stranded cable
	mm²	1 x 6 / 2 x 4	1 x 4 / 2 x 2.5
	AWG	1 x 10 / 2 x 12	1 x 12 / 2 x 14





































## Outline drawings

Type 81.01

Screw Terminal










## Time range setting

	(0.1...1)s	(1...10)s	(10...60)s	(1...10)min	(10...60)min	(1...10)h
1						
2						
3						
4						
5						
6						

NOTE: time range and function must be set before energising the timer.

## Functions

- U** = Supply voltage  
**S** = Signal switch  
**R** = Reset  
 = Output contact


LED (green)	LED (red)	Supply voltage	NO output contact	Contacts	
				Open	Closed
		OFF	Open	15 - 18	15 - 16
		ON	Open	15 - 18	15 - 16
		ON	Closed	15 - 16	15 - 18

Supply Start = Start via contact in supply line (A1).

Control signal = Start via contact into control terminal (X-S).


## Wiring diagram

## Supply START




**\*\* Connection of the Reset (R-X) is optional**

## Control signal




\* Terminals R, S & X must not be directly connected to the timer supply voltage, but they should be considered to be at supply voltage for the purposes of insulation.


**\*\* Connection of the Reset (R-X) is optional**

**(AI) On-delay.**


Apply power to timer. Output contacts transfer after preset time has elapsed. Reset occurs when power is removed.

**(DI) Interval.**

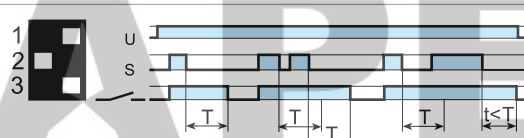
Apply power to timer. Output contacts transfer immediately. After the preset time has elapsed, contacts reset.

**(SW) Symmetrical flasher (starting pulse on).**

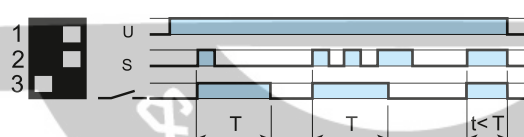
Apply power to timer. Output contacts transfer immediately and cycle between ON and OFF for as long as power is applied. The ratio is 1:1 (time on = time off).

**(SP) Symmetrical flasher (starting pulse off).**

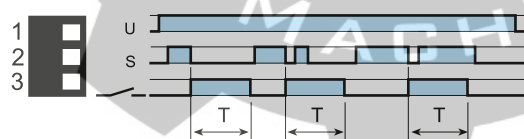
Apply power to timer. First transfer of contact occurs after preset time has elapsed. The timer now cycles between OFF and ON as long as power is applied. The ratio is 1:1 (time on = time off).

**(BE) Off-delay with control signal.**

Power is permanently applied to the timer. The output contacts transfer immediately on closure of the Signal Switch (S). Opening the Signal Switch initiates the preset delay, after which time the output contacts reset.

**(DE) Interval with control signal on.**

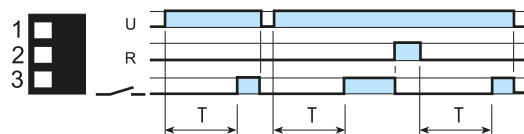
Power is permanently applied to the timer. On momentary or maintained closure of Signal Switch (S), the output contacts transfer, and remain so for the duration of the preset delay, after which they reset.

**(EEb) Interval with control signal off.**

Power is permanently applied to the timer. On opening of the Signal Switch (S) the output contacts transfer, and remain so for the duration of the preset delay, after which they reset.

## RESET function (R)

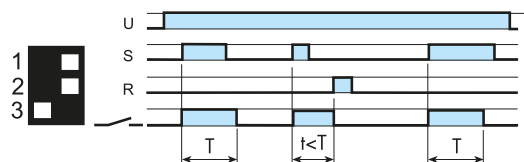
For each and every function and time range, the timer is immediately reset when the reset switch is closed.



Example:

Supply START; ON delay function

**Closing the external reset switch immediately resets the timer. Opening the reset switch re-initiates the timing function.**



Example:

Control signal; ON pulse function.

**Closing the external reset switch terminates the interval time and resets the timer. To re-start, it is necessary to open the reset switch, before closing the control signal contact.**


## Accessories



019.01

Identification tag, for type 81.01, plastic, 1 tag, 17 x 25.5 mm

019.01



060.48

Sheet of marker tags (CEMBRE Thermal transfer printers) for type 81.01, plastic,  
48 tags, 6 x 12 mm

060.48

