


ADDITIONAL TURNOUTS SHALL BE PROVIDED AT 200 FT. INTERVALS

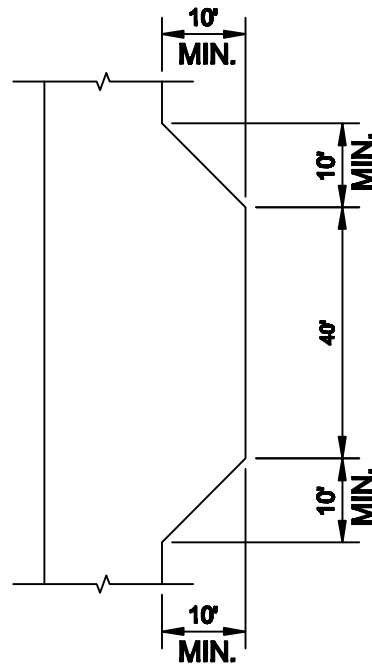

NOTE: PRESCRIBED PAVING WIDTHS DO NOT ALLOW FOR ROADSIDE PARKING. VERTICAL CLEARANCE ABOVE ACCESS SHALL BE MAINTAINED AT 13½ FT. MINIMUM.

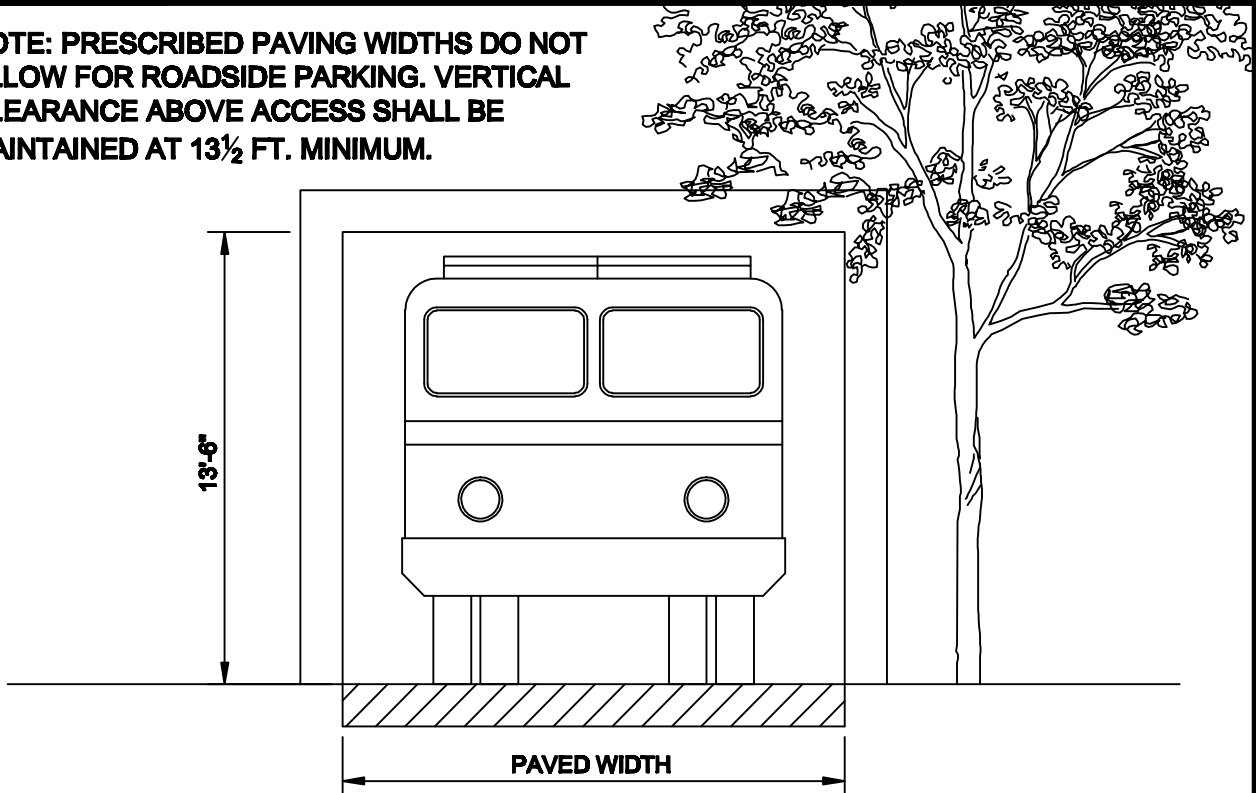


FIGURE: 3-2

TURNOUTS / VERTICAL CLEARANCE

MONTECITO FIRE DEPARTMENT