

EXAMPLE:

**ELEVATED WATER TANK WITH AUTOMATIC REFILL
DEVICE, 5,000 GALLONS MINIMUM CAPACITY.
DOMESTIC STORAGE OUTLET SHALL BE LOCATED
ABOVE THE 5,000 GALLON MINIMUM CAPACITY.**

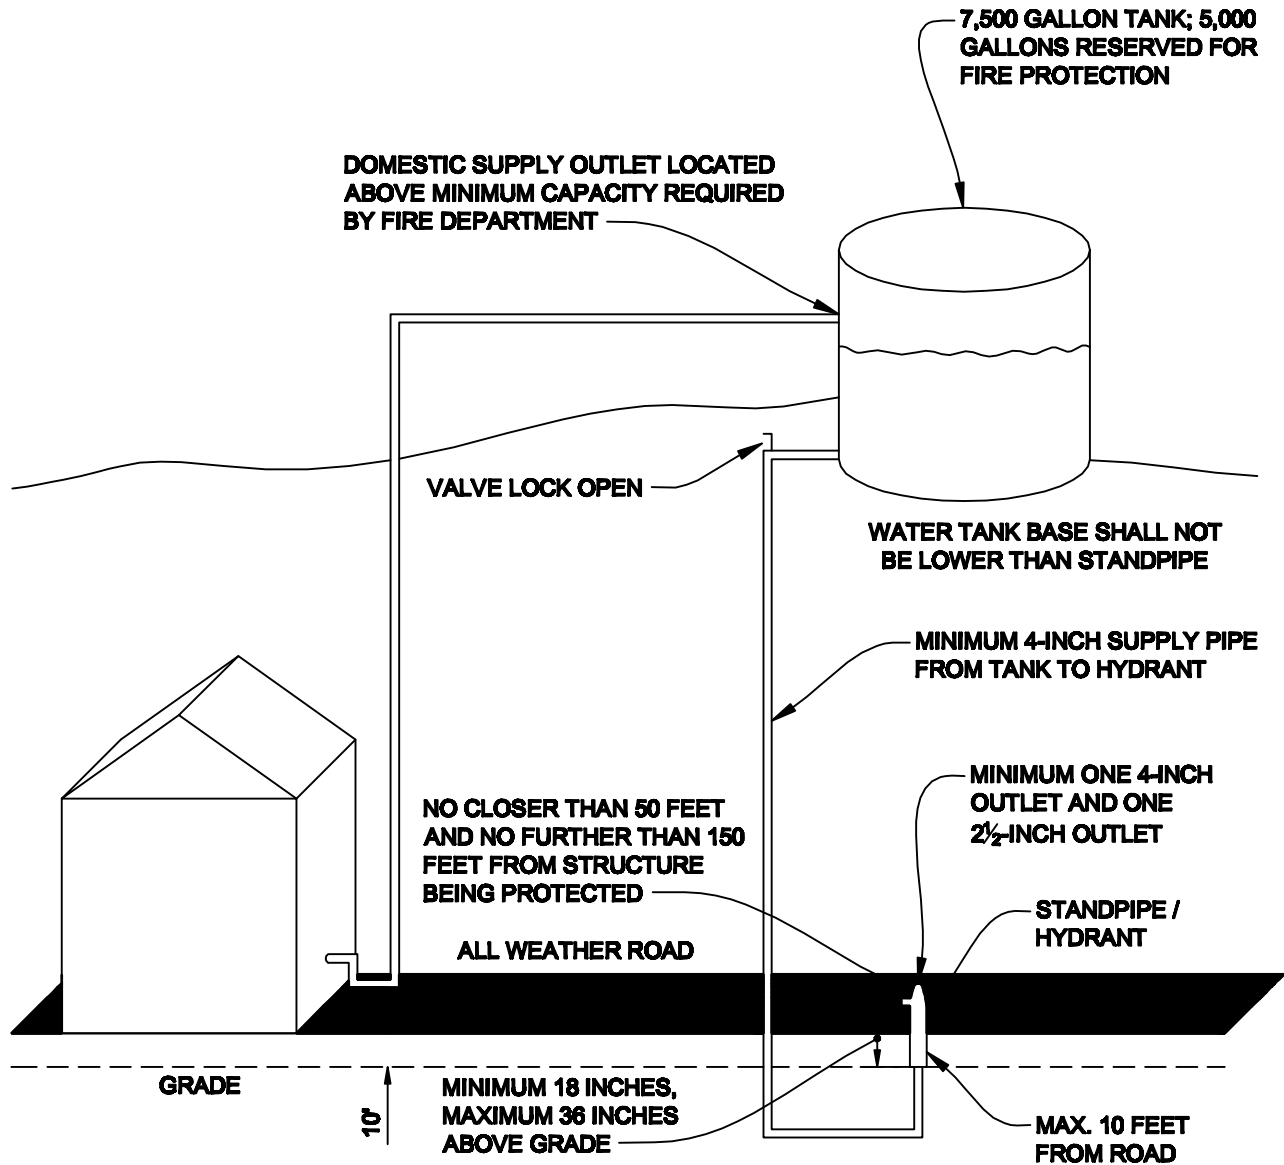


FIGURE: 4b-1

**SINGLE TANK SUPPLYING FIRE
PROTECTION AND DOMESTIC USE**

**MONTECITO FIRE
DEPARTMENT**