


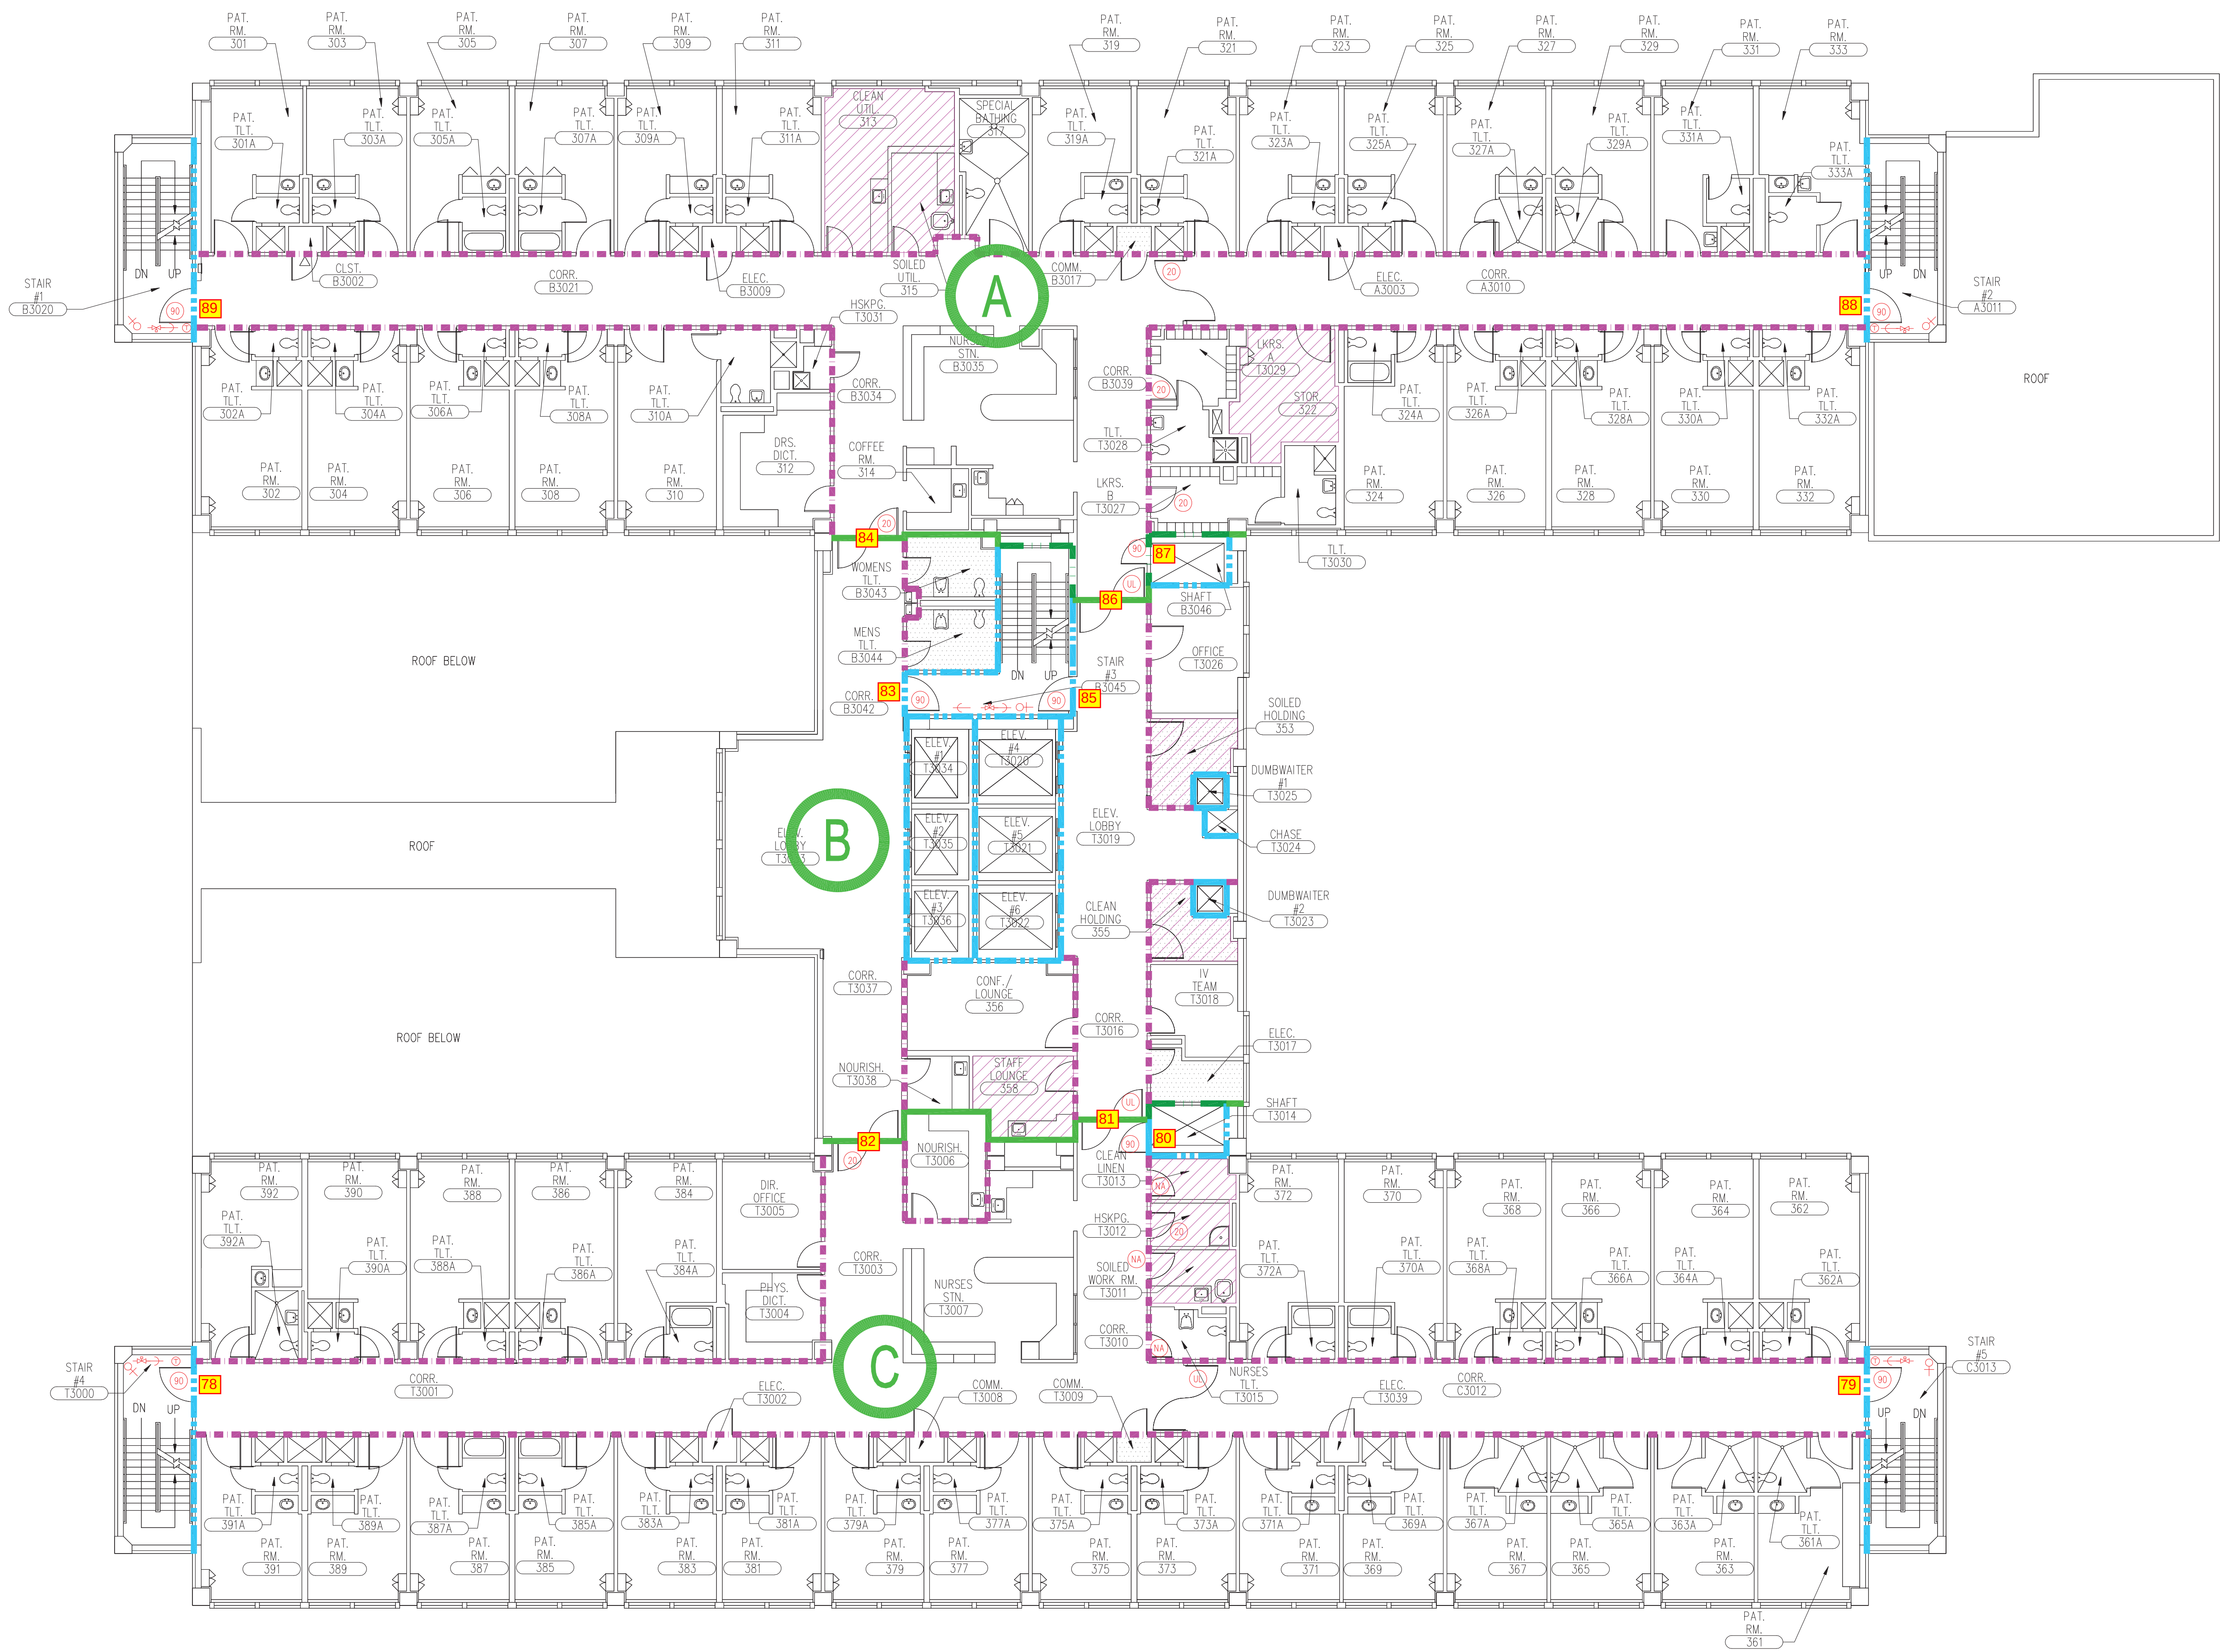

SMOKE ZONES

A

 = 9,800 SQ. FT.


B

 = 2,500 SQ. FT.

C

 = 9,800 SQ. FT.

DOCTORS HOSPITAL AT WHITE ROCK LAKE
MAIN FACILITY
THIRD FLOOR

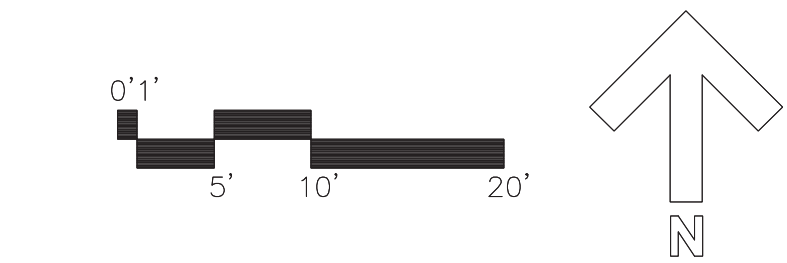

LIFE SAFETY LEGEND	
	SMOKE TIGHT
	SMOKE BARRIER
	1-HR. ENCLOSURE
	2-HR. ENCLOSURE
	2-HR. FIRE/SMOKE
	SUITE BOUNDARY
	HAZARDOUS ROOM

FIRE VALVE LEGEND	
	FIRE HYDRANT
	HOSE CONNECTIONS, STANDPIPE
	FIRE PUMP
	ALARM CHECK VALVE
	FLOW ALARM
	CHECK VALVE
	GATE VALVE
	OS&Y VALVE (OPEN SCREW & YOKE)
	INSPECTOR'S TEST
	ZONE VALVE - W/ TAMPER SWITCH

	FIRE EXTINGUISHER CABINET
	FIRE HOSE CABINET
	FIRE DOOR RATING (IN MINS.)
	FIRE DOOR RATING NOT LEGIBLE
	FIRE DOOR RATING NOT ACCESSIBLE
	FIRE DOOR RATING NOT LABELED
	FIRE DOOR NOT RATED
	HARD CEILING

AREA COULD NOT BE ACCESSED DURING ATG SURVEY

"NFPA 101 CHAPTER 19 APPLICABLE UNLESS OTHERWISE NOTED"