


3/8" & 1/2"


Materials/Finishes	Plain Ductile Iron: (62B)	Electro-Galvanized: (62G)
Variants:	N/A	
Service:	Designed to attach hanger rod to the top or bottom flange of a beam or bar joist where flange thickness does not exceed 5/8 of an inch.	
Approvals:	U.L. - U.L.C. listed 3/8 and 1/2 (1/2 for 4" IPS max). FM approved for 3/8 only. Complies with Federal Specification A-A-1192 A (Type# 19) and Manufacturers' Standardization Society MSS SP-58 and SP-69 (Type# 19).	
Ordering:	Specify figure number, finish and rod size.	
Notes:	Set screw is of hardened steel. See MSS SP-69 for proper set screw recommendations. Stainless steel beam clamps are recommended for corrosive environments.	

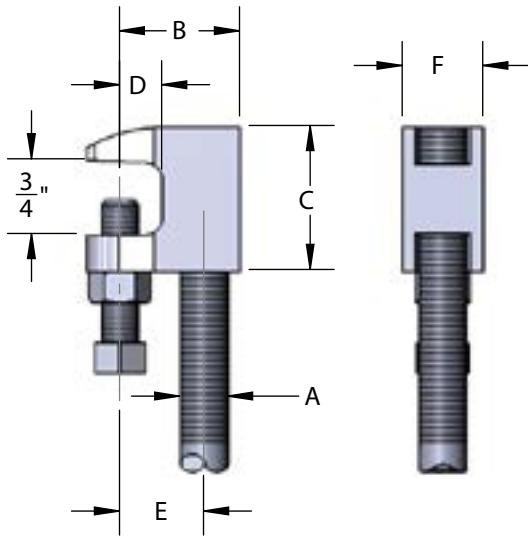

ROD SIZE A	SET SCREW	B	C	D	E	F	MAX PIPE SIZE	WGT EACH (lbs)	MAX REC LOAD (lbs) INVERTED	MAX REC LOAD (lbs) STANDARD
3/8-16 1/2-13	3/8-16 3/8-16	1-5/16 1-5/16	1-1/2 1-1/2	1/2 1/2	1 1	7/8 7/8	4 4	0.320 0.320	610 750	610 1130

PROJECT INFORMATION			APPROVAL STAMP
Project:			Notes:
Address:			
Contractor:			
Engineer:			
Date:			
Approved	Approved as Noted	Not Approved	